


| <i>Source Exists</i> | <i>Source is Active</i> | <i>Maximum Magnitude</i> | <i>Average Repeat Time</i> |
|--------------------------|-----------------------------|------------------------------|------------------------------------|
|--------------------------|-----------------------------|------------------------------|------------------------------------|

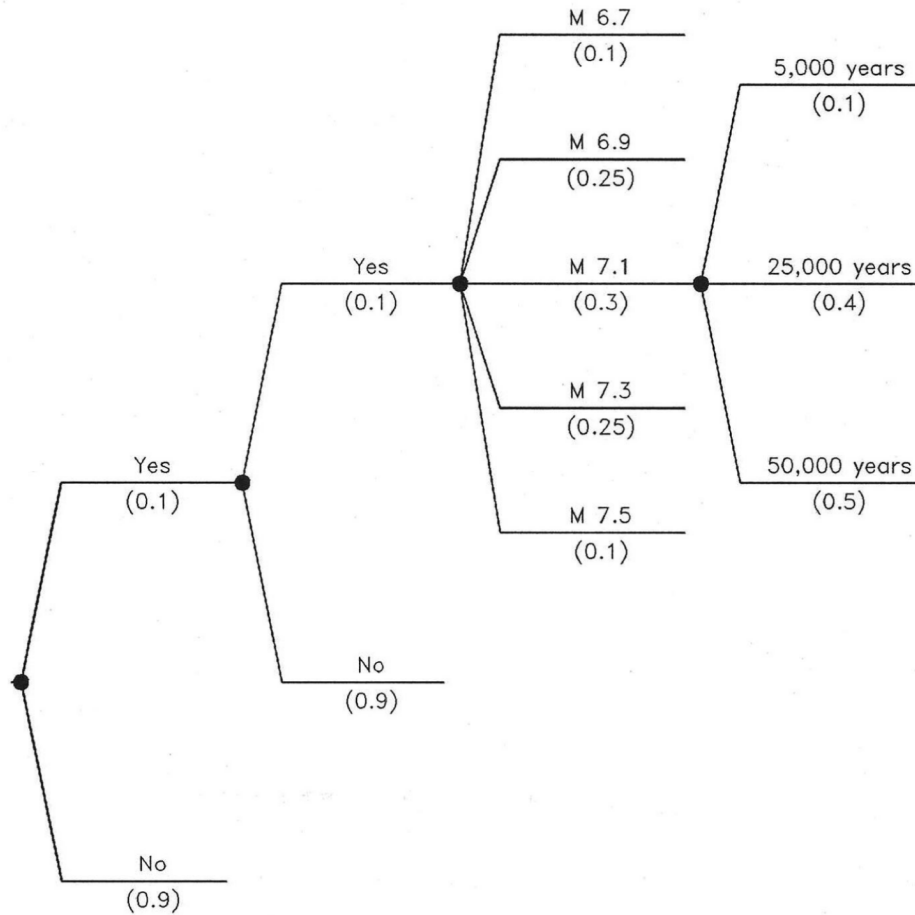

Progress Energy Carolinas

**Shearon Harris Nuclear Power Plant
Units 2 and 3
Part 2, Final Safety Analysis Report**

New Hill, North Carolina

Logic Tree for East Coast Fault System
Central and Northern Sources

FIGURE 2.5.2-215

Rev. 0