


Well Identification	Bedrock Water Level Elevation (feet NGVD29)
ADP-21A	218.48
ADP-23	236.51
LP-2	255.46
LP-5	249.03
LP-6	246.12
LP-7	245.91
LP-9	223.44
LP-13/GW-57	238.30
LP-16	226.96
MWA-1D	253.40
MWA-2D	251.89
MWA-3D	254.53
MWA-4D	256.42
MWA-5D	251.56
MWA-7D	269.74
MWA-8D	249.28
MWA-9D	248.59
MWA-10D	252.73
MWA-12	234.80
MW-1 (LF)	252.58
MW-2 (LF)	259.99
MW-3 (LF)	260.70
MW-6 (LF)	251.80
MW-7 (LF)	> 275.21
W-5	242.71
W-5A	241.01
W-8A/GW-58	239.87
W-9A/GW-60	219.79
W-12	238.18
W-13/GW-59	227.44
W-14	252.16
W-15	228.88
WAD-1/GW-39	235.42

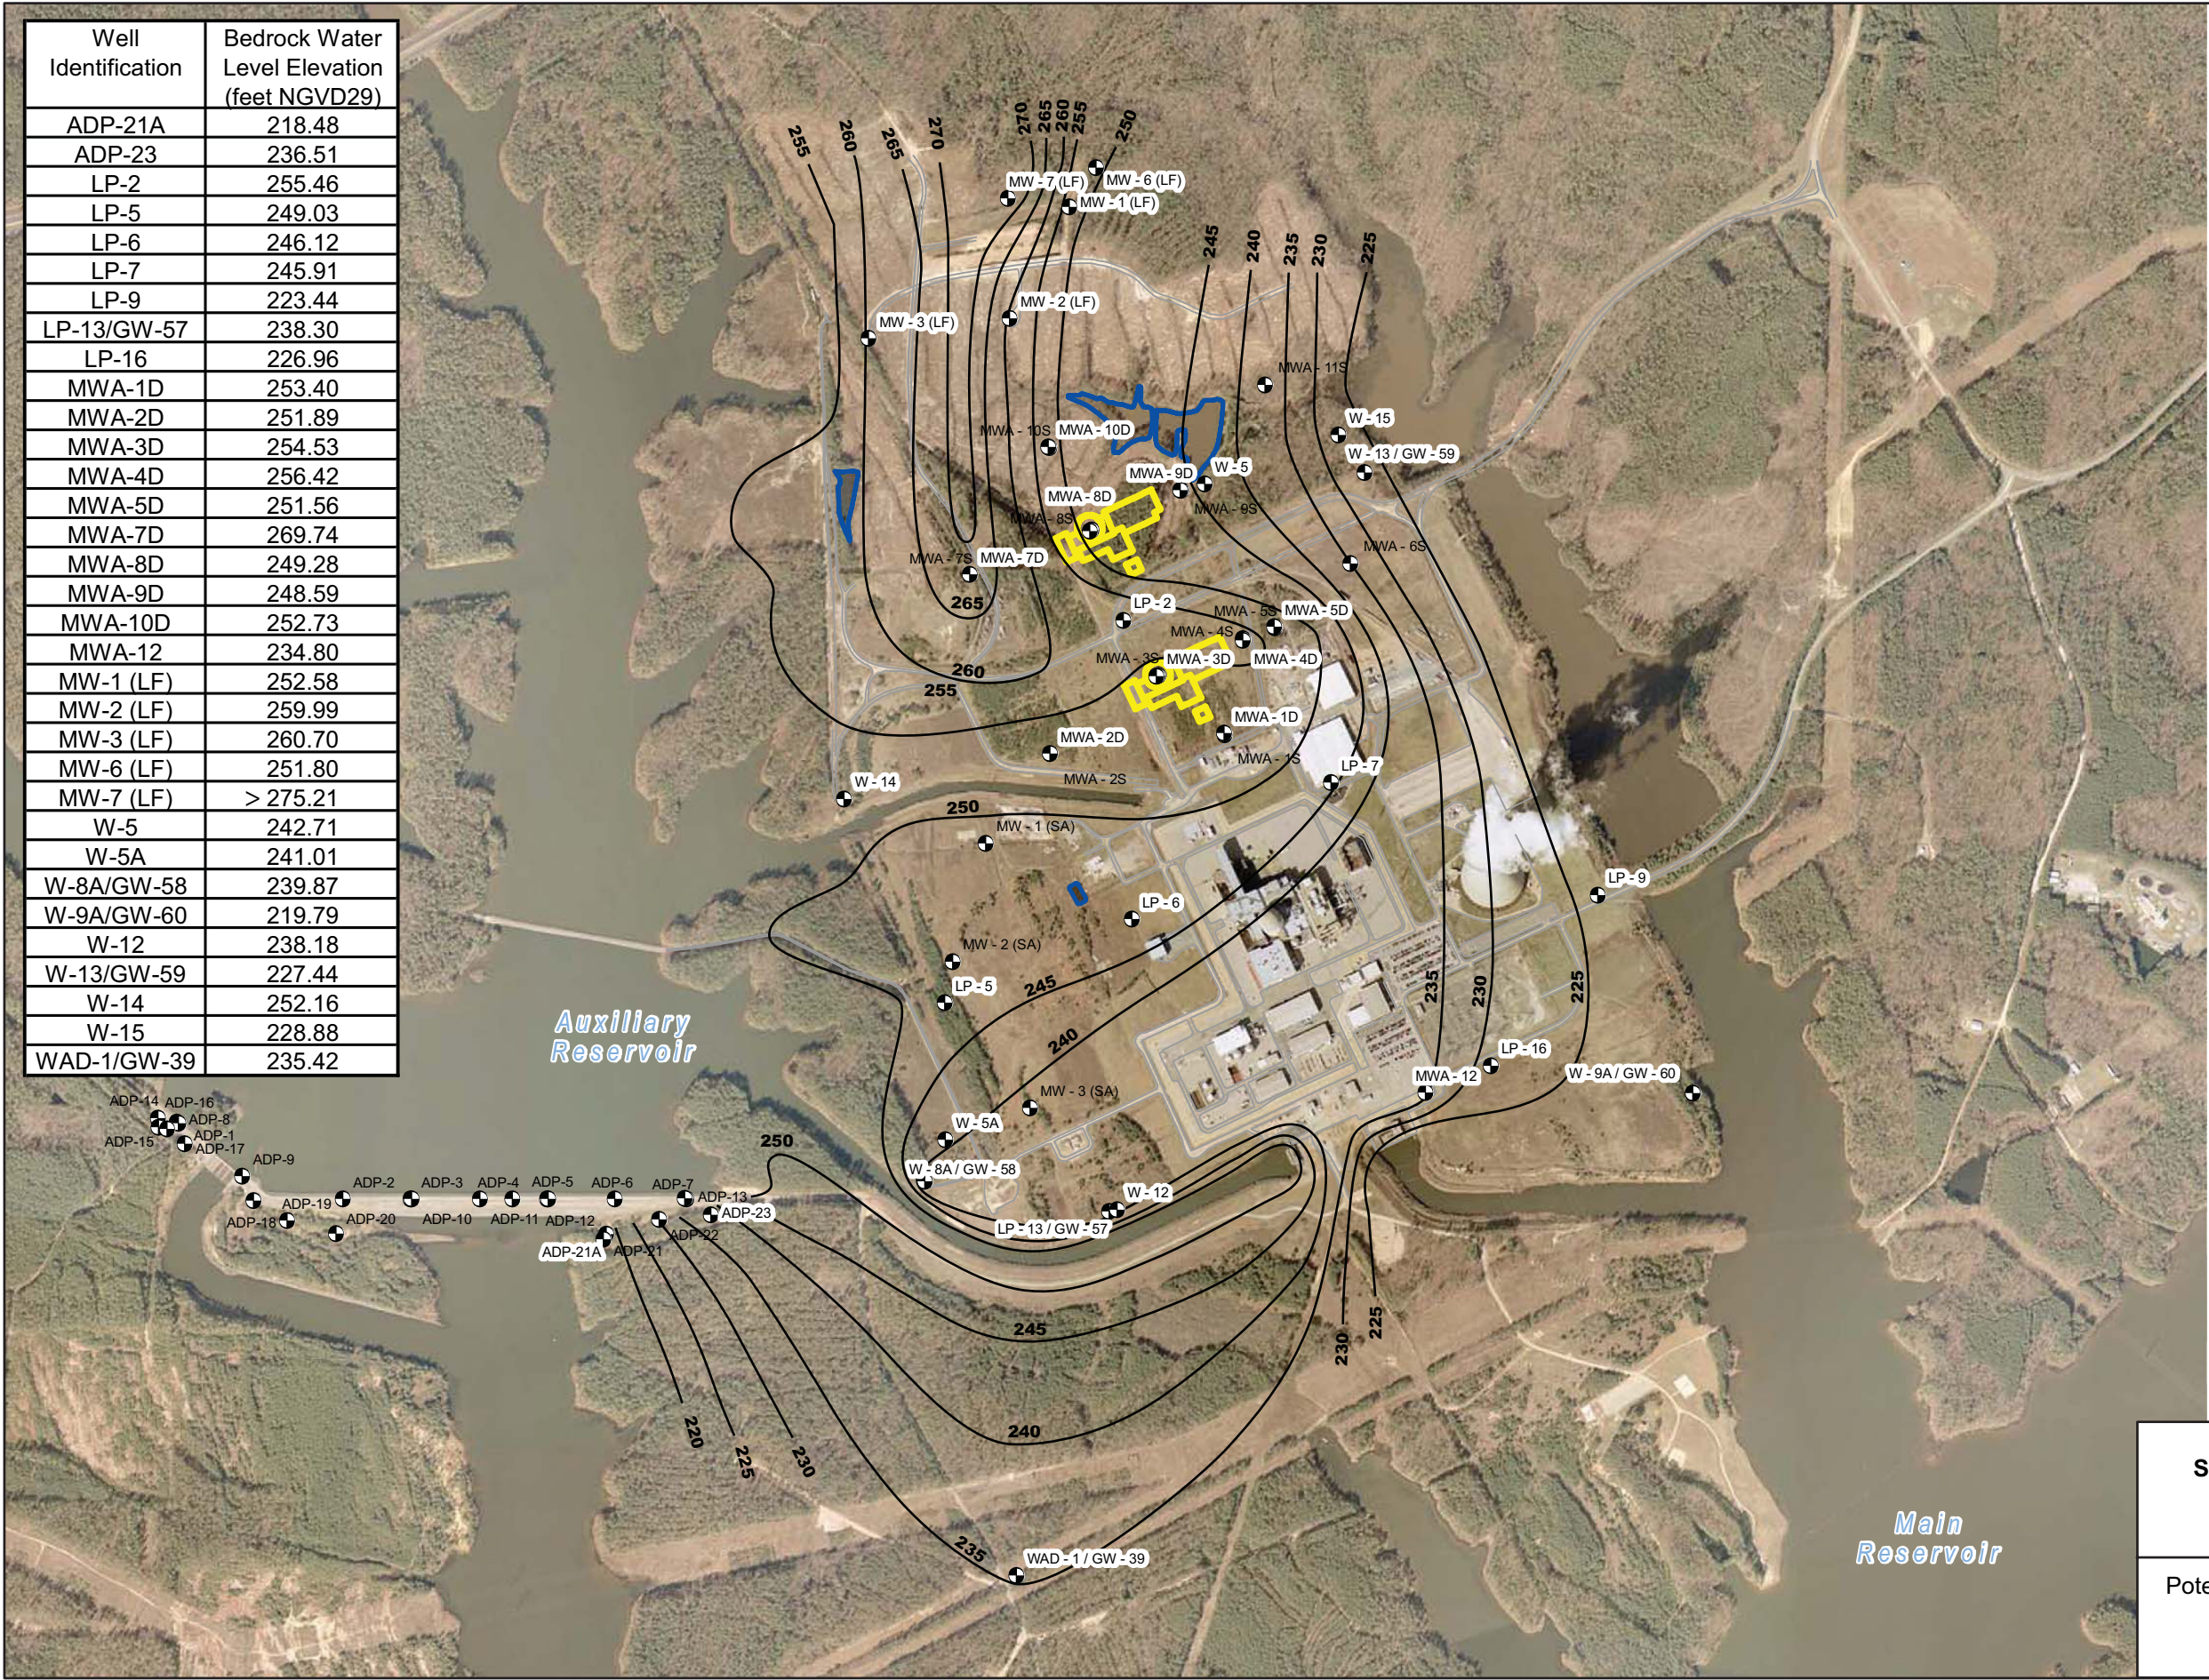


LEGEND

- Plant Site Monitoring Wells and Piezometers
- Proposed Safety-Related Structures
- Ponds
- LF Landfill

Note:

- 1) Main Reservoir also known as Harris Reservoir.
- 2) Auxiliary Reservoir normal pool elevation is 252 ft NGVD29.
- 3) Main Reservoir normal pool elevation is 220 ft NGVD29.
- 4) Water level in MW-7 exceeded the top of casing and therefore created artesian conditions.

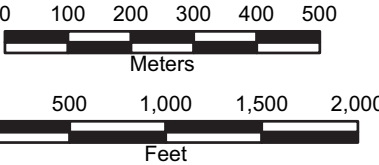

Progress Energy Carolinas
**Shearon Harris Nuclear Power Plant
Units 2 and 3**
Part 3, Environmental Report
New Hill, North Carolina

Potentiometric Surface Map of the Bedrock
Aquifer: May 29, 2007
FIGURE 2.3-28