

PLANT SYSTEMS

CONDENSATE STORAGE TANK

LIMITING CONDITION FOR OPERATION

3.7.1.3 The condensate storage tanks (CSTs) shall be OPERABLE with a contained volume of at least 144,000 gallons in T-121 and 280,000 gallons in T-120.

APPLICABILITY: MODES 1, 2 and 3.

ACTION:

With the condensate storage tanks inoperable, within 4 hours either restore the CSTs to OPERABLE status or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.

SURVEILLANCE REQUIREMENTS

4.7.1.3 The condensate storage tanks shall be demonstrated OPERABLE at least once per 12 hours by verifying the contained water volume is within its limits.

8208180053 820816
PDR ADOCK 05000361
P PDR

SAN ONOFRE-UNIT 2

3/4 7-6

ATTACHMENT "B"

PLANT SYSTEMS

CONDENSATE STORAGE TANK

LIMITING CONDITION FOR OPERATION

3.7.1.3 The condensate storage tanks (CSTs) shall be OPERABLE with a contained volume of at least 144,000* gallons in T-121 and 280,000 gallons in T-120.

APPLICABILITY: MODES 1, 2 and 3.

ACTION:

With the condensate storage tanks inoperable, within 4 hours either restore the CSTs to OPERABLE status or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.

SURVEILLANCE REQUIREMENTS

4.7.1.3 The condensate storage tanks shall be demonstrated OPERABLE at least once per 12 hours by verifying the contained water volume is within its limits.

* Prior to first achieving 100% power, the minimum volume required to be contained in T-121 is that shown on Figure 3.7-1 corresponding to the maximum power level achieved to date.

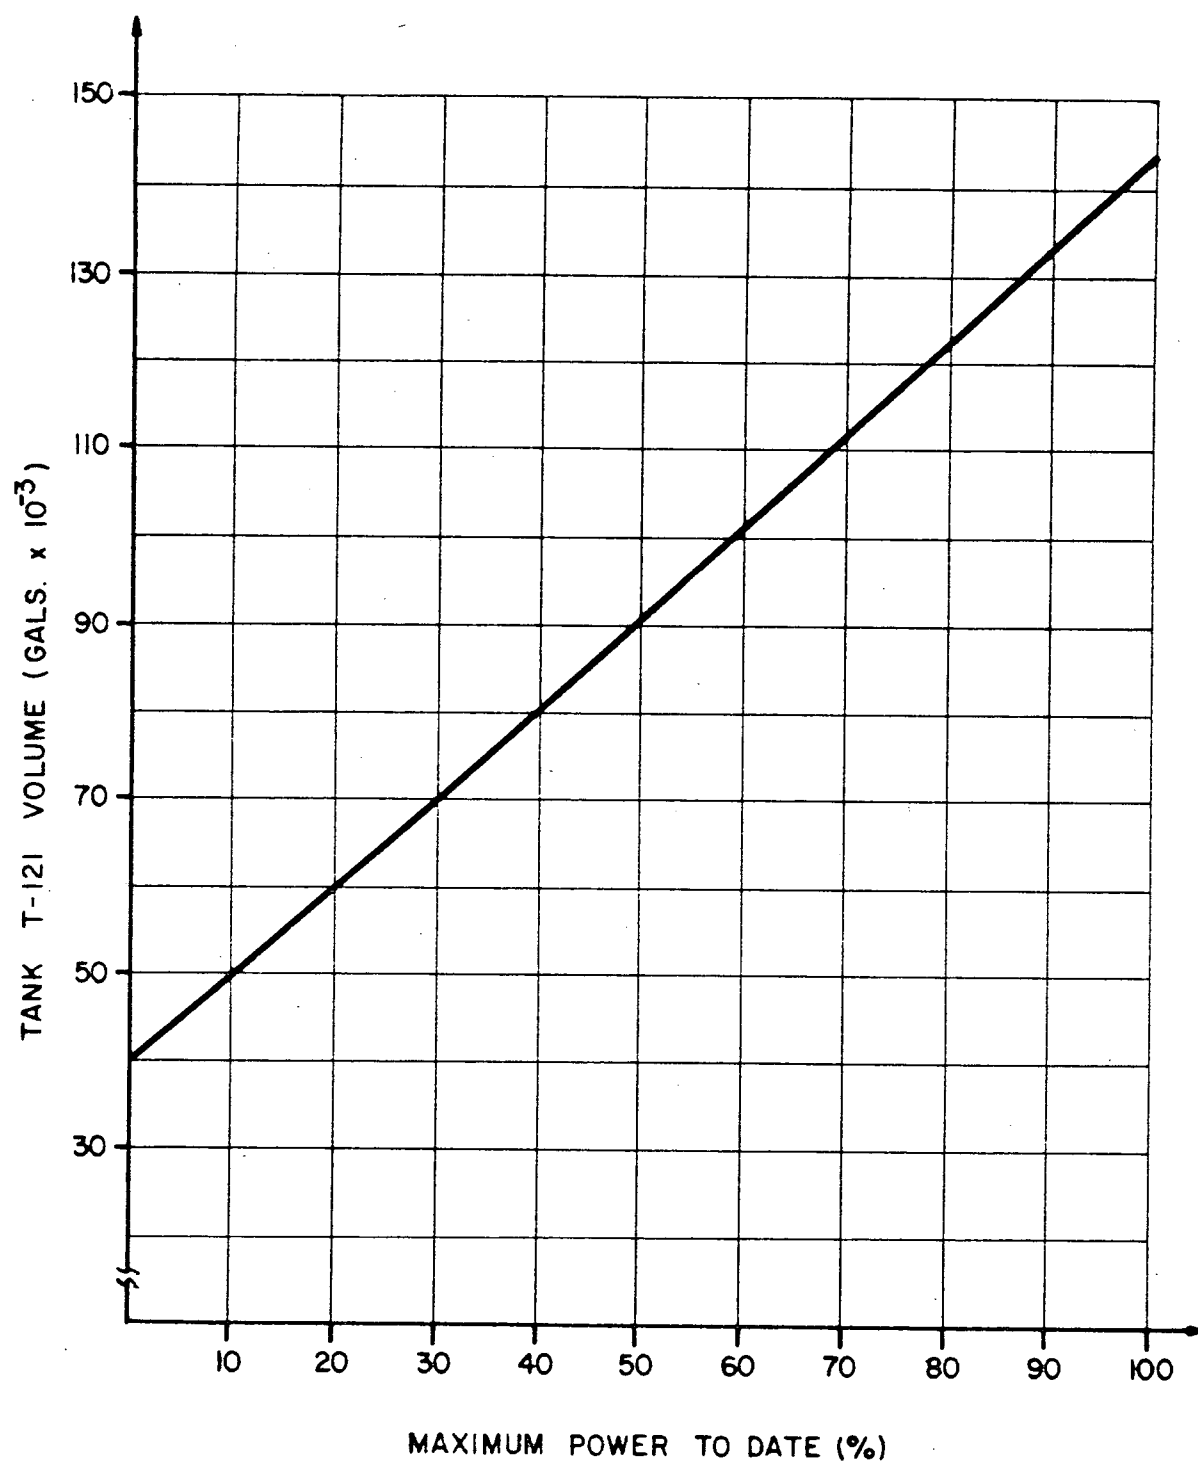


FIGURE 3.7.-1

MINIMUM REQUIRED FEEDWATER INVENTORY FOR TANK T-121 FOR MAXIMUM
POWER ACHIEVED TO DATE

SAN ONOFRE-UNIT 2

3/4 7-6A