


RETS MASTER FILE

LEFF-83A

# SAN ONOFRE NUCLEAR GENERATING STATION UNIT 1 SEMI ANNUAL EFFLUENT REPORT

JANUARY — JUNE 1983

SONGS - 1

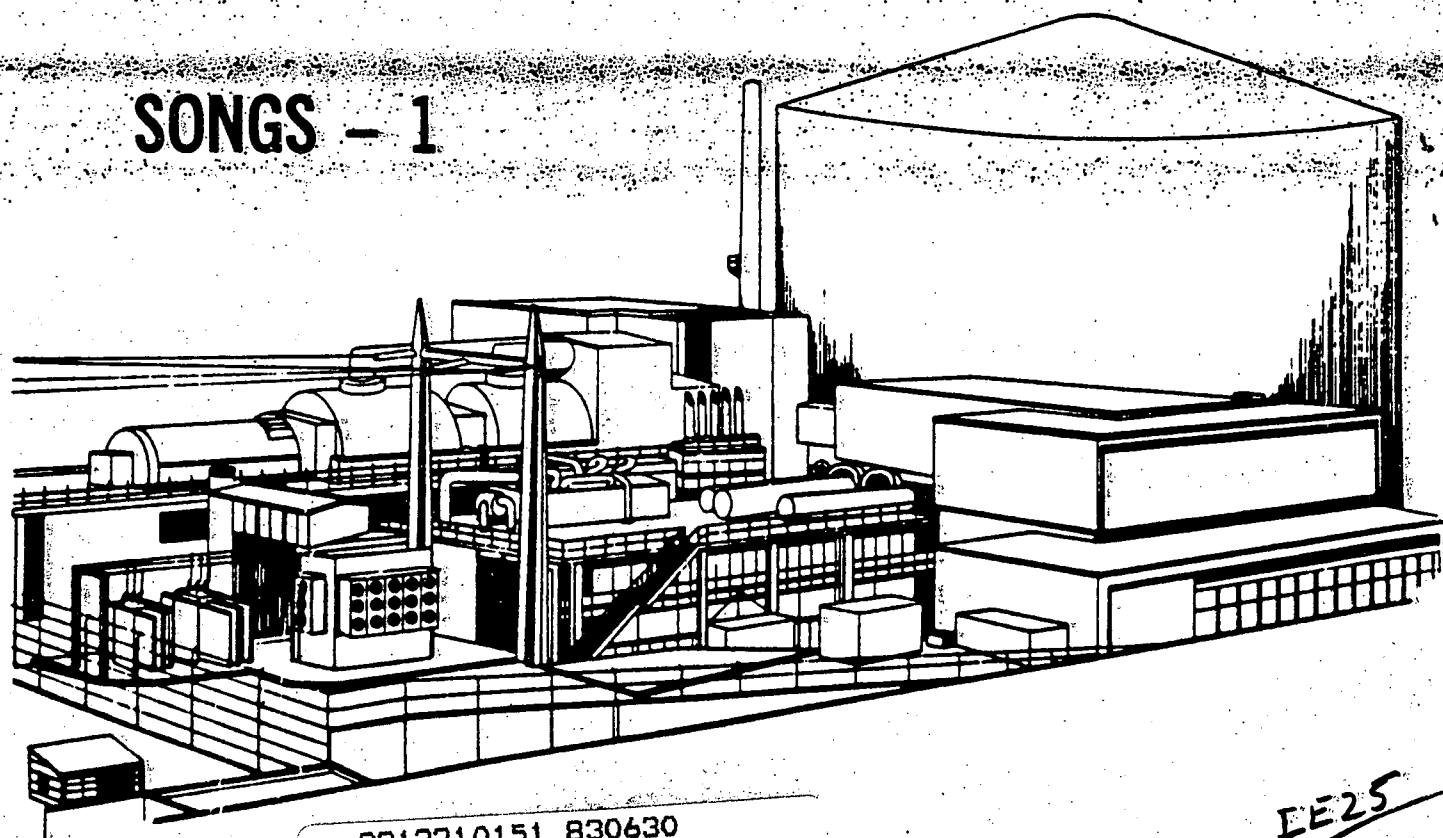

8312210151 830630  
PDR ADOCK 05000206  
R PDR

EE25

## TABLE OF CONTENTS

SECTION A - INTRODUCTION. . . . .	1
SECTION B - GASEOUS EFFLUENTS . . . . .	2
SECTION C - LIQUID EFFLUENTS. . . . .	6
SECTION D - RADWASTE SHIPMENTS. . . . .	10
SECTION E - TECHNICAL SPECIFICATION LIMITS. . . . .	12
SECTION F - ESTIMATION OF ERROR . . . . .	16
SECTION G - METEOROLOGY . . . . .	17
SECTION H - 10 CFR 50 APPENDIX I CONSIDERATIONS . . . . .	34
SECTION I - 40 CFR 190 CONSIDERATIONS . . . . .	35
SECTION J - CONCLUSIONS . . . . .	36

## SEMIANNUAL EFFLUENT REPORT

January - June 1983

### SECTION A. INTRODUCTION

This Semiannual Report summarizes the gaseous and liquid radioactive effluent releases and solid waste shipments made from the San Onofre Nuclear Generating Station Unit 1. This report is prepared in the general format of USNRC Regulatory Guide 1.21 and includes:

1. quarterly summaries of liquid and gaseous effluents for "batch" and "continuous" modes of release;
2. percent of Technical Specification Limits;
3. estimated total percent error;
4. lower limit of detection concentrations;
5. meteorological data;
6. 10 CFR 50 Appendix I considerations;
7. 40 CFR 190 considerations;
8. radwaste shipments.

## SECTION B. GASEOUS EFFLUENTS

Table 1A, "Gaseous Effluents - Summation of All Releases", and Table 1B, "Gaseous Effluents", provide a detailed listing of the quantity of gaseous effluent releases in four categories: Fission and Activation Gases, Iodines, Particulates, and Tritium. Table 1B provides the systematic listing by isotope of the quantity of radioactivity released in each category. The total activity of each isotope released is listed for the quarterly period and also is separated into "continuous" and "batch" modes of releases.

Waste gas decay tank and calibration releases are considered to be "batch" releases. Containment sphere purges and plant stack releases are considered to be "continuous" releases.

Table 1A, "Gaseous Effluents-Summation of All Releases", provides a summary of all gaseous effluent releases for the quarter. Listed are the total releases of each category, the average release rate for the quarter, and the percent of Technical Specification Limit (TSL). The percent of TSL was calculated according to SCE's proposed Technical Specification change because of ambiguity in the current Technical Specifications. The SCE method is fully described in Section E of this report. The percent of TSL is reported for the "maximum hourly release rate" condition rather than the "averaged over a year" condition, since the hourly condition of the TSL was the limiting condition by several orders of magnitude.

Table 1C, "Gaseous Effluents-Lower Limit of Detection", provides a listing of lower limit of detection concentrations for isotopes not detected in Table 1B.

The percent estimated total error is listed in Table 1A for each of the four gaseous effluent categories. The methodology used for error analysis is described in Section F of this report.

The July-December 1982 Semiannual Report values for composite Gross Alpha, Sr-89, Sr-90, (Tables 1A and 1B Gaseous Effluents) were incomplete due to data not available prior to reporting time. The values not reported were for the months November and December 1982. The values are as follows:

	<u>Unit</u>	
Gross Alpha	Ci	2.00E-12
Sr-89	Ci	LLD
Sr-90	Ci	LLD

LLD =  $1.68\text{E-}16$   $\mu\text{Ci/cc}$

TABLE 1A

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT (1983)  
GASEOUS EFFLUENTS-SUMMATION OF ALL RELEASES

	Unit	First Quarter	Second Quarter	
<b>A. Fission &amp; activation gases</b>				
1. Total release	Ci	3.20E+0*	7.40E+0*	22% Estimated Total Error
2. Average release rate for period	μCi/sec	4.11E-1	9.41E-1	
3. Percent of Technical Specification Limit	%	3.26E-1	4.24E-1	
<b>B. Iodines</b>				
1. Total Iodine	Ci	LLD	2.15E-6**	22% Estimated Total Error
2. Average release rate for period	μCi/sec	0.00	2.73E-7	
3. Percent of Technical Specification Limit	%	0.00	2.58E-6	
<b>C. Particulate</b>				
1. Particulates with half-lives > 8 days	Ci	LLD	2.10E-7	16% Estimated Total Error
2. Average release rate for period	μCi/sec	0.00	2.67E-8	
3. Percent of Technical Specification Limit	%	0.00	3.81E-8	
4. Gross Alpha Radioactivity	Ci	LLD	1.50E-12***	
<b>D. Tritium</b>				
1. Total release	Ci	2.05E+0	1.88E+0	25% Estimated Total Error
2. Average release rate for period	μCi/sec	2.64E-1	2.39E-1	
3. Percent of Technical Specification Limit	%	1.05E-3	1.37E-3	

LLD - Lower Limit of Detection; See Table 1C.

\* - All radioactivity released is due to calibration of monitors.

\*\* - All radioiodine released from Unit 1 during the period of this report is due to processing of Unit 2/3 Radwaste at Unit 1.

\*\*\* - Incomplete data-values reported are calculated using only April analyses. The following Semiannual Report will include May and June analyses.

TABLE 1B

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT (1983)  
GASEOUS EFFLUENTS

Nuclides Released	Unit	Continuous Mode		Batch Mode	
		First Quarter	Second Quarter	First Quarter	Second Quarter
1. Fission gases					
krypton-85	Ci	LLD	LLD	3.20E+0	3.70E+0
krypton-85m	Ci	LLD	LLD	LLD	LLD
krypton-87	Ci	LLD	LLD	LLD	LLD
krypton-88	Ci	LLD	LLD	LLD	LLD
xenon-133	Ci	LLD	LLD	LLD	3.70E+0
xenon-135	Ci	LLD	LLD	LLD	LLD
xenon-135m	Ci	LLD	LLD	LLD	LLD
xenon-138	Ci	LLD	LLD	LLD	LLD
Total for period	Ci	LLD	LLD	3.20E+0	7.40E+0
2. Iodines					
iodine-131	Ci	LLD	2.15E-6	LLD	LLD
iodine-133	Ci	LLD	LLD	LLD	LLD
iodine-135	Ci	LLD	LLD	LLD	LLD
Total for period	Ci	LLD	2.15E-6	LLD	LLD
3. Particulates					
strontium-89	Ci	LLD	LLD **	*	*
strontium-90	Ci	LLD	LLD **	*	*
cesium-134	Ci	LLD	LLD	LLD	LLD
cesium-137	Ci	LLD	2.10E-7	LLD	LLD
barium-lanthanum-140	Ci	LLD	LLD	LLD	LLD
Total for period	Ci	LLD	2.10E-7	LLD	LLD
4. Tritium					
	Ci	2.05E+0	1.88E+0	NA	NA

\*\* - Incomplete data-values reported are calculated using only April analyses.  
The following Semiannual Report will include May and June analyses.

\* - See footnote, Table 1C

LLD - Lower Limit of Detection: See Table 1C.

NA - See footnote, Table 1C.

TABLE 1C

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT (1983)  
GASEOUS EFFLUENTS - LOWER LIMIT OF DETECTION

ISOTOPES	BATCH MODE LLD ( $\mu\text{Ci/cc}$ )	CONTINUOUS MODE LLD ( $\mu\text{Ci/cc}$ )
Krypton-85m	**	7.90E-8
Krypton-87	**	1.37E-7
Krypton-88	**	1.64E-7
Krypton-85	**	1.59E-5
Xenon-133	**	2.05E-7
Xenon-135	**	5.65E-8
Xenon-135m	**	4.11E-7
Xenon-138	**	1.45E-6
Iodine-131	NA	2.12E-13
Iodine-133	NA	6.07E-13
Iodine-135	NA	2.63E-12
Strontium-89	*	7.62E-16
Strontium-90	*	7.62E-16
Cesium-134	NA	4.76E-13
Cesium-137	NA	5.77E-13
Lanthanum 140	NA	5.88E-13
Barium 140	NA	8.84E-14
Gross Alpha	*	7.62E-16

NA - Particulates are not analyzed prior to release.

\* - All gaseous releases made from SONGS-1 are vented through the Plant Stack. Sr-89, Sr-90, and gross alpha are analyzed by "continuous" mode only.

\*\* - For this Semiannual period, there were no releases made via batch mode; therefore no batch mode LLDs will be reported.

## SECTION C. LIQUID EFFLUENTS

Table 2A, "Liquid Effluents-Summation of All Releases", and Table 2B, "Liquid Effluents", provide a detailed listing of liquid effluent releases in four categories: Particulates, Tritium, Iodines and Gases. Table 2B provides the systematic listing by isotope of the quantity of radioactivity released in each category. The total activity of each isotope released is listed for each quarterly period and is also separated into "continuous" and "batch" modes of release.

Table 2A, "Liquid Effluents-Summation of All Releases", provides a summary of all liquid effluents for each quarter. Listed are (1) the total release of each category, (2) the average diluted concentration at the point of discharge during each quarterly period, and (3) the percent of Technical Specification Limit. Also listed are the gross alpha radioactivity, the volume of actual waste released (prior to dilution by the circulating water), and the volume of dilution water (i.e., the volume of circulating water) used to dilute the batch releases.

The percent of Technical Specification Limit (TSL) was calculated according to SCE's proposed Technical Specification change because of the ambiguity in the current Technical Specifications. The methodology used in calculating TSL is presented in Section E of this report. The methodology used for error analysis is presented in Section F of this report.

Table 2C, "Liquid Effluents-Lower Limit of Detection", provides a listing of lower limit of detection concentrations for isotopes not detected in Table 2B.

In the July-December 1982 Semiannual Report, the values for composite Gross Alpha, Sr-89, and Sr-90, in Table 2A and Table 2B Liquid Effluents, were incomplete due to data not available at the time of the report. The values not reported were for the months November and December 1982. The values are as follows:

	<u>Unit</u>	
Gross Alpha	Ci	LLD
Strontium-89	Ci	LLD
Strontium-90	Ci	6.91E-5

Gross Alpha LLD =  $5.00\text{E-}8$   $\mu\text{Ci/ml}$

Strontium-89 LLD =  $3.00\text{E-}8$   $\mu\text{Ci/ml}$



TABLE 2A

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT (1983)  
LIQUID EFFLUENTS-SUMMATION OF ALL RELEASES

	Unit	First Quarter	Second Quarter	
<b>A. Particulates</b>				
1. Total release	Ci	9.64E-1	9.32E-2	19% Estimated Total Error
2. Average diluted concentration during period	μCi/ml	2.04E-7	2.34E-9	
3. Percent of Technical Specification Limit	%	2.08E+0	7.25E-1	
<b>B. Tritium</b>				
1. Total release	Ci	8.58E+0	2.49E+0	19% Estimated Total Error
2. Average diluted concentration during period	μCi/ml	1.81E-6	6.25E-8	
3. Percent of Technical Specification Limit	%	2.27E-1	6.98E-2	
<b>C. Iodines</b>				
1. Total release	Ci	8.03E-6	LLD	19% Estimated Total Error
2. Average diluted concentration during period	μCi/ml	1.70E-12	0.00	
3. Percent of Technical Specification Limit	%	2.04E-2	0.00	
<b>D. Gases (Dissolved and Entrained)</b>				
1. Total release	Ci	LLD	LLD	19% Estimated Total Error
2. Average diluted concentration during period	μCi/ml	0.00	0.00	
3. Percent of Technical Specification Limit	%	0.00	0.00	
<b>E. Gross Alpha Radioactivity</b>				
	Ci	1.12E-5	5.20E-3**	19% Estimated Total Error
<b>F. Volume of waste released (prior to dilution)</b>				
	liters	4.17E+6	3.97E+6	
<b>G. Volume of dilution water used during period</b>				
	liters	4.73E+9	3.99E+10	

LLD - Lower Limit of Detection; See Table 2C.

\*\* - Incomplete data-values reported are calculated using only April analyses.  
The following Semiannual Report will include May and June analyses.

TABLE 2B

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT (1983)  
LIQUID EFFLUENTS

Nuclides Released	Unit	Continuous Mode		Batch Mode	
		First Quarter	Second Quarter	First Quarter	Second Quarter
1. Particulates					
strontium-89	Ci	3.82E-5	LLD**	LLD	LLD**
strontium-90	Ci	LLD	LLD**	9.85E-4	1.28E-4**
cesium-134	Ci	2.26E-4	3.32E-5	4.51E-2	9.96E-3
cesium-137	Ci	6.27E-4	9.71E-5	1.60E-1	4.88E-2
cobalt-57	Ci	LLD	LLD	4.88E-4	LLD
cobalt-58	Ci	LLD	LLD	4.13E-2	8.65E-4
cobalt-60	Ci	LLD	1.73E-4	5.31E-1	3.15E-2
iron-59	Ci	LLD	LLD	LLD	LLD
zinc-65	Ci	LLD	LLD	LLD	LLD
manganese-54	Ci	LLD	LLD	2.25E-2	1.66E-3
chromium-51	Ci	LLD	LLD	LLD	LLD
silver-110m	Ci	LLD	LLD	1.03E-3	LLD
zirconium-niobium-95	Ci	LLD	LLD	LLD	LLD
niobium-97	Ci	LLD	LLD	1.62E-1	LLD
molybdenum-99	Ci	LLD	LLD	LLD	LLD
technetium-99m	Ci	LLD	LLD	LLD	LLD
barium-lanthanum-140	Ci	LLD	LLD	LLD	LLD
cerium-141	Ci	LLD	LLD	LLD	LLD
Total for period	Ci	8.91E-4	3.03E-4	9.63E-1	9.29E-2
B. Tritium	Ci	6.72E-3	9.52E-2	8.57E+0	2.40E+0
C. Iodines					
iodine-131	Ci	7.03E-6	LLD	1.06E-6	LLD
Total for period	Ci	7.03E-6	LLD	1.06E-6	LLD
D. Dissolved and Entrained Gases					
xenon-133	Ci	LLD	LLD	LLD	LLD
xenon-135	Ci	LLD	LLD	LLD	LLD
Total for period	Ci	LLD	LLD	LLD	LLD

LLD - Lower Limit of Detection; See Table 2C.

\*\* - Incomplete data-values reported are calculated using only April analyses.  
The following Semiannual Report will include May and June analyses.

TABLE 2C

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT (1983)  
LIQUID EFFLUENTS - LOWER LIMIT OF DETECTION

ISOTOPES	BATCH MODE LLD ( $\mu\text{Ci}/\text{ml}$ )	CONTINUOUS MODE LLD ( $\mu\text{Ci}/\text{ml}$ )
Strontium-89	5.00E-7	4.00E-8
Strontium-90	1.00E-8	2.00E-8
Cobalt-57	2.79E-6	5.34E-8
Cobalt-58	2.98E-8	5.79E-8
Cobalt-60	4.67E-8	8.27E-8
Manganese-54	3.13E-8	5.82E-8
Iron-59	1.55E-5	1.04E-7
Zinc-65	1.69E-5	1.03E-7
Chromium-51	3.27E-5	4.82E-7
Zirconium-95	9.74E-6	9.62E-8
Niobium-95	5.74E-6	8.05E-8
Niobium-97	1.64E-4	7.18E-7
Molybdenum-99	1.12E-5	4.76E-7
Technetium-99m	2.02E-5	5.65E-7
Silver 110m	7.51E-6	5.28E-8
Barium-140	1.69E-5	2.90E-7
Lanthanum-140	1.17E-5	2.25E-6
Cerium-141	5.70E-8	8.09E-8
Iodine-131	5.19E-5	5.71E-8
Xenon-133	1.47E-5	6.01E-7
Xenon-135	1.23E-5	7.69E-8

# SECTION-D. RADWASTE SHIPMENTS

## EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT (1983) SOLID WASTE AND IRRADIATED FUEL SHIPMENT

### A. Solid Waste Shipped Offsite for Burial or Disposal (Not irradiated fuel)

1. Type of Waste	Unit	6-Month Period	Est. Total Error, %
a. Spent Resins	m <sup>3</sup> Ci	1.98E+1 2.17E+2	3.00E+1
b. Dry Compressible Waste, Contaminated Equip. Etc.	m <sup>3</sup> Ci	1.07E+2 5.73E+0	3.00E+1
c. Irradiated Components, Control Rods, Etc.	m <sup>3</sup> Ci	0.00E+0 0.00E+0	3.00E+1
d. Absorbed Liquids, Sand, Building Rubble, Biological Waste	m <sup>3</sup> Ci	6.73E+1 3.13E+0	3.00E+1

### 2. Estimate of Major Nuclide Composition (by type of waste)

a.	Mn-54	%	3.20E+0
	Co-58	%	7.00E+0
	Co-60	%	7.67E+1
	Co-57	%	8.00E-1
	Sr-90/Y-90	%	6.00E-1
	Cs-134	%	3.70E+0
	Cs-137	%	8.00E+0
b.	Mn-54	%	2.00E-1
	Co-57	%	0.00E+0
	Co-60	%	7.64E+1
	Cs-134	%	6.30E-1
	Cs-137	%	2.27E+1
c.	Not Applicable	%	0.00E+0
d.	Mn-54	%	2.00E+0
	Co-58	%	5.50E+0
	Co-60	%	5.20E+1
	Cs-134	%	3.70E+0
	Cs-137	%	3.50E+1
	Ce-144	%	8.00E-1
	H-3	%	1.00E+0

SECTION D. RADWASTE SHIPMENTS (Continued)

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT (1983)  
SOLID WASTE AND IRRADIATED FUEL SHIPMENT

A. Solid Waste Shipped Offsite for Burial or Disposal (Not irradiated fuel)  
(Continued)

3. Solid Waste Disposition

<u>Number of Shipments</u>	<u>Mode of Transportation</u>	<u>Destination</u>
15	South West Nuclear Truck	Richland, WA

B. Irradiated Fuel Shipments (Disposition)

<u>Number of Shipments</u>	<u>Mode of Transportation</u>	<u>Destination</u>
None	N/A	N/A

## SECTION E. TECHNICAL SPECIFICATION LIMITS

The existing Technical Specifications 4.5.A and 4.6.A for SONGS 1 have led to several discussions between SCE, NRR, and Region V. The results of these discussions have led to agreement that the intent of these Technical Specifications is to require compliance with 10 CFR 20, Appendix B. This intent limits concentrations in unrestricted areas such that the following condition is met on both gaseous and liquid effluents:

$$\sum_i C_i / \text{MPC}_i \leq 1 \text{ for concentrations}$$

averaged over a year; and  $\sum_i C_i / \text{MPC}_i \leq 10$  for concentrations averaged over an hour. SCE has developed revised Technical Specification 4.5.A and 4.6.A. This Semiannual Report has calculations of the percent of the Technical Specification Limit according to the following proposed Technical Specifications 4.5.A and 4.6.A.

### Proposed Technical Specification 4.5.A (Liquid Effluents)

Averaged over a year, radioactivity released shall not result in concentrations at the point of discharge such that the following condition is exceeded.

$$\sum_i C_i / \text{MPC}_i \leq 1$$

Where:  $C_i$  = Concentration of radionuclide  $i$  in the circulating water discharge at the point of release to unrestricted areas; in  $\mu\text{Ci/ml}$ .

$\text{MPC}_i$  = Maximum Permissible Concentration of radionuclide  $i$ , as defined in 10 CFR 20, Appendix B, Table II, Column 2; in  $\mu\text{Ci/ml}$ .

SECTION E. TECHNICAL SPECIFICATION LIMITS (Continued)

The percent of Technical Specification Limit averaged over a year shall be determined by calculation of the following parameter:

$$(1E+6/V_T) \sum_i (A_i/MPC_i) \times 100\%$$

Where:  $A_i$  = Activity of radionuclide  $i$  released over a year; in Ci.

$V_T$  = Total volume of liquid effluent released to the unrestricted area during the year; in ml.

$V_T$  =  $V_{DW} + V_{LW}$

$V_{DW}$  = Total volume of dilution water used to dilute liquid waste during the year; in ml.

$V_{LW}$  = Total volume of liquid waste released prior to dilution; in ml.

$MPC_i$  = As defined above.

The licensee shall be provided the flexibility of averaging over the semiannual period of interest rather than averaging over a year if the licensee so desires.

Averaged over an hour, radioactivity released shall not result in concentrations in circulating water discharge such that the following condition is exceeded:

$$\sum_i C_i/MPC_i \leq 10$$

Where: 10 = Maximum value of the summation of the ratios of  $C_i/MPC_i$  averaged over hourly time periods; dimensionless.

$C_i$  = As defined above

$MPC_i$  = As defined above

## SECTION E. TECHNICAL SPECIFICATION LIMITS (Continued)

The percent of Technical Specification Limit averaged over an hour shall be determined by calculation of the following parameter for the hourly period when maximum releases and/or concentrations occurred:

$$(1E+6/10V_{T,h}) \sum_i (A_{i,h}/MPC_i) \times 100\%$$

Where: 10 = As defined above

h = Subscript used to indicate the hourly period when maximum releases occurred; in Ci.

$A_{i,h}$  = Activity of radionuclide i released during the hour when maximum releases occurred; in Ci.

$V_{T,h}$  = Total volume of liquid waste released to the unrestricted area during the hour when maximum releases occurred; in ml.

$MPC_i$  = As defined above.

For purposes of reporting the percent of Technical Specification Limit in the Semiannual Effluent Report, the licensee will report the higher percent of the limit as determined from averaging either over the year or over the maximum hour.

### Proposed Technical Specification 4.6.A (Gaseous Effluents)

Averaged over a year, radioactivity released shall not result in concentrations of radioactivity in unrestricted areas such that the following condition is exceeded:

$$\sum_i C_i/MPC_i \leq 1$$

Where:  $C_i$  = Concentration of radionuclide i at the unrestricted area.

$MPC_i$  = Maximum permissible concentrations of radionuclide i as defined in 10 CFR 20, Appendix B, Table II, Column 1, in  $\mu\text{Ci/cc}$ .



SECTION E. TECHNICAL SPECIFICATION LIMITS (Continued)

The percent of Technical Specification Limit averaged over a year shall be determined by calculation of the following parameter:

$$(5.56E-6) \sum_i (Q_i / MPC_i) \times 100\%$$

Where:  $5.56E-6$  = Atmospheric dispersion factor, in  $\text{sec}/\text{m}^3$   
 $Q_i$  = Release rate of nuclide  $i$  averaged over a year; in  $\text{Ci}/\text{sec}$ .  
 $MPC_i$  = As defined above.

The licensee shall be provided the flexibility of averaging over the semiannual period of interest rather than averaging over a year if the licensee desires.

Averaged over the hour when maximum releases occur, radioactivity released shall not result in concentrations in unrestricted areas exceeding ten times the yearly averaged limit stated above. The percent of Technical Specification Limit shall be determined by calculation of the following parameter for the hourly period when maximum releases occurred:

$$(5.56E-7) \sum_i (Q_{i,h} / MPC_i) \times 100\%$$

Where:  $5.56E-7$  = Atmospheric dispersion factor divided by 10, in  $\text{sec}/\text{m}^3$   
 $h$  = Subscript used to indicate the hourly period when maximum releases occurred.  
 $Q_{i,h}$  = Release rate of nuclide  $i$  averaged over the hour during which the highest releases occurred.  
 $MPC_i$  = As defined above.

For purposes of reporting the percent of Technical Specification Limit in the Semiannual Effluent Report, the licensee will report the higher percent of the limit as determined from averaging either over the year or over the maximum hour.

## SECTION F. ESTIMATION OF ERROR

Estimation of the error in reported values of gaseous and liquid effluent releases have been determined. Sources of error considered for gaseous effluents-batch releases are the following: (1) tank volumes, (2) sampling errors, (3) counting errors, and (4) calibration errors. Sources of error for gaseous effluents-continuous release are the following: (1) fan flow rate error, (2) sampling error, (3) counting errors, and (4) calibration errors.

Sources of error for liquid effluents-batch releases are the following: (1) tank volumes, (2) dilution water flow rate, (3) sampling errors, (4) counting error, and (5) calibration errors. These sources of error are independent; thus the total error is calculated according to the following formula:

$$\text{Total Error} = \sqrt{\sigma_1^2 + \sigma_2^2 + \sigma_3^2 + \dots + \sigma_i^2}$$

Where:  $\sigma_i$  = Error associated with each component.

## SECTION G. METEOROLOGY

The meteorology of the SONGS-1 site for the quarterly periods January-March and April-June, 1983, is described in this section. Meteorological measurements have been made according to the guidance set forth in USNRC Regulatory Guide 1.23, "Onsite Meteorological Programs." A summary report of the meteorological measurements taken during each calendar quarter are presented in Tables 3A and 3B as joint frequency distributions (JFD) of wind direction and wind speed by atmospheric stability class.

Hourly meteorological data for batch releases have been recorded for the periods of actual release. This data is available, as well as the hourly data for all periods of the semiannual period, but are not included here because of the bulk of data recorded.

Table 3A, "JFD's First Quarter 1983" and Table 3B, "JFD's Second Quarter 1983" list the joint frequency distributions for the first and second quarters of 1983. Each page of the tables represents the data that is classified as stability Class A, B, C, D, E, F, G; the last page of each table is the JFD with all stability classes combined. Each page is divided into two parts; the upper part lists the number of hourly periods when each meteorology condition occurred and the lower part of each page lists the frequency of each classification by percent. The wind speeds have been measured at the 10 meter level and the stability classes are defined by the temperature differential between the 10 and 40 meter levels.

SOUTHERN CALIFORNIA EDISON COMPANY  
 SAN ONOFRE NUCLEAR GENERATING STATION  
 1ST QUARTER, 1983  
 DAMEB AND MOORE JOB NO. - 00377-082-09  
 DATA PERIOD- 01/01/83 TO 03/31/83  
 STABILITY CLASS BAW (10-40 METERS )  
 WINDS AT 10 METER LEVEL

23-JUL-83

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN NUMBER OF OCCURRENCES)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
NE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
ENE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
E	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
ESE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
SE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
SSE	0.	0.	0.	0.	0.	0.	0.	3.	2.	0.	0.	1.	6.	8.75
S	0.	0.	0.	2.	4.	6.	2.	4.	3.	1.	0.	1.	23.	7.20
SSW	0.	0.	0.	3.	2.	14.	9.	5.	6.	1.	0.	3.	43.	6.86
SW	0.	0.	1.	7.	13.	12.	19.	9.	2.	0.	3.	1.	63.	6.04
WSW	0.	0.	0.	6.	13.	13.	17.	6.	3.	0.	0.	0.	58.	5.75
W	0.	0.	1.	3.	13.	30.	32.	24.	14.	7.	10.	10.	144.	7.30
WNW	0.	0.	0.	0.	1.	3.	6.	2.	11.	4.	3.	6.	36.	8.79
NW	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	1.	0.	1.	10.60
NNW	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
N	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
VARIABLE													0.	0.00
CALM													0.	0.00
TOTAL	0.	0.	2.	21.	46.	78.	81.	53.	41.	14.	17.	24.	377.	7.02

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN PERCENT OF TOTAL)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
ENE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
E	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
ESE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
SE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
SSE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.13	0.10	0.00	0.00	0.03	0.31	8.75
S	0.00	0.00	0.00	0.10	0.21	0.31	0.10	0.21	0.13	0.09	0.00	0.03	1.18	7.20
SSW	0.00	0.00	0.00	0.13	0.10	0.72	0.46	0.26	0.31	0.05	0.00	0.13	2.21	6.86
SW	0.00	0.00	0.03	0.36	0.67	0.62	0.77	0.46	0.10	0.00	0.13	0.03	3.24	6.04
WSW	0.00	0.00	0.00	0.31	0.67	0.67	0.87	0.31	0.13	0.00	0.00	0.00	2.98	5.75
W	0.00	0.00	0.03	0.13	0.67	1.54	1.64	1.23	0.72	0.36	0.31	0.31	7.40	7.30
WNW	0.00	0.00	0.00	0.00	0.03	0.13	0.31	0.10	0.56	0.21	0.13	0.31	1.85	8.79
NW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.03	10.60
NNW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
N	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
VARIABLE													0.00	0.00
CALM													0.00	0.00
TOTAL	0.00	0.00	0.10	1.08	2.36	4.01	4.16	2.72	2.11	0.72	0.87	1.23	19.36	7.02

TOTAL NUMBER OF POSSIBLE OBSERVATIONS - 2160  
 TOTAL NUMBER OF OBSERVATIONS WITH VALID SPEED, DIRECTION AND STABILITY - 1947

Table 3A JFD's First Quarter 1983

Stability Class A

SOUTHERN CALIFORNIA EDISON COMPANY  
 SAN ONOFRE NUCLEAR GENERATING STATION  
 1ST QUARTER, 1983  
 DAMEB AND MOORE JOB NO. - 00377-082-09  
 DATA PERIOD- 01/01/83 TO 03/31/83  
 STABILITY CLASS 888 (10-40 METERS )  
 WINDS AT 10 METER LEVEL

25-JUL-83

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN NUMBER OF OCCURRENCES)

WIND DIRECTION	UPPER CLASS INTERVALS OF WIND SPEED (MPH)											TOTAL	MEAN SPEED
	1	2	3	4	5	6	7	8	9	10	11	>11	
NNE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
NE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
ENE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
E	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
ESE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
SE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	1.	17.70
SSE	0.	0.	0.	0.	0.	0.	1.	2.	0.	0.	1.	1.	8.86
S	0.	0.	0.	1.	0.	0.	1.	0.	0.	0.	0.	0.	3.30
SSW	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
SW	0.	0.	1.	1.	0.	0.	0.	0.	0.	0.	0.	0.	3.03
WSW	0.	0.	0.	0.	2.	0.	0.	0.	0.	0.	0.	2.	4.10
W	0.	0.	0.	0.	1.	0.	0.	0.	0.	0.	0.	1.	4.80
WNW	0.	0.	0.	0.	0.	0.	1.	2.	0.	0.	0.	0.	7.13
NW	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
NNW	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
N	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
VARIABLE													0.00
CALM													0.00
TOTAL	0.	0.	1.	2.	3.	0.	3.	4.	0.	0.	1.	2.	16. 7.07

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN PERCENT OF TOTAL)

WIND DIRECTION	UPPER CLASS INTERVALS OF WIND SPEED (MPH)											TOTAL	MEAN SPEED
	1	2	3	4	5	6	7	8	9	10	11	>11	
NNE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
ENE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
E	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
ESE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
SE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.03	17.70
SSE	0.00	0.00	0.00	0.00	0.00	0.00	0.03	0.10	0.00	0.00	0.03	0.03	8.86
S	0.00	0.00	0.00	0.03	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	3.30
SSW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
SW	0.00	0.00	0.03	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	3.03
WSW	0.00	0.00	0.00	0.00	0.10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	4.10
W	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	4.80
WNW	0.00	0.00	0.00	0.00	0.00	0.00	0.03	0.10	0.00	0.00	0.00	0.00	7.13
NW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NNW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
N	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
VARIABLE													0.00
CALM													0.00
TOTAL	0.00	0.00	0.03	0.10	0.13	0.00	0.13	0.21	0.00	0.00	0.03	0.10	0.82 7.07

TOTAL NUMBER OF POSSIBLE OBSERVATIONS - 2160

TOTAL NUMBER OF OBSERVATIONS WITH VALID SPEED, DIRECTION AND STABILITY - 1947

Table 3A JFD's First Quarter 1983  
 Stability Class B

SOUTHERN CALIFORNIA EDISON COMPANY  
 SAN ONOFRE NUCLEAR GENERATING STATION  
 1ST QUARTER, 1983  
 DAMEB AND MOORE JOB NO. - 00377-082-09  
 DATA PERIOD- 01/01/83 TO 03/31/83  
 STABILITY CLASS C (10-40 METERS )  
 WINDS AT 10 METER LEVEL

25-JUL-83

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN NUMBER OF OCCURRENCES)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
NE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	1.	1.	11.80
ENE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
E	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
ESE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	2.	2.	16.95
SE	0.	0.	0.	0.	0.	1.	0.	0.	1.	0.	0.	1.	3.	12.37
SSE	0.	0.	0.	0.	0.	2.	1.	1.	0.	3.	3.	3.	12.	9.81
S	0.	0.	1.	2.	0.	1.	0.	2.	1.	1.	0.	0.	2.	5.40
SSW	0.	0.	0.	1.	0.	0.	0.	1.	0.	0.	0.	0.	2.	5.40
SW	0.	0.	2.	0.	0.	1.	1.	2.	1.	0.	0.	1.	8.	7.03
WSW	0.	1.	2.	0.	2.	3.	1.	0.	1.	0.	0.	1.	11.	5.72
W	0.	0.	0.	1.	1.	2.	0.	0.	1.	0.	0.	4.	9.	9.80
WNW	0.	0.	0.	1.	1.	2.	1.	2.	1.	0.	0.	0.	10.	7.44
NW	0.	0.	0.	0.	0.	0.	2.	1.	0.	0.	0.	0.	3.	7.07
NNW	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
N	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
VARIABLE													0.	0.00
CALM													0.	0.00
TOTAL	0.	1.	3.	5.	4.	12.	6.	9.	6.	3.	3.	13.	69.	8.17

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN PERCENT OF TOTAL)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.03	0.03	11.80
ENE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
E	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
ESE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.10	0.10	16.95
SE	0.00	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.03	0.00	0.00	0.03	0.13	12.37
SSE	0.00	0.00	0.00	0.00	0.00	0.10	0.03	0.03	0.00	0.10	0.13	0.13	0.62	9.81
S	0.00	0.00	0.03	0.10	0.00	0.03	0.00	0.10	0.03	0.03	0.00	0.00	0.41	6.09
SSW	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.10	5.40
SW	0.00	0.00	0.10	0.00	0.00	0.03	0.03	0.10	0.03	0.00	0.00	0.03	0.41	7.03
WSW	0.00	0.03	0.10	0.00	0.10	0.13	0.03	0.00	0.03	0.00	0.00	0.03	0.36	5.72
W	0.00	0.00	0.00	0.03	0.03	0.10	0.00	0.00	0.03	0.00	0.00	0.21	0.46	9.80
WNW	0.00	0.00	0.00	0.03	0.03	0.10	0.03	0.10	0.03	0.00	0.00	0.10	0.31	7.44
NW	0.00	0.00	0.00	0.00	0.00	0.00	0.10	0.03	0.00	0.00	0.00	0.00	0.13	7.07
NNW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
N	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
VARIABLE													0.00	0.00
CALM													0.00	0.00
TOTAL	0.00	0.03	0.26	0.26	0.21	0.62	0.31	0.46	0.31	0.13	0.13	0.77	3.54	8.17

TOTAL NUMBER OF POSSIBLE OBSERVATIONS - 2160

TOTAL NUMBER OF OBSERVATIONS WITH VALID SPEED, DIRECTION AND STABILITY - 1947

Table 3A JFD's First Quarter 1983

Stability Class C

SOUTHERN CALIFORNIA EDISON COMPANY  
 SAN ONOFRE NUCLEAR GENERATING STATION  
 1ST QUARTER, 1983  
 DAMES AND MOORE JOB NO. - 00377-082-09  
 DATA PERIOD- 01/01/83 TO 03/31/83  
 STABILITY CLASS 000 (10-40 METERS )  
 WINDS AT 10 METER LEVEL

25-JUL-83

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN NUMBER OF OCCURRENCES)

UPPER CLASS INTERVALS OF WIND SPEED (MPH)													TOTAL	MEAN SPEED
WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11		
NNE	0.	1.	2.	1.	5.	1.	0.	0.	0.	0.	0.	0.	10.	3.83
NE	0.	1.	0.	0.	0.	0.	0.	0.	0.	0.	0.	2.	3.	9.60
ENE	0.	0.	0.	0.	0.	0.	0.	1.	0.	0.	0.	0.	1.	7.80
E	0.	0.	0.	0.	1.	1.	0.	0.	0.	0.	1.	0.	3.	6.63
ESE	0.	1.	1.	0.	0.	4.	4.	0.	2.	2.	1.	12.	27.	10.87
SE	0.	0.	1.	0.	2.	5.	8.	7.	7.	5.	4.	22.	61.	10.85
SSE	0.	0.	1.	5.	2.	2.	10.	1.	1.	1.	2.	26.	51.	10.95
S	0.	0.	1.	4.	3.	2.	4.	2.	2.	0.	0.	27.	45.	12.13
SSW	0.	0.	0.	6.	1.	1.	4.	2.	1.	1.	0.	13.	31.	11.17
SW	0.	0.	3.	5.	3.	3.	2.	1.	1.	1.	2.	13.	34.	10.20
WSW	0.	2.	0.	2.	5.	7.	5.	5.	2.	0.	2.	13.	43.	8.70
W	0.	0.	4.	11.	2.	5.	2.	1.	1.	3.	2.	19.	50.	9.88
WNW	0.	0.	1.	3.	4.	3.	1.	2.	5.	2.	5.	28.	7.78	
NW	0.	1.	0.	2.	5.	7.	4.	2.	4.	5.	0.	6.	36.	7.41
NNW	0.	0.	0.	1.	3.	2.	1.	2.	0.	1.	0.	2.	12.	7.65
N	0.	0.	1.	1.	1.	1.	2.	0.	0.	0.	0.	0.	6.	4.77
VARIABLE													0.	0.00
CALM													0.	0.00
TOTAL	0.	6.	15.	41.	37.	44.	47.	26.	26.	21.	16.	162.	441.	9.80

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN PERCENT OF TOTAL)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.00	0.03	0.10	0.03	0.26	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.31	3.83
NE	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.10	0.15	9.60
ENE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.05	7.80
E	0.00	0.00	0.00	0.00	0.03	0.03	0.00	0.00	0.00	0.00	0.03	0.00	0.15	6.63
ESE	0.00	0.03	0.03	0.00	0.00	0.21	0.21	0.00	0.10	0.10	0.03	0.62	1.39	10.87
SE	0.00	0.00	0.03	0.00	0.10	0.26	0.41	0.36	0.36	0.26	0.21	1.13	3.13	10.85
SSE	0.00	0.00	0.03	0.26	0.10	0.10	0.31	0.03	0.03	0.03	0.10	1.34	2.62	10.95
S	0.00	0.00	0.03	0.21	0.15	0.10	0.21	0.10	0.10	0.00	0.00	1.39	2.31	12.13
SSW	0.00	0.00	0.00	0.31	0.03	0.03	0.21	0.10	0.03	0.03	0.00	0.77	1.59	11.17
SW	0.00	0.00	0.15	0.26	0.15	0.15	0.10	0.03	0.03	0.03	0.10	0.67	1.75	10.20
WSW	0.00	0.10	0.00	0.10	0.26	0.36	0.26	0.26	0.10	0.00	0.10	0.67	2.21	8.70
W	0.00	0.00	0.21	0.56	0.10	0.26	0.10	0.03	0.03	0.13	0.10	0.98	2.57	9.88
WNW	0.00	0.00	0.03	0.15	0.21	0.15	0.03	0.10	0.26	0.10	0.10	0.26	1.44	7.78
NW	0.00	0.03	0.00	0.10	0.26	0.36	0.21	0.10	0.21	0.26	0.00	0.31	1.85	7.41
NNW	0.00	0.00	0.00	0.03	0.15	0.10	0.03	0.10	0.00	0.03	0.00	0.10	0.62	7.65
N	0.00	0.00	0.03	0.03	0.03	0.03	0.10	0.00	0.00	0.00	0.00	0.00	0.31	4.77
VARIABLE													0.00	0.00
CALM													0.00	0.00
TOTAL	0.00	0.31	0.77	2.11	1.90	2.26	2.41	1.34	1.34	1.08	0.82	8.32	22.65	9.80

TOTAL NUMBER OF POSSIBLE OBSERVATIONS - 2160  
 TOTAL NUMBER OF OBSERVATIONS WITH VALID SPEED, DIRECTION AND STABILITY - 1947

Table 3A JFD's First Quarter 1983

Stability Class D

SOUTHERN CALIFORNIA EDISON COMPANY  
 SAN ONOFRE NUCLEAR GENERATING STATION  
 1ST QUARTER, 1983  
 DAMES AND MOORE JOB NO. - 00377-082-09  
 DATA PERIOD- 01/01/83 TO 03/31/83  
 STABILITY CLASS 000 (10-40 METERS )  
 WINDS AT 10 METER LEVEL

23-JUL-83

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN NUMBER OF OCCURRENCES)

WIND DIRECTION	UPPER CLASS INTERVALS OF WIND SPEED (MPH)												TOTAL	MEAN SPEED
	1	2	3	4	5	6	7	8	9	10	11	>11		
NNE	0.	3.	4.	11.	8.	7.	15.	4.	2.	0.	0.	0.	54.	5.10
NE	0.	0.	2.	2.	3.	0.	0.	0.	0.	0.	0.	1.	8.	5.00
ENE	0.	1.	1.	2.	2.	3.	0.	0.	0.	0.	0.	3.	12.	6.82
E	0.	0.	3.	5.	0.	1.	0.	2.	0.	0.	0.	0.	11.	4.35
ESE	0.	0.	1.	2.	2.	2.	0.	1.	0.	0.	0.	1.	9.	6.81
SE	0.	0.	1.	5.	3.	5.	2.	1.	2.	0.	1.	17.	37.	10.36
SSE	0.	1.	3.	2.	2.	3.	0.	1.	1.	0.	0.	10.	23.	13.19
S	0.	0.	1.	2.	2.	0.	0.	0.	1.	0.	0.	3.	9.	10.24
SSW	0.	0.	2.	1.	1.	1.	1.	0.	0.	0.	0.	0.	6.	4.40
SW	0.	1.	3.	3.	2.	0.	1.	1.	0.	1.	0.	3.	15.	8.52
WSW	0.	0.	0.	3.	0.	0.	1.	1.	0.	0.	0.	0.	5.	4.84
W	0.	0.	4.	1.	2.	3.	1.	4.	2.	0.	2.	11.	30.	8.94
WNW	0.	0.	2.	4.	0.	1.	3.	9.	3.	3.	1.	8.	30.	8.48
NW	0.	0.	0.	0.	2.	3.	3.	3.	3.	0.	0.	2.	18.	7.16
NNW	0.	0.	3.	3.	3.	0.	1.	1.	0.	0.	0.	0.	13.	4.18
N	0.	2.	6.	8.	4.	4.	4.	3.	1.	0.	0.	0.	32.	4.52
VARIABLE													0.	0.00
CALM													0.	0.00
TOTAL	0.	8.	36.	54.	38.	35.	32.	27.	15.	4.	4.	59.	312.	7.56

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN PERCENT OF TOTAL)

WIND DIRECTION	UPPER CLASS INTERVALS OF WIND SPEED (MPH)												TOTAL	MEAN SPEED
	1	2	3	4	5	6	7	8	9	10	11	>11		
NNE	0.00	0.13	0.21	0.36	0.41	0.36	0.77	0.21	0.10	0.00	0.00	0.00	2.77	5.10
NE	0.00	0.00	0.10	0.10	0.15	0.00	0.00	0.00	0.00	0.00	0.00	0.03	0.41	5.00
ENE	0.00	0.03	0.03	0.10	0.10	0.15	0.00	0.00	0.00	0.00	0.00	0.15	0.62	6.82
E	0.00	0.00	0.13	0.26	0.00	0.03	0.00	0.10	0.00	0.00	0.00	0.00	0.56	4.35
ESE	0.00	0.00	0.03	0.10	0.10	0.10	0.00	0.03	0.00	0.00	0.00	0.03	0.46	6.81
SE	0.00	0.00	0.03	0.26	0.15	0.26	0.10	0.03	0.10	0.00	0.03	0.87	1.90	10.36
SSE	0.00	0.03	0.13	0.10	0.10	0.15	0.00	0.03	0.03	0.00	0.00	0.31	1.18	13.19
S	0.00	0.00	0.03	0.10	0.10	0.00	0.00	0.00	0.03	0.00	0.00	0.13	0.46	10.24
SSW	0.00	0.00	0.10	0.03	0.03	0.03	0.03	0.00	0.00	0.00	0.00	0.00	0.31	4.40
SW	0.00	0.03	0.13	0.15	0.10	0.00	0.03	0.03	0.00	0.00	0.00	0.15	0.77	8.52
WSW	0.00	0.00	0.00	0.13	0.00	0.00	0.03	0.03	0.00	0.00	0.00	0.00	0.26	4.84
W	0.00	0.00	0.21	0.03	0.10	0.15	0.03	0.21	0.10	0.00	0.10	0.56	1.54	8.94
WNW	0.00	0.00	0.10	0.21	0.00	0.03	0.15	0.26	0.15	0.15	0.03	0.41	1.54	8.48
NW	0.00	0.00	0.00	0.00	0.10	0.26	0.15	0.15	0.15	0.00	0.00	0.10	0.92	7.16
NNW	0.00	0.00	0.13	0.15	0.26	0.00	0.03	0.03	0.00	0.00	0.00	0.00	0.67	4.18
N	0.00	0.10	0.31	0.41	0.21	0.21	0.21	0.15	0.03	0.00	0.00	0.00	1.64	4.52
VARIABLE													0.00	0.00
CALM													0.00	0.00
TOTAL	0.00	0.41	1.85	2.77	1.95	1.80	1.64	1.39	0.77	0.21	0.21	3.03	16.02	7.56

TOTAL NUMBER OF POSSIBLE OBSERVATIONS - 2160  
 TOTAL NUMBER OF OBSERVATIONS WITH VALID SPEED, DIRECTION AND STABILITY - 1947

Table 3A JFD's First Quarter 1983

Stability Class E



SOUTHERN CALIFORNIA EDISON COMPANY  
 SAN ONOFRE NUCLEAR GENERATING STATION  
 1ST QUARTER, 1983  
 DAMES AND MOORE JOB NO. - 00377-082-09  
 DATA PERIOD- 01/01/83 TO 03/31/83  
 STABILITY CLASS #F (10-40 METERS)  
 WINDS AT 10 METER LEVEL

25-JUL-83

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN NUMBER OF OCCURRENCES)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.	1.	4.	14.	25.	39.	19.	13.	6.	7.	1.	1.	130.	5.84
NE	0.	0.	5.	16.	10.	2.	0.	1.	1.	0.	0.	0.	35.	4.15
ENE	0.	2.	3.	1.	4.	0.	0.	0.	1.	0.	1.	0.	12.	4.48
E	0.	0.	3.	1.	0.	1.	0.	0.	0.	0.	0.	0.	5.	3.22
EBE	0.	0.	1.	0.	0.	0.	0.	0.	0.	0.	0.	0.	1.	2.60
BE	0.	0.	2.	2.	3.	4.	3.	1.	0.	1.	1.	0.	21.	5.51
BSE	0.	0.	4.	4.	3.	2.	0.	0.	0.	0.	0.	0.	13.	3.83
S	0.	0.	0.	3.	2.	1.	0.	0.	0.	0.	0.	0.	8.	3.96
BSW	0.	0.	0.	0.	3.	0.	1.	1.	1.	0.	0.	0.	6.	6.07
SW	0.	0.	0.	0.	0.	0.	1.	0.	1.	0.	0.	0.	2.	7.75
WSW	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
W	0.	0.	1.	0.	2.	0.	0.	0.	0.	0.	0.	0.	3.	3.97
WNW	0.	0.	2.	2.	2.	0.	0.	0.	0.	0.	0.	0.	6.	3.73
NW	0.	0.	0.	1.	1.	1.	0.	0.	0.	0.	0.	0.	3.	4.27
NNW	0.	0.	1.	2.	0.	0.	0.	1.	2.	0.	0.	0.	6.	5.72
N	0.	0.	0.	4.	9.	6.	3.	4.	1.	1.	0.	0.	24.	5.75
VARIABLE													0.	0.00
CALM													0.	0.00
TOTAL	0.	3.	26.	52.	62.	56.	29.	21.	13.	9.	3.	1.	275.	5.26

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN PERCENT OF TOTAL)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.00	0.03	0.21	0.72	1.28	2.00	0.98	0.67	0.31	0.36	0.03	0.03	6.68	5.84
NE	0.00	0.00	0.26	0.82	0.51	0.10	0.00	0.03	0.03	0.00	0.00	0.00	1.80	4.15
ENE	0.00	0.10	0.13	0.03	0.21	0.00	0.00	0.00	0.03	0.00	0.03	0.00	0.62	4.48
E	0.00	0.00	0.13	0.03	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.26	3.22
EBE	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.03	2.60
BE	0.00	0.00	0.10	0.10	0.26	0.21	0.26	0.03	0.00	0.03	0.03	0.00	1.08	5.51
BSE	0.00	0.00	0.21	0.21	0.13	0.10	0.00	0.00	0.00	0.00	0.00	0.00	0.67	3.83
S	0.00	0.00	0.00	0.26	0.10	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.41	3.96
BSW	0.00	0.00	0.00	0.00	0.13	0.00	0.03	0.03	0.03	0.00	0.00	0.00	0.31	6.07
SW	0.00	0.00	0.00	0.00	0.00	0.00	0.03	0.00	0.03	0.00	0.00	0.00	0.10	7.75
WSW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
W	0.00	0.00	0.03	0.00	0.10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.13	3.97
WNW	0.00	0.00	0.10	0.10	0.10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.31	3.73
NW	0.00	0.00	0.00	0.03	0.03	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.13	4.27
NNW	0.00	0.00	0.03	0.10	0.00	0.03	0.00	0.03	0.10	0.00	0.00	0.00	0.31	5.72
N	0.00	0.00	0.00	0.21	0.26	0.31	0.15	0.21	0.03	0.03	0.00	0.00	1.23	5.75
VARIABLE													0.00	0.00
CALM													0.00	0.00
TOTAL	0.00	0.13	1.34	2.67	3.18	2.88	1.49	1.08	0.67	0.46	0.13	0.03	14.12	5.26

TOTAL NUMBER OF POSSIBLE OBSERVATIONS - 2160  
 TOTAL NUMBER OF OBSERVATIONS WITH VALID SPEED, DIRECTION AND STABILITY - 1947

Table 3A JFD's First Quarter 1983

Stability Class F

SOUTHERN CALIFORNIA EDISON COMPANY  
 SAN ONOFRE NUCLEAR GENERATING STATION  
 1ST QUARTER, 1983  
 DAMES AND MOORE JOB NO. - 00377-082-09  
 DATA PERIOD- 01/01/83 TO 03/31/83  
 STABILITY CLASS 400 (10-40 METERS )  
 WINDS AT 10 METER LEVEL

25-JUL-83

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN NUMBER OF OCCURRENCES)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.	0.	1.	5.	8.	18.	39.	46.	54.	52.	34.	25.	282.	8.48
NE	0.	0.	1.	4.	3.	3.	4.	1.	1.	1.	0.	1.	19.	5.85
ENE	0.	0.	0.	1.	0.	2.	0.	0.	0.	0.	0.	0.	3.	5.03
E	0.	0.	0.	1.	0.	0.	0.	0.	0.	0.	0.	0.	1.	4.00
ESE	0.	2.	2.	1.	0.	0.	0.	0.	0.	0.	0.	0.	5.	2.52
SE	1.	0.	0.	1.	3.	4.	16.	18.	13.	4.	1.	0.	61.	7.32
SSE	0.	1.	1.	1.	2.	1.	0.	3.	0.	1.	1.	1.	12.	6.42
S	0.	0.	0.	0.	0.	0.	1.	0.	4.	0.	2.	1.	8.	9.09
SSW	0.	0.	0.	0.	1.	1.	1.	5.	3.	7.	6.	0.	24.	8.88
SW	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
WSW	0.	0.	0.	0.	2.	0.	0.	0.	0.	0.	0.	0.	2.	4.43
W	0.	0.	0.	0.	0.	1.	0.	2.	0.	0.	0.	0.	3.	6.87
WNW	0.	1.	0.	1.	2.	2.	0.	0.	2.	0.	0.	0.	8.	5.39
NW	0.	0.	0.	0.	0.	1.	1.	0.	0.	0.	0.	0.	2.	5.93
NNW	0.	0.	0.	0.	1.	0.	1.	0.	1.	0.	0.	0.	3.	6.67
N	0.	0.	0.	0.	1.	1.	5.	7.	1.	6.	2.	1.	24.	8.08
VARIABLE													0.	0.00
CALM													0.	0.00
TOTAL	1.	4.	5.	15.	23.	34.	68.	82.	79.	71.	46.	29.	457.	7.97

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN PERCENT OF TOTAL)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.00	0.00	0.05	0.26	0.41	0.92	2.00	2.36	2.77	2.67	1.75	1.28	14.48	8.48
NE	0.00	0.00	0.05	0.21	0.15	0.15	0.21	0.05	0.05	0.05	0.00	0.05	0.98	5.85
ENE	0.00	0.00	0.00	0.05	0.00	0.10	0.00	0.00	0.00	0.00	0.00	0.00	0.15	5.03
E	0.00	0.00	0.00	0.05	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.05	4.00
ESE	0.00	0.10	0.10	0.05	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.26	2.52
SE	0.05	0.00	0.00	0.05	0.15	0.21	0.82	0.92	0.67	0.21	0.05	0.00	3.13	7.32
SSE	0.00	0.05	0.05	0.05	0.10	0.05	0.00	0.15	0.00	0.05	0.05	0.05	0.62	6.42
S	0.00	0.00	0.00	0.00	0.00	0.00	0.05	0.00	0.21	0.00	0.10	0.05	0.41	9.09
SSW	0.00	0.00	0.00	0.00	0.05	0.05	0.05	0.26	0.15	0.36	0.31	0.00	1.23	8.88
SW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
WSW	0.00	0.00	0.00	0.00	0.10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.10	4.43
W	0.00	0.00	0.00	0.00	0.00	0.05	0.00	0.10	0.00	0.00	0.00	0.00	0.15	6.87
WNW	0.00	0.05	0.00	0.05	0.10	0.10	0.00	0.00	0.10	0.00	0.00	0.00	0.41	5.39
NW	0.00	0.00	0.00	0.00	0.00	0.05	0.05	0.00	0.00	0.00	0.00	0.00	0.10	5.93
NNW	0.00	0.00	0.00	0.00	0.05	0.00	0.05	0.00	0.05	0.00	0.00	0.00	0.15	6.67
N	0.00	0.00	0.00	0.00	0.05	0.05	0.26	0.36	0.05	0.31	0.10	0.05	1.23	8.08
VARIABLE													0.00	0.00
CALM													0.00	0.00
TOTAL	0.05	0.21	0.26	0.77	1.18	1.75	3.49	4.21	4.06	3.65	2.36	1.49	23.47	7.97

TOTAL NUMBER OF POSSIBLE OBSERVATIONS - 2160  
 TOTAL NUMBER OF OBSERVATIONS WITH VALID SPEED, DIRECTION AND STABILITY - 1947

Table 3A JFD's First Quarter 1983  
 Stability Class G

SOUTHERN CALIFORNIA EDISON COMPANY  
 SAN ONOFRE NUCLEAR GENERATING STATION  
 1ST QUARTER, 1983  
 DAMES AND MOORE JOB NO. - 00377-082-09  
 DATA PERIOD- 01/01/83 TO 03/31/83  
 STABILITY CLASS ALL (10-40 METERS )  
 WINDS AT 10 METER LEVEL

25-JUL-83

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN NUMBER OF OCCURRENCES)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.	9.	11.	32.	49.	66.	73.	63.	62.	59.	35.	26.	481.	7.25
NE	0.	1.	8.	22.	17.	9.	4.	2.	2.	1.	0.	5.	67.	5.10
ENE	0.	3.	4.	4.	7.	5.	0.	1.	1.	0.	1.	3.	29.	5.63
E	0.	0.	6.	7.	1.	3.	0.	2.	0.	0.	1.	0.	20.	4.39
ESE	0.	3.	9.	3.	2.	6.	6.	1.	2.	2.	1.	13.	46.	9.06
SE	1.	0.	4.	10.	13.	21.	32.	29.	23.	12.	7.	43.	194.	9.00
SSE	0.	2.	9.	13.	10.	12.	12.	11.	4.	4.	7.	42.	126.	10.08
S	0.	0.	3.	17.	11.	10.	8.	10.	13.	2.	2.	32.	108.	9.28
SSW	0.	0.	2.	12.	8.	17.	16.	14.	11.	9.	6.	18.	113.	8.24
SW	0.	1.	11.	16.	19.	17.	20.	13.	5.	2.	3.	18.	127.	7.44
WSW	0.	3.	2.	11.	26.	24.	24.	12.	6.	0.	2.	14.	124.	6.66
W	0.	0.	10.	14.	21.	41.	35.	31.	18.	10.	14.	44.	240.	8.08
WNW	0.	1.	9.	11.	10.	11.	12.	13.	22.	9.	6.	21.	121.	7.85
NW	0.	1.	0.	3.	8.	14.	10.	4.	7.	8.	1.	8.	63.	7.17
NNW	0.	0.	4.	6.	9.	2.	3.	4.	3.	1.	0.	2.	34.	5.90
N	0.	2.	7.	13.	11.	12.	14.	14.	3.	7.	2.	1.	86.	5.88
VARIABLE													0.	0.00
CALM													0.	0.00
TOTAL	1.	22.	91.	196.	222.	266.	269.	225.	182.	123.	90.	292.	1979.	7.71

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN PERCENT OF TOTAL)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.00	0.25	0.56	1.62	2.48	3.34	3.69	3.18	3.13	2.98	1.77	1.31	24.31	7.25
NE	0.00	0.05	0.40	1.11	0.86	0.25	0.20	0.10	0.10	0.05	0.00	0.25	3.39	5.10
ENE	0.00	0.13	0.20	0.20	0.35	0.25	0.00	0.05	0.05	0.00	0.05	0.15	1.47	5.63
E	0.00	0.00	0.30	0.33	0.05	0.15	0.00	0.10	0.00	0.00	0.05	0.00	1.01	4.39
ESE	0.00	0.15	0.25	0.15	0.10	0.30	0.30	0.05	0.10	0.10	0.05	0.76	2.32	9.06
SE	0.05	0.00	0.20	0.31	0.44	1.06	1.62	1.41	1.16	0.61	0.35	2.17	9.80	9.00
SSE	0.00	0.10	0.45	0.66	0.51	0.61	0.61	0.56	0.20	0.20	0.35	2.12	6.37	10.08
S	0.00	0.00	0.15	0.86	0.56	0.51	0.40	0.31	0.66	0.10	0.10	1.62	5.46	9.28
SSW	0.00	0.00	0.10	0.61	0.40	0.86	0.81	0.71	0.56	0.45	0.30	0.91	5.71	8.24
SW	0.00	0.05	0.56	0.81	0.96	0.86	1.01	0.64	0.25	0.10	0.25	0.91	6.42	7.44
WSW	0.00	0.15	0.10	0.56	1.31	1.21	0.61	0.30	0.00	0.10	0.71	2.22	12.13	6.66
W	0.00	0.00	0.31	0.81	1.06	2.07	1.77	1.37	0.91	0.51	0.71	2.22	12.13	8.08
WNW	0.00	0.05	0.25	0.56	0.51	0.56	0.61	0.66	1.11	0.45	0.30	1.06	6.11	7.85
NW	0.00	0.05	0.00	0.15	0.40	0.71	0.51	0.30	0.35	0.25	0.05	0.40	3.18	7.17
NNW	0.00	0.00	0.20	0.30	0.45	0.10	0.15	0.20	0.15	0.05	0.00	0.10	1.72	5.90
N	0.00	0.10	0.35	0.66	0.56	0.61	0.71	0.71	0.15	0.35	0.10	0.05	4.35	5.88
VARIABLE													0.00	0.00
CALM													0.00	0.00
TOTAL	0.05	1.11	4.60	9.90	11.22	13.44	13.59	11.37	9.20	6.22	4.55	14.75	100.00	7.71

TOTAL NUMBER OF POSSIBLE OBSERVATIONS - 2160

TOTAL NUMBER OF OBSERVATIONS WITH VALID SPEED, DIRECTION AND STABILITY - 1947

Table 3A JFD's First Quarter 1983

Stability Class A11

SOUTHERN CALIFORNIA EDISON COMPANY  
 SAN ONOFRE NUCLEAR GENERATING STATION  
 2ND QUARTER, 1983  
 DAMES AND MOORE JOB NO. - 00377-082-09  
 DATA PERIOD- 04/01/83 TO 06/30/83  
 STABILITY CLASS BAA (10-40 METERS )  
 WINDS AT 10 METER LEVEL

23-JUL-83

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN NUMBER OF OCCURRENCES)

WIND DIRECTION	UPPER CLASS INTERVALS OF WIND SPEED (MPH)											TOTAL	MEAN SPEED
	1	2	3	4	5	6	7	8	9	10	11	>11	
NNE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
NE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
ENE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
E	0.	0.	0.	0.	0.	0.	0.	0.	1.	0.	0.	2.	7.35
ESE	0.	0.	0.	0.	0.	1.	0.	0.	1.	0.	0.	1.	11.25
SE	0.	0.	0.	0.	0.	0.	0.	0.	1.	0.	0.	31.	9.98
SSE	0.	0.	0.	0.	0.	1.	2.	3.	4.	4.	5.	12.	8.55
S	0.	0.	0.	1.	3.	3.	11.	13.	7.	14.	7.	66.	7.37
SSW	0.	0.	1.	4.	12.	13.	17.	24.	21.	12.	8.	114.	6.99
SW	0.	0.	0.	2.	16.	22.	34.	29.	22.	7.	3.	137.	7.65
WSW	0.	0.	0.	1.	6.	18.	33.	48.	35.	16.	4.	168.	8.17
W	1.	0.	0.	0.	8.	23.	30.	37.	49.	29.	2.	193.	7.89
WNW	0.	0.	0.	0.	2.	3.	10.	9.	9.	3.	4.	44.	7.75
NW	0.	0.	0.	0.	1.	0.	0.	0.	0.	0.	1.	2.	0.00
NNW	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
N	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
VARIABLE												1.	0.20
CALM													
TOTAL	1.	0.	1.	8.	48.	84.	137.	163.	149.	87.	34.	47.	760.

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN PERCENT OF TOTAL)

WIND DIRECTION	UPPER CLASS INTERVALS OF WIND SPEED (MPH)											TOTAL	MEAN SPEED
	1	2	3	4	5	6	7	8	9	10	11	>11	
NNE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
ENE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
E	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
ESE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
SE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
SSE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
S	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
SSW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
SW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
WSW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
W	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
WNW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NNW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
N	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
VARIABLE												0.00	0.00
CALM													
TOTAL	0.03	0.00	0.03	0.37	2.21	3.87	6.31	7.51	6.87	4.01	1.57	2.17	35.02

TOTAL NUMBER OF POSSIBLE OBSERVATIONS - 2184

TOTAL NUMBER OF OBSERVATIONS WITH VALID SPEED, DIRECTION AND STABILITY - 2170

Table 3B JFD's Second Quarter 1983

Stability Class A

SOUTHERN CALIFORNIA EDISON COMPANY  
 SAN ONOFRE NUCLEAR GENERATING STATION  
 2ND QUARTER, 1983  
 DAMES AND MOORE JOB NO. - 00377-082-09  
 DATA PERIOD- 04/01/83 TO 06/30/83  
 STABILITY CLASS B (10-40 METERS)  
 WINDS AT 10 METER LEVEL

29-JUL-83

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN NUMBER OF OCCURRENCES)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.	0.	0.	0.	0.	1.	0.	0.	0.	0.	0.	0.	1.	5.40
NE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
ENE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
E	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
ESE	0.	0.	0.	0.	0.	0.	0.	0.	0.	1.	0.	1.	2.	11.33
SE	0.	0.	0.	0.	0.	0.	0.	0.	0.	1.	2.	0.	3.	8.87
SSE	0.	0.	0.	0.	0.	1.	0.	0.	3.	1.	0.	0.	5.	8.96
S	0.	0.	0.	0.	2.	0.	1.	2.	1.	0.	0.	3.	7.	5.60
SSW	0.	0.	1.	1.	0.	0.	0.	0.	0.	0.	1.	0.	3.	4.57
SW	0.	0.	0.	2.	2.	2.	0.	0.	0.	0.	0.	0.	6.	5.03
WSW	0.	0.	0.	2.	0.	1.	0.	1.	0.	0.	0.	0.	4.	6.91
W	0.	0.	0.	2.	3.	1.	0.	2.	0.	0.	1.	2.	11.	5.87
WNW	0.	0.	0.	0.	2.	2.	2.	0.	1.	0.	0.	0.	7.	4.90
NW	0.	0.	0.	0.	1.	0.	0.	0.	0.	0.	0.	0.	1.	5.20
NNW	0.	0.	0.	0.	0.	1.	0.	0.	0.	0.	0.	0.	0.	0.00
N	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
VARIABLE													0.	0.00
CALM													0.	0.00
TOTAL	0.	0.	1.	7.	10.	9.	3.	5.	5.	2.	4.	6.	52.	6.97

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN PERCENT OF TOTAL)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.00	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.03	5.40
NE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
ENE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
E	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
ESE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.03	0.00	0.03	0.09	11.33
SE	0.00	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.14	0.03	0.09	0.00	0.32	8.87
SSE	0.00	0.00	0.00	0.00	0.00	0.03	0.03	0.09	0.03	0.00	0.00	0.14	0.41	8.96
S	0.00	0.00	0.00	0.00	0.09	0.00	0.03	0.09	0.03	0.00	0.00	0.14	0.28	5.60
SSW	0.00	0.00	0.03	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.03	0.00	0.14	4.57
SW	0.00	0.00	0.00	0.09	0.09	0.09	0.00	0.00	0.00	0.00	0.00	0.00	0.18	5.03
WSW	0.00	0.00	0.00	0.09	0.00	0.03	0.00	0.03	0.00	0.00	0.00	0.00	0.31	6.91
W	0.00	0.00	0.00	0.09	0.14	0.03	0.00	0.09	0.03	0.00	0.00	0.00	0.32	5.87
WNW	0.00	0.00	0.00	0.00	0.09	0.09	0.09	0.00	0.03	0.00	0.00	0.00	0.03	4.90
NW	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.03	5.20
NNW	0.00	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
N	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
VARIABLE													0.00	0.00
CALM													0.00	0.00
TOTAL	0.00	0.00	0.03	0.32	0.46	0.41	0.14	0.23	0.23	0.09	0.18	0.28	2.40	6.97

TOTAL NUMBER OF POSSIBLE OBSERVATIONS - 2184

TOTAL NUMBER OF OBSERVATIONS WITH VALID SPEED, DIRECTION AND STABILITY - 2170

Table 3B JFD's Second Quarter 1983

Stability Class B

SOUTHERN CALIFORNIA EDISON COMPANY  
 SAN ONOFRE NUCLEAR GENERATING STATION  
 2ND QUARTER, 1983  
 DAMES AND MOORE JOB NO. - 00377-082-09  
 DATA PERIOD- 04/01/83 TO 04/30/83  
 STABILITY CLASS 6C (10-40 METERS )  
 WINDS AT 10 METER LEVEL

25-JUL-83

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN NUMBER OF OCCURRENCES)

WIND DIRECTION	UPPER CLASS INTERVALS OF WIND SPEED (MPH)												TOTAL	MEAN SPEED
	1	2	3	4	5	6	7	8	9	10	11	>11		
NNE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
NE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
ENE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
E	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
ESE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
SE	0.	0.	0.	0.	0.	0.	1.	1.	0.	0.	1.	0.	3.	8.30
SSE	0.	0.	0.	0.	1.	0.	1.	2.	2.	0.	1.	2.	9.	9.20
S	0.	0.	0.	1.	0.	1.	2.	0.	1.	0.	0.	2.	7.	8.30
SSW	0.	0.	0.	1.	1.	3.	1.	2.	1.	0.	0.	1.	10.	7.08
SW	0.	0.	0.	2.	3.	1.	2.	0.	0.	0.	0.	0.	8.	4.86
WSW	0.	0.	0.	2.	1.	0.	0.	1.	3.	2.	0.	1.	10.	7.46
W	0.	0.	0.	2.	3.	3.	1.	2.	0.	0.	0.	1.	12.	6.36
WNW	0.	0.	0.	3.	3.	1.	2.	2.	1.	0.	0.	0.	13.	5.51
NW	0.	0.	0.	0.	2.	0.	0.	0.	0.	1.	0.	0.	3.	6.43
NNW	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
N	0.	0.	0.	1.	1.	1.	0.	0.	0.	0.	0.	0.	3.	4.33
VARIABLE													0.	0.00
CALM													0.	0.00
TOTAL	0.	0.	0.	12.	16.	10.	10.	10.	8.	3.	2.	7.	78.	6.80

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN PERCENT OF TOTAL)

WIND DIRECTION	UPPER CLASS INTERVALS OF WIND SPEED (MPH)												TOTAL	MEAN SPEED
	1	2	3	4	5	6	7	8	9	10	11	>11		
NNE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
ENE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
E	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
ESE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
SE	0.00	0.00	0.00	0.00	0.00	0.00	0.03	0.03	0.00	0.00	0.03	0.00	0.14	8.30
SSE	0.00	0.00	0.00	0.00	0.03	0.00	0.03	0.09	0.03	0.00	0.03	0.09	0.41	9.20
S	0.00	0.00	0.00	0.03	0.03	0.14	0.03	0.09	0.03	0.00	0.00	0.03	0.46	7.08
SSW	0.00	0.00	0.00	0.03	0.03	0.14	0.03	0.09	0.03	0.00	0.00	0.00	0.37	4.86
SW	0.00	0.00	0.00	0.09	0.16	0.03	0.09	0.00	0.00	0.00	0.00	0.03	0.46	7.46
WSW	0.00	0.00	0.00	0.09	0.03	0.00	0.00	0.03	0.14	0.09	0.00	0.03	0.55	6.36
W	0.00	0.00	0.00	0.09	0.14	0.14	0.03	0.09	0.00	0.00	0.00	0.03	0.60	5.51
WNW	0.00	0.00	0.00	0.14	0.18	0.03	0.09	0.00	0.00	0.03	0.00	0.00	0.14	6.43
NW	0.00	0.00	0.00	0.00	0.09	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00
NNW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.14	4.33
N	0.00	0.00	0.00	0.03	0.03	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
VARIABLE													0.00	0.00
CALM													0.00	0.00
TOTAL	0.00	0.00	0.00	0.33	0.74	0.46	0.46	0.46	0.37	0.34	0.09	0.32	3.59	6.80

TOTAL NUMBER OF POSSIBLE OBSERVATIONS - 2184  
 TOTAL NUMBER OF OBSERVATIONS WITH VALID SPEED, DIRECTION AND STABILITY - 2170

Table 3B JFD's Second Quarter 1983

Stability Class C

25-JUL-83

SOUTHERN CALIFORNIA EDISON COMPANY  
 SAN ONOFRE NUCLEAR GENERATING STATION  
 2ND QUARTER, 1983  
 DAMES AND MOORE JOB NO. - 00377-082-09  
 DATA PERIOD- 04/01/83 TO 06/30/83  
 STABILITY CLASS SDS (10-40 METERS )  
 WINDS AT 10 METER LEVEL

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN NUMBER OF OCCURRENCES)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.	0.	7.	14.	15.	11.	5.	5.	0.	0.	0.	0.	57.	4.72
NE	0.	0.	2.	1.	3.	4.	0.	0.	0.	0.	0.	0.	10.	4.43
ENE	0.	0.	2.	4.	3.	2.	0.	0.	0.	0.	0.	0.	11.	4.03
E	0.	0.	1.	2.	3.	7.	8.	0.	0.	0.	1.	3.	42.	6.38
ESE	0.	0.	0.	3.	11.	9.	7.	8.	0.	0.	1.	3.	102.	7.23
SE	0.	0.	0.	2.	16.	18.	16.	18.	10.	12.	7.	16.	111.	7.39
SSE	0.	0.	2.	11.	14.	23.	15.	11.	5.	7.	7.	16.	84.	6.04
S	0.	1.	4.	10.	21.	13.	13.	9.	6.	0.	1.	6.	98.	6.90
SSW	0.	1.	2.	5.	0.	6.	10.	4.	3.	1.	2.	2.	43.	6.15
SW	0.	0.	6.	3.	6.	6.	10.	4.	2.	0.	2.	4.	43.	6.07
WSW	0.	1.	8.	10.	3.	5.	5.	6.	1.	1.	0.	7.	50.	5.62
W	0.	0.	9.	17.	4.	3.	3.	5.	1.	3.	1.	2.	54.	5.68
WNW	0.	0.	8.	14.	10.	4.	5.	1.	9.	3.	3.	1.	42.	5.58
NW	0.	0.	6.	11.	5.	4.	6.	2.	1.	3.	3.	1.	19.	4.66
NNW	0.	0.	1.	7.	4.	4.	0.	3.	0.	0.	0.	0.	24.	3.93
N	0.	0.	4.	12.	4.	2.	2.	0.	0.	0.	0.	0.	0.	0.00
VARIABLE													0.	0.00
CALM													0.	0.00
TOTAL	0.	3.	56.	126.	130.	124.	108.	79.	40.	29.	23.	53.	771.	6.13

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN PERCENT OF TOTAL)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.00	0.00	0.32	0.63	0.69	0.51	0.23	0.23	0.00	0.00	0.00	0.00	2.63	4.72
NE	0.00	0.00	0.09	0.03	0.14	0.18	0.00	0.00	0.00	0.00	0.00	0.00	0.46	4.43
ENE	0.00	0.00	0.09	0.18	0.14	0.09	0.00	0.00	0.00	0.00	0.00	0.00	0.51	4.03
E	0.00	0.00	0.03	0.09	0.14	0.32	0.37	0.00	0.00	0.00	0.03	0.14	1.94	6.38
ESE	0.00	0.00	0.00	0.14	0.51	0.41	0.32	0.37	0.00	0.00	0.03	0.14	4.70	7.23
SE	0.00	0.00	0.00	0.09	0.74	0.83	0.74	0.83	0.46	0.35	0.18	0.28	5.12	7.39
SSE	0.00	0.00	0.09	0.51	0.65	1.06	0.69	0.51	0.23	0.32	0.32	0.74	3.87	6.04
S	0.00	0.03	0.18	0.46	0.97	0.60	0.60	0.41	0.28	0.00	0.03	0.28	2.67	6.90
SSW	0.00	0.03	0.09	0.23	0.37	0.41	0.60	0.32	0.14	0.09	0.09	0.28	1.98	6.15
SW	0.00	0.00	0.28	0.14	0.28	0.28	0.46	0.18	0.14	0.03	0.09	0.09	1.98	6.07
WSW	0.00	0.03	0.23	0.46	0.14	0.23	0.23	0.28	0.09	0.00	0.09	0.18	2.30	5.62
W	0.00	0.00	0.41	0.78	0.18	0.14	0.14	0.23	0.03	0.03	0.00	0.32	2.49	5.68
WNW	0.00	0.00	0.23	0.63	0.46	0.18	0.23	0.03	0.41	0.14	0.03	0.09	1.94	5.58
NW	0.00	0.00	0.28	0.51	0.23	0.18	0.28	0.09	0.03	0.14	0.14	0.03	0.88	4.66
NNW	0.00	0.00	0.03	0.32	0.18	0.18	0.00	0.14	0.00	0.00	0.00	0.00	1.11	3.93
N	0.00	0.00	0.18	0.55	0.18	0.09	0.09	0.00	0.00	0.00	0.00	0.00	0.00	0.00
VARIABLE													0.00	0.00
CALM													0.00	0.00
TOTAL	0.00	0.14	2.58	5.81	5.99	5.71	4.98	3.64	1.84	1.34	1.06	2.44	35.53	6.13

TOTAL NUMBER OF POSSIBLE OBSERVATIONS - 2184

TOTAL NUMBER OF OBSERVATIONS WITH VALID SPEED, DIRECTION AND STABILITY - 2170

Table 38 JFD's Second Quarter 1983  
 Stability Class D

SOUTHERN CALIFORNIA EDISON COMPANY  
 SAN ONOFRE NUCLEAR GENERATING STATION  
 2ND QUARTER, 1983  
 DAMEB AND MOORE JOB NO. - 00377-082-09  
 DATA PERIOD- 04/01/83 TO 06/30/83  
 STABILITY CLASS 0E0 (10-40 METERS )  
 WINDS AT 10 METER LEVEL

23-JUL-83

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN NUMBER OF OCCURRENCES)

WIND DIRECTION	UPPER CLASS INTERVALS OF WIND SPEED (MPH)											TOTAL	MEAN SPEED	
	1	2	3	4	5	6	7	8	9	10	11			>11
NNE	0.	0.	7.	20.	7.	13.	10.	6.	3.	1.	0.	0.	67.	5.10
NE	0.	0.	0.	1.	1.	1.	0.	0.	0.	0.	0.	0.	3.	4.50
ENE	0.	0.	1.	3.	2.	0.	0.	0.	0.	0.	0.	0.	6.	3.70
E	0.	0.	2.	3.	1.	1.	2.	0.	0.	0.	0.	0.	9.	4.32
ESE	0.	0.	1.	0.	3.	4.	2.	0.	0.	0.	0.	0.	10.	5.06
SE	0.	0.	0.	3.	1.	3.	2.	1.	0.	0.	0.	0.	12.	5.32
SSE	0.	0.	2.	0.	1.	0.	0.	1.	0.	0.	0.	1.	5.	7.32
S	0.	0.	3.	1.	0.	1.	0.	0.	0.	0.	0.	0.	5.	3.72
SSW	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
SW	0.	1.	2.	3.	0.	0.	0.	0.	1.	0.	0.	0.	7.	3.63
WSW	0.	0.	0.	0.	1.	0.	0.	1.	1.	1.	0.	0.	4.	7.73
W	0.	0.	0.	0.	0.	1.	0.	0.	0.	0.	0.	1.	2.	8.75
WNW	0.	0.	0.	0.	1.	0.	2.	1.	0.	1.	1.	0.	6.	7.60
NW	0.	2.	0.	1.	1.	1.	3.	1.	1.	1.	1.	1.	13.	6.45
NNW	0.	1.	0.	1.	0.	2.	4.	0.	0.	1.	0.	0.	9.	5.62
N	0.	0.	4.	7.	5.	9.	2.	3.	0.	0.	0.	0.	30.	4.75
VARIABLE													0.	0.00
CALM													0.	0.00
TOTAL	0.	4.	22.	43.	24.	38.	27.	14.	6.	5.	2.	3.	188.	5.23

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN PERCENT OF TOTAL)

WIND DIRECTION	UPPER CLASS INTERVALS OF WIND SPEED (MPH)											TOTAL	MEAN SPEED	
	1	2	3	4	5	6	7	8	9	10	11			>11
NNE	0.00	0.00	0.32	0.92	0.32	0.60	0.46	0.28	0.14	0.05	0.00	0.00	3.09	5.10
NE	0.00	0.00	0.00	0.05	0.05	0.05	0.00	0.00	0.00	0.00	0.00	0.00	0.14	4.50
ENE	0.00	0.00	0.05	0.14	0.09	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.28	3.70
E	0.00	0.00	0.09	0.14	0.05	0.05	0.09	0.00	0.00	0.00	0.00	0.00	0.41	4.32
ESE	0.00	0.00	0.05	0.00	0.14	0.18	0.09	0.00	0.00	0.00	0.00	0.00	0.46	5.06
SE	0.00	0.00	0.00	0.14	0.05	0.23	0.09	0.05	0.00	0.00	0.00	0.00	0.55	5.32
SSE	0.00	0.00	0.09	0.00	0.05	0.00	0.00	0.05	0.00	0.00	0.00	0.05	0.23	7.32
S	0.00	0.00	0.14	0.05	0.00	0.05	0.00	0.00	0.00	0.00	0.00	0.00	0.23	3.72
SSW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
SW	0.00	0.05	0.09	0.14	0.00	0.00	0.00	0.00	0.05	0.00	0.00	0.00	0.32	3.63
WSW	0.00	0.00	0.00	0.00	0.05	0.00	0.00	0.05	0.05	0.05	0.00	0.00	0.18	7.73
W	0.00	0.00	0.00	0.00	0.00	0.05	0.00	0.00	0.00	0.00	0.00	0.05	0.09	8.75
WNW	0.00	0.00	0.00	0.00	0.05	0.00	0.09	0.05	0.00	0.05	0.05	0.00	0.28	7.60
NW	0.00	0.09	0.00	0.05	0.05	0.05	0.14	0.05	0.05	0.05	0.05	0.05	0.60	6.45
NNW	0.00	0.05	0.00	0.05	0.00	0.09	0.18	0.00	0.00	0.05	0.00	0.00	0.41	5.62
N	0.00	0.00	0.18	0.32	0.23	0.41	0.09	0.14	0.00	0.00	0.00	0.00	1.38	4.75
VARIABLE													0.00	0.00
CALM													0.00	0.00
TOTAL	0.00	0.18	1.01	1.98	1.11	1.75	1.24	0.65	0.28	0.23	0.09	0.14	8.66	5.23

TOTAL NUMBER OF POSSIBLE OBSERVATIONS - 2184  
 TOTAL NUMBER OF OBSERVATIONS WITH VALID SPEED, DIRECTION AND STABILITY - 2170

Table 38 JFD's Second Quarter 1983  
 Stability Class E



SOUTHERN CALIFORNIA EDISON COMPANY  
 SAN ONOFRE NUCLEAR GENERATING STATION  
 2ND QUARTER, 1983  
 DAMES AND MOORE JOB NO. - 00377-082-09  
 DATA PERIOD- 04/01/83 TO 06/30/83  
 STABILITY CLASS FFB (10-40 METERS )  
 WINDS AT 10 METER LEVEL

25-JUL-83

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN NUMBER OF OCCURRENCES)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.	0.	2.	12.	20.	26.	22.	11.	5.	0.	0.	0.	98.	3.70
NE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
ENE	0.	0.	0.	2.	0.	0.	0.	0.	0.	0.	0.	0.	2.	3.50
E	0.	0.	1.	0.	0.	0.	0.	0.	0.	0.	0.	0.	1.	2.80
ESE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
SE	0.	0.	0.	1.	1.	5.	3.	0.	0.	1.	0.	0.	11.	6.15
SSE	0.	0.	2.	2.	1.	1.	3.	1.	3.	0.	0.	0.	13.	5.75
S	0.	0.	0.	1.	0.	3.	0.	0.	0.	0.	0.	0.	4.	5.23
SSW	0.	0.	0.	0.	0.	1.	0.	0.	0.	0.	0.	0.	1.	5.50
SW	0.	0.	0.	0.	0.	0.	0.	1.	0.	0.	0.	0.	3.	5.07
WSW	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
W	0.	0.	0.	0.	1.	0.	0.	0.	0.	0.	0.	0.	1.	4.90
WNW	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
NW	0.	0.	0.	0.	0.	0.	0.	1.	0.	0.	0.	0.	1.	7.60
NNW	0.	0.	0.	0.	1.	0.	1.	0.	0.	0.	0.	0.	2.	5.90
N	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
VARIABLE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
CALM	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
TOTAL	0.	0.	8.	20.	24.	36.	29.	14.	8.	1.	0.	0.	137.	5.67

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN PERCENT OF TOTAL)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.00	0.00	0.09	0.35	0.92	1.20	1.01	0.51	0.23	0.00	0.00	0.00	4.32	3.70
NE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
ENE	0.00	0.00	0.00	0.09	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.09	3.50
E	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.03	2.80
ESE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
SE	0.00	0.00	0.00	0.03	0.03	0.23	0.14	0.00	0.00	0.03	0.00	0.00	0.31	6.15
SSE	0.00	0.00	0.00	0.09	0.09	0.03	0.03	0.14	0.03	0.14	0.00	0.00	0.60	5.75
S	0.00	0.00	0.00	0.03	0.00	0.14	0.00	0.00	0.00	0.00	0.00	0.00	0.18	5.23
SSW	0.00	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.03	5.50
SW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.14	5.07
WSW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
W	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.03	4.90
WNW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.03	7.60
NNW	0.00	0.00	0.00	0.00	0.03	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.09	5.90
N	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
VARIABLE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
CALM	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
TOTAL	0.00	0.00	0.23	0.92	1.11	1.66	1.34	0.65	0.37	0.05	0.00	0.00	6.31	5.67

TOTAL NUMBER OF POSSIBLE OBSERVATIONS - 2184

TOTAL NUMBER OF OBSERVATIONS WITH VALID SPEED, DIRECTION AND STABILITY - 2170

Table 3B JFD's Second Quarter 1983

Stability Class F

SOUTHERN CALIFORNIA EDISON COMPANY  
 SAN ONOFRE NUCLEAR GENERATING STATION  
 2ND QUARTER, 1983  
 DAMES AND MOORE JOB NO. - 00377-082-09  
 DATA PERIOD- 04/01/83 TO 06/30/83  
 STABILITY CLASS 608 (10-40 METERS )  
 WINDS AT 10 METER LEVEL

25-JUL-83

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN NUMBER OF OCCURRENCES)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.	0.	0.	0.	3.	7.	31.	42.	30.	23.	7.	1.	144.	7.86
NE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
ENE	0.	0.	0.	1.	0.	0.	0.	0.	0.	0.	0.	0.	1.	3.80
E	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
ESE	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
SE	0.	0.	1.	0.	0.	0.	2.	0.	2.	1.	0.	2.	8.	8.93
SSE	0.	0.	1.	2.	1.	1.	1.	1.	3.	4.	0.	1.	19.	7.57
S	0.	0.	1.	0.	0.	0.	1.	0.	1.	0.	0.	0.	3.	6.13
SSW	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
SW	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
WSW	0.	0.	0.	0.	1.	0.	0.	0.	0.	0.	0.	0.	1.	4.70
W	0.	0.	0.	1.	0.	1.	0.	0.	0.	0.	0.	0.	2.	4.75
WNW	0.	0.	0.	0.	0.	0.	1.	0.	0.	0.	0.	0.	1.	6.70
NW	0.	0.	0.	1.	0.	0.	0.	0.	0.	0.	0.	0.	0.	4.00
NNW	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.00
N	0.	0.	0.	0.	0.	0.	2.	1.	2.	3.	0.	0.	8.	8.39
VARIABLE													0.	0.00
CALM													0.	0.00
TOTAL	0.	0.	3.	5.	5.	9.	38.	44.	38.	31.	7.	4.	184.	7.78

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN PERCENT OF TOTAL)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.00	0.00	0.00	0.00	0.14	0.32	1.43	1.94	1.38	1.06	0.32	0.03	6.64	7.86
NE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
ENE	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.03	3.80
E	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
ESE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
SE	0.00	0.00	0.03	0.00	0.00	0.00	0.09	0.00	0.09	0.03	0.00	0.09	0.37	8.93
SSE	0.00	0.00	0.03	0.09	0.03	0.03	0.03	0.03	0.14	0.18	0.00	0.03	0.69	7.57
S	0.00	0.00	0.03	0.00	0.00	0.00	0.03	0.00	0.03	0.00	0.00	0.00	0.14	6.13
SSW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
SW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
WSW	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.03	4.70
W	0.00	0.00	0.00	0.03	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.09	4.75
WNW	0.00	0.00	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.03	6.70
NW	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.03	4.00
NNW	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
N	0.00	0.00	0.00	0.00	0.00	0.00	0.09	0.03	0.09	0.14	0.00	0.00	0.37	8.39
VARIABLE													0.00	0.00
CALM													0.00	0.00
TOTAL	0.00	0.00	0.14	0.23	0.23	0.41	1.73	2.03	1.73	1.43	0.32	0.18	8.48	7.78

TOTAL NUMBER OF POSSIBLE OBSERVATIONS - 2184  
 TOTAL NUMBER OF OBSERVATIONS WITH VALID SPEED, DIRECTION AND STABILITY - 2170

Table 3B JFD's Second Quarter 1983  
 Stability Class G

SOUTHERN CALIFORNIA EDISON COMPANY  
 SAN ONOFRE NUCLEAR GENERATING STATION  
 2ND QUARTER, 1983  
 DAMES AND MOORE JOB NO. - 00377-082-09  
 DATA PERIOD- 04/01/83 TO 06/30/83  
 STABILITY CLASS ALL (10-40 METERS )  
 WINDS AT 10 METER LEVEL

25-JUL-83

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN NUMBER OF OCCURRENCES)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.	0.	16.	46.	43.	58.	68.	64.	38.	24.	7.	1.	367.	6.29
NE	0.	0.	2.	2.	4.	3.	0.	0.	0.	0.	0.	0.	13.	4.46
ENE	0.	0.	3.	10.	5.	2.	0.	0.	0.	0.	0.	0.	20.	3.88
E	0.	0.	4.	3.	4.	8.	10.	0.	0.	0.	0.	0.	31.	3.06
ESE	0.	0.	1.	3.	14.	14.	9.	8.	1.	0.	1.	3.	54.	6.17
SE	0.	0.	1.	6.	18.	28.	24.	20.	13.	15.	8.	10.	140.	7.23
SSE	0.	0.	7.	19.	18.	27.	22.	19.	20.	16.	15.	32.	191.	7.83
S	0.	1.	8.	14.	26.	21.	28.	24.	16.	14.	8.	18.	178.	7.13
SSW	0.	1.	4.	11.	21.	26.	31.	33.	25.	14.	11.	9.	186.	7.17
SW	0.	1.	8.	14.	27.	31.	46.	34.	26.	8.	9.	4.	204.	6.31
WSW	0.	1.	3.	13.	12.	24.	38.	57.	41.	19.	6.	12.	230.	7.29
W	1.	0.	9.	22.	19.	32.	34.	46.	50.	30.	3.	25.	271.	7.33
WNW	0.	0.	3.	17.	19.	10.	22.	13.	20.	9.	6.	4.	125.	6.33
NW	0.	2.	4.	13.	10.	8.	9.	4.	2.	8.	9.	2.	63.	5.87
NNW	0.	1.	1.	8.	9.	7.	9.	3.	0.	1.	0.	0.	31.	5.04
N	0.	0.	8.	20.	10.	12.	6.	4.	2.	3.	0.	0.	63.	4.88
VARIABLE													0.	0.00
CALM													1.	0.20
TOTAL	1.	7.	88.	221.	297.	310.	352.	329.	254.	198.	72.	120.	2170.	6.80

WIND FREQUENCY DISTRIBUTION  
 (FREQUENCY IN PERCENT OF TOTAL)

WIND DIRECTION	1	2	3	4	5	6	7	8	9	10	11	>11	TOTAL	MEAN SPEED
NNE	0.00	0.00	0.74	2.12	2.07	2.67	3.13	2.93	1.73	1.18	0.32	0.03	16.91	6.29
NE	0.00	0.00	0.09	0.09	0.18	0.23	0.00	0.00	0.00	0.00	0.00	0.00	0.60	4.46
ENE	0.00	0.00	0.14	0.46	0.23	0.09	0.00	0.00	0.00	0.00	0.00	0.00	0.92	3.88
E	0.00	0.00	0.18	0.23	0.18	0.37	0.46	0.00	0.00	0.00	0.00	0.00	1.43	3.06
ESE	0.00	0.00	0.03	0.14	0.63	0.63	0.41	0.37	0.03	0.00	0.03	0.14	2.49	6.17
SE	0.00	0.00	0.03	0.28	0.83	1.29	1.11	0.92	0.60	0.69	0.23	0.46	6.43	7.23
SSE	0.00	0.00	0.32	0.69	0.83	1.24	1.01	0.88	0.92	0.74	0.69	1.47	8.80	7.83
S	0.00	0.03	0.37	0.63	1.20	0.97	1.29	1.11	0.74	0.63	0.37	0.83	8.20	7.13
SSW	0.00	0.03	0.18	0.51	0.97	1.20	1.43	1.52	1.13	0.65	0.31	0.41	8.37	7.17
SW	0.00	0.03	0.37	0.63	1.24	1.43	2.12	1.57	1.20	0.37	0.23	0.18	9.40	6.31
WSW	0.00	0.03	0.23	0.69	0.53	1.11	1.75	2.63	1.89	0.88	0.28	0.33	10.60	7.29
W	0.03	0.00	0.41	1.01	0.88	1.47	1.37	2.12	2.30	1.38	0.14	1.13	12.49	7.33
WNW	0.00	0.00	0.23	0.78	0.88	0.46	1.01	0.60	0.92	0.41	0.28	0.18	5.76	6.33
NW	0.00	0.09	0.28	0.60	0.46	0.23	0.41	0.18	0.09	0.23	0.23	0.09	2.90	5.87
NNW	0.00	0.03	0.03	0.37	0.23	0.32	0.23	0.14	0.00	0.03	0.00	0.00	1.43	5.04
N	0.00	0.00	0.37	0.92	0.46	0.53	0.28	0.18	0.09	0.14	0.00	0.00	3.00	4.88
VARIABLE													0.03	0.00
CALM													0.03	0.20
TOTAL	0.03	0.32	4.06	10.18	11.84	14.29	16.22	13.16	11.71	7.28	3.32	5.33	100.00	6.80

TOTAL NUMBER OF POSSIBLE OBSERVATIONS - 2184

TOTAL NUMBER OF OBSERVATIONS WITH VALID SPEED, DIRECTION AND STABILITY - 2170

Table 3B JFD's Second Quarter 1983

Stability Class All

#### SECTION H. 10 CFR 50, APPENDIX I, CONSIDERATIONS

Current Technical Specifications do not require and effluent monitoring capabilities do not allow, strict compliance to the provisions of Appendix I. However, using data from an Appendix I study conducted for the years 1973, 1974, and 1975, conclusions may be drawn regarding relative release amounts versus doses assessed.

A submittal dated October 6, 1976, titled: Evaluation of Radioactive Gaseous Effluents from the San Onofre Nuclear Generating Station - Unit 1. For the Years 1973, 1974 and 1975 (CN05-RAD) lists releases and dose assessments for 1973, 1974, and 1975. In 1975, Appendix I criteria were met and the lowest doses were obtained. The releases for the first half of 1983 were categorized as Noble Gas, Particulate, Tritium and Iodine. Activity released in each of these categories was at least an order of magnitude less than in 1975. Therefore, it may be concluded that the current reporting period meets Appendix I constraints.

## SECTION I. 40 CFR 190 CONSIDERATIONS

Current capabilities at Unit-1 do not allow for the direct determination (calculation) of doses from liquid and gaseous releases. However, comparing the releases from this reporting period to the referenced study in Section H, and direct dose measurements via TLDs located on the beach west of Unit-1, it is reasonable to conclude that the doses from releases at Unit-1, including scattered and direct radiation, comply with the provision of 40 CFR 190.

## SECTION J. CONCLUSIONS

- Radioactive releases totaled 14.53 curies for gaseous effluent releases and 12.13 curies total for liquid releases. Gaseous releases resulted primarily from calibrations of monitors (10.6 curies). Liquid releases were primarily tritium (11.07 curies).
- Unit 1 generated radioactive releases which were below the Technical Specifications Limits,  $7.52\text{E}-1\%$  for gaseous effluents and  $3.12\text{E}+0\%$  for liquid effluents.
- Radwaste shipments totaled 15 shipments to Richland, Washington. There were 194 cubic meters of solid radwaste shipped containing 226 curies of radioactivity.
- Meteorological conditions during the semiannual period were typical of the meteorology at SONGS-1. Meteorological dispersion was good 32% of the time, fair 41% of the time and poor 26% of the time.
- 10 CFR 50, Appendix I criteria was met and SONGS-1 had no measurable radiological impact on the surrounding environment during the reporting period. This is based on a comparison with a report generated for the years 1973, 1974, and 1975 which showed compliance with the criteria set forth in Appendix I to 10 CFR 50.
- 40 CFR 190 compliance has been demonstrated using the comparison of this reporting period data with the study referenced in Section H.
- For liquid releases, marine sample analyses will indicate if any of the particulate activity has concentrated in marine life. Detection of any tritium in these samples is not expected because of the rapid turnover of water in marine life and because of the bulk of ocean water available for dilution.
- The net results of these effluent releases analyses indicate that the operation of SONGS-1 should not have produced any detrimental effect on the environment.

*Southern California Edison Company*

SAN ONOFRE NUCLEAR GENERATING STATION

P.O. BOX 128

SAN CLEMENTE, CALIFORNIA 92672

**SCE**

H. B. RAY  
STATION MANAGER

TELEPHONE  
(714) 492-7700

August 16, 1983

U.S. Nuclear Regulatory Commission  
Office of Inspection and Enforcement  
Region V  
1450 Maria Lane, Suite 210  
Walnut Creek, California 94596-5368

Attention: Mr. J.B. Martin, Regional Administrator

Dear Sir:

Subject: Docket No. 50-206  
Semiannual Radioactive Effluent Release Report  
San Onofre Nuclear Generating Station, Unit 1

Environmental Technical Specification 5.6.2 of Provisional Operating License No. DPR-13 for San Onofre Nuclear Generating Station, Unit 1, requires a semiannual report of the radioactive content of effluents released to unrestricted areas and shipments of solid waste during the previous six months be submitted within sixty days after July 1, 1983. Pursuant to this requirement, the semiannual report for January 1, 1983, through June 30, 1983, is enclosed.

This report has been prepared in the general format of NRC Regulatory Guide 1.21, sections pertinent to SONGS 1. Included in this report are quarterly effluent summaries, percent of Technical Specifications Limits, estimated total percent error, lower limit of detection concentrations, 40 CFR 190 consideration, meteorological data and 10 CFR 50, Appendix I considerations.

Please contact us if we can be of further assistance.

Sincerely,



Enclosures: 2 copies

11 IE-25

Mr. J.B. Martin

-2-

August 16, 1983

cc: A. J. D'Angelo (USNRC Resident Inspector, Unit 1)

U.S. Nuclear Regulatory Commission  
Office of Inspection and Enforcement

U.S. Nuclear Regulatory Commission  
Division of Technical Information and Document Control

Institute of Nuclear Power Operations (INPO)



U.S. Nuclear Regulatory Commission

August 16, 1983

bcc: California Public Utilities Commission  
Energy Branch  
350 McAllister  
San Francisco, California 94102

Los Angeles Public Utilities Commission  
Electric Branch  
107 South Broadway  
Los Angeles, California 90012

Dr. L. Bernath  
San Diego Gas & Electric Company  
P.O. Box 1831  
San Diego, California 92112

J. N. Sorenson  
NUS Corporation  
Four Research Place  
Rockville, Maryland 20850

Bechtel Power Corporation  
Attention: SFPD Library  
P.O. Box 3965  
San Francisco, California 94119

Director  
Nuclear Eng. & Operations Department  
Electric Power Research Institute  
3412 Hillview Avenue  
P.O. Box 10412  
Palo Alto, California 94303

Environmental & Regulatory Affairs  
M. Hertel

Manager of Nuclear Engineering, Safety, and Licensing  
K. P. Baskin, Room 410A

Acting Manager, Nuclear Engineering and Safety  
D. F. Pilmer

Senior Engineer, Environmental Engineering  
R. De La Parra

Manager Q.A.  
J. M. Curran, Room 169

Law Department, Room 328  
C. R. Kocher/J. A. Beoletto

H. B. Ray

bcc: (Continued)

- 2 -

August 16, 1983

Supervisor, Stem. Div. Chem.  
K. Hendersen

Nuclear (3)  
J. G. Haynes (Manager of Nuclear Operations)  
W. G. Zintl (Supervisor Operations Support)  
W. W. Strom (Supervisor Nuclear Safety)

Vice President, Nuclear Engineering and Operations  
Robert Dietch

Research and Development  
A. R. Strachan

California Regional Water Quality Control Board  
San Diego Region  
Attn: Mr. Leonard Burtman, Executive Officer  
6154 Mission Gorge Road, Suite 205  
San Diego, California 92120

P. J. Knapp

R. M. Rosenblum

D. E. Nunn

W. C. Moody

F. K. Massey

B. D. Graham

D. D. Duran

L. D. Brevig

F. Briggs

K. S. Helm

P. A. Croy

G. T. Gibson

J. A. Pagliaro

CDM Files