


Comanche Peak Nuclear Power Plant, Units 3 & 4  
COL Application  
Part 3 - Environmental Report

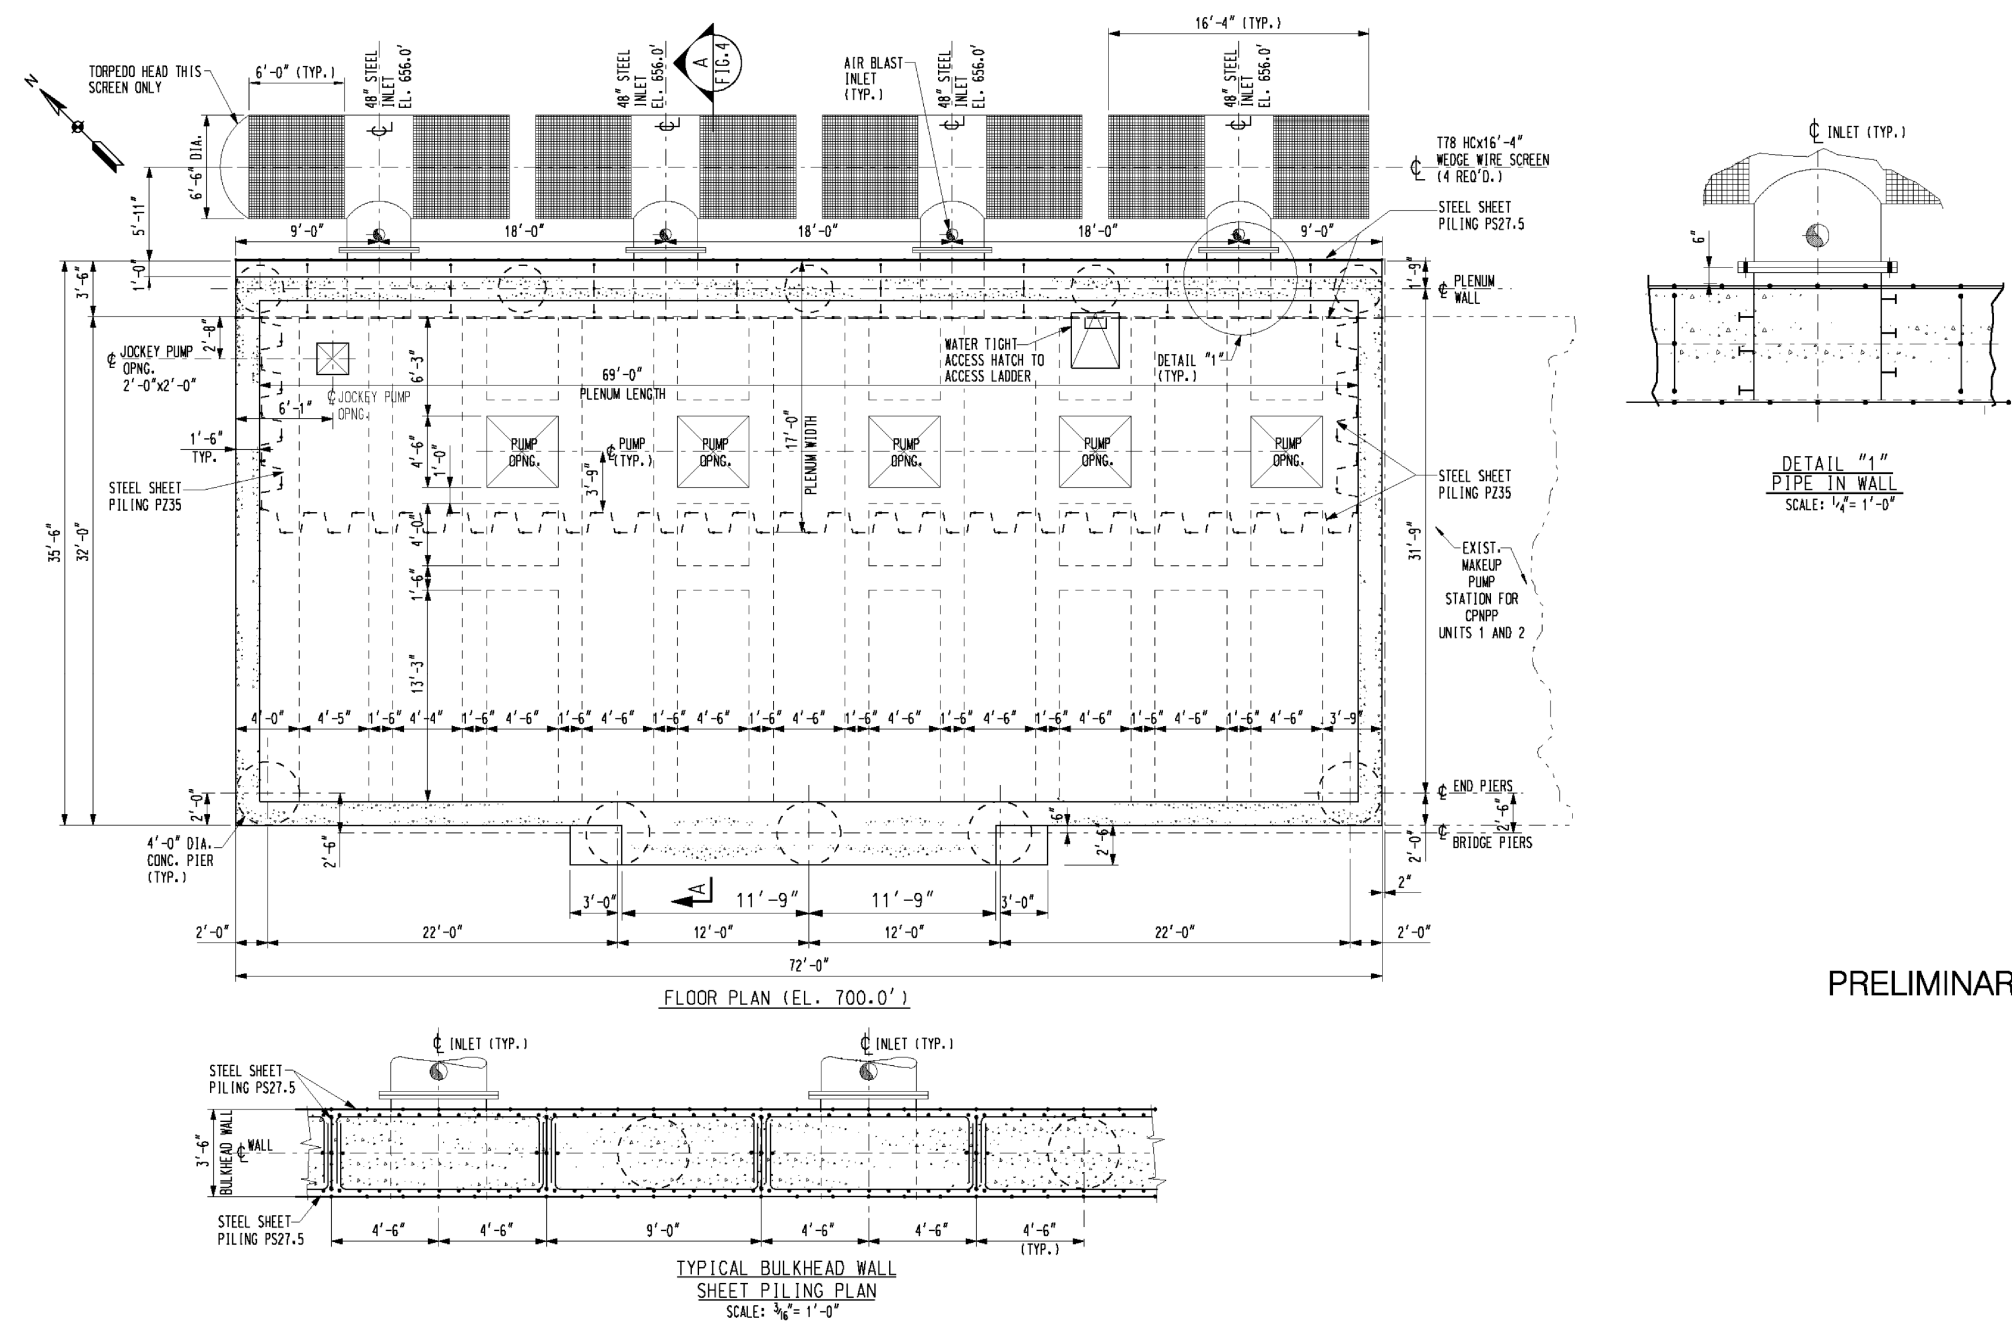

PRELIMINARY

Figure 3.4-4 Makeup Water Intake Structure Floor Plan