

**Comanche Peak Nuclear Power Plant, Units 3 & 4
COL Application
Part 2, FSAR**

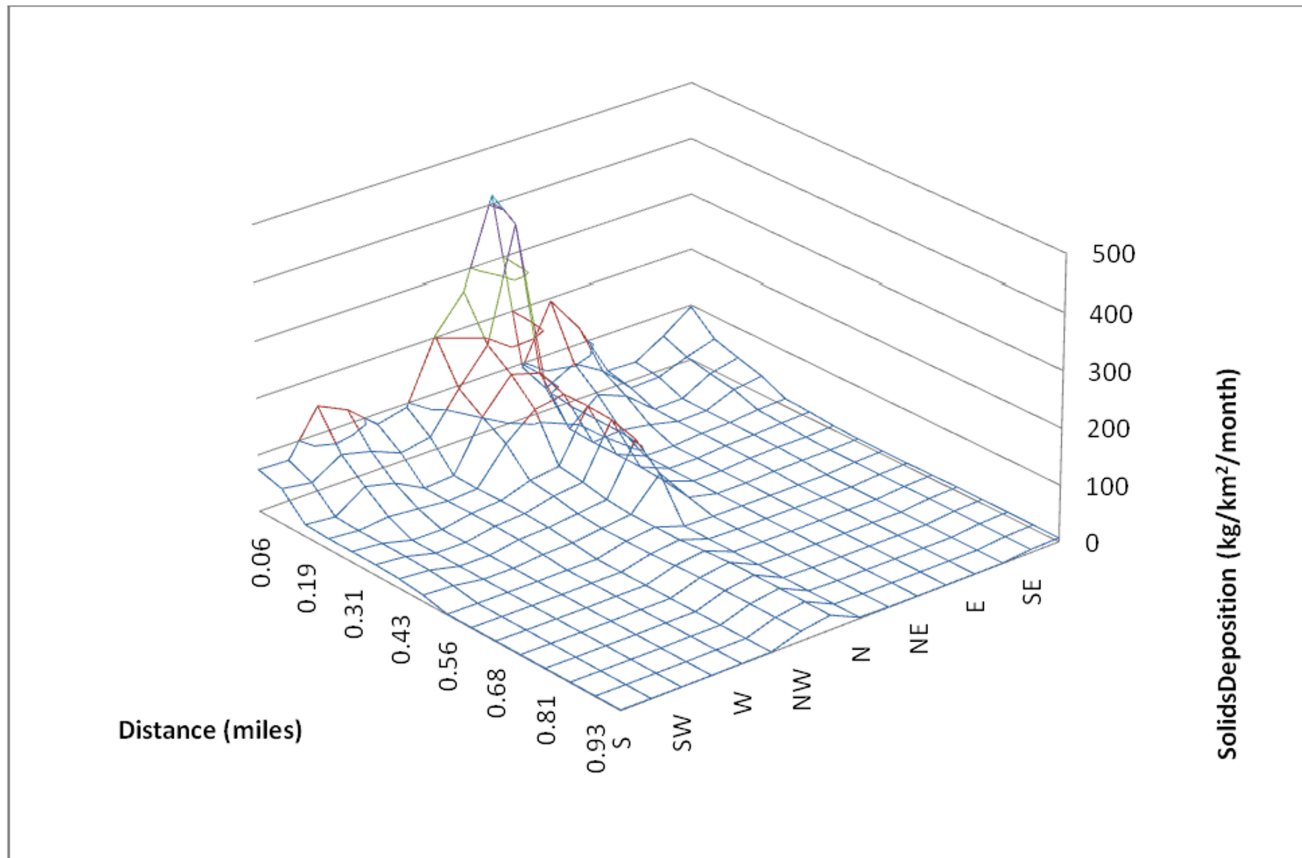


Figure 2.3-375 CPNPP Cooling Tower Total Dissolved Solids Deposition