

**Comanche Peak Nuclear Power Plant, Units 3 & 4
COL Application
Part 2, FSAR**

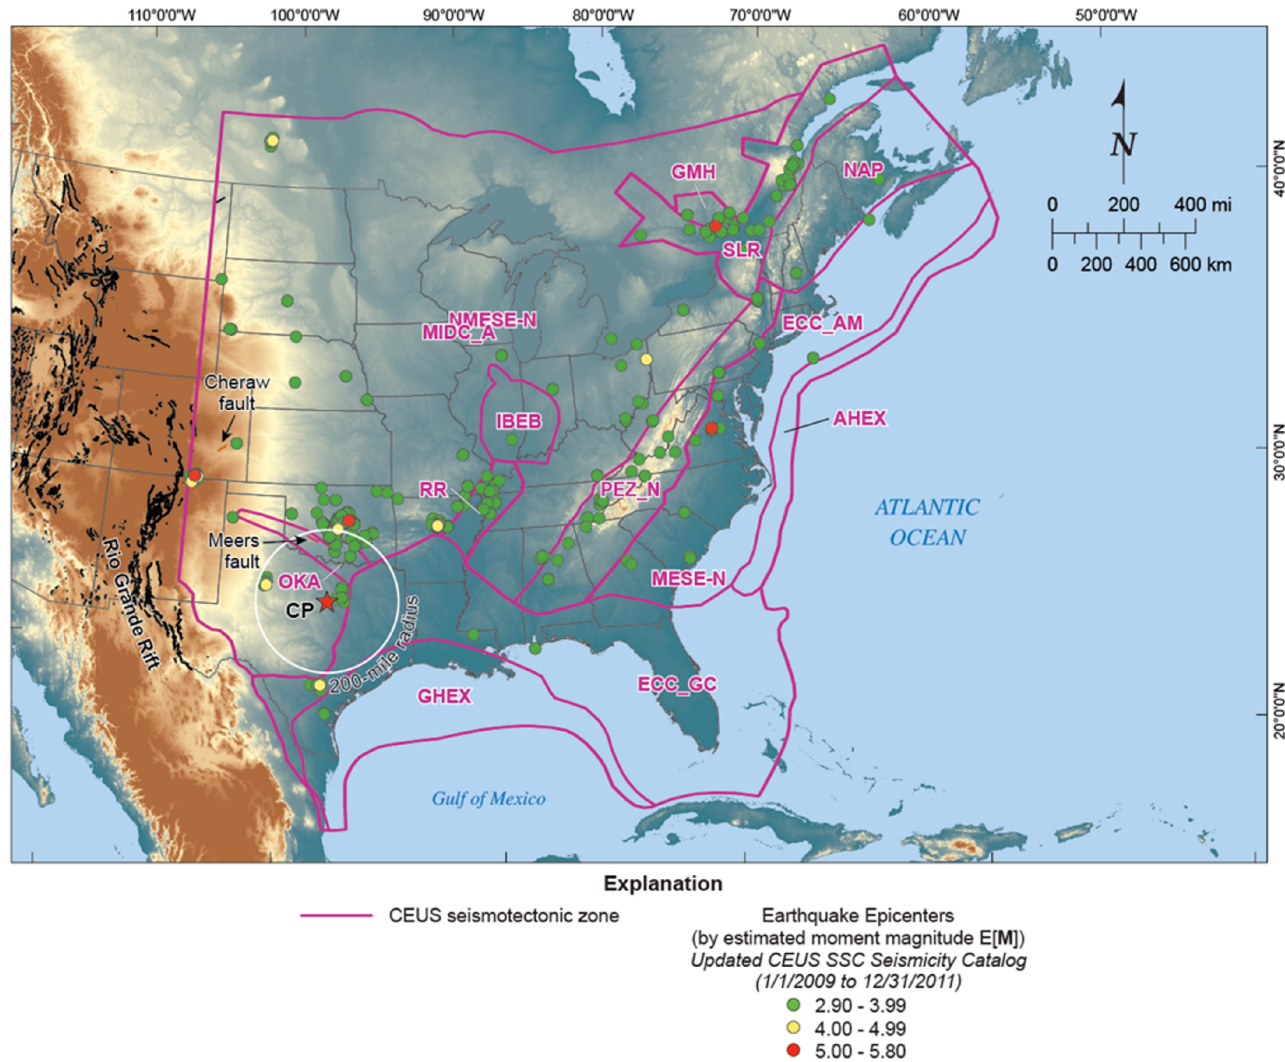


Figure 2.5.2-205 Updated CEUS SSC Seismicity Catalog plotted in the case where the Rough Creek Graben (RR_RCG) is not part of the Reelfoot Rift (RR) and the Paleozoic Extended Zone (PEZ-N) is narrow