

**Comanche Peak Nuclear Power Plant, Units 3 & 4
COL Application
Part 2, FSAR**

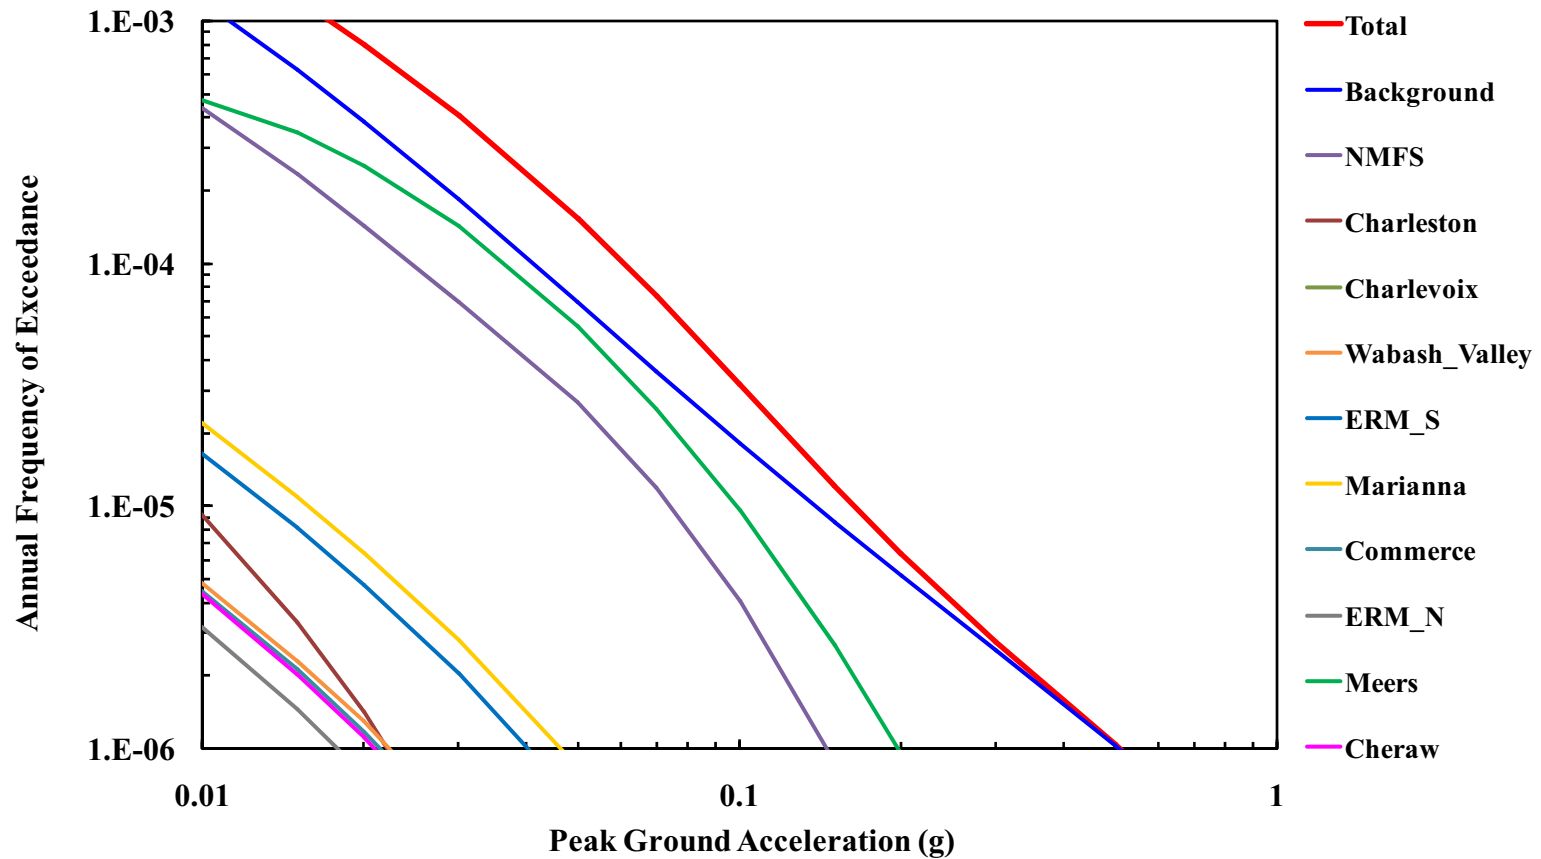


Figure 2.5.2-216 Contribution to 100 Hz(PGA) Rock Total Mean Hazard