

Comanche Peak Nuclear Power Plant, Units 3 & 4
COL Application
Part 2, FSAR

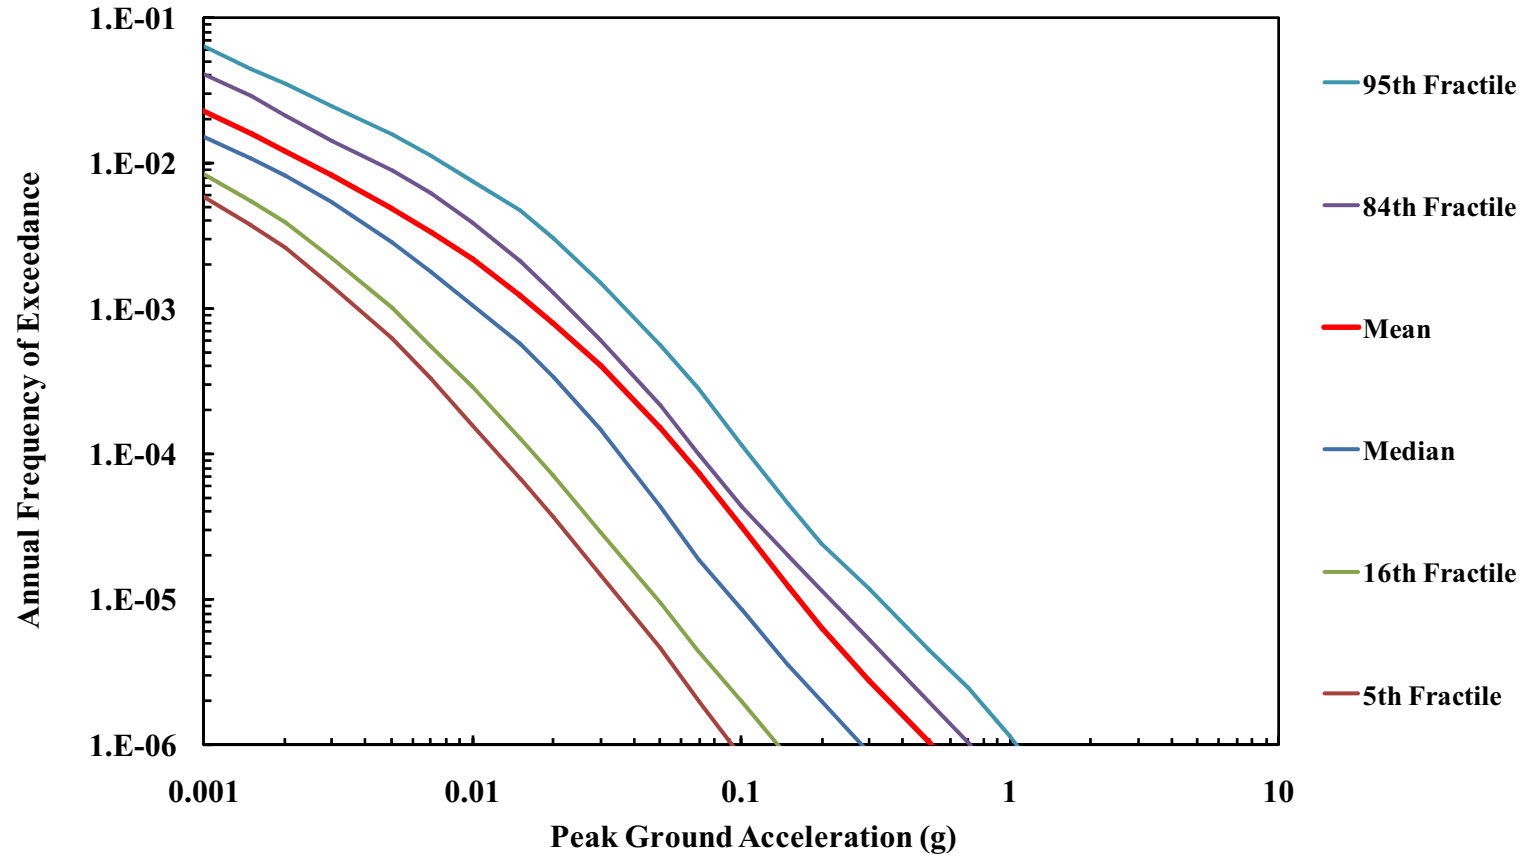


Figure 2.5.2-223 100 Hz (PGA) Rock Total Mean and Median Hazard and Select Fractiles