

Comanche Peak Nuclear Power Plant, Units 3 & 4
COL Application
Part 2, FSAR

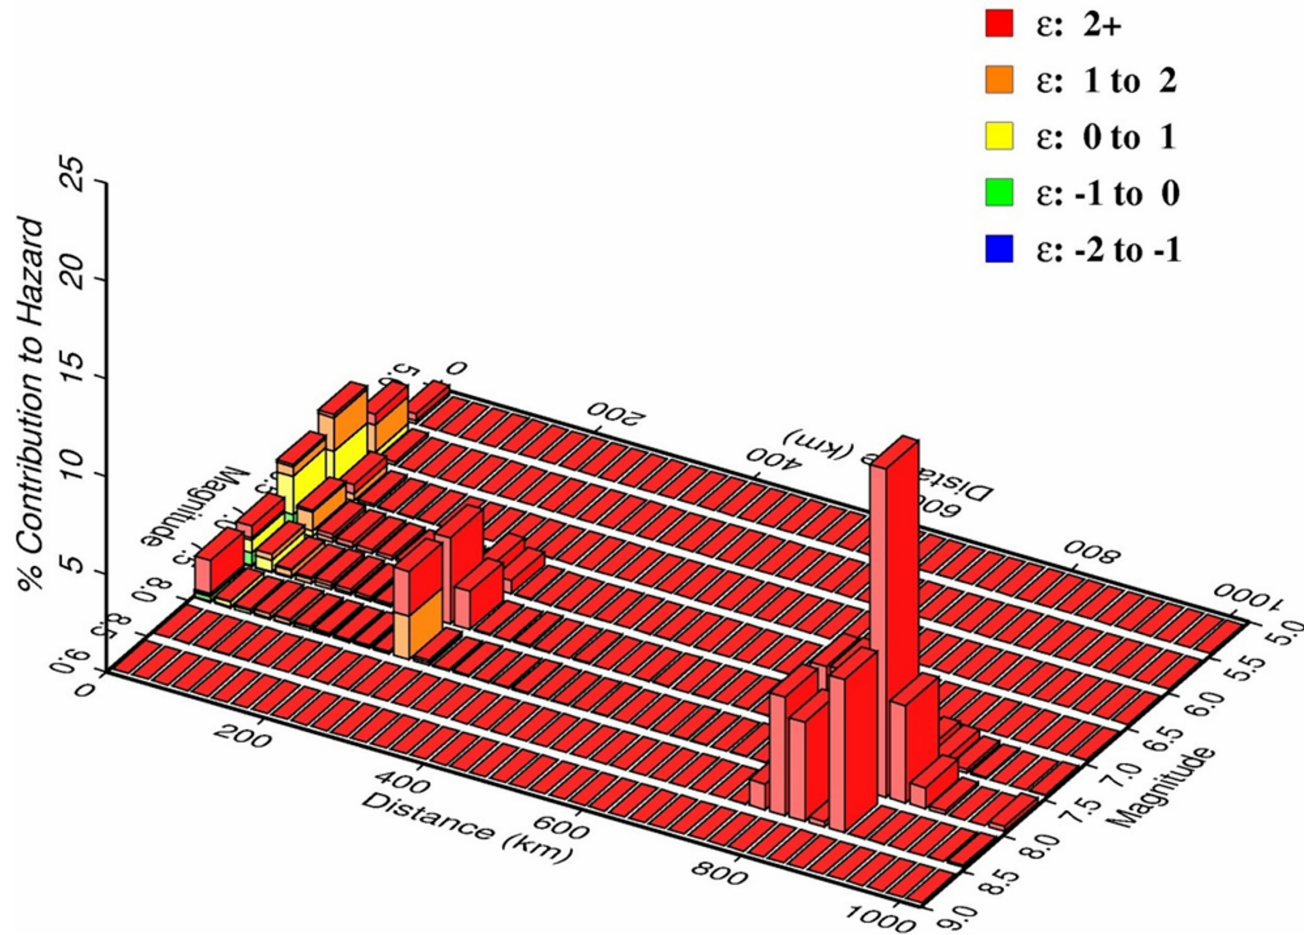


Figure 2.5.2-230 Deaggregation of 10^{-6} Rock Hazard for 1 and 2.5 Hz