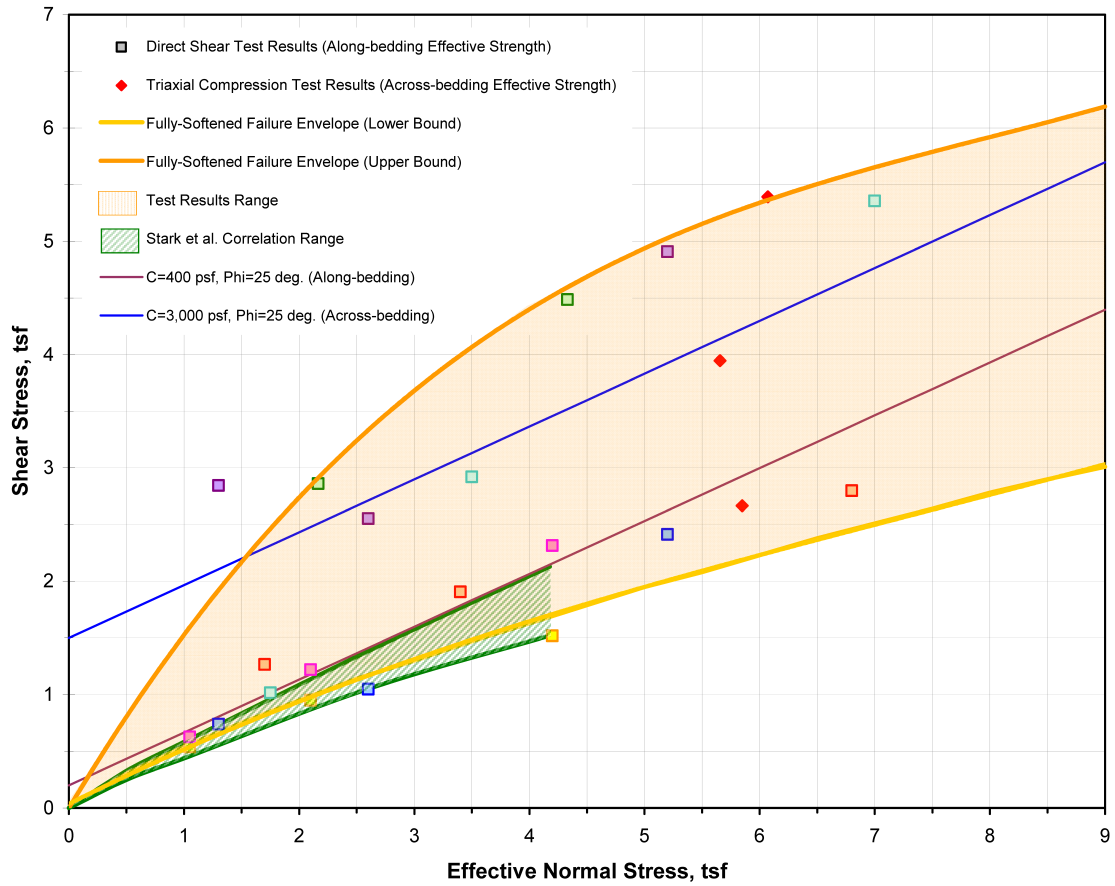


**Comanche Peak Nuclear Power Plant, Units 3 & 4**  
**COL Application**  
**Part 2, FSAR**



**Figure 2.5.4-235 Fully-Softened Drained Shear Strength of Shale from Direct Shear and Triaxial Consolidated-Undrained Tests**