

SCH-13-049  
CERTIFIED MAIL  
RETURN RECEIPT REQUESTED  
ARTICLE NUMBER: 7012 1640 0000 4257 0199



Department of Environmental Protection  
Division of Water Quality  
Bureau of Permit Management  
P.O. Box 029  
Trenton, N.J. 08625-0029

DEC 20 2013

**NEW JERSEY POLLUTANT DISCHARGE ELIMINATION SYSTEM  
DISCHARGE MONITORING REPORT  
SALEM GENERATING STATION  
NJPDES PERMIT NJ0005622**

Dear Sir:

Attached is the Discharge Monitoring Report for the Salem Generating Station for the month of November 2013.

This report is required by and prepared specifically for the New Jersey Department of Environmental Protection (NJDEP). It presents only the observed results of measurements and analyses required to be performed by the above agencies. The choice of the measurement devices and analytical methods are controlled by the EPA and the NJDEP, not by the company, and there are limitations on the accuracy of such measurement devices and analytical techniques even when used and maintained as required. Accordingly, this report is not intended as an assertion that any instrument has measured, or that any reading or analytical result represents the true value with absolute accuracy, nor is it an endorsement of the suitability of any analytical or measurement procedure.

If you have any questions concerning this report, please feel free to contact Mark Pyle (856) 339-2331.

Sincerely,

  
John F. Perry  
Site Vice President - Salem

Attachment (12 DMR's )

C Executive Director, DRBC  
USNRC - Docket numbers 50-272 & 50-311

IE25  
Nile

## EXPLANATION OF CONDITIONS

**November 2013**

The following explanations are included to clarify possible deviation from permit conditions.

General - The columns labeled "No. Ex" on the enclosed DMR tabulate the number of daily discharge values outside the indicated limits.

Data reporting and accuracy reflect the working environment, the design capabilities and reliability of the monitoring instruments and operating equipment.

Deviations from required sampling, analysis monitoring and reporting methods and periodicities are noted on the respective transmittal sheet.

Results reported on the Discharge Monitoring Report forms are consistent with permit limits, data supplied from contract laboratories, the December 2007 revision of the NJDEP DMR Instruction Manual and specific guidance from DEP personnel.

Included in this months report are the results from the flow test for 21A circulator.

### ATTACHMENT:

Determination of circulating water flow at Salem Generating Station Unit 2- Pump 21A

## EXPLANATION OF EXCEEDANCES

**November 2013**

The following exceedance(s) are included in the attached report and explained below.


EXPLANATION

**No Exceedances**


COUNTY OF SALEM  
STATE OF NEW JERSEY


I, John F. Perry, of full age, being duly sworn according to law, upon my oath depose and say:

1. I am the Site Vice President – Salem for PSEG Nuclear, and as such am authorized to sign Salem's Discharge Monitoring Reports submitted to the New Jersey Department of Environmental Protection pursuant to the Station's New Jersey Pollutant Discharge Elimination System permit.
2. I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe the submitted information is true, accurate and complete. I am aware that there are significant penalties for submitting false information including the possibility of fine and imprisonment.
3. The signature on the attached Discharge Monitoring Reports is my signature and I am submitting this affidavit in satisfaction of the requirement that my signature be notarized.

  
John F. Perry  
Site Vice President – Salem

Sworn and subscribed before me  
this 20th day of December 2013





New Jersey Department of Environmental Protection  
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	Month	Day	Year	To	Month	Day	Year	FACA – SW Outfall FACA
	11	1	2013		11	30	2013	

**PERMITTEE:**

PSE&G NUCLEAR LLC  
80 PARK PLAZA  
NEWARK, NJ 07101

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC SALEM  
GENERATING STATION  
ALLOWAY CREEK NECK RD  
HANCOCKS BRIDGE, NJ 08038

**REPORT RECIPIENT:**

PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: ☐ No Discharge this Monitoring Period ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.


I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

John F. Perry, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)



12/23/2013

856-339-3463

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

*\*For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

FACA SW Outfall FACA

11/1/2013 TO 11/30/2013

PSEG NUCLEAR LLC SALEM GENERATIN

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, oC 00010 G Raw Sew/influent	SAMPLE MEASUREMENT	*****	*****	*****	*****	11.3	16.1	DEG.C	0	Continuous	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	REPORT 01DAMX			Continuous	CONTIN
	QL	*****	*****		*****	*****	*****				
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	19.2	23.8	DEG.C	0	Continuous	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	43.3 01DAMX			Continuous	CONTIN
	QL	*****	*****		*****	*****	*****				
Temperature, oC 00010 2 Effluent Net Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	7.8	8.0	DEG.C	0	1/Day	CALCTD
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	15.3 01DAMX			1/Day	CALCTD
	QL	*****	*****		*****	*****	*****				
Lab Certification #  99999 99 Lab	SAMPLE MEASUREMENT	17327	17451	*****	PA 166			DEG.C			
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the BPSP - Region 2 at (609)292-4860 or via email at "srosenwi@dep.state.nj.us".

New Jersey Department of Environmental Protection  
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD	MONITORED LOCATION:												
NJ0005622	<table border="1"><tr><th>Month</th><th>Day</th><th>Year</th></tr><tr><td>11</td><td>1</td><td>2013</td></tr></table> To <table border="1"><tr><th>Month</th><th>Day</th><th>Year</th></tr><tr><td>11</td><td>30</td><td>2013</td></tr></table>	Month	Day	Year	11	1	2013	Month	Day	Year	11	30	2013	FACB – SW Outfall FACB
Month	Day	Year												
11	1	2013												
Month	Day	Year												
11	30	2013												

**PERMITTEE:**

PSE&G NUCLEAR LLC  
80 PARK PLAZA  
NEWARK, NJ 07101

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC SALEM  
GENERATING STATION  
ALLOWAY CREEK NECK RD  
HANCOCKS BRIDGE, NJ 08038

**REPORT RECIPIENT:**

PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE:

☐

No Discharge this Monitoring Period

☐

Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

John F. Perry, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

*\*For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE


DATE

AREA CODE/PHONE NUMBER

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: NJ0005622 MONITORED LOCATION: FACB SW Outfall FACB MONITORING PERIOD: 11/1/2013 TO 11/30/2013 FACILITY NAME: PSEG NUCLEAR LLC SALEM GENERATIN

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, oC 00010 G Raw Sew/Influent	SAMPLE MEASUREMENT	*****	*****	*****	*****	11.3	16.1	DEG.C	0	Continuous	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	REPORT 01DAMX			Continuous	CONTIN
	QL	*****	*****		*****	*****	*****				
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	20.0	25.6	DEG.C	0	Continuous	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	43.3 01DAMX			Continuous	CONTIN
	QL	*****	*****		*****	*****	*****				
Temperature, oC 00010 2 Effluent Net Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	8.7	9.5	DEG.C	0	1/Day	CALCTD
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	15.3 01DAMX			1/Day	CALCTD
	QL	*****	*****		*****	*****	*****				
Lab Certification #  99999 99 Lab	SAMPLE MEASUREMENT	17327	17451	*****	PA 166						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the BPSP - Region 2 at (609)292-4860 or via email at "srosenwi@dep.state.nj.us".



New Jersey Department of Environmental Protection  
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	Month	Day	Year	To	Month	Day	Year	FACC – SW Outfall FACC
	11	1	2013		11	30	2013	

**PERMITTEE:**

PSE&G NUCLEAR LLC  
80 PARK PLAZA  
NEWARK, NJ 07101

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC SALEM  
GENERATING STATION  
ALLOWAY CREEK NECK RD  
HANCOCKS BRIDGE, NJ 08038

**REPORT RECIPIENT:**

PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE:

☐

No Discharge this Monitoring Period

☐

Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.


I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

John F. Perry, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)



12/23/2013

856-339-3463

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

*\*For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: NJ0005622 MONITORED LOCATION: FACC SW Outfall FACC MONITORING PERIOD: 11/1/2013 TO 11/30/2013 FACILITY NAME: PSEG NUCLEAR LLC SALEM GENERATIN

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 G Raw Sew/influent	SAMPLE MEASUREMENT	2458	2559	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	3024 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	QL	*****	*****		*****	*****	*****				
Thermal Discharge Million BTUs per Hr 00015 2 Effluent Net Value	SAMPLE MEASUREMENT	12955	13178	MBTU/HR	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	30600 01DAMX		*****	*****	*****			1/Day	CALCTD
	QL	*****	*****		*****	*****	*****				
Lab Certification #  99999 99 Lab	SAMPLE MEASUREMENT	17327	17451		PA 166						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the BPSP - Region 2 at (609)292-4860 or via email at "srosenwi@dep.state.nj.us".

New Jersey Department of Environmental Protection  
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	Month	Day	Year	To	Month	Day	Year	048C – SW Outfall 48C
	11	1	2013		11	30	2013	

**PERMITTEE:**

PSE&G NUCLEAR LLC  
80 PARK PLAZA  
NEWARK, NJ 07101

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC SALEM  
GENERATING STATION  
ALLOWAY CREEK NECK RD  
HANCOCKS BRIDGE, NJ 08038

**REPORT RECIPIENT:**


PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: ☐ No Discharge this Monitoring Period ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

John F. Perry, Site Vice President - Salem	N/A
NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	GRADE AND REGISTRY NUMBER (IF APPLICABLE)
	12/23/2013 856-339-3463
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	DATE AREA CODE/PHONE NUMBER

*\*For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A	N/A	N/A	N/A
NAME AND TITLE	SIGNATURE	DATE	AREA CODE/PHONE NUMBER

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

048C SW Outfall 48C

11/1/2013 TO 11/30/2013

PSEG NUCLEAR LLC SALEM GENERATIN

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	0.3371	0.5537	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	QL	*****	*****		*****	*****	*****				
Solids, Total Suspended 00530 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	9	10	MG/L	0	2/MONTH	COMPOS
	PERMIT REQUIREMENT	*****	*****		*****	30 01MOAV	100 01DAMX			2/Month	COMPOS
	QL	*****	*****		*****	*****	*****				
Nitrogen, Ammonia Total (as N) 00610 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	2	5	MG/L	0	2/MONTH	COMPOS
	PERMIT REQUIREMENT	*****	*****		*****	35 01MOAV	70 01DAMX			2/Month	COMPOS
	QL	*****	*****		*****	*****	*****				
Petroleum Hydrocarbons 00551 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	< 5	< 5	MG/L	0	2/MONTH	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	10 01MOAV	15 01DAMX			2/Month	GRAB
	QL	*****	*****		*****	*****	*****				
Carbon, Tot Organic (TOC) 00680 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	10	14	MG/L	0	2/MONTH	COMPOS
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	50 01DAMX			2/Month	COMPOS
	QL	*****	*****		*****	*****	*****				
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	17451	PA 166	PA 166						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the BPSP - Region 2 at (609)292-4680 or via email at "srosenwi@dep.state.nj.us".

New Jersey Department of Environmental Protection  
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	Month	Day	Year	To	Month	Day	Year	481A – SW Outfall 481A
	11	1	2013		11	30	2013	

**PERMITTEE:**

PSE&G NUCLEAR LLC  
80 PARK PLAZA  
NEWARK, NJ 07101

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC SALEM  
GENERATING STATION  
ALLOWAY CREEK NECK RD  
HANCOCKS BRIDGE, NJ 08038

**REPORT RECIPIENT:**

PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: ☐ No Discharge this Monitoring Period ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

John F. Perry, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)

*John F. Perry*

12/23/2013

856-339-3463

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

*\*For a local agency where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

481A SW Outfall 481A

11/1/2013 TO 11/30/2013

PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	450	457	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	QL	*****	*****		*****	*****	*****				
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.8	*****	8.0	SU	0	1/week	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.9	*****	8.1	SU	0	1/week	GRAB
	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX			1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
LC50 Statre 96hr Acu Cyprinodon TAN6A 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	CODE=N	*****	*****	%EFFL	0	CODE=N	CODE=N
	PERMIT REQUIREMENT	*****	*****		50 01DAMN	*****	*****			2/Year	COMPOS
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	CODE=N	CODE=N	MG/L	0	CODE=N	CODE=N
	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX			3/Week	GRAB
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	0.1	0.2	MG/L	0	3/week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX			3/Week	GRAB
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: NJ0005622
 MONITORED LOCATION: 481A SW Outfall 481A
 MONITORING PERIOD: 11/1/2013 TO 11/30/2013
 FACILITY NAME: PSEG NUCLEAR LLC SALEM GENERATIN

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	19.5	24.8	DEG.C	0	1/Day	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	REPORT 01DAMX			1/Day	CONTIN
	QL	*****	*****		*****	*****	*****				
Lab Certification #  99999 99 Lab	SAMPLE MEASUREMENT	17327	17451		PA 166						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

New Jersey Department of Environmental Protection  
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	Month	Day	Year	To	Month	Day	Year	482A – SW Outfall 482A
	11	1	2013		11	30	2013	

**PERMITTEE:**

PSE&G NUCLEAR LLC  
80 PARK PLAZA  
NEWARK, NJ 07101

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC SALEM  
GENERATING STATION  
ALLOWAY CREEK NECK RD  
HANCOCKS BRIDGE, NJ 08038

**REPORT RECIPIENT:**

PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: ☐ No Discharge this Monitoring Period ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.


I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

John F. Perry, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)



12/23/2013

856-339-3463

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

*\*For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER



# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

482A SW Outfall 482A

11/1/2013 TO 11/30/2013

PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	440	441	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	QL	*****	*****		*****	*****	*****				
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.7	*****	8.1	SU	0	1/week	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.9	*****	8.1	SU	0	1/week	GRAB
	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX			1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
LC50 Statre 96hr Acu Cyprinodon TAN6A 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	CODE=N	*****	*****	%EFFL	0	CODE=N	CODE=N
	PERMIT REQUIREMENT	*****	*****		50 01DAMN	*****	*****			2/Year	COMPOS
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	CODE=N	CODE=N	MG/L	0	CODE=N	CODE=N
	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX			3/Week	GRAB
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	0.1	0.2	MG/L	0	3/week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX			3/Week	GRAB
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

# Surface Water Discharge Monitoring Report

PI 46814

**PERMIT NUMBER:** NJ0005622     
 **MONITORED LOCATION:** 482A SW Outfall 482A     
 **MONITORING PERIOD:** 11/1/2013 TO 11/30/2013     
 **FACILITY NAME:** PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	19.2	24.4	DEG.C	0	1/Day	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	REPORT 01DAMX			1/Day	CONTIN
	QL	*****	*****		*****	*****	*****				
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	17451		PA 166						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

New Jersey Department of Environmental Protection  
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	Month	Day	Year	To	Month	Day	Year	483A – SW Outfall 483A
	11	1	2013		11	30	2013	

**PERMITTEE:**

PSE&G NUCLEAR LLC  
80 PARK PLAZA  
NEWARK, NJ 07101

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC SALEM  
GENERATING STATION  
ALLOWAY CREEK NECK RD  
HANCOCKS BRIDGE, NJ 08038

**REPORT RECIPIENT:**

PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE:

☐

No Discharge this Monitoring Period

☐

Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

John F. Perry, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)

*John F. Perry*

12/23/2013

856-339-3463

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

*\*For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:


FACILITY NAME:

NJ0005622

483A SW Outfall 483A

11/1/2013 TO 11/30/2013

PSEG NUCLEAR LLC SALEM GENERATIN

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	450	455	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	QL	*****	*****		*****	*****	*****				
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.7	*****	7.9	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.9	*****	8.1	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX			1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	CODE=N	CODE=N	MG/L	0	CODE=N	CODE=N
	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX			3/Week	GRAB
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX			3/Week	GRAB
	QL	*****	*****		*****	*****	*****				
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	18.9	23.9	DEG.C	0	1/Day	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	REPORT 01DAMX			1/Day	CONTIN
	QL	*****	*****		*****	*****	*****				

Comments: Any questions in regards to the monitoring report form can be directed to S. Rosenwinkel of the BPSP - Region 2 at (609)292-4860.

# Surface Water Discharge Monitoring Report

PI 46814

**PERMIT NUMBER:** NJ0005622     
 **MONITORED LOCATION:** 483A SW Outfall 483A     
 **MONITORING PERIOD:** 11/1/2013 TO 11/30/2013     
 **FACILITY NAME:** PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Lab Certification #  99999 99 Lab	SAMPLE MEASUREMENT	17327	174S1		PA166						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: Any questions in regards to the monitoring report form can be directed to S. Rosenwinkel of the BPSP - Region 2 at (609)292-4860.

New Jersey Department of Environmental Protection  
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	Month	Day	Year	To	Month	Day	Year	484A – SW Outfall 484A
	11	1	2013		11	30	2013	

**PERMITTEE:**

PSE&G NUCLEAR LLC  
80 PARK PLAZA  
NEWARK, NJ 07101

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC SALEM  
GENERATING STATION  
ALLOWAY CREEK NECK RD  
HANCOCKS BRIDGE, NJ 08038

**REPORT RECIPIENT:**

PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: ☐ No Discharge this Monitoring Period ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

John F. Perry, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)

*John F. Perry*

12/23/2013

856-339-3463

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

*\*For a local agency where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:


FACILITY NAME:

NJ0005622

484A SW Outfall 484A

11/1/2013 TO 11/30/2013

PSEG NUCLEAR LLC SALEM GENERATIN

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	340	442	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	QL	*****	*****		*****	*****	*****				
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.7	*****	7.9	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.9	*****	8.1	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX			1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
LC50 Statre 96hr Acu Cyprinodon TAN6A 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	CODE=N	*****	*****	%EFFL	0	CODE=N	CODE=N
	PERMIT REQUIREMENT	*****	*****		50 01DAMN	*****	*****			2/Year	COMPOS
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	CODE=N	CODE=N	MG/L	0	CODE=N	CODE=N
	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX			3/Week	GRAB
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX			3/Week	GRAB
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: NJ0005622     
 MONITORED LOCATION: 484A SW Outfall 484A     
 MONITORING PERIOD: 11/1/2013 TO 11/30/2013     
 FACILITY NAME: PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, °C 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	21.6	29.2	DEG.C	0	1/Day	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	REPORT 01DAMX			1/Day	CONTIN
	QL	*****	*****		*****	*****	*****				
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	17451		PA 166						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.



New Jersey Department of Environmental Protection  
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	Month	Day	Year	To	Month	Day	Year	485A – SW Outfall 485A
	11	1	2013		11	30	2013	

**PERMITTEE:**

PSE&G NUCLEAR LLC  
80 PARK PLAZA  
NEWARK, NJ 07101

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC SALEM  
GENERATING STATION  
ALLOWAY CREEK NECK RD  
HANCOCKS BRIDGE, NJ 08038

**REPORT RECIPIENT:**


PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: ☐ No Discharge this Monitoring Period ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

John F. Perry, Site Vice President - Salem	N/A
NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	GRADE AND REGISTRY NUMBER (IF APPLICABLE)
	12/23/2013 856-339-3463
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	DATE AREA CODE/PHONE NUMBER

*\*For a local agency where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A	N/A	N/A	N/A
NAME AND TITLE	SIGNATURE	DATE	AREA CODE/PHONE NUMBER

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

485A SW Outfall 485A

11/1/2013 TO 11/30/2013

PSEG NUCLEAR LLC SALEM GENERATIN

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	422	422	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	QL	*****	*****		*****	*****	*****				
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.6	*****	8.0	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.9	*****	8.1	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX			1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
LC50 Statre 96hr Acu Cyprinodon TAN6A 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	CODE=N	*****	*****	%EFFL	0	CODE=N	CODE=N
	PERMIT REQUIREMENT	*****	*****		50 01DAMN	*****	*****			2/Year	COMPOS
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	CODE=N	CODE=N	MG/L	0	CODE=N	CODE=N
	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX			3/Week	GRAB
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX			3/Week	GRAB
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: NJ0005622
 MONITORED LOCATION: 485A SW Outfall 485A
 MONITORING PERIOD: 11/1/2013 TO 11/30/2013
 FACILITY NAME: PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, °C 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	19.8	25.8	DEG.C	0	1/Day	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	REPORT 01DAMX			1/Day	CONTIN
	QL	*****	*****		*****	*****	*****				
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	17451		PA166						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

New Jersey Department of Environmental Protection  
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD							MONITORED LOCATION:
NJ0005622	Month	Day	Year	To	Month	Day	Year	486A – SW Outfall 486A
	11	1	2013		11	30	2013	

**PERMITTEE:**

PSE&G NUCLEAR LLC  
80 PARK PLAZA  
NEWARK, NJ 07101

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC SALEM  
GENERATING STATION  
ALLOWAY CREEK NECK RD  
HANCOCKS BRIDGE, NJ 08038

**REPORT RECIPIENT:**

PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: ☐ No Discharge this Monitoring Period ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.


I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

John F. Perry, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)



12/23/2013

856-339-3463

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

*\*For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: NJ0005622
 MONITORED LOCATION: 486A SW Outfall 486A
 MONITORING PERIOD: 11/1/2013 TO 11/30/2013
 FACILITY NAME: PSEG NUCLEAR LLC SALEM GENERATIN

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	422	423	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	QL	*****	*****		*****	*****	*****				
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.6	*****	8.0	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.9	*****	8.1	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX			1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	CODE=N	CODE=N	MG/L	0	CODE=N	CODE=N
	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX			3/Week	GRAB
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX			3/Week	GRAB
	QL	*****	*****		*****	*****	*****				
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	19.2	24.6	DEG.C	0	1/Day	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	REPORT 01DAMX			1/Day	CONTIN
	QL	*****	*****		*****	*****	*****				

Comments: Any questions in regards to the monitoring report form can be directed to S. Rosenwinkel of the BPSP - Region 2 at (609)292-4860.

# Surface Water Discharge Monitoring Report

PI 46814

**PERMIT NUMBER:** NJ0005622     
 **MONITORED LOCATION:** 486A SW Outfall 486A     
 **MONITORING PERIOD:** 11/1/2013 TO 11/30/2013     
 **FACILITY NAME:** PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Lab Certification #  99999 99 Lab	SAMPLE MEASUREMENT	17327	17451		PA 166						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: Any questions in regards to the monitoring report form can be directed to S. Rosenwinkel of the BPSP - Region 2 at (609)292-4860.

New Jersey Department of Environmental Protection  
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD							MONITORED LOCATION:
NJ0005622	Month	Day	Year	To	Month	Day	Year	487B – SW Outfall 487B
	11	1	2013		11	30	2013	

**PERMITTEE:**

PSE&G NUCLEAR LLC  
80 PARK PLAZA  
NEWARK, NJ 07101

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC SALEM  
GENERATING STATION  
ALLOWAY CREEK NECK RD  
HANCOCKS BRIDGE, NJ 08038

**REPORT RECIPIENT:**


PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: ☒ No Discharge this Monitoring Period ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

John F. Perry, Site Vice President - Salem	N/A
NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	GRADE AND REGISTRY NUMBER (IF APPLICABLE)
	12/23/2013 856-339-3463
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	DATE AREA CODE/PHONE NUMBER

*\*For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A	N/A	N/A	N/A
NAME AND TITLE	SIGNATURE	DATE	AREA CODE/PHONE NUMBER

New Jersey Department of Environmental Protection  
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	Month	Day	Year	To	Month	Day	Year	489A – SW Outfall 489A
	11	1	2013		11	30	2013	

**PERMITTEE:**

PSE&G NUCLEAR LLC  
80 PARK PLAZA  
NEWARK, NJ 07101

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC SALEM  
GENERATING STATION  
ALLOWAY CREEK NECK RD  
HANCOCKS BRIDGE, NJ 08038

**REPORT RECIPIENT:**

PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: ☐ No Discharge this Monitoring Period ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

John F. Perry, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)

*John F. Perry*

12/23/2013

856-339-3463

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

*\*For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE


AREA CODE/PHONE NUMBER



# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: NJ0005622
 MONITORED LOCATION: 489A SW Outfall 489A
 MONITORING PERIOD: 11/1/2013 TO 11/30/2013
 FACILITY NAME: PSEG NUCLEAR LLC SALEM GENERATIN

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	0.0168	0.0168	MGD	*****	*****	*****	*****	0	1/Month	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Month	CALCTD
	QL	*****	*****		*****	*****	*****				
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.6	*****	7.6	SU	0	1/Month	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Month	GRAB
	QL	*****	*****		*****	*****	*****				
Solids, Total Suspended 00530 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	3	3	*****	MG/L	0	1/Month	GRAB
	PERMIT REQUIREMENT	*****	*****		100 01DAMX	30 01MOAV	*****			1/Month	GRAB
	QL	*****	*****		*****	*****	*****				
Petroleum Hydrocarbons 00551 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	< 5	< 5	MG/L	0	1/Month	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	10 01MOAV	15 01DAMX			1/Month	GRAB
	QL	*****	*****		*****	*****	*****				
Carbon, Tot Organic (TOC) 00680 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	5	5	MG/L	0	1/Month	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	50 01DAMX			1/Month	GRAB
	QL	*****	*****		*****	*****	*****				
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	17451		PA166						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the the BPSP - Region 2 at (609)292-4860 or via email at "srosenwi@dep.state.nj.us".

LABORATORY & TESTING SERVICES REPORT



TO: Louis H. Menoscal  
Manager, Nuclear Projects  
PSEG Nuclear

October 17, 2013  
Report No. MSPG13037

SUBJECT: **DETERMINATION OF CIRCULATING WATER FLOW AT  
SALEM GENERATING STATION UNIT 2 - PUMP #21A**

CONDUCTED BY: Gary Floystad  
Sr. Test Engineer, PSEG Laboratory & Testing Services

SUMMARY

On October 16, 2013 the Mechanical Systems Performance Group of PSEG Laboratory and Testing Services conducted a test at Salem Unit No. 2 to determine the capacity of the #21A circulating water pump as illustrated in the table below.


Work was performed under SAP work order:  
60102946

Final results are as follows:

**SUMMARY OF TEST RESULTS**

Pump No.	CMS Pump Desig.	Test Date	Measured Pump Capacity (gpm)	Pump Suction Head (ft h <sub>2</sub> o)	Pump Discharge Head (ft h <sub>2</sub> o)	Total Static Head (ft h <sub>2</sub> o)
21A	I	10/16/13	150273	-8.6	13.6	22.2

Note: Pump suction heads and discharge heads corrected to elevation 100.3'

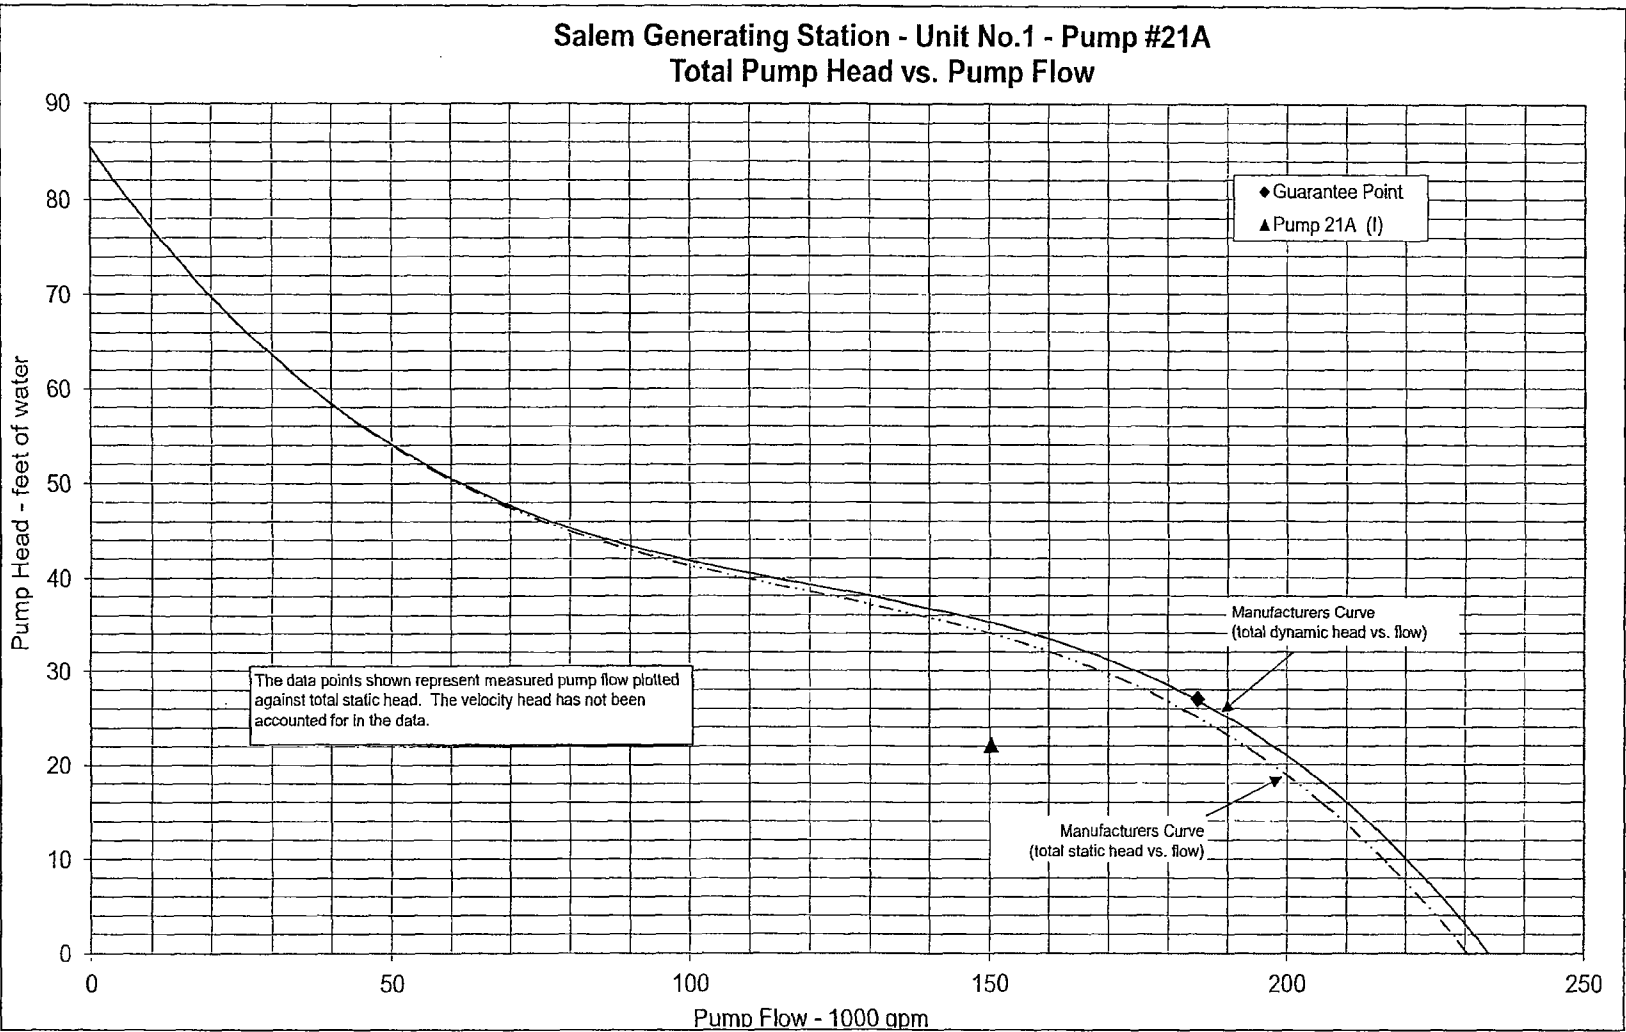

Louis H. Menoscal  
Manager, Nuclear Projects  
PSEG Nuclear

October 17, 2013  
Report No. MSPG13037

SUMMARY (Cont'd)

For reporting purposes, shown below is the data pertinent to the injection of Rhodamine WT dye released to the river during testing. Testing is complete at this station.

**RECORD OF RHODAMINE WT DYE INJECTION**

Test Date	Pump No.	Injection Time		Pure Dye Injected (ml)	Number of Pumps in Service	Total System Flow (1000 gpm)	Effluent Concentration (ppb)
		(start)	(stop)				
10/16/13	21A	1147	1235	72.60	11	2035.0	0.20

TEST METHOD

The circulating water flow rate was determined by fluorometry using MTS Mechanical Division Work Instruction TPG-19 Rev. 13 "Water Flow Using The Turner Fluorometer". Rhodamine WT dye was injected into the bell mouth of each pump using 1/2 inc PVC pipe with a carrier flow of screen wash water at approximately 3 gallons per minute.

The dye was injected at a known rate using a peristaltic pump and a class A burette to measure rate. The diluted sample was retrieved and monitored by taking a sample from the inlet water box piping. The ratio of the injected concentration to the sample concentration multiplied by the injection flow rate yielded the circulator flow rate.

The total static head was obtained by measuring the pump suction head in feet from elevation 100.3' and the pump discharge head in feet of water at the water box inlet. After correcting for elevation, the total pump head was calculated as the pump discharge head minus the pump suction head.

ANSI Level II or III Evaluation



Vic Simpson  
Senior Test Engineer  
LTS Mechanical Division