


Open Phase Condition

Original Actuation Concept

Actuation upon detection of open phase, feeder breakers open, transformer is disconnected and 4Kv bus loses voltage and transfers to diesel

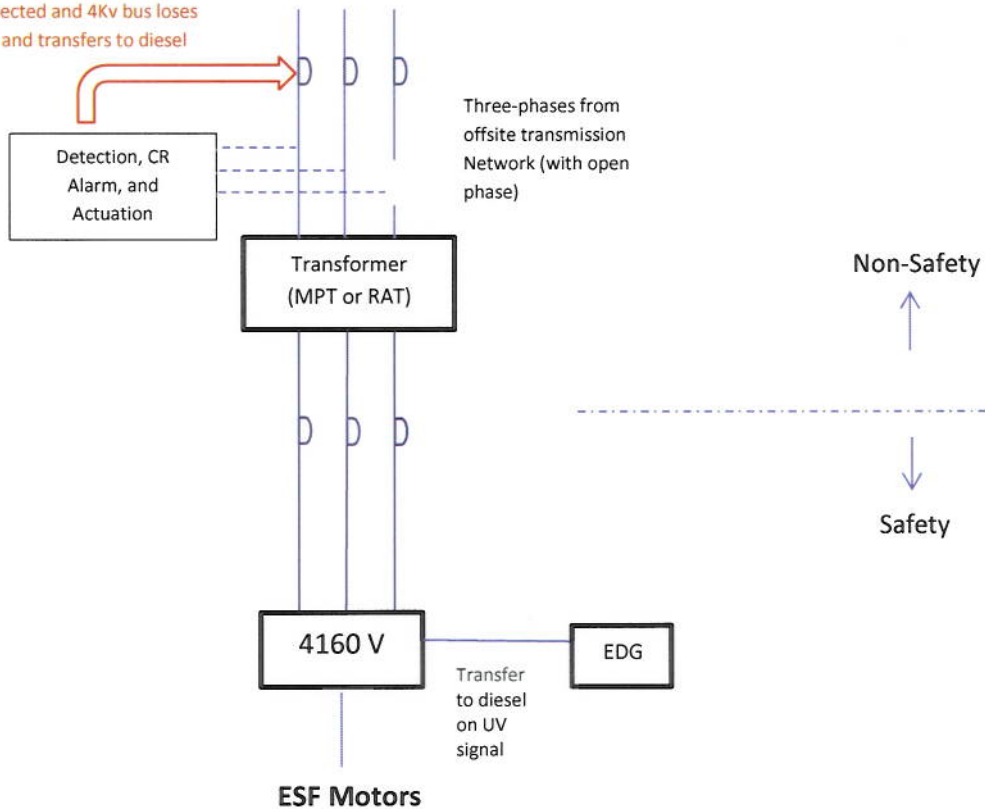


ACTUATION – YES

TECH SPECS – Not Feasible

Open Phase Condition

New Safety Related Actuation Concept

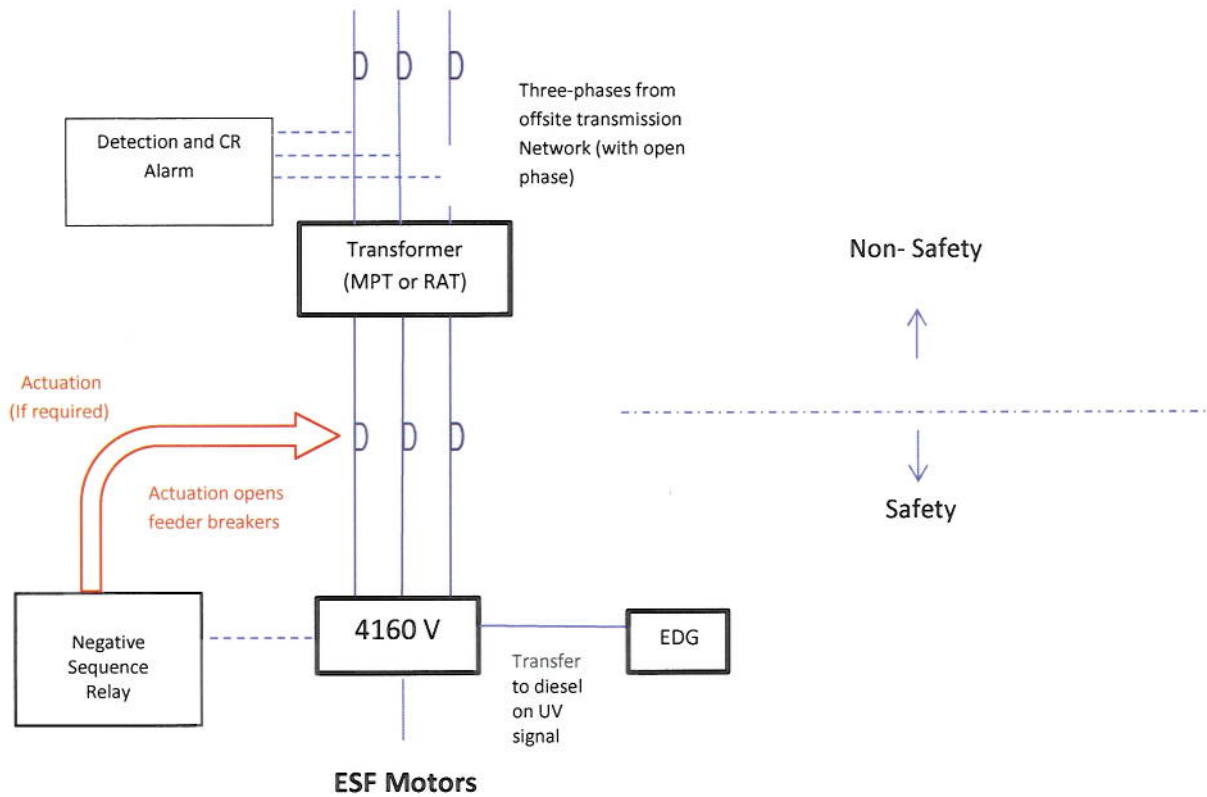

ACTUATION –YES (if required)

Tech Specs - YES

