5137 - E - 6311 5

PARTIAL PLAN

TOP VIEW LOOKING DOWN (NTS)

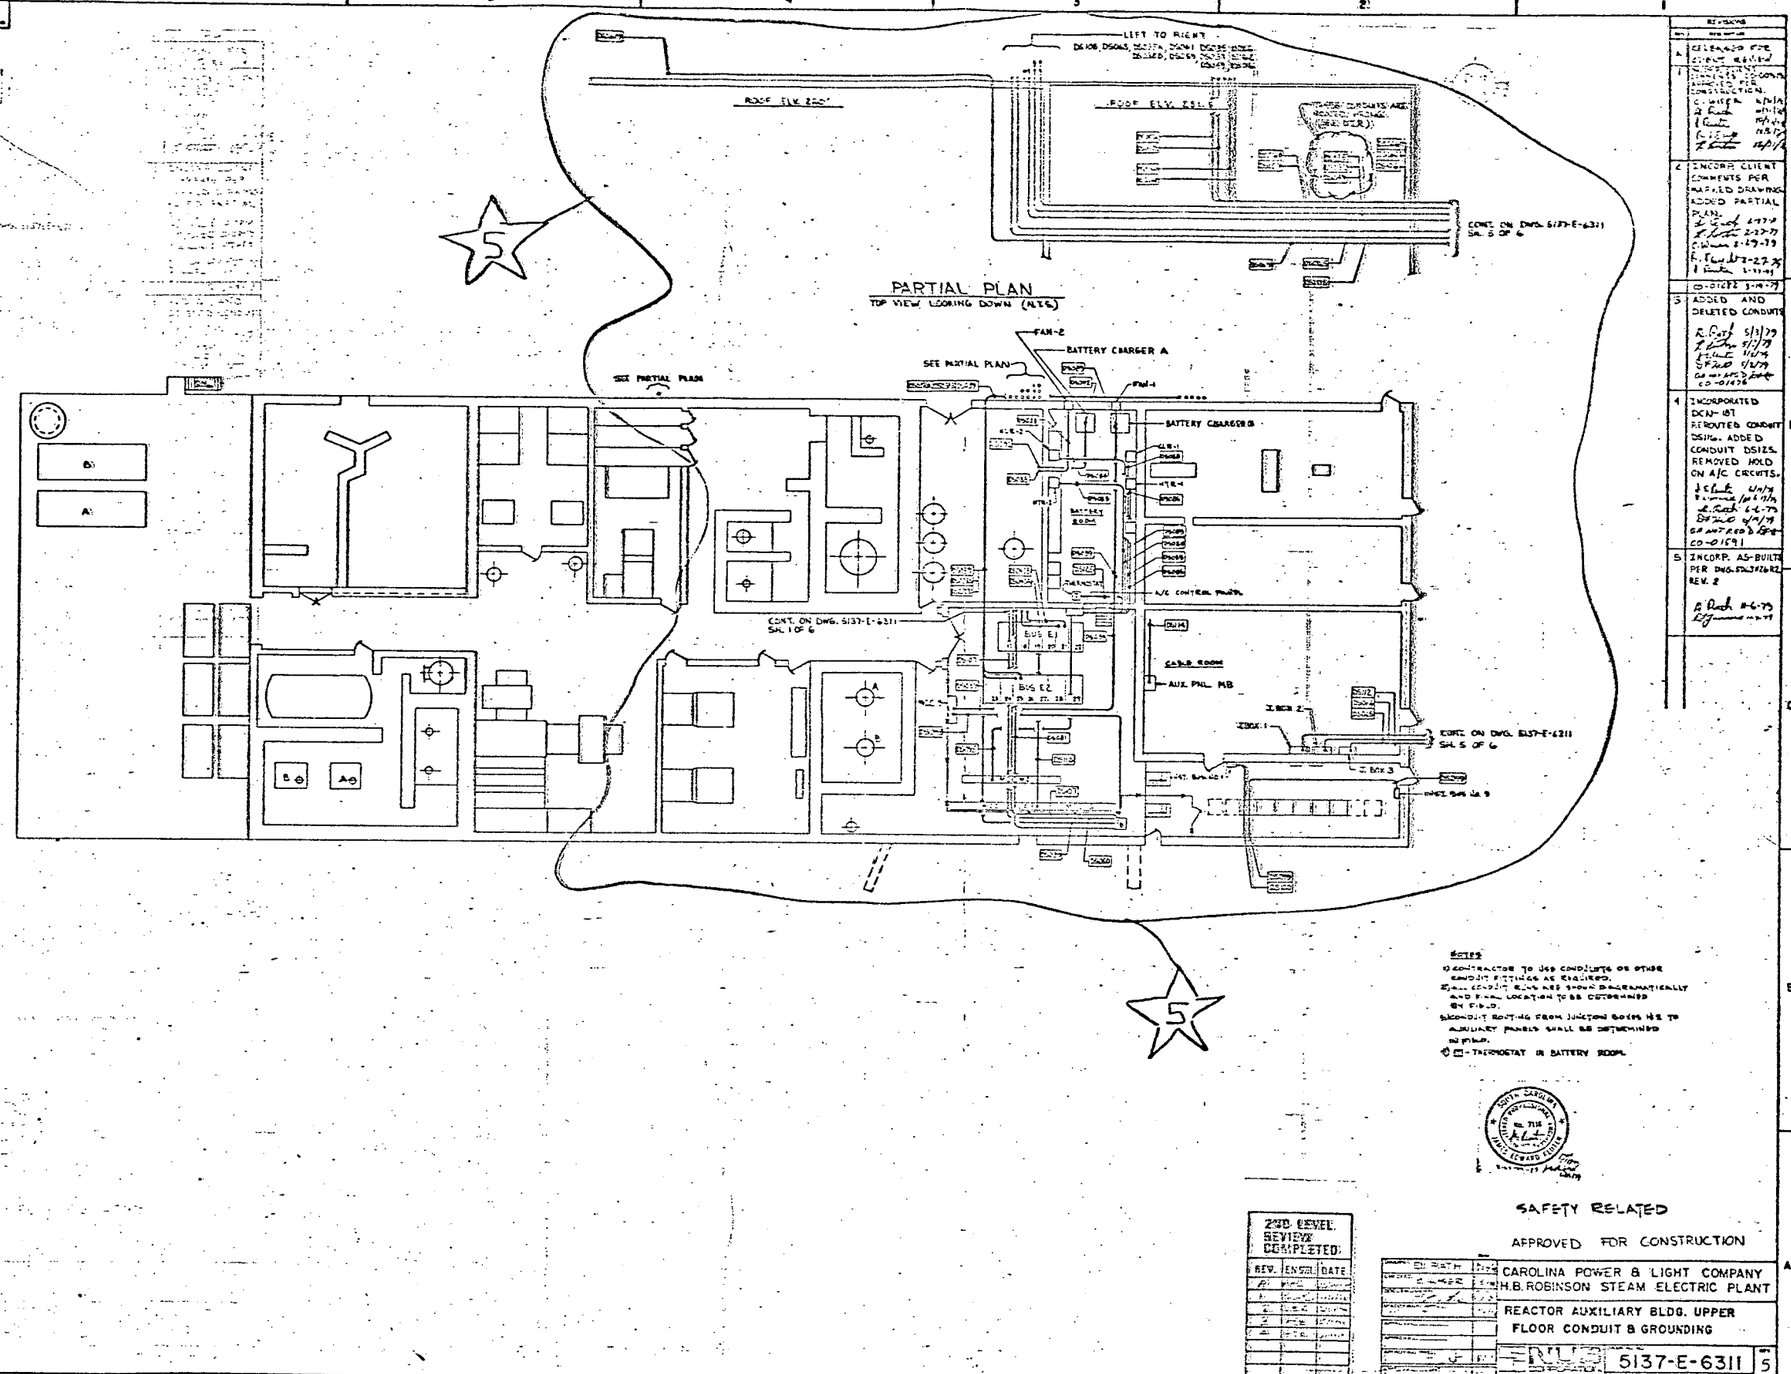

NOTES

1. CONTRACTOR TO USE CONDUITS OR OTHER CONDUIT FITTINGS AS REQUIRED.
2. ALL CONDUIT RUNS ARE SHOWN DIAGRAMMATICALLY AND FINAL LOCATION TO BE DETERMINED BY FIELD.
3. CONDUIT ROUTING FROM JUNCTION BOXES ETC TO AUXILIARY PANELS SHALL BE DETERMINED BY FIELD.
4. ⊡ - THERMOSTAT IN BATTERY ROOM.

SAFETY RELATED

APPROVED FOR CONSTRUCTION

REV.	DESCRIPTION	DATE
E	CLEARED FOR CLIENT REVIEW	
F	CLEARED FOR CONSTRUCTION. ISSUED FOR CONSTRUCTION	
G	INCORP. CLIENT COMMENTS PER MARKED DRAWING. ADDED PARTIAL PLAN.	
H	ADDED AND DELETED CONDUITS	
J	INCORPORATED DCN-187 REROUTED CONDUIT DS11A. ADDED CONDUIT SIZES. REMOVED HOLD ON A/C CIRCUITS.	
K	INCORP. AS-BUILTS PER DWG. 5137-E-76282 REV. 2	

2ND. LEVEL REVIEW COMPLETED:

REV.	ENGR.	DATE

CAROLINA POWER & LIGHT COMPANY
H.B. ROBINSON STEAM ELECTRIC PLANT
REACTOR AUXILIARY BLDG. UPPER FLOOR CONDUIT & GROUNDING
5137-E-6311 5

8002110 450