


5137-E-6311



NOTES
1. CONTRACTOR TO USE CONSULTS RE OTHER
CONDUIT SIZING AS REQUIRED.
2. ALL CONDUIT RUNS ARE SHOWN DIAGONALLY
AND FINAL LOCATION TO BE DETERMINED BY FIELD.

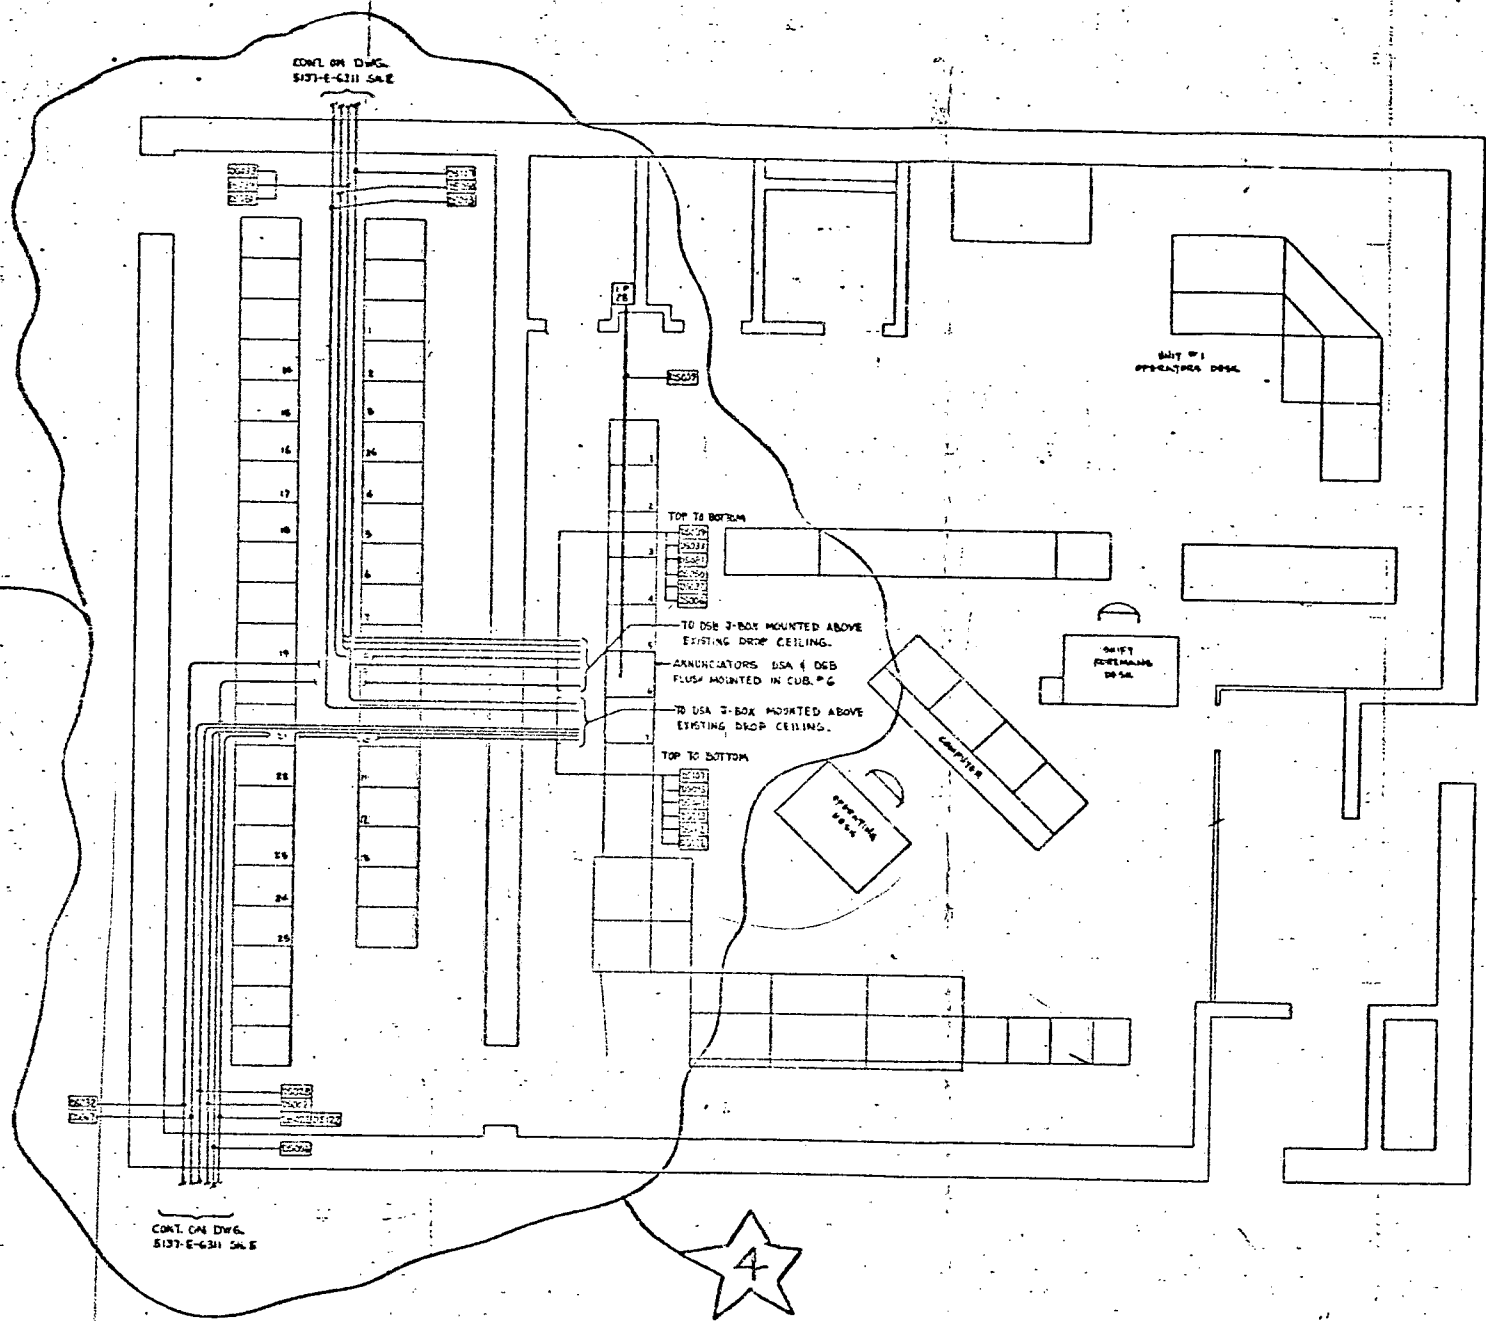

FIRE PROTECTION LIST

APPROVED FOR CONSTRUCTION

CAROLINA POWER & LIGHT COMPANY
H.E. ROBINSON STEAM ELECTRIC PLANT

CONTROL ROOM
CONDUIT & GROUNDING

5137-E-6311

| NO. | REVISION |
|-----|--|
| 1 | RELEASED FOR CLIENT REVIEW |
| 2 | INCORP. CLIENT COMMENTS CO-0039 REVISIONS FOR CONSTRUCTION. C. W. H. 5/1/79 E. L. H. 5/1/79 |
| 3 | INCORP. CLIENT COMMENTS PER MARKED UP DRAWING. G. R. H. 5/1/79 H. R. H. 5/1/79 C. W. H. 5/1/79 E. L. H. 5/1/79 CO-0039 |
| 4 | ADDED CONDUIT SIZING, DELETED SIZING RELATED TO DBB 3-BOX 12. R. H. 5/1/79 13. R. H. 5/1/79 14. R. H. 5/1/79 CO-0039 |
| 5 | INCORP. AS BUILT PER MARKED DWG. SD-6311602 REV 2 13. R. H. 11-6-79 14. R. H. 11-6-79 |

468
8002110