

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:9012270009 DOC.DATE: 90/12/21 NOTARIZED: YES DOCKET #
 FACIL:50-261 H.B. Robinson Plant, Unit 2, Carolina Power & Light C 05000261
 AUTH.NAME AUTHOR AFFILIATION
 VAUGHN,G.E. Carolina Power & Light Co.
 RECIP.NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Clarifies commitment in util 901019 ltr that radionoble gas
 monitor in condenser vacuum pump discharge path will
 continue to be maintained & used as indicator of steam
 generator tube leakage.

DISTRIBUTION CODE: A001D COPIES RECEIVED:LTR 1 ENCL 0 SIZE: 1
 TITLE: OR Submittal: General Distribution

NOTES:

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTTR	ENCL		ID CODE/NAME		LTTR	ENCL
	PD2-1 LA		1	1		PD2-1 PD		1	1
	LO,R		2	2					
INTERNAL:	NRR/DET/ECMB 9H		1	1		NRR/DET/ESGB		1	1
	NRR/DOEA/OTSB11		1	1		NRR/DST 8E2		1	1
	NRR/DST/SELB 8D		1	1		NRR/DST/SICB 7E		1	1
	NRR/DST/SRXB 8E		1	1		NUDOCS-ABSTRACT		1	1
	OC/LEMB		1	0		OGC/HDS1		1	0
	<u>REG FILE 01</u>		1	1		RES/DSIR/EIB		1	1
EXTERNAL:	NRC PDR		1	1		NSIC		1	1

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 18 ENCL 16-0

sub MAY



Carolina Power & Light Company

P.O. Box 1551 • Raleigh, N.C. 27602

DEC 21 1990

G. E. VAUGHN
Vice President
Nuclear Services Department

SERIAL: NLS-90-262

United States Nuclear Regulatory Commission
ATTENTION: Document Control Desk
Washington, DC 20555

H. B. ROBINSON STEAM ELECTRIC PLANT, UNIT NO. 2
DOCKET NO. 50-261/LICENSE NO. DPR-23
COMMITMENT TO RADIATION MONITOR SURVEILLANCE

Gentlemen:

As discussed in a December 20, 1990 conference call between the NRC Project Manager and representatives of Carolina Power & Light this letter provides clarification of the commitment in our October 19, 1990 letter that the radionoble gas monitor in the condenser vacuum pump discharge path "will continue to be maintained and used as an indicator of steam generator tube leakage". This commitment is intended to specify that the process monitor RMS-15 will remain in place, will continue to receive the level of surveillance currently specified in Technical Specification Table 4.19-2, item 3.a, and will continue to be included in the Plant Operating Manual, as appropriate, as an indicator of steam generator tube leakage.

Questions regarding this matter may be referred to Mr. R. W. Prunty at (919) 546-7318.

Yours very truly,

G. E. Vaughn


JSK/cwh (938RNP)

G. E. Vaughn, having been first duly sworn, did depose and say that the information contained herein is true and correct to the best of his information, knowledge and belief; and the sources of his information are officers, employees, contractors, and agents of Carolina Power & Light Company.

Notary (Seal)

My commission expires: 6-7-93

cc: Mr. S. D. Ebnetter
Mr. L. Garner (NRC-HBR)
Mr. R. Lo

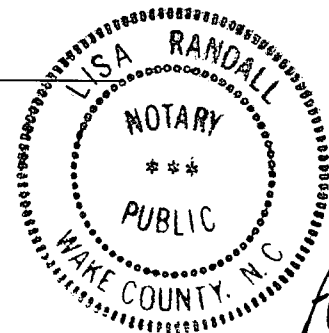

9012270009 901221
PDR ADOCK 05000261
PDR

1001
Feb
1/0