

REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8202030132 DOC. DATE: 82/01/29 NOTARIZED: YES DOCKET #
 FACIL: 50-261 H. B. Robinson Plant, Unit 2, Carolina Power and Light 05000261
 AUTH. NAME: AUTHOR AFFILIATION
 HOWE, P.W. Carolina Power & Light Co.
 RECIP. NAME: RECIPIENT AFFILIATION
 VARGA, S.A. Operating Reactors Branch 1

SUBJECT: Forwards proposed revisions to Tech Specs to incorporate requirements of 10CFR50 App J re frequency of personnel air lock testing & acceptance criteria for integrated leak rate tests. Fee encl.

DISTRIBUTION CODE: A017S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2 + 1
 TITLE: Containment Leak Rate Testing - Appendix J

NOTES: W/CHECK \$1200.00

ACTION:	RECIPIENT		COPIES		RECIPIENT	COPIES	
	ID CODE/NAME		LTTR	ENCL		ID CODE/NAME	LTTR
	ORB #1 BC	01	7	7			
INTERNAL:	ELD	13	1	1	IE	06	2
	NRR/DHFS/PTRB08		1	1	NRR/DL/ORAB	10	1
	NRR/DSI/ADCCS11		1	0	NRR/DSI/AEB		1
	NRR/DSI/CSB 09		1	1	<u>REG FILE</u>	04	1
EXTERNAL:	ACRS	11	10	10	LPDR	03	1
	NRC PDR	02	1	1	NSIC	05	1
	NTIS		1	1			

Mr. Steven A. Varga

-2-

January 29, 1982

If you have any further questions, please contact a member of our staff.

Yours very truly,




P. W. Howe
Vice President
Technical Services

DCW/lr (6358)


Enclosure

cc: J. P. O'Reilly
W. J. Ross

Sworn to and subscribed before me this 29th day of January, 1982.


Notary Public

My commission expires: Oct. 4, 1986

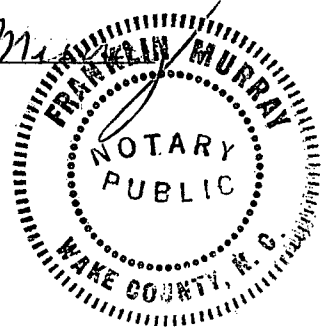




Carolina Power & Light Company

January 29, 1982

Office of Nuclear Reactor Regulation
ATTN: Mr. Steven A. Varga, Chief
Operating Reactors Branch No. 1
United States Nuclear Regulatory Commission
Washington, D.C. 20555

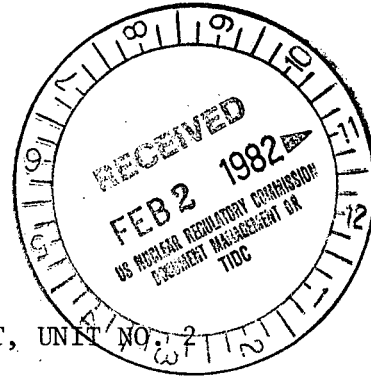

H. B. ROBINSON STEAM ELECTRIC PLANT, UNIT NO. 2
DOCKET NO. 50-261
LICENSE NO. DPR-23
REQUEST FOR LICENSE AMENDMENT - CONTAINMENT TESTS

Dear Mr. Varga:

Summary

In accordance with the Code of Federal Regulations, Title 10, Part 50.90 and Part 2.101, Carolina Power & Light Company (CP&L) hereby requests revisions to the Technical Specifications for the H. B. Robinson Steam Electric Plant (HBR) Unit 2. These revisions will incorporate the requirements of 10CFR50 Appendix J with regard to the frequency of personnel air lock testing, and acceptance criteria for Integrated Leak Rate Tests.

Details

As discussed in your letters of August 7, 1975, July 5, 1977, and December 28, 1981, and our letters of September 16, 1975 and September 21, 1977, you have requested that we incorporate the requirements of 10CFR50 Appendix J III.D.2.(b)(i), requiring leak testing of the total air lock system every six months and the requirements of Sections III.A.4.b.1 and 2 of Appendix J, requiring that values "shall be less than 0.75". These requirements have been incorporated in our proposed change.

The affected pages are attached for your review. Changes are indicated by vertical lines in the right hand margin.

In accordance with 10CFR170.22, we have determined that this revision constitutes a Class II Amendment. Accordingly, our check for \$1,200.00 is enclosed.

A017
1/1
w/check:
\$1200.00