

# REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:8202250231 DOC.DATE: 82/02/22 NOTARIZED: YES DOCKET #  
 FACIL:50-261 H. B. Robinson Plant, Unit 2, Carolina Power and Light 05000261  
 AUTH.NAME AUTHOR AFFILIATION  
 HOWE,P.W. Carolina Power & Light Co.  
 RECIP.NAME RECIPIENT AFFILIATION  
 VARGA,S.A. Operating Reactors Branch 1

SUBJECT: Application to amend DPR-23, revising Tech Specs to  
 incorporate surveillance frequencies & action statement for  
 noble gas effluent monitors.

DISTRIBUTION CODE: A001S COPIES RECEIVED:LTR 1 ENCL 1 SIZE: 2+4  
 TITLE: General Distribution for after Issuance of Operating License

NOTES: w/CHECK \$4,000.00

ACTION:	RECIPIENT		COPIES		RECIPIENT	COPIES		
	ID	CODE/NAME	LTTR	ENCL		ID	CODE/NAME	LTTR
ACTION:	ORB #1	BC	01	13			13	
INTERNAL:	ELD			1	0	IE	06	2
	NRR/DHFS	DEPY08		1	1	NRR/DL DIR		1
	NRR/DL	ORAB		1	0	NRR/DSI/RAB		1
	REG FILE		04	1	1			
EXTERNAL:	ACRS		09	10	10	LPDR	03	1
	NRC PDR		02	1	1	NSIC	05	1
	NTIS			1	1			




Carolina Power & Light Company

FEB 22 1982

Office of Nuclear Reactor Regulation  
ATTN: Mr. Steven A. Varga, Chief  
Operating Reactors Branch No. 1  
United States Nuclear Regulatory Commission  
Washington, D.C. 20555

H. B. ROBINSON STEAM ELECTRIC PLANT, UNIT NO. 2  
DOCKET NO. 50-261  
LICENSE NO. DPR-23  
REQUEST FOR LICENSE AMENDMENT -  
SURVEILLANCE REQUIREMENTS

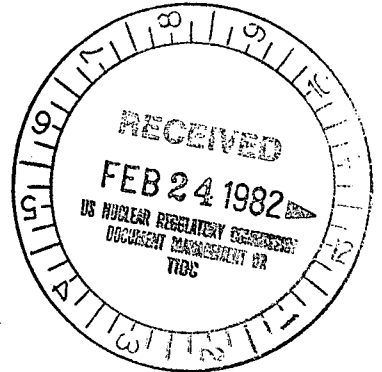

Dear Mr. Varga:

Summary

As per your requests of September 30, 1981 and of October 29, 1981 and in accordance with the Code of Federal Regulations, Title 10, Part 50.90 and Part 2.101, Carolina Power & Light Company (CP&L) hereby requests revisions to the Technical Specifications (TS) for the H. B. Robinson Steam Electric Plant, Unit No. 2 (HBR). These revisions incorporate surveillance frequencies and an action statement for Noble Gas Effluent Monitors.

Details

As requested in your letters, we propose revisions to the HBR TS that will incorporate surveillance requirements and action statements regarding the Noble Gas Effluent Monitors in Tables 3.5-5, INSTRUMENTATION TO FOLLOW THE COURSE OF AN ACCIDENT; and 4.1-1, MINIMUM FREQUENCIES FOR CHECKS, CALIBRATIONS AND TEST OF INSTRUMENT CHANNELS. The proposed revisions fulfill the requirements of NUREG-0737, Item II.F.1. Specific deviations from your sample TS have been made in an effort to be consistent with the surveillance requirements for instruments previously incorporated to fulfill the requirements of NUREG-0578, Items 2.1.3.a, 2.1.3.b and 2.1.7.b.

The affected pages are attached for your review. Revisions are indicated by vertical lines in the right hand margin.

In accordance with 10CFR170.22, we have determined that this revision constitutes a Class III Amendment. Accordingly, our check for \$4,000.00 is enclosed.

A001  
1/1  
w/check:  
\$4000.00

8202250231 820222  
PDR ADOCK 05000261  
P PDR

If you have any further questions, please contact a member of our staff.

Yours very truly,




P. W. Howe  
Vice President  
Technical Services

DCW/lr (4789)  
Enclosures

cc: Mr. J. P. O'Reilly (NRC-RII)  
Mr. W. J. Ross (NRC)

Sworn to and subscribed before me this 22nd day of February, 1982.

  
Notary Public

My commission expires: Oct. 4, 1986

