

CONTROL NO: 8432

FILE:

DO NOT REMOVE

11-26-73 GC

BUTLER(L)	SCHWENCER(L)	ZIEMANN(L)	REGAN(E)
W/ Copies	W/ Copies	W/ Copies	W/ Copies
CLARK(L)	STOLZ(L)	DICKER(E)	
W/ Copies	W/ Copies	W/ Copies	W/ Copies
GOLLER(L)	VASSALLO(L)	KNIGHTON(E)	
W/ Copies	W/ Copies	W/ Copies	W/ Copies
KNIEL(L)	✓SCHEMEL(L)	YOUNGBLOOD(E)	
W/ Copies	W/ 7 Copies	W/ Copies	W/ Copies

INTERNAL DISTRIBUTION

<u>REG FILE</u>	<u>TECH REVIEW</u>	<u>DENTON</u>	<u>LIC ASST</u>	<u>A/T IND</u>
✓AEC PDR	✓HENDRIE	GRIMES		BRAITMAN
✓OGC, ROOM P-506A	SCHROEDER	GAMMILL	DIGGS (L)	SALTZMAN
✓MUNTZING/STAFF	✓MACCARY	KASTNER	GEARIN (L)	B. HURT
✓CASE	✓KNIGHT	BALLARD	GOULBOURNE (L)	<u>PLANS</u>
GIAMBUSSO	✓PAWLICKI	SPANGLER	LEE (L)	MCDONALD
BOYD	✓SHAO		MAIGRET (L)	DUBE
MOORE (L) (BWR)	✓STELLO	<u>ENVIRO</u>	SERVICE (L)	<u>INFO</u>
DEYOUNG (L) (PWR)	✓HOUSTON	MULLER	SHEPPARD (E)	C. MILES
✓SKOVHOLT (L)	✓NOVAK	DICKER	SMITH (L)	✓B. KING (RO)
P. COLLINS	✓ROSS	KNIGHTON	✓TEETS (L)	
	✓IPPOLITO	YOUNGBLOOD	WADE (E)	
<u>REG OPR</u>	✓TEDESCO	REGAN	WILLIAMS (E)	
✓FILE & REGION (3)	✓LONG	PROJECT LDR	WILSON (L)	
✓MORRIS	✓LAINAS			
✓STEELE	✓BENAROYA	<u>HARLESS</u>		
	✓VOLLMER			

EXTERNAL DISTRIBUTION

EXTERNAL DISSEMINATION		DATE
✓1 - LOCAL PDR <u>Hartville, S. C.</u>	(1)(2)(10)-NATIONAL LAB'S _____	1-PDR-SAN/LA/NY
✓1 - DTIE(ABERNATHY)	1-ASLBP(E/W Bldg, Rm 529)	1-GERALD LELLOUCHE
✓1 - NSIC(BUCHANAN)	1-W. PENNINGTON, Rm E-201 GT	BROOKHAVEN NAT. LAB
1 - ASLB(YORE/SAYRE/ WOODARD/"H" ST.	1-CONSULTANT'S	1-AGMED(Ruth Gussman)
✓16 - CYS ACRS HOLDING SENT TO LIC. ASST. NEWMARK/BLUME/AGBABIAN	RM-B-127, GT.	1-RD..MULLER..F-309 GT
11-26-73 TEETS	1-GERALD ULRIKSON...ORNL	

Regulatory Docket File

CP&L
Carolina Power & Light Company

H. B. ROBINSON STEAM ELECTRIC PLANT
Post Office Box 790
Hartsville, South Carolina

November 23, 1973

Robinson File No. 2-0-4-a



Mr. Norman C. Mosley, Director
U. S. Atomic Energy Commission
Directorate of Regulatory Operations, Region II,
230 Peachtree Street, N.W.
Suite 818
Atlanta, Georgia 30303

Mr. John F. O'Leary
Directorate of Licensing (Office of Regulation)
U. S. Atomic Energy Commission
Washington, D. C. 20545

Dear Sir:

In accordance with section 6.6.2 of the Technical Specifications, the following abnormal occurrence is reported:

1. Report No. 50-261/73-70
- 2a. Date November 23, 1973
- 2b. Occurrence Date November 22, 1973
3. Facility H. B. Robinson Unit No. 2, Hartsville, South Carolina
4. Identification of Occurrence
Primary to secondary leak in Steam Generator "C".
5. Conditions Prior to Occurrence
The plant was operating normally at full power.

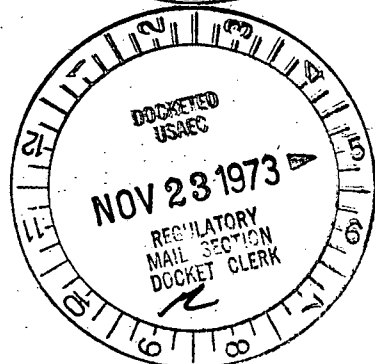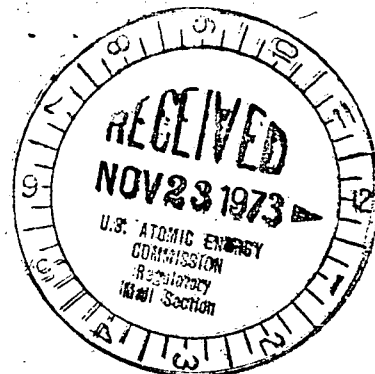

8432
8432
8432

6. Description of Occurrence

At 1110 hours on November 23, 1973, radiation monitors alarmed indicating radioactivity in the secondary plant. Investigation showed the source of the leak to be Steam Generator "C". A leakage rate evaluation indicated a leakage rate of approximately 4 gpm from primary to secondary. The plant was taken to hot shutdown at 1504, and a cooldown was begun at 1512.

7. Designation of the Apparent Cause of the Occurrence

The leak resulted from a failure in the primary to secondary pressure boundary within Steam Generator "C".

8. Analysis of Occurrence

No personnel injuries occurred, and activity releases were minimal and within limits.

9. Corrective Action


Following plant cooldown Steam Generator "C" will be entered for investigation. Corrective actions will depend on investigative results.

10. Failure Data

This generator is a Westinghouse Series 44 vertical steam generator, serial number 16A6081-2.

Previous problems in this steam generator have been cladding separation on June 11, 1971, and tube corrosion in May, 1972.

Yours very truly,



Benny J. Furr, Manager
H. B. Robinson SEG Plant

ACT:gg