
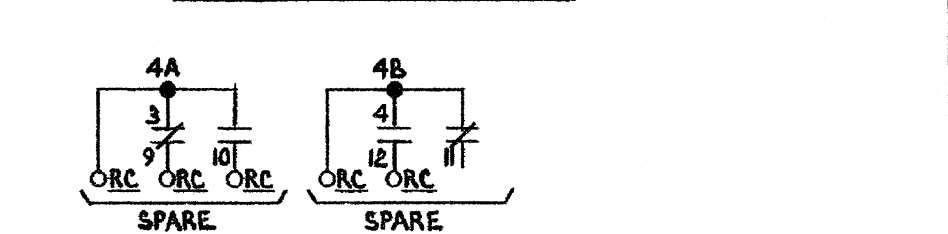
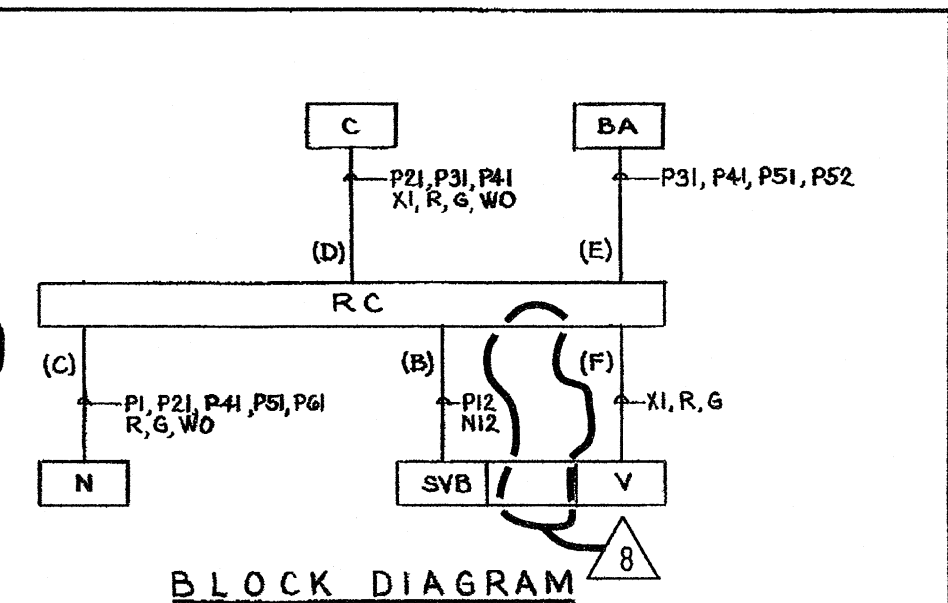


REV	DESCRIPTION	DATE	CHK	SUPV	CHIEF	PROJ	OWNER
7	INC. DUN 04-0212-001-010 & -002-010 BOTH REV. 00 (REDRAWN)	2-8-73	APC	MA/KS	SVS	CEC	—
8	ISSUED FOR CONSTRUCTION	2-8-73	APC	MA/KS	SVS	CEC	—
0							

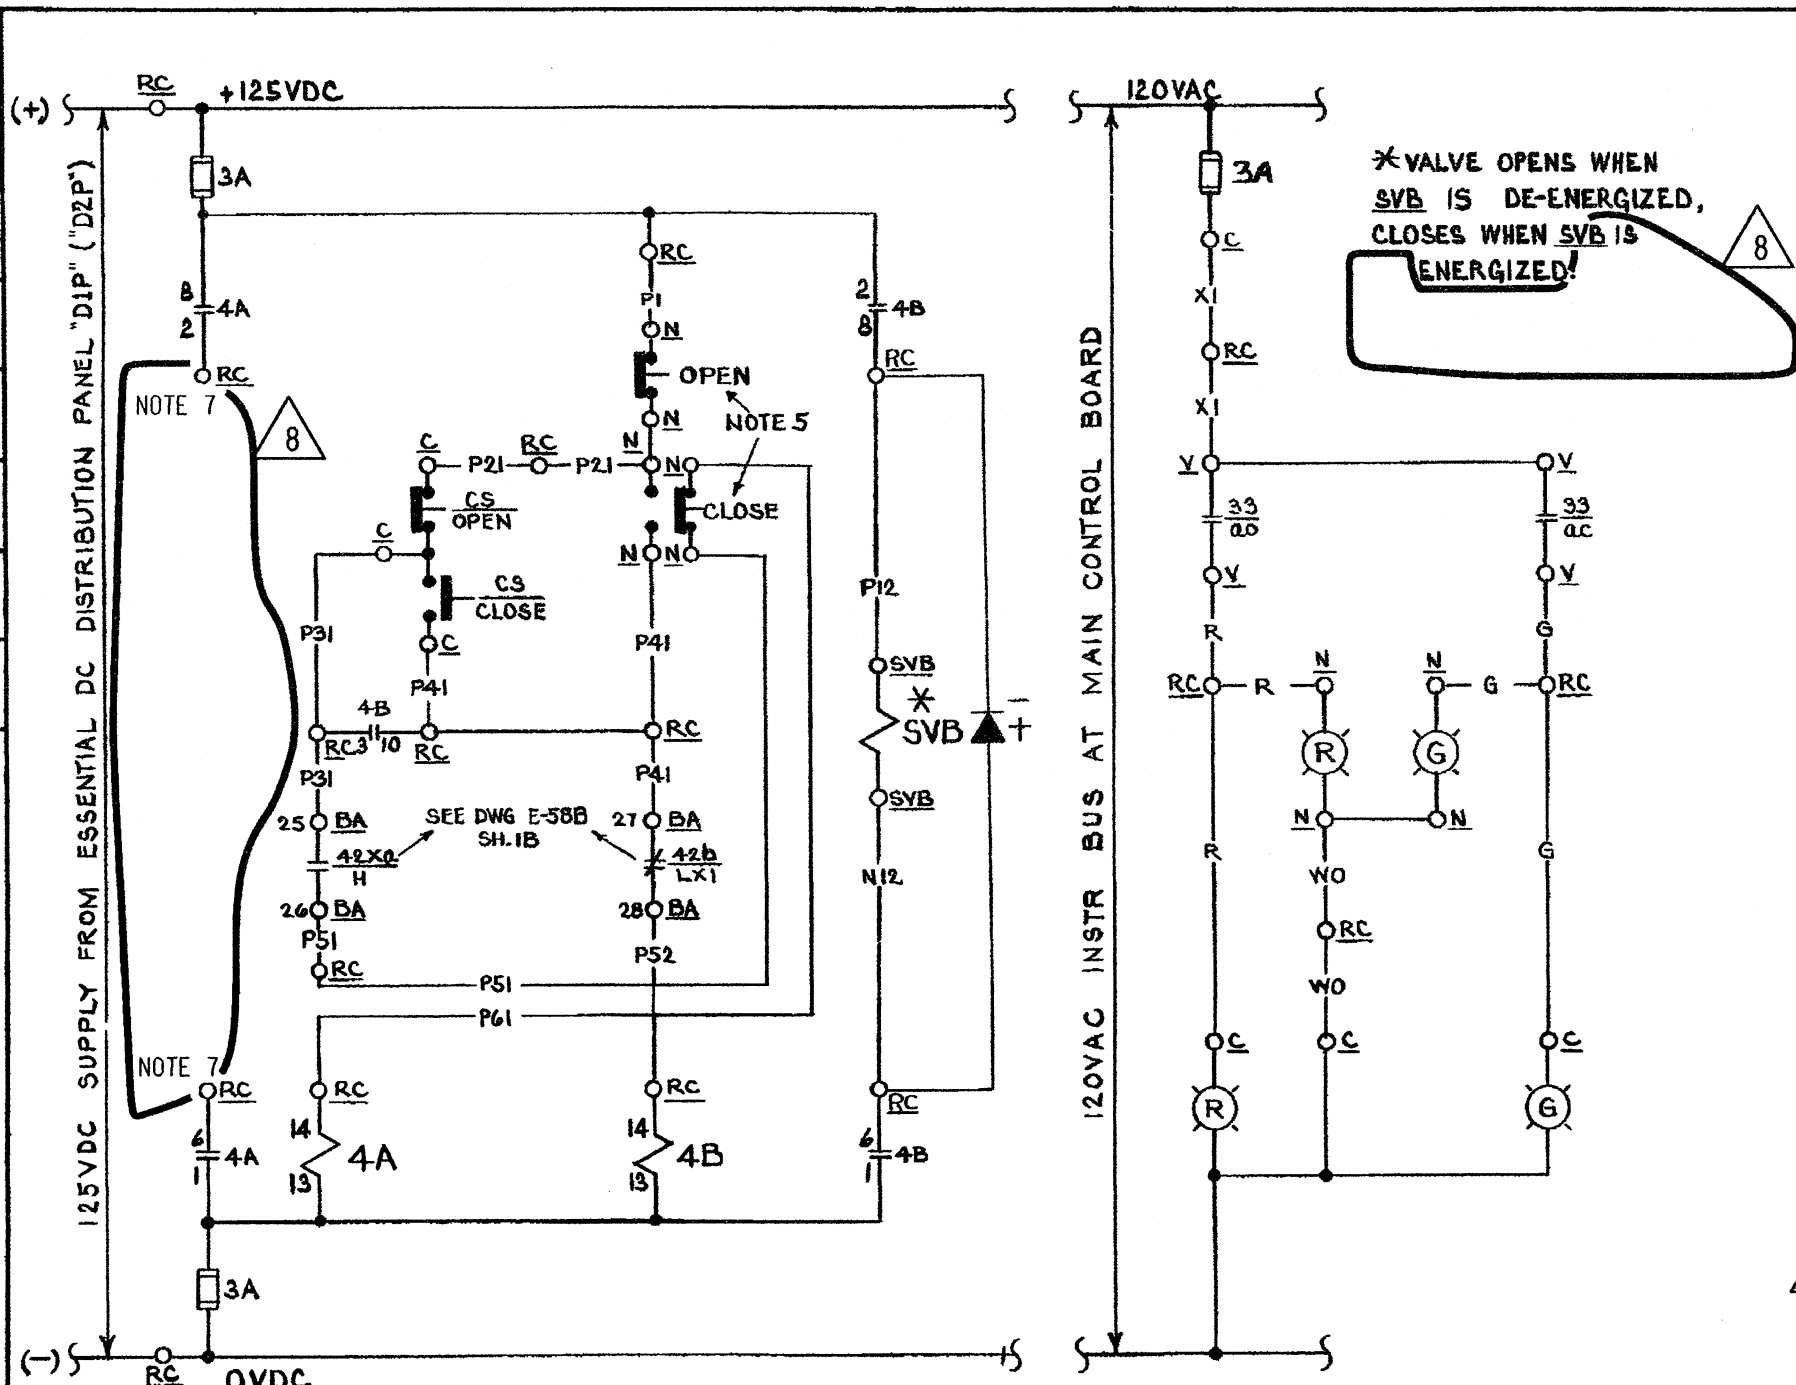

- NOTES**
- FOR GENERAL NOTES SEE DWG E-48B INDEX SHEET
  - FOR DETAILS OF CONTROL SW (CS) SEE DWG E-30B SH. 7 FIG 7C
  - FOR DETAILS OF LOCAL INDICATING LIGHTS SEE DWG. E-30B SH 7 TYPES 4.
  - FOR VALVE LIMIT SW CONTACT DESIGNATION SEE DWG E-30B SH. 8
  - LOCAL PUSHBUTTONS SHALL BE REES CAT # 00294-002 FOR 'OPEN' P.B. AND CAT # 00294-003 FOR 'CLOSE' P.B.
  - CONTROL SWITCH CS OPENS AND CLOSES THE VALVE ONLY WHEN FAN IS OFF.
  - SVB HAS BEEN REMOVED AND ITS CABLE HAS BEEN DETERMINATED AT THE RELAY CABINET AND VALVE JUNCTION BOX AND SPARED IN PLACE.

SCHEME NO. (SEE TABLE)

**LEGEND**

SCHEME NO	S U NO	CHANNEL	WIRE PREFIX AT MAIN CTRL BD	CS	EQUIPMENT						D E S C R I P T I O N
					C	RC	SV A	SV B	N	BA	
VI356	II	1	AOA	HIS1356	C5716	RC3701	NOTE 7	SV1356B	NV1356	BE1401	CTMT AIR CLR 1-1 OUTLET
VI357	II	2	AOB	HIS1357	C5716	RC3702	NOTE 7	SV1357B	NV1357	BF1401	CTMT AIR CLR 1-2 OUTLET

■ CONTROLLED VALVE HAS THE SAME NO AS THE SCHEME NO.

THIS DRAWING WAS REDRAWN/SCANNED ON CAD AND SUPERSEDES REV. 7.

**DAVIS-BESSE NUCLEAR POWER STATION**

THE TOLEDO EDISON COMPANY  
THE CLEVELAND ELECTRIC ILLUMINATING COMPANY

**ELEMENTARY WIRING DIAGRAMS**

**LAKE WATER SYSTEM**

**CTMT AIR CLR'S 1-1 & 1-2 OUTLET VLV'S**

BECHTEL COMPANY	JOB NO	DRAWING NO.	REV.
	7749	E-48B SH. 13	8