



Tennessee Valley Authority, Post Office Box 2000, Decatur, Alabama 35609-2000

April 21, 2015

10 CFR 50.4

ATTN: Document Control Desk
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555-0001

Browns Ferry Nuclear Plant, Unit 2
Renewed Facility Operating License No. DPR-52
NRC Docket No. 50-260

Subject: **Browns Ferry Nuclear Plant, Unit 2 Core Operating Limits Report for Cycle 19 Operations Revision 2**

- References:
1. Letter from TVA to NRC, "Browns Ferry Nuclear Plant, Unit 2 Core Operating Limits Report for Cycle 19 Operations," dated March 16, 2015
 2. Letter from TVA to NRC, "Browns Ferry Nuclear Plant, Unit 2 Core Operating Limits Report for Cycle 19 Operations Revision 1," dated April 6, 2015

In accordance with the requirements of Technical Specification 5.6.5.d, the Tennessee Valley Authority (TVA) is submitting the Browns Ferry Nuclear Plant (BFN), Unit 2, Cycle 19, Core Operating Limits Report (COLR), Revision 2. Revision 0 of the BFN, Unit 2, Cycle 19, COLR (Reference 1) included all modes of operation (Modes 1 through 5). Revision 1 of the BFN, Unit 2, Cycle 19, COLR (Reference 2) provided supplemental thermal limits information for early in cycle startup support (0-250 megawatt day per metric ton uranium (MWd/MTU) cycle exposure). Revision 2 of the BFN, Unit 2, Cycle 19, COLR has been updated to extend supplemental thermal limits information for early cycle startup from 250 MWd/MTU out to 3000 MWd/MTU cycle exposure. TVA expects to revise the COLR again in approximately 90 days to cover full cycle operation.

There are no new commitments contained in this letter. If you have any questions please contact Jamie L. Paul at (256) 729-2636.

Respectfully,

A handwritten signature in black ink, appearing to read "K. J. Polson".

K. J. Polson
Vice President

U.S. Nuclear Regulatory Commission
Page 2
April 21, 2015

Enclosure: Core Operating Limits Report, (105% OLTP), for Cycle 19 Operation
TVA-COLR-BF2C19, Revision 2

cc: (w/ Enclosure)

NRC Regional Administrator - Region II
NRC Senior Resident Inspector - Browns Ferry Nuclear Plant

**Enclosure
Tennessee Valley Authority
Browns Ferry Nuclear Plant
Unit 2**

**Core Operating Limits Report, (105% OLTP), for Cycle 19 Operation
TVA-COLR-BF2C19, Revision 2**

(See Attached)



EDMS L32 150416 801
QA Document
Pages Affected: all
BFE-3843, Revision 2

Reactor Engineering and Fuels - BWRFE


1101 Market Street, Chattanooga, TN 37402


Browns Ferry Unit 2 Cycle 19

Core Operating Limits Report, (105% OLTP)


TVA-COLR-BF2C19 Revision 2 (Final)
(Revision Log, Page v)


April 2015

Prepared:  Date: April 16, 2015
T. W. Eichenberg, Sr. Specialist

Verified:  Date: 4/16/15
B. C. Mitchell, Engineer

Approved:  Date: 4/16/15
G. C. Storey, Manager, BWR Fuel Engineering

Reviewed:  Date: 4/17/15
D. D. Coffey, Manager, Reactor Engineering

Approved:  Date: 4.21.15
Chairman, PORC

Approved:  Date: 4/21/15
Plant Manager



Table of Contents

Total Number of Pages = 59 (including review cover sheet)

List of Tables.....	iii
List of Figures	iv
Revision Log	v
Nomenclature.....	vi
References.....	viii
1 Introduction	1
1.1 Purpose	1
1.1.1 Revision 2.....	1
1.2 Scope	1
1.3 Fuel Loading.....	2
1.4 Acceptability	2
2 APLHGR Limits	3
2.1 Rated Power and Flow Limit: $APLHGR_{RATED}$	3
2.2 Off-Rated Power Dependent Limit: $APLHGR_P$	3
2.2.1 Startup without Feedwater Heaters.....	3
2.3 Off-Rated Flow Dependent Limit: $APLHGR_F$	3
2.4 Single Loop Operation Limit: $APLHGR_{SLO}$	3
2.5 Equipment Out-Of-Service Corrections.....	7
3 LHGR Limits.....	8
3.1 Rated Power and Flow Limit: $LHGR_{RATED}$	8
3.2 Off-Rated Power Dependent Limit: $LHGR_P$	8
3.2.1 Startup without Feedwater Heaters.....	8
3.3 Off-Rated Flow Dependent Limit: $LHGR_F$	9
3.4 Equipment Out-Of-Service Corrections.....	9
4 OLMCPR Limits	27
4.1 Flow Dependent MCPR Limit: $MCPR_F$	27
4.2 Power Dependent MCPR Limit: $MCPR_P$	27
4.2.1 Startup without Feedwater Heaters.....	27
4.2.2 Scram Speed Dependent Limits (TSSS vs. NSS vs. OSS).....	28
4.2.3 Exposure Dependent Limits	28
4.2.4 Equipment Out-Of-Service (EOOS) Options	29
4.2.5 Single-Loop-Operation (SLO) Limits	29
4.2.6 Below Pbypass Limits	29
5 Oscillation Power Range Monitor (OPRM) Setpoint	45
6 APRM Flow Biased Rod Block Trip Settings.....	46
7 Rod Block Monitor (RBM) Trip Setpoints and Operability	47
8 Shutdown Margin Limit.....	49



List of Tables

Nuclear Fuel Types	2
Startup Feedwater Temperature Basis	8
Nominal Scram Time Basis	28
MCPR _P Limits for All Fuel Types: Optimum Scram Time Basis	31
MCPR _P Limits for All Fuel Types: Nominal Scram Time Basis	32
MCPR _P Limits for All Fuel Types: Technical Specification Scram Time Basis	34
Startup Operation MCPR _P Limits for Table 3.1 Temperature Range 1 for All Fuel Types: Nominal Scram Time Basis	36
Startup Operation MCPR _P Limits for Table 3.1 Temperature Range 2 for All Fuel Types: Nominal Scram Time Basis	37
Startup Operation MCPR _P Limits for Table 3.1 Temperature Range 1 for All Fuel Types: Technical Specification Scram Time Basis	38
Startup Operation MCPR _P Limits for Table 3.1 Temperature Range 2 for All Fuel Types: Technical Specification Scram Time Basis	39
BOC to 3000 MWd/MTU Startup Operation MCPR _P Limits for Table 3.1 Temperature Range 1 for All Fuel Types: Nominal Scram Time Basis	40
BOC to 3000 MWd/MTU Startup Operation MCPR _P Limits for Table 3.1 Temperature Range 2 for All Fuel Types: Nominal Scram Time Basis	41
BOC to 3000 MWd/MTU Startup Operation MCPR _P Limits for Table 3.1 Temperature Range 1 for All Fuel Types: Technical Specification Scram Time Basis	42
BOC to 3000 MWd/MTU Startup Operation MCPR _P Limits for Table 3.1 Temperature Range 2 for All Fuel Types: Technical Specification Scram Time Basis	43
MCPR _P Limits for All Fuel Types: Single Loop Operation for All Scram Times	44
OPRM Setpoint Range	45
OPRM Successive Confirmation Count Setpoint	45
Analytical RBM Trip Setpoints	47
RBM Setpoint Applicability	47
Control Rod Withdrawal Error Results	48



List of Figures

APLHGR _{RATED} for ATRIUM-10 Fuel	4
APLHGR _{RATED} for ATRIUM-10XM Fuel	5
APLHGR _{RATED} for ATRIUM-11 Fuel.....	6
LHGR _{RATED} for ATRIUM-10 Fuel	10
LHGR _{RATED} for ATRIUM-10XM Fuel.....	11
LHGR _{RATED} for ATRIUM-11 Fuel	12
Base Operation LHGRFAC _P for ATRIUM-10 Fuel	13
Base Operation LHGRFAC _P for ATRIUM-10XM Fuel.....	14
Base Operation LHGRFAC _P for ATRIUM-11 Fuel	15
LHGRFAC _F for ATRIUM-10 Fuel	16
LHGRFAC _F for ATRIUM-10XM Fuel.....	17
LHGRFAC _F for ATRIUM-11 Fuel	18
Startup Operation LHGRFAC _P for ATRIUM-10 Fuel: Table 3.1 Temperature Range 1.....	19
Startup Operation LHGRFAC _P for ATRIUM-10 Fuel: Table 3.1 Temperature Range 2.....	20
Startup Operation LHGRFAC _P for ATRIUM-10XM Fuel: Table 3.1 Temperature Range 1	21
Startup Operation LHGRFAC _P for ATRIUM-10XM Fuel: Table 3.1 Temperature Range 2	22
Startup Operation LHGRFAC _P for ATRIUM-11 Fuel: Table 3.1 Temperature Range 1.....	23
Startup Operation LHGRFAC _P for ATRIUM-11 Fuel: Table 3.1 Temperature Range 2.....	24
BOC to 3000 MWd/MTU Startup Operation LHGRFAC _P for ATRIUM-10 Fuel: Table 3.1 Temperature Range 1	25
BOC to 3000 MWd/MTU Startup Operation LHGRFAC _P for ATRIUM-10 Fuel: Table 3.1 Temperature Range 2.....	26
MCPR _F for All Fuel Types	30



Revision Log

Number	Page	Description
1-R2	x	Added Reference 32 supplement to BFN Reload Analysis Report
2-R2	1	Revised Section 1.1.1 to identify the new range of applicability for startup with feedwater heating out of service
3-R2	8	Revised last sentence of Section 3.2.1 to reflect the updated cycle exposure range of applicability (3000 MWd/MTU); also added Reference 32
4-R2	25-26	Revised Section 3, Figure 3.16-17 titles to reflect the updated cycle exposure range of applicability (3000 MWd/MTU). No limits were changed, only titles.
5-R2	27	Revised last sentence of Section 4.2.1 to reflect the updated cycle exposure range of applicability (3000 MWd/MTU); also added Reference 32.
6-R2	40-43	Revised Section 4, Tables 4.9 - 4.12 to reflect the updated cycle exposure range of applicability (3000 MWd/MTU). No limits were changed, only titles
1-R1	x	Added Reference 31 supplement to BFN Unit 2 Cycle 19 Reload Analysis
2-R1	1-49	Corrected page numbering. Revision 0 did not reset the page numbering at Section 1 to start at 1, after the roman numeral sections at the front of the document . The new Arabic numbered pages for Sections 1 through 8 begin with page 1 and go through page 49.
3-R1	1	Added Section 1.1.1 to describe Revision 1 purpose
4-R1	8	Added discussion of Reference 31 for LHGRFAC _p
5-R1	9	Figure number range increased to Figure 3.17
6-R1	25-26	Added Figure 3.16 & Figure 3.17, LHGRFAC _p for ATRIUM-10 fuel BOC - 250 MWd/MTU
7-R1	27	Added discussion of Reference 31 for MCPR _p
8-R1	29	Renumbered Table 4.9 as Table 4.13
9-R1	40-43	Inserted Table 4.9 through Table 4.12, BOC – 250 MWd/MTU Startup Operation MCPR _p Limits
10-R1	44	Renumbered Table 4.9 as Table 4.13
0-R0	All	New document.



Nomenclature

APLHGR	Average Planar LHGR
APRM	Average Power Range Monitor
AREVA NP	Vendor (Framatome, Siemens)
BOC	Beginning of Cycle
BSP	Backup Stability Protection
BWR	Boiling Water Reactor
CAVEX	Core Average Exposure
CD	Coast Down
CMSS	Core Monitoring System Software
COLR	Core Operating Limits Report
CPR	Critical Power Ratio
CRWE	Control Rod Withdrawal Error
CSDM	Cold SDM
DIVOM	Delta CPR over Initial CPR vs. Oscillation Magnitude
EOC	End of Cycle
EOCLB	End-of-Cycle Licensing Basis
EOOS	Equipment OOS
FFTR	Final Feedwater Temperature Reduction
FFWTR	Final Feedwater Temperature Reduction
FHOOS	Feedwater Heaters OOS
ft	Foot: english unit of measure for length
GNF	Vendor (General Electric, Global Nuclear Fuels)
GWd	Giga Watt Day
HTSP	High TSP
ICA	Interim Corrective Action
ICF	Increased Core Flow (beyond rated)
IS	In-Service
kW	kilo watt: SI unit of measure for power.
LCO	License Condition of Operation
LFWH	Loss of Feedwater Heating
LHGRFAC	LHGR Multiplier (Power or Flow dependent)
LPRM	Low Power Range Monitor
LRNB	Generator Load Reject, No Bypass
MAPFAC	MAPLHGR multiplier (Power or Flow dependent)



MCPR	Minimum CPR
MSRV	Moisture Separator Reheater Valve
MSRVOOS	MSRV OOS
MTU	Metric Ton Uranium
MWd/MTU	Mega Watt Day per Metric Ton Uranium
NEOC	Near EOC
NRC	United States Nuclear Regulatory Commission
NSS	Nominal Scram Speed
NTSP	Nominal TSP
OLMCPR	MCPR Operating Limit
OOS	Out-Of-Service
OPRM	Oscillation Power Range Monitor
OSS	Optimum Scram Speed
PBDA	Period Based Detection Algorithm
Pbypass	Power, below which TSV Position and TCV Fast Closure Scrams are Bypassed
PLU	Power Load Unbalance
PLUOOS	PLU OOS
PRNM	Power Range Neutron Monitor
RBM	Rod Block Monitor
RCPOOS	Recirculation Pump OOS (SLO)
RPS	Reactor Protection System
RPT	Recirculation Pump Trip
RPTOOS	RPT OOS
SDM	Shutdown Margin
SLMCPR	MCPR Safety Limit
SLO	Single Loop Operation
TBV	Turbine Bypass Valve
TBVIS	TBV IS
TBVOOS	Turbine Bypass Valves OOS
TIP	Transversing In-core Probe
TIPOOS	TIP OOS
TLO	Two Loop Operation
TSP	Trip Setpoint
TSSS	Technical Specification Scram Speed
TVA	Tennessee Valley Authority



References

1. ANP-3354, Revision 0, **Browns Ferry Unit 2 Cycle 19 Reload Safety Report**, AREVA NP, Inc., November 2014.
2. ANP-3031P, Revision 3, **Mechanical Design Report for Browns Ferry Units 1, 2, and 3 ATRIUM-10 Fuel Assemblies**, AREVA NP, Inc., May 2014.
3. ANP-3150P, Revision 1, **Mechanical Design Report for Browns Ferry ATRIUM 10XM Fuel Assemblies**, AREVA Inc., October 2014.
4. ANP-3302P, Revision 0, **Browns Ferry Unit 2 Cycle 19 Plant Parameters Document**, AREVA Inc., June 2014.
5. BFE-3830, Revision 0, **Browns Ferry Unit 2 Cycle 19 In Core Shuffle**, Calculation File, Tennessee Valley Authority, March 2015.

Methodology References

6. XN-NF-81-58(P)(A) Revision 2 and Supplements 1 and 2, **RODEX2 Fuel Rod Thermal-Mechanical Response Evaluation Model**, Exxon Nuclear Company, March 1984.
7. XN-NF-85-67(P)(A) Revision 1, **Generic Mechanical Design for Exxon Nuclear Jet Pump BWR Reload Fuel**, Exxon Nuclear Company, September 1986.
8. EMF-85-74(P) Revision 0 Supplement 1(P)(A) and Supplement 2(P)(A), **RODEX2A (BWR) Fuel Rod Thermal-Mechanical Evaluation Model**, Siemens Power Corporation, February 1998.
9. ANF-89-98(P)(A) Revision 1 and Supplement 1, **Generic Mechanical Design Criteria for BWR Fuel Designs**, Advanced Nuclear Fuels Corporation, May 1995.
10. XN-NF-80-19(P)(A) Volume 1 and Supplements 1 and 2, **Exxon Nuclear Methodology for Boiling Water Reactors - Neutronic Methods for Design and Analysis**, Exxon Nuclear Company, March 1983.
11. XN-NF-80-19(P)(A) Volume 4 Revision 1, **Exxon Nuclear Methodology for Boiling Water Reactors: Application of the ENC Methodology to BWR Reloads**, Exxon Nuclear Company, June 1986.
12. EMF-2158(P)(A) Revision 0, **Siemens Power Corporation Methodology for Boiling Water Reactors: Evaluation and Validation of CASMO-4/MICROBURN-B2**, Siemens Power Corporation, October 1999.
13. XN-NF-80-19(P)(A) Volume 3 Revision 2, **Exxon Nuclear Methodology for Boiling Water Reactors, THERMEX: Thermal Limits Methodology Summary Description**, Exxon Nuclear Company, January 1987.
14. XN-NF-84-105(P)(A) Volume 1 and Volume 1 Supplements 1 and 2, **XCOBRA-T: A Computer Code for BWR Transient Thermal-Hydraulic Core Analysis**, Exxon Nuclear Company, February 1987.



15. ANP-10307PA, Revision 0, **AREVA MCPR Safety Limit Methodology for Boiling Water Reactors**, AREVA NP Inc., June 2011.
16. ANF-913(P)(A) Volume 1 Revision 1 and Volume 1 Supplements 2, 3 and 4, **COTRANSA2: A Computer Program for Boiling Water Reactor Transient Analyses**, Advanced Nuclear Fuels Corporation, August 1990.
17. ANF-1358(P)(A) Revision 3, **The Loss of Feedwater Heating Transient in Boiling Water Reactors**, Advanced Nuclear Fuels Corporation, September 2005.
18. EMF-2209(P)(A) Revision 3, **SPCB Critical Power Correlation**, AREVA NP Inc., September 2009.
19. EMF-2361(P)(A) Revision 0, **EXEM BWR-2000 ECCS Evaluation Model**, Framatome ANP Inc., May 2001, [as supplemented by the site specific approval in NRC safety evaluations dated February 15, 2013 and July 31, 2014.](#)
20. EMF-2292(P)(A) Revision 0, **ATRIUM™-10: Appendix K Spray Heat Transfer Coefficients**, Siemens Power Corporation, September 2000.
21. EMF-CC-074(P)(A), Volume 4, Revision 0, **BWR Stability Analysis: Assessment of STAIF with Input from MICROBURN-B2**, Siemens Power Corporation, August 2000.
22. BAW-10255(P)(A), Revision 2, **Cycle-Specific DIVOM Methodology Using the RAMONA5-FA Code**, AREVA NP Inc., May 2008.
23. BAW-10247PA, Revision 0, **Realistic Thermal-Mechanical Fuel Rod Methodology for Boiling Water Reactors**, AREVA NP Inc., April 2008.
24. ANP-10298PA, Revision 0, **ACE/ATRIUM 10XM Critical Power Correlation**, AREVA NP Inc., March 2010.
25. ANP-3140(P), Revision 0, **Browns Ferry Units 1, 2, and 3 Improved K-factor Model for ACE/ATRIUM 10XM Critical Power Correlation**, AREVA NP Inc., August 2012.

PRNM Setpoint References

26. Filtered Setpoints - EDE-28-0990 Rev. 3 Supplement E, "PRNM (APRM, RBM, and RFM) Setpoint Calculations [ARTS/MELLL (NUMAC) - Power-Uprate Condition] for Tennessee Valley Authority Browns Ferry Nuclear Plant", October 1997.
27. Unfiltered Setpoints - EDE-28-0990 Rev. 2 Supplement E, "PRNM (APRM, RBM, and RFM) Setpoint Calculations [ARTS/MELLL (NUMAC) - Power-Uprate Condition] for Tennessee Valley Authority Browns Ferry Nuclear Plant", October 1997.
28. GE Letter LB#: 262-97-133, Browns Ferry Nuclear Plant Rod Block Monitor Setpoint Clarification - GE Proprietary Information, September 12, 1997.
29. NEDC-32433P, **Maximum Extended Load Line Limit and ARTS Improvement Program Analyses for Browns Ferry Nuclear Plant Unit 1, 2, and 3**, GE Nuclear Energy, April 1995.



-
30. NEDO-32465-A, **Licensing Topical Report – Reactor Stability Detect and Suppress Solutions Licensing Basis Methodology for Reload Applications**, GE Nuclear Energy, August 1996.
 31. FAB15-2152, **Transmittal of Supplement to Browns Ferry Unit 2 Cycle 19 Reload Analysis**, AREVA Inc., April 4, 2015.
 32. FAB15-2162, **Transmittal of Extended Applicability of Supplement to BFE2-19 Startup FHOOS1 and Startup FHOOS2 to 3000 MWd/MTU**, AREVA Inc., April 15, 2015.
-



1 Introduction

In anticipation of cycle startup, it is necessary to describe the expected limits of operation.

1.1 Purpose

The primary purpose of this document is to satisfy requirements identified by unit technical specification section 5.6.5. This document may be provided, upon final approval, to the NRC.

1.1.1 Revision 2

The purpose of this revision is to provide supplemental thermal limits information for early in cycle startup support (0-3000 MWd/MTU cycle exposure). New limits are provided for power operation below P_{bypass} .

1.2 Scope

This document will discuss the following areas:

- Average Planar Linear Heat Generation Rate (APLHGR) Limit
(Technical Specifications 3.2.1 and 3.7.5)
Applicability: Mode 1, $\geq 25\%$ RTP (Technical Specifications definition of RTP)
- Linear Heat Generation Rate (LHGR) Limit
(Technical Specification 3.2.3, 3.3.4.1, and 3.7.5)
Applicability: Mode 1, $\geq 25\%$ RTP (Technical Specifications definition of RTP)
- Minimum Critical Power Ratio Operating Limit (OLMCPR)
(Technical Specifications 3.2.2, 3.3.4.1, 3.7.5 and Table 3.3.2.1-1)
Applicability: Mode 1, $\geq 25\%$ RTP (Technical Specifications definition of RTP)
- Oscillation Power Range Monitor (OPRM) Setpoint
(Technical Specification Table 3.3.1.1)
Applicability: Mode 1, \geq (as specified in Technical Specifications Table 3.3.1.1-1)
- Average Power Range Monitor (APRM) Flow Biased Rod Block Trip Setting
(Technical Requirements Manual Section 5.3.1 and Table 3.3.4-1)
Applicability: Mode 1, \geq (as specified in Technical Requirements Manuals Table 3.3.4-1)
- Rod Block Monitor (RBM) Trip Setpoints and Operability
(Technical Specification Table 3.3.2.1-1)
Applicability: Mode 1, \geq % RTP as specified in Table 3.3.2.1-1 (TS definition of RTP)
- Shutdown Margin (SDM) Limit
(Technical Specification 3.1.1)
Applicability: All Modes



1.3 Fuel Loading

The core will contain previously exposed AREVA NP, Inc., ATRIUM-10 fuel, along with fresh ATRIUM-10XM and ATRIUM-11 fuel. Nuclear fuel types used in the core loading are shown in Table 1.1. The core shuffle and final loading were explicitly evaluated for BOC cold shutdown margin performance as documented per Reference 5.

Table 1.1 Nuclear Fuel Types^{*}

Fuel Description	Original Cycle	Number of Assemblies	Nuclear Fuel Type (NFT)	Fuel Names (Range)
ATRIUM-10 A10-3799B-14GV80-FBD	17	73	10	FBD001-FBD136
ATRIUM-10 A10-4004B-15GV80-FBD	17	115	11	FBD137-FBD272
ATRIUM-10 A10-4165B-15GV75-FBE	18	176	12	FBE001-FBE176
ATRIUM-10 A10-4107B-13GV75-FBE	18	68	13	FBE177-FBE244
ATRIUM-10 A10-4176B-10GV75-FBE	18	72	14	FBE245-FBE316
ATRIUM 10XM XMLC-3904B-15GV80-FBF	19	172	15	FBF401-FBF572
ATRIUM 10XM XMLC-4035B-13GV80-FBF	19	80	16	FBF573-FBF652
ATRIUM 11 A11-3693B-13GV80-FBF	19	8	17	FBF653-FBF660

1.4 Acceptability

Limits discussed in this document were generated based on NRC approved methodologies per References 6 through 25.

^{*} The table identifies the expected fuel type breakdown in anticipation of final core loading. The final composition of the core depends upon uncertainties during the outage such as discovering a failed fuel bundle, or other bundle damage. Minor core loading changes, due to unforeseen events, will conform to the safety and monitoring requirements identified in this document.



2 APLHGR Limits

(Technical Specifications 3.2.1 & 3.7.5)

The APLHGR limit is determined by adjusting the rated power APLHGR limit for off-rated power, off-rated flow, and SLO conditions. The most limiting of these is then used as follows:

$$\text{APLHGR limit} = \text{MIN} (\text{APLHGR}_P , \text{APLHGR}_F, \text{APLHGR}_{\text{SLO}})$$

where:

APLHGR _P	off-rated power APLHGR limit	$[\text{APLHGR}_{\text{RATED}} * \text{MAPFAC}_P]$
APLHGR _F	off-rated flow APLHGR limit	$[\text{APLHGR}_{\text{RATED}} * \text{MAPFAC}_F]$
APLHGR _{SLO}	SLO APLHGR limit	$[\text{APLHGR}_{\text{RATED}} * \text{SLO Multiplier}]$

2.1 Rated Power and Flow Limit: APLHGR_{RATED}

The rated conditions APLHGR for ATRIUM-10 fuel is identified in Reference 1 and shown in Figure 2.1. The rated conditions APLHGR for ATRIUM-10XM are shown in Figure 2.2. The rated conditions APLHGR for ATRIUM-11 are shown in Figure 2.3.

2.2 Off-Rated Power Dependent Limit: APLHGR_P

Reference 1 does not specify a power dependent APLHGR. Therefore, MAPFAC_P is set to a value of **1.0**.

2.2.1 Startup without Feedwater Heaters


There is a range of operation during startup when the feedwater heaters are not placed into service until after the unit has reached a significant operating power level. No additional power dependent limitation is required.

2.3 Off-Rated Flow Dependent Limit: APLHGR_F

Reference 1 does not specify a flow dependent APLHGR. Therefore, MAPFAC_F is set to a value of **1.0**.


2.4 Single Loop Operation Limit: APLHGR_{SLO}

The single loop operation multiplier for ATRIUM-10, ATRIUM-10XM, and ATRIUM-11 fuel is **0.85**, per Reference 1.

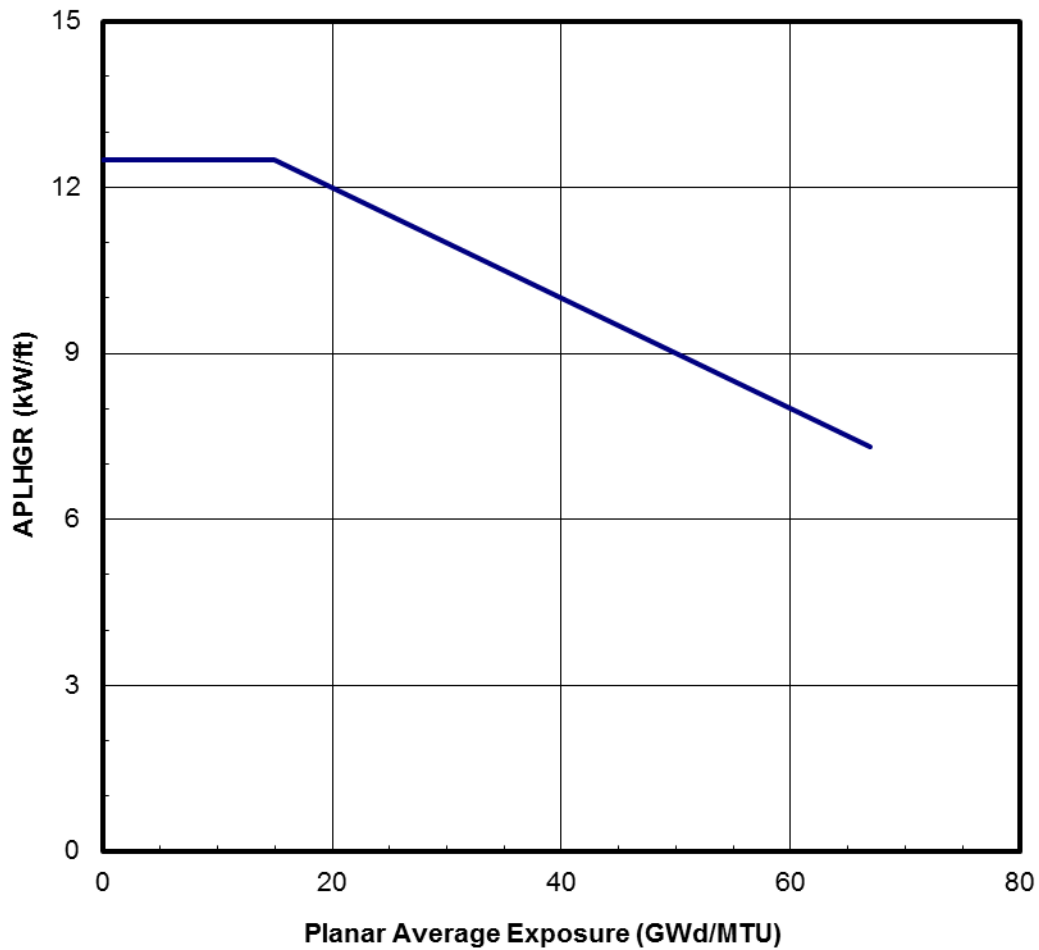


Planar Avg. Exposure (GWd/MTU)	APLHGR Limit (kW/ft)
0.0	12.5
15.0	12.5
67.0	7.3

Figure 2.1 APLHGR_{RATED} for ATRIUM-10 Fuel

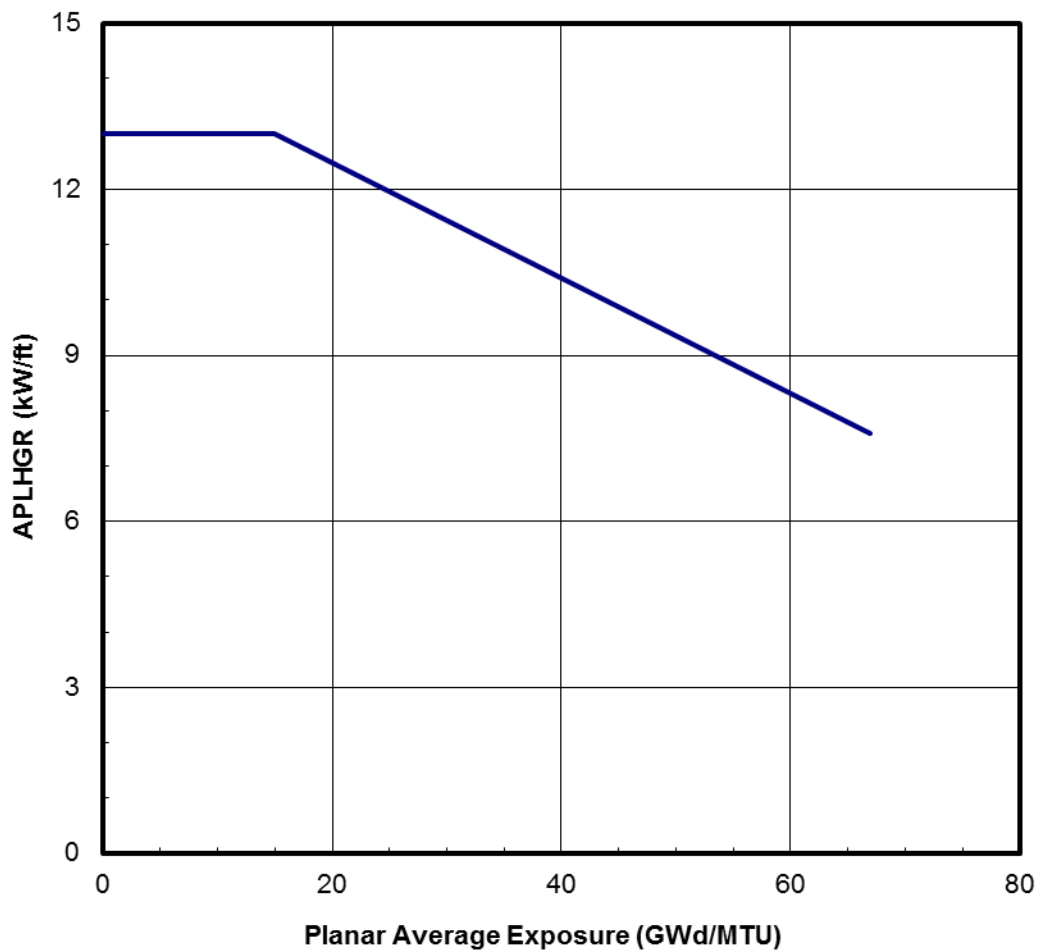

Planar Avg. Exposure (GWd/MTU)	APLHGR Limit (kW/ft)
0.0	13.0
15.0	13.0
67.0	7.6

Figure 2.2 APLHGR_{RATED} for ATRIUM-10XM Fuel

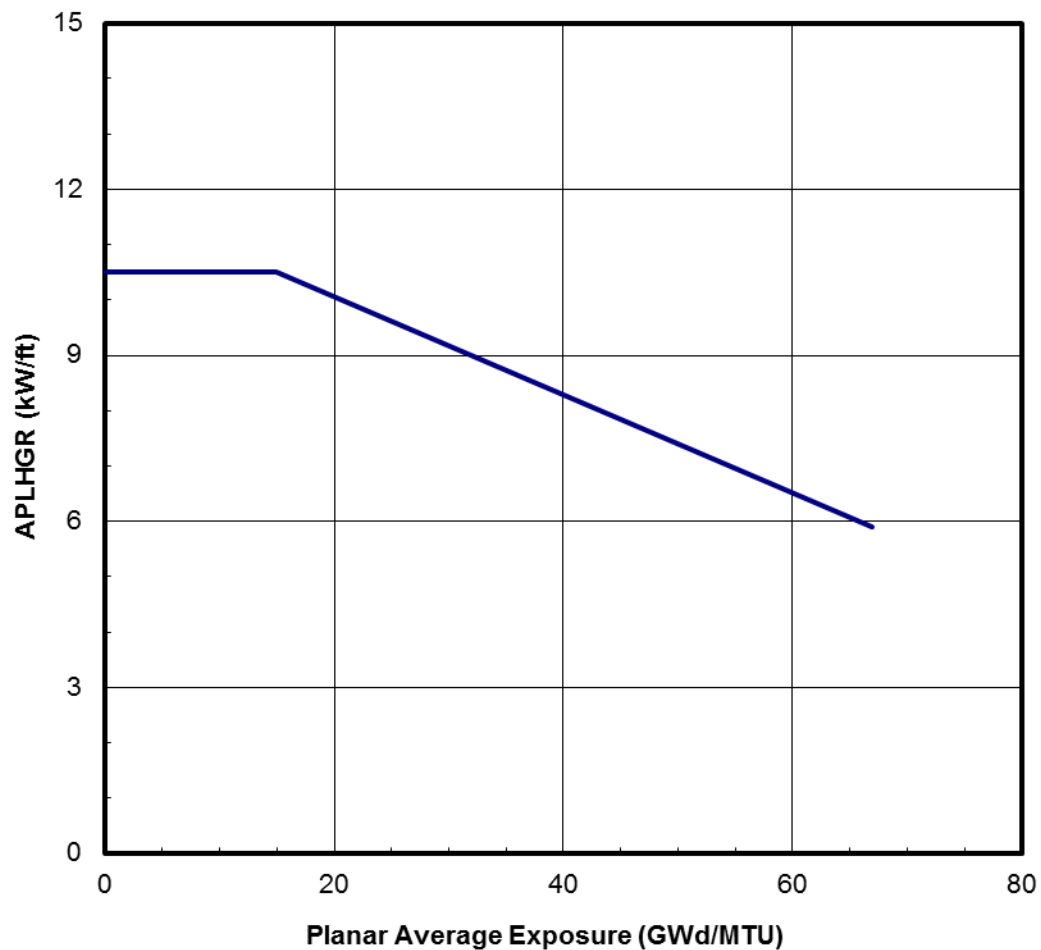

Planar Avg. Exposure (GWd/MTU)	APLHGR Limit (kW/ft)
0.0	10.5
15.0	10.5
67.0	5.9

Figure 2.3 APLHGR_{RATED} for ATRIUM-11 Fuel



2.5 Equipment Out-Of-Service Corrections

The limits shown in Figure 2.1, Figure 2.2, and Figure 2.3 are applicable for operation with all equipment In-Service as well as the following Equipment Out-Of-Service (EOOS) options; including combinations of the options.

In-Service	All equipment In-Service [*]
RPTOOS	EOC-Recirculation Pump Trip Out-Of-Service
TBVOOS	Turbine Bypass Valve(s) Out-Of-Service
PLUOOS	Power Load Unbalance Out-Of-Service
FHOOS (or FFWTR)	Feedwater Heaters Out-Of-Service or Final Feedwater Temperature Reduction
RCPOOS	One Recirculation Pump Out-Of-Service

^{*} All equipment service conditions assume 1 SRVOOS.



3 LHGR Limits

(Technical Specification 3.2.3, 3.3.4.1, & 3.7.5)

The LHGR limit is determined by adjusting the rated power LHGR limit for off-rated power and off-rated flow conditions. The most limiting of these is then used as follows:

$$\text{LHGR limit} = \text{MIN} (\text{LHGR}_P, \text{LHGR}_F)$$

where:

LHGR_P	off-rated power LHGR limit	$[\text{LHGR}_{\text{RATED}} * \text{LHGRFAC}_P]$
LHGR_F	off-rated flow LHGR limit	$[\text{LHGR}_{\text{RATED}} * \text{LHGRFAC}_F]$

3.1 Rated Power and Flow Limit: $\text{LHGR}_{\text{RATED}}$

The rated conditions LHGR for ATRIUM-10 fuel is identified in Reference 1 and shown in Figure 3.1. The rated conditions LHGR for ATRIUM-10XM fuel is shown in Figure 3.2. The rated conditions LHGR for ATRIUM-11 fuel is shown in Figure 3.3. The LHGR limit is consistent with References 2 and 3.

3.2 Off-Rated Power Dependent Limit: LHGR_P

LHGR limits are adjusted for off-rated power conditions using the LHGRFAC_P multiplier provided in References 1 & 31. The multiplier is split into two sub cases: turbine bypass valves in and out-of-service. The base case multipliers are shown in Figure 3.4 through Figure 3.6.

3.2.1 Startup without Feedwater Heaters

There is a range of operation during startup when the feedwater heaters are not placed into service until after the unit has reached a significant operating power level. Additional limits are shown in Figure 3.10 through Figure 3.17, based on temperature conditions identified in Table 3.1. Supplemental thermal limits for BOC to 3000 MWd/MTU cycle exposure, shown in Figure 3.16 and Figure 3.17, are based on References 31 & 32.

Table 3.1 Startup Feedwater Temperature Basis

Power (%Rated)	Temperature	
	Range 1	Range 2
	(°F)	(°F)
25	160.0	155.0
30	165.0	160.0
40	175.0	170.0
50	185.0	180.0



3.3 Off-Rated Flow Dependent Limit: $LHGR_F$

LHGR limits are adjusted for off-rated flow conditions using the $LHGRFAC_F$ multiplier provided in Reference 1. Multipliers are shown in Figure 3.7 through Figure 3.9.

3.4 Equipment Out-Of-Service Corrections

The limits shown in Figure 3.1 through Figure 3.3 are applicable for operation with all equipment In-Service as well as the following Equipment Out-Of-Service (EOOS) options; including combinations of the options.*


In-Service	All equipment In-Service
RPTOOS	EOC-Recirculation Pump Trip Out-Of-Service
TBVOOS	Turbine Bypass Valve(s) Out-Of-Service
PLUOOS	Power Load Unbalance Out-Of-Service
FHOOS (or FFWTR)	Feedwater Heaters Out-Of-Service or Final Feedwater Temperature Reduction
RCPOOS	One Recirculation Pump Out-Of-Service

Off-rated power corrections shown in Figure 3.4 through Figure 3.6 are dependent on operation of the Turbine Bypass Valve system. For this reason, separate limits are to be applied for TBVIS or TBVOOS operation. The limits have no dependency on RPTOOS, PLUOOS, FHOOS/FFWTR, or SLO.

Off-rated flow corrections shown in Figure 3.7 through Figure 3.9 are bounding for all EOOS conditions.


Off-rated power corrections shown in Figure 3.10 through Figure 3.17 are also dependent on operation of the Turbine Bypass Valve system. In this case, limits support FHOOS operation during startup. These limits have no dependency on RPTOOS, PLUOOS, or SLO.

* All equipment service conditions assume 1 SRVOOS.

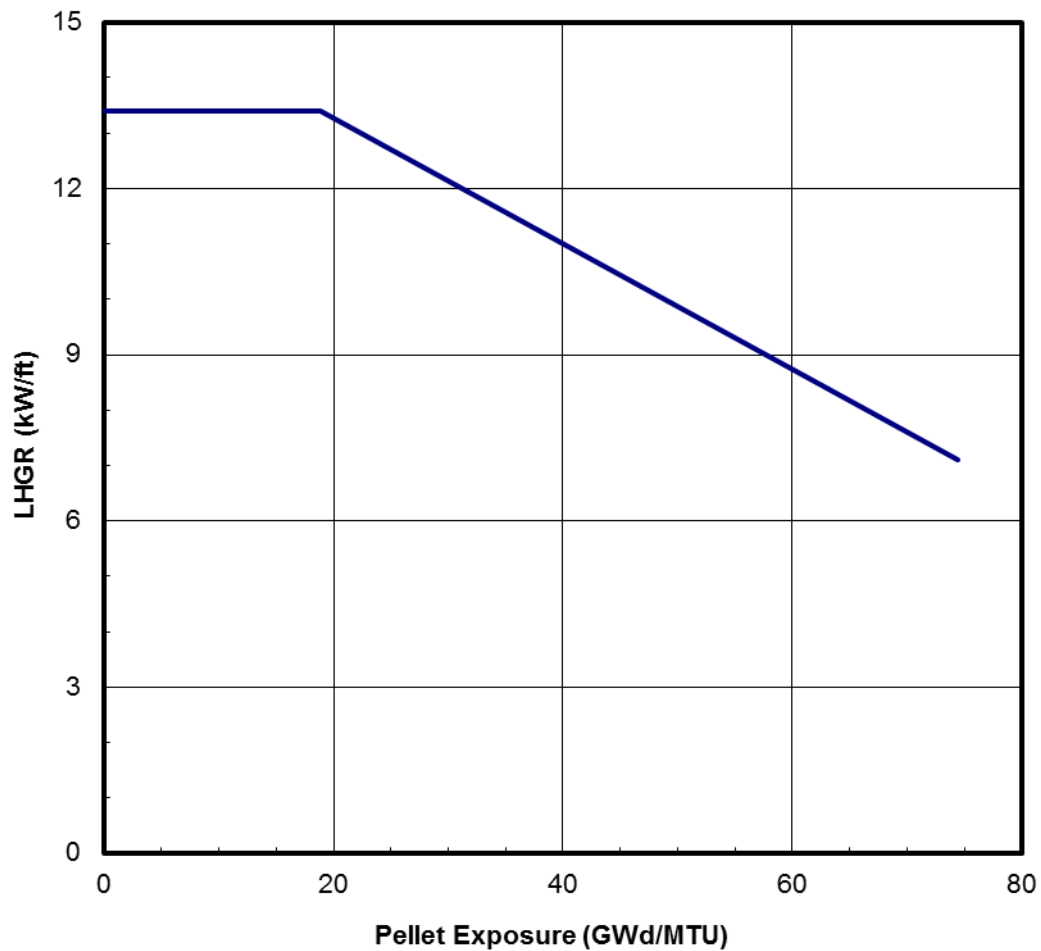


Pellet Exposure (GWd/MTU)	LHGR Limit (kW/ft)
0.0	13.4
18.9	13.4
74.4	7.1

Figure 3.1 LHGR_{RATED} for ATRIUM-10 Fuel

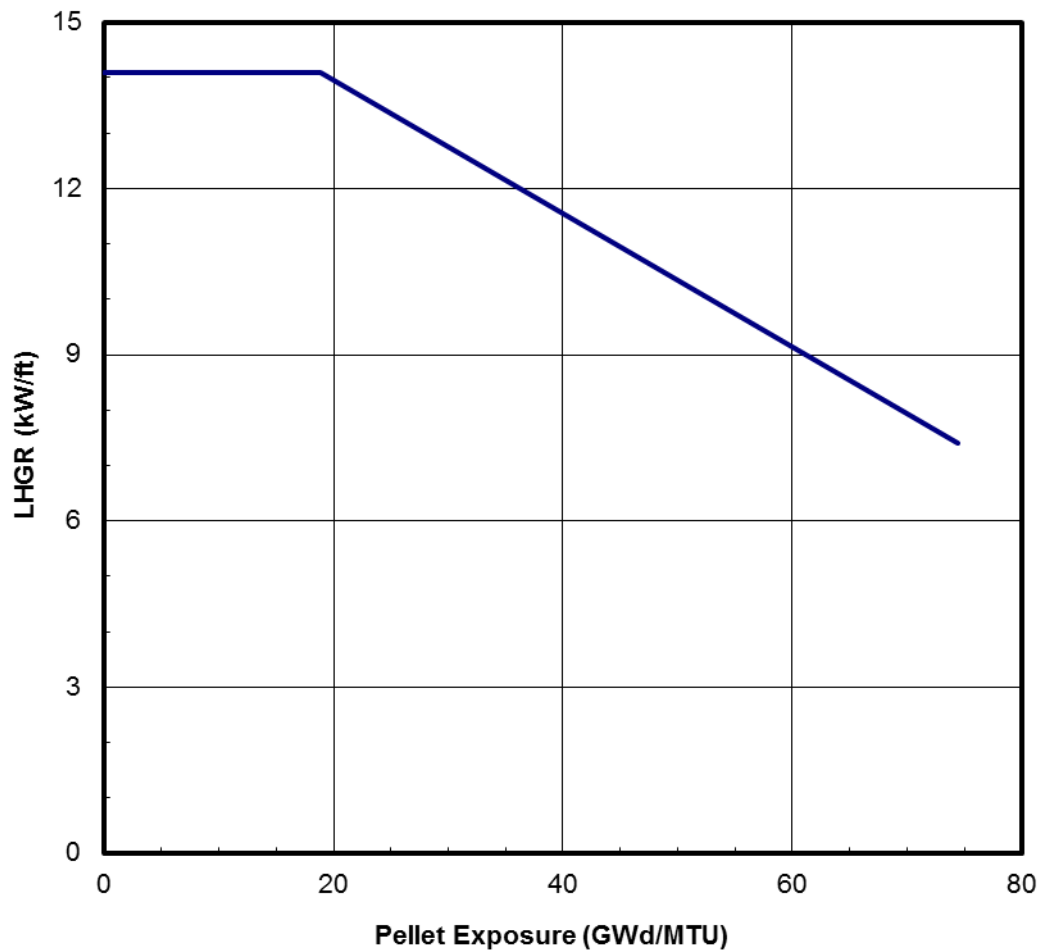


Pellet Exposure (GWd/MTU)	LHGR Limit (kW/ft)
0.0	14.1
18.9	14.1
74.4	7.4

Figure 3.2 LHGR_{RATED} for ATRIUM-10XM Fuel

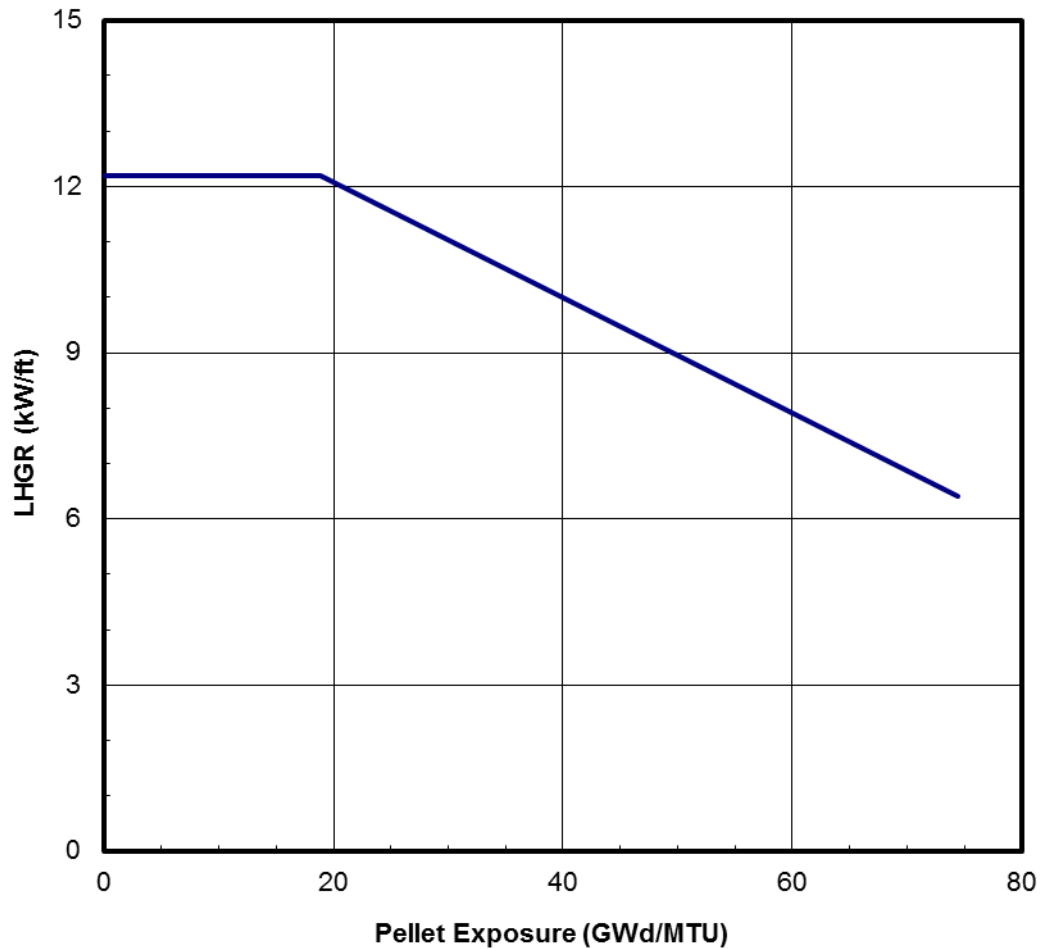


Pellet Exposure (GWd/MTU)	LHGR Limit (kW/ft)
0.0	12.2
18.9	12.2
74.4	6.4

Figure 3.3 LHGR_{RATED} for ATRIUM-11 Fuel

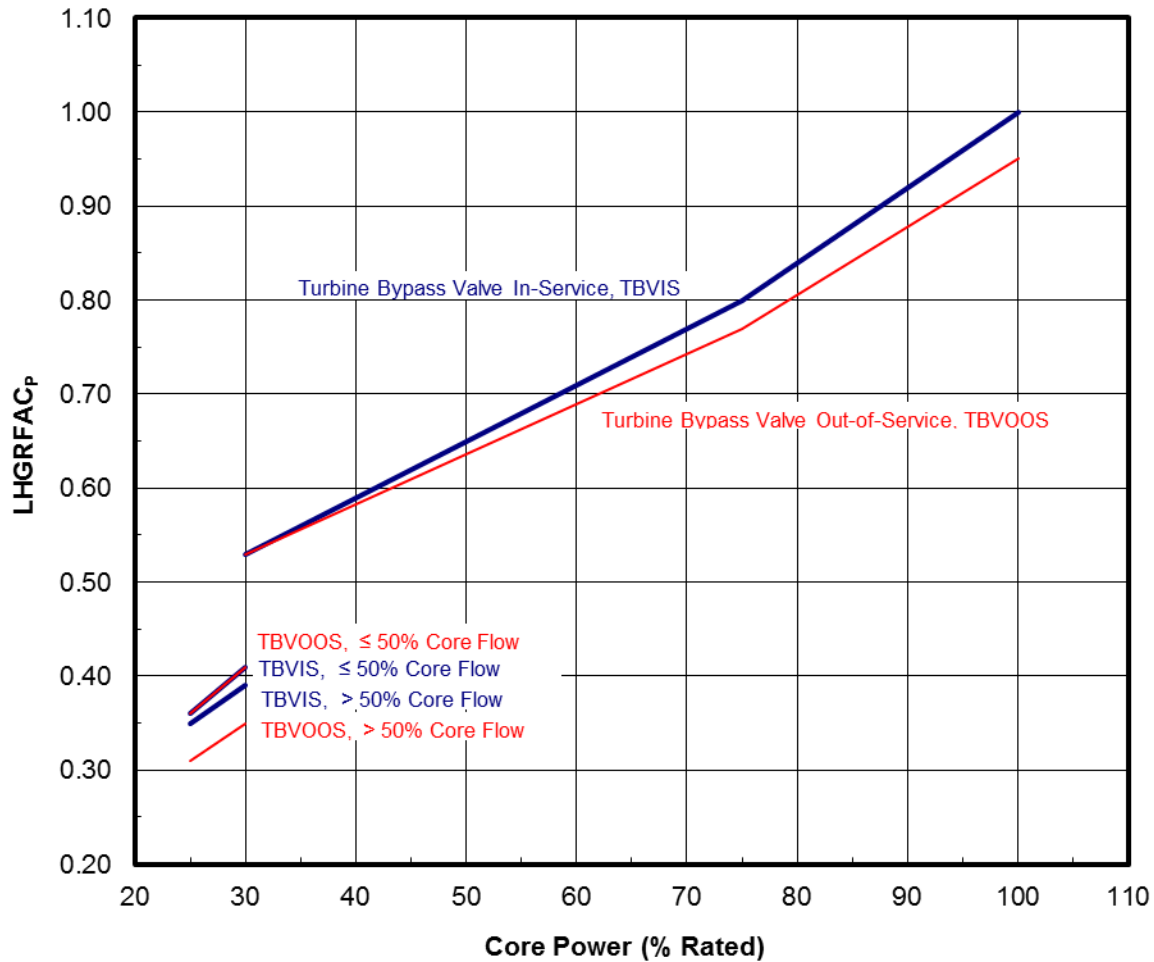


<i>Turbine Bypass In-Service</i>		<i>Turbine Bypass Out-of-Service</i>	
Core Power	LHGRFAC_p	Core Power	LHGRFAC_p
(% Rated)		(% Rated)	
100.0	1.00	100.0	0.95
75.0	0.80	75.0	0.77
30.0	0.53	30.0	0.53
Core Flow > 50% Rated		Core Flow > 50% Rated	
30.0	0.39	30.0	0.35
25.0	0.35	25.0	0.31
Core Flow ≤ 50% Rated		Core Flow ≤ 50% Rated	
30.0	0.41	30.0	0.41
25.0	0.36	25.0	0.36

Figure 3.4 Base Operation LHGRFAC_p for ATRIUM-10 Fuel
 (Independent of other EOOS conditions)

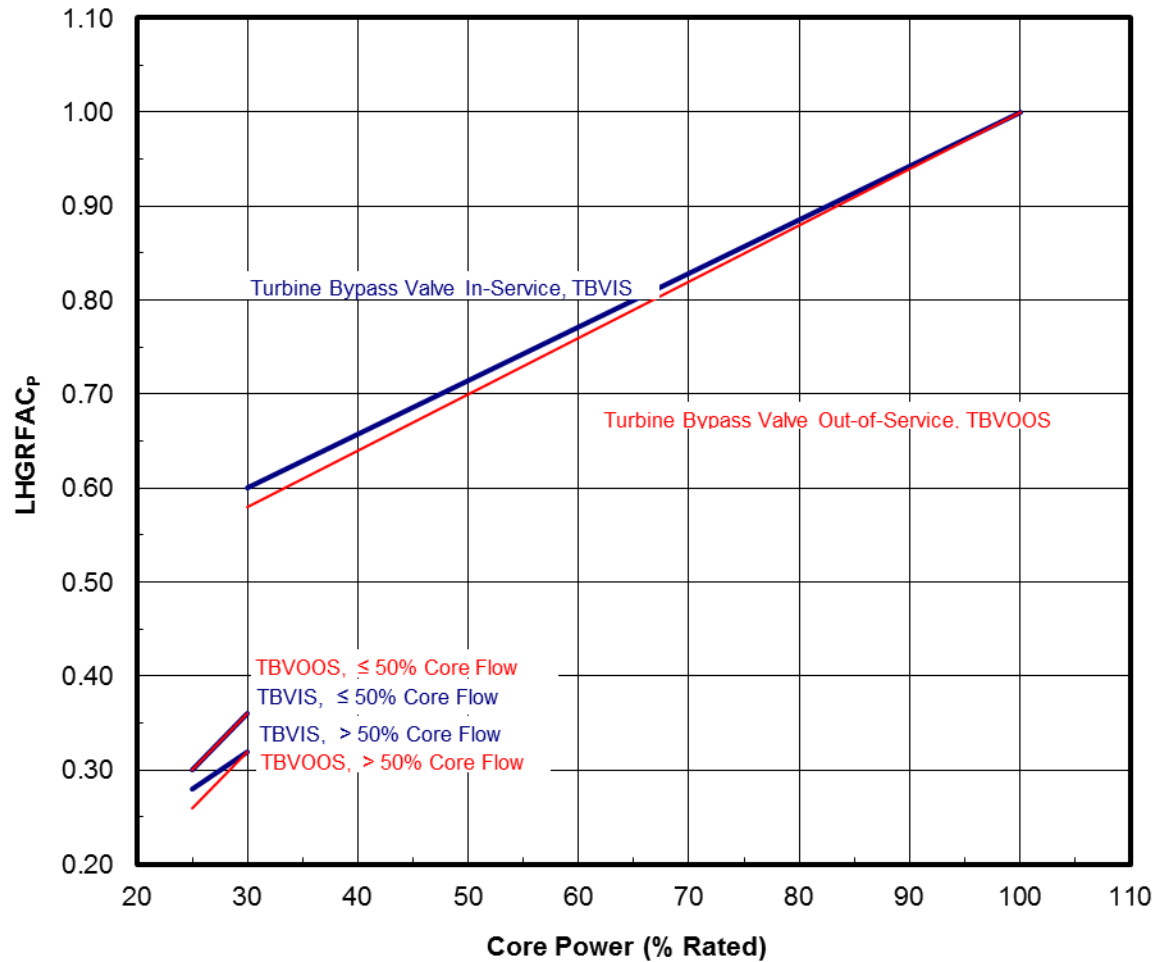


Turbine Bypass In-Service		Turbine Bypass Out-of-Service	
Core Power	LHGRFAC _p	Core Power	LHGRFAC _p
(% Rated)		(% Rated)	
100.0	1.00	100.0	1.00
30.0	0.60	30.0	0.58
Core Flow > 50% Rated		Core Flow > 50% Rated	
30.0	0.32	30.0	0.32
25.0	0.28	25.0	0.26
Core Flow ≤ 50% Rated		Core Flow ≤ 50% Rated	
30.0	0.36	30.0	0.36
25.0	0.30	25.0	0.30

Figure 3.5 Base Operation LHGRFAC_p for ATRIUM-10XM Fuel
 (Independent of other EOOS conditions)

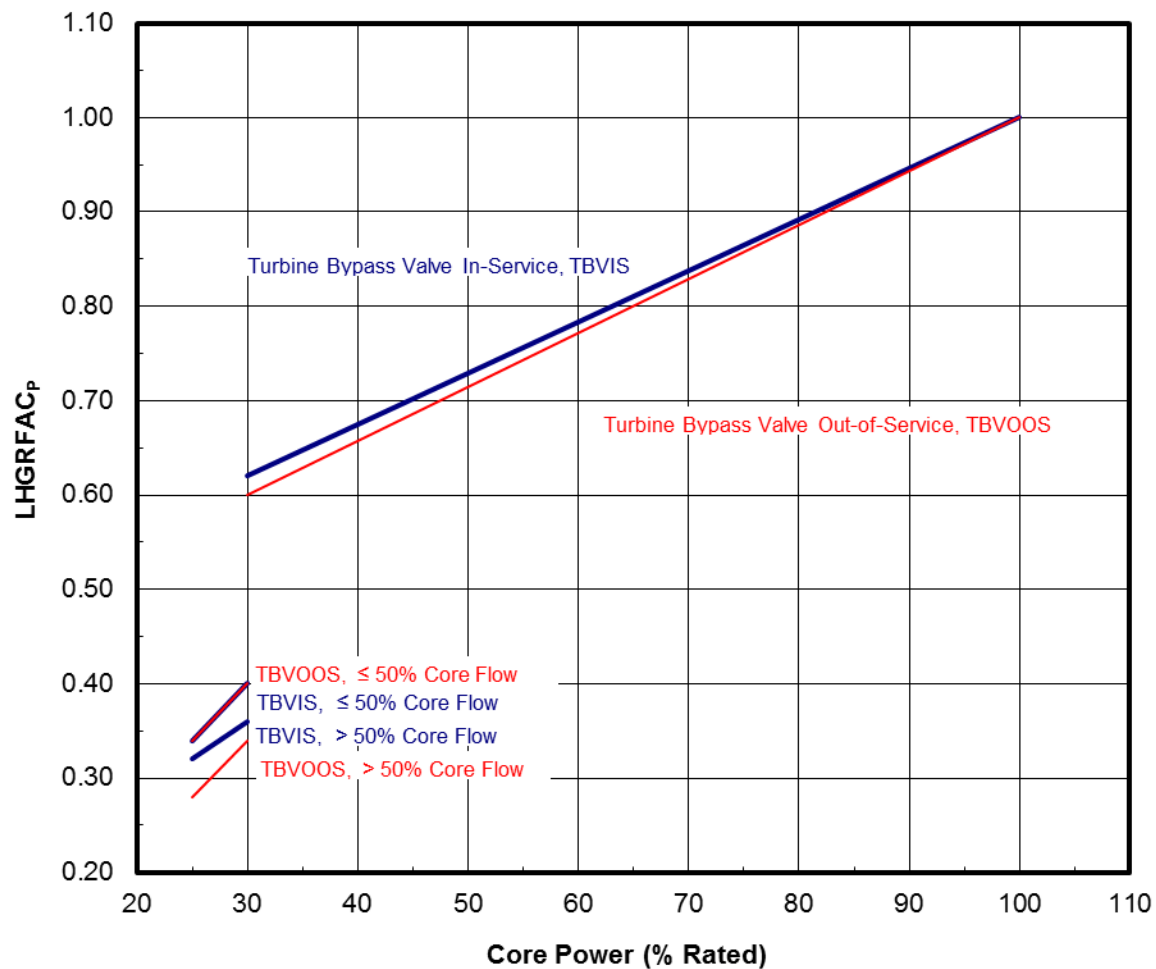

Turbine Bypass In-Service		Turbine Bypass Out-of-Service	
Core Power	LHGRFAC _p	Core Power	LHGRFAC _p
(% Rated)		(% Rated)	
100.0	1.00	100.0	1.00
30.0	0.62	30.0	0.60
Core Flow > 50% Rated		Core Flow > 50% Rated	
30.0	0.36	30.0	0.34
25.0	0.32	25.0	0.28
Core Flow ≤ 50% Rated		Core Flow ≤ 50% Rated	
30.0	0.40	30.0	0.40
25.0	0.34	25.0	0.34


Figure 3.6 Base Operation LHGRFAC_p for ATRIUM-11 Fuel
 (Independent of other EOOS conditions)

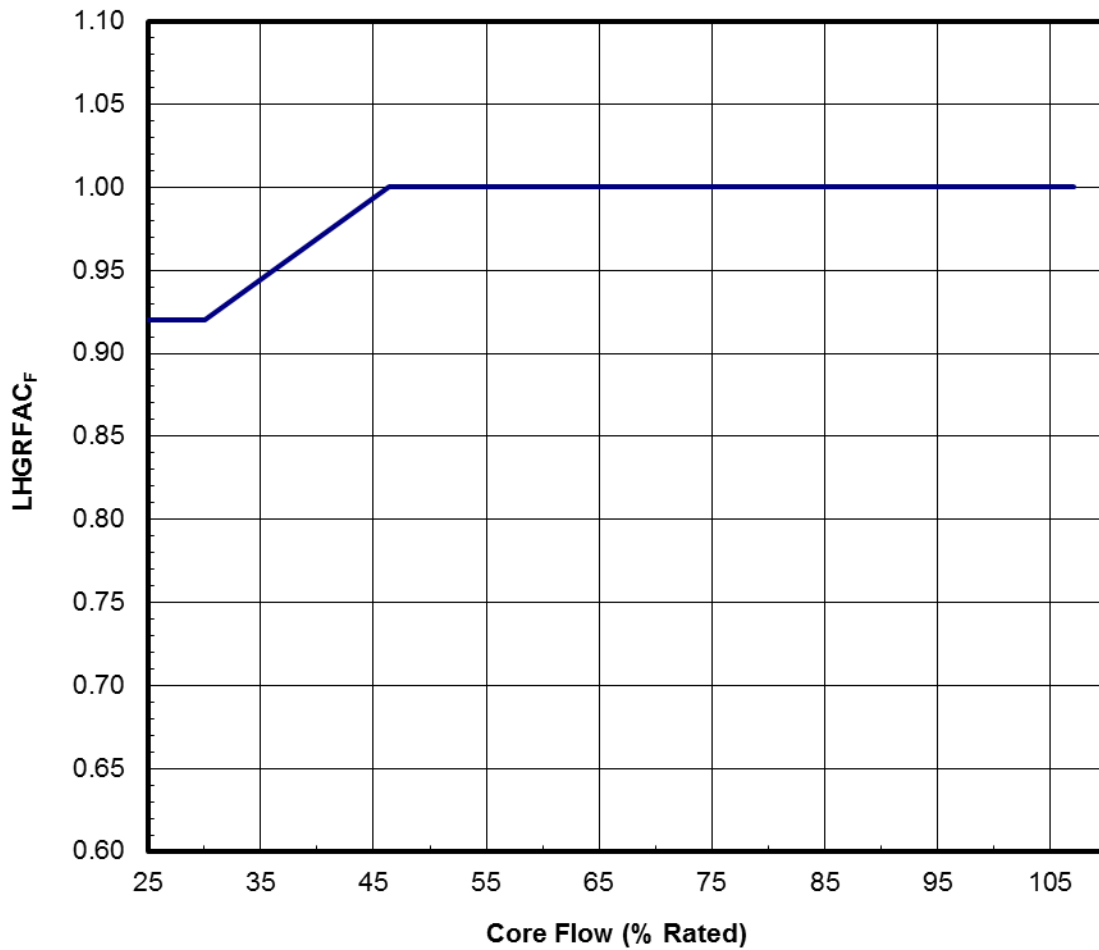

Core Flow (% Rated)	LHGRFAC _F
0.0	0.92
30.0	0.92
46.4	1.00
107.0	1.00

Figure 3.7 LHGRFAC_F for ATRIUM-10 Fuel
 (Values bound all EOOS conditions)


(107.0% maximum core flow line is used to support 105% rated flow operation, ICF)

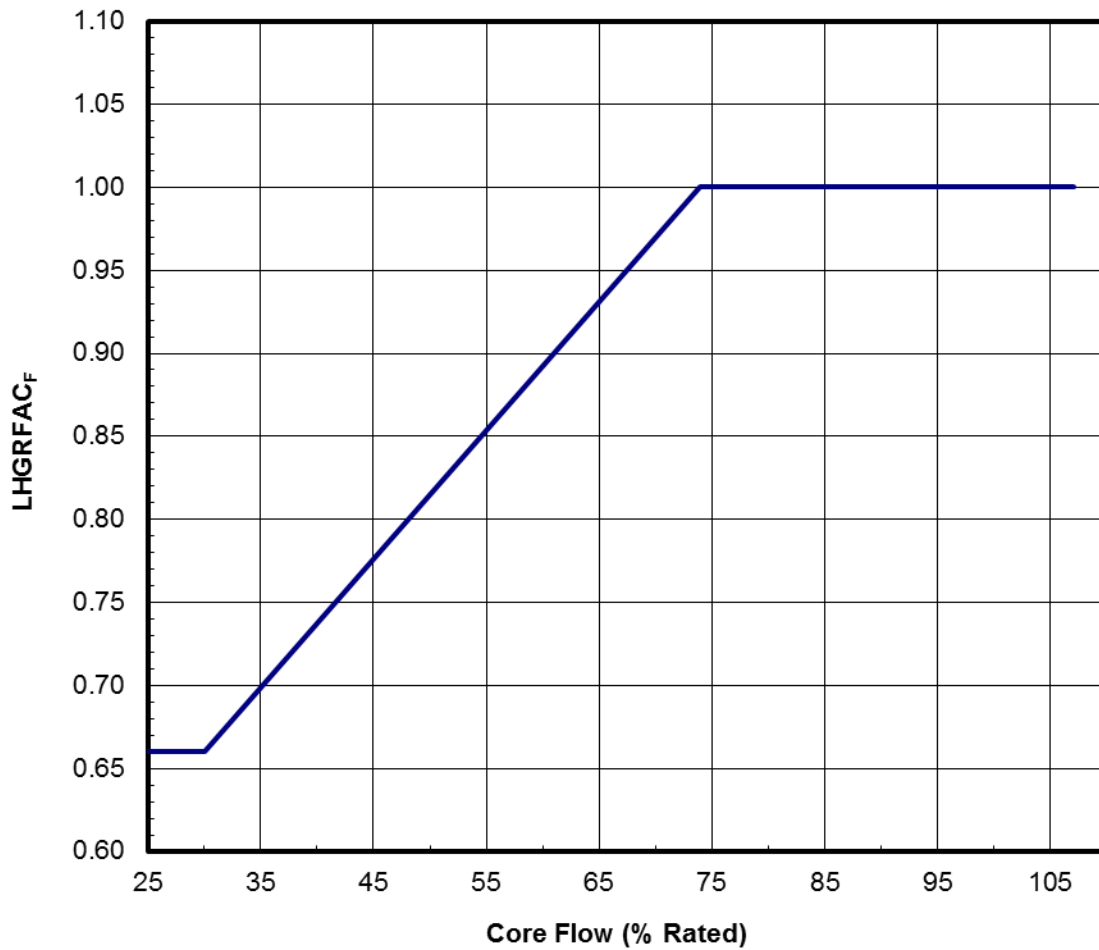

Core Flow (% Rated)	LHGRFAC _F
0.0	0.66
30.0	0.66
73.9	1
107.0	1

Figure 3.8 LHGRFAC_F for ATRIUM-10XM Fuel
 (Values bound all EOOS conditions)


(107.0% maximum core flow line is used to support 105% rated flow operation, ICF)

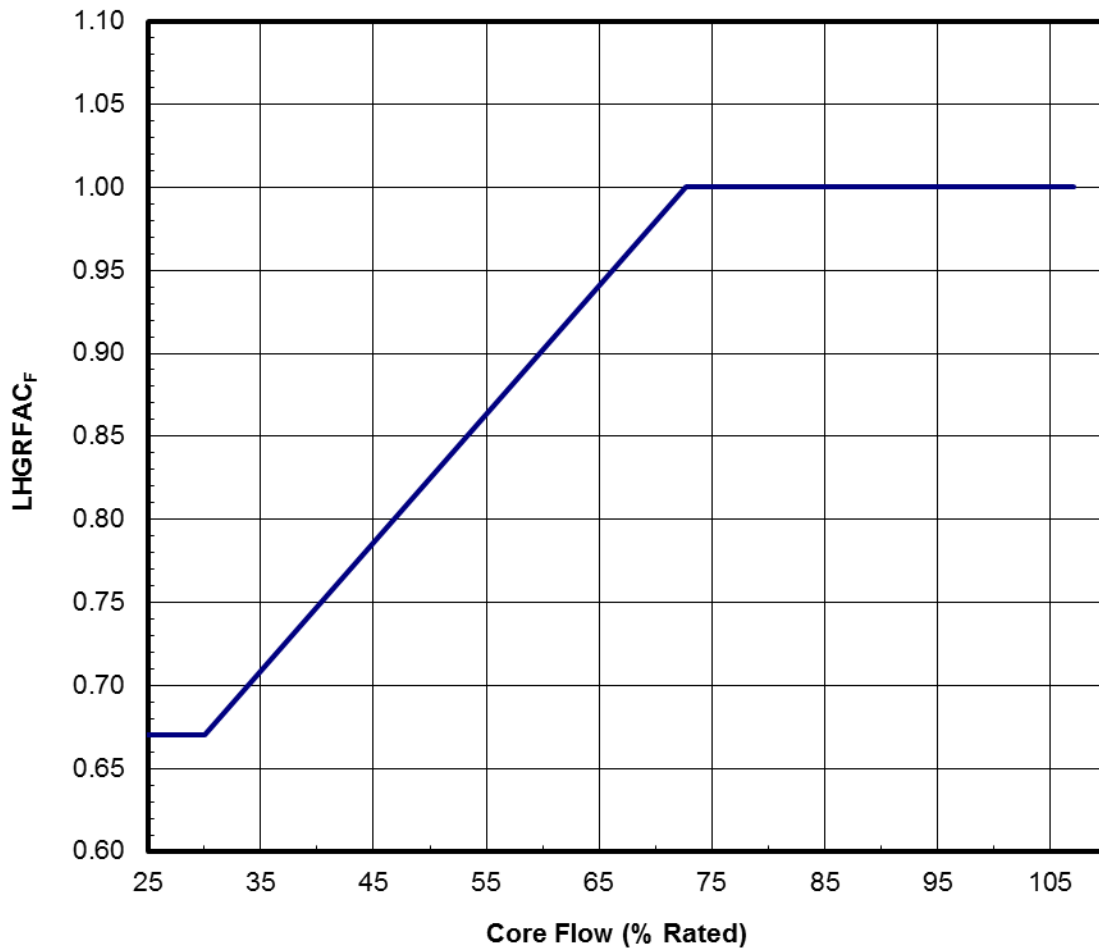

Core Flow (% Rated)	LHGRFAC _F
0.0	0.67
30.0	0.67
72.7	1
107.0	1

Figure 3.9 LHGRFAC_F for ATRIUM-11 Fuel
 (Values bound all EOOS conditions)


(107.0% maximum core flow line is used to support 105% rated flow operation, ICF)

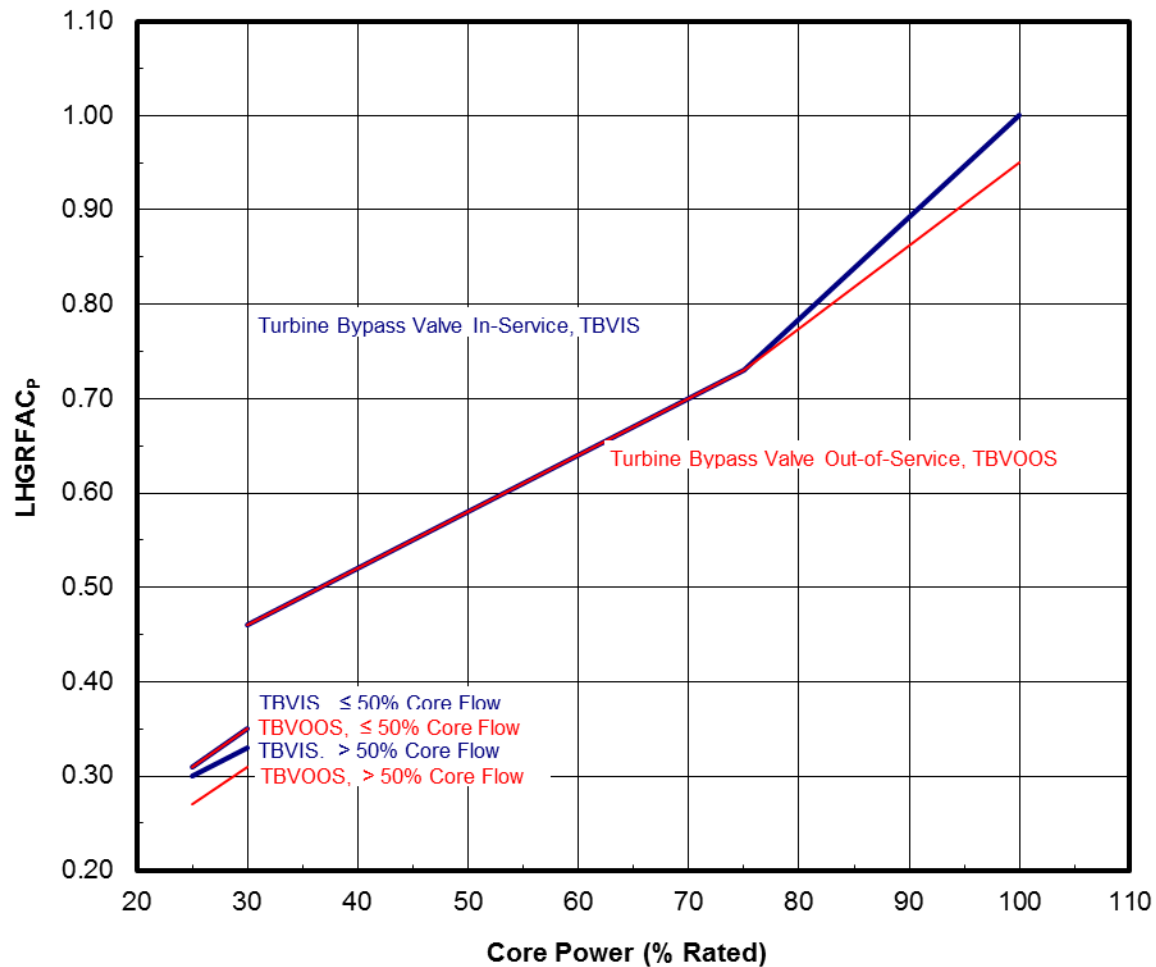

Turbine Bypass In-Service		Turbine Bypass Out-of-Service	
Core Power	LHGRFAC _p	Core Power	LHGRFAC _p
(% Rated)		(% Rated)	
100.0	1.00	100.0	0.95
75.0	0.73	75.0	0.73
30.0	0.46	30.0	0.46
Core Flow > 50% Rated		Core Flow > 50% Rated	
30.0	0.33	30.0	0.31
25.0	0.30	25.0	0.27
Core Flow ≤ 50% Rated		Core Flow ≤ 50% Rated	
30.0	0.35	30.0	0.35
25.0	0.31	25.0	0.31


Figure 3.10 Startup Operation LHGRFAC_p for ATRIUM-10 Fuel:

Table 3.1 Temperature Range 1
 (no Feedwater heating during startup)
 (Limits valid at and below 50% power)

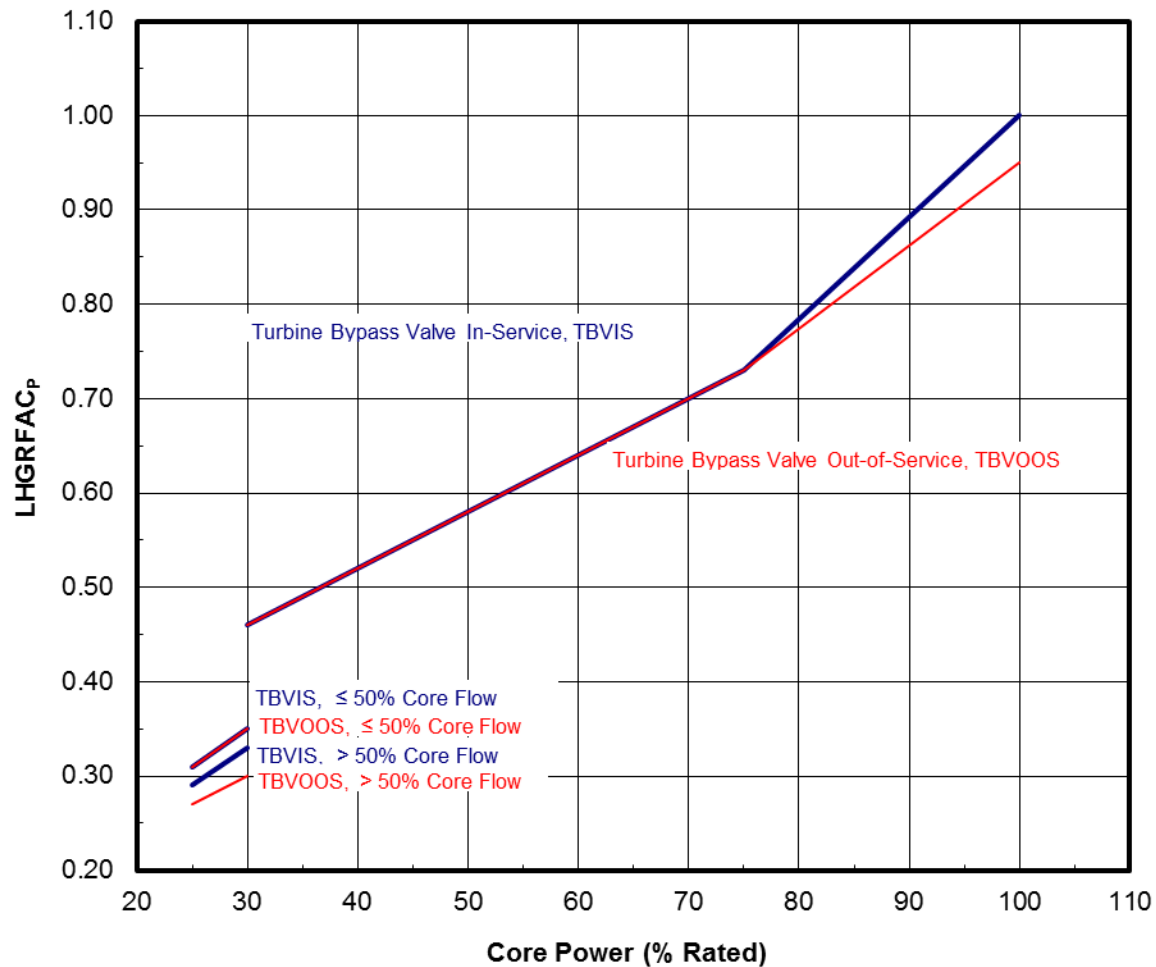


Turbine Bypass In-Service		Turbine Bypass Out-of-Service	
Core Power	LHGRFAC _p	Core Power	LHGRFAC _p
(% Rated)		(% Rated)	
100.0	1.00	100.0	0.95
75.0	0.73	75.0	0.73
30.0	0.46	30.0	0.46
Core Flow > 50% Rated		Core Flow > 50% Rated	
30.0	0.33	30.0	0.30
25.0	0.29	25.0	0.27
Core Flow ≤ 50% Rated		Core Flow ≤ 50% Rated	
30.0	0.35	30.0	0.35
25.0	0.31	25.0	0.31

Figure 3.11 Startup Operation LHGRFAC_p for ATRIUM-10 Fuel:
 Table 3.1 Temperature Range 2
 (no Feedwater heating during startup)
 (Limits valid at and below 50% power)

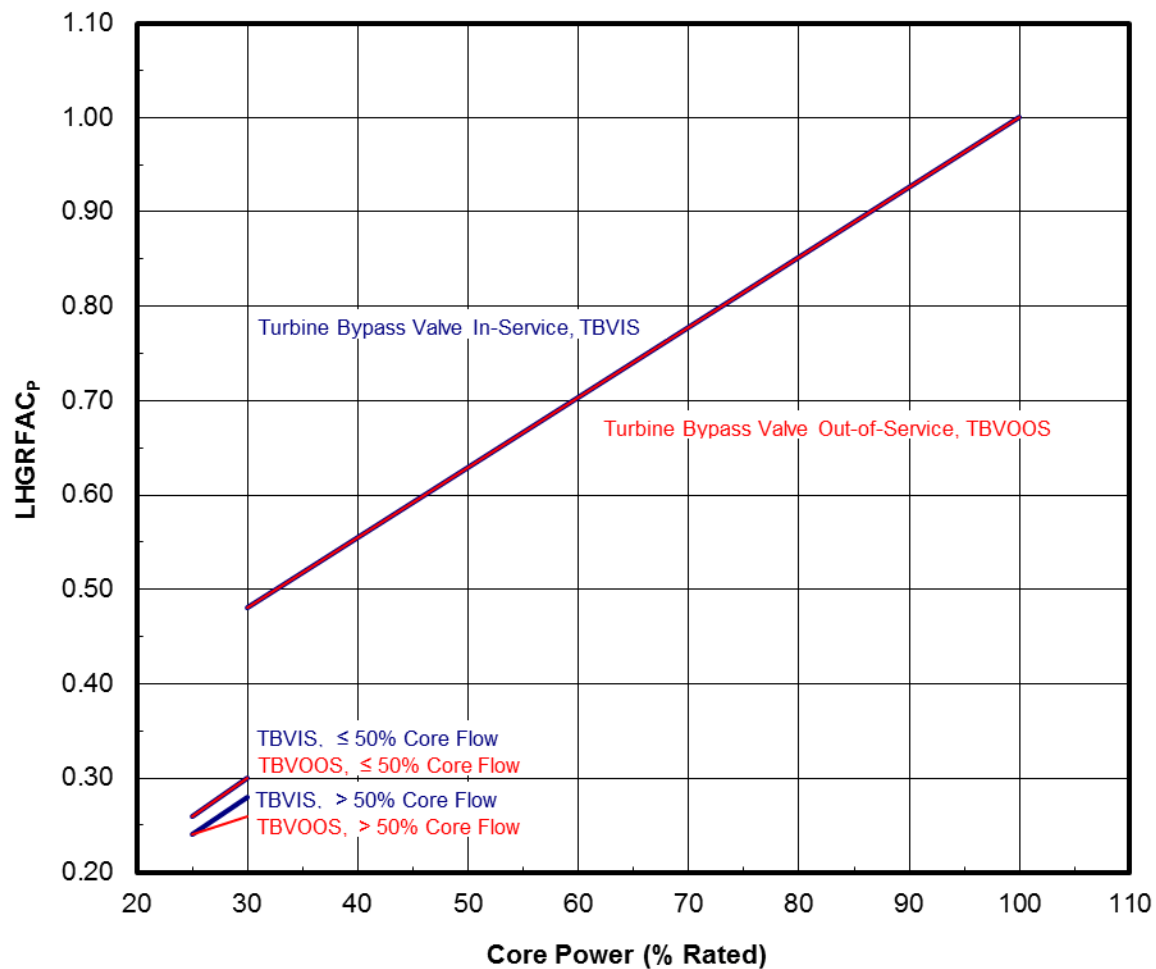


Turbine Bypass In-Service		Turbine Bypass Out-of-Service	
Core Power	LHGRFAC _p	Core Power	LHGRFAC _p
(% Rated)		(% Rated)	
100.0	1.00	100.0	1.00
30.0	0.48	30.0	0.48
Core Flow > 50% Rated		Core Flow > 50% Rated	
30.0	0.28	30.0	0.26
25.0	0.24	25.0	0.24
Core Flow ≤ 50% Rated		Core Flow ≤ 50% Rated	
30.0	0.30	30.0	0.30
25.0	0.26	25.0	0.26

Figure 3.12 Startup Operation LHGRFAC_p for ATRIUM-10XM
 Fuel: Table 3.1 Temperature Range 1
 (no Feedwater heating during startup)
 (Limits valid at and below 50% power)

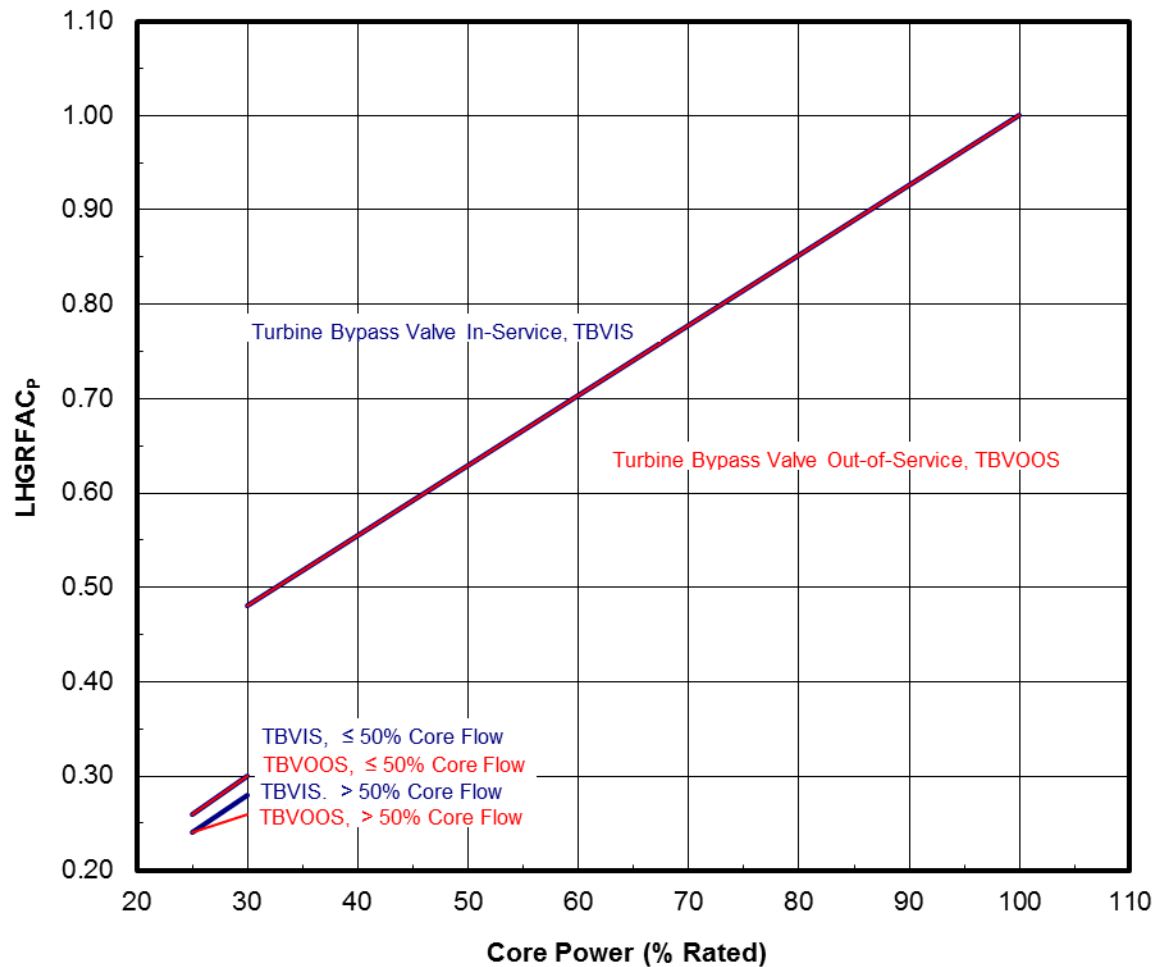

Turbine Bypass In-Service		Turbine Bypass Out-of-Service	
Core Power	LHGRFAC _p	Core Power	LHGRFAC _p
(% Rated)		(% Rated)	
100.0	1.00	100.0	1.00
30.0	0.48	30.0	0.48
Core Flow > 50% Rated		Core Flow > 50% Rated	
30.0	0.28	30.0	0.26
25.0	0.24	25.0	0.24
Core Flow ≤ 50% Rated		Core Flow ≤ 50% Rated	
30.0	0.30	30.0	0.30
25.0	0.26	25.0	0.26


Figure 3.13 Startup Operation LHGRFAC_p for ATRIUM-10XM
 Fuel: Table 3.1 Temperature Range 2
 (no Feedwater heating during startup)
 (Limits valid at and below 50% power)

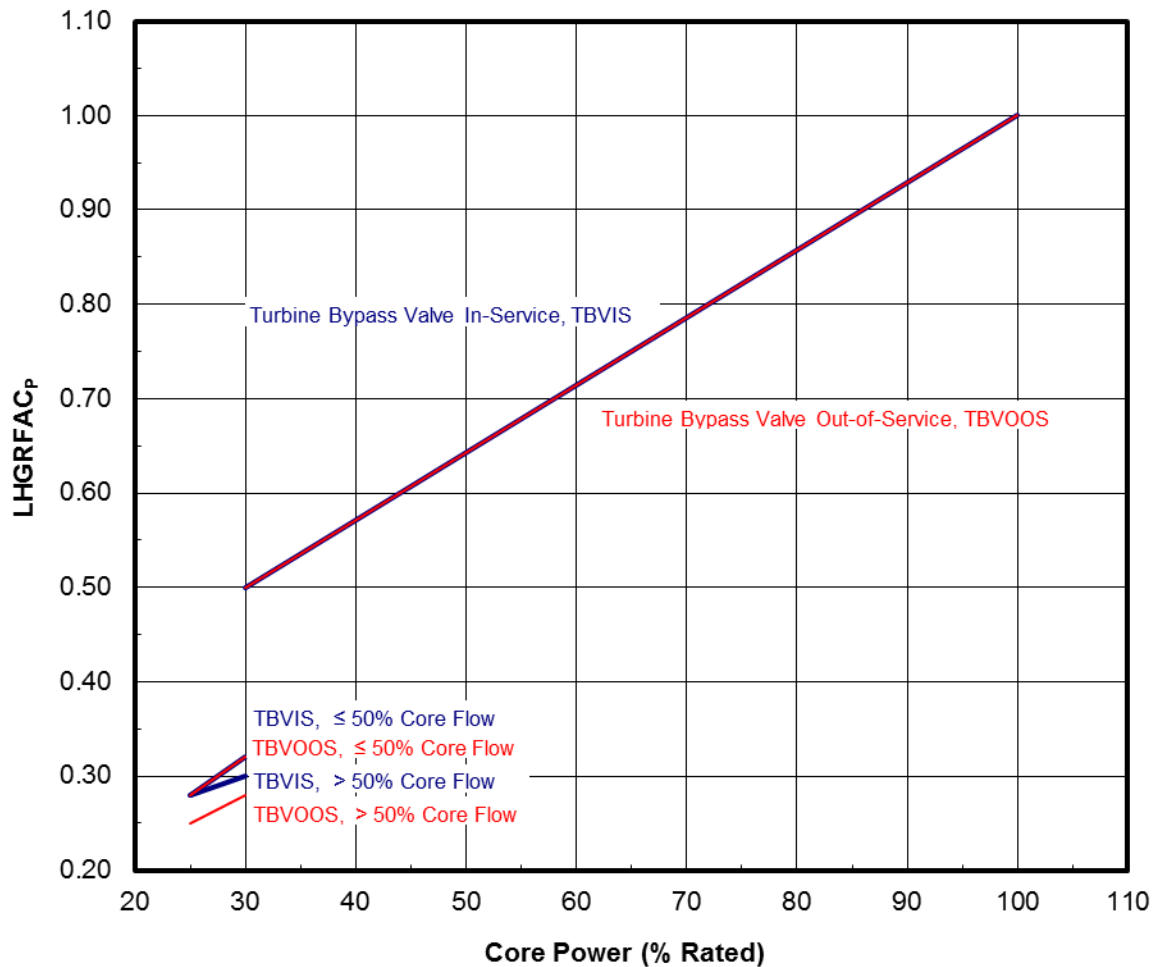

Turbine Bypass In-Service		Turbine Bypass Out-of-Service	
Core Power	LHGRFAC _p	Core Power	LHGRFAC _p
(% Rated)		(% Rated)	
100.0	1.00	100.0	1.00
30.0	0.50	30.0	0.50
Core Flow > 50% Rated		Core Flow > 50% Rated	
30.0	0.30	30.0	0.28
25.0	0.28	25.0	0.25
Core Flow $\leq 50\%$ Rated		Core Flow $\leq 50\%$ Rated	
30.0	0.32	30.0	0.32
25.0	0.28	25.0	0.28

Figure 3.14 Startup Operation LHGRFAC_p for ATRIUM-11 Fuel:


Table 3.1 Temperature Range 1
(no Feedwater heating during startup)
(Limits valid at and below 50% power)

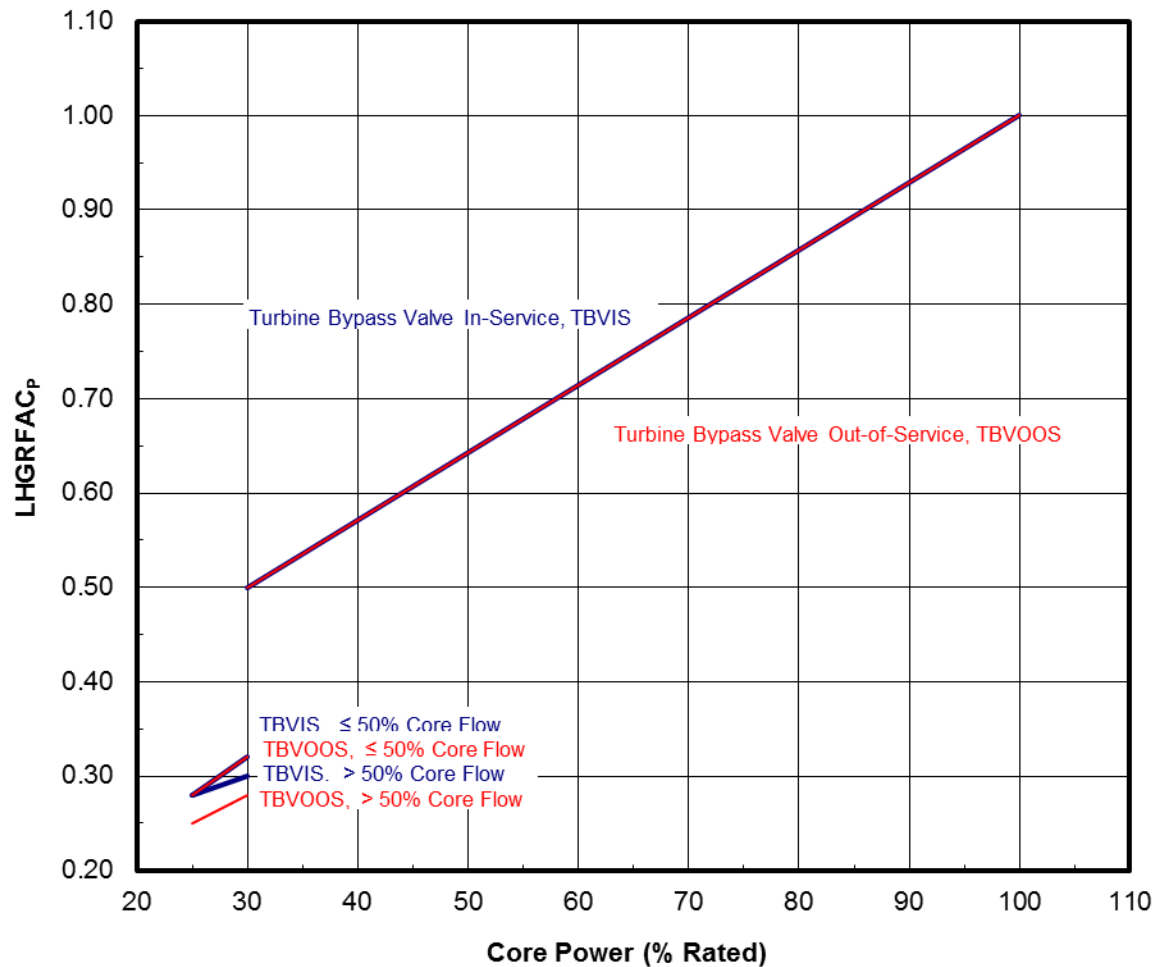

Turbine Bypass In-Service		Turbine Bypass Out-of-Service	
Core Power	LHGRFAC _p	Core Power	LHGRFAC _p
(% Rated)		(% Rated)	
100.0	1.00	100.0	1.00
30.0	0.50	30.0	0.50
Core Flow > 50% Rated		Core Flow > 50% Rated	
30.0	0.30	30.0	0.28
25.0	0.28	25.0	0.25
Core Flow ≤ 50% Rated		Core Flow ≤ 50% Rated	
30.0	0.32	30.0	0.32
25.0	0.28	25.0	0.28


Figure 3.15 Startup Operation LHGRFAC_p for ATRIUM-11 Fuel:

Table 3.1 Temperature Range 2
 (no Feedwater heating during startup)
 (Limits valid at and below 50% power)

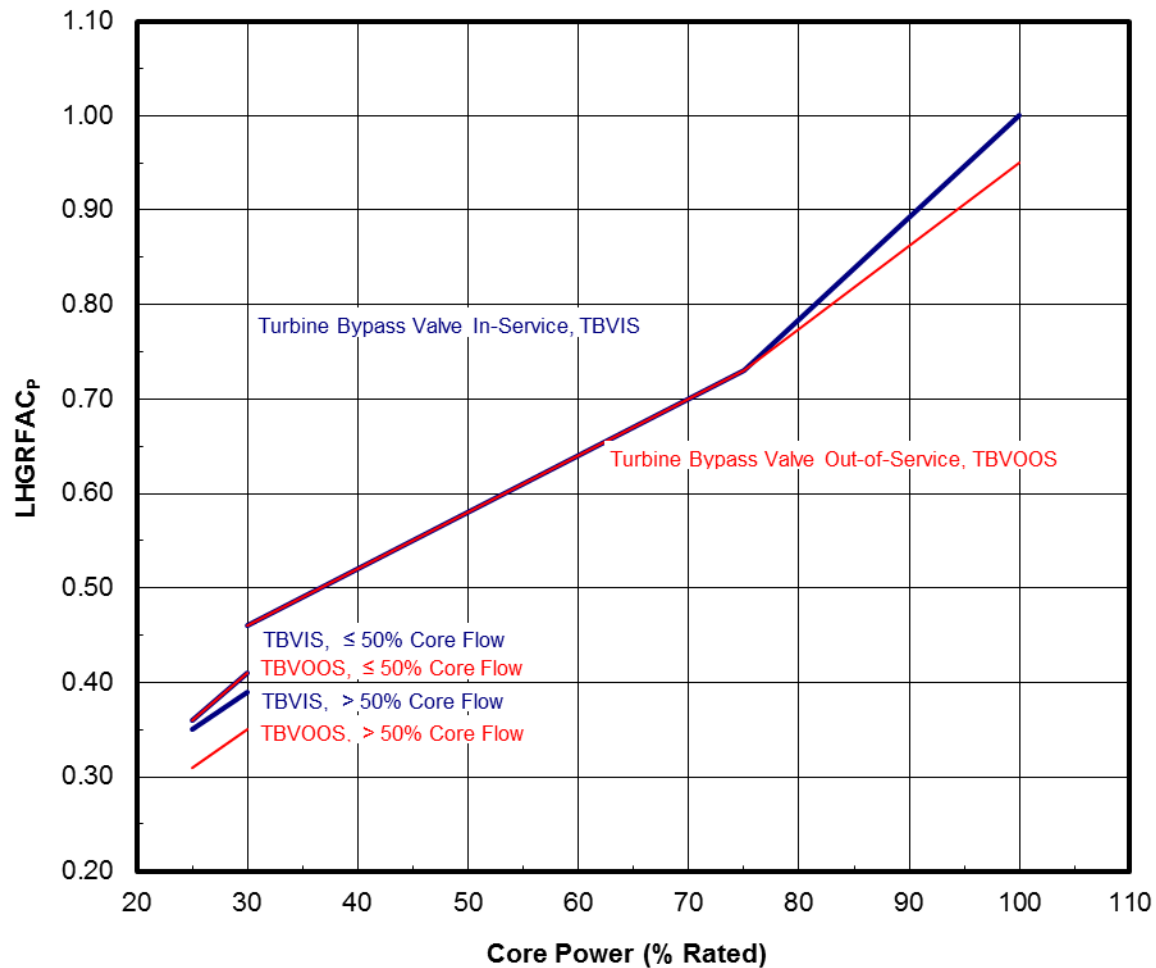

Turbine Bypass In-Service		Turbine Bypass Out-of-Service	
Core Power	LHGRFAC _P	Core Power	LHGRFAC _P
(% Rated)		(% Rated)	
100.0	1.00	100.0	0.95
75.0	0.73	75.0	0.73
30.0	0.46	30.0	0.46
Core Flow > 50% Rated		Core Flow > 50% Rated	
30.0	0.39	30.0	0.35
25.0	0.35	25.0	0.31
Core Flow ≤ 50% Rated		Core Flow ≤ 50% Rated	
30.0	0.41	30.0	0.41
25.0	0.36	25.0	0.36

Figure 3.16 BOC to 3000 MWd/MTU Startup Operation
 LHGRFAC_P for ATRIUM-10 Fuel: Table 3.1 Temperature Range 1
 (no Feedwater heating during startup)
 (Limits valid at and below 50% power)

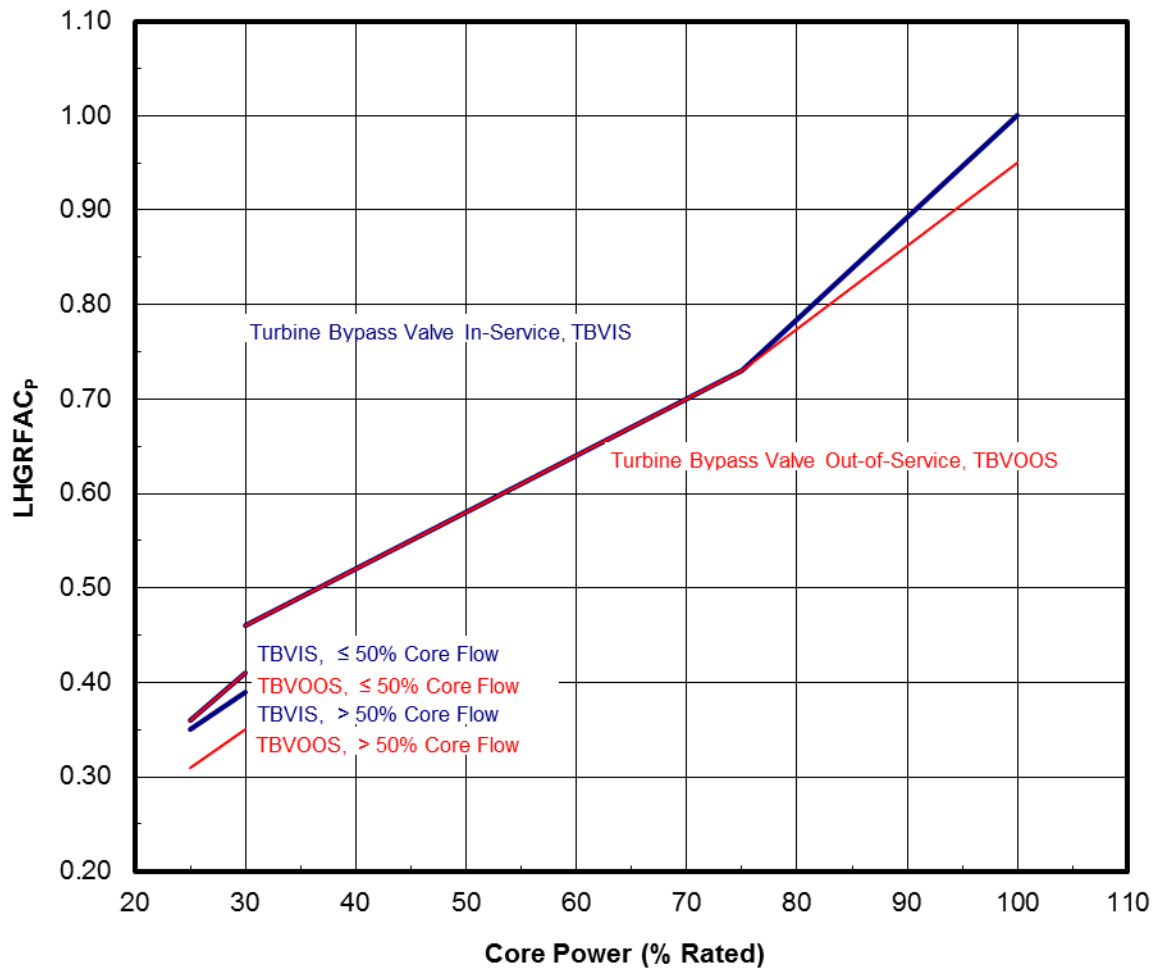

Turbine Bypass In-Service		Turbine Bypass Out-of-Service	
Core Power	LHGRFAC _p	Core Power	LHGRFAC _p
(% Rated)		(% Rated)	
100.0	1.00	100.0	0.95
75.0	0.73	75.0	0.73
30.0	0.46	30.0	0.46
Core Flow > 50% Rated		Core Flow > 50% Rated	
30.0	0.39	30.0	0.35
25.0	0.35	25.0	0.31
Core Flow ≤ 50% Rated		Core Flow ≤ 50% Rated	
30.0	0.41	30.0	0.41
25.0	0.36	25.0	0.36

Figure 3.17 BOC to 3000 MWd/MTU Startup Operation
LHGRFAC_p for ATRIUM-10 Fuel: Table 3.1 Temperature Range 2
(no Feedwater heating during startup)
(Limits valid at and below 50% power)



4 OLMCPR Limits

(Technical Specification 3.2.2, 3.3.4.1, & 3.7.5)

OLMCPR is calculated to be the most limiting of the flow or power dependent values

$$\text{OLMCPR limit} = \text{MAX} (\text{MCPR}_F , \text{MCPR}_P)$$

where:

MCPR_F	core flow-dependent MCPR limit
MCPR_P	power-dependent MCPR limit

4.1 Flow Dependent MCPR Limit: MCPR_F

MCPR_F limits are dependent upon core flow (% of Rated), and the max core flow limit, (Rated or Increased Core Flow, ICF). MCPR_F limits are shown in Figure 4.1, per Reference 1. Limits are valid for all EOOS combinations. No adjustment is required for SLO conditions.

4.2 Power Dependent MCPR Limit: MCPR_P

MCPR_P limits are dependent upon:

- Core Power Level (% of Rated)
- Technical Specification Scram Speed (TSSS), Nominal Scram Speed (NSS), or Optimum Scram Speed (OSS)
- Cycle Operating Exposure (NEOC, EOC, and CD - as defined in this section)
- Equipment Out-Of-Service Options
- Two or Single recirculation Loop Operation (TLO vs. SLO)

The MCPR_P limits are provided in Table 4.2 through Table 4.4, where each table contains the limits for all fuel types and EOOS options (for a specified scram speed and exposure range). The CMSS determines MCPR_P limits, from these tables, based on linear interpolation between the specified powers.

4.2.1 Startup without Feedwater Heaters

There is a range of operation during startup when the feedwater heaters are not placed into service until after the unit has reached a significant operating power level. Additional power dependent limits are shown in Table 4.5 through Table 4.12 based on temperature conditions identified in Table 3.1. Supplemental thermal limits for BOC to 3000 MWd/MTU cycle exposure are shown in Table 4.9 through Table 4.12, based on References 31 & 32.



4.2.2 Scram Speed Dependent Limits (TSSS vs. NSS vs. OSS)

MCPR_P limits are provided for three different sets of assumed scram speeds. The Technical Specification Scram Speed (TSSS) MCPR_P limits are applicable at all times, as long as the scram time surveillance demonstrates the times in Technical Specification Table 3.1.4-1 are met. Both Nominal Scram Speeds (NSS) and/or Optimum Scram Speeds (OSS) may be used, as long as the scram time surveillance demonstrates Table 4.1 times are applicable.*†

Table 4.1 Nominal Scram Time Basis

Notch Position	Nominal Scram Timing	Optimum Scram Timing
(index)	(seconds)	(seconds)
46	0.420	0.380
36	0.980	0.875
26	1.600	1.465
6	2.900	2.900

In demonstrating compliance with the NSS and/or OSS scram time basis, surveillance requirements from Technical Specification 3.1.4 apply; accepting the definition of SLOW rods should conform to scram speeds shown in Table 4.1. If conformance is not demonstrated, TSSS based MCPR_P limits are applied.

On initial cycle startup, TSSS limits are used until the successful completion of scram timing confirms NSS and/or OSS based limits are applicable.

4.2.3 Exposure Dependent Limits

Exposures are tracked on a Core Average Exposure basis (CAVEX, not Cycle Exposure). Higher exposure MCPR_P limits are always more limiting and may be used for any Core Average Exposure up to the ending exposure. Per Reference 1, MCPR_P limits are provided for the following exposure ranges:

BOC to NEOC	NEOC corresponds to	30,910.3 MWd / MTU
BOC to EOCLB	EOCLB corresponds to	33,210.3 MWd / MTU
BOC to End of Coast	End of Coast	34,624.4 MWd / MTU

NEOC refers to a Near EOC exposure point.

* Reference 1 analysis results are based on information identified in Reference 4.

† Drop out times consistent with method used to perform actual timing measurements (i.e., including pickup/dropout effects).



The EOCLB exposure point is not the true End-Of-Cycle exposure. Instead it corresponds to a licensing exposure window exceeding expected end-of-full-power-life.

The End of Coast exposure point represents a licensing exposure point exceeding the expected end-of-cycle exposure including cycle extension options.

4.2.4 Equipment Out-Of-Service (EOOS) Options

EOOS options* covered by MCPR_P limits are given by the following:

In-Service	All equipment In-Service
RPTOOS	EOC-Recirculation Pump Trip Out-Of-Service
TBVOOS	Turbine Bypass Valve(s) Out-Of-Service
RPTOOS+TBVOOS	Combined RPTOOS and TBVOOS
PLUOOS	Power Load Unbalance Out-Of-Service
PLUOOS+RPTOOS	Combined PLUOOS and RPTOOS
PLUOOS+TBVOOS	Combined PLUOOS and TBVOOS
PLUOOS+TBVOOS+RPTOOS	Combined PLUOOS, RPTOOS, and TBVOOS
FHOOS (or FFWTR)	Feedwater Heaters Out-Of-Service (or Final Feedwater Temperature Reduction)
RCPOOS	One Recirculation Pump Out-Of-Service

For exposure ranges up to NEOC and EOCLB, additional combinations of MCPR_P limits are also provided including FHOOS. The coast down exposure range assumes application of FFWTR. FHOOS based MCPR_P limits for the coast down exposure are redundant because the temperature setdown assumption is identical with FFWTR.

4.2.5 Single-Loop-Operation (SLO) Limits


When operating in RCPOOS conditions, MCPR_P limits are constructed differently from the normal operating RCP conditions. The limiting event for RCPOOS is a pump seizure scenario, which sets the upper bound for allowed core power and flow[†]. This event is not impacted by scram time assumptions. Specific MCPR_P limits are shown in Table 4.13.

4.2.6 Below Pbypass Limits

Below Pbypass (30% rated power), MCPR_P limits depend upon core flow. One set of MCPR_P limits applies for core flow above 50% of rated; a second set applies if the core flow is less than or equal to 50% rated.

* All equipment service conditions assume 1 SRVOOS.

† RCPOOS limits are only valid up to 50% rated core power, 50% rated core flow, and an active recirculation drive flow of 17.73 Mlb_m/hr.

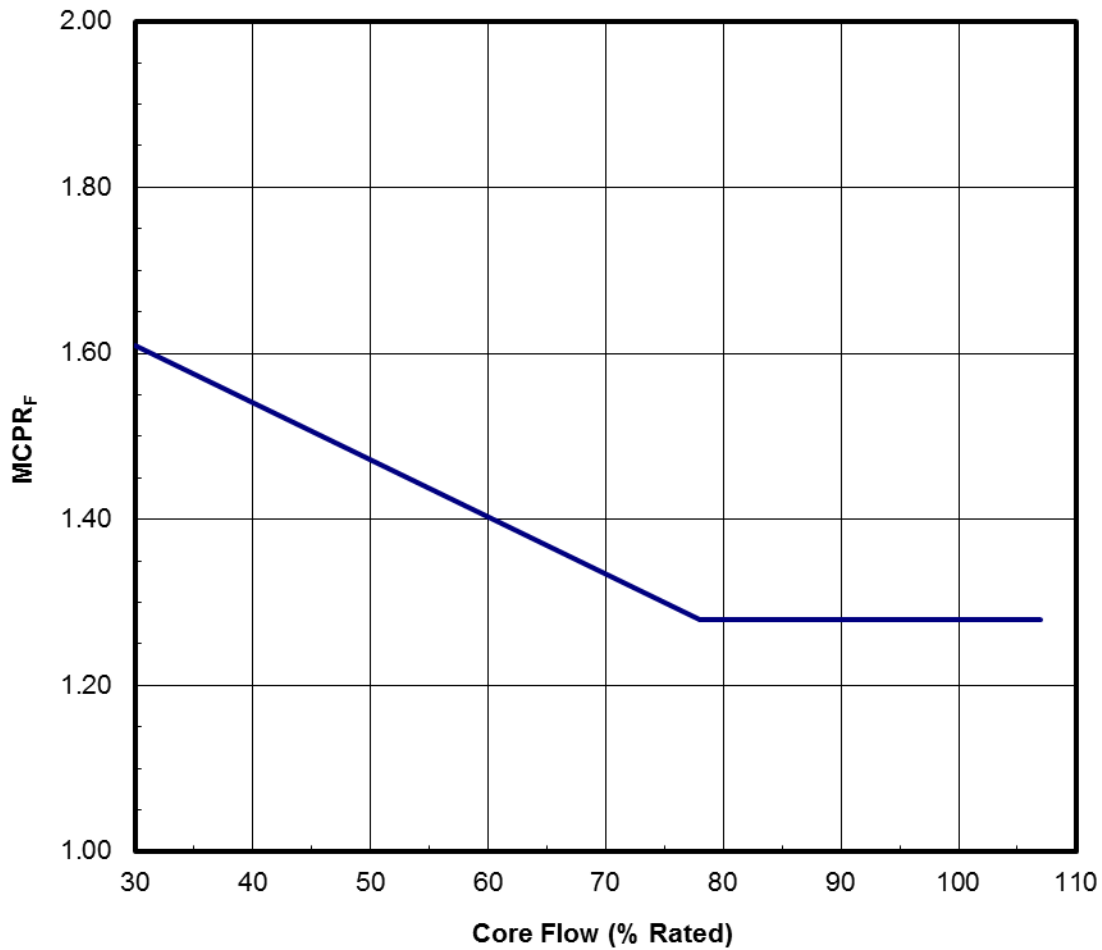

Core Flow (% Rated)	MCPR _F
30.0	1.61
78.0	1.28
107.0	1.28

Figure 4.1 MCPR_F for All Fuel Types
(Values bound all EOOS conditions)

(107.0% maximum core flow line is used to support 105% rated flow operation, ICF)

Table 4.2 MCPR_P Limits for All Fuel Types: Optimum Scram Time Basis*

Operating Condition	Power (% of rated)	ATRIUM-10			ATRIUM-10XM			ATRIUM-11		
		BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
Base Case	100	1.45	1.47	1.50	1.40	1.41	1.43	1.39	1.41	1.43
	75	1.60	1.61	1.65	1.52	1.52	1.55	1.52	1.53	1.56
	65	1.67	1.68	1.73	1.58	1.58	1.62	1.59	1.60	1.68
	50	1.81	1.82	1.92	1.71	1.71	1.78	1.81	1.82	---
	50	1.92	1.93	1.93	1.78	1.80	1.81	1.84	1.85	1.93
	40	2.09	2.10	2.21	1.92	1.92	2.01	2.08	2.09	2.21
	30	2.43	2.44	2.59	2.22	2.22	2.34	2.40	2.41	2.58
	30 at > 50°F	3.23	3.24	3.38	2.95	2.95	3.07	3.30	3.31	3.48
	25 at > 50°F	3.62	3.63	3.82	3.30	3.30	3.45	3.71	3.72	3.93
	30 at ≤ 50°F	3.23	3.24	3.38	2.86	2.86	2.97	3.11	3.12	3.25
	25 at ≤ 50°F	3.59	3.60	3.80	3.19	3.19	3.33	3.46	3.47	3.65
FHOOS	100	1.48	1.50	---	1.42	1.43	---	1.42	1.43	---
	75	1.63	1.65	---	1.55	1.55	---	1.55	1.56	---
	65	1.72	1.73	---	1.62	1.62	---	1.67	1.68	---
	50	1.91	1.92	---	1.78	1.78	---	---	---	---
	50	1.92	1.93	---	1.79	1.80	---	1.92	1.93	---
	40	2.20	2.21	---	2.01	2.01	---	2.20	2.21	---
	30	2.58	2.59	---	2.34	2.34	---	2.57	2.58	---
	30 at > 50°F	3.37	3.38	---	3.07	3.07	---	3.47	3.48	---
	25 at > 50°F	3.81	3.82	---	3.45	3.45	---	3.92	3.93	---
	30 at ≤ 50°F	3.37	3.38	---	2.97	2.97	---	3.24	3.25	---
	25 at ≤ 50°F	3.79	3.80	---	3.33	3.33	---	3.64	3.65	---

* All limits, including "Base Case," support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service.

FFWTR/FHOOS is supported for the BOC to End of Coast limits.

Table 4.3 MCPR_p Limits for All Fuel Types: Nominal Scram Time Basis*

Operating Condition	Power (% of rated)	ATRIUM-10			ATRIUM-10XM			ATRIUM-11		
		BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
Base Case	100	1.46	1.48	1.51	1.41	1.42	1.44	1.41	1.42	1.44
	75	1.61	1.62	1.66	1.54	1.54	1.56	1.53	1.54	1.60
	65	1.68	1.69	1.74	1.59	1.59	1.63	1.63	1.64	1.72
	50	1.86	1.87	---	1.73	1.73	1.81	---	---	---
	50	1.93	1.94	1.96	1.79	1.81	1.82	1.85	1.86	1.98
	40	2.14	2.15	2.26	1.96	1.96	2.05	2.13	2.14	2.27
	30	2.49	2.50	2.65	2.25	2.25	2.37	2.46	2.47	2.64
	30 at > 50°F	3.23	3.24	3.38	2.95	2.95	3.07	3.30	3.31	3.48
	25 at > 50°F	3.62	3.63	3.82	3.30	3.30	3.45	3.71	3.72	3.93
	30 at ≤ 50°F	3.23	3.24	3.38	2.86	2.86	2.97	3.11	3.12	3.25
TBVOOS	25 at ≤ 50°F	3.59	3.60	3.80	3.19	3.19	3.33	3.46	3.47	3.65
	100	1.52	1.53	1.56	1.45	1.45	1.47	1.45	1.47	1.49
	75	1.67	1.68	1.71	1.57	1.57	1.59	1.58	1.59	1.61
	65	1.73	1.74	1.80	1.63	1.63	1.66	1.64	1.65	1.72
	50	1.87	1.88	---	1.75	1.75	1.81	---	---	---
	50	1.93	1.94	1.97	1.79	1.81	1.82	1.86	1.87	1.98
	40	2.15	2.16	2.26	1.96	1.96	2.05	2.13	2.14	2.27
	30	2.49	2.50	2.65	2.25	2.25	2.38	2.46	2.47	2.64
	30 at > 50°F	3.71	3.72	3.91	3.39	3.39	3.57	3.78	3.79	4.02
	25 at > 50°F	4.28	4.29	4.50	3.96	3.96	4.15	4.37	4.38	4.63
FHOOS	30 at ≤ 50°F	3.23	3.24	3.39	2.89	2.89	3.06	3.26	3.27	3.42
	25 at ≤ 50°F	3.72	3.73	3.94	3.41	3.41	3.63	3.79	3.80	4.06
	100	1.50	1.51	---	1.43	1.44	---	1.43	1.44	---
	75	1.65	1.66	---	1.56	1.56	---	1.59	1.60	---
	65	1.73	1.74	---	1.63	1.63	---	1.71	1.72	---
	50	---	---	---	---	---	---	---	---	---
	50	1.95	1.96	---	1.81	1.81	---	1.97	1.98	---
	40	2.25	2.26	---	2.05	2.05	---	2.26	2.27	---
	30	2.64	2.65	---	2.37	2.37	---	2.63	2.64	---
	30 at > 50°F	3.37	3.38	---	3.07	3.07	---	3.47	3.48	---
PLUOOS	25 at > 50°F	3.81	3.82	---	3.45	3.45	---	3.92	3.93	---
	30 at ≤ 50°F	3.37	3.38	---	2.97	2.97	---	3.24	3.25	---
	25 at ≤ 50°F	3.79	3.80	---	3.33	3.33	---	3.64	3.65	---
	100	1.46	1.48	1.51	1.41	1.42	1.44	1.41	1.42	1.44
	75	1.61	1.62	1.66	1.54	1.54	1.56	1.53	1.54	1.60
	65	1.84	1.87	1.87	1.72	1.73	1.74	1.76	1.78	1.78
	50	---	---	---	---	---	---	---	---	---
	50	1.93	1.94	1.96	1.79	1.81	1.82	1.85	1.86	1.98
	40	2.14	2.15	2.26	1.96	1.96	2.05	2.13	2.14	2.27
	30	2.49	2.50	2.65	2.25	2.25	2.37	2.46	2.47	2.64
	30 at > 50°F	3.23	3.24	3.38	2.95	2.95	3.07	3.30	3.31	3.48
	25 at > 50°F	3.62	3.63	3.82	3.30	3.30	3.45	3.71	3.72	3.93
	30 at ≤ 50°F	3.23	3.24	3.38	2.86	2.86	2.97	3.11	3.12	3.25
	25 at ≤ 50°F	3.59	3.60	3.80	3.19	3.19	3.33	3.46	3.47	3.65

* All limits, including "Base Case," support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service.

FFWTR and FHOOS assume the same value of temperature drop. Consequently, FHOOS limits are not provided for BOC to End of COAST due to redundancy. Thermal limits for the "BOC to End of COAST" exposure applicability window are developed to conservatively bound FHOOS limits for earlier exposure applicability windows.

Table 4.3 MCPR_P Limits for All Fuel Types: Nominal Scram Time Basis (*continued*)^{*}

Operating Condition	Power (% of rated)	ATRIUM-10			ATRIUM-10XM			ATRIUM-11		
		BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
TBVOOS FHOOS	100	1.54	1.56	---	1.46	1.47	---	1.47	1.48	---
	75	1.70	1.71	---	1.59	1.59	---	1.60	1.61	---
	65	1.79	1.80	---	1.66	1.66	---	1.71	1.72	---
	50	---	---	---	---	---	---	---	---	---
	50	1.96	1.97	---	1.81	1.81	---	1.97	1.98	---
	40	2.25	2.26	---	2.05	2.05	---	2.26	2.27	---
	30	2.64	2.65	---	2.38	2.38	---	2.63	2.64	---
	30 at > 50°F	3.90	3.91	---	3.57	3.57	---	4.01	4.02	---
	25 at > 50°F	4.49	4.50	---	4.15	4.15	---	4.62	4.63	---
	30 at ≤ 50°F	3.38	3.39	---	3.06	3.06	---	3.41	3.42	---
	25 at ≤ 50°F	3.93	3.94	---	3.63	3.63	---	4.05	4.06	---
TBVOOS PLUOOS	100	1.52	1.53	1.56	1.45	1.45	1.47	1.45	1.47	1.49
	75	1.67	1.68	1.71	1.57	1.57	1.59	1.58	1.59	1.61
	65	1.84	1.87	1.87	1.72	1.73	1.74	1.76	1.78	1.78
	50	---	---	---	---	---	---	---	---	---
	50	1.93	1.94	1.97	1.79	1.81	1.82	1.86	1.87	1.98
	40	2.15	2.16	2.26	1.96	1.96	2.05	2.13	2.14	2.27
	30	2.49	2.50	2.65	2.25	2.25	2.38	2.46	2.47	2.64
	30 at > 50°F	3.71	3.72	3.91	3.39	3.39	3.57	3.78	3.79	4.02
	25 at > 50°F	4.28	4.29	4.50	3.96	3.96	4.15	4.37	4.38	4.63
	30 at ≤ 50°F	3.23	3.24	3.39	2.89	2.89	3.06	3.26	3.27	3.42
	25 at ≤ 50°F	3.72	3.73	3.94	3.41	3.41	3.63	3.79	3.80	4.06
FHOOS PLUOOS	100	1.50	1.51	---	1.43	1.44	---	1.43	1.44	---
	75	1.65	1.66	---	1.56	1.56	---	1.59	1.60	---
	65	1.84	1.87	---	1.72	1.73	---	1.76	1.78	---
	50	---	---	---	---	---	---	---	---	---
	50	1.95	1.96	---	1.81	1.81	---	1.97	1.98	---
	40	2.25	2.26	---	2.05	2.05	---	2.26	2.27	---
	30	2.64	2.65	---	2.37	2.37	---	2.63	2.64	---
	30 at > 50°F	3.37	3.38	---	3.07	3.07	---	3.47	3.48	---
	25 at > 50°F	3.81	3.82	---	3.45	3.45	---	3.92	3.93	---
	30 at ≤ 50°F	3.37	3.38	---	2.97	2.97	---	3.24	3.25	---
	25 at ≤ 50°F	3.79	3.80	---	3.33	3.33	---	3.64	3.65	---
TBVOOS FHOOS PLUOOS	100	1.54	1.56	---	1.46	1.47	---	1.47	1.48	---
	75	1.70	1.71	---	1.59	1.59	---	1.60	1.61	---
	65	1.84	1.87	---	1.72	1.73	---	1.76	1.78	---
	50	---	---	---	---	---	---	---	---	---
	50	1.96	1.97	---	1.81	1.81	---	1.97	1.98	---
	40	2.25	2.26	---	2.05	2.05	---	2.26	2.27	---
	30	2.64	2.65	---	2.38	2.38	---	2.63	2.64	---
	30 at > 50°F	3.90	3.91	---	3.57	3.57	---	4.01	4.02	---
	25 at > 50°F	4.49	4.50	---	4.15	4.15	---	4.62	4.63	---
	30 at ≤ 50°F	3.38	3.39	---	3.06	3.06	---	3.41	3.42	---
	25 at ≤ 50°F	3.93	3.94	---	3.63	3.63	---	4.05	4.06	---

^{*} All limits, including "Base Case," support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service.

FFWTR and FHOOS assume the same value of temperature drop. Consequently, FHOOS limits are not provided for BOC to End of COAST due to redundancy. Thermal limits for the "BOC to End of COAST" exposure applicability window are developed to conservatively bound FHOOS limits for earlier exposure applicability windows.

Table 4.4 MCPR_p Limits for All Fuel Types: Technical Specification Scram Time Basis*

Operating Condition	Power (% of rated)	ATRIUM-10			ATRIUM-10XM			ATRIUM-11		
		BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
Base Case	100	1.48	1.49	1.52	1.43	1.43	1.45	1.42	1.43	1.46
	75	1.62	1.63	1.67	1.54	1.54	1.57	1.56	1.57	1.64
	65	1.68	1.69	1.75	1.60	1.60	1.64	1.67	1.68	1.76
	50	1.91	1.92	---	1.76	1.76	---	---	---	---
	50	1.94	1.95	2.01	1.81	1.82	1.85	1.90	1.91	2.03
	40	2.19	2.20	2.31	1.99	1.99	2.08	2.17	2.18	2.32
	30	2.55	2.56	2.72	2.28	2.28	2.40	2.52	2.53	2.70
	30 at > 50°F	3.23	3.24	3.38	2.95	2.95	3.07	3.30	3.31	3.48
	25 at > 50°F	3.62	3.63	3.82	3.30	3.30	3.45	3.71	3.72	3.93
	30 at ≤ 50°F	3.23	3.24	3.38	2.86	2.86	2.97	3.11	3.12	3.25
	25 at ≤ 50°F	3.59	3.60	3.80	3.19	3.19	3.33	3.46	3.47	3.65
TBVOOS	100	1.53	1.55	1.57	1.46	1.46	1.48	1.46	1.48	1.50
	75	1.68	1.69	1.72	1.58	1.58	1.60	1.59	1.60	1.65
	65	1.74	1.75	1.81	1.63	1.63	1.67	1.68	1.69	1.77
	50	1.92	1.93	---	1.77	1.77	---	---	---	---
	50	1.94	1.95	2.03	1.81	1.82	1.85	1.91	1.92	2.04
	40	2.21	2.22	2.32	1.99	1.99	2.09	2.18	2.19	2.32
	30	2.55	2.56	2.72	2.29	2.29	2.42	2.52	2.53	2.70
	30 at > 50°F	3.71	3.72	3.91	3.39	3.39	3.57	3.78	3.79	4.02
	25 at > 50°F	4.28	4.29	4.50	3.96	3.96	4.15	4.37	4.38	4.63
	30 at ≤ 50°F	3.23	3.24	3.39	2.89	2.89	3.06	3.26	3.27	3.42
	25 at ≤ 50°F	3.72	3.73	3.94	3.41	3.41	3.63	3.79	3.80	4.06
FHOOS	100	1.51	1.52	---	1.45	1.45	---	1.45	1.46	---
	75	1.66	1.67	---	1.57	1.57	---	1.63	1.64	---
	65	1.74	1.75	---	1.64	1.64	---	1.75	1.76	---
	50	---	---	---	---	---	---	---	---	---
	50	2.00	2.01	---	1.85	1.85	---	2.02	2.03	---
	40	2.30	2.31	---	2.08	2.08	---	2.31	2.32	---
	30	2.71	2.72	---	2.40	2.40	---	2.69	2.70	---
	30 at > 50°F	3.37	3.38	---	3.07	3.07	---	3.47	3.48	---
	25 at > 50°F	3.81	3.82	---	3.45	3.45	---	3.92	3.93	---
	30 at ≤ 50°F	3.37	3.38	---	2.97	2.97	---	3.24	3.25	---
	25 at ≤ 50°F	3.79	3.80	---	3.33	3.33	---	3.64	3.65	---
PLUOOS	100	1.48	1.49	1.52	1.43	1.43	1.45	1.42	1.43	1.46
	75	1.62	1.63	1.67	1.54	1.54	1.57	1.56	1.57	1.64
	65	1.86	1.89	1.89	1.73	1.75	1.76	1.77	1.80	1.81
	50	---	---	---	---	---	---	---	---	---
	50	1.94	1.95	2.01	1.82	1.82	1.85	1.90	1.91	2.03
	40	2.19	2.20	2.31	1.99	1.99	2.08	2.17	2.18	2.32
	30	2.55	2.56	2.72	2.28	2.28	2.40	2.52	2.53	2.70
	30 at > 50°F	3.23	3.24	3.38	2.95	2.95	3.07	3.30	3.31	3.48
	25 at > 50°F	3.62	3.63	3.82	3.30	3.30	3.45	3.71	3.72	3.93
	30 at ≤ 50°F	3.23	3.24	3.38	2.86	2.86	2.97	3.11	3.12	3.25
	25 at ≤ 50°F	3.59	3.60	3.80	3.19	3.19	3.33	3.46	3.47	3.65

* All limits, including "Base Case," support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service.

FFWTR and FHOOS assume the same value of temperature drop. Consequently, FHOOS limits are not provided for BOC to End of COAST due to redundancy. Thermal limits for the "BOC to End of COAST" exposure applicability window are developed to conservatively bound FHOOS limits for earlier exposure applicability windows.

Table 4.4 MCPR_P Limits for All Fuel Types: Technical Specification Scram Time Basis (*continued*)^{*}

Operating Condition	Power (% of rated)	ATRIUM-10			ATRIUM-10XM			ATRIUM-11		
		BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
TBVOOS FHOOS	100	1.56	1.57	---	1.48	1.48	---	1.48	1.50	---
	75	1.71	1.72	---	1.60	1.60	---	1.64	1.65	---
	65	1.80	1.81	---	1.67	1.67	---	1.76	1.77	---
	50	---	---	---	---	---	---	---	---	---
	50	2.02	2.03	---	1.85	1.85	---	2.03	2.04	---
	40	2.31	2.32	---	2.09	2.09	---	2.31	2.32	---
	30	2.71	2.72	---	2.42	2.42	---	2.69	2.70	---
	30 at > 50°F	3.90	3.91	---	3.57	3.57	---	4.01	4.02	---
	25 at > 50°F	4.49	4.50	---	4.15	4.15	---	4.62	4.63	---
	30 at ≤ 50°F	3.38	3.39	---	3.06	3.06	---	3.41	3.42	---
	25 at ≤ 50°F	3.93	3.94	---	3.63	3.63	---	4.05	4.06	---
TBVOOS PLUOOS	100	1.53	1.55	1.57	1.46	1.46	1.48	1.46	1.48	1.50
	75	1.68	1.69	1.72	1.58	1.58	1.60	1.59	1.60	1.65
	65	1.86	1.89	1.89	1.73	1.75	1.76	1.77	1.80	1.81
	50	---	---	---	---	---	---	---	---	---
	50	1.94	1.95	2.03	1.82	1.82	1.85	1.91	1.92	2.04
	40	2.21	2.22	2.32	1.99	1.99	2.09	2.18	2.19	2.32
	30	2.55	2.56	2.72	2.29	2.29	2.42	2.52	2.53	2.70
	30 at > 50°F	3.71	3.72	3.91	3.39	3.39	3.57	3.78	3.79	4.02
	25 at > 50°F	4.28	4.29	4.50	3.96	3.96	4.15	4.37	4.38	4.63
	30 at ≤ 50°F	3.23	3.24	3.39	2.89	2.89	3.06	3.26	3.27	3.42
	25 at ≤ 50°F	3.72	3.73	3.94	3.41	3.41	3.63	3.79	3.80	4.06
FHOOS PLUOOS	100	1.51	1.52	---	1.45	1.45	---	1.45	1.46	---
	75	1.66	1.67	---	1.57	1.57	---	1.63	1.64	---
	65	1.86	1.89	---	1.73	1.75	---	1.77	1.80	---
	50	---	---	---	---	---	---	---	---	---
	50	2.00	2.01	---	1.85	1.85	---	2.02	2.03	---
	40	2.30	2.31	---	2.08	2.08	---	2.31	2.32	---
	30	2.71	2.72	---	2.40	2.40	---	2.69	2.70	---
	30 at > 50°F	3.37	3.38	---	3.07	3.07	---	3.47	3.48	---
	25 at > 50°F	3.81	3.82	---	3.45	3.45	---	3.92	3.93	---
	30 at ≤ 50°F	3.37	3.38	---	2.97	2.97	---	3.24	3.25	---
	25 at ≤ 50°F	3.79	3.80	---	3.33	3.33	---	3.64	3.65	---
TBVOOS FHOOS PLUOOS	100	1.56	1.57	---	1.48	1.48	---	1.48	1.50	---
	75	1.71	1.72	---	1.60	1.60	---	1.64	1.65	---
	65	1.86	1.89	---	1.73	1.75	---	1.77	1.80	---
	50	---	---	---	---	---	---	---	---	---
	50	2.02	2.03	---	1.85	1.85	---	2.03	2.04	---
	40	2.31	2.32	---	2.09	2.09	---	2.31	2.32	---
	30	2.71	2.72	---	2.42	2.42	---	2.69	2.70	---
	30 at > 50°F	3.90	3.91	---	3.57	3.57	---	4.01	4.02	---
	25 at > 50°F	4.49	4.50	---	4.15	4.15	---	4.62	4.63	---
	30 at ≤ 50°F	3.38	3.39	---	3.06	3.06	---	3.41	3.42	---
	25 at ≤ 50°F	3.93	3.94	---	3.63	3.63	---	4.05	4.06	---

^{*} All limits, including "Base Case," support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service.

FFWTR and FHOOS assume the same value of temperature drop. Consequently, FHOOS limits are not provided for BOC to End of COAST due to redundancy. Thermal limits for the "BOC to End of COAST" exposure applicability window are developed to conservatively bound FHOOS limits for earlier exposure applicability windows.



Table 4.5 Startup Operation MCPRP Limits for Table 3.1 Temperature
Range 1 for All Fuel Types: Nominal Scram Time Basis*

Operating Condition	Power (% of rated)	ATRIUM-10			ATRIUM-10XM			ATRIUM-11		
		BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
TBVIS	100	1.50	1.51	1.51	1.43	1.44	1.44	1.43	1.44	1.44
	75	1.65	1.66	1.66	1.56	1.56	1.56	1.59	1.60	1.60
	65	1.84	1.87	1.87	1.72	1.73	1.73	1.76	1.78	1.78
	50	---	---	---	---	---	---	---	---	---
	50	2.18	2.19	2.19	1.99	1.99	1.99	2.24	2.25	2.25
	40	2.54	2.55	2.55	2.28	2.28	2.28	2.59	2.60	2.60
	30	3.00	3.01	3.01	2.67	2.67	2.67	3.01	3.02	3.02
	30 at > 50°F	3.80	3.81	3.81	3.36	3.36	3.36	3.93	3.94	3.94
	25 at > 50°F	4.30	4.31	4.31	3.82	3.82	3.82	4.44	4.45	4.45
	30 at ≤ 50°F	3.71	3.72	3.72	3.28	3.28	3.28	3.58	3.59	3.59
TBVOOS	25 at ≤ 50°F	4.25	4.26	4.26	3.70	3.70	3.70	4.06	4.07	4.07
	100	1.54	1.56	1.56	1.46	1.47	1.47	1.47	1.48	1.48
	75	1.70	1.71	1.71	1.59	1.59	1.59	1.60	1.61	1.61
	65	1.84	1.87	1.87	1.72	1.73	1.73	1.76	1.78	1.78
	50	---	---	---	---	---	---	---	---	---
	50	2.18	2.19	2.19	1.99	1.99	1.99	2.24	2.25	2.25
	40	2.54	2.55	2.55	2.28	2.28	2.28	2.59	2.60	2.60
	30	3.00	3.01	3.01	2.67	2.67	2.67	3.01	3.02	3.02
	30 at > 50°F	4.24	4.25	4.25	3.86	3.86	3.86	4.42	4.43	4.43
	25 at > 50°F	4.89	4.90	4.90	4.50	4.50	4.50	5.08	5.09	5.09
	30 at ≤ 50°F	3.76	3.77	3.77	3.35	3.35	3.35	3.76	3.77	3.77
	25 at ≤ 50°F	4.45	4.46	4.46	3.97	3.97	3.97	4.44	4.45	4.45

* Limits support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service.

Limits are applicable for all other EOOS scenarios, apart from TBV.

Limits are only valid up to 50% rated core power.



Table 4.6 Startup Operation MCPR_P Limits for Table 3.1 Temperature Range 2 for All Fuel Types: Nominal Scram Time Basis*

Operating Condition	Power (% of rated)	ATRIUM-10			ATRIUM-10XM			ATRIUM-11		
		BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
TBVIS	100	1.50	1.51	1.51	1.43	1.44	1.44	1.43	1.44	1.44
	75	1.65	1.66	1.66	1.56	1.56	1.56	1.59	1.60	1.60
	65	1.84	1.87	1.87	1.72	1.73	1.73	1.76	1.78	1.78
	50	---	---	---	---	---	---	---	---	---
	50	2.20	2.21	2.21	2.00	2.00	2.00	2.26	2.27	2.27
	40	2.55	2.56	2.56	2.29	2.29	2.29	2.61	2.62	2.62
	30	3.02	3.03	3.03	2.69	2.69	2.69	3.04	3.05	3.05
	30 at > 50°F	3.82	3.83	3.83	3.38	3.38	3.38	3.96	3.97	3.97
	25 at > 50°F	4.34	4.35	4.35	3.85	3.85	3.85	4.47	4.48	4.48
	30 at ≤ 50°F	3.72	3.73	3.73	3.30	3.30	3.30	3.60	3.61	3.61
	25 at ≤ 50°F	4.30	4.31	4.31	3.71	3.71	3.71	4.09	4.10	4.10
TBVOOS	100	1.54	1.56	1.56	1.46	1.47	1.47	1.47	1.48	1.48
	75	1.70	1.71	1.71	1.59	1.59	1.59	1.60	1.61	1.61
	65	1.84	1.87	1.87	1.72	1.73	1.73	1.76	1.78	1.78
	50	---	---	---	---	---	---	---	---	---
	50	2.20	2.21	2.21	2.00	2.00	2.00	2.26	2.27	2.27
	40	2.55	2.56	2.56	2.29	2.29	2.29	2.61	2.62	2.62
	30	3.02	3.03	3.03	2.69	2.69	2.69	3.04	3.05	3.05
	30 at > 50°F	4.27	4.28	4.28	3.88	3.88	3.88	4.45	4.46	4.46
	25 at > 50°F	4.91	4.92	4.92	4.52	4.52	4.52	5.11	5.12	5.12
	30 at ≤ 50°F	3.80	3.81	3.81	3.37	3.37	3.37	3.76	3.77	3.77
	25 at ≤ 50°F	4.48	4.49	4.49	3.99	3.99	3.99	4.47	4.48	4.48

* Limits support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service.

Limits are applicable for all other EOOS scenarios, apart from TBV.

Limits are only valid up to 50% rated core power.



Table 4.7 Startup Operation MCPR_P Limits for Table 3.1 Temperature Range 1 for All Fuel Types: Technical Specification Scram Time Basis*

Operating Condition	Power (% of rated)	ATRIUM-10			ATRIUM-10XM			ATRIUM-11		
		BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
TBVIS	100	1.51	1.52	1.52	1.45	1.45	1.45	1.45	1.46	1.46
	75	1.66	1.67	1.67	1.57	1.57	1.57	1.63	1.64	1.64
	65	1.86	1.89	1.89	1.73	1.75	1.75	1.77	1.80	1.80
	50	---	---	---	---	---	---	---	---	---
	50	2.24	2.25	2.25	2.03	2.03	2.03	2.29	2.30	2.30
	40	2.59	2.60	2.60	2.32	2.32	2.32	2.65	2.66	2.66
	30	3.07	3.08	3.08	2.71	2.71	2.71	3.08	3.09	3.09
	30 at > 50°F	3.80	3.81	3.81	3.36	3.36	3.36	3.93	3.94	3.94
	25 at > 50°F	4.30	4.31	4.31	3.82	3.82	3.82	4.44	4.45	4.45
	30 at ≤ 50°F	3.71	3.72	3.72	3.28	3.28	3.28	3.58	3.59	3.59
	25 at ≤ 50°F	4.25	4.26	4.26	3.70	3.70	3.70	4.06	4.07	4.07
TBVOOS	100	1.56	1.57	1.57	1.48	1.48	1.48	1.48	1.50	1.50
	75	1.71	1.72	1.72	1.60	1.60	1.60	1.64	1.65	1.65
	65	1.86	1.89	1.89	1.73	1.75	1.75	1.77	1.80	1.80
	50	---	---	---	---	---	---	---	---	---
	50	2.24	2.25	2.25	2.03	2.03	2.03	2.29	2.30	2.30
	40	2.60	2.61	2.61	2.32	2.32	2.32	2.65	2.66	2.66
	30	3.07	3.08	3.08	2.72	2.72	2.72	3.08	3.09	3.09
	30 at > 50°F	4.24	4.25	4.25	3.86	3.86	3.86	4.42	4.43	4.43
	25 at > 50°F	4.89	4.90	4.90	4.50	4.50	4.50	5.08	5.09	5.09
	30 at ≤ 50°F	3.76	3.77	3.77	3.35	3.35	3.35	3.76	3.77	3.77
	25 at ≤ 50°F	4.45	4.46	4.46	3.97	3.97	3.97	4.44	4.45	4.45

* Limits support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service.

Limits are applicable for all other EOOS scenarios, apart from TBV.

Limits are only valid up to 50% rated core power.



Table 4.8 Startup Operation MCPR_P Limits for Table 3.1 Temperature Range 2 for All Fuel Types: Technical Specification Scram Time Basis*

Operating Condition	Power (% of rated)	ATRIUM-10			ATRIUM-10XM			ATRIUM-11		
		BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
TBVIS	100	1.51	1.52	1.52	1.45	1.45	1.45	1.45	1.46	1.46
	75	1.66	1.67	1.67	1.57	1.57	1.57	1.63	1.64	1.64
	65	1.86	1.89	1.89	1.73	1.75	1.75	1.77	1.80	1.80
	50	---	---	---	---	---	---	---	---	---
	50	2.25	2.26	2.26	2.04	2.04	2.04	2.31	2.32	2.32
	40	2.61	2.62	2.62	2.33	2.33	2.33	2.67	2.68	2.68
	30	3.09	3.10	3.10	2.73	2.73	2.73	3.11	3.12	3.12
	30 at > 50°F	3.82	3.83	3.83	3.38	3.38	3.38	3.96	3.97	3.97
	25 at > 50°F	4.34	4.35	4.35	3.85	3.85	3.85	4.47	4.48	4.48
	30 at ≤ 50°F	3.72	3.73	3.73	3.30	3.30	3.30	3.60	3.61	3.61
	25 at ≤ 50°F	4.30	4.31	4.31	3.71	3.71	3.71	4.09	4.10	4.10
TBVOOS	100	1.56	1.57	1.57	1.48	1.48	1.48	1.48	1.50	1.50
	75	1.71	1.72	1.72	1.60	1.60	1.60	1.64	1.65	1.65
	65	1.86	1.89	1.89	1.73	1.75	1.75	1.77	1.80	1.80
	50	---	---	---	---	---	---	---	---	---
	50	2.26	2.27	2.27	2.04	2.04	2.04	2.31	2.32	2.32
	40	2.61	2.62	2.62	2.33	2.33	2.33	2.67	2.68	2.68
	30	3.09	3.10	3.10	2.73	2.73	2.73	3.11	3.12	3.12
	30 at > 50°F	4.27	4.28	4.28	3.88	3.88	3.88	4.45	4.46	4.46
	25 at > 50°F	4.91	4.92	4.92	4.52	4.52	4.52	5.11	5.12	5.12
	30 at ≤ 50°F	3.80	3.81	3.81	3.37	3.37	3.37	3.76	3.77	3.77
	25 at ≤ 50°F	4.48	4.49	4.49	3.99	3.99	3.99	4.47	4.48	4.48

* Limits support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service.

Limits are applicable for all other EOOS scenarios, apart from TBV.

Limits are only valid up to 50% rated core power.



Table 4.9 BOC to 3000 MWd/MTU Startup Operation MCPR_P Limits for
Table 3.1 Temperature Range 1 for All Fuel Types: Nominal Scram
Time Basis*

Operating Condition	Power (% of rated)	ATRIUM-10	ATRIUM-10XM	ATRIUM-11
		BOC to 3000 MWd/MTU	BOC to 3000 MWd/MTU	BOC to 3000 MWd/MTU
TBVIS	100	1.50	1.43	1.43
	75	1.65	1.56	1.59
	65	1.84	1.72	1.76
	50	---	---	---
	50	2.18	1.99	2.24
	40	2.54	2.28	2.59
	30	3.00	2.67	3.01
	30 at > 50°F	3.40	3.36	3.93
	25 at > 50°F	3.85	3.82	4.44
	30 at ≤ 50°F	3.21	3.28	3.58
	25 at ≤ 50°F	3.60	3.70	4.06
TBVOOS	100	1.54	1.46	1.47
	75	1.70	1.59	1.60
	65	1.84	1.72	1.76
	50	---	---	---
	50	2.18	1.99	2.24
	40	2.54	2.28	2.59
	30	3.00	2.67	3.01
	30 at > 50°F	3.83	3.86	4.42
	25 at > 50°F	4.39	4.50	5.08
	30 at ≤ 50°F	3.26	3.35	3.76
	25 at ≤ 50°F	3.80	3.97	4.44

* Limits support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service.

Limits are applicable for all other EOOS scenarios, apart from TBV.

Limits are only valid up to 50% rated core power.



Table 4.10 BOC to 3000 MWd/MTU Startup Operation MCPR_P Limits for
Table 3.1 Temperature Range 2 for All Fuel Types: Nominal Scram Time
Basis*

Operating Condition	Power (% of rated)	ATRIUM-10	ATRIUM-10XM	ATRIUM-11
		BOC to 3000 MWd/MTU	BOC to 3000 MWd/MTU	BOC to 3000 MWd/MTU
TBVIS	100	1.50	1.43	1.43
	75	1.65	1.56	1.59
	65	1.84	1.72	1.76
	50	---	---	---
	50	2.20	2.00	2.26
	40	2.55	2.29	2.61
	30	3.02	2.69	3.04
	30 at > 50°F	3.42	3.38	3.96
	25 at > 50°F	3.87	3.85	4.47
	30 at ≤ 50°F	3.22	3.30	3.60
	25 at ≤ 50°F	3.63	3.71	4.09
TBVOOS	100	1.54	1.46	1.47
	75	1.70	1.59	1.60
	65	1.84	1.72	1.76
	50	---	---	---
	50	2.20	2.00	2.26
	40	2.55	2.29	2.61
	30	3.02	2.69	3.04
	30 at > 50°F	3.86	3.88	4.45
	25 at > 50°F	4.42	4.52	5.11
	30 at ≤ 50°F	3.28	3.37	3.76
	25 at ≤ 50°F	3.82	3.99	4.47

* Limits support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service.

Limits are applicable for all other EOOS scenarios, apart from TBV.

Limits are only valid up to 50% rated core power.



Table 4.11 BOC to 3000 MWd/MTU Startup Operation MCPR_P Limits for
Table 3.1 Temperature Range 1 for All Fuel Types: Technical
Specification Scram Time Basis*

Operating Condition	Power (% of rated)	ATRIUM-10	ATRIUM-10XM	ATRIUM-11
		BOC to 3000 MWd/MTU	BOC to 3000 MWd/MTU	BOC to 3000 MWd/MTU
TBVIS	100	1.51	1.45	1.45
	75	1.66	1.57	1.63
	65	1.86	1.73	1.77
	50	---	---	---
	50	2.24	2.03	2.29
	40	2.59	2.32	2.65
	30	3.07	2.71	3.08
	30 at > 50°F	3.40	3.36	3.93
	25 at > 50°F	3.85	3.82	4.44
	30 at ≤ 50°F	3.21	3.28	3.58
	25 at ≤ 50°F	3.60	3.70	4.06
TBVOOS	100	1.56	1.48	1.48
	75	1.71	1.60	1.64
	65	1.86	1.73	1.77
	50	---	---	---
	50	2.24	2.03	2.29
	40	2.60	2.32	2.65
	30	3.07	2.72	3.08
	30 at > 50°F	3.83	3.86	4.42
	25 at > 50°F	4.39	4.50	5.08
	30 at ≤ 50°F	3.26	3.35	3.76
	25 at ≤ 50°F	3.80	3.97	4.44

* Limits support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service.

Limits are applicable for all other EOOS scenarios, apart from TBV.

Limits are only valid up to 50% rated core power.



Table 4.12 BOC to 3000 MWd/MTU Startup Operation MCPR_P Limits for
Table 3.1 Temperature Range 2 for All Fuel Types: Technical
Specification Scram Time Basis*

Operating Condition	Power (% of rated)	ATRIUM-10	ATRIUM-10XM	ATRIUM-11
		BOC to 3000 MWd/MTU	BOC to 3000 MWd/MTU	BOC to 3000 MWd/MTU
TBVIS	100	1.51	1.45	1.45
	75	1.66	1.57	1.63
	65	1.86	1.73	1.77
	50	---	---	---
	50	2.25	2.04	2.31
	40	2.61	2.33	2.67
	30	3.09	2.73	3.11
	30 at > 50°F	3.42	3.38	3.96
	25 at > 50°F	3.87	3.85	4.47
	30 at ≤ 50°F	3.22	3.30	3.60
	25 at ≤ 50°F	3.63	3.71	4.09
TBVOOS	100	1.56	1.48	1.48
	75	1.71	1.60	1.64
	65	1.86	1.73	1.77
	50	---	---	---
	50	2.26	2.04	2.31
	40	2.61	2.33	2.67
	30	3.09	2.73	3.11
	30 at > 50°F	3.86	3.88	4.45
	25 at > 50°F	4.42	4.52	5.11
	30 at ≤ 50°F	3.28	3.37	3.76
	25 at ≤ 50°F	3.82	3.99	4.47

* Limits support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service.

Limits are applicable for all other EOOS scenarios, apart from TBV.

Limits are only valid up to 50% rated core power.

Table 4.13 MCPR_p Limits for All Fuel Types: Single Loop Operation for All Scram Times*

Operating Condition	Power (% of rated)	BOC to End of COAST		
		ATRIUM-10	ATRIUM-10XM	ATRIUM-11
RCPOOS FHOOS	100	2.03	1.91	2.05
	50	2.03	1.91	2.05
	40	2.33	2.10	2.34
	30	2.74	2.42	2.72
	30 at > 50°F	3.40	3.09	3.50
	25 at > 50°F	3.84	3.47	3.95
	30 at ≤ 50°F	3.40	2.99	3.27
	25 at ≤ 50°F	3.82	3.35	3.67
RCPOOS TBVOOS PLUOOS FHOOS	100	2.05	1.91	2.06
	50	2.05	1.91	2.06
	40	2.34	2.11	2.34
	30	2.74	2.44	2.72
	30 at > 50°F	3.93	3.59	4.04
	25 at > 50°F	4.52	4.17	4.65
	30 at ≤ 50°F	3.41	3.08	3.44
	25 at ≤ 50°F	3.96	3.65	4.08
RCPOOS TBVOOS FHOOS1	100	2.27	2.05	2.32
	50	2.27	2.05	2.32
	40	2.63	2.34	2.68
	30	3.10	2.74	3.11
	30 at > 50°F	4.27	3.88	4.45
	25 at > 50°F	4.92	4.52	5.11
	30 at ≤ 50°F	3.79	3.37	3.79
	25 at ≤ 50°F	4.48	3.99	4.47
RCPOOS TBVOOS FHOOS2	100	2.29	2.06	2.34
	50	2.29	2.06	2.34
	40	2.64	2.35	2.70
	30	3.12	2.75	3.14
	30 at > 50°F	4.30	3.90	4.48
	25 at > 50°F	4.94	4.54	5.14
	30 at ≤ 50°F	3.83	3.39	3.79
	25 at ≤ 50°F	4.51	4.01	4.50

* All limits, including "Base Case," support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service.

FFWTR and FHOOS assume the same value of temperature drop.

RCPOOS limits are only valid up to 50% rated core power, 50% rated core flow, and an active recirculation drive flow of 17.73 Mlbm/hr.



5 Oscillation Power Range Monitor (OPRM) Setpoint

(Technical Specification 3.3.1.1)

Technical Specification Table 3.3.1.1-1, Function 2f, identifies the OPRM upscale function.

Instrument setpoints are established, such that the reactor will be tripped before an oscillation can grow to the point where the SLMCPR is exceeded. An Option III stability analysis is performed for each reload core to determine allowable OLMCPR's as a function of OPRM setpoint. Analyses consider both steady state startup operation, and the case of a two recirculation pump trip from rated power.

The resulting stability based OLMCPR's are reported in Reference 1. The OPRM setpoint (*sometimes referred to as the Amplitude Trip, S_p*) is selected, such that required margin to the SLMCPR is provided without stability being a limiting event. Analyses are based on cycle specific DIVOM analyses performed per Reference 22. The calculated OLMCPR's are shown in Table 5.1. Review of results shown in COLR Table 4.2 indicates an OPRM setpoint of **1.14** may be used. The successive confirmation count (*sometimes referred to as N_p*) is provided in Table 5.2, per Reference 30.

Table 5.1 OPRM Setpoint Range*

OPRM Setpoint	OLMCPR (SS)	OLMCPR (2PT)
1.05	1.15	1.16
1.06	1.17	1.18
1.07	1.19	1.19
1.08	1.20	1.21
1.09	1.22	1.23
1.10	1.24	1.25
1.11	1.26	1.27
1.12	1.28	1.29
1.13	1.30	1.31
1.14	1.33	1.34
1.15	1.35	1.36

Table 5.2 OPRM Successive Confirmation Count Setpoint

Count	OPRM Setpoint
6	≥ 1.04
8	≥ 1.05
10	≥ 1.07
12	≥ 1.09
14	≥ 1.11
16	≥ 1.14
18	≥ 1.18
20	≥ 1.24

* Extrapolation beyond a setpoint of 1.15 is not allowed



6 APRM Flow Biased Rod Block Trip Settings

(Technical Requirements Manual Section 5.3.1 and Table 3.3.4-1)

The APRM rod block trip setting is based upon References 26 & 27, and is defined by the following:

$$\text{SRB} \leq (0.66(W - \Delta W) + 61\%) \quad \text{Allowable Value}$$

$$\text{SRB} \leq (0.66(W - \Delta W) + 59\%) \quad \text{Nominal Trip Setpoint (NTSP)}$$

where:

SRB = Rod Block setting in percent of rated thermal power (3458 MW_t)

W = Loop recirculation flow rate in percent of rated

ΔW = Difference between two-loop and single-loop effective recirculation flow at the same core flow ($\Delta W = 0.0$ for two-loop operation)

The APRM rod block trip setting is clamped at a maximum allowable value of 115% (corresponding to a NTSP of 113%).



7 Rod Block Monitor (RBM) Trip Setpoints and Operability

(Technical Specification Table 3.3.2.1-1)

The RBM trip setpoints and applicable power ranges, based on References 26 & 27, are shown in Table 7.1. Setpoints are based on an HTSP, unfiltered analytical limit of 114%. Unfiltered setpoints are consistent with a nominal RBM filter setting of 0.0 seconds; filtered setpoints are consistent with a nominal RBM filter setting less than 0.5 seconds. Cycle specific CRWE analyses of OLMCPR are documented in Reference 1, superseding values reported in References 26, 27, and 29.

Table 7.1 Analytical RBM Trip Setpoints*

RBM Trip Setpoint	Allowable Value (AV)	Nominal Trip Setpoint (NTSP)
LPSP	27%	25%
IPSP	62%	60%
HPSP	82%	80%
LTSP - unfiltered	121.7%	120.0%
- filtered	120.7%	119.0%
ITSP - unfiltered	116.7%	115.0%
- filtered	115.7%	114.0%
HTSP - unfiltered	111.7%	110.0%
- filtered	110.9%	109.2%
DTSP	90%	92%

As a result of cycle specific CRWE analyses, RBM setpoints in Technical Specification Table 3.3.2.1-1 are applicable as shown in Table 7.2. Cycle specific setpoint analysis results are shown in Table 7.3, per Reference 1.

Table 7.2 RBM Setpoint Applicability

Thermal Power (% Rated)	Applicable MCPR [†]	Notes from Table 3.3.2.1-1	Comment
> 27% and < 90%	< 1.70	(a), (b), (f), (h)	two loop operation
	< 1.74	(a), (b), (f), (h)	single loop operation
≥ 90%	< 1.39	(g)	two loop operation [‡]

* Values are considered maximums. Using lower values, due to RBM system hardware/software limitations, is conservative, and acceptable.

† MCPR values shown correspond with, (support), SLMPCR values identified in Reference 1.

‡ Greater than 90% rated power is not attainable in single loop operation.

Table 7.3 Control Rod Withdrawal Error Results

RBM HTSP Analytical Limit	CRWE OLMCPR
Unfiltered	
107	1.20
111	1.26
114	1.37
117	1.37

Results, compared against the base case OLMCPR results of Table 4.2, indicate SLMCPR remains protected for RBM inoperable conditions (i.e., 114% unblocked).



8 Shutdown Margin Limit

(Technical Specification 3.1.1)

Assuming the strongest OPERABLE control blade is fully withdrawn, and all other OPERABLE control blades are fully inserted, the core shall be sub-critical and meet the following minimum shutdown margin:

$$\text{SDM} > 0.38\% \text{ dk/k}$$