



Fire PRA Maturity and Realism: A Discussion and Suggestions for Improvement

N. Siu, K. Coyne, S. Sancaktar, and N. Melly
Office of Nuclear Regulatory Research
U.S. Nuclear Regulatory Commission

Presented at
ANS International Topical Meeting on Probabilistic Safety
Assessment and Analysis (PSA 2015: A Forum for Learning)
Sun Valley, ID, USA; April 26-30, 2015

Topics

- Maturity
 - Indicators
 - Implications
- Realism
 - Quantitative
 - Frequency and probability of fire-induced core damage
 - Relative contributions to total CDF
 - Frequencies of intermediate states
 - Qualitative
- Infrastructure
- Conclusions and Suggestions

Conclusions

- Technical maturity and realism are separate issues.
 - Lack of maturity \nRightarrow unrealistic results
 - Maturity \nRightarrow realistic results
 - Existence of uncertainties \nRightarrow lack of maturity
- Fire PRA is in an intermediate-to-late stage of maturity.

Conclusions (cont.)

- Quantitative results of fire PRAs may be conservative.
 - Degree of potential conservatism is uncertain.
 - Sources include practical modeling choices as well as limitations in current technology and guidance.
- Qualitative results match well with operating experience.
 - Most important fire PRA scenarios appear to have a basis in past precursor events.
 - Most precursor fire sources and induced plant transients are typically included in fire PRAs.
 - Yard fires are a potential realism concern.
 - Not yet addressable: multiple fires, multiple hazards, non-proceduralized recovery actions.
- Work is underway to improve fire PRA technology.

Potential Indicators of Technical Maturity

	Developmental Stage		
	Early (Infancy, Emerging)	Intermediate (Adolescent, Developing)	Late (Mature, Stable)
Practitioners	<ul style="list-style-type: none"> • Small research community • Small number of practitioners • Strong personality influences, competing schools of thought 	<ul style="list-style-type: none"> • Larger number of practitioners • Larger number of experienced researchers 	<ul style="list-style-type: none"> • Many well-trained and experienced practitioners • Recognize limits of applicability of methods • Can adapt methods to new situations • Can work with researchers to identify important issues
Research Agenda	<ul style="list-style-type: none"> • Driven by perceived needs • Problem selection affected by personal choice (e.g., due to ease of formulation or solution) 	<ul style="list-style-type: none"> • New practice-driven research problems • Some consensus positions for some broadly defined problem areas • Some unproductive research lines abandoned • Incomplete coverage of topics 	<ul style="list-style-type: none"> • Most research driven by needs of practice • More abstract research addresses needs clearly identifiable by all concerned
Applications	<ul style="list-style-type: none"> • Local applications (addressing small parts of larger problems) • No broader framework 	<ul style="list-style-type: none"> • Fast growth • Developing vocabulary • Optimistic views on new methods; limitations not well understood 	<ul style="list-style-type: none"> • Vocabulary has evolved • General framework exists • Little “selling” of area

Does Maturity Assessment Matter?


- Largely self-resolving (if continual need, desire, and resources)
- Potential consequences of assessments
 - Discounting of valuable results and insights
 - Use of alternative sources with their own weaknesses
- Potential improvement activities not limited to R&D
 - Applications
 - Other (e.g., training, consensus development)
- Changes will take time

Potential Indicators of Realism


- Quantitative
 - CDF
 - Absolute value
 - Relative contribution
 - Probability of core damage
 - Frequency of intermediate states
- Qualitative
 - Important fire PRA scenarios seen in events?
 - Event features seen in fire PRAs?

Comparing With Historical “Data”

- Data: CCDPs from precursor events
- Fire PRAs: NFPA 805 LARs (2006-2013)
- Metric: Total fire-induced core damage frequency, all plants

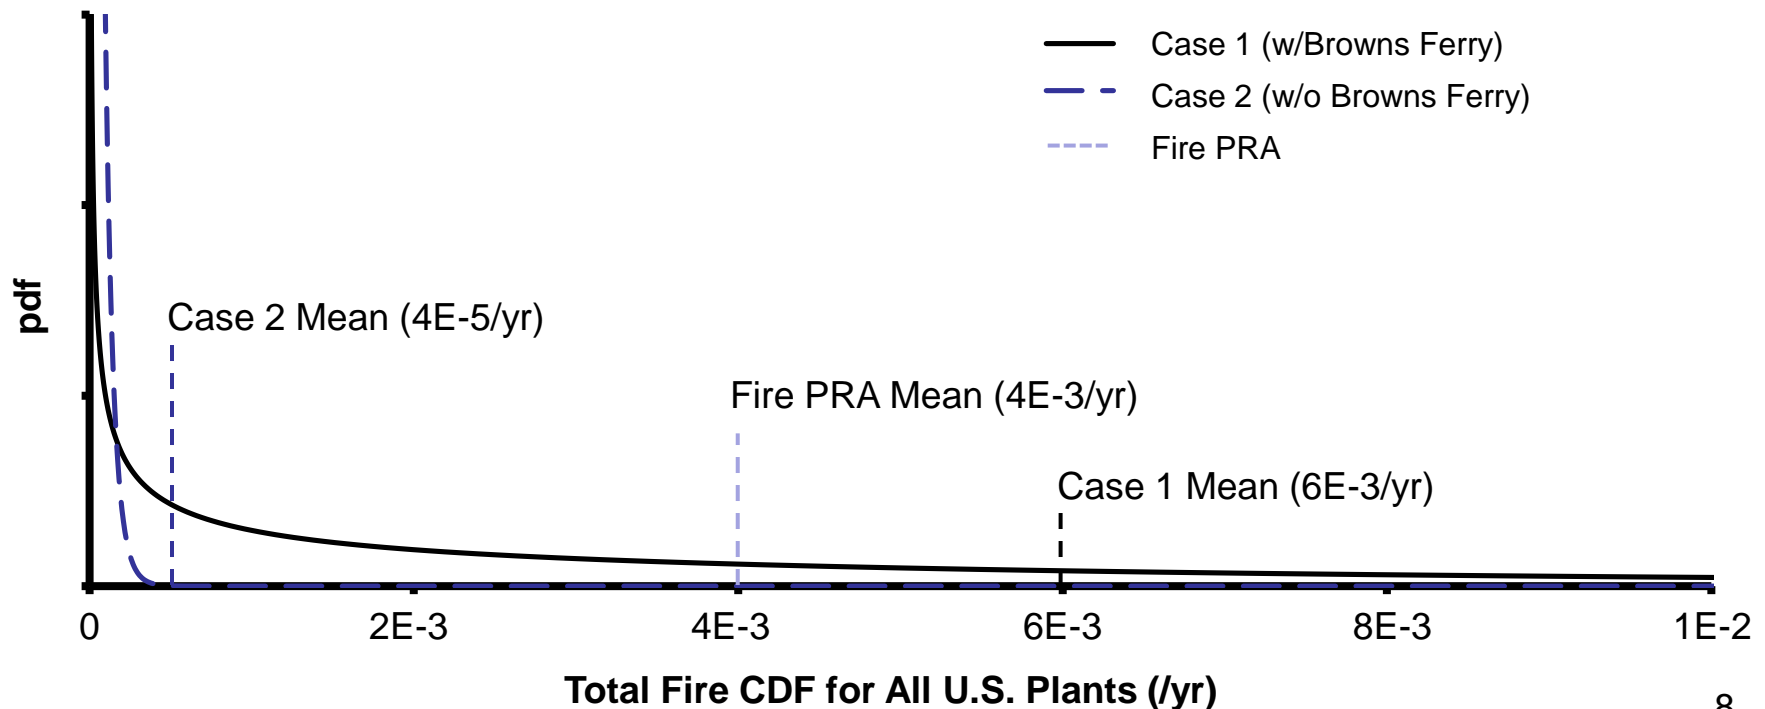



Comparing With Historical “Data”

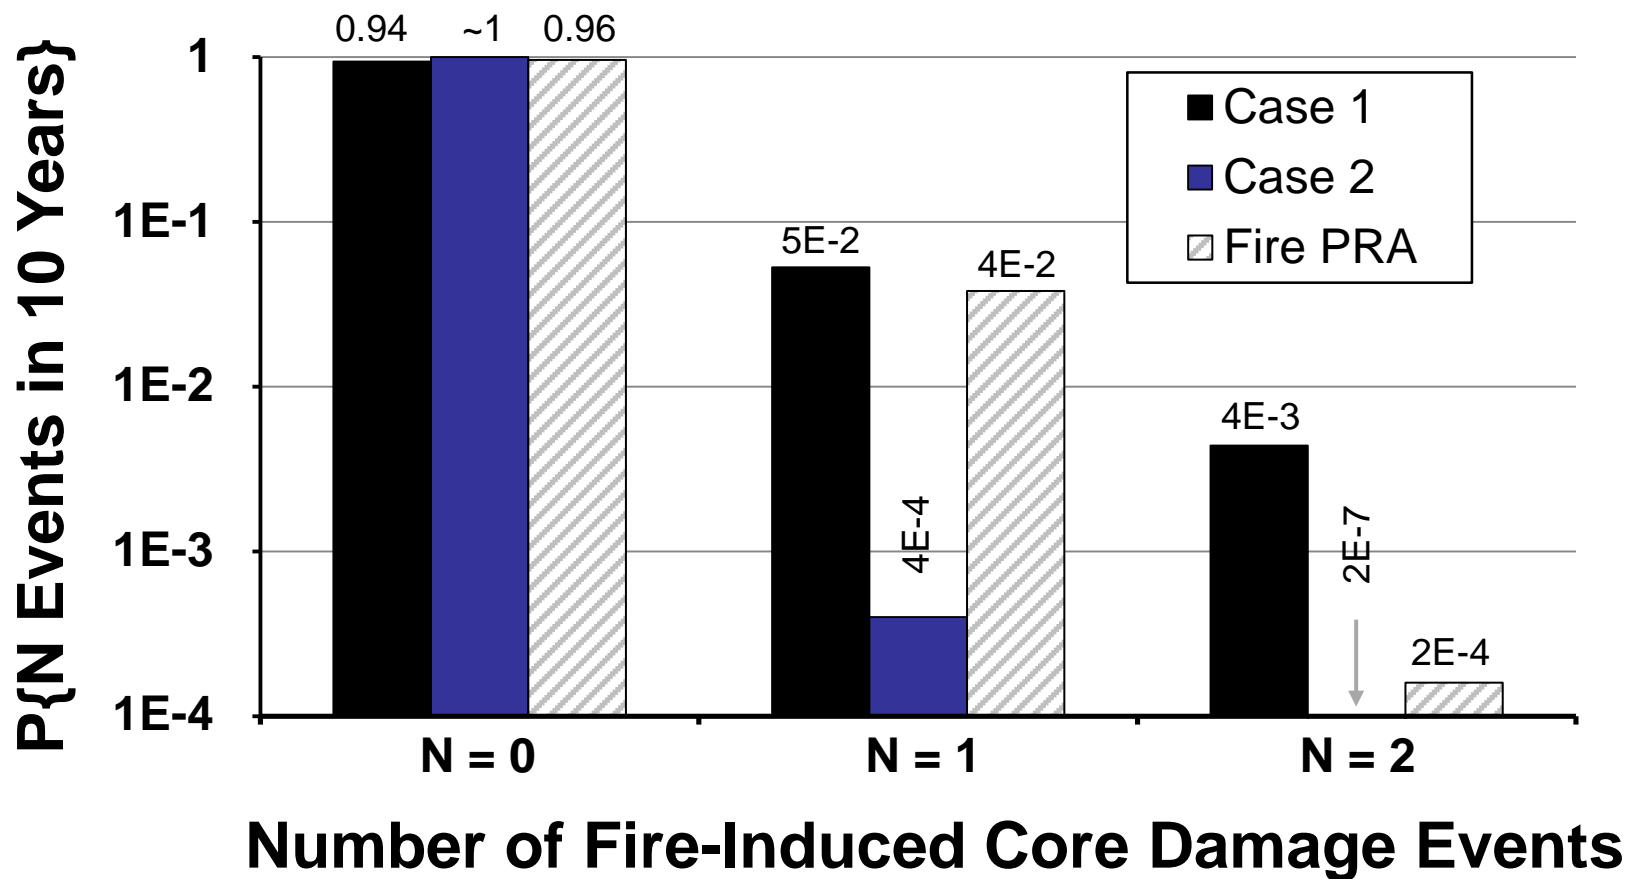

Cautions with Quantitative Analysis

- ***Assumption of exchangeability***
- Also
 - Only CCDPs for initiating event precursors
 - Methods and models for assessing CCDPs have evolved
 - Uses “failure memory” assumption
 - Use of NFPA 805 LAR fire CDFs
 - Representative for remaining plants?
 - Provide post-change CDFs

Changes: Relative Contribution

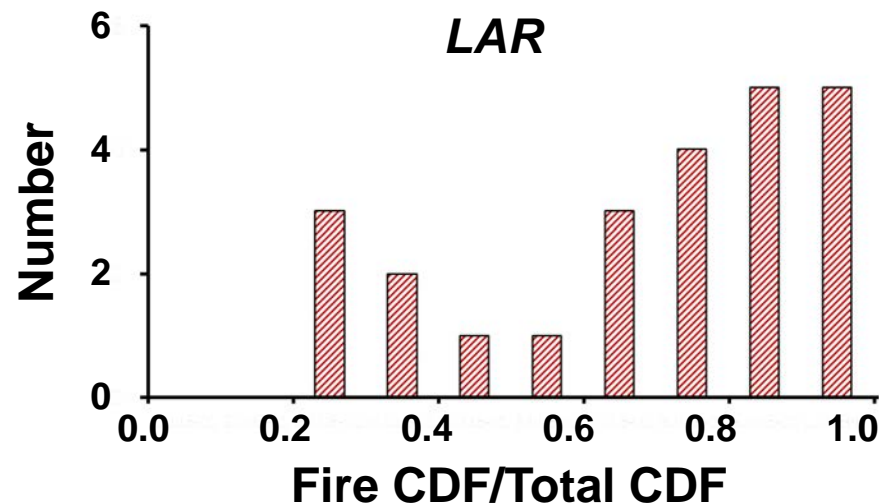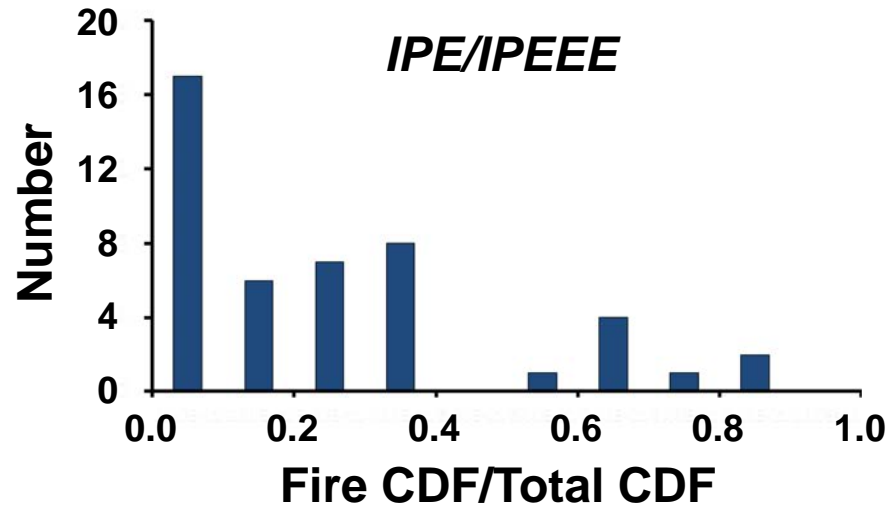

Frequency of Intermediate States

- Canavan et al. (2010)
 - Fire frequencies and severities
 - Frequency of spurious operations
 - Frequency of events with high CCDPs
 - Cumulative effects of multiple modeling conservatisms
- Observations
 - Similar results for fire-induced trips and LOOP
 - Ongoing work has addressed some issues
 - Effort to improve realism may not always be cost-beneficial
 - Conservatisms can be in CCDPs as well as in frequencies

Qualitative Scenario Comparisons

- Risk = $\{s_i, C_i, p_i\}$ (qualitative as well as quantitative)
- Consider IPEEEs as well as current fire PRAs (represented by SPAR-AHZ)
- Results
 - Most important fire PRA areas (e.g., MCR, CSR, switchgear rooms, turbine buildings) and scenarios (e.g., transients, fire-induced failures) seen in major historical events. Yard fires?
 - Historical events involve sources and transients typically included in fire PRAs. Overcooling?
 - Not addressed: multiple fires, multiple hazards, fires as consequences, non-proceduralized recovery actions...
- NUREG/CR-6738 still relevant

Cautions with Qualitative Analysis

- Use of SPAR-AHZ models as representing the broader set of current fire PRAs
- Sparse data for severe events
- Old events (pre-date many improvements)
- PRA does not “predict”
 - Identifies possibilities
 - Even low-likelihood events can occur

Fire PRA Infrastructure Elements

- Research and development
- Standards and guidance
- Staff
 - Training
 - Attitudes and beliefs

Conclusions

- Technical maturity and realism are separate issues.
 - Lack of maturity \nRightarrow unrealistic results
 - Maturity \nRightarrow realistic results
 - Existence of uncertainties \nRightarrow lack of maturity
- Fire PRA is in an intermediate-to-late stage of maturity.

Conclusions (cont.)

- Quantitative results of fire PRAs may be conservative.
 - Degree of potential conservatism is uncertain.
 - Sources include practical modeling choices as well as limitations in current technology and guidance.
- Qualitative results match well with operating experience.
 - Most important fire PRA scenarios appear to have a basis in past precursor events.
 - Most precursor fire sources and induced plant transients are typically included in fire PRAs.
 - Yard fires are a potential realism concern.
 - Not yet addressable: multiple fires, multiple hazards, non-proceduralized recovery actions.
- Work is underway to improve fire PRA technology.


Suggestions

- Structured consideration of indicators of maturity (if maturation acceleration is desired).
- Continue technology development.
 - Operational experience reviews to help identify and prioritize remaining gaps.
 - Emphasize work on enabling efficient analysis of situations where current, qualitative results appear to be inconsistent with operating experience.

BACKUP SLIDES

Comparing With Historical “Data” (2014 update)

- Data: CCDPs from precursor events
- Fire PRAs: NFPA 805 LARs (2006-2014)
- Metric: Total fire-induced core damage frequency, all plants

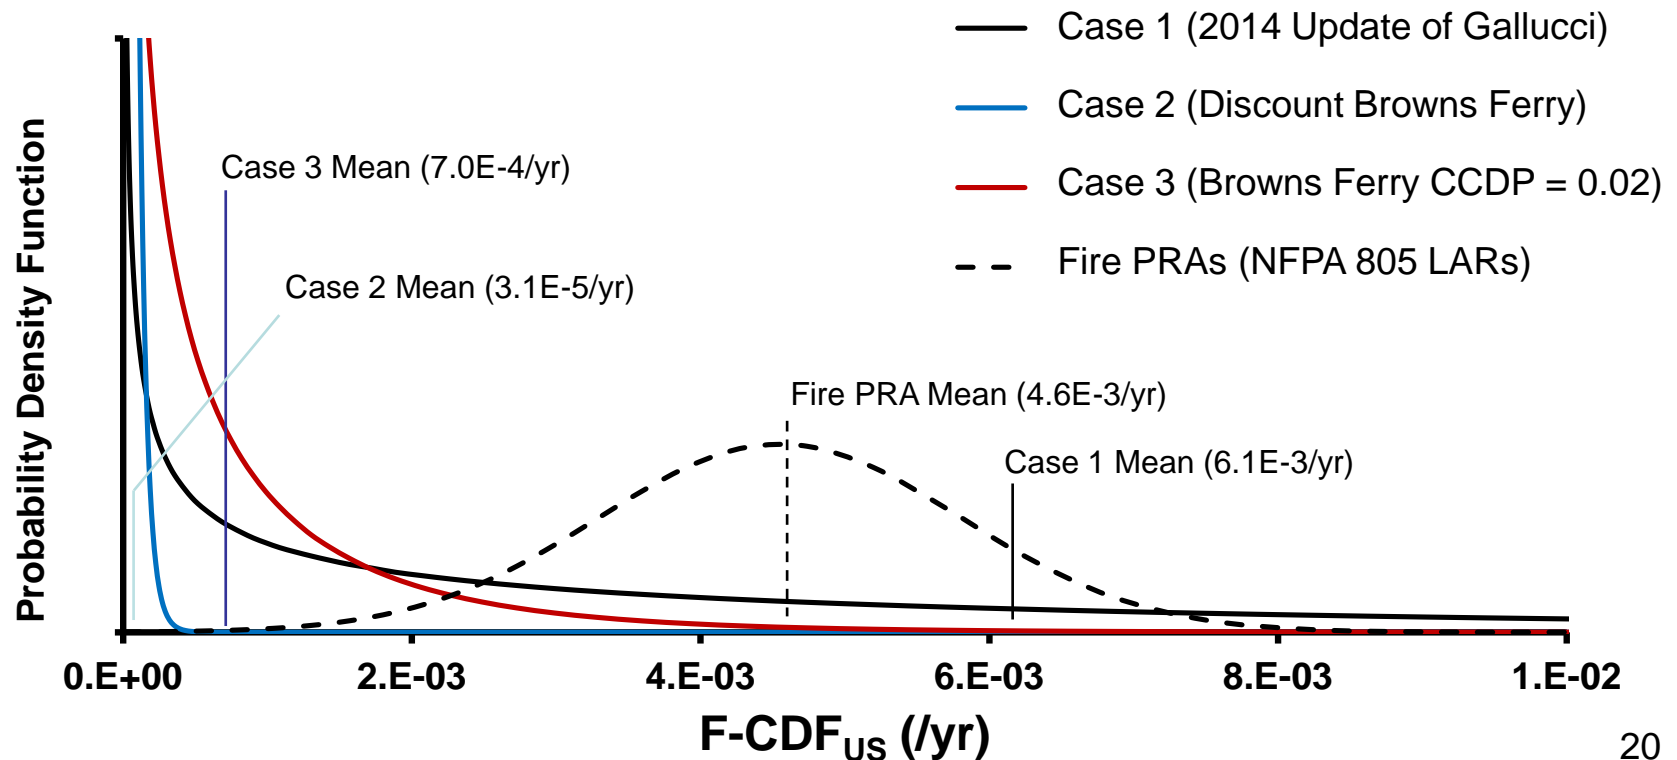

Changes: Relative Contribution (2014 update)

