


ENCLOSURE 1

MAINE YANKEE
INDEPENDENT SPENT FUEL STORAGE INSTALLATION
ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT
JANUARY – DECEMBER 2014

**MAINE YANKEE
INDEPENDENT SPENT FUEL STORAGE INSTALLATION**
License Nos. DPR-36 and SFGL-14

**ANNUAL RADIOACTIVE EFFLUENT
RELEASE REPORT**

January - December 2014

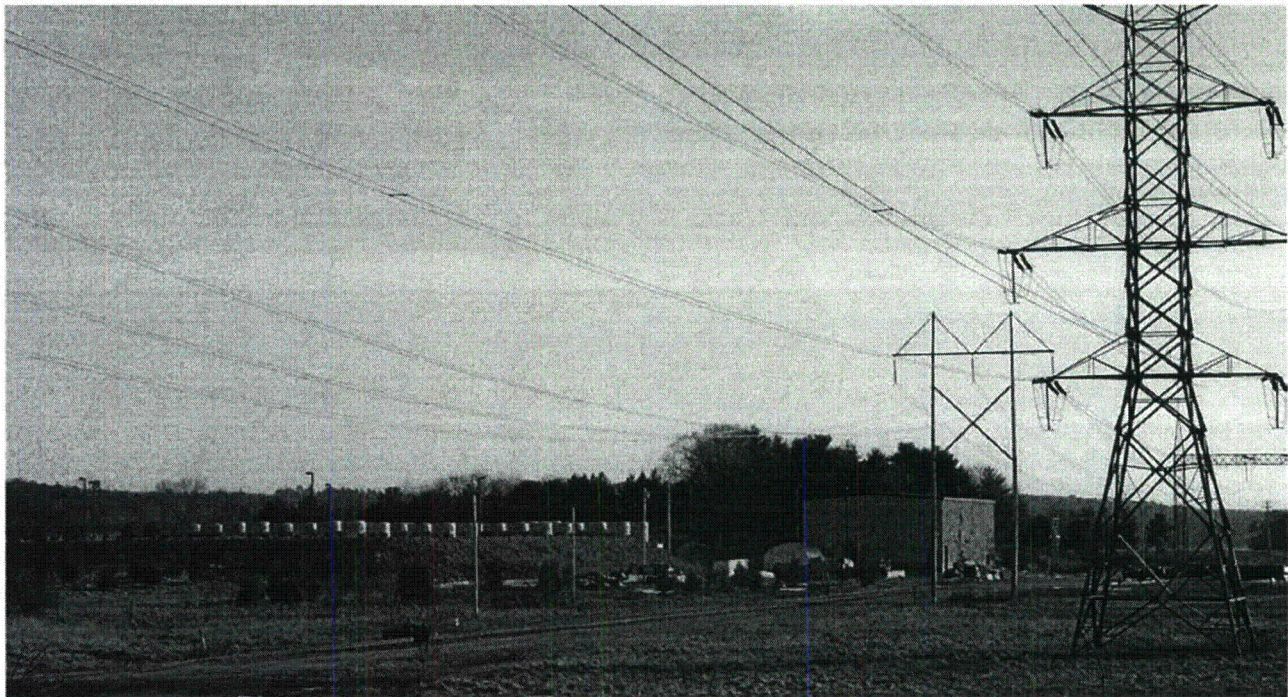

April 2015
Prepared by:

**Radiation Safety & Control Services
91 Portsmouth Avenue
Stratham, NH 03885-2468**

EXECUTIVE SUMMARY

Tables 1 and 2 summarize the quantity of radioactive gaseous and liquid effluents, respectively, for each quarter of 2014. There were no gaseous or liquid releases in 2014. Table 3 summarizes waste shipped off-site for disposal for each half year of 2014. There was no waste shipped for disposal in 2014.

Appendices A and B indicate the status of reportable items per the requirements of the Off-site Dose Calculation Manual (ODCM). There were no reportable items in 2014. Appendix C presents any changes in the ODCM. The ODCM was revised in 2014.

Table 1

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
2014 Gaseous Effluents-Summation of All Releases

Nuclides Released	Units	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Error
A. Fission and Activation Gases						
Total Release	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Average release rate	µCi/s	N/A*	N/A*	N/A*	N/A*	
Percent of regulatory limit	%	N/A*	N/A*	N/A*	N/A*	
B. Iodines						
Total Iodines released	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Average release rate	µCi/s	N/A*	N/A*	N/A*	N/A*	
Percent of regulatory limit	%	N/A*	N/A*	N/A*	N/A*	
C. Particulates						
Particulates Released	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Average release rate	µCi/s	N/A*	N/A*	N/A*	N/A*	
Percent of regulatory limit	%	N/A*	N/A*	N/A*	N/A*	
Gross alpha radioactivity	Ci	N/A*	N/A*	N/A*	N/A*	
D. Tritium						
Total release	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Average release rate	µCi/s	N/A*	N/A*	N/A*	N/A*	
Percent of regulatory limit	%	N/A*	N/A*	N/A*	N/A*	

N/A*= Not Applicable

There are no gaseous effluents associated with the Maine Yankee Independent Spent Fuel Storage Installation (ISFSI)

Table 1A

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
2014 Gaseous Effluents - Ground Level Releases - Batch Mode

Nuclides Released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Total
1. Fission Gases						
Krypton-85	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-85m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-87	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-88	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-133	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-135	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-135m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-138	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Unidentified	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
2. Iodines						
Iodine-131	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-133	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-135	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
3. Particulates						
Strontium-89	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Strontium-90	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-134	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-137	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cobalt-60	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Barium-Lanthanum-140	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Others-						
Plutonium-238	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Curium-243,244	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Uranium-234	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Uranium-238	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Thorium-232	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Radium-226	Ci	N/A*	N/A*	N/A*	N/A*	N/A*

N/A*= Not Applicable

There are no gaseous effluents associated with the Maine Yankee Independent Spent Fuel Storage Installation (ISFSI)

Table 1B

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
2014 Gaseous Effluents - Ground Level Releases - Continuous Mode

Nuclides Released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Total
1. Fission Gases						
Krypton-85	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-85m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-87	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-88	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-133	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-135	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-135m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-138	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Unidentified	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
2. Iodines						
Iodine-131	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-133	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-135	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
3. Particulates						
Strontium-89	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Strontium-90	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-134	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-137	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cobalt-60	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Barium-Lanthanum-140	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Others-						
Plutonium-238	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Curium-243,244	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Uranium-234	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Uranium-238	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Thorium-232	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Radium-226	Ci	N/A*	N/A*	N/A*	N/A*	N/A*

N/A*= Not Applicable

There are no gaseous effluents associated with the Maine Yankee Independent Spent Fuel Storage Installation (ISFSI)

Table 1C

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
2014 Gaseous Effluents - Elevated Releases – Batch Mode

Nuclides Released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Total
1. Fission Gases						
Krypton-85	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-85m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-87	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-88	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-133	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-135	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-135m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-138	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Unidentified	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
2. Iodines						
Iodine-131	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-133	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-135	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
3. Particulates						
Strontium-89	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Strontium-90	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-134	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-137	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cobalt-60	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Barium-Lanthanum-140	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Others-						
Plutonium-238	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Curium-243,244	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Uranium-234	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Uranium-238	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Thorium-232	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Radium-226	Ci	N/A*	N/A*	N/A*	N/A*	N/A*

N/A*= Not Applicable

There are no gaseous effluents associated with the Maine Yankee Independent Spent Fuel Storage Installation (ISFSI)

Table 1D

**MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
2014 Gaseous Effluents - Elevated Releases – Continuous Mode**

Nuclides Released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Total
1. Fission Gases						
Krypton-85	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-85m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-87	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-88	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-133	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-135	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-135m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-138	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Unidentified	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
2. Iodines						
Iodine-131	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-133	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-135	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
3. Particulates						
Strontium-89	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Strontium-90	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-134	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-137	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cobalt-60	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Barium-Lanthanum-140	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Others-						
Plutonium-238	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Curium-243,244	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Uranium-234	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Uranium-238	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Thorium-232	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Radium-226	Ci	N/A*	N/A*	N/A*	N/A*	N/A*

N/A*= Not Applicable

There are no gaseous effluents associated with the Maine Yankee Independent Spent Fuel Storage Installation (ISFSI)

Table 2

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
2014 Liquid Effluents - Summation of All Releases

Nuclides Released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Error
A. Fission and Activation Products						
Total Release (not including tritium, gases, alpha)	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Average diluted concentration during period	µCi/ml	N/A*	N/A*	N/A*	N/A*	
Percent of applicable limit	%	N/A*	N/A*	N/A*	N/A*	
B. Tritium						
Total Release	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Average diluted concentration during period	µCi/ml	N/A*	N/A*	N/A*	N/A*	
Percent of applicable limit	%	N/A*	N/A*	N/A*	N/A*	
C. Dissolved and Entrained Gases						
Total Release	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Average diluted concentration during period	µCi/ml	N/A*	N/A*	N/A*	N/A*	
Percent of applicable limit	%	N/A*	N/A*	N/A*	N/A*	
D. Gross Alpha Radioactivity						
Total release	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Average diluted concentration during period	µCi/ml	N/A*	N/A*	N/A*	N/A*	
E. Volume of Waste Released (prior to dilution)	Liters	N/A*	N/A*	N/A*	N/A*	
F. Volume of Dilution Water Used During Period	Liters	N/A*	N/A*	N/A*	N/A*	

N/A*= Not Applicable

There are no liquid effluents associated with the Maine Yankee Independent Spent Fuel Storage Installation (ISFSI)

Table 2A

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
2014 Liquid Effluents – Batch Mode

Nuclides Released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Totals
Strontium-89	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Strontium-90	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-134	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-137	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-131	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cobalt-58	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cobalt-60	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iron-59	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Zinc-65	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Manganese-54	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Chromium-51	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Zirconium-Niobium-95	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Molybdenum-99	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Technetium-99m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Barium-Lanthanum-140	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cerium-141	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Others- Iron-55	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Antimony-125	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Unidentified	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period (above)	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Dissolved and Entrained Gasses	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Tritium	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Gross Alpha	Ci	N/A*	N/A*	N/A*	N/A*	N/A*

N/A*= Not Applicable

There are no liquid effluents associated with the Maine Yankee Independent Spent Fuel Storage Installation (ISFSI)

Table 2B

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
2014 Liquid Effluents – Continuous Mode

Nuclides Released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Totals
Strontium-89	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Strontium-90	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-134	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-137	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-131	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cobalt-58	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cobalt-60	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iron-59	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Zinc-65	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Manganese-54	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Chromium-51	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Zirconium-Niobium-95	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Molybdenum-99	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Technetium-99m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Barium-Lanthanum-140	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cerium-141	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Others- Iron-55	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Antimony-125	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Unidentified	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period (above)	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Dissolved and Entrained Gasses	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Tritium	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Gross Alpha	Ci	N/A*	N/A*	N/A*	N/A*	N/A*

N/A*= Not Applicable

There are no liquid effluents associated with the Maine Yankee Independent Spent Fuel Storage Installation (ISFSI)

Table 3

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
First Half 2014 Low Level Waste Shipments

Resins, Filters and Evaporator Bottoms		Volume		Curies Shipped
Waste Class	Solidifying Agent	ft ³	m ³	Curies
A		0	0	0
B		0	0	0
C		0	0	0
All		0	0	0
Major radionuclides for above data:				
Dry Active Waste		Volume		Curies Shipped
Waste Class	Solidifying Agent	ft ³	m ³	Curies
A		0	0	0
B		0	0	0
C		0	0	0
All		0	0	0
Major radionuclides for above data:				
Irradiated Components		Volume		Curies Shipped
Waste Class	Solidifying Agent	ft ³	m ³	Curies
A		0	0	0
B		0	0	0
C		0	0	0
All		0	0	0
Major radionuclides for above data:				
Other Waste		Volume		Curies Shipped
Waste Class	Solidifying Agent	ft ³	m ³	Curies
A		0	0	0
B		0	0	0
C		0	0	0
All		0	0	0
Major radionuclides for above data:				

Table 3A

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
Second Half 2014 Low Level Waste Shipments

Resins, Filters and Evaporator Bottoms		Volume		Curies Shipped
Waste Class	Solidifying Agent	ft ³	m ³	Curies
A		0	0	0
B		0	0	0
C		0	0	0
All		0	0	0
Major radionuclides for above data:				
Dry Active Waste		Volume		Curies Shipped
Waste Class	Solidifying Agent	ft ³	m ³	Curies
A		0	0	0
B		0	0	0
C		0	0	0
All		0	0	0
Major radionuclides for above data:				
Irradiated Components		Volume		Curies Shipped
Waste Class	Solidifying Agent	ft ³	m ³	Curies
A		0	0	0
B		0	0	0
C		0	0	0
All		0	0	0
Major radionuclides for above data:				
Other Waste		Volume		Curies Shipped
Waste Class	Solidifying Agent	ft ³	m ³	Curies
A		0	0	0
B		0	0	0
C		0	0	0
All		0	0	0
Major radionuclides for above data:				

Appendix A

Radiation Dose Assessment

There were no gaseous or liquid effluent releases in 2014. Therefore, an assessment of radiation doses to the most likely exposed member(s) of the public to show compliance with 40CFR190 or 10CFR72.104 from effluents was not required.

Appendix B
Unplanned Releases

There were no unplanned releases of radioactive materials from the site in 2014.

Appendix C

Off-site Dose Calculation Manual Changes

There were changes to the Off-site Dose Calculation Manual in 2014. The primary change was to increase the TLD deployment period from quarterly to semi-annually. An analysis of TLD data over the past 5 years indicated very small dose totals at all monitoring locations and very little seasonal variation at any of the monitoring locations. The following table describes all the changes in the ODCM.

Section	Proposed Change	Rationale
Abstract	Updated discussions to reflect that the ODCM is addressing operations at the Maine Yankee ISFSI	The Maine Yankee Nuclear Power Station was dismantled and decommissioned in accordance with the Maine Yankee License Termination Plan. Subsequently, the Operating License was revised to reflect that the only areas that remain are those associated with the operation of the ISFSI.
Abstract, Table of Contents, 1.0, 2.0, 2.3, 3.0, and Sections 1 and 2 of Appendix A	Administrative, editorial, or grammatical changes.	Corrects the language and grammar utilized in the document.
1.0	Added references to 10 CFR 72.104(a).	10 CFR 72.104(a) is applicable to ISFSI operations.
1.0	As applicable, expanded references to 40 CFR 190 to 40 CFR 190.10(a).	The expanded references accurately reflect the correct subpart of the code.
Section 1 of Appendix A	Currently, the section requires any missing data to be submitted as soon as possible in a supplementary report. This was revised to identify that if the data is available, it will be submitted in the next annual report.	In the event that some results are not available for inclusion with the Annual Radiological Environmental Operating Report, the ODCM requires that the report note the missing data and explain the reasons for the missing results. The change relaxes the time frame for submitting any missing data. In addition, the current wording would be a compliance trap if the data was not available. These changes are administrative changes.
Table 3.1	Reduced the Frequency of Sampling from Quarterly to Semi-Annual.	Based on a review of the historical records conducted by the Radiation Protection Manager, the dose rate does not vary significantly through-out the year.