

AP1000 CORE REFERENCE REPORT
DCD (Rev. 19) Change Road Map

Change No.	Chapter 15 Section 15.2	Change Summary Description
[15.2-1]	15.2.2, Loss of External Electrical Load	Editorial changes incorporated.
[15.2-2]	15.2.3, Turbine Trip	<p>The following changes were incorporated in the updated analysis: increased $F_{\Delta H}$ limit (1.65 to 1.72), use of the digital ΔT signal, increased rod drop time for the Safety analysis and the updated valve, nozzle and piping pressure loss coefficients.</p> <p>Additionally, the moderator density function was modeled as a function of density.</p>
[15.2-3]	15.2.6, Loss of ac Power to the Plant Auxiliaries	<p>The following changes were incorporated in the updated analysis: increased $F_{\Delta H}$ limit (1.65 to 1.72), containment backpressure effects on PRHR heat transfer, increased rod drop time for the Safety analysis and the updated valve, nozzle and piping pressure loss coefficients.</p> <p>The loss of ac power to the plant auxiliaries case presented in the DCD, where feedwater flow is lost at time zero, and power to the reactor coolant pumps is lost as a result of the turbine trip, was renamed Loss of Normal Feedwater Flow with loss of offsite power and was moved into Section 15.2.7. The case presented in Section 15.2.6 now assumes a loss of reactor coolant pumps and loss of feedwater pumps at event initiation.</p>
[15.2-4]	15.2.7, Loss of Normal Feedwater Flow	<p>The following changes were incorporated in the updated analysis: increased $F_{\Delta H}$ limit (1.65 to 1.72), containment backpressure effects on PRHR heat transfer, addition of the flow skirt, increased lower core support plate flow hole size, increased pressurizer volume, increased RV diameter for the neutron pad addition, increased rod drop time for the Safety analysis and the updated valve, nozzle and piping pressure loss coefficients.</p> <p>Editorial changes were made to the loss of feedwater analyses to identify an operator action to open the safety related reactor vessel head vent to prevent filling the reactor coolant system water solid.</p> <p>An additional case, Loss of Normal Feedwater Flow with loss of offsite power was added to this section (See the description of changes for Change Number 15.2.6-1).</p>
[15.2-5]	15.2.8, Feedwater System Pipe Break	The following changes were incorporated in the updated analysis: increased $F_{\Delta H}$ limit (1.65 to 1.72), containment backpressure effects on PRHR heat transfer, addition of the flow skirt, increased lower core support plate flow hole size, increased pressurizer volume, increased RV diameter for the neutron pad addition, increased rod drop time for the Safety analysis and the updated valve, nozzle and piping pressure loss coefficients.
[15.2-6]	15.2.10 References	Added new reference, WCAP-14565 – consistent with the change to Section 15.2.3.2.1
[15.2-7]	Table 15.2-1	Updated in Revision 1 due to revised CVS makeup flows.
[15.2-8]	Figures 15.2.7-1 through 15.2.7-13	Updated in Revision 1 due to revised CVS makeup flows.

Change No.	Chapter 15 Section 15.2	Change Summary Description
[15.2-9]	15.2.7	Updated in Revision 1 due to revised CVS makeup flows.

15.2 Decrease in Heat Removal by the Secondary System

A number of transients and accidents that could result in a reduction of the capacity of the secondary system to remove heat generated in the reactor coolant system are postulated. Analyses are presented in this section for the following events that are identified as more limiting than the others:

- Steam pressure regulator malfunction or failure that results in decreasing steam flow
- Loss of external electrical load
- Turbine trip
- Inadvertent closure of main steam isolation valves
- Loss of condenser vacuum and other events resulting in turbine trip
- Loss of ac power to the station auxiliaries
- Loss of normal feedwater flow
- Feedwater system pipe break

The above items are considered to be Condition II events, with the exception of a feedwater system pipe break, which is considered to be a Condition IV event.

The radiological consequences of the accidents in this section are bounded by the radiological consequences of a main steam line break (see subsection 15.1.5).

15.2.1 Steam Pressure Regulator Malfunction or Failure that Results in Decreasing Steam Flow

There are no steam pressure regulators in the AP1000 whose failure or malfunction causes a steam flow transient.

15.2.2 Loss of External Electrical Load

Comment [B1]: [15.2-1]

15.2.2.1 Identification of Causes and Accident Description

A major load loss on the plant can result from a loss of electrical load due to an electrical system disturbance. The ac power remains available to operate plant components such as the reactor coolant pumps; as a result, the standby onsite diesel generators do not function for this event. Following the loss of generator load, an immediate fast closure of the turbine control valves occurs. The automatic turbine bypass system accommodates the excess steam generation. Reactor coolant temperatures and pressure do not significantly increase if the turbine bypass system and pressurizer pressure control system function properly. If the condenser is not available, the excess steam generation is relieved to the atmosphere. Additionally, main feedwater flow is lost if the condenser is not available. For this transient, feedwater flow is maintained by the startup feedwater system.

15.2-1

For a loss of electrical load without subsequent turbine trip, no direct reactor trip signal is generated. The plant trips from the protection and safety monitoring system if a safety limit is approached. A continued steam load of approximately 5 percent exists after total loss of external electrical load because of the steam demand of plant auxiliaries.

If a safety limit is approached, protection is provided by high pressurizer pressure, high pressurizer water level, and overtemperature ΔT trips. Voltage and frequency relays associated with the reactor coolant pump provide no additional safety function for this event. Following a complete loss of external electrical load, the maximum turbine overspeed is not expected to affect the voltage and frequency sensors. Any increased frequency to the reactor coolant pump motors results in a slightly increased flow rate and subsequent additional margin to safety limits. For postulated loss of load and subsequent turbine-generator overspeed, an overfrequency condition is not seen by the protection and safety monitoring system equipment or other safety-related loads. Safety-related loads and the protection and safety monitoring system equipment are supplied from the 120-Vac instrument power supply system, which in turn is supplied from the inverters. The inverters are supplied from a dc bus energized from batteries or by a regulated ac voltage.

If the steam dump valves fail to open following a large loss of load, the steam generator safety valves may lift and the reactor may be tripped by the high pressurizer pressure signal, the high pressurizer water level signal, or the overtemperature ΔT signal. This would cause steam generator shell side pressure and reactor coolant temperature to increase rapidly. However, the pressurizer safety valves and steam generator safety valves are sized to protect the reactor coolant system and steam generator against overpressure for load losses, without assuming the operation of the turbine bypass system, pressurizer spray, or automatic rod cluster control assembly control.

The steam generator safety valve capacity is sized to remove the steam flow at the nuclear steam supply system thermal rating from the steam generator, without exceeding 110 percent of the steam system design pressure. The pressurizer safety valve capacity is sized to accommodate a complete loss of heat sink, with the plant initially operating at the maximum turbine load. The pressurizer safety valves can then relieve sufficient steam to maintain the reactor coolant system pressure within 110 percent of the reactor coolant system design pressure.

Deleted: along with operation of the steam generator safety valves.

A discussion of overpressure protection can be found in WCAP-7769, Revision 1 (Reference 1) and WCAP-16779 (Reference 9).

Deleted: 8

A loss-of-external-load event is classified as a Condition II event, fault of moderate frequency.

A loss-of-external-load event results in a plant transient that is bounded by the turbine trip event analyzed in subsection 15.2.3. Therefore, a detailed transient analysis is not presented for the loss-of-external-load event.

The primary side transient is caused by a decrease in heat transfer capability, from primary to secondary, due to a rapid termination of steam flow to the turbine, accompanied by an automatic reduction of feedwater flow (should feedwater flow not be reduced, a larger heat sink is available and the transient is less severe). Reduction of steam flow to the turbine following a loss-of-external load event occurs due to automatic fast closure of the turbine control valves. Following a turbine trip event, termination of steam flow occurs via turbine stop valve closure, which occurs in approximately 0.15 seconds. The transient in primary pressure, temperature, and water volume is less severe for the loss-of-external-load event than for the turbine trip due to a slightly slower loss of heat transfer capability.

The protection available to mitigate the consequences of a loss-of-external-load event is the same as that for a turbine trip, as listed in Table 15.0-6.

15.2.2.2 Analysis of Effects and Consequences

Refer to subsection 15.2.3.2 for the method used to analyze the limiting transient (turbine trip) in this grouping of events. The results of the turbine trip event analysis bound those expected for the loss-of-external-load event, as discussed in subsection 15.2.2.1.

Plant systems and equipment that may be required to function in order to mitigate the effects of a complete loss of load are discussed in subsection 15.0.8 and listed in Table 15.0-6.

The protection and safety monitoring system may be required to terminate core heat input and to prevent departure from nucleate boiling (DNB). Depending on the magnitude of the load loss, pressurizer safety valves and/or steam generator safety valves may open to maintain system pressures below allowable limits. No single active failure prevents operation of any system required to function. Normal plant control systems and engineered safety systems are not required to function. The passive residual heat removal (PRHR) system may be automatically actuated following a loss of main feedwater, further mitigating the effects of the transient.

15.2.2.3 Conclusions

Based on results obtained for the turbine trip event and considerations described in subsection 15.2.2.1, the applicable Standard Review Plan, subsection 15.2.1, evaluation criteria for a loss-of-external-load event, are met (see subsection 15.2.3).

15.2.3 Turbine Trip

Comment [B2]: [15.2-2]

15.2.3.1 Identification of Causes and Accident Description

The turbine stop valves close rapidly (about 0.15 seconds) on loss of trip fluid pressure actuated by one of a number of possible turbine trip signals. Turbine trip initiation signals include:

- Generator trip
- Low condenser vacuum
- Loss of lubricating oil
- Turbine thrust bearing failure
- Turbine overspeed
- Manual trip
- Reactor trip

Upon initiation of stop valve closure, steam flow to the turbine stops abruptly. Sensors on the stop valves detect the turbine trip and initiate turbine bypass. The loss of steam flow results in a rapid increase in secondary system temperature and pressure, with a resultant primary system transient, described in subsection 15.2.2.1, for the loss-of-external-load event. A slightly more severe transient occurs for the turbine trip event due to the rapid loss of steam flow caused by the abrupt valve closure.

The automatic turbine bypass system accommodates up to 40 percent of rated steam flow. Reactor coolant temperatures and pressure do not increase significantly if the turbine bypass system and pressurizer pressure control system are functioning properly. If the condenser is not available, the excess steam generation is relieved to the atmosphere and main feedwater flow is lost. For this situation, feedwater flow is maintained by the startup feedwater system to provide adequate residual and decay heat removal capability. Should the turbine bypass system fail to operate, the steam generator safety valves may lift to provide pressure control. See subsection 15.2.2.1 for a further discussion of the transient.

A turbine trip is classified as a Condition II event, fault of moderate frequency.

A turbine trip is a more limiting than a loss-of-external-load event, loss of condenser vacuum, and other events which result in a turbine trip. As such, this event is analyzed and presented in subsection 15.2.3.2.

15.2.3.2 Analysis of Effects and Consequences

15.2.3.2.1 Method of Analysis

In this analysis, the behavior of the unit is evaluated for a complete loss of steam load from 100 percent of full power, without rapid power reduction, primarily to show the adequacy of the pressure-relieving devices, and to demonstrate core protection margins. The turbine is assumed to trip without actuating the rapid power reduction system. This assumption delays reactor trip until conditions in the reactor coolant system result in a trip due to other signals. Thus, the analysis assumes a bounding transient. In addition, no credit is taken for the turbine bypass system. Main feedwater flow is terminated at the time of turbine trip, with no credit taken for startup feedwater or the PRHR heat exchanger (except for long-term recovery) to mitigate the consequences of the transient.

In meeting the requirements of GDC 17 of 10 CFR Part 50, Appendix A, analyses are performed to evaluate the effects produced by a possible consequential loss of offsite power during a complete loss of steam load. As discussed in subsection 15.0.14, the loss of offsite power is considered as a direct consequence of a turbine trip occurring while the plant is operating at power. The primary effect of the loss of offsite power is to cause the reactor coolant pumps to coast down.

The turbine trip transients are analyzed by using a modified version of the LOFTRAN code (Reference 2), as described in Reference 6. The program simulates the neutron kinetics, reactor coolant system, pressurizer, pressurizer safety valves, pressurizer spray, steam generator, and steam generator safety valves. The program computes pertinent plant variables, including temperatures, pressures, and power level.

Deleted: computer program

Deleted:).

In the turbine trip analyses, which include a primary coolant flow coastdown caused by a consequential loss of offsite power, a combination of three computer codes is used to perform the departure from nucleate boiling ratio (DNBR) analyses. First, the LOFTRAN code (References 2 and 6) is used to calculate the plant system transient. The FACTRAN code (Reference 7) or the VIPRE-01 fuel rod model (Reference 8), which is equivalent to FACTRAN, is then used to calculate the core heat flux based on nuclear power and reactor coolant flow from LOFTRAN. Finally, the VIPRE-01 code (see Section 4.4) is used to calculate the DNBR using heat flux from FACTRAN (or VIPRE-01 fuel rod model) and flow from LOFTRAN.

Deleted: that

The major assumptions used in the analysis are summarized below.

Initial Operating Conditions

Two sets of initial operating conditions are used. Cases performed to evaluate the minimum DNBR obtained are analyzed using the revised thermal design procedure. Initial core power, reactor coolant temperature, and pressure are assumed to be at their nominal values consistent with steady-state full-power operation. Uncertainties in initial conditions are included in the DNBR limit as described in WCAP-11397-P-A (Reference 5). Instrument bias on the RCS temperature signal is also considered to ensure it is reflected in either the modeled initial conditions or in the safety analysis DNBR limit value.

Cases performed to evaluate the maximum calculated RCS pressure include uncertainties on the initial conditions. Initial core power, reactor coolant temperature, and pressure are assumed to be at the nominal full-power values plus or minus uncertainties. The direction of the uncertainties is chosen to maximize the RCS pressure.

Reactivity Coefficients

Two cases are analyzed:

- Minimum reactivity feedback – A least-negative moderator temperature coefficient and a least-negative Doppler-only power coefficient are assumed (see Figure 15.0.4-1).
- Maximum reactivity feedback – A conservatively large negative moderator temperature coefficient and a most-negative Doppler-only power coefficient are assumed (see Figure 15.0.4-1).

Rod Control

From the standpoint of the maximum RCS pressure and minimum DNBR attained, it is conservative to assume that the reactor is in manual rod control. If the reactor is in automatic rod control, the control rod banks move prior to trip and reduce the severity of the transient.

Deleted: Reactor

Deleted: pressures

Steam Release

No credit is taken for the operation of the turbine bypass system or steam generator power-operated relief valves. The steam generator pressure rises to the safety valve setpoint where steam release through safety valves limits secondary steam pressure at the setpoint value.

Pressurizer Spray

Two cases for both the minimum and maximum reactivity feedback cases are analyzed:

- Full credit is taken for the effect of pressurizer spray in reducing or limiting the coolant pressure. Safety valves are also available. These cases are analyzed primarily to address DNBR concerns.
- No credit is taken for the effect of pressurizer spray in reducing or limiting the coolant pressure. Safety valves are operable. These cases are analyzed to address RCS overpressure concerns.

Feedwater Flow

Main feedwater flow to the steam generators is assumed to be lost at the time of turbine trip. No credit is taken for startup feedwater flow or the PRHR heat exchanger, because a stabilized plant condition is reached before initiation of the startup feedwater or the PRHR heat exchanger is normally assumed to occur. The startup feedwater flow or PRHR heat exchanger ~~removes core~~

Deleted: remove

Reactor Trip

Reactor trip is actuated by the first reactor trip setpoint reached, with no credit taken for the rapid power reduction on the turbine trip. Trip signals are expected due to high pressurizer pressure, overtemperature ΔT , low RCP speed, high pressurizer water level, ~~or low steam generator water~~

Deleted: and

Plant characteristics and initial conditions are further discussed in subsection 15.0.3. Plant systems and equipment that may be required to function in order to mitigate the effects of a turbine trip event are discussed in subsection 15.0.8 and listed in Table 15.0-6.

The protection and safety monitoring system may be required to function following a turbine trip. Pressurizer safety valves and/or steam generator safety valves may be required to open to maintain system pressures below allowable limits. No single active failure prevents operation of systems required to function. Cases are analyzed, both with and without the operation of pressurizer spray, to determine the worst case for presentation.

Availability of Offsite Power

Each case is analyzed with and without offsite power available. As discussed in subsection 15.0.14, the loss of offsite power is considered to be a consequence of an event due to

disruption of the electrical grid following a turbine trip during the event. The grid is assumed to remain stable for 3 seconds following the turbine trip. In the analysis for the complete loss of steam load, the event is initiated by a turbine trip. Therefore, offsite power is assumed to be lost 3 seconds after the start of the event. For the loss of steam load analysis, the primary impact of the loss of offsite power is a coastdown of the reactor coolant pumps.

Main Steam System Pressure

Additional cases are performed to evaluate the maximum Main Steam System (MSS) pressure, with initial condition uncertainties chosen to maximize MSS pressure. The additional cases include cases with and without offsite power available for minimum and maximum reactivity feedback.

15.2.3.2.2 Results

The transient responses for a turbine trip from 100 percent of full-power operation are shown for eight cases. The eight analysis cases are performed assuming minimum and maximum reactivity feedback, with and without credit for pressurizer spray, and with and without offsite power available. The results of the analyses are shown in Figures 15.2.3-1 through 15.2.3-26. The calculated sequence of events for the accident is shown in Table 15.2-1.

Minimum Reactivity Feedback, With Pressurizer Spray, With and Without Offsite Power Available

Figures 15.2.3-1 through 15.2.3-7 show the transient responses for two cases analyzed for DNBR concerns, with and without offsite power available. In the case with offsite power available, the reactor is tripped by the overtemperature ΔT trip function. The transient DNBR is shown in Figure 15.2.3-6; the minimum DNBR remains above the safety analysis DNBR limit value at all times. Based on this, the DNB design basis defined in Section 4.4 is met.

The case without offsite power is tripped by the low reactor coolant pump speed trip function. The minimum DNBR remains above the safety analysis DNBR limit value at all times, as shown in Figure 15.2.3-6; therefore, the DNBR design basis defined in Section 4.4 is met. This case is the limiting case with respect to the DNBR margin of the turbine trip cases.

Maximum Reactivity Feedback, With Pressurizer Spray, With and Without Offsite Power Available

Figures 15.2.3-8 through 15.2.3-14 show the transient responses for the other two cases analyzed for DNBR concerns, with and without offsite power available. In the case with offsite power available, the reactor is tripped by the overtemperature ΔT trip function. The transient DNBR

Deleted: Without

Deleted: ¶

Deleted: The results for these cases are shown in Figures 15.2.3-15 through 15.2.3-20. In the case with offsite power available, the reactor is tripped by the high pressurizer pressure trip function. The pressure safety valves are actuated in this case and maintain the reactor coolant system pressure below 110 percent of the design value. The DNB design basis defined in Section 4.4 is met for this case.¶

... [1]

Deleted: high pressurizer pressure

Deleted: Pressurizer pressure is shown in Figure 15.2.3-2, and ... [2]

Deleted: for the case with offsite power

Deleted: , and

Deleted: DNB

Deleted: most

Deleted: DNB

Deleted: loss of steam load

Deleted: The pressurizer pressure is shown in ... [3]

Deleted: high pressurizer pressure

Deleted: The pressure safety valves are actuated in this case and ... [4]

for the case, is shown in Figure 15.2.3-13; the minimum DNBR remains above the safety analysis DNBR limit value at all times. Based on this, the DNBR design basis defined in Section 4.4 is met for this case.

The case without offsite power is tripped by the low reactor coolant pump speed trip function. The DNBR transient is similar to, and bounded by, the minimum feedback case with pressurizer spray and without offsite power discussed above. The minimum DNBR remains above the safety analysis DNBR limit value at all times, as shown in Figure 15.2.3-13; therefore the DNBR design basis defined in Section 4.4 is met.

Minimum Reactivity Feedback, Without Pressurizer Spray, With and Without Offsite Power Available

The results for these cases analyzed to address RCS pressure concerns are shown in Figure 15.2.3-15 through 15.2.3-20. In the case with offsite power available, the reactor is tripped by the high pressurizer pressure trip function. The pressurizer safety valves are actuated in this case and maintain the reactor coolant system pressure below 110 percent of the design value.

If offsite power is lost, the reactor is tripped by the low reactor coolant pump speed reactor trip function. Offsite power is assumed to be lost 3 seconds after turbine trip. This causes a reduction in the reactor coolant system flow, which is illustrated in Figure 15.2.3-20.

The pressurizer safety valves actuate in both of these cases and maintain the reactor coolant system pressure below 110 percent of the design value. RCS pressure for these cases is shown in Figure 15.2.3-16. Note that the with and without power cases have different assumptions regarding initial pressure. The initial pressure assumptions were based upon sensitivities that were run. With respect to maximum reactor coolant system pressure, this case with offsite power available is the most limiting for turbine trip cases.

Maximum Reactivity Feedback, Without Pressurizer Spray, With and Without Offsite Power Available

Figures 15.2.3-21 through 15.2.3-26 show the transient responses for the two other cases analyzed to address RCS pressure concerns, with and without offsite power available. In the case with offsite power available, the reactor is tripped by the high pressurizer pressure function.

The case without offsite power is tripped by the low reactor coolant pump speed trip function. RCS pressure for both cases is shown in Figure 15.2.3-22; the pressure within the reactor coolant system is maintained below 110 percent of the design value. Note that with and without

Deleted: with offsite power available

Deleted: The DNB

Deleted: DNB

Deleted: .

Deleted: DNB

Deleted: i

Deleted: The pressurizer pressure is shown in Figure 15.2.3-9, and the pressure within the reactor coolant system is maintained below 110 percent of the design value. Maximum

Deleted: Figures 15.2.3-21

Deleted: -26 show the transient responses with and without offsite power available.

Deleted: Pressurizer pressure

Deleted: shown in Figure 15.2.3-22, and the pressure within

Deleted: maintained

Deleted: The DNB design basis defined in Section 4.4 is met for this case

Deleted: The DNB transient is similar to, and bounded by, the minimum feedback case with pressurizer spray and without offsite power. The DNB design basis defined in Section 4.4 is met. The pressurizer pressure

Deleted: and

power cases have different assumptions regarding initial pressure. The initial pressure assumptions were based upon sensitivities that were run.

The additional cases performed to address maximum MSS pressure concerns confirm that the steam generator safety valves provide sufficient pressure relief to prevent overpressurization of the MSS.

15.2.3.3 Conclusions

Results of the analyses show that a turbine trip presents no challenge to the integrity of the reactor coolant system or the main steam system. Pressure-relieving devices incorporated in the two systems are adequate to limit the maximum pressures to within the design limits.

The analyses show that the predicted DNBR is greater than the safety analysis DNBR limit value at any time during the transient. Thus, the departure from nucleate boiling design basis, as described in Section 4.4, is met.

Deleted: design

15.2.4 Inadvertent Closure of Main Steam Isolation Valves

Inadvertent closure of the main steam isolation valves results in a turbine trip with no credit taken for the turbine bypass system. Turbine trips are discussed in subsection 15.2.3.

15.2.5 Loss of Condenser Vacuum and Other Events Resulting in Turbine Trip

Loss of condenser vacuum is one of the events that can cause a turbine trip. Turbine trip initiating events are described in subsection 15.2.3. A loss of condenser vacuum prevents the use of steam dump to the condenser. Because steam dump is assumed to be unavailable in the turbine trip analysis, no additional adverse effects result if the turbine trip is caused by loss of condenser vacuum. Therefore, the analysis results and conclusions contained in subsection 15.2.3 apply to the loss of the condenser vacuum. In addition, analyses for the other possible causes of a turbine trip, listed in subsection 15.2.3.1, are covered by subsection 15.2.3. Possible overfrequency effects, due to a turbine overspeed condition, are discussed in subsection 15.2.2.1 and are not a concern for this type of event.

15.2.6 Loss of ac Power to the Plant Auxiliaries

Comment [B3]: [15.2-3]

15.2.6.1 Identification of Causes and Accident Description

The loss of power to the plant auxiliaries is caused by a complete loss of the offsite grid accompanied by a turbine-generator trip. The onsite standby ac power system remains available but is not credited to mitigate the accident.

From the decay heat removal point of view, in the long term this transient is more severe than the turbine trip event analyzed in subsection 15.2.3 because, for this case, the decrease in heat removal by the secondary system is accompanied by a reactor coolant flow coastdown, which further reduces the capacity of the primary coolant to remove heat from the core. The reactor will trip:

- Upon reaching one of the trip setpoints in the primary or secondary systems as a result of the flow coastdown and decrease in secondary heat removal.
- Due to the loss of power to the control rod drive mechanisms as a result of the loss of power to the plant.

Following a loss of ac power with turbine and reactor trips, the sequence described below occurs:

- Plant vital instruments are supplied from the Class 1E and uninterruptable power supply.
- As the steam system pressure rises following the trip, the steam generator power-operated relief valves may be automatically opened to the atmosphere. The condenser is assumed not to be available for turbine bypass. If the steam flow rate through the power-operated relief valves is not available, the steam generator safety valves may lift to dissipate the sensible heat of the fuel and coolant plus the residual decay heat produced in the reactor.
- The onsite standby power system, if available, supplies ac power to the selected plant non-safety loads.
- As the no-load temperature is approached, the steam generator power-operated relief valves (or safety valves, if the power-operated relief valves are not available) are used to dissipate the residual decay heat and to maintain the plant at the hot shutdown condition if the startup feedwater is available to supply water to the steam generators.
- If startup feedwater is not available, the PRHR heat exchanger is actuated.

During a plant transient, core decay heat removal is normally accomplished by the startup feedwater system if available, which is started automatically when low levels occur in either steam generator. If that system is not available, emergency core decay heat removal is provided by the PRHR heat exchanger. The PRHR heat exchanger is a C-tube heat exchanger connected, through inlet and outlet headers, to the reactor coolant system. The inlet to the heat exchanger is from the reactor coolant system hot leg, and the return is to the steam generator outlet plenum. The heat exchanger is located above the core to provide natural circulation flow when the reactor coolant pumps are not operating. The IRWST provides the heat sink for the heat exchanger. The PRHR heat exchanger, in conjunction with the passive containment cooling system, keeps the

reactor coolant subcooled indefinitely. After the IRWST water reaches saturation, steam starts to vent to the containment atmosphere. The condensation that collects on the containment steel shell (cooled by the passive containment cooling system) returns to the IRWST, maintaining fluid level for the PRHR heat exchanger heat sink. The analysis shows that the natural circulation flow in the reactor coolant system following a loss of ac power event is sufficient to remove residual heat from the core.

Deleted: (in about two and half hours),

Upon the loss of power to the reactor coolant pumps, coolant flow necessary for core cooling and the removal of residual heat is maintained by natural circulation in the reactor coolant and PRHR loops.

A loss of ac power to the plant auxiliaries is a Condition II event, a fault of moderate frequency. This event is more limiting with respect to long-term heat removal than the turbine trip initiated decrease in secondary heat removal without loss of ac power, which is discussed in subsection 15.2.3. A loss of offsite power to the plant auxiliaries will also result in a loss of normal feedwater.

The plant systems and equipment available to mitigate the consequences of a loss of ac power event are discussed in subsection 15.0.8 and listed in Table 15.0-6.

15.2.6.2 Analysis of Effects and Consequences

15.2.6.2.1 Method of Analysis

The analysis is performed to demonstrate the adequacy of the protection and safety monitoring system, the PRHR heat exchanger, and the reactor coolant system natural circulation capability in removing long-term (approximately 36,000 seconds) decay heat. This analysis also demonstrates the adequacy of these systems in preventing excessive heatup of the reactor coolant system with possible reactor coolant system overpressurization or loss of reactor coolant system water.

A modified version of the LOFTRAN code (Reference 2), described in WCAP- 15644 (Reference 6), is used to simulate the system transient following a plant loss of offsite power. The simulation describes the plant neutron kinetics and reactor coolant system, including the natural circulation, pressurizer, and steam generator system responses. The digital program computes pertinent variables, including the steam generator level, pressurizer water level, and reactor coolant average temperature.

The assumptions used in this analysis minimize the energy removal capability of the PRHR heat exchanger and maximize the coolant system expansion.

Deleted: The transient response of the plant following a loss of ac power to plant auxiliaries is similar to the loss of normal feedwater flow accident (see subsection 15.2.7), except that power is assumed to be lost to the reactor coolant pumps at the time of the reactor trip.¶

The assumptions used in the analysis are as follows:

- The plant is initially operating at 101 percent of the design power rating with initial reactor coolant temperature 8°F below the nominal value and the pressurizer pressure 50 psi above the nominal value.
- Core residual heat generation is based on ANSI 5.1 (Reference 3). ANSI 5.1 is a conservative representation of the decay energy release rates.
- Reactor trip occurs on RCP speed-low
- A heat transfer coefficient is assumed in the steam generator associated with reactor coolant system natural circulation flow conditions following the reactor coolant pump coastdown.
- The PRHR heat exchanger is actuated by the low steam generator water level (narrow range coincident with low start up feed water flow).
- For the loss of ac power to the station auxiliaries and following reactor trip, the main safety function required is core decay heat removal. That is accomplished by the secondary steam relief through the steam generator safety valves and the PRHR heat exchanger. One of two parallel valves in the PRHR outlet line is assumed to fail to open. This is the worst single failure.
- The pressurizer safety valves are assumed to function.

Plant characteristics and initial conditions are further discussed in subsection 15.0.3.

Plant systems and equipment necessary to mitigate the effects of a loss of ac power to the station auxiliaries are discussed in subsection 15.0.8 and listed in Table 15.0-6. Normal reactor control systems are not required to function. The protection and safety monitoring system is required to function following a loss of ac power. The PRHR heat exchanger is required to function with an overall minimum capability to extract heat from the reactor coolant system. No single active failure prevents operation of any system required to function.

Parameters used in the analysis are selected to maximize the pressurizer water volume. Input parameters are not selected to maximize the transient primary side and secondary side pressure. Transient primary side and secondary side pressures during a loss of ac power to station auxiliaries are bounded by those calculated for the turbine trip analyses presented in Section 15.2.3

Deleted: 102

Deleted: 7°F

Deleted: The main feedwater flow measurement supports a 1-percent power uncertainty; use of a 2-percent power uncertainty is conservative.

Deleted: <#>Reactor trip occurs on steam generator low level (narrow range). Offsite power is assumed to be lost at the time of reactor trip. This is more conservative than the case in which offsite power is lost at time zero because of the lower steam generator water mass at the time of the reactor trip.

Deleted: only

Deleted: <#>Secondary system steam relief is achieved through the steam generator safety valves.

Deleted: <#>

Deleted: a

Deleted: heat transfer

Deleted: .

Deleted: The DNB analysis is not specifically addressed for this event since, from the point of view of DNBR transient, the loss of ac power to auxiliaries is similar and bounded by the Turbine Trip event analyzed in subsection 15.2.3. In fact, the Turbine Trip is analyzed assuming that, following the turbine trip, a loss of ac power

[5]

With respect to DNB concerns, the loss of ac power to station auxiliaries event is bounded by the loss of ac power case analyzed for the turbine trip event presented in Section 15.2.3.

15.2.6.2.2 Results

The transient response of the reactor coolant system following a loss of ac power to the plant auxiliaries is shown in Figures 15.2.6-1 through 15.2.6-12. The calculated sequence of events for this event is listed in Table 15.2-1.

The loss of ac power event results in a pressurizer water volume increase until the actuation of the steam generator safety valves. Actuation of the steam generator safety valves attenuates the pressurizer water volume until actuation of the PRHR which turns around the pressurizer water volume increase. PRHR heat extraction and steam generator safety valve relief results in a consequential decrease in the water volume until the safety valve relief stops. After the steam generator safety valve flow stops the pressurizer water volume begins a slight increase until the PRHR heat extraction matches and then exceeds the decay heat addition resulting in a reduction in the pressurizer water volume.

15.2.6.3 Conclusions

Results of the analysis show that for the loss of ac power to plant auxiliaries event, all safety criteria are met. The heat extraction provided by the steam relief capacity of the steam generator safety valves and the operation of the PRHR is sufficient to prevent water relief through the pressurizer safety valves.

The analysis demonstrates that sufficient long-term reactor coolant system heat removal capability exists, via the steam generator safety valves, natural circulation and the PRHR heat exchanger, following reactor coolant pump coastdown to prevent fuel or cladding damage and reactor coolant system overpressure.

15.2.7 Loss of Normal Feedwater Flow

15.2.7.1 Identification of Causes and Accident Description

A loss of normal feedwater (from pump failures, valve malfunctions, or loss of ac power sources) results in a reduction in the capability of the secondary system to remove the heat generated in the reactor core. If startup feedwater is not available, the safety-related PRHR heat exchanger is automatically aligned by the protection and safety monitoring system to remove decay heat.

Deleted: The LOFTRAN code results show that the natural circulation flow and the PRHR system are sufficient to provide adequate core decay heat removal following reactor trip and reactor coolant pump coastdown.¶ Immediately following the reactor trip, the heat transfer capability of the PRHR heat exchanger and the steam generator heat extraction rate are sufficient to slowly cool down the plant. The cooldown continues until a low T_{cold} "S" signal is reached. The "S" signal actuates the core makeup tanks. During this transient, the core makeup tanks operate in water recirculation mode. The cold borated water injected by the core makeup tanks accelerates the cooldown of the plant. The core makeup tank flow slowly decreases as the core makeup tanks ... [6]

Deleted:

Deleted:

Deleted: s

Deleted: ¶

Pressurizer safety valves open to discharge steam to containment and reclose later in the transient ... [7]

Deleted: PRHR heat exchanger capacity

Comment [B4]: [15.2-4]

Comment [B5]: [15.2-9]

A small secondary system break can affect normal feedwater flow control, causing low steam generator levels prior to protective actions for the break. This scenario is addressed by the assumptions made for the feedwater system pipe break (see subsection 15.2.8).

The following occurs upon loss of normal feedwater (assuming main feedwater pump fails or valve malfunctions):

- The steam generator water inventory decreases as a consequence of the continuous steam supply to the turbine. The mismatch between the steam flow to the turbine and the feedwater flow leads to the reactor trip on a low steam generator water level signal. The same signal also actuates the startup feedwater system (see subsection 15.2.6.1).
- As the steam system pressure rises following the trip, the steam generator power-operated relief valves are automatically opened to the atmosphere. The condenser is assumed to be unavailable for turbine bypass. If the steam flow path through the power-operated relief valves is not available, the steam generator safety valves may lift to dissipate the sensible heat of the fuel and coolant plus the residual decay heat produced in the reactor.
- As the no-load temperature is approached, the steam generator power-operated relief valves (or safety valves, if the power-operated relief valves are not available) are used to dissipate the decay heat and to maintain the plant at the hot shutdown condition, if the startup feedwater is used to supply water to the steam generator.
- If startup feedwater is not available, the PRHR heat exchanger is actuated on either a low steam generator water level (narrow range), coincident with a low startup feedwater flow rate signal or a low steam generator water level (wide range) signal.
- The PRHR heat exchanger extracts heat from the reactor coolant system leading to an "S" signal on a Low T_{cold} signal. This actuates the core makeup tanks. Both core makeup tanks inject mass into the reactor coolant system and the pressurizer level continues to increase until the operators take action to end the pressurizer level increase transient. The operators are assumed to be alerted that a potential filling event is occurring on the high-2 pressurizer level signal. The operator action assumed in the analysis is to open the reactor vessel head vent following receipt of the high-3 pressurizer level signal; this action is at least 30 minutes after the operator has been alerted by the high-2 pressurizer level signal. When the head vent is opened, the pressurizer level increase slows and ultimately the level begins to decrease.

Deleted: The PRHR heat exchanger transfers the core decay heat and sensible heat to the IRWST so that core heat removal is uninterrupted following a loss of normal and startup feedwater (see subsection 15.2.6).

Deleted: 2

A loss-of-normal-feedwater event is classified as a Condition II event, a fault of moderate frequency.

15.2.7.2 Analysis of Effects and Consequences

The analysis is performed to demonstrate the adequacy of the protection and safety monitoring system, and the capability of the PRHR heat exchanger in removing long-term (approximately 36,000 seconds) decay heat following a loss of normal feedwater. Those systems in conjunction with the operator action to open the reactor head vent show that the loss of water from the reactor coolant system is prevented. This analysis also demonstrates the adequacy of these systems in preventing excessive heatup of the reactor coolant system with possible reactor coolant system overpressurization.

Deleted: An

Deleted: transient is presented below to show that, following a loss of normal feedwater, the

Deleted: is capable of

Deleted: the stored and

Deleted: prevent either overpressurization of the

Deleted: coolant system or

15.2.7.2.1 Method of Analysis

An analysis using a modified version of the LOFTRAN code (Reference 2), described in WCAP-15644 (Reference 6), is performed to obtain the plant transient following a loss of normal feedwater. The simulation describes the neutron kinetics, reactor coolant system (including the natural circulation), pressurizer, and steam generators. The program computes pertinent variables, including the steam generator level, pressurizer water level, and reactor coolant average temperature.

Two cases are analyzed. One case assumes a consequential loss of ac power to the plant auxiliaries resulting from the turbine trip after reactor trip. The loss of ac power results in a coast down of the reactor coolant pumps. A second case does not assume the consequential loss of ac power, which maintains the reactor coolant pumps at normal speed until automatically tripped when the core makeup tanks are actuated.

The assumptions used in the analysis are as follows:

- The plant is initially operating at 101 percent of the design power rating.
- Reactor trip occurs on steam generator low (narrow range) level.
- The principle safety function required after reactor trip is the core decay heat removal. That function is carried out by the PRHR heat exchanger. The worst single failure is assumed to occur in the PRHR heat exchanger. The actuation of the PRHR heat exchanger requires the opening of one of the two fail-open valves arranged in parallel at the PRHR heat exchanger discharge. Because no single failure can be assumed that impairs the opening of both valves, the failure of a single valve is assumed.

Deleted: 102

Deleted: The main feedwater flow measurement supports a 1-percent power uncertainty; use of a 2-percent power uncertainty is conservative.

Deleted: only

Deleted: that

Deleted: ; therefore,

The PRHR heat exchanger is actuated by the low steam generator water level narrow range signal, coincident with low start up feedwater flow or by the low steam generator water level wide range signal.

- Plant cool down with the PRHR heat exchanger may cause a reduction in the low cold leg temperature such that the Safeguards setpoint is reached which will actuate the core makeup tanks. The additional borated fluid added by the core makeup tanks may cause excessive pressurizer water volume. Prevention of pressurizer filling is accomplished by an operator action to open the reactor head vent.
- Secondary system steam relief is achieved through the steam generator safety valves.
- The initial reactor coolant average temperature is 8°F lower than the nominal value, and initial pressurizer pressure is 50 psi lower than nominal.

The loss of normal feedwater analyses are performed to demonstrate the adequacy of the protection and safety monitoring system and the PRHR heat exchanger in removing long-term decay heat. Such decay heat removal prevents excessive heatup of the reactor coolant system with possible resultant reactor coolant system overpressurization or loss of reactor coolant system water. The assumptions used in this analysis minimize the energy removal capability of the system, and maximize the coolant system expansion.

With respect to the overpressure evaluation, the loss of normal feedwater transient with and without ac power available events are bounded by the turbine trip event.

Plant characteristics and initial conditions are further discussed in subsection 15.0.3.

Plant systems and equipment necessary to mitigate the effects of a loss of normal feedwater accident are discussed in subsection 15.0.8 and listed in Table 15.0-6. Normal reactor control systems are not required to function. The protection and safety monitoring system is required to function following a loss of normal feedwater. The PRHR heat exchanger is required to function with an overall minimum capability to extract heat from the reactor coolant system. No single active failure prevents operation of any system to perform its required function.

15.2.7.2.2 Results

Figures 15.2.7-1 through 15.2.7-13 show the significant plant parameters following a loss of normal feedwater.

The loss of main feedwater results in an increase in the pressurizer water volume until reactor trip on low steam generator water level (narrow range). The pressurizer water volume then decreases briefly due to the reactor trip. Later in the transient, the pressurizer water level decreases again when the steam generator safety valves open. Steam relief and a consequential reduction in the pressurizer water volume continues until the steam generator pressure falls below the safety

Deleted: 7°F

Deleted: analysis is

Deleted: and preventing

Deleted: For the loss of normal feedwater transient, the reactor coolant volumetric flow remains at its normal value and the reactor trips via the low steam generator narrow range level trip. The reactor coolant pumps continue to run until automatically tripped when the core makeup tanks are actuated.¶

... [8]

Deleted: a

Deleted: heat transfer

Deleted: .

Deleted: A discussion of anticipated transients without scram considerations is presented in Section 15.8.

... [9]

Deleted: 10

Deleted: Prior to reactor trip and the insertion of the rods into the core, the loss of normal feedwater transient is the same as the transient response presented in subsection 15.2.6 for the loss of ac power to plant auxiliaries. The DNB results, presented in Figure 15.2.6-12 for the loss of ac power to plant auxiliaries, are also

... [10]

Deleted: ¶

Deleted: reduction in nuclear power and then increases

... [11]

Deleted: pressurizer

valve setpoints stopping the steam relief. The pressurizer water volume then increases until the PRHR actuates.

The capacity of the PRHR heat exchanger, when the reactor coolant pumps are operating, is much larger than the decay heat, and in the first part of the transient, the reactor coolant system is cooled down and the pressurizer pressure and water volume decrease. The cool down continues until the reactor coolant temperature reaches the low T_{cold} setpoint. When the low T_{cold} setpoint is reached, the reactor coolant pumps are tripped and the core makeup tanks are actuated.

The pressurizer water volume then increases due to the cold borated water injected by the core makeup tanks and the reduced PRHR efficiency due to the loss of forced flow resulting from the reactor coolant pump trip. Pressurizer water volume increases during this period. The operators are alerted to the pressurizer level increase when the level exceeds the high-2 pressurizer level setpoint. The operator action assumed in the analysis is to open the reactor vessel head vent following receipt of the high-3 pressurizer level signal; this action is at least 30 minutes after the operator has been alerted by the high-2 pressurizer level signal. After that point, the pressurizer water volume begins to decrease.

The DNBR transient for the loss of normal feedwater event is shown in Figure 15.2.7-12.

The calculated sequence of events for this accident is listed in Table 15.2-1.

In the loss of normal feedwater event, the operator action to open the reactor vessel head vent and the capacity of the PRHR heat exchanger is sufficient to avoid water relief through the pressurizer safety valves.

Figures 15.2.7-14 through 15.2.7-26 show the significant plant parameters following a loss of normal feedwater with a consequential loss of ac power to plant auxiliaries.

The first increase in pressurizer water volume is turned around by the heat extraction provided by the steam generator safety valves. Due to the steam generator safety valve relief, the pressurizer water volume decreases until the heat extraction provided by the steam generator safety valves relief stops once the steam pressure decreases below the steam generator safety valve setpoints. With no steam generator safety valve relief, the pressurizer water volume begins to increase until the PRHR heat extraction approaches the magnitude of the decay heat addition resulting in a peak pressurizer water volume at 3584 seconds.

15.2.7.3 Conclusions

Results of the analyses show that a loss of normal feedwater, or a loss of normal feedwater with a consequential loss of ac power to the plant auxiliaries do not adversely affect the core, the reactor

Deleted: pressure decreases.

Deleted: The cooldown continues pressurizer water volume decreases until a low T_{cold} "S" signal is eventually reached. the reactor coolant pump trip due to the core makeup tank actuation.

Deleted: "S" signal actuates the core makeup tanks. During this transient, the core makeup tanks ... [12]

Deleted: accelerates the cooldown ... [13]

Deleted: the plant. The core makeup tank ... [14]

Deleted: slowly decreases as the core makeup tank fluid ... [15]

Deleted: As the plant cools down, the heat removal capacity of ... [16]

Deleted: Approximately 30 minutes after the high-2 ... [17]

Deleted:

Deleted: The pressurizer water volume increases until the ... [18]

Deleted: exchanger

Deleted: 3 and

Deleted: 15.2.7-4,

Deleted: starts

Deleted: slow cooldown driven by the ... [19]

Deleted: exchanger. Plant procedures may be followed ... [20]

Deleted: analysis

Deleted: does

coolant system, or the steam system. The heat removal capacity of the PRHR heat exchanger, the steam generator safety valves and the fluid relief capacity of the reactor vessel head vent are such that reactor coolant water is not relieved from the pressurizer safety valves. DNBR always remains above the design limit values, and reactor coolant system and steam generator pressures remain below 110 percent of their design values.

Deleted: is

15.2.8 Feedwater System Pipe Break

Comment [B5]: [15.2-5]

15.2.8.1 Identification of Causes and Accident Description

A major feedwater line rupture is a break in a feedwater line large enough to prevent the addition of sufficient feedwater to the steam generators in order to maintain shell-side fluid inventory in the steam generators. If the break is postulated in a feedwater line between the check valve and the steam generator, fluid from the steam generator may also be discharged through the break. (A break upstream of the feedwater line check valve would affect the plant only as a loss of feedwater. This case is covered by the evaluation in subsections 15.2.6 and 15.2.7.)

Depending upon the size of the break and the plant operating conditions at the time of the break, the break could cause either a reactor coolant system cooldown (by excessive energy discharge through the break) or a reactor coolant system heatup. Potential reactor coolant system cooldown resulting from a secondary pipe rupture is evaluated in subsection 15.1.5. Therefore, only the reactor coolant system heatup effects are evaluated for a feedwater line rupture in this subsection.

The feedwater line rupture reduces the ability to remove heat generated by the core from the reactor coolant system for the following reasons:

- Feedwater flow to the steam generators is reduced. Because feedwater is subcooled, its loss may cause reactor coolant temperatures to increase prior to reactor trip.
- Fluid in the steam generator may be discharged through the break and would not be available for decay heat removal after trip.
- The break may be large enough to prevent the addition of main feedwater after trip.

A major feedwater line rupture is classified as a Condition IV event.

The severity of the feedwater line rupture transient depends on a number of system parameters, including the break size, initial reactor power, and the functioning of various control and safety-related systems. Sensitivity studies presented in WCAP-9230 (Reference 4) illustrate that the most limiting feedwater line rupture is a double-ended rupture of the largest feedwater line.

At the beginning of the transient, the main feedwater control system is assumed to malfunction due to an adverse environment. Interactions between the break and the main feedwater control system result in no feedwater flow being injected or lost through the steam generator feedwater nozzles. This assumption causes the water levels in both steam generators to decrease equally until the low steam generator level (narrow range) reactor trip setpoint is reached. After reactor trip, a full double-ended rupture of the feedwater line is assumed such that the faulted steam generator blows down through the break and no main feedwater is delivered to the intact steam generator. These assumptions conservatively bound the most limiting feedwater line rupture that can occur. Analysis is performed at full power assuming the loss of offsite power at the time of the reactor trip. This is more conservative than the case where power is lost at the initiation of the event. The case with offsite power available is not explicitly examined because, due to the fast generation of an "S" signal (generated by the low steam line pressure), the reactor coolant pumps would be tripped by the protection and safety monitoring system shortly after the reactor trip. The only difference between the cases with and without offsite power available would be a small difference in when the reactor coolant pumps are tripped.

The following provides the protection for a main feedwater line rupture:

- A reactor trip on any of the following five conditions:
 - High pressurizer pressure
 - Overtemperature ΔT
 - High-3 pressurizer water level
 - Low steam generator water level in either steam generator
 - "S" signals from either of the following:
 - Two out of four low steam line pressure in either steam generator
 - Two out of four high containment pressure (high-2)

Refer to Sections 7.1 and 7.2 for a description of the actuation system.

The PRHR heat exchanger functions to:

- Provide a passive method for decay heat removal. The heat exchanger is a C-tube type, located inside the IRWST. The heat exchanger is above the reactor coolant system to provide natural circulation of the reactor coolant. Operation of the PRHR heat exchanger is initiated by the opening of one of the two parallel power-operated valves at the PRHR heat exchanger cold leg.

Deleted: presented

Deleted: core makeup tanks actuation

Deleted: on an "S" signal

Deleted: are

Deleted: a few seconds

Deleted: is the operating status of

Deleted: four

- Prevent substantial overpressurization of the reactor coolant system (less than 110 percent of design pressures).
- Maintain sufficient liquid in the reactor coolant system so that the core remains in place, and geometrically intact, with no loss of core cooling capability.

Refer to subsection 6.3.2.2.5 for a description of the PRHR heat exchanger.

15.2.8.2 Analysis of Effects and Consequences

15.2.8.2.1 Method of Analysis

An analysis using a modified version, described in WCAP-15644 (Reference 6), of the LOFTRAN code (Reference 2) is performed to determine the plant transient following a feedwater line rupture. The code describes the reactor thermal kinetics, reactor coolant system (including natural circulation), pressurizer, steam generators, and feedwater system responses and computes pertinent variables, including the pressurizer pressure, pressurizer water level, and reactor coolant average temperature.

The case analyzed assumes a double-ended rupture of the largest feedwater pipe at full power. Major assumptions used in the analysis are as follows:

- The plant is initially operating at 101 percent of the design plant rating. The main feedwater flow measurement supports a 1-percent power uncertainty.
- Initial reactor coolant average temperature is 8.0°F above the nominal value, and the initial pressurizer pressure is 50 psi below its nominal value.
- The pressurizer spray is turned on.
- Initial pressurizer level is at a conservative maximum value and a conservative initial steam generator water level is assumed in both steam generators.
- At the start of the transient, interaction between the break in the feedline and the main feedwater control system is assumed to result in a complete loss of feedwater flow to both steam generators. No feedwater flow is delivered to or lost through the steam generator nozzles.
- Reactor trip is assumed to be initiated by the low steam generator water level (narrow range) signal on the ruptured steam generator. A two-second delay is assumed following the low level setpoint being reached to allow for the system response times.

Deleted: 102

Deleted: ; use of a 2-percent power uncertainty is conservative

Deleted: 6.5°F

Deleted: No credit is taken for the high pressurizer pressure reactor trip.

Deleted: when

- After reactor trip, the faulted steam generator blows down through a double-ended break area of 1.117 ft². A saturated liquid discharge is assumed until all the water inventory is discharged from the faulted steam generator. This minimizes the heat removal capability of the faulted steam generator and maximizes the resultant heatup of the reactor coolant. No feedwater flow is assumed to be delivered to the intact steam generator.
- The PRHR heat exchanger is assumed to be actuated by the low steam generator water level (wide range) signal. A 17-second delay is assumed following the low level setpoint being reached to allow for the system response times and the valve stroke time.
- Credit is taken for heat energy deposited in reactor coolant system metal during the reactor coolant system heatup.
- No credit is taken for charging or letdown.
- Pressurizer safety valve setpoint is assumed to be at its minimum value.
- Steam generator heat transfer area is assumed to decrease as the shell-side liquid inventory decreases. The heat transfer remains approximately 100 percent in the faulted steam generator until the liquid mass reaches about 11 percent. The heat transfer is then reduced to 0 percent with the liquid inventory.
- Conservative core residual heat generation is assumed based upon long-term operation at the initial power level preceding the trip (Reference 3).
- No credit is taken for the following four protection and safety monitoring system reactor trip signals to mitigate the consequences of the accident:
 - High pressurizer pressure
 - Overtemperature ΔT
 - High pressurizer water level
 - High containment pressure

Deleted: 755

Deleted: 15

Deleted: signal

Deleted: time

Deleted: ,alignment of PRHR
heat exchanger valves

The PRHR heat exchanger is initiated once the steam generator water level drops to the low steam generator level (wide range). Similarly, receipt of a low steam line pressure signal in at least one steam line initiates a steam line isolation signal that closes all main steam line and feed line isolation valves. This signal also gives an "S" signal that initiates flow of cold borated water from the core makeup tanks to the reactor coolant system.

Deleted: if

Plant characteristics and initial conditions are further discussed in subsection 15.0.3.

No credit is taken for the plant control system to mitigate the consequences of the event. The protection and safety monitoring system is required to function following a feedwater line rupture as analyzed here. No single active failure prevents operation of this system.

Deleted: is not assumed to function in order

The engineered safety features assumed to function are the PRHR heat exchanger, core makeup tank, and steam line isolation valves. The single failure assumed is the failure of one of the two parallel discharge valves in the PRHR outlet line (see Table 15.0-7).

A description and analysis of the core makeup tank is provided in subsection 6.3.2.2.1. The PRHR heat exchanger is described in subsection 6.3.2.2.5.

Deleted: For the case without offsite power, there is a flow coastdown until flow in the loops reaches the natural circulation value. The natural circulation capability of the reactor coolant system is shown (see subsection 15.2.6) to be sufficient to remove core decay heat following reactor trip for the loss of ac power transient. Pump coastdown characteristics are demonstrated in subsections 15.3.1 and 15.3.2 for single and multiple reactor coolant pump trips, respectively.¶

15.2.8.2.2 Results

Calculated plant parameters following a major feedwater line rupture are shown in Figures 15.2.8-1 through 15.2.8-10. The calculated sequence of events for the case analyzed is listed in Table 15.2-1.

The results presented in Figures 15.2.8-5 and 15.2.8-7 show that pressures in the reactor coolant system and main steam system remain below 110 percent of the respective design pressures. Pressurizer pressure decreases after reactor trip on the low steam generator water level (narrow range) due to the loss of heat input.

Deleted: pressure

Deleted: 70.3 seconds

In the first part of the transient, due to the conservative analysis assumptions, the system response following the feedwater line rupture is similar to the loss of ac power to the station auxiliaries (subsection 15.2.6). Accordingly, like the loss of ac power event documented in subsection 15.2.6, the feedwater line rupture event is bounded by the turbine trip event presented in Section 15.2.3 with respect to DNB concerns.

Deleted: The DNB results, presented in Figure 15.2.6-12 for the loss of ac power to plant auxiliaries, are also applicable to a feedwater system pipe break and demonstrate that are also bounded by the loss of ac power case analyzed for the DNB design basis is met. turbine trip event presented in Section 15.2.3.¶
After

Deleted: (95 seconds)

Deleted: (90.1 seconds)

After the trip, the core makeup tanks are actuated, on low steam line pressure in the ruptured loop while the PRHR heat exchanger is actuated on a low steam generator water level (wide range).

The addition of the PRHR heat exchanger and the core makeup tanks flow rates helps to cool down the primary system and to provide sufficient fluid to keep the core covered with water.

Pressurizer safety valves open due to the mismatch between decay heat and the heat transfer capability of the PRHR heat exchanger. In the first part of the transient, there is a cooling effect due to the core makeup tanks that inject cold water into the reactor coolant system and receive hot water from the cold leg. This effect decreases due to the heatup of the core makeup tanks from recirculation flow. Also, the injection driving head is lowered as the core makeup tanks heat up.

Reactor coolant system temperatures are low (approximately 510°F at about 2,500 seconds) and, in this condition, the PRHR heat exchanger cannot remove the entire decay heat load. Reactor coolant system temperatures increase until an equilibrium between decay heat power and heat absorbed by the PRHR heat exchanger is reached. After about 26,400 seconds, the heat transfer capability of the PRHR heat exchanger exceeds the decay heat power and the reactor coolant system temperatures, and pressure, start to steadily decrease. Since subcooling is maintained throughout the transient and the reactor coolant system inventory increases (i.e., net core makeup tank injection exceeds net pressurizer safety valve relief), core cooling capability is maintained.

Deleted: 11,300

Deleted: , and pressurizer water volumes

Deleted: Core cooling capability

Deleted: because

Deleted: is increasing due to

15.2.8.3 Conclusions

Results of the analyses show that for the postulated feedwater line rupture, the capacity of the PRHR heat exchanger is adequate to remove decay heat, to prevent overpressurization the reactor coolant system, and to maintain the core cooling capability. Radioactivity doses from postulated ruptures of the feedwater lines are less than those presented for the postulated main steam line break. The Standard Review Plan, subsection 15.2.8, evaluation criteria are therefore met.

Deleted: overpressurizing

Deleted: postulated

15.2.9 Combined License Information

This section has no requirement for additional information to be provided in support of the Combined License application.

15.2.10 References

1. Cooper, L., Miselis, V., and Starek, R. M., "Overpressure Protection for Westinghouse Pressurized Water Reactors," WCAP-7769, Revision 1, June 1972. (Also letter NS-CE-622, C. Eicheldinger (Westinghouse) to D. B. Vassallo (NRC), additional information on WCAP-7769, Revision 1, April 16, 1975).
2. Burnett, T. W. T., et al., "LOFTRAN Code Description," WCAP-7907-P-A (Proprietary) and WCAP-7907-A (Nonproprietary), April 1984.
3. "American National Standard for Decay Heat Power in Light Water Reactors," ANSI/ANS-5.1-1979, August 1979.
4. Lang, G. E., and Cunningham, J. P., "Report on the Consequences of a Postulated Main Feedline Rupture," WCAP-9230 (Proprietary) and WCAP-9231 (Nonproprietary), January 1978.

-
5. Friedland, A. J., and Ray, S., "Revised Thermal Design Procedure," WCAP-11397-P-A (Proprietary) and WCAP-11397-A (Nonproprietary), April 1989.
 6. "AP1000 Code Applicability Report," WCAP-15644-P (Proprietary) and WCAP-15644-NP (Nonproprietary), Revision 2, March 2004.
 7. Hargrove, H. G., "FACTRAN – A FORTRAN-TV Code for Thermal Transients in a UO₂ Fuel Rod," WCAP-7908-A, December 1989.
 8. Sung, Y. X., et al., "VIPRE-01 Modeling and Qualification for Pressurized Water Reactor Non-LOCA Thermal Hydraulic Safety Analysis," WCAP-14565-P-A (Proprietary) and WCAP-15306-NP-A (Nonproprietary), October 1999.
 9. Matthys, C., "Overpressure Protection Report for AP1000 Nuclear Power Plant," WCAP-16779-NP, April 2007.

Comment [B6]: [15.2-6]

Table 15.2-1 (Sheet 1 of 8)

**TIME SEQUENCE OF EVENTS FOR INCIDENTS WHICH
RESULT IN A DECREASE IN HEAT REMOVAL BY
THE SECONDARY SYSTEM**

Accident	Event	Time (seconds)
I. Turbine trip		
A.1. With pressurizer control, minimum reactivity feedback, with offsite power available	Turbine trip; loss of main feedwater	0.0
	Minimum DNBR (2.336) occurs	10.7
	Initiation of steam release from steam generator safety valves	11.5
	OTDT reactor trip setpoint reached	19.1
	Rods begin to drop	21.1
A.2. With pressurizer control, minimum reactivity feedback, without offsite power available	Turbine trip; loss of main feedwater	0.0
	Offsite power lost, reactor coolant pumps begin coasting down	3.0
	Low reactor coolant pump speed reactor trip setpoint reached	3.55
	Rods begin to drop	4.35
	Minimum DNBR (1.575/1.554, typical/thimble) occurs	6.2
	Initiation of steam release from steam generator safety valves	16.6

Deleted: 7

Deleted: 0.0

Deleted: ¶
High pressurizer pressure reactor trip point reached ... [17]

Deleted: 12.4

Deleted: 47

Deleted: 24

Deleted: 57

Deleted: 0

Deleted: ¶
Peak RCS pressure occurs ... [18]

Deleted: 18.7

Table 15.2-1 (Sheet 2 of 8)

**TIME SEQUENCE OF EVENTS FOR INCIDENTS WHICH
RESULT IN A DECREASE IN HEAT REMOVAL BY
THE SECONDARY SYSTEM**

Accident	Event	Time (seconds)
B.1. With pressurizer control, maximum reactivity feedback, with offsite power available	Turbine trip; loss of main feedwater flow	0.0
	Minimum DNBR (2.393) occurs	0.0 ⁽¹⁾
	Initiation of steam release from steam generator safety valves	11.7
	OTDT reactor trip setpoint reached	21.0
	Rod motion begins	23.0
B.2. With pressurizer control, maximum reactivity feedback, without offsite power available	Turbine trip; loss of main feedwater	0.0
	Offsite power lost, reactor coolant pumps begin coasting down	3.0
	Low reactor coolant pump speed reactor trip setpoint reached	3.55
	Rods begin to drop	4.35
	Minimum DNBR (2.168/2.117 typical/thimble) occurs	5.2
	Initiation of steam release from steam generator safety valves	18.8

(1) Minimum DNB never drops below initial value.

Deleted: 7

Deleted: ¶
High pressurizer pressure reactor
trip setpoint reached ... [19]

Deleted: 13.0

Deleted: 47

Deleted: 24

Deleted: 44

Deleted: 4.4

Deleted: ¶
Peak RCS pressure occurs ... [20]

Deleted: 24.9

Table 15.2-1 (Sheet 3 of 8)

**TIME SEQUENCE OF EVENTS FOR INCIDENTS WHICH
RESULT IN A DECREASE IN HEAT REMOVAL BY
THE SECONDARY SYSTEM**

Accident	Event	Time (seconds)
C.1. Without pressurizer control, minimum reactivity feedback, with offsite power available	Turbine trip; loss of main feedwater flow	0.0
	High pressurizer pressure reactor trip point reached	5.1
	Rods begin to drop	7.1
	Initiation of steam release from steam generator safety valves	8.9
	Peak RCS pressure (2728 psia) occurs	8.9
C.2. Without pressurizer control, minimum reactivity feedback, without offsite power available	Turbine trip; loss of main feedwater	0.0
	Offsite power lost, reactor coolant pumps begin coasting down	3.0
	Low reactor coolant pump speed reactor trip setpoint reached	3.55
	Rods begin to drop	4.35
	Peak RCS pressure (2708 psia) occurs	6.4
	Initiation of steam release from steam generator safety valves	10.7

Deleted: 7

Deleted: 9

Deleted: 9

Deleted: Peak RCS pressure occurs

Deleted: .5

Deleted: Initiation of steam release from steam generator safety valves

Deleted: 10.5

Deleted: 47

Deleted: 24

Deleted: 3

Deleted: 14.0

Table 15.2-1 (Sheet 4 of 8)

**TIME SEQUENCE OF EVENTS FOR INCIDENTS WHICH
RESULT IN A DECREASE IN HEAT REMOVAL BY
THE SECONDARY SYSTEM**

Accident	Event	Time (seconds)
D.1. Without pressurizer control, maximum reactivity feedback, with offsite power available	Turbine trip; loss of main feedwater flow	0.0
	High pressurizer pressure reactor trip	5.1
	Rods begin to drop	7.1
	Peak RCS pressure (2710 psia) occurs	8.2
	Initiation of steam release from steam generator safety valves	8.8
D.2. Without pressurizer control, maximum reactivity feedback, without offsite power available	Turbine trip; loss of main feedwater	0.0
	Offsite power lost, reactor coolant pumps begin coasting down	3.0
	Low reactor coolant pump speed reactor trip setpoint reached	3.55
	Rods begin to drop	4.35
	Peak RCS pressure (2668 psia) occurs	6.1
	Initiation of steam release from steam generator safety valves	10.9

Deleted: 7

Deleted: 6.0

Deleted: 8.0

Deleted: 4

Deleted: 10.7

Deleted: 47

Deleted: 24

Deleted: 5.9

Deleted: 15.6

Table 15.2-1 (Sheet 5 of 8)

**TIME SEQUENCE OF EVENTS FOR INCIDENTS WHICH
RESULT IN A DECREASE IN HEAT REMOVAL BY
THE SECONDARY SYSTEM**

Accident	Event	Time (seconds)
II.A. Loss of ac power to the plant auxiliaries	Offsite ac power is lost, feedwater is lost, RCPs begin to coast down, turbine trip	0.0
	RCP speed- low reactor trip set point is reached	0.5
	Rods begin to drop	1.3
	Pressurizer safety valves open	~3.0
	Maximum pressurizer pressure reached	3.0
	Pressurizer safety valves close	~7.5
	Pressurizer safety valves open	47.0 ¹
	Steam generator 1 safety valves open	89.0 ¹
	Steam generator 2 safety valves open	91.0 ¹
	Maximum pressurizer water volume reached	401.0
	PRHR heat exchanger actuation on low steam generator water level (narrow range coincident with low start up flow rate)	401.0
	PRHR heat exchanger extracted heat matches decay heat	~18,500

1. The pressurizer safety valves open and close from 47.0 seconds until the time the maximum pressurizer water volume is reached. The steam generator safety valves in Loops 1 and 2 also cycled open and closed from 89.0 and 91.0 seconds, respectively, until the time the maximum pressurizer water volume was reached.

Deleted: 7

Deleted: Feedwater is lost

Deleted: 10

Deleted: Low steam generator water level

Deleted: 70.4

Deleted: , ac power is lost, reactor coolant pumps start to coastdown

Deleted: 72.4

Deleted: 76.5

Deleted: 77

Deleted: Pressurizer

Deleted: 87.0

Deleted: 132.4

Deleted: ¶
Maximum pressurizer water volume reached ... [21]

Deleted: 19,100

Deleted: ¶
Second pressurizer water volume peak is reached ... [22]

Table 15.2-1 (Sheet 6 of 8)

**TIME SEQUENCE OF EVENTS FOR INCIDENTS WHICH
RESULT IN A DECREASE IN HEAT REMOVAL BY
THE SECONDARY SYSTEM**

Accident	Event	Time (seconds)
IIIA. Loss of normal feedwater flow	Feedwater is lost	0.0
	Low steam generator water level (narrow range) reactor trip reached	48.2
	Rods begin to drop	50.2
	Minimum DNBR is reached	51.0
	PRHR heat exchanger actuation on low steam generator water level (narrow range coincident with low start up feedwater flow rate)	110.2
	Cold leg temperature reaches low T_{cold} setpoint	1,915.7
	Reactor coolant pump trip on low T_{cold} "S" signal	1,922.4
	Steam line isolation on low T_{cold} "S" signal	1,927.7
	Core makeup tank actuation on low T_{cold} "S" signal	1,932.7
	The chemical volume and control system is isolated on "S" signal and Pressurizer Water Level -High1	1,953.2
	Pressurizer safety valves open	2,452.0
	High-2 pressurizer level setpoint reached	2,602.0
	High-3 pressurizer level setpoint reached	3,958.0
	Operator opens reactor vessel head vent (at least 30 minutes after high-2 pressurizer level setpoint is reached)	4,402.0
	Pressurizer safety valves reclose	4,394.0
	Maximum pressurizer water volume reached	5,894.0

Comment [B7]: [15.2-7]

Deleted: 7

Deleted: III

Split Cells

Deleted: 10.

Deleted: 70.4

Deleted: 72.4

Deleted: Steam generator ... [27]

Deleted: 80

Deleted: 132.4

Deleted: Steam generator ... [28]

Deleted: 144

Deleted: 2.6

Deleted: Cold leg tempo ... [29]

Deleted: 154.6

Deleted: 19.3

Deleted: Reactor coolant ... [30]

Deleted: 160

Deleted: 4.6

Deleted: Steam line isolation

Deleted: 166

Deleted: 29.6

Deleted: Core makeup tank ... [31]

Deleted: 171.6

Deleted: 0...21 ... [32]

Deleted: low T_{cold}

Deleted: Prz

Deleted: 3,500

Deleted: 564

Deleted: 3270

Deleted: 5270

Deleted: 17,7025270.0

Deleted: Pressurizer saf ... [33]

Deleted: Passive residual ... [34]

Deleted: 17,620

Deleted: 5272

Deleted: 19,548

Deleted: 868

Table 15.2-1 (Sheet 7 of 8)

**TIME SEQUENCE OF EVENTS FOR INCIDENTS WHICH
RESULT IN A DECREASE IN HEAT REMOVAL BY
THE SECONDARY SYSTEM**

Accident	Event	Time (seconds)
III.B Loss of normal feedwater flow with a consequential loss of ac power	Feedwater is lost	10.0
	Low steam generator water level setpoint is reached	58.2
	Rods begin to drop	60.2
	Minimum DNBR is reached	61.0
	RCP trip due to loss of ac power	67.6
	Steam generator safety valves open	98.6
	Pressurizer safety valves open	~104.5
	PRHR heat exchanger actuation on low steam generator water level (narrow range coincident with low start up flow rate)	120.2
	Pressurizer safety valves close	~137.0
	Pressurizer safety valves open	~1744
	Steam generator safety valves close	~2018 ¹
	Pressurizer safety valves close	~2822 ²
	PRHR heat extraction matches decay heat addition	~3165
	Maximum pressurizer water volume reached	3584

- Between 98.6 seconds and 2018 seconds the steam generator safety valves cycle open and closed. After 2018 seconds the steam generator safety valves intermittently relieve steam, but with a relief rate less than 1 lbm/second, which has a negligible effect on the transient.
- Between 1744 seconds and 2822 seconds the pressurizer safety valves cycle open and closed.

Deleted: 7
Deleted: IV. Feedwater ... [30]
Deleted: Main feedwater ... [31]
Deleted: (narrow range)
Deleted: 70.3
Deleted: ¶ ... [32]
Deleted: 72.3
Deleted: offsite... c pow ... [33]
Deleted: 72.3
Deleted: Low ... team ge ... [34]
Deleted: 73.1
Deleted: 74
Deleted: ¶ ... [35]
Deleted: 90.1
Deleted: wide
Deleted: Core makeup ... [36]
Deleted: 95
Deleted: ¶ ... [37]
Deleted: Intact steam generator
Deleted: 180
Deleted: Intact
Deleted: 425
Deleted: open
Deleted: 1,848
Deleted: exchanger extr ... [38]
Deleted: 11,300
Deleted: Pressurizer saf ... [39]
Deleted: ~ 11,300
Deleted: — Page Break ... [40]

Table 15.2-1 (Sheet 8 of 8)

**TIME SEQUENCE OF EVENTS FOR INCIDENTS WHICH
RESULT IN A DECREASE IN HEAT REMOVAL BY
THE SECONDARY SYSTEM**

Accident	Event	Time (seconds)
IV. Feedwater system pipe break	Main feedwater flow to both steam generators stops due to interaction between the break and the main feedwater control system	10.0
	Low steam generator water level (narrow range) setpoint reached	60.3
	Rods begin to drop	62.3
	Reverse flow from the faulted steam generator through a full double-ended rupture starts	62.3
	Loss of offsite power	70.3
	Low steam line pressure setpoint is reached	76.7
	Core makeup tank valves fully opened	76.7
	Low steam generator water level (wide range) setpoint reached	81.7
	All steam isolation valves close	88.7
	PRHR heat exchanger actuation on low steam generator water level (wide range)	98.7
	Faulted steam generator empties	122.0
	Intact steam generator safety valves open for the first time	251.9
	Pressurizer safety valves open for the first time	1,792
	PRHR heat exchanger extracted heat matches decay heat	~26,400

Deleted: reactor trip


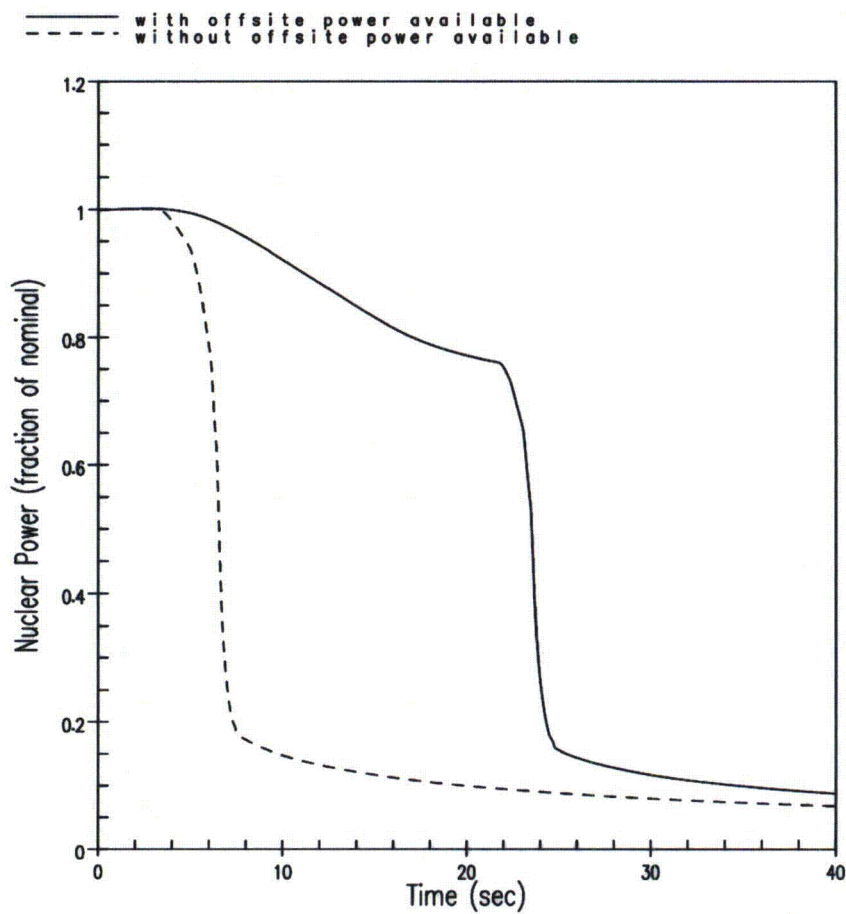


Figure 15.2.3-1

**Nuclear Power versus Time for Turbine Trip
Accident with Pressurizer Spray and Minimum Moderator Feedback**

Deleted: (Fraction of Nominal)

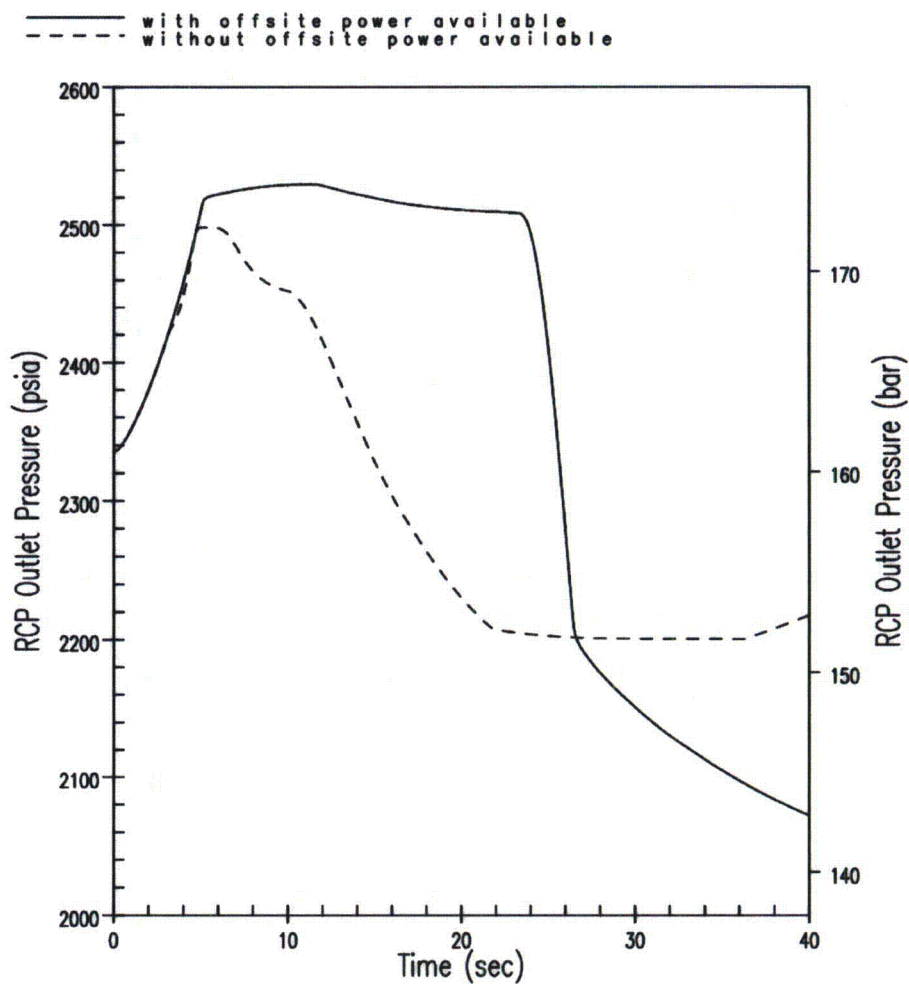


Deleted:

Figure 15.2.3-2

**RCP Outlet Pressure versus Time for Turbine Trip
Accident with Pressurizer Spray and Minimum Moderator Feedback**

Deleted: Pressurizer

Deleted: (psia)

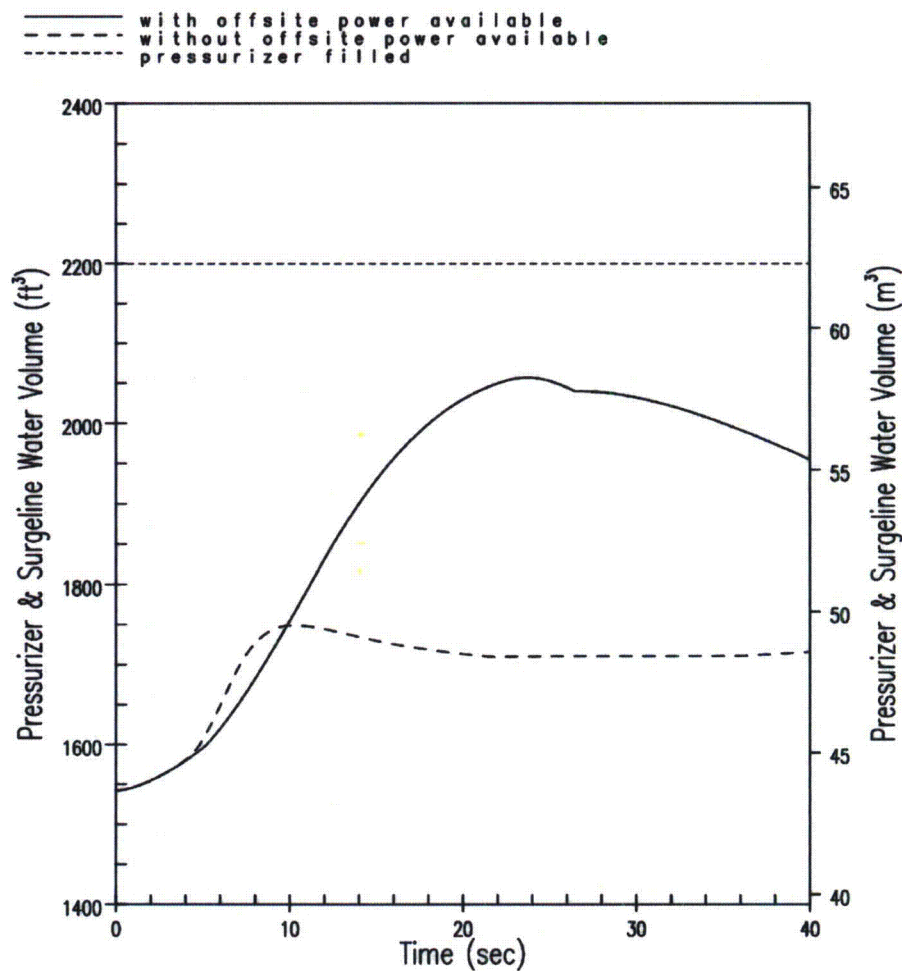


Deleted:

Figure 15.2.3-3

Pressurizer & Surgeline Water Volume versus Time for Turbine Trip Accident with Pressurizer Spray and Minimum Moderator Feedback

Deleted: (ft³)

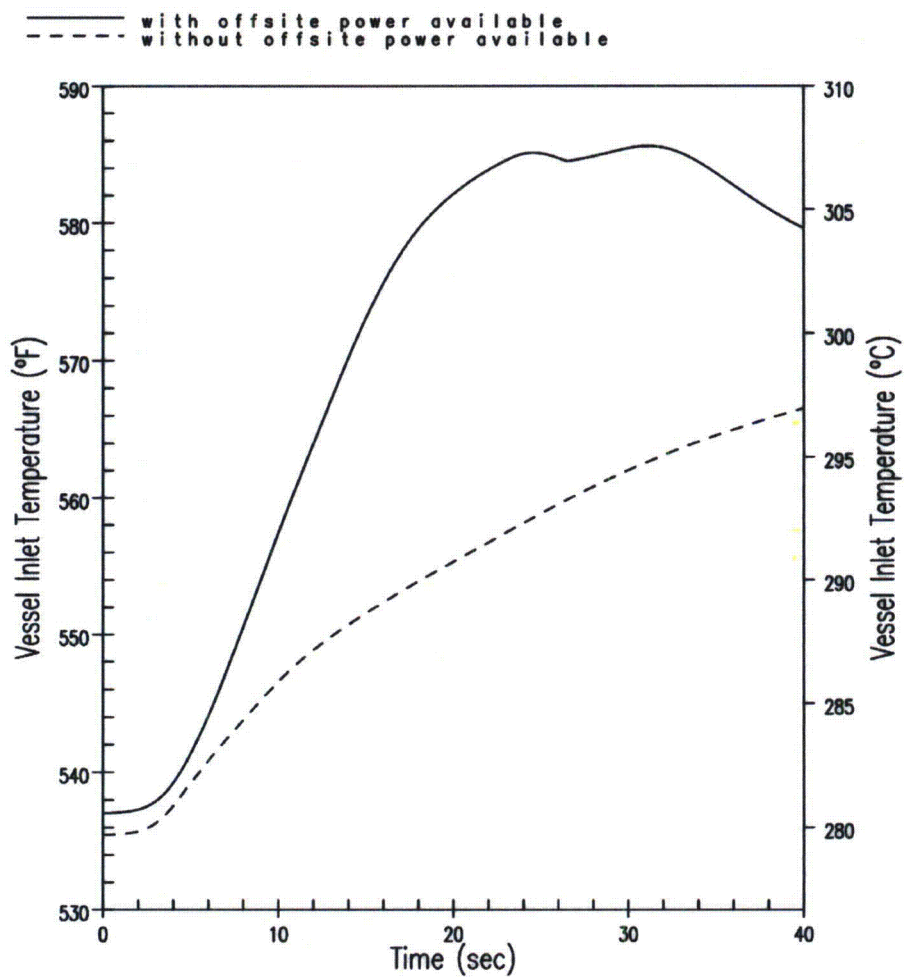


Deleted:

Figure 15.2.3-4

**Vessel Inlet Temperature versus Time for Turbine Trip
Accident with Pressurizer Spray and Minimum Moderator Feedback**

Deleted: (°F)

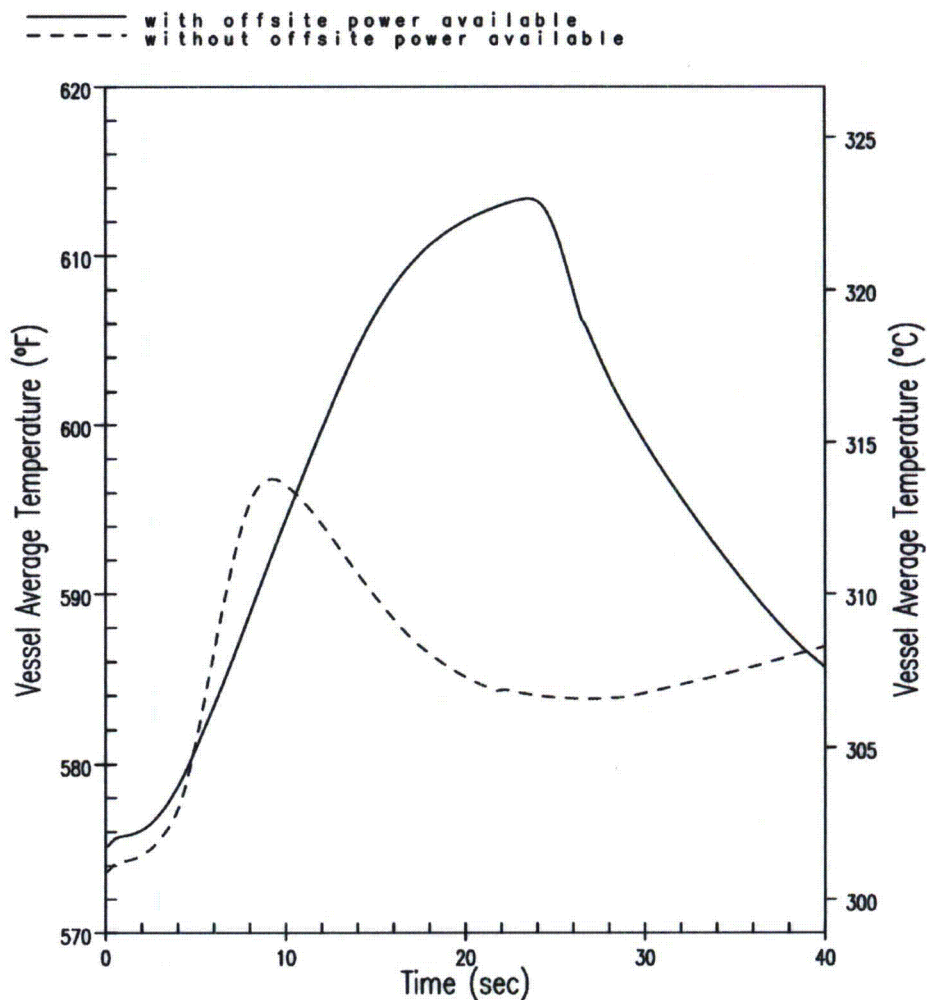

Deleted:

Figure 15.2.3-5

Vessel Average Temperature versus Time for Turbine Trip
 Accident with Pressurizer Spray and Minimum Moderator Feedback

Deleted: (°F)


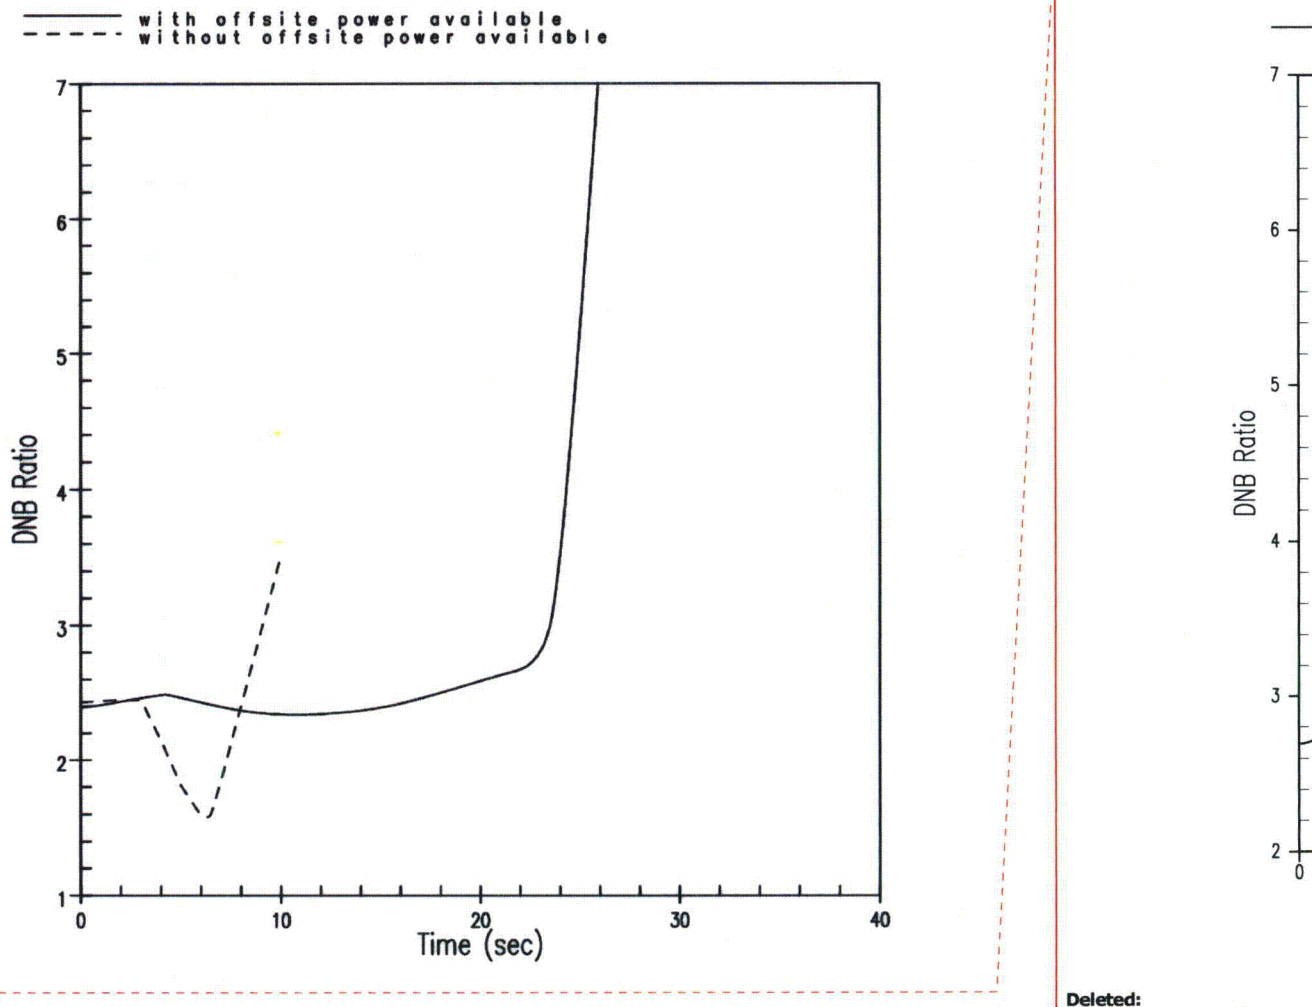


Figure 15.2.3-6

**DNBR versus Time for Turbine Trip Accident
with Pressurizer Spray and Minimum Moderator Feedback**

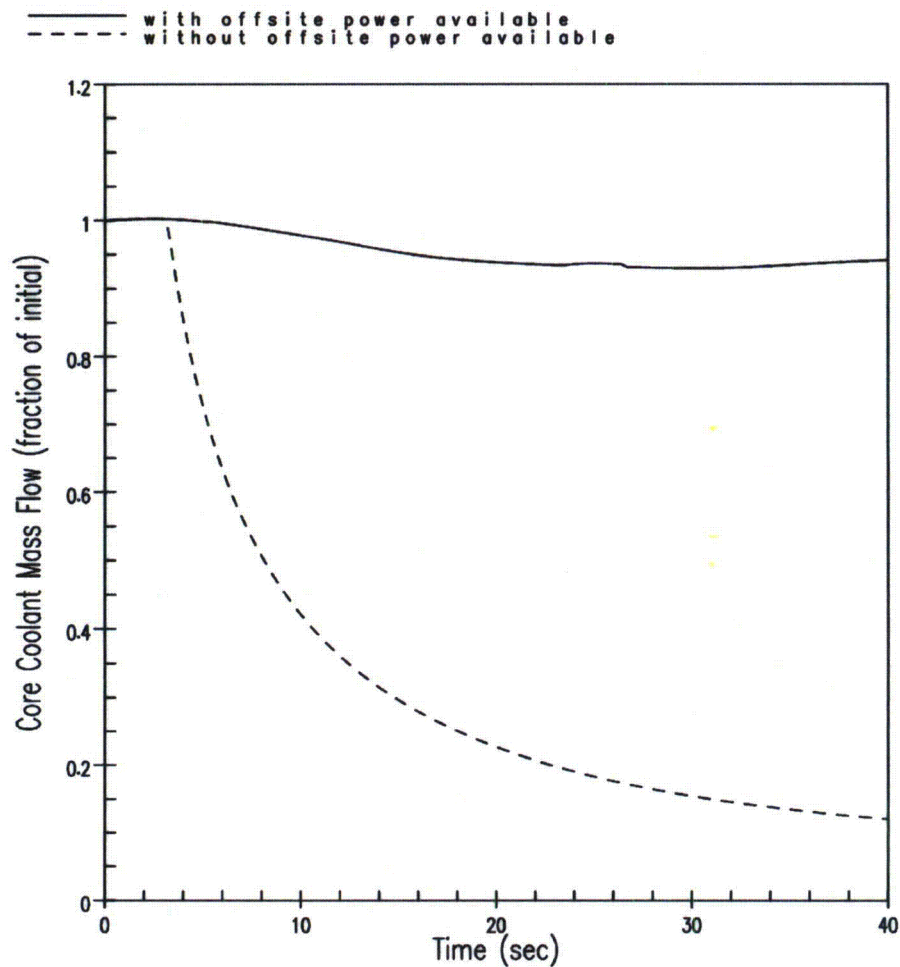

Deleted:

Figure 15.2.3-7

**Core Coolant Mass Flow Rate versus Time for Turbine Trip
Accident with Pressurizer Spray and Minimum Moderator Feedback**

Deleted: (Fraction of Initial)


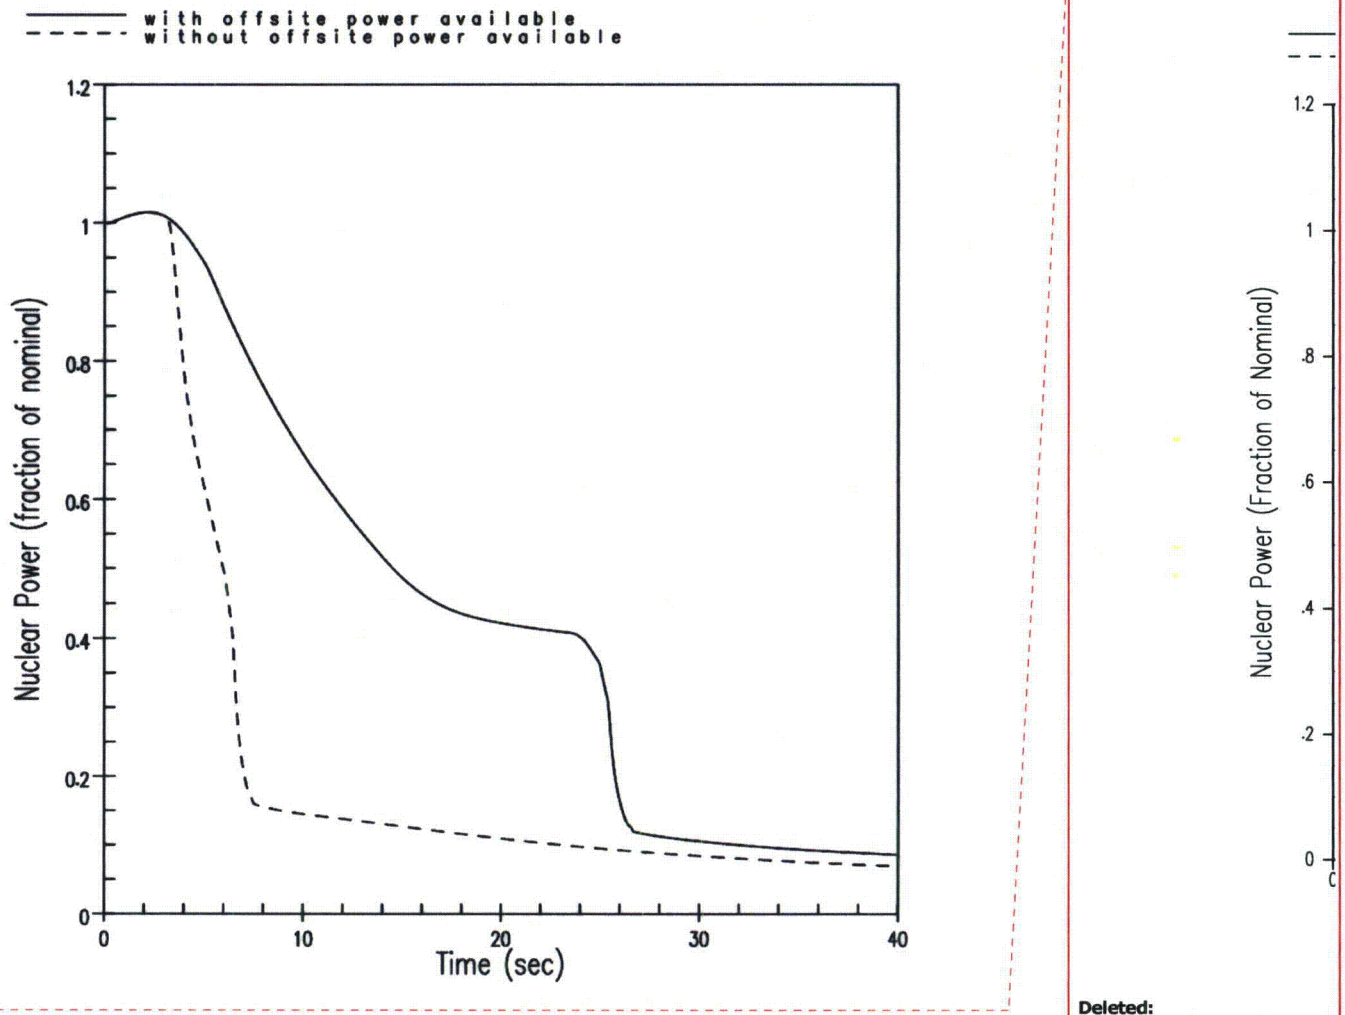


Figure 15.2.3-8

**Nuclear Power versus Time for Turbine Trip
Accident with Pressurizer Spray and Maximum Moderator Feedback**

Deleted: (Fraction of Nominal)

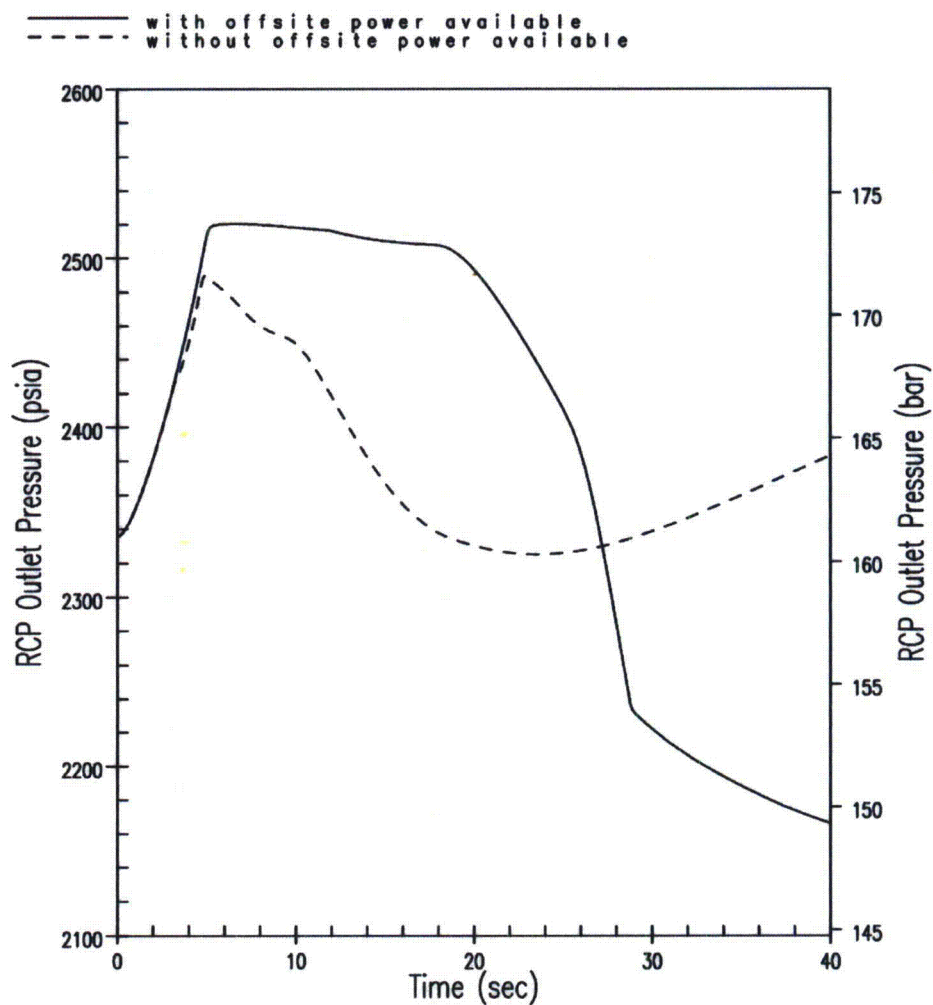

Deleted:

Figure 15.2.3-9

**RCP Outlet Pressure versus Time for Turbine Trip
Accident with Pressurizer Spray and Maximum Moderator Feedback**

Deleted: Pressurizer

Deleted: (psia)

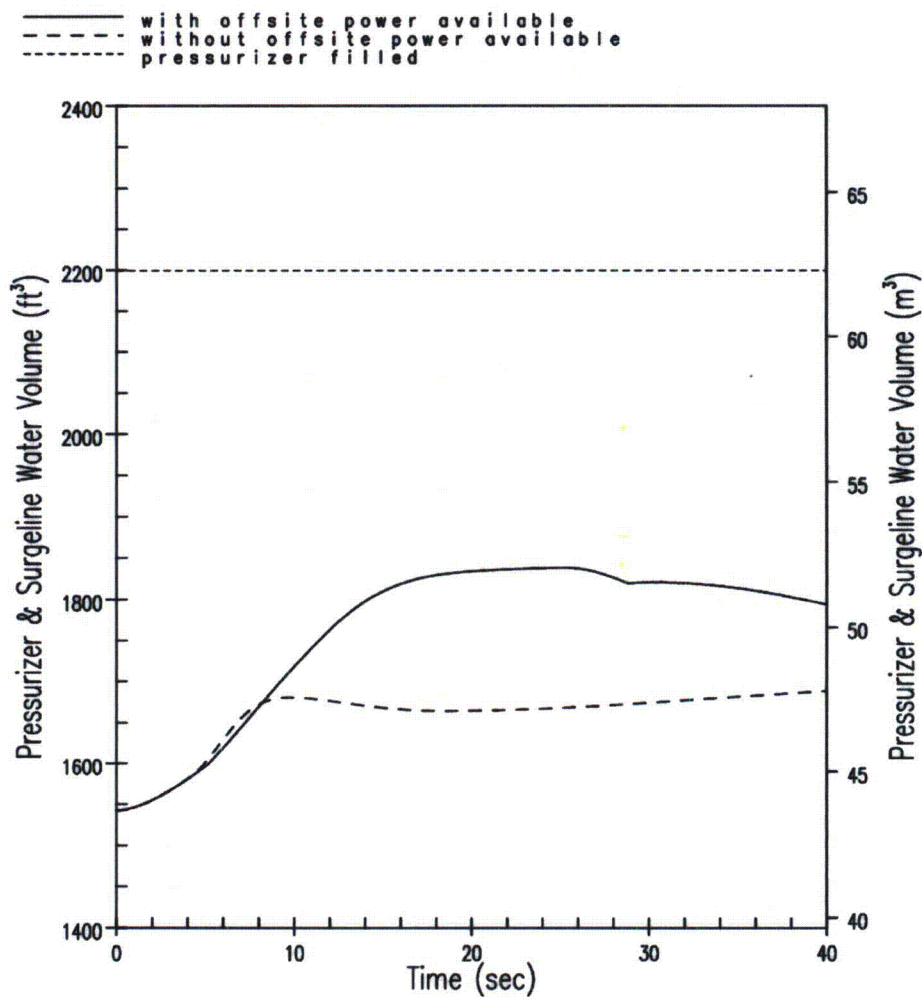


Figure 15.2.3-10

Pressurizer & Surgeline Water Volume versus Time for Turbine Trip
 Accident with Pressurizer Spray and Maximum Moderator Feedback

Deleted: (ft³)

Deleted:

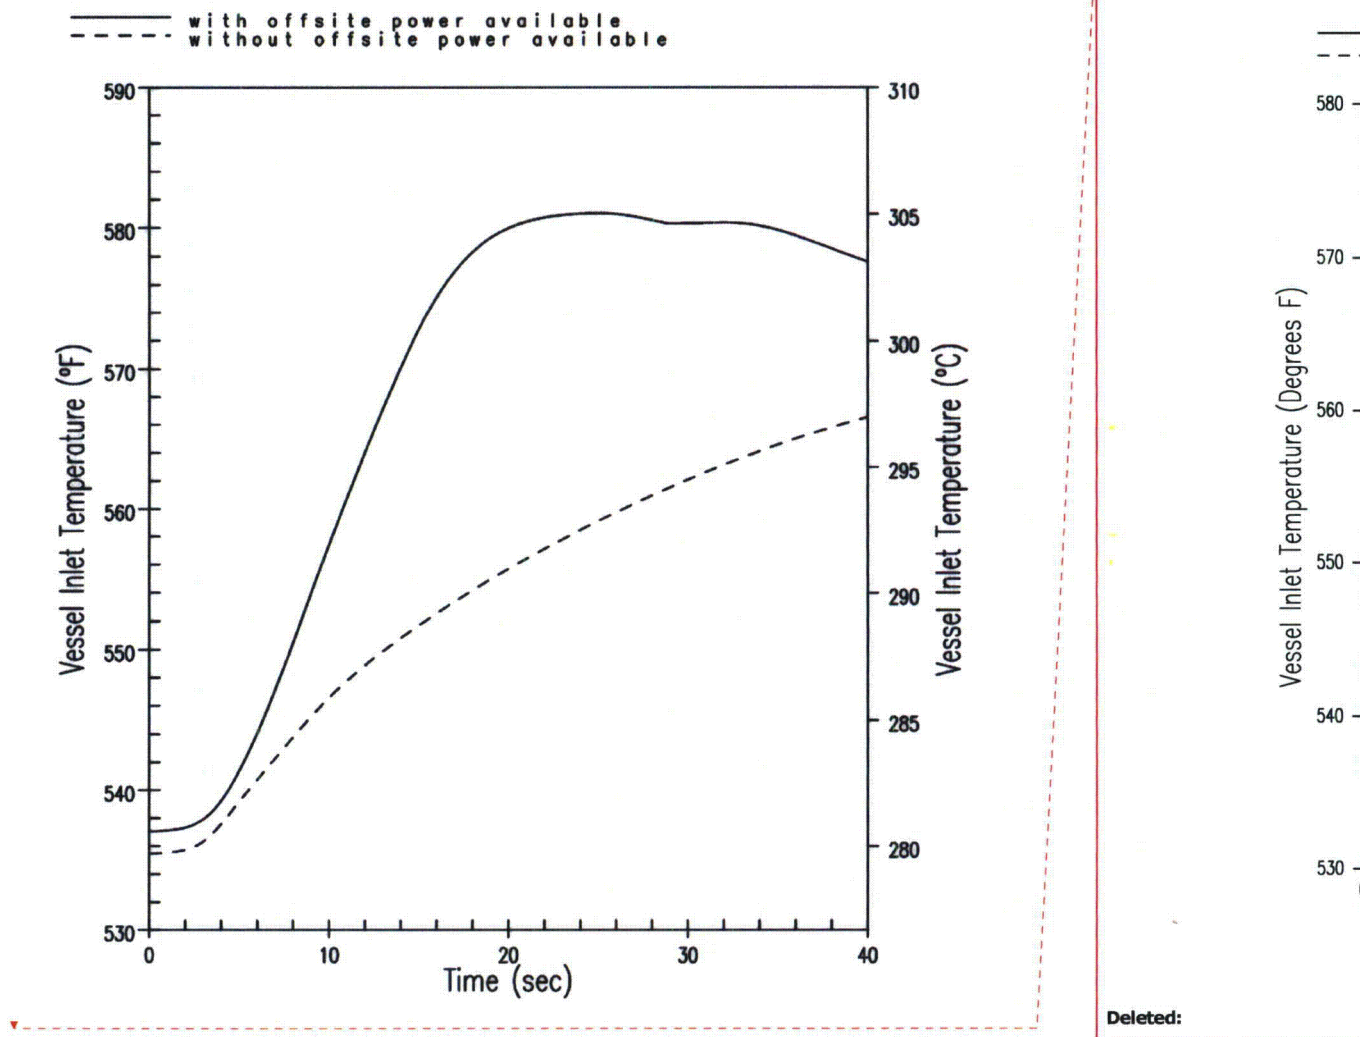


Figure 15.2.3-11

Vessel Inlet Temperature versus Time for Turbine Trip
Accident with Pressurizer Spray and Maximum Moderator Feedback

Deleted: (°F)

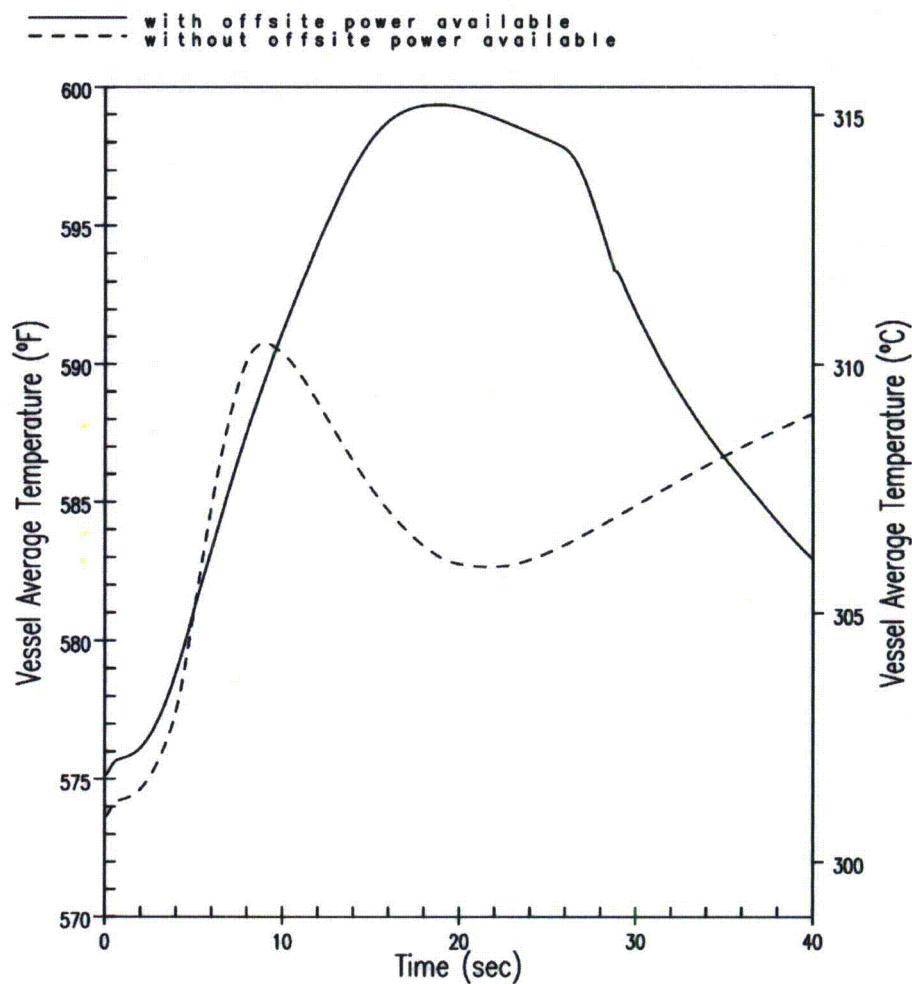


Figure 15.2.3-12

Vessel Average Temperature versus Time for Turbine Trip
 Accident with Pressurizer Spray and Maximum Moderator Feedback

Deleted: (°F)

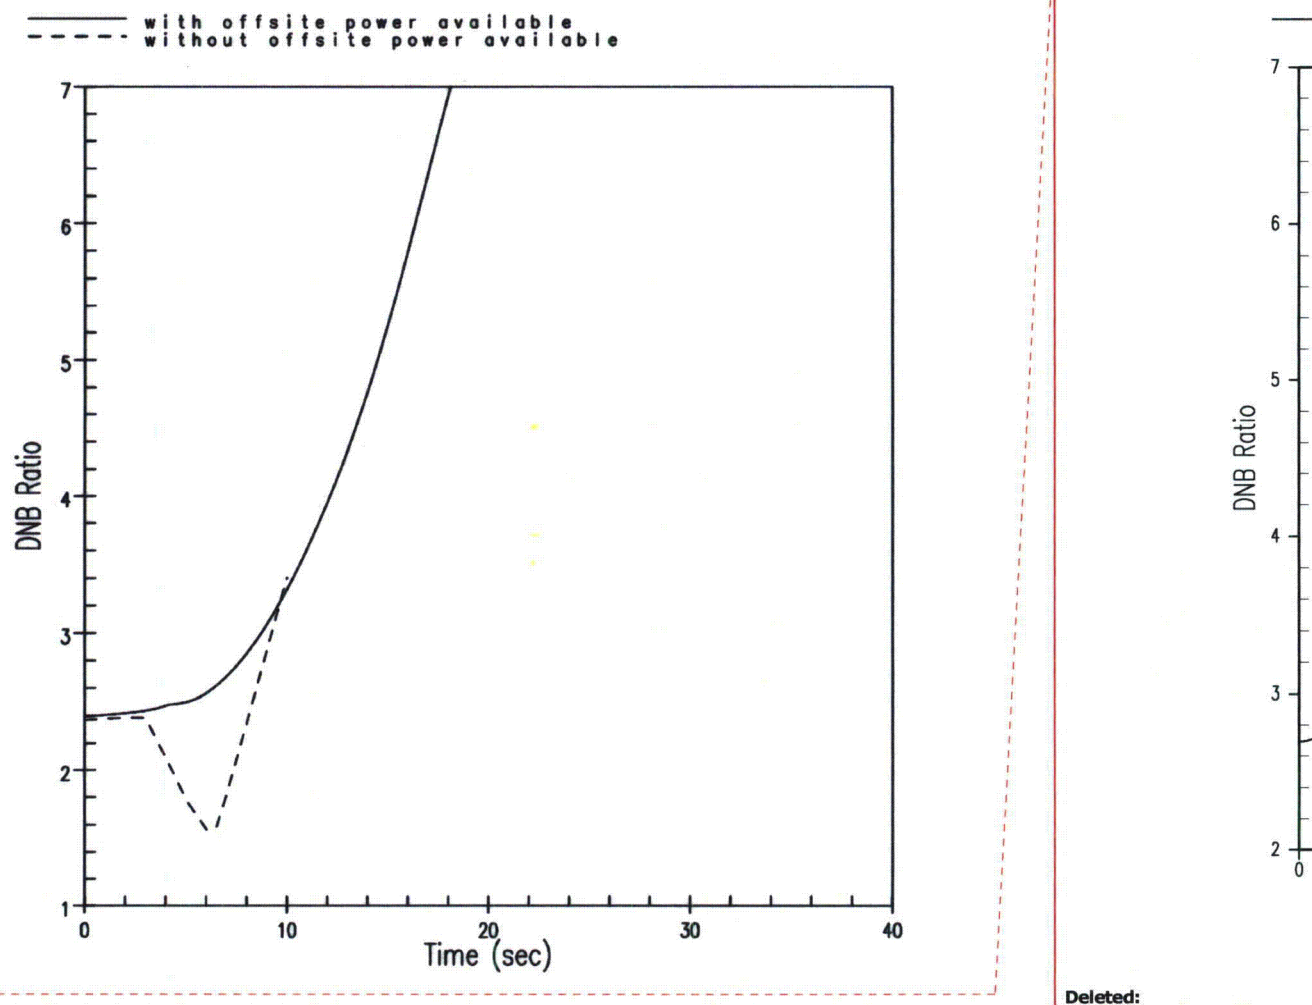


Figure 15.2.3-13

**DNBR versus Time for Turbine Trip Accident
with Pressurizer Spray and Maximum Moderator Feedback**

15.2-46

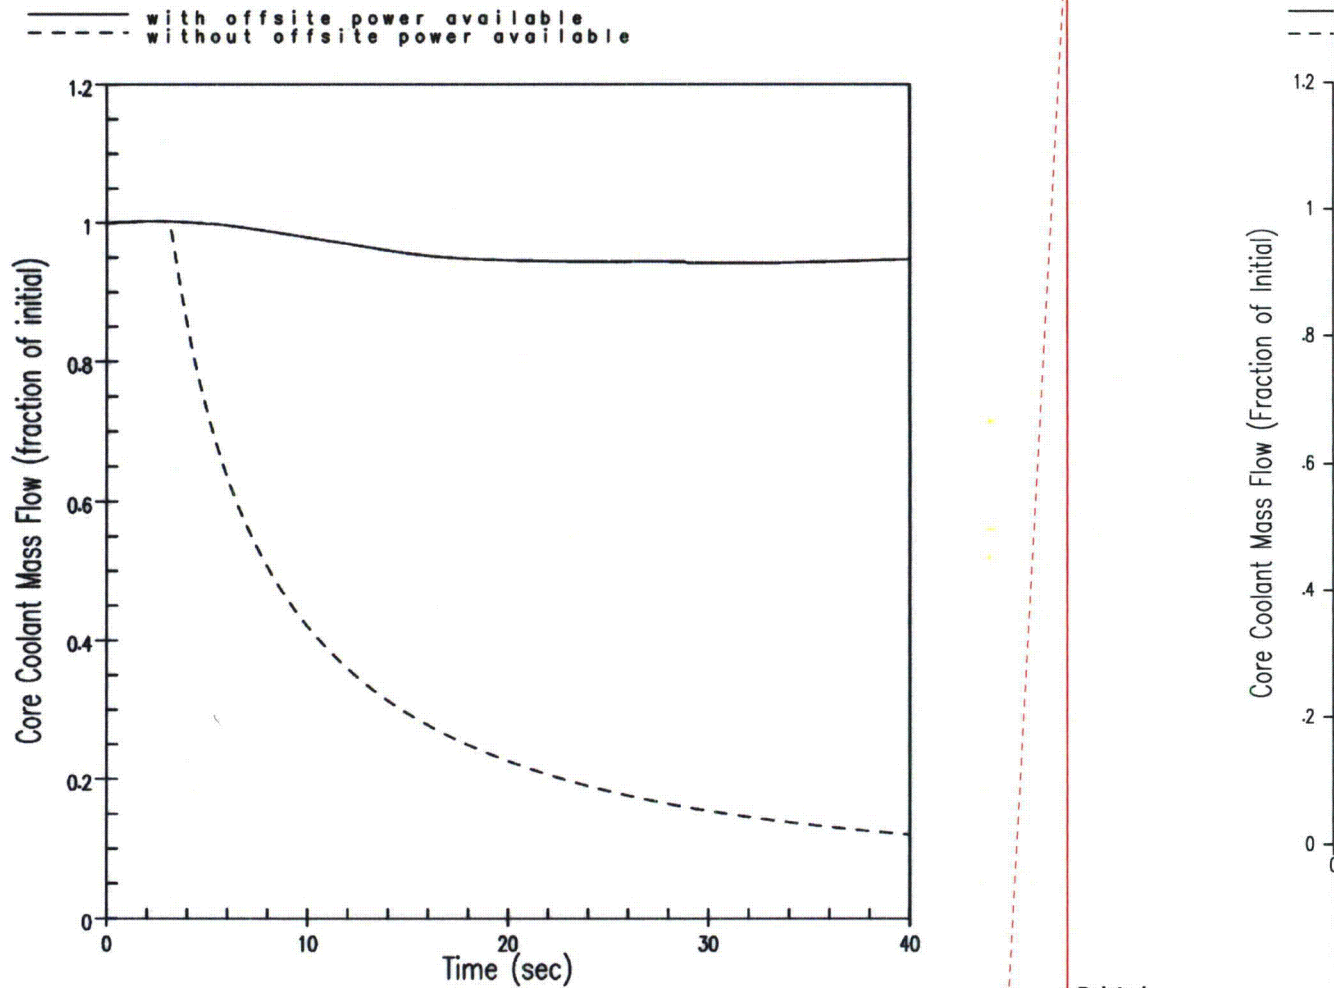


Figure 15.2.3-14

Core Coolant Mass Flow Rate versus Time for Turbine Trip Accident with Pressurizer Spray and Maximum Moderator Feedback

Deleted: (Fraction of Initial)


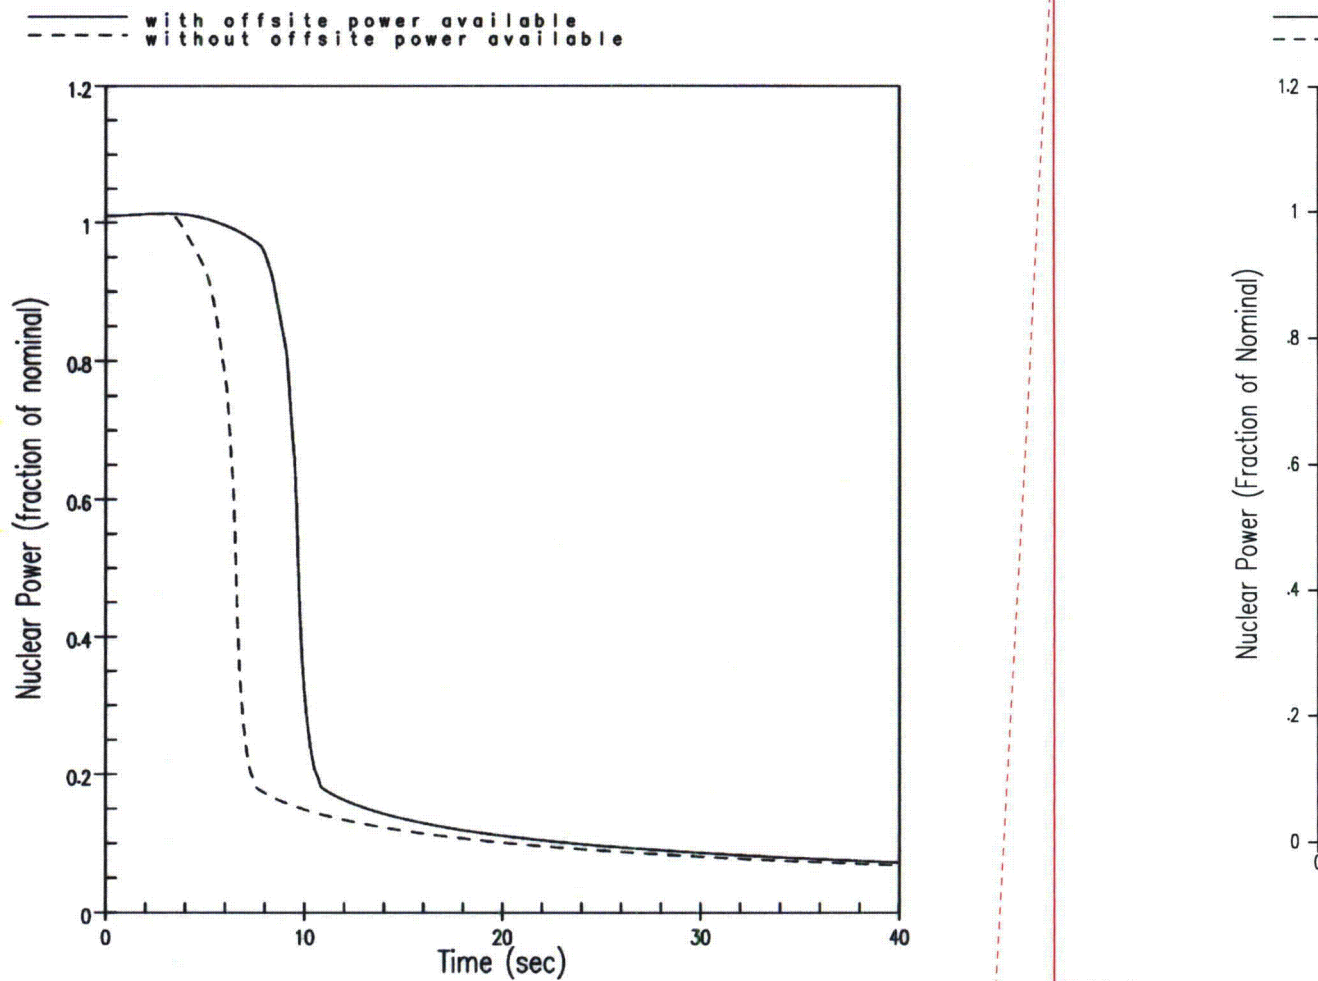


Figure 15.2.3-15

**Nuclear Power versus Time for Turbine Trip
Accident Without Pressurizer Spray and Minimum Moderator Feedback**

Deleted: (Fraction of Nominal)

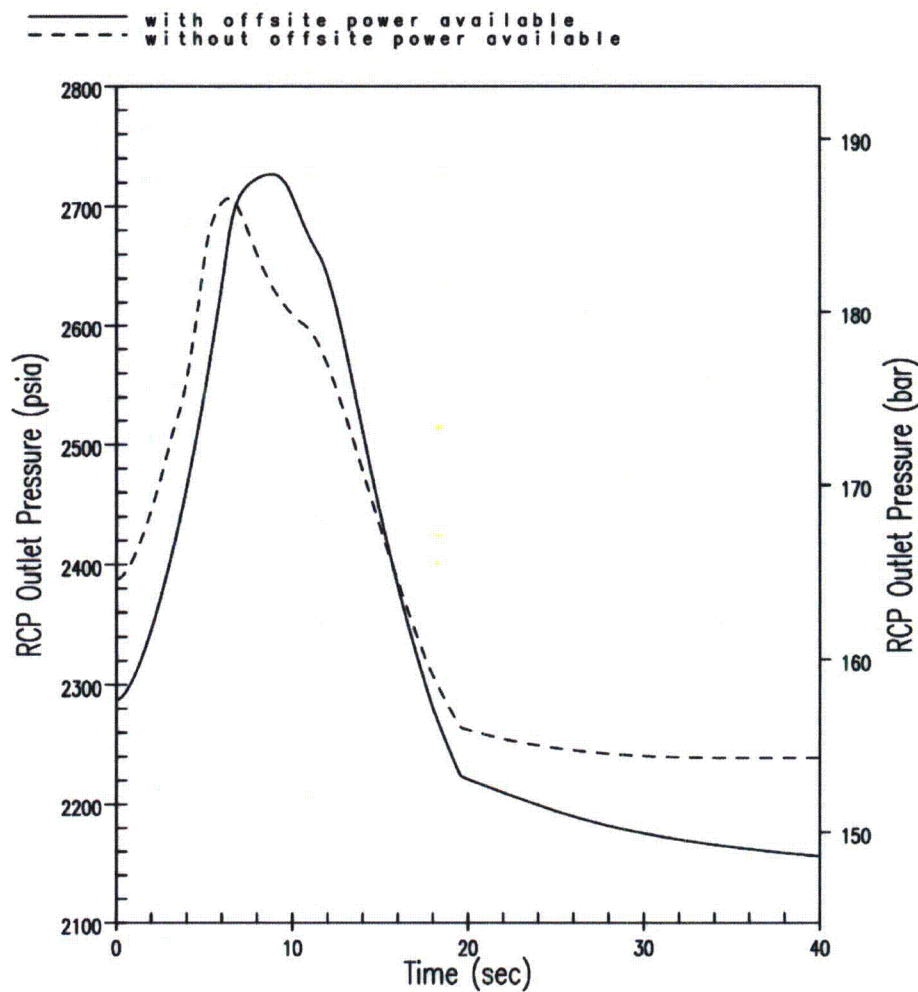

Deleted:

Figure 15.2.3-16

**RCP Outlet Pressure versus Time for Turbine Trip
Accident Without Pressurizer Spray and Minimum Moderator Feedback**

Deleted: Pressurizer

Deleted: (psia)

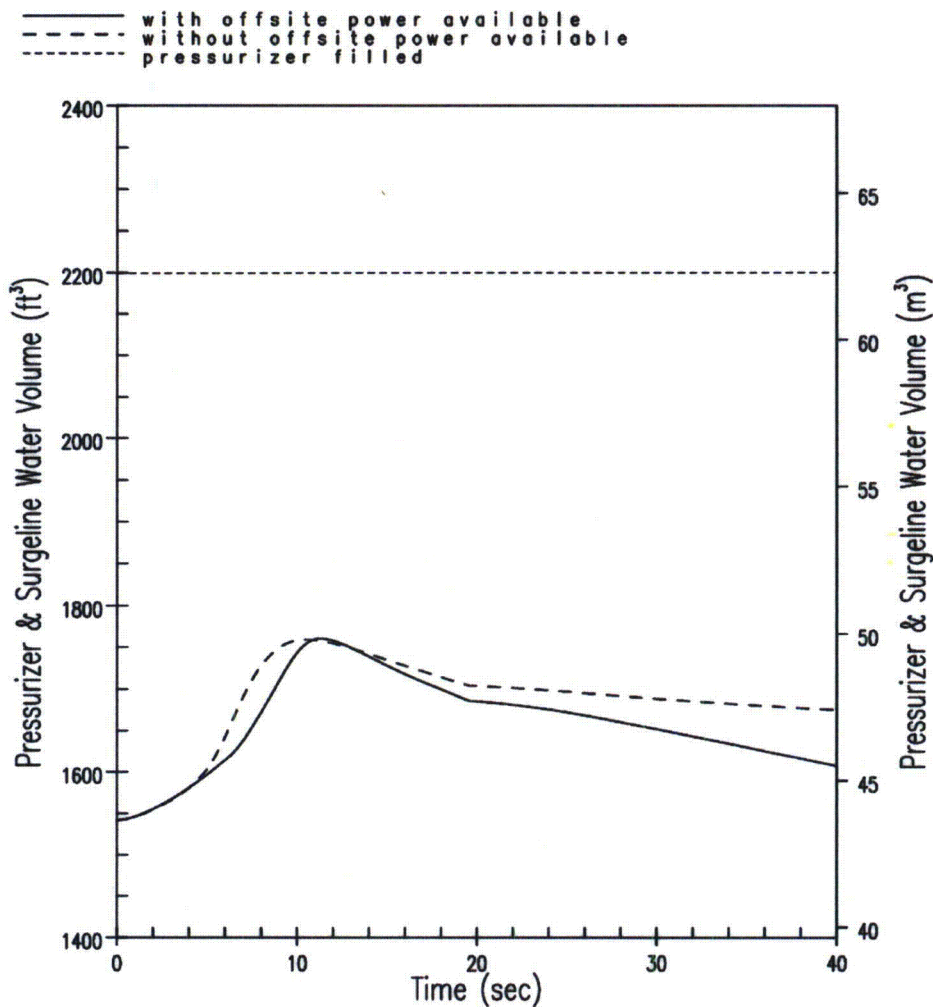


Figure 15.2.3-17

Pressurizer & Surgeline Water Volume versus Time for Turbine Trip
 Accident Without Pressurizer Spray and Minimum Moderator Feedback

Deleted: (ft³)


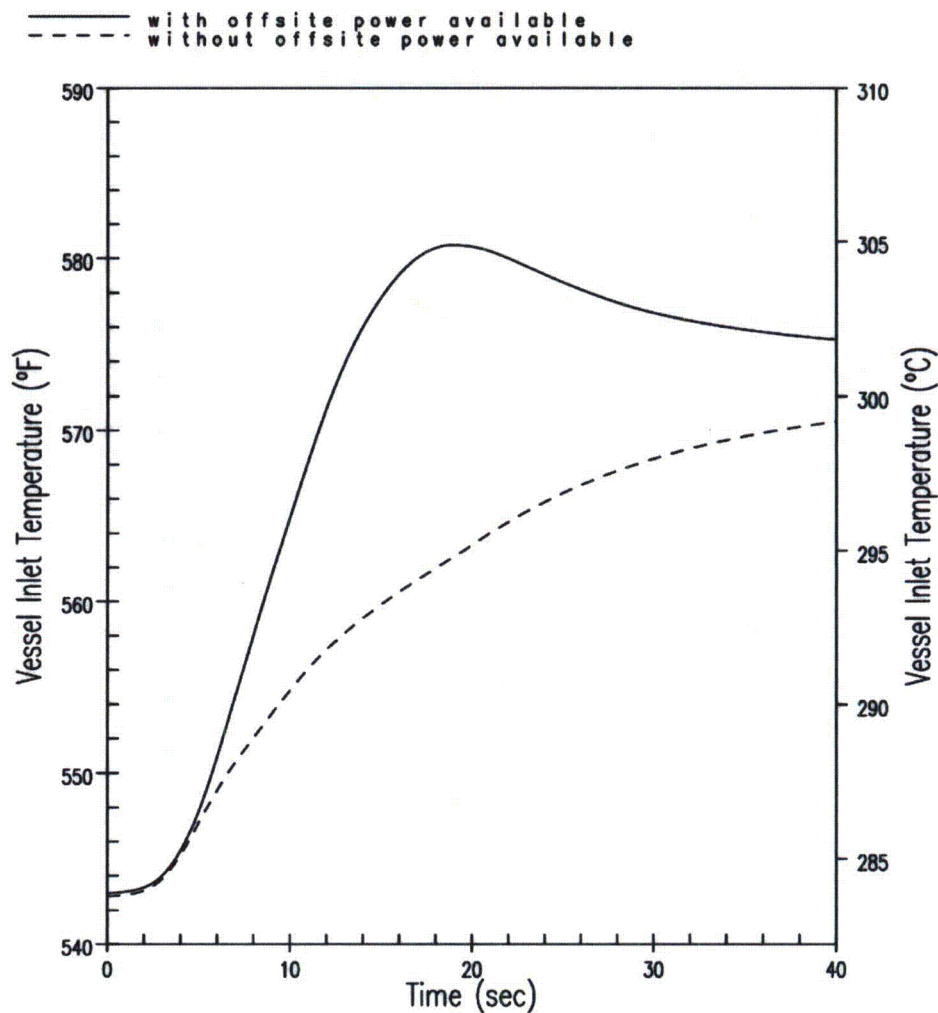


Figure 15.2.3-18

Vessel Inlet Temperature versus Time for Turbine Trip
Accident Without Pressurizer Spray and Minimum Moderator Feedback

Deleted: (°F)

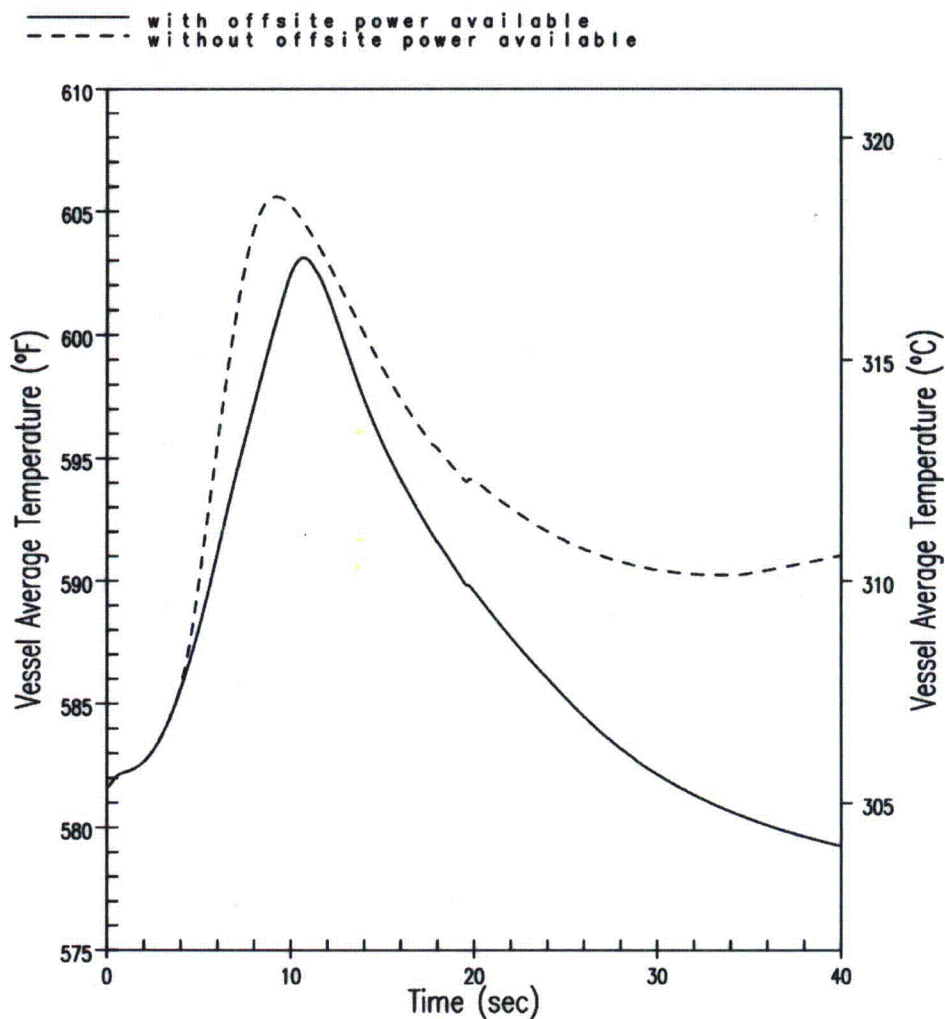


Deleted:

Figure 15.2.3-19

**Vessel Average Temperature versus Time for Turbine Trip
Accident Without Pressurizer Spray and Minimum Moderator Feedback**

Deleted: (°F)

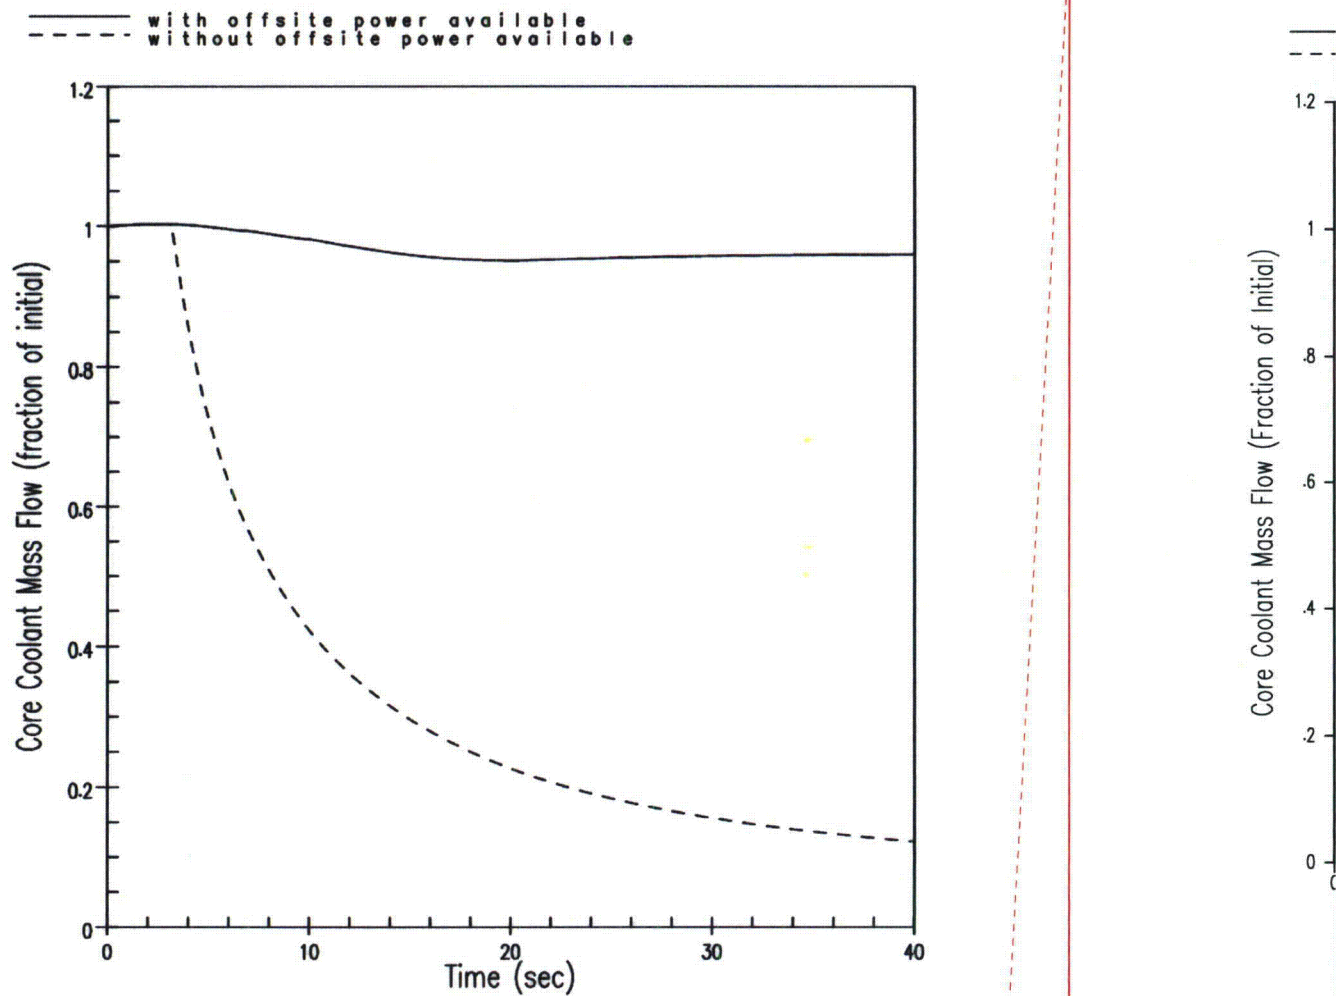

Deleted:

Figure 15.2.3-20

**Core Coolant Mass Flow Rate versus Time for Turbine Trip
Accident Without Pressurizer Spray and Minimum Moderator Feedback**

Deleted: (Fraction of Initial)


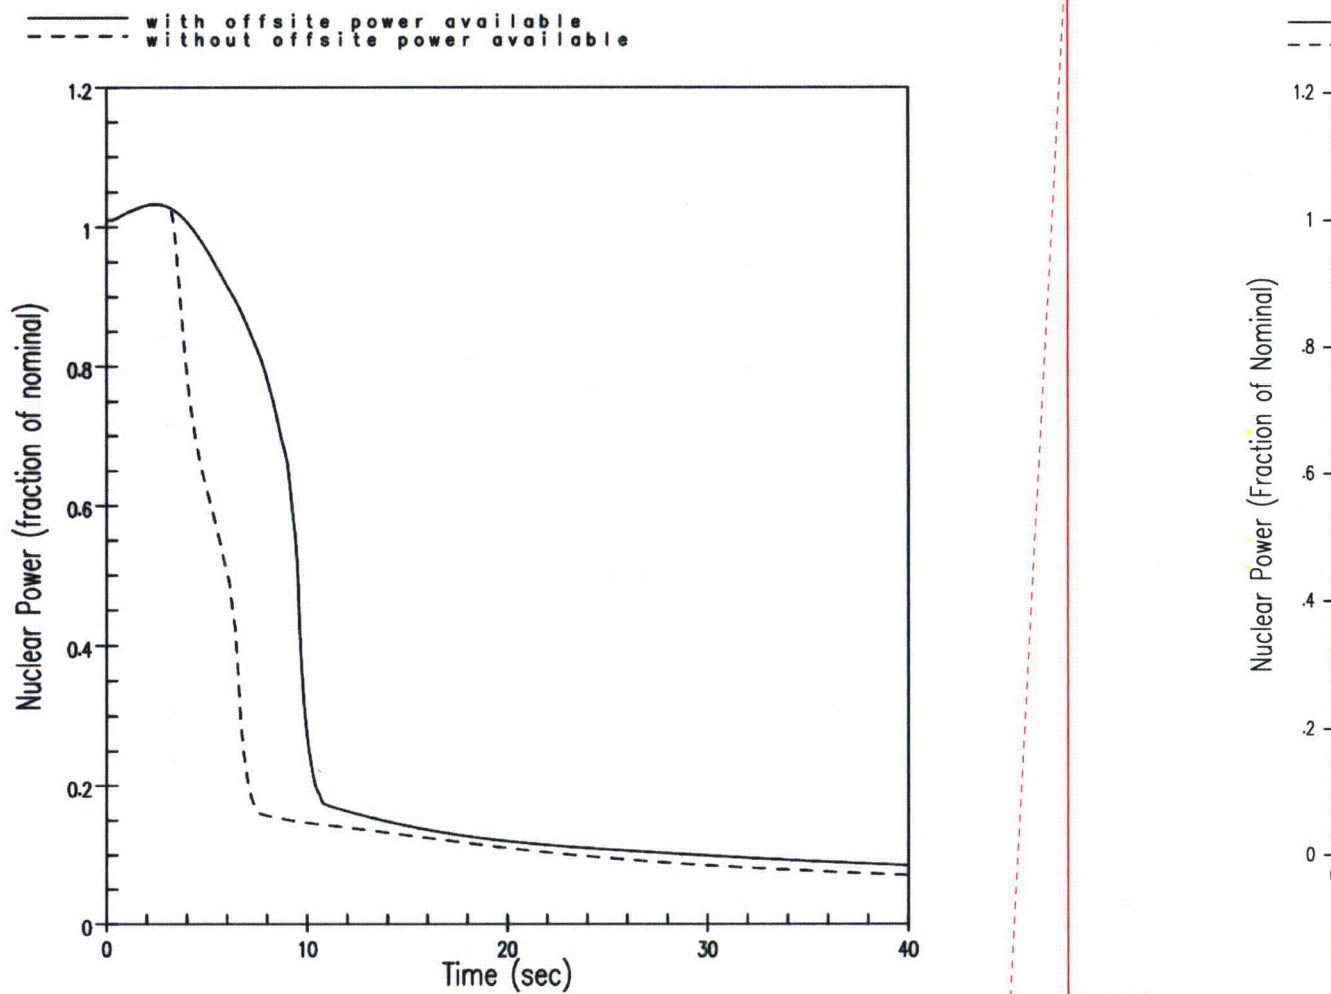


Figure 15.2.3-21

Nuclear Power versus Time for Turbine Trip
Accident Without Pressurizer Spray and Maximum Moderator Feedback

Deleted: (Fraction of Nominal)

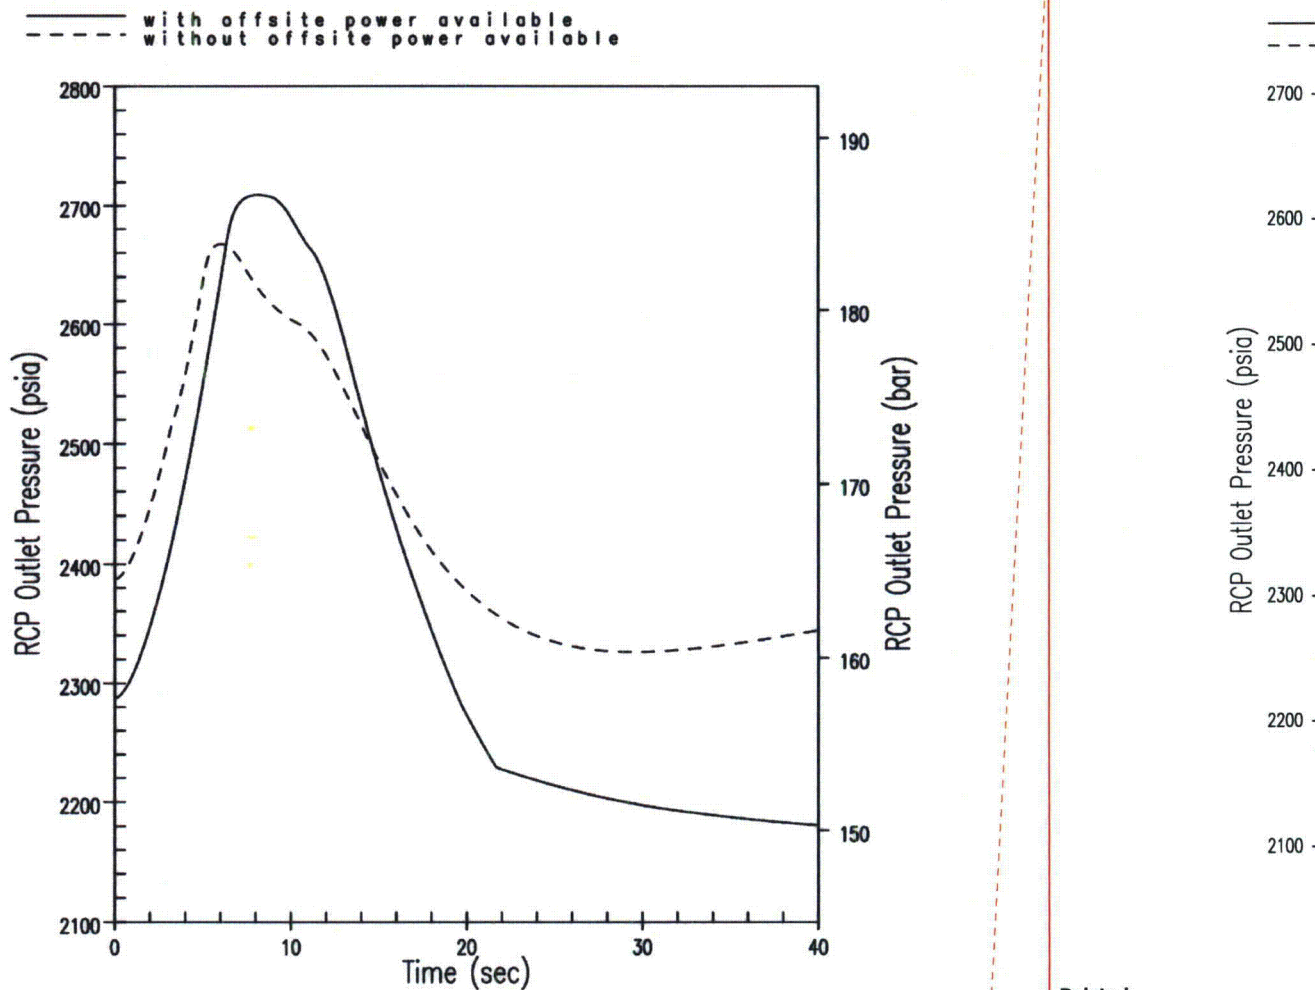


Deleted:

Figure 15.2.3-22

**RCP Outlet Pressure versus Time for Turbine Trip
Accident Without Pressurizer Spray and Maximum Moderator Feedback**

Deleted: Pressurizer

Deleted: (psia)

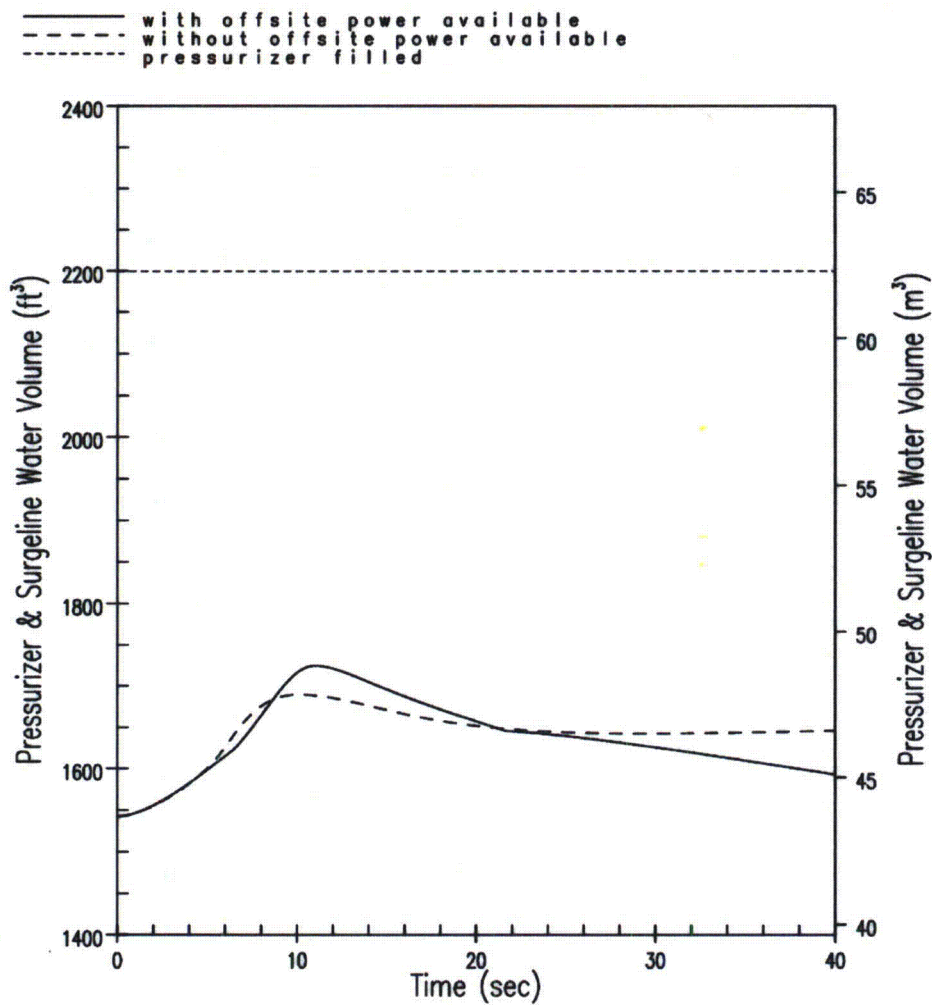

Deleted:

Figure 15.2.3-23

Pressurizer & Surgeline Water Volume versus Time for Turbine Trip
 Accident Without Pressurizer Spray and Maximum Moderator Feedback

Deleted: (ft³)

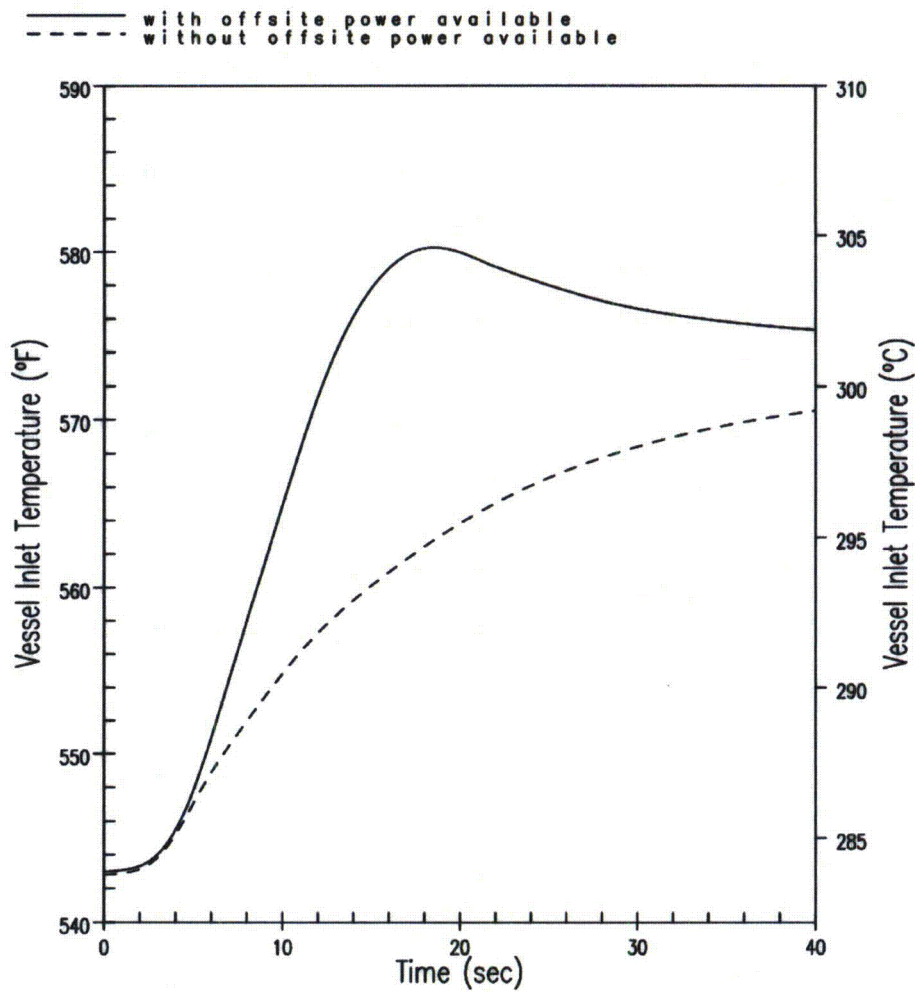


Figure 15.2.3-24

**Vessel Inlet Temperature versus Time for Turbine Trip
Accident Without Pressurizer Spray and Maximum Moderator Feedback**

Deleted: (°F)


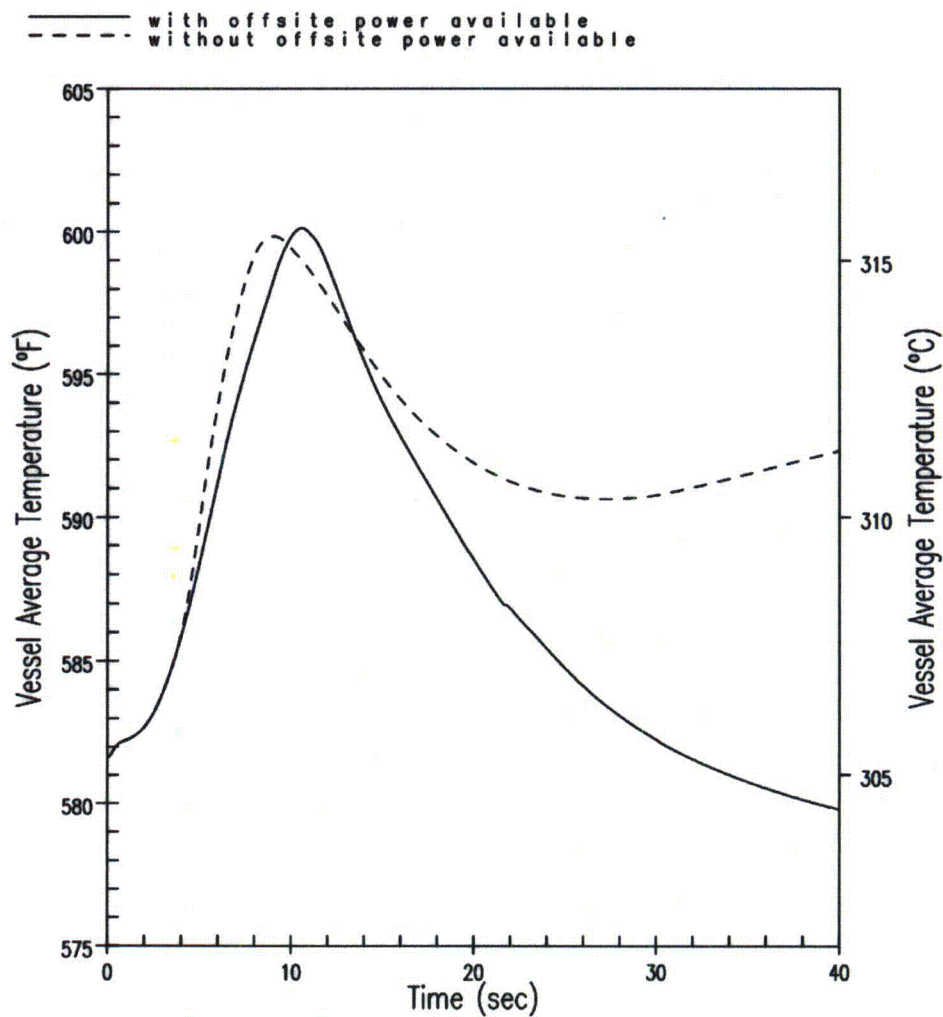


Figure 15.2.3-25

Vessel Average Temperature versus Time for Turbine Trip
 Accident Without Pressurizer Spray and Maximum Moderator Feedback

Deleted: (°F)

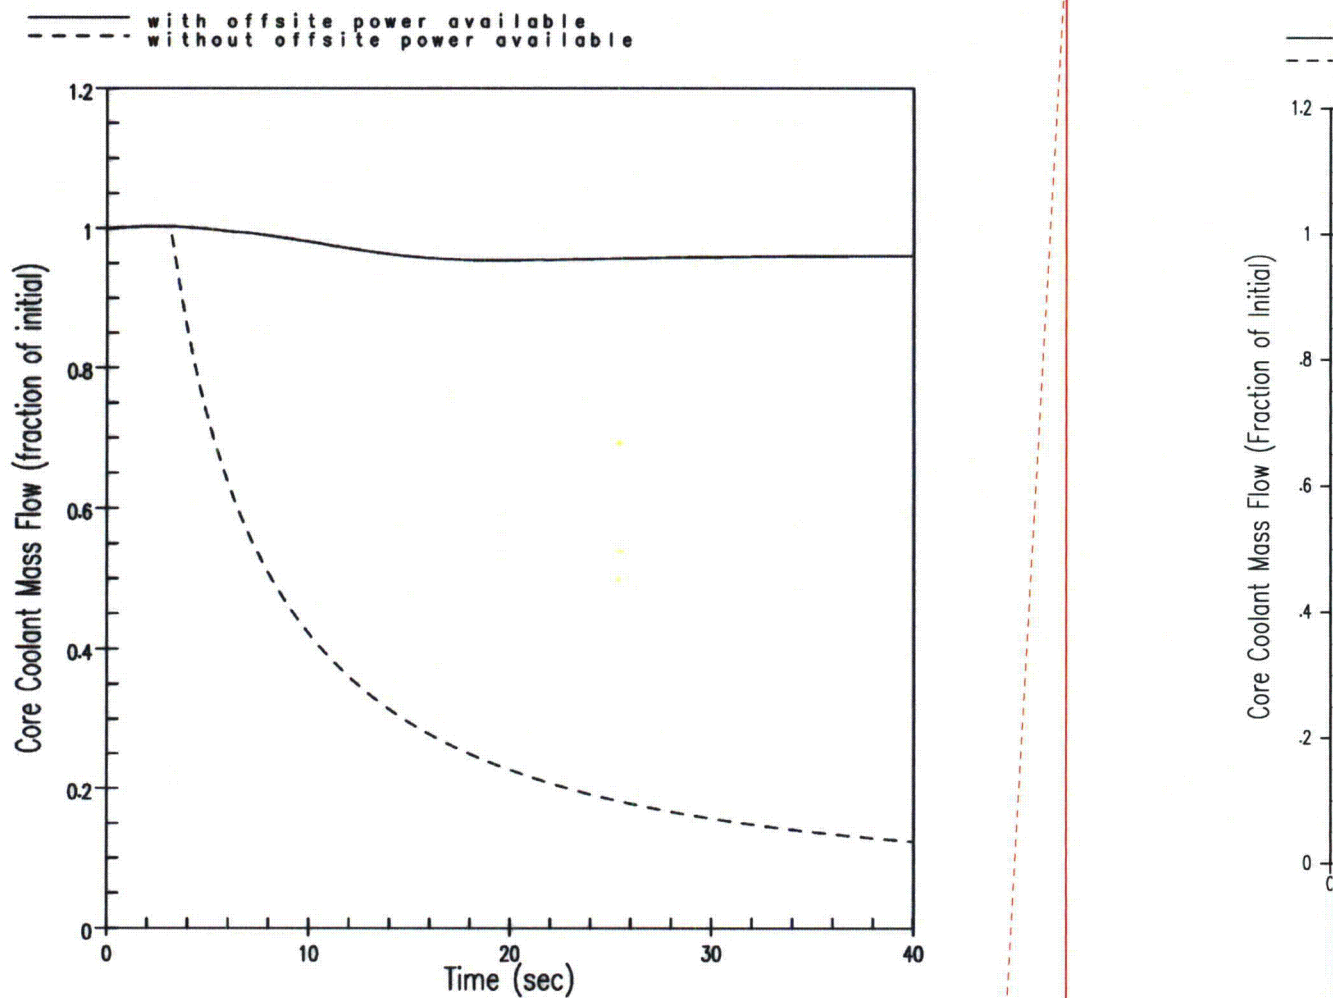


Deleted:

Figure 15.2.3-26

**Core Coolant Mass Flow Rate versus Time for Turbine Trip
Accident Without Pressurizer Spray and Maximum Moderator Feedback**

Deleted: (Fraction of Initial)

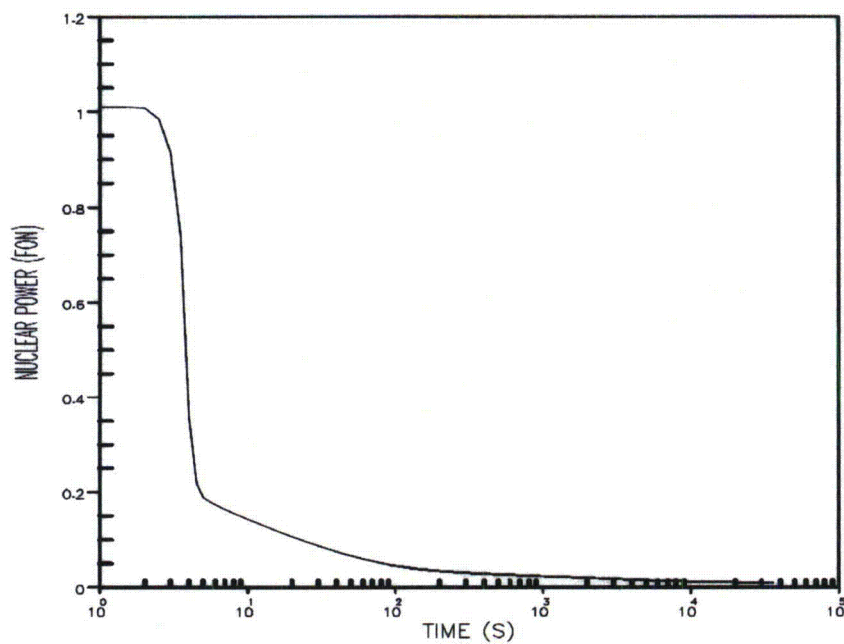

Deleted:

Figure 15.2.6-1

**Nuclear Power Transient for Loss
of ac Power to the Plant Auxiliaries**


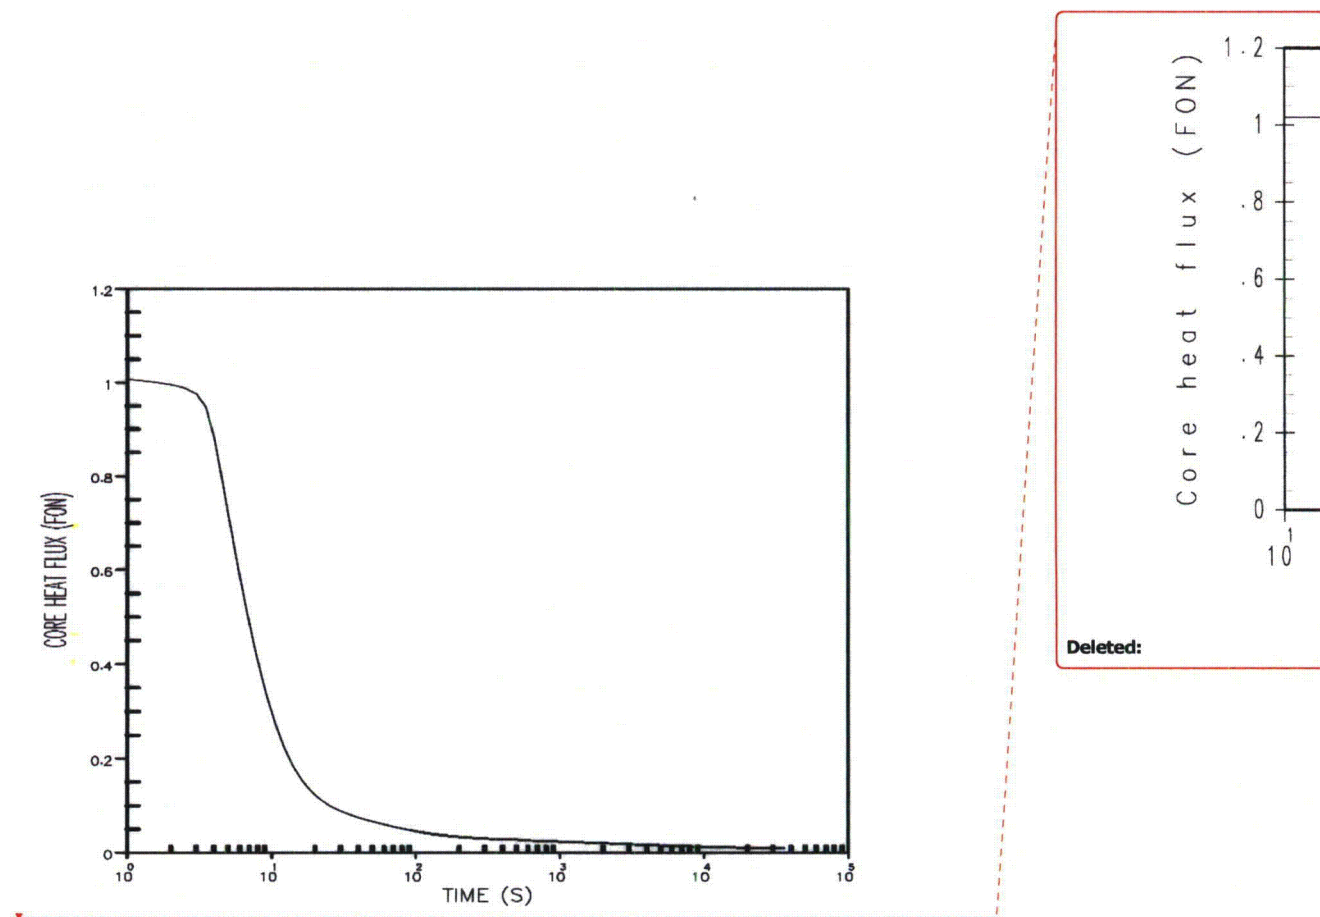


Figure 15.2.6-2

**Core Heat Flux Transient for Loss
of ac Power to the Plant Auxiliaries**

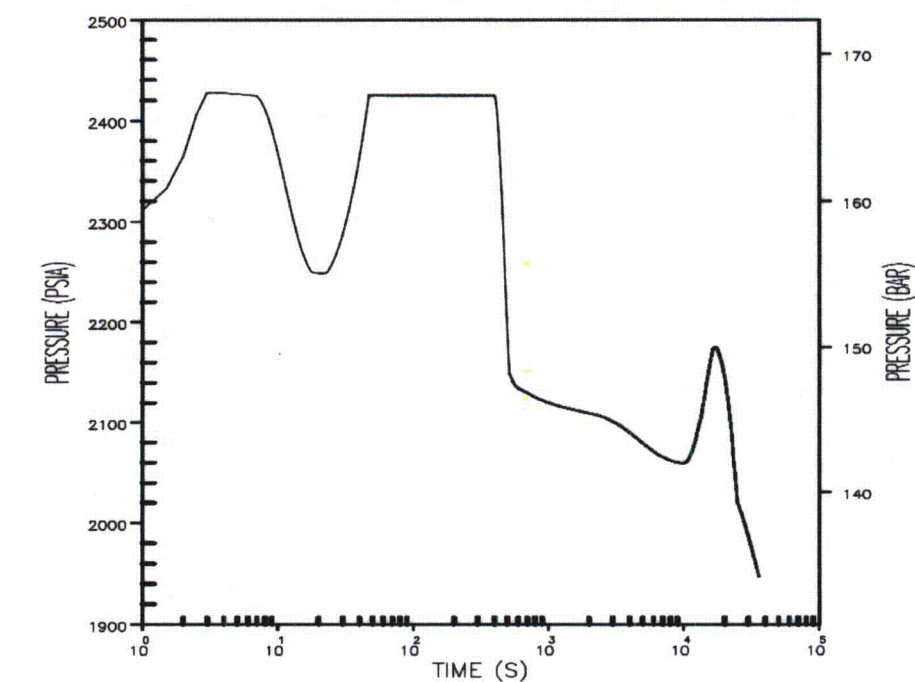


Deleted:

Figure 15.2.6-3

**Pressurizer Pressure Transient for Loss
of ac Power to the Plant Auxiliaries**

15.2-62

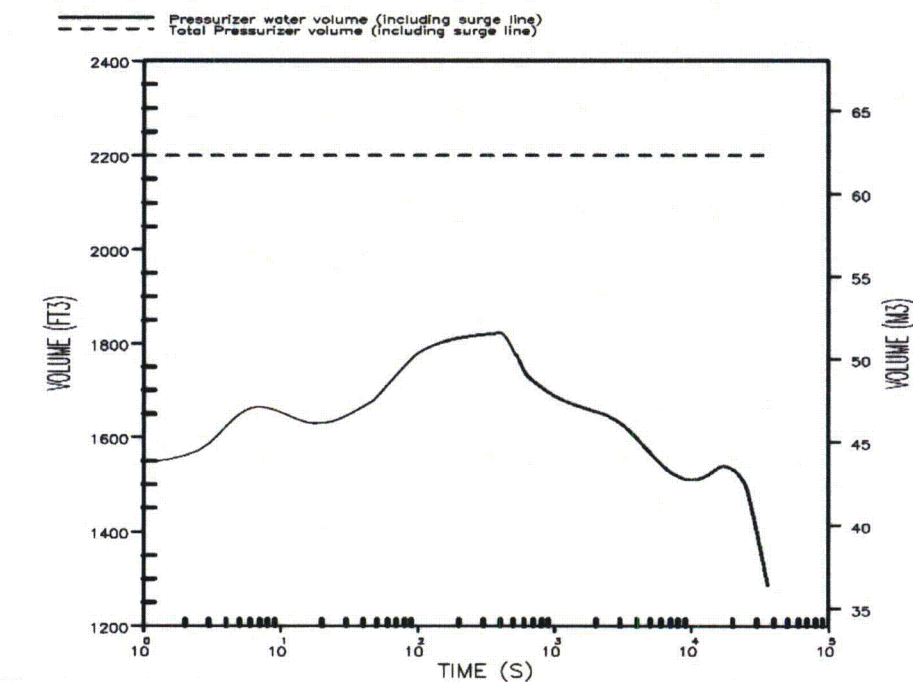


Deleted:

Figure 15.2.6-4

**Pressurizer Water Volume Transient for Loss
of ac Power to the Plant Auxiliaries**

15.2-63

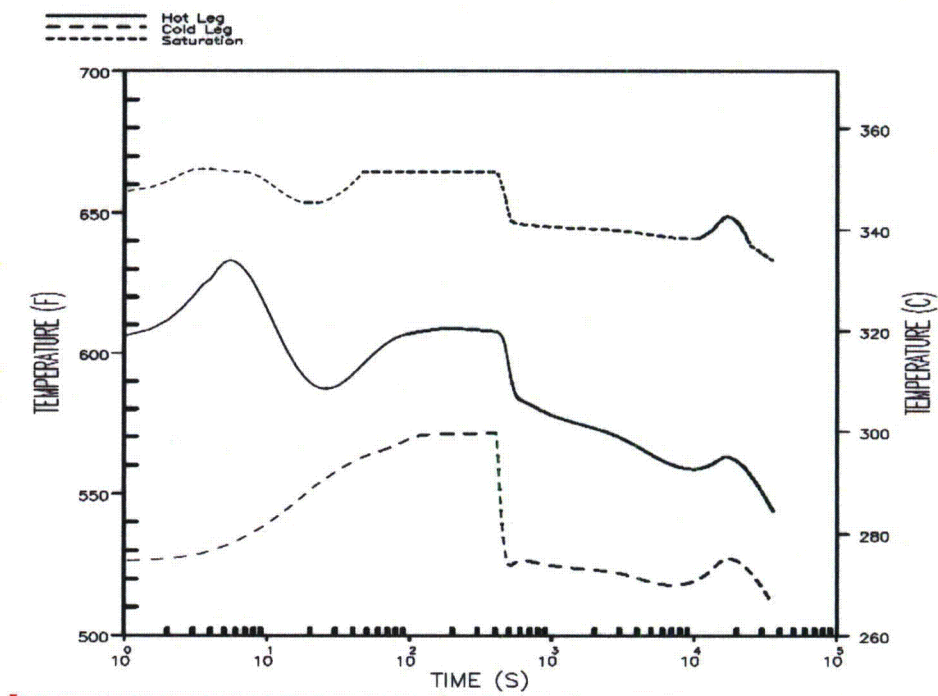

Deleted:

Figure 15.2.6-5

**Reactor Coolant System Temperature Transients in Loop
Containing the PRHR for Loss of ac Power to the Plant Auxiliaries**

15.2-64


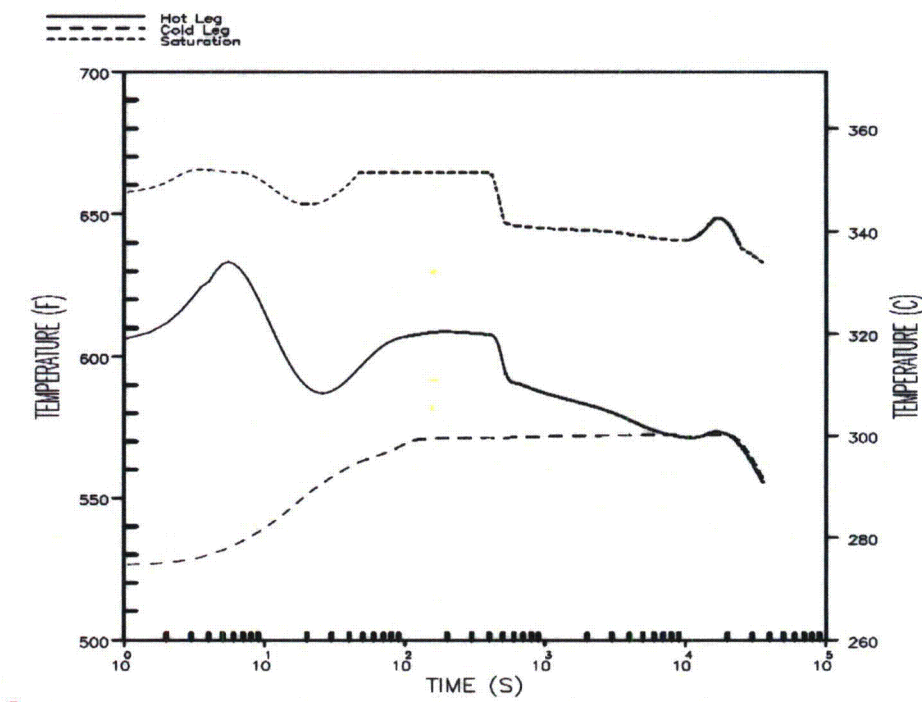


Figure 15.2.6-6

**Reactor Coolant System Temperature Transients in Loop Not
Containing the PRHR for Loss of ac Power to the Plant Auxiliaries**

15.2-65

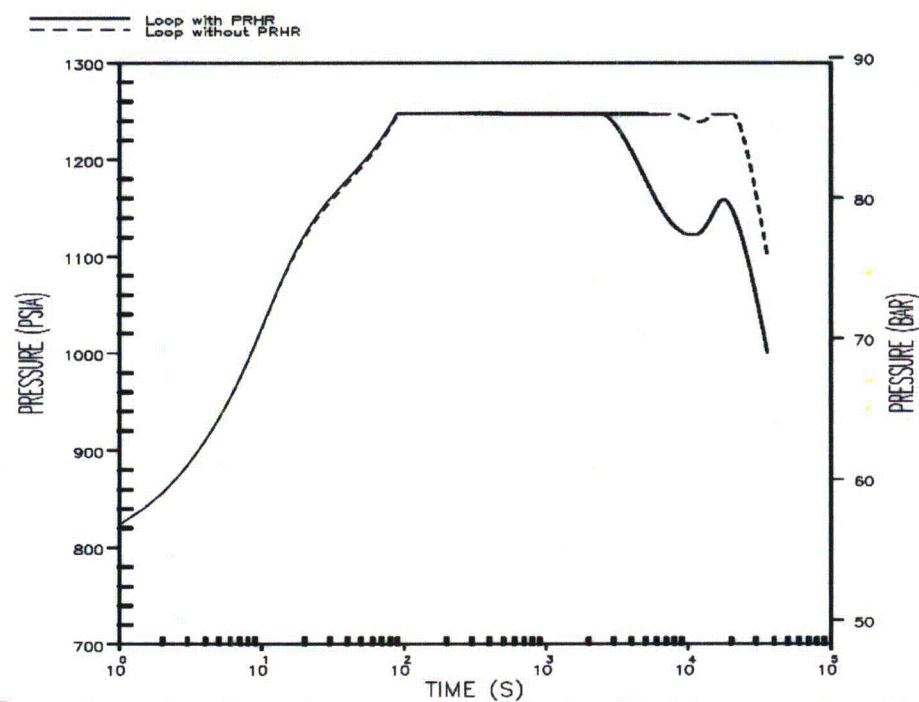


Deleted:

Figure 15.2.6-7

**Steam Generator Pressure Transient
for Loss of ac Power to the Plant Auxiliaries**

15.2-66

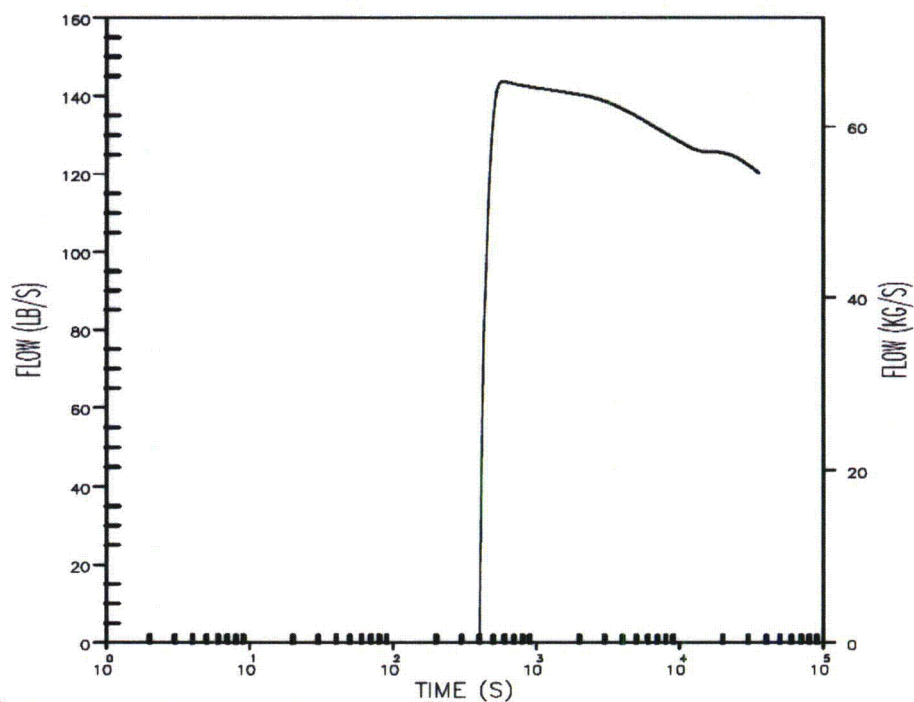


Deleted:

Figure 15.2.6-8

**PRHR Flow Rate Transient
for Loss of ac Power to the Plant Auxiliaries**

15.2-67

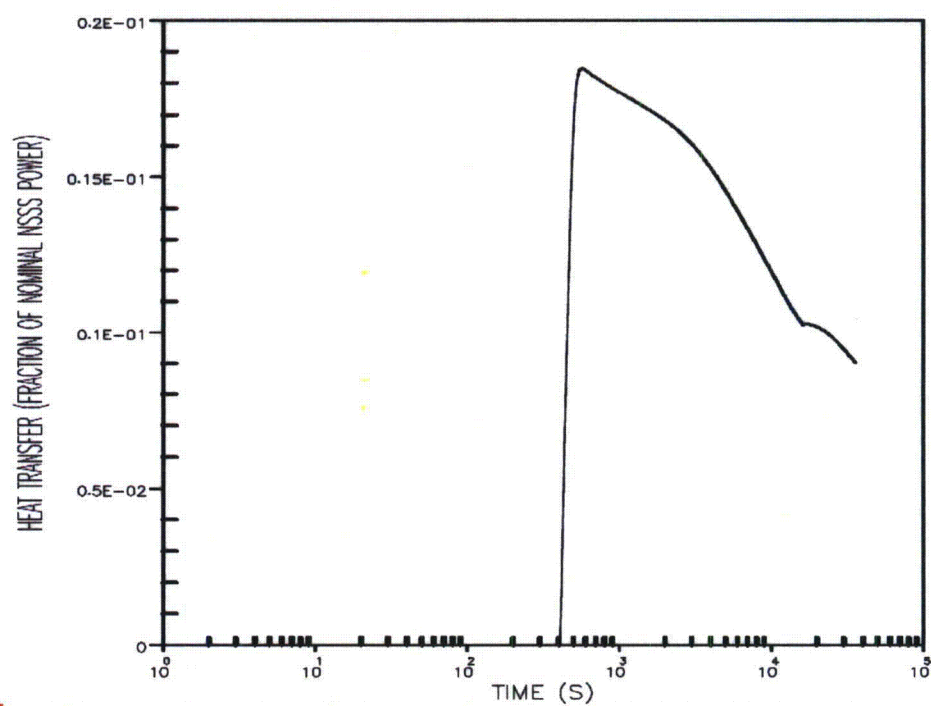

PRHR heat flux (FON)

0.2E-01

0.15E-01

0.1E-01

0.05E-01



0

Deleted:

Figure 15.2.6-9

PRHR Heat Transfer Transient
for Loss of ac Power to the Plant Auxiliaries

Deleted: Flux

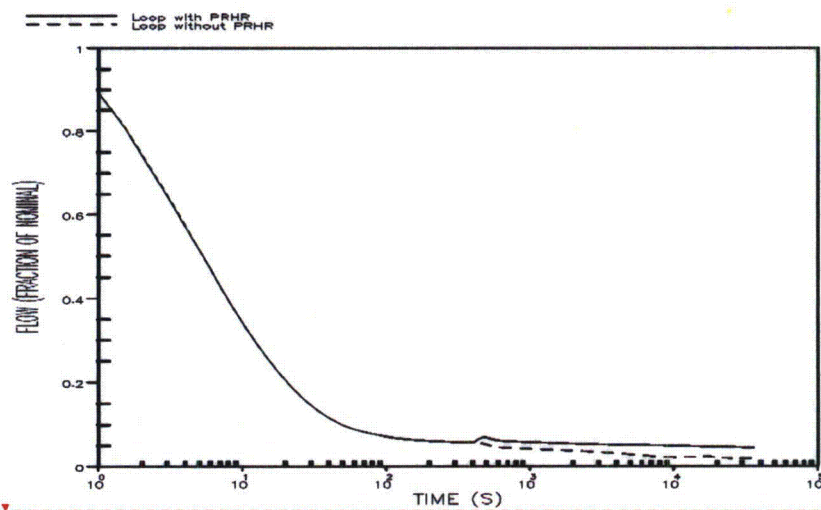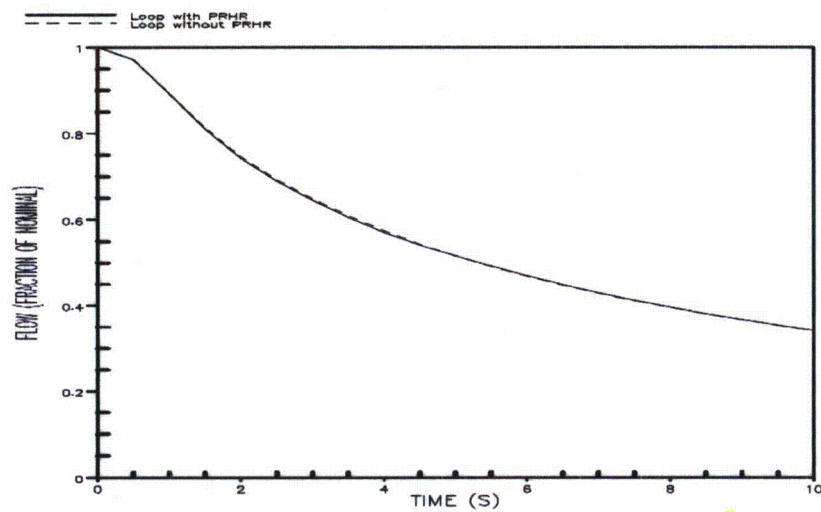

Deleted: — Page Break —


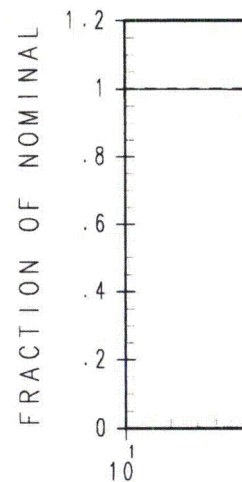
— Loop w
--- Loop w

Figure 15.2.6-10

**Reactor Coolant Volumetric Flow Rate
Transient for Loss of ac Power to the Plant Auxiliaries**

15.2-69


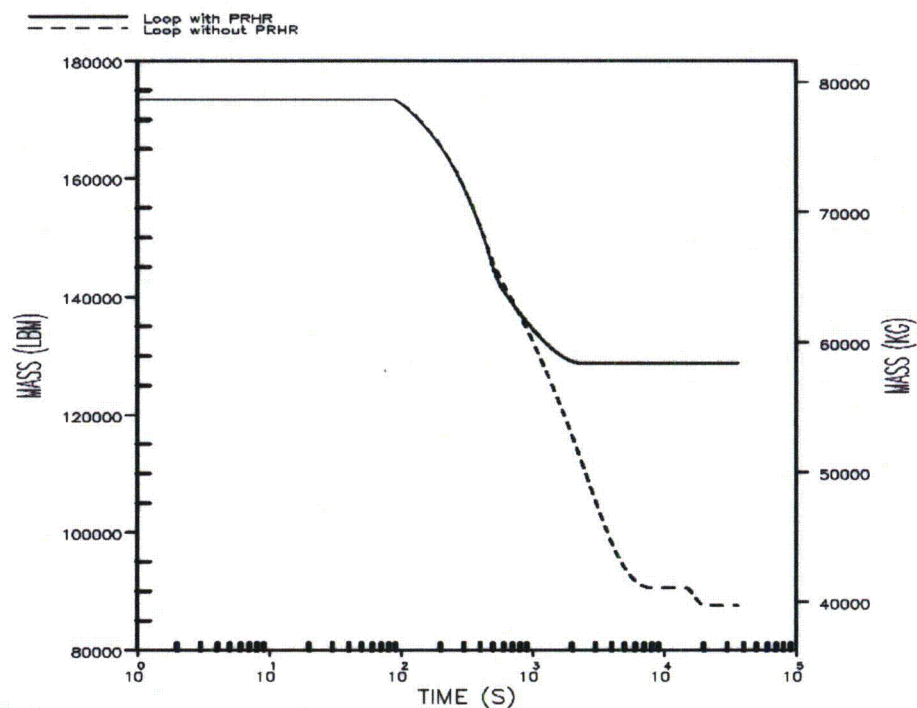


Deleted:

Figure 15.2.6-11

**Steam Generator Inventory Transient
for Loss of ac Power to the Plant Auxiliaries**

15.2-70

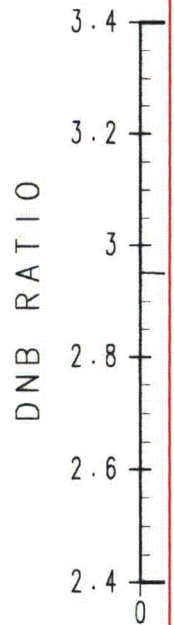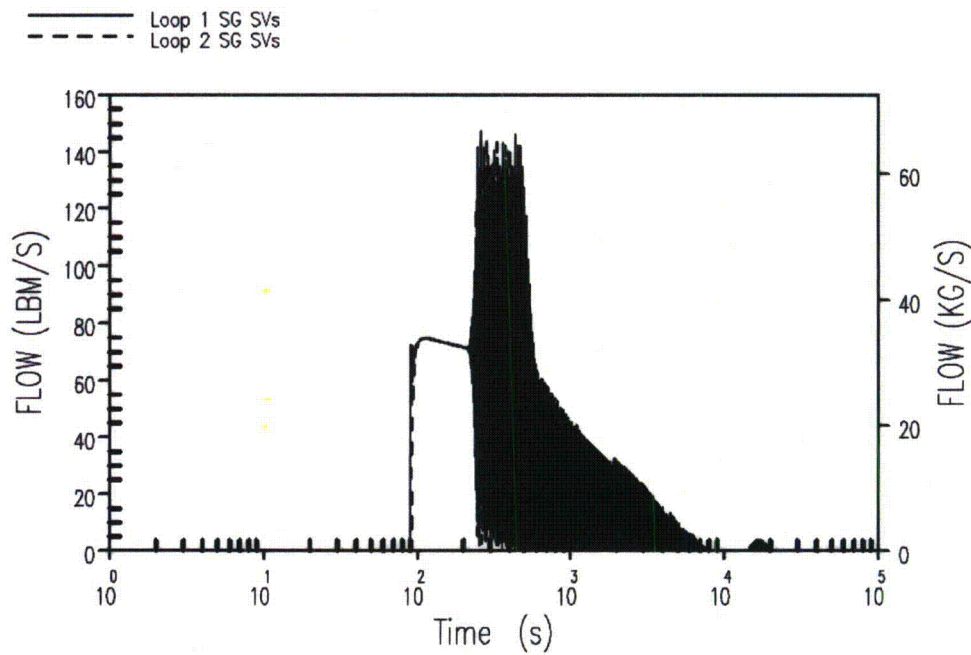

Deleted:

Figure 15.2.6-12

**Steam Generator Safety Valve Relief
for Loss of ac Power to the Plant Auxiliaries**

Deleted: DNB Ratio Transient


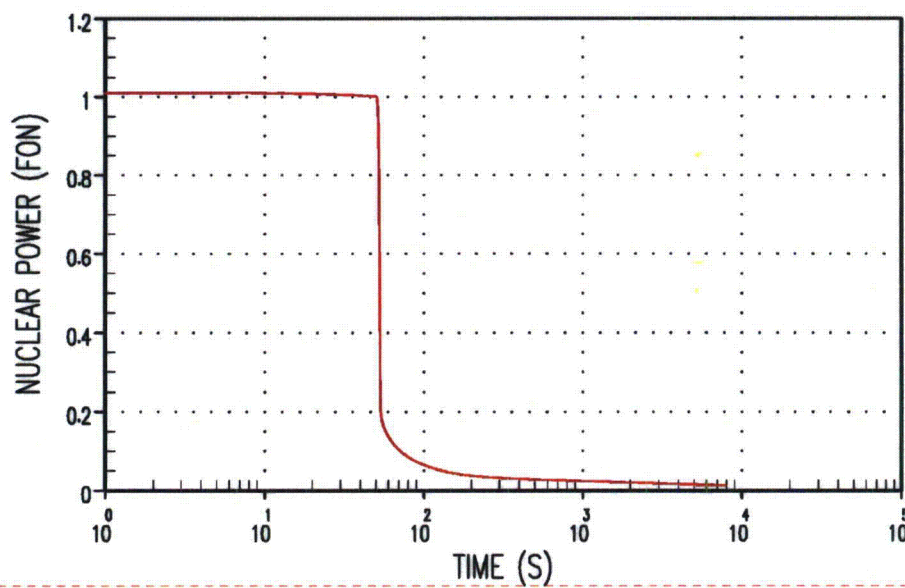


Figure 15.2.7-1

Nuclear Power Transient for Loss of
Normal Feedwater




Deleted:

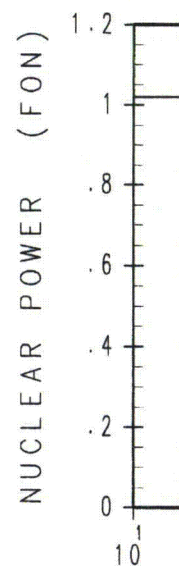


Deleted:

Comment [B8]: [15.2-8]

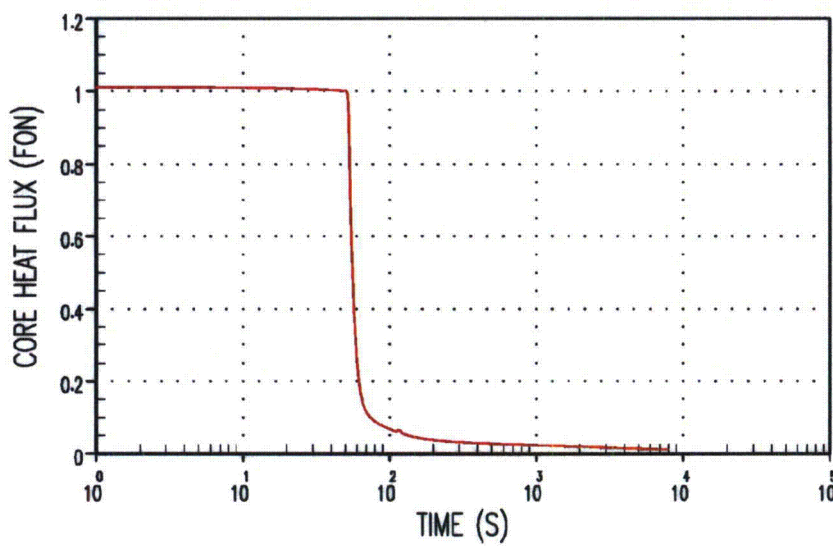

Deleted: Flow

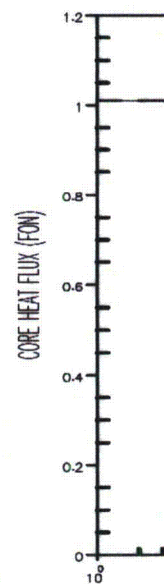

Deleted:

Figure 15.2.7-2

Core Heat Flux Transient for
for Loss of Normal Feedwater

Comment [B9]: [15.2-8]

Deleted: Reactor Coolant
System Volumetric Flow

Deleted: Flow


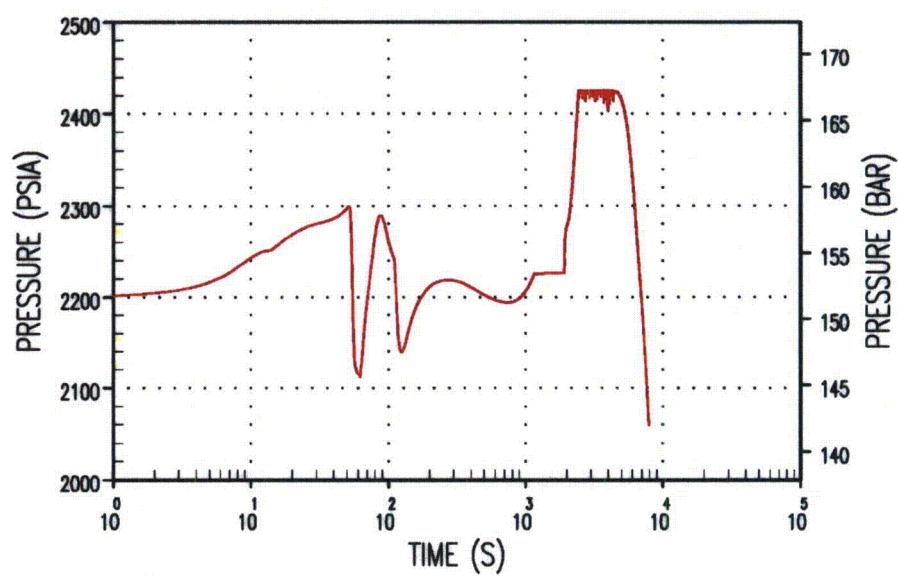



Figure 15.2.7-3

Pressurizer Pressure Transient for
Loss of Normal Feedwater

15.2-74

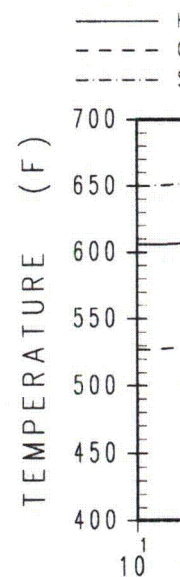

Deleted:

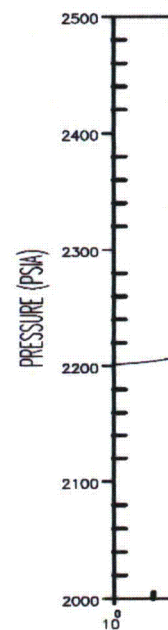

Deleted:

Comment [B10]: [15.2-8]

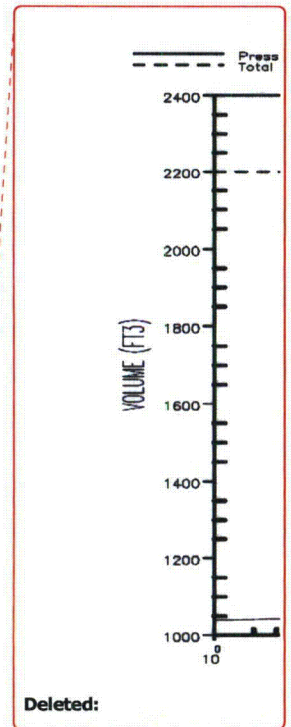
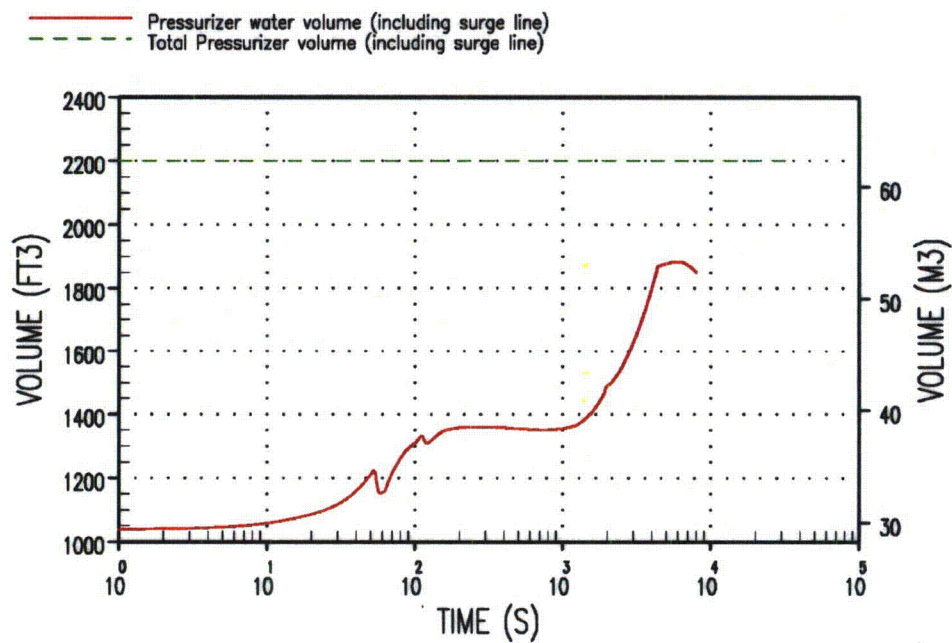


Figure 15.2.7-4

Comment [B11]: [15.2-8]

**Pressurizer Water Volume Transient
 for Loss of Normal Feedwater**

15.2-75




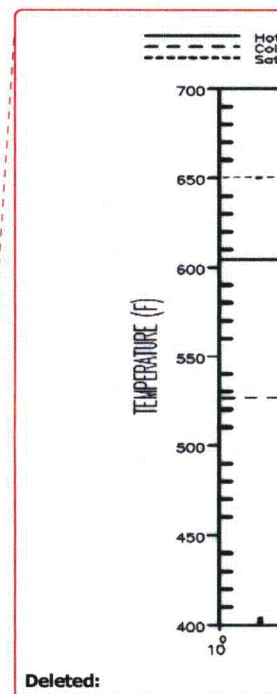


Figure 15.2.7-5


Comment [B12]: [15.2-8]

Reactor Coolant System Temperature Transients in Loop
Containing the PRHR for Loss of Normal Feedwater Flow

15.2-76

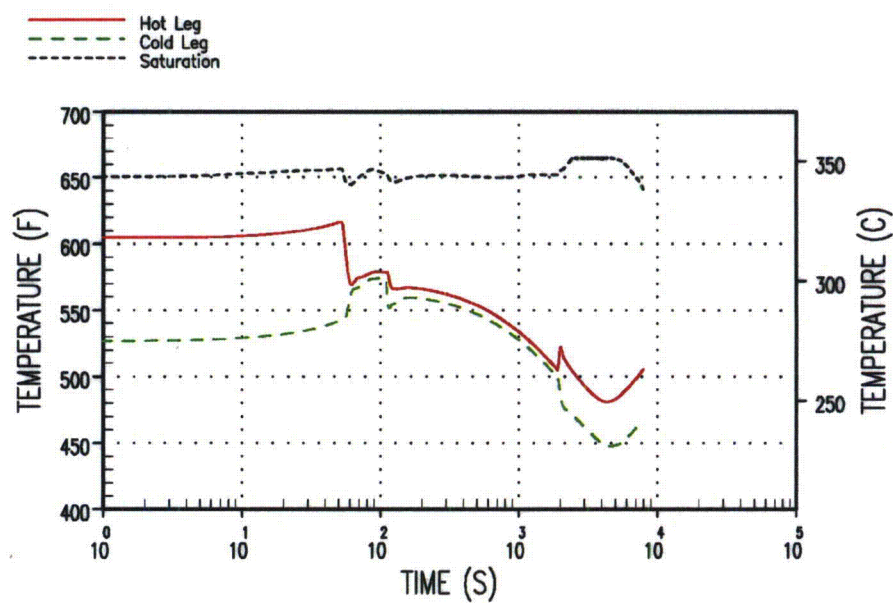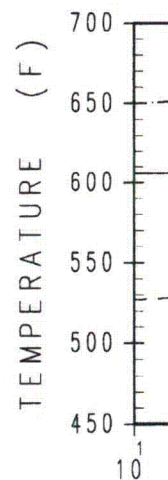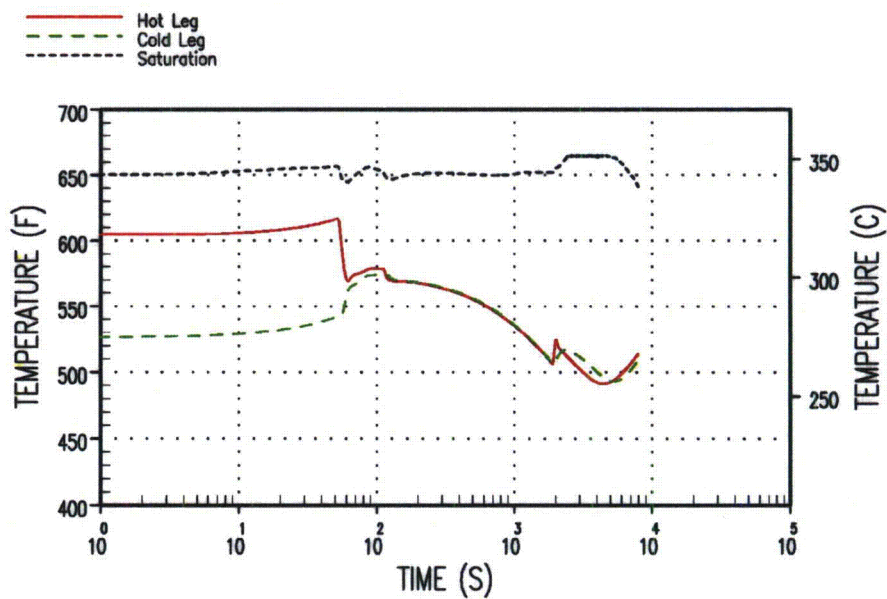

Deleted:

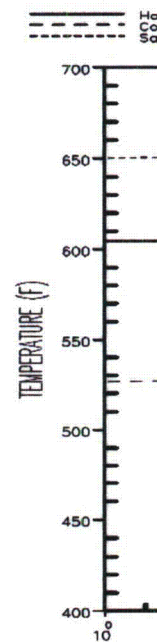

Deleted:

Comment [B13]: [15.2-8]

Deleted: 4

Deleted: Transients

Figure 15.2.7-6

Reactor Coolant System Temperature Transient
in Loop Not Containing the PRHR for Loss of Normal Feedwater Flow

15.2-77

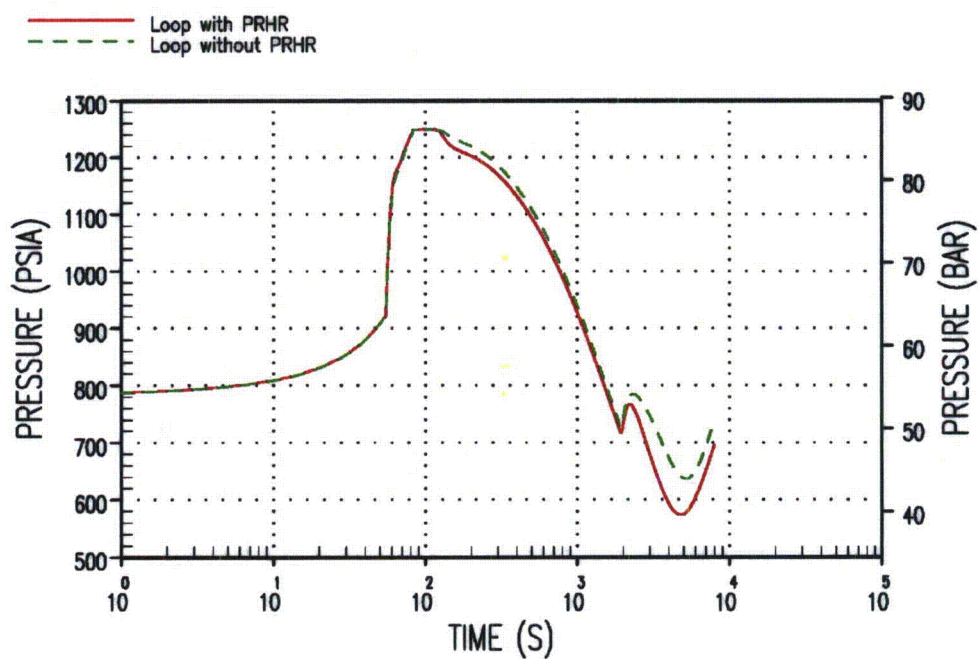


Figure 15.2.7-7

Steam Generator Pressure Transient
for Loss of Normal Feedwater

Deleted:

Deleted:

Comment [B14]: [15.2-8]

Deleted: Flow

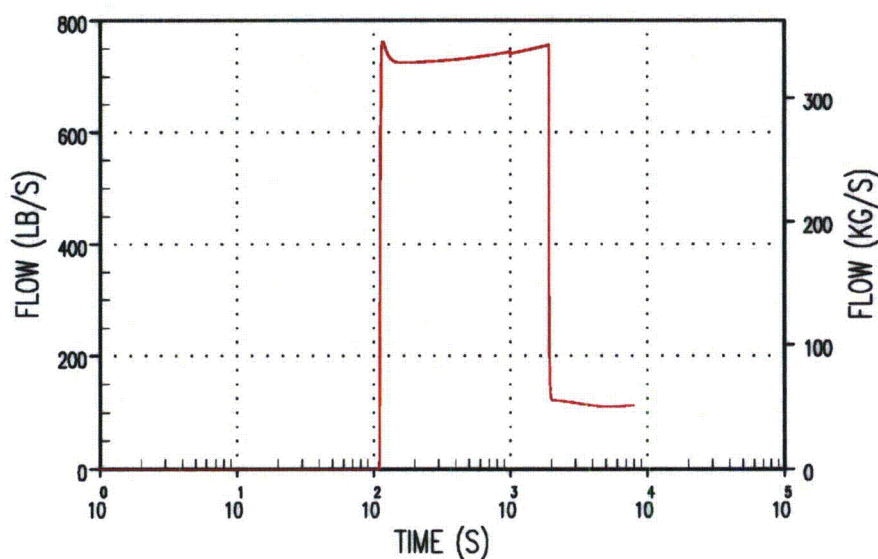


Figure 15.2.7-8

PRHR Flow Rate Transient
for Loss of Normal Feedwater.

MASS (LBM)

240000
220000
200000
180000
160000
140000
120000
100000
80000
60000
1

Deleted:

FLOW (LB/S)

800
600
400
200
0

Deleted:

Comment [B15]: [15.2-8]

Deleted: Steam Generator

Inventory...RHR Flow P... [46]

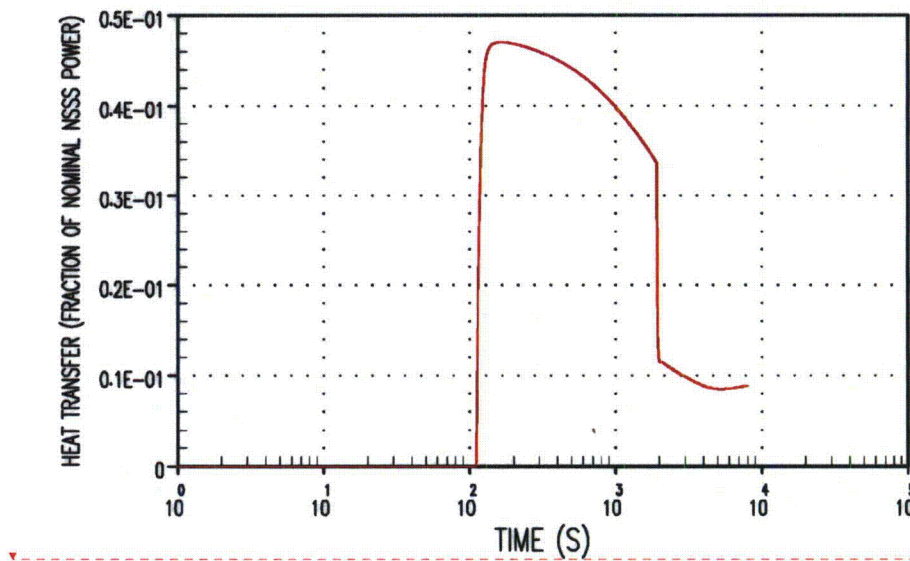


Figure 15.2.7-9

PRHR Heat Transfer Transient
for Loss of Normal Feedwater:

PRHR heat flux (FON)

0.6E-01
0.5E-01
0.4E-01
0.3E-01
0.2E-01
0.1E-01
0
1

Deleted:

HEAT TRANSFER (FRACTION OF NOMINAL NSSS POWER)

0.5E-01
0.4E-01
0.3E-01
0.2E-01
0.1E-01
0
10

Deleted:

Comment [B16]: [15.2-8]

Deleted: Flux...ransfer ... [47]

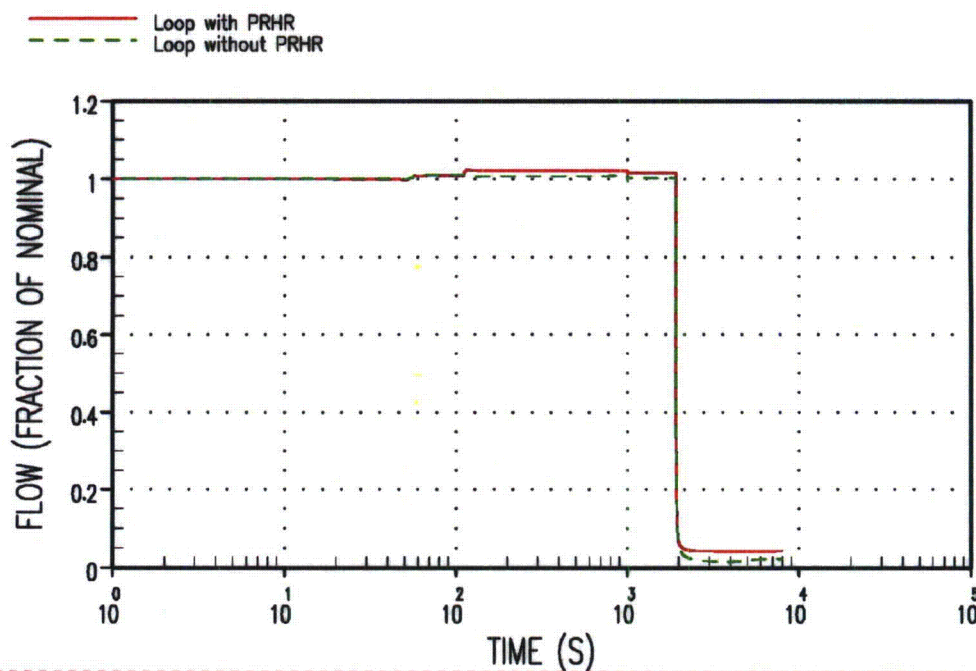


Figure 15.2.7-10

Reactor Coolant Volumetric Flow
Transient for Loss of Normal Feedwater

CMT injection flow (lb/s)

140
120
100
80
60
40
20
0
10

Deleted:

FLOW (FRACTION OF NOMINAL)

1.2
1
0.8
0.6
0.4
0.2
0
10

Deleted:

Comment [B17]: [15.2-8]

Deleted: CMT Injection

Deleted: Rate ...ransier ... [48]



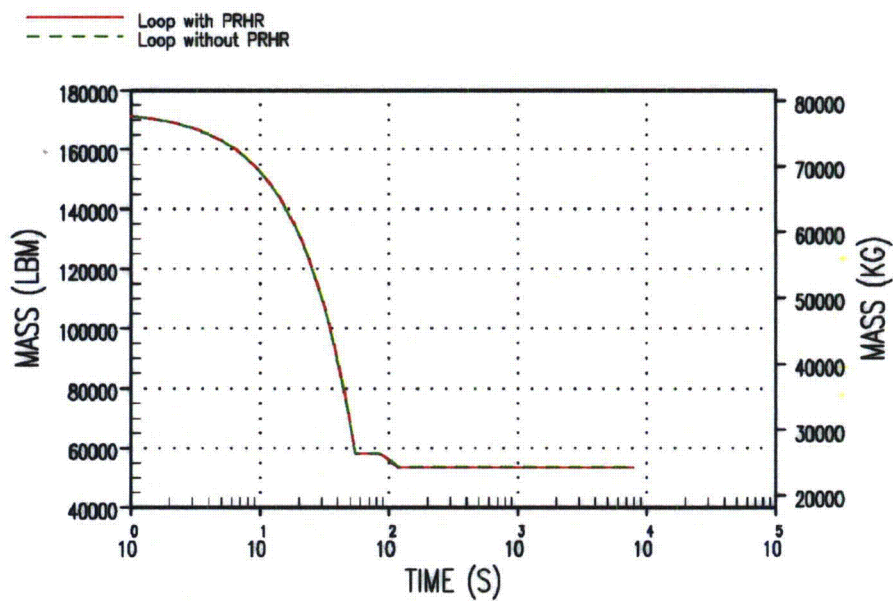


Figure 15.2.7-11

Steam Generator Inventory Transient
for Loss of Normal Feedwater

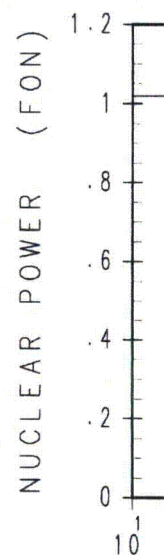

Deleted:

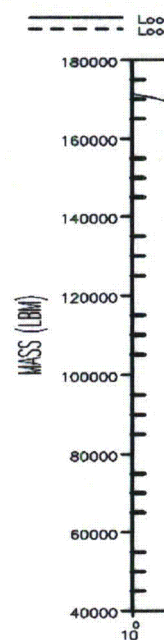

Deleted:

Comment [B18]: [15.2-8]




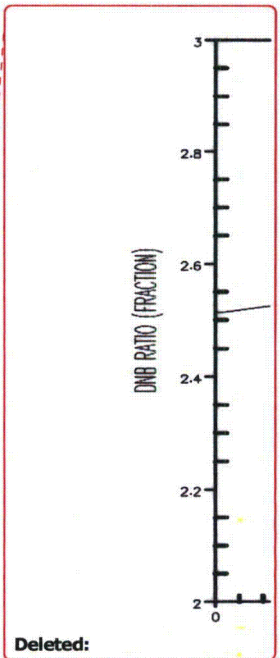


Figure 15.2.7-12

DNB Ratio Transient
for Loss of Normal Feedwater

Comment [B19]: [15.2-8]

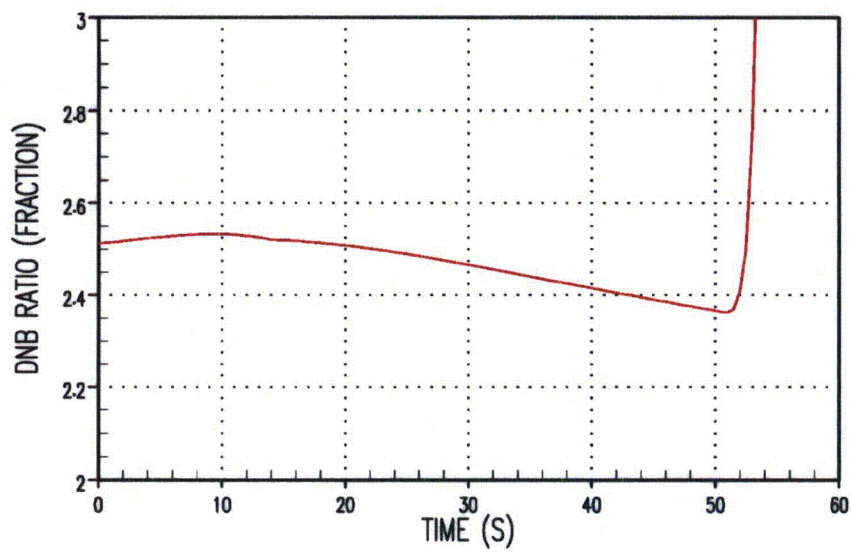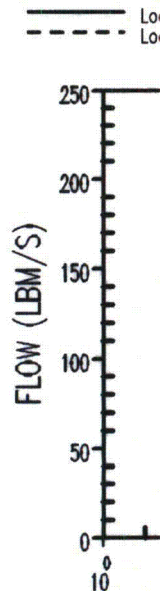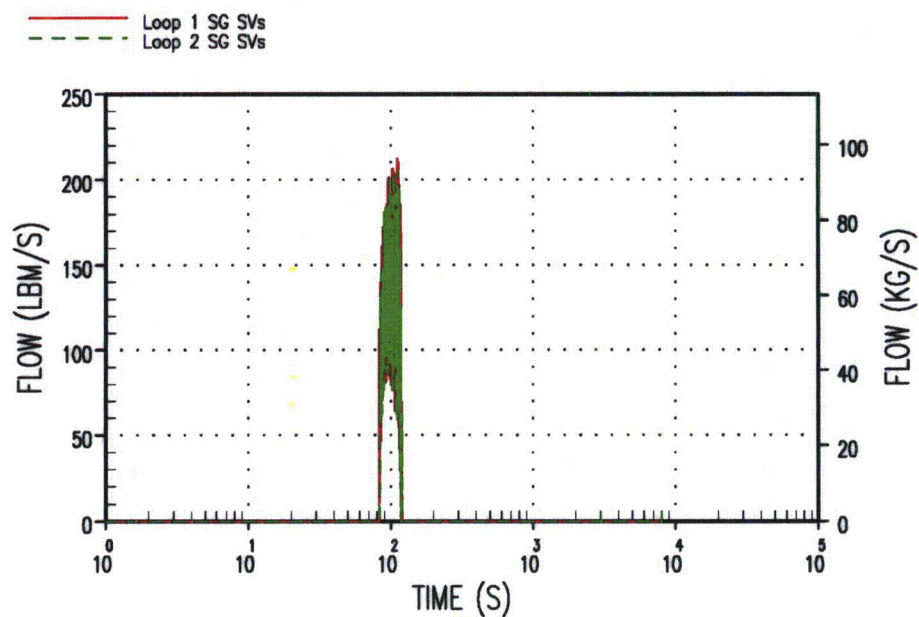

Deleted:

Figure 15.2.7-13

Steam Generator Safety Valve Relief Transient
for Loss of Normal Feedwater

Comment [B20]: [15.2-8]

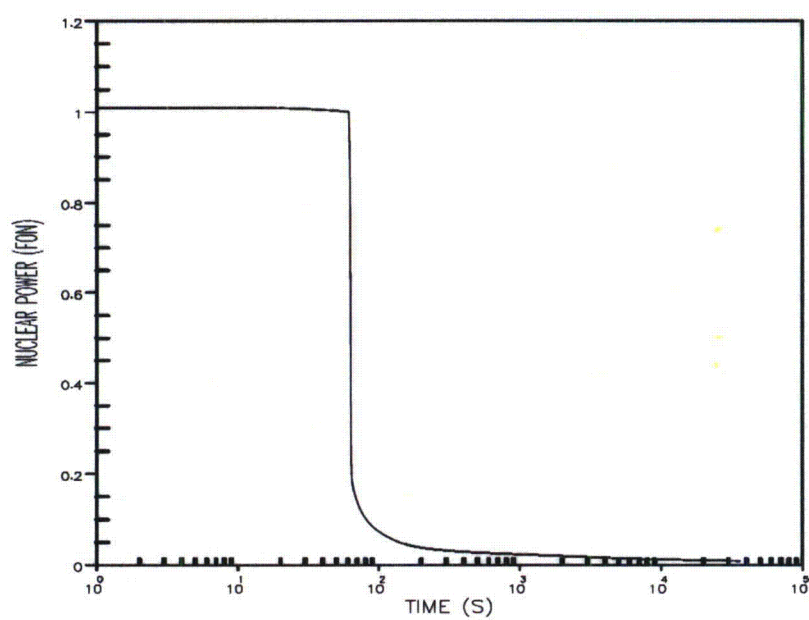


Figure 15.2.7-14
**Nuclear Power Transient for Loss of Normal Feedwater
with a Consequential Loss of ac Power to the Plant Auxiliaries**

15.2-85

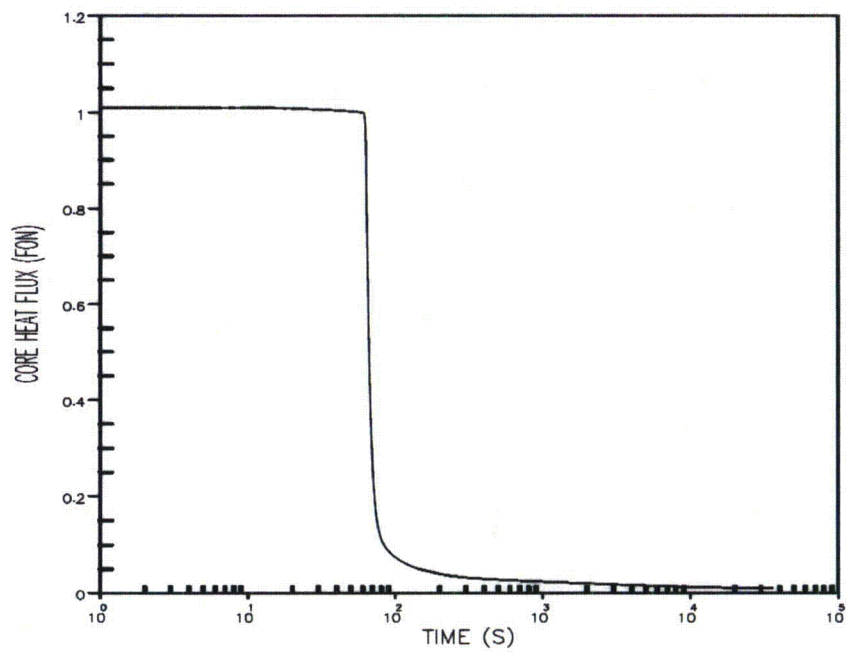


Figure 15.2.7-15

**Core Heat Flux Transient for Loss of Normal Feedwater
with a Consequential Loss of ac Power to the Plant Auxiliaries**

15.2-86

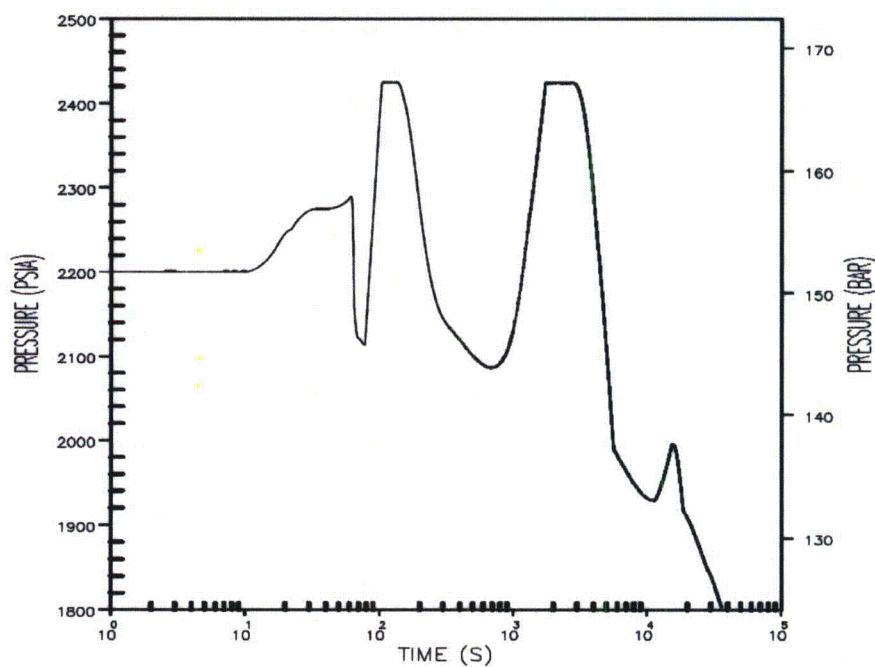


Figure 15.2.7-16

**Pressurizer Pressure Transient for Loss of Normal Feedwater
with a Consequential Loss of ac Power to the Plant Auxiliaries**

15.2-87

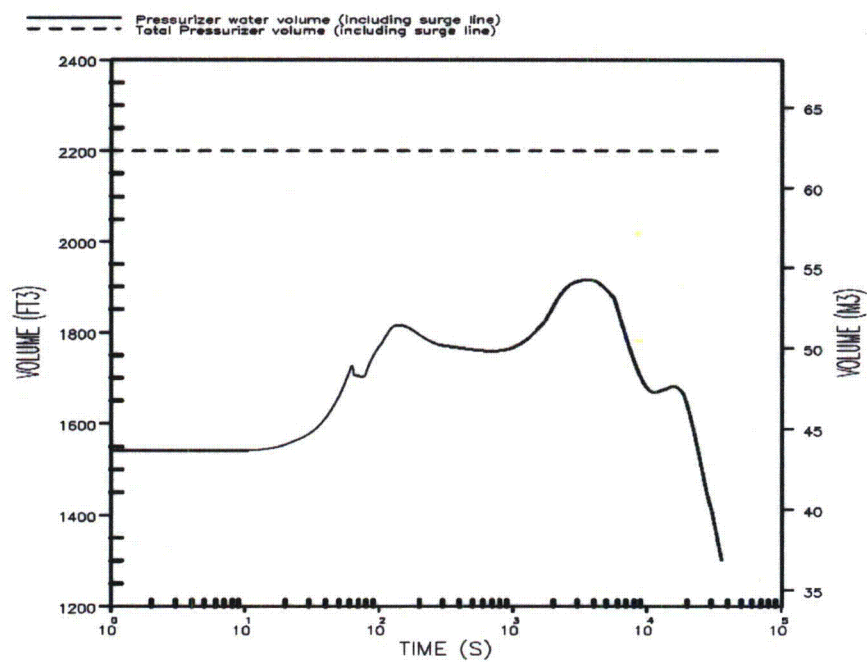


Figure 15.2.7-17

**Pressurizer Water Volume Transient for Loss of Normal Feedwater
with a Consequential Loss of ac Power to the Plant Auxiliaries**

15.2-88

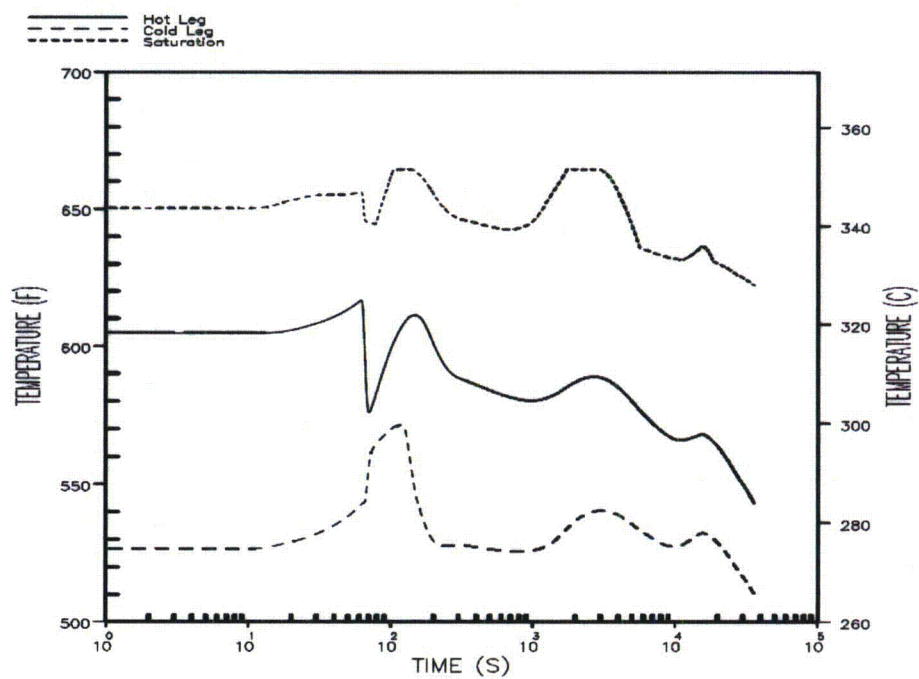


Figure 15.2.7-18

**Reactor Coolant System Temperature Transients in Loop
Containing the PRHR for Loss of Normal Feedwater
with a Consequential Loss of ac Power to the Plant Auxiliaries**

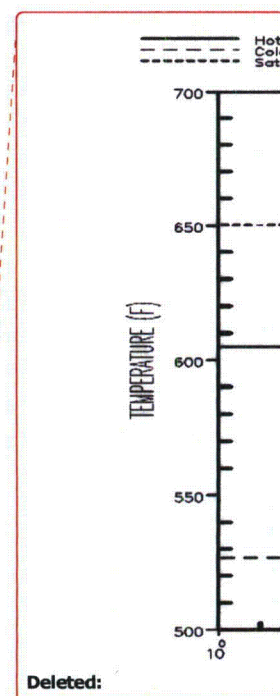
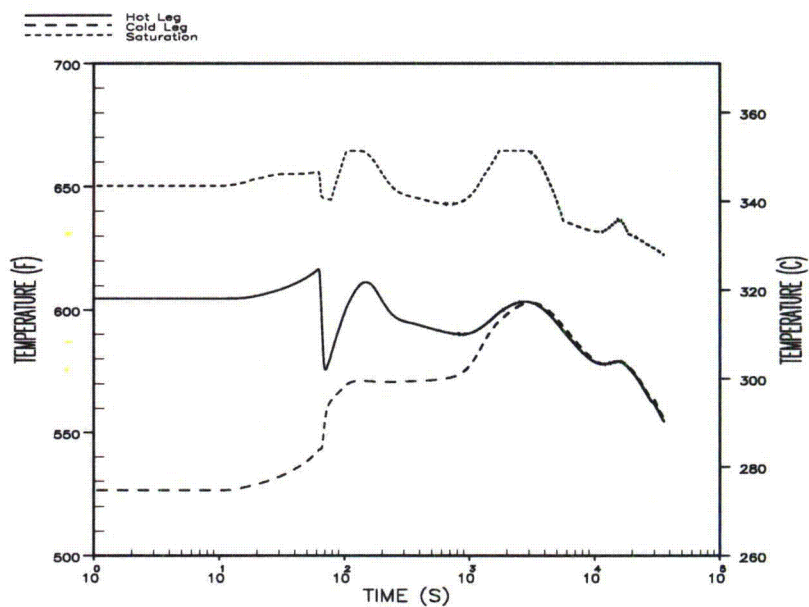


Figure 15.2.7-19

**Reactor Coolant System Temperature Transients
in Loop Not Containing the PRHR for Loss of Normal Feedwater
with a Consequential Loss of ac Power to the Plan Auxiliaries**

15.2-90

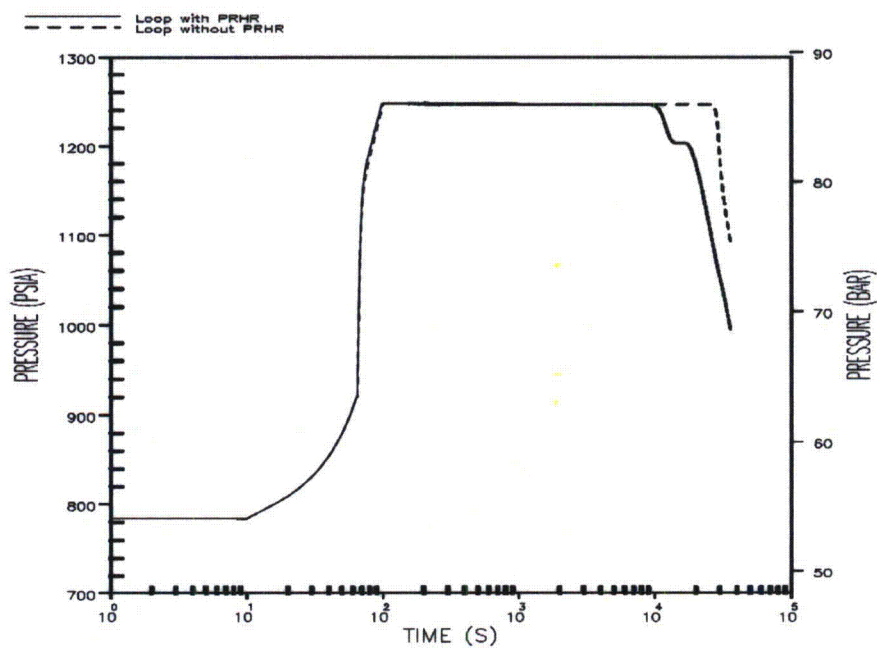


Figure 15.2.7-20

**Steam Generator Pressure Transient for Loss of Normal Feedwater
with a Consequential Loss of ac Power to the Plant Auxiliaries**

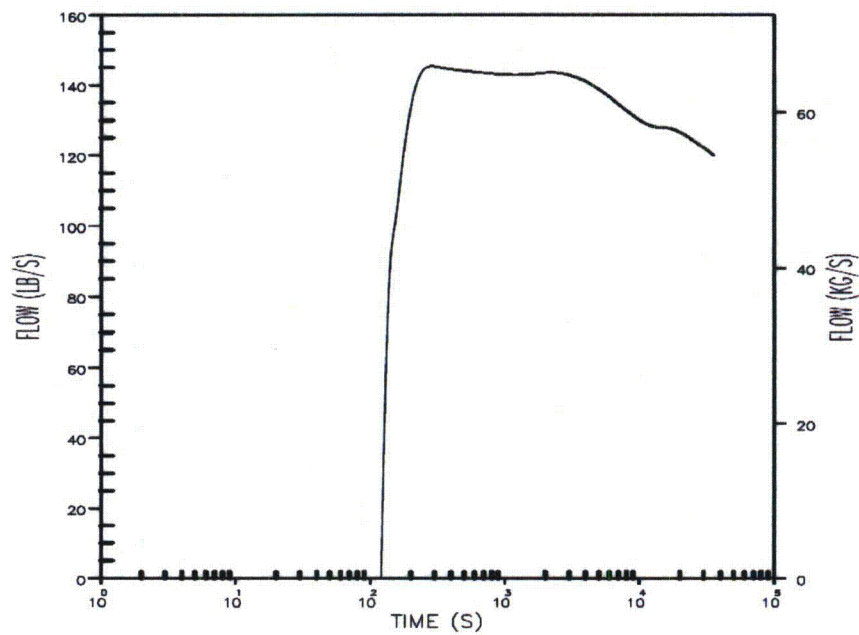


Figure 15.2.7-21

**PRHR Flow Rate Transient for Loss of Normal Feedwater
with a Consequential Loss of ac Power to the Plant Auxiliaries**

15.2-92

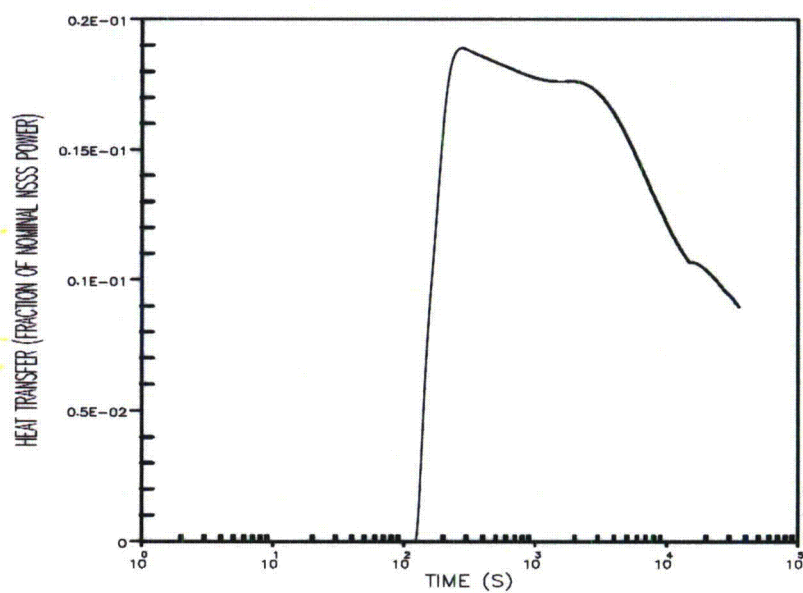


Figure 15.2.7-22
**PRHR Heat Transfer Transient
for Loss of Normal Feedwater with a
Consequential Loss of ac Power to the Plant Auxiliaries**

15.2-93

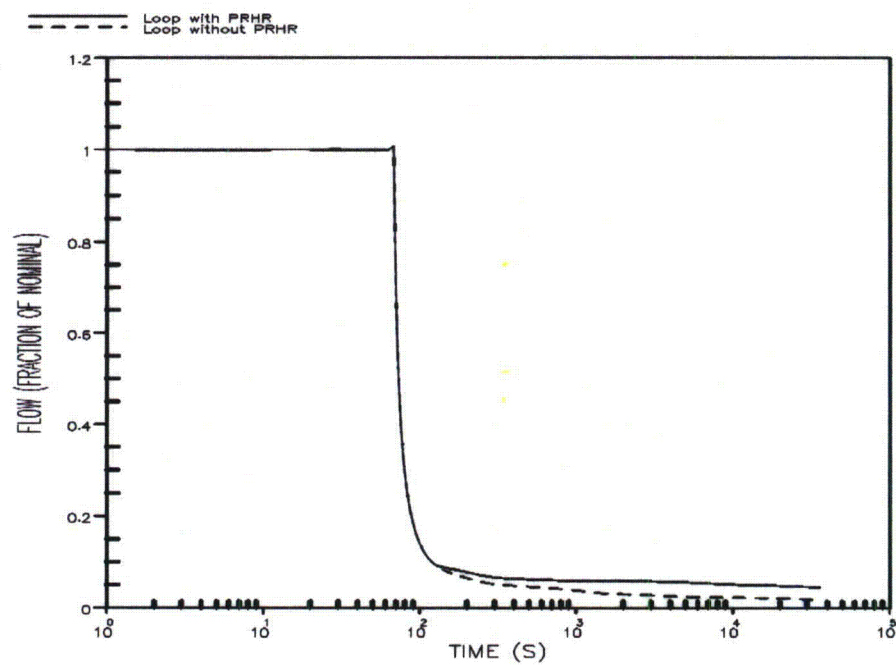


Figure 15.2.7-23
**Reactor Coolant Volumetric Flow Transient
for Loss of Normal Feedwater with a
Consequential Loss of ac Power to the Plant Auxiliaries**

15.2-94

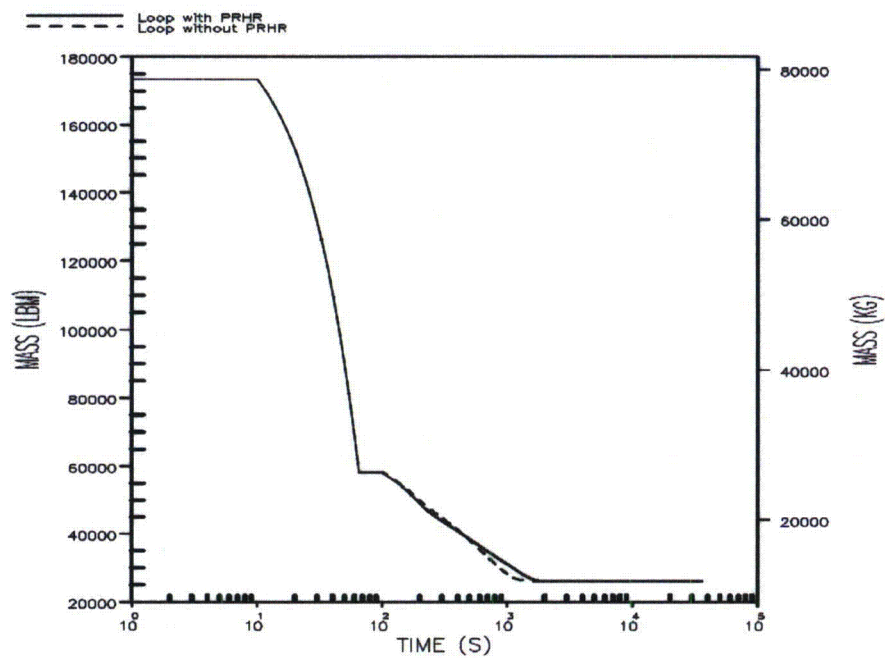


Figure 15.2.7-24
Steam Generator Inventory Transient
for Loss of Normal Feedwater with a
Consequential Loss of ac Power to the Plant Auxiliaries

15.2-95

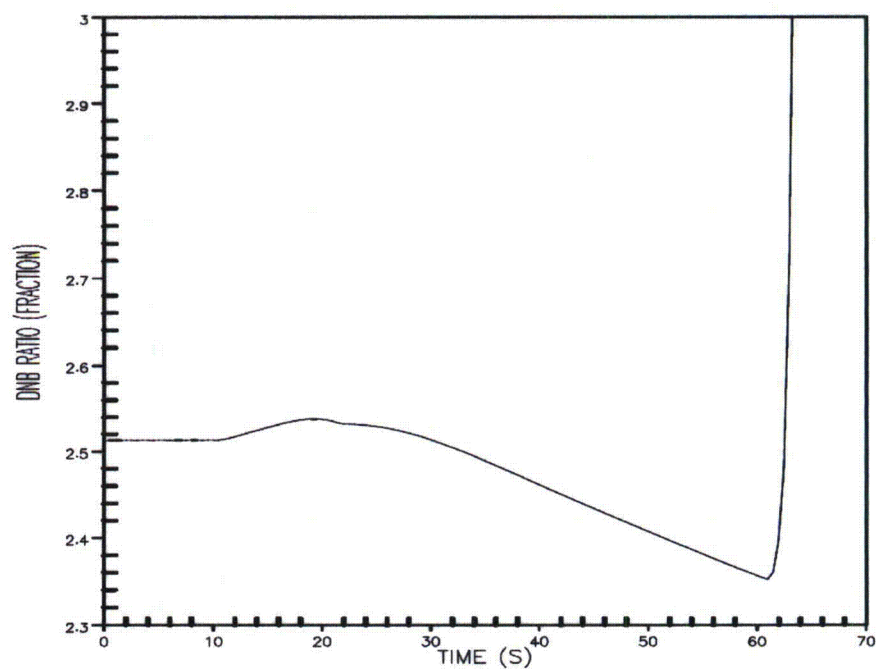


Figure 15.2.7-25
DNB Ratio Transient
for Loss of Normal Feedwater with a
Consequential Loss of ac Power to the Plant Auxiliaries

15.2-96

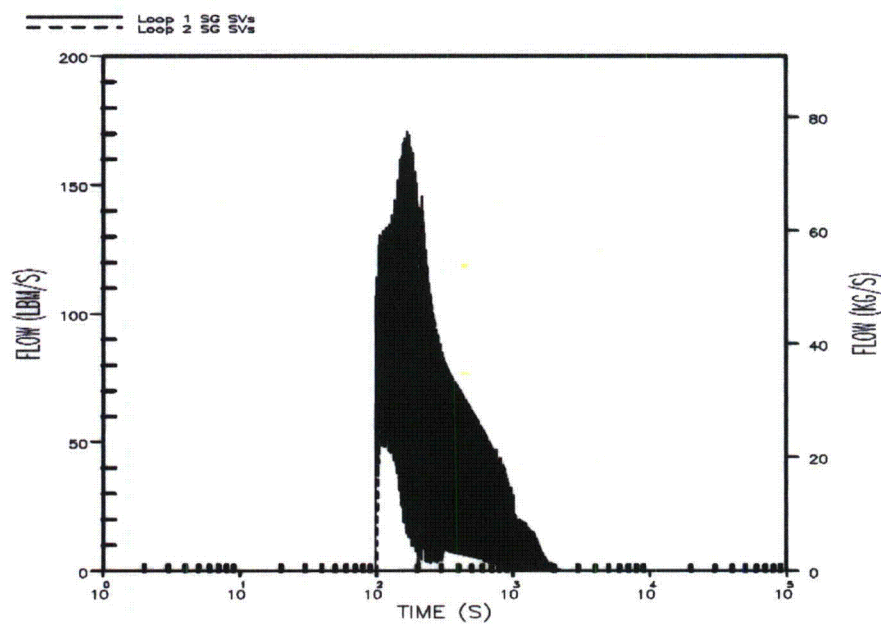


Figure 15.2.7-26
Steam Generator Safety Valve Relief Transient
for Loss of Normal Feedwater with a
Consequential Loss of ac Power to the Plant Auxiliaries

15.2-97



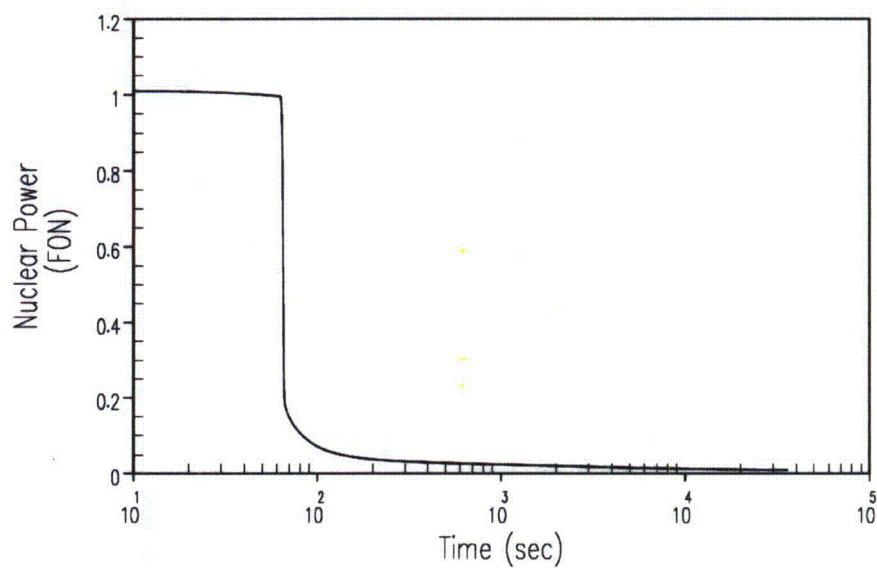


Figure 15.2.8-1

**Nuclear Power Transient for
Main Feedwater Line Rupture**

15.2-98

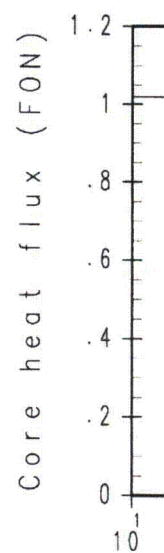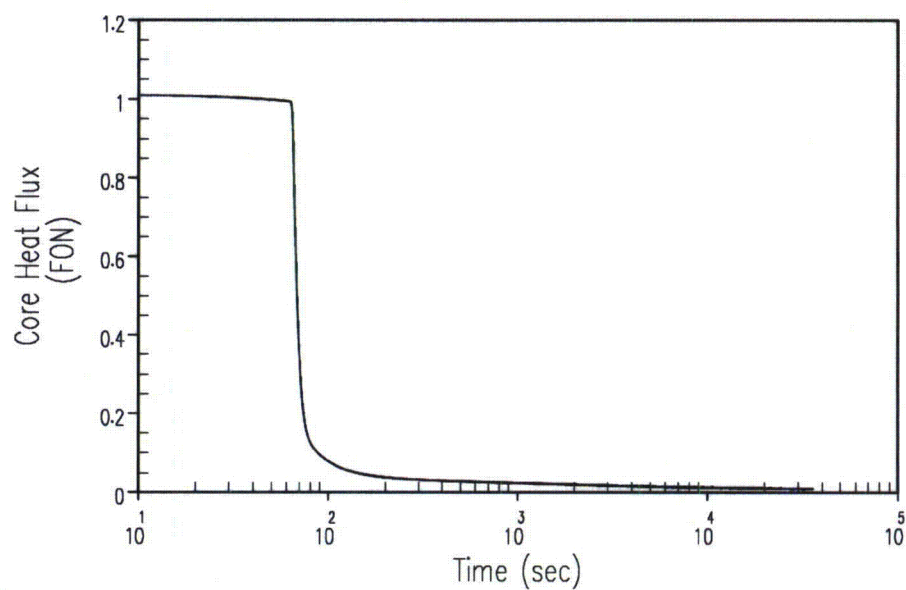


Deleted:

Figure 15.2.8-2

**Core Heat Flux Transient for
Main Feedwater Line Rupture**

15.2-99

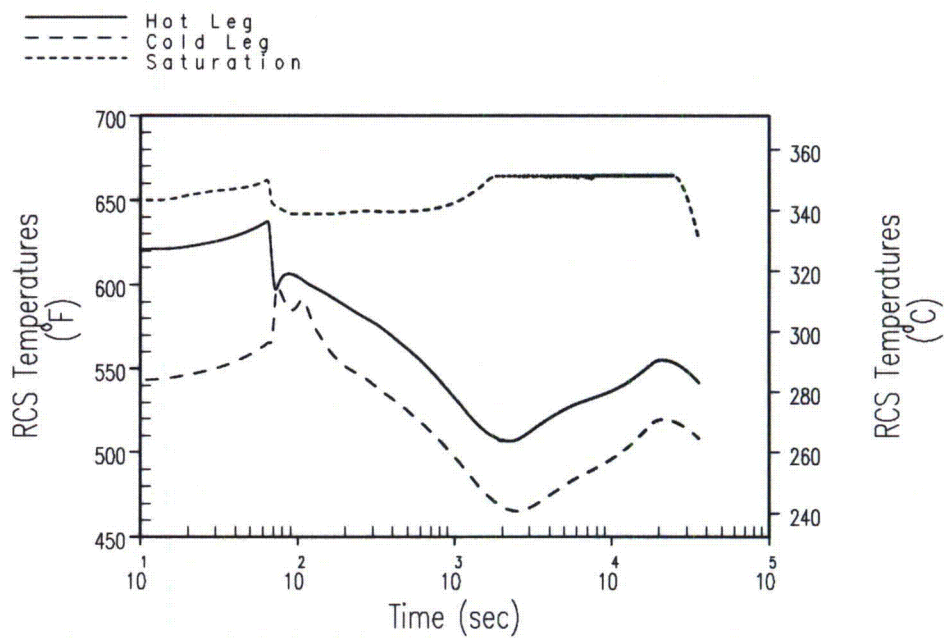

Deleted:

Figure 15.2.8-3

**Faulted Loop Reactor Coolant System
Temperature Transients for Main Feedwater Line Rupture**

15.2-100



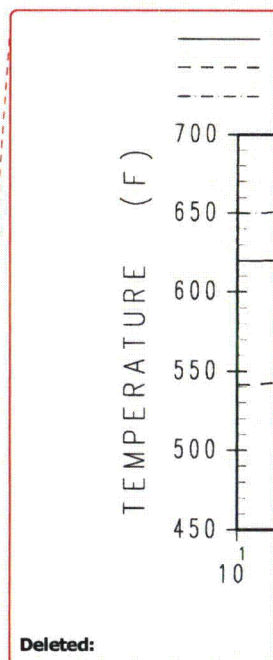


Figure 15.2.8-4

**Intact Loop Reactor Coolant System
Temperature Transients for Main Feedwater Line Rupture**


15.2-101

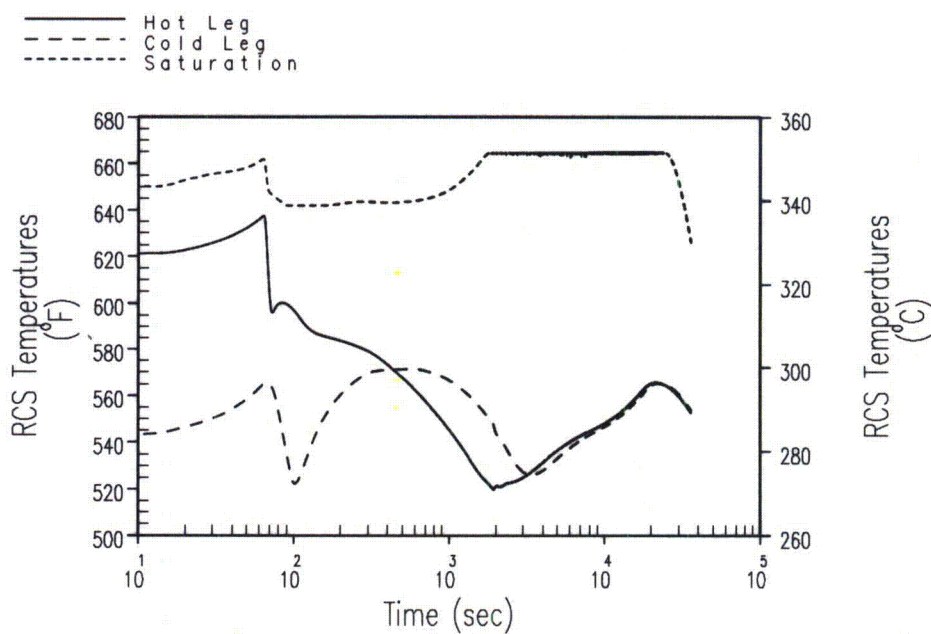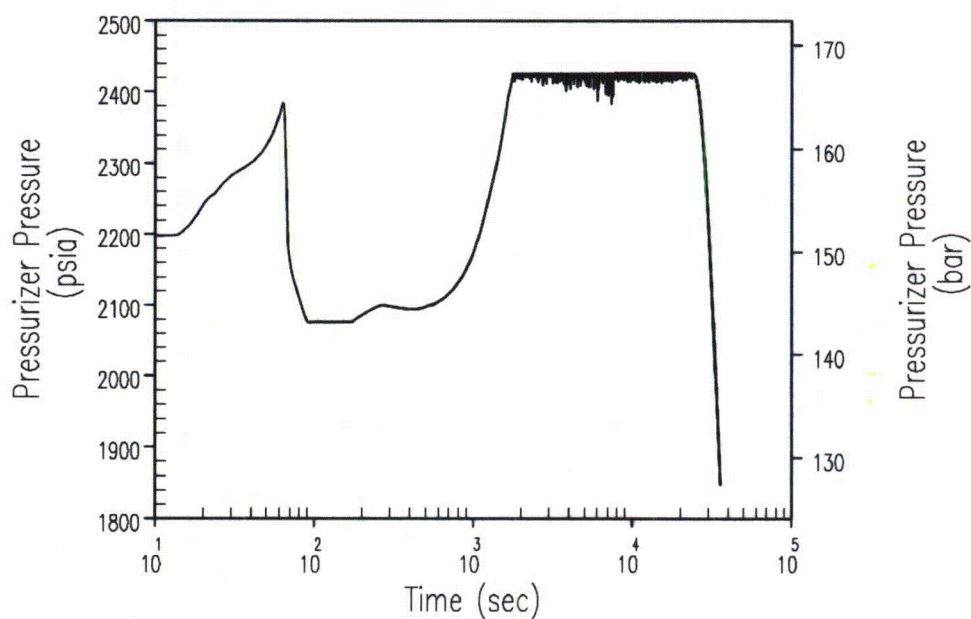

Deleted:

Figure 15.2.8-5

**Pressurizer Pressure Transient for
Main Feedwater Line Rupture**

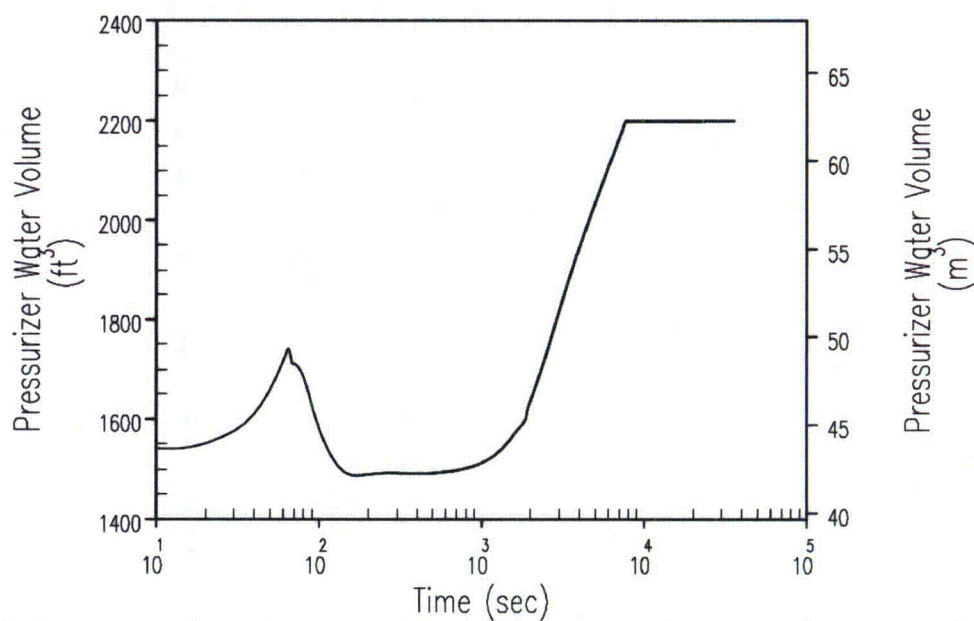

Deleted:

Figure 15.2.8-6

**Pressurizer Water Volume Transient for
Main Feedwater Line Rupture**

15.2-103


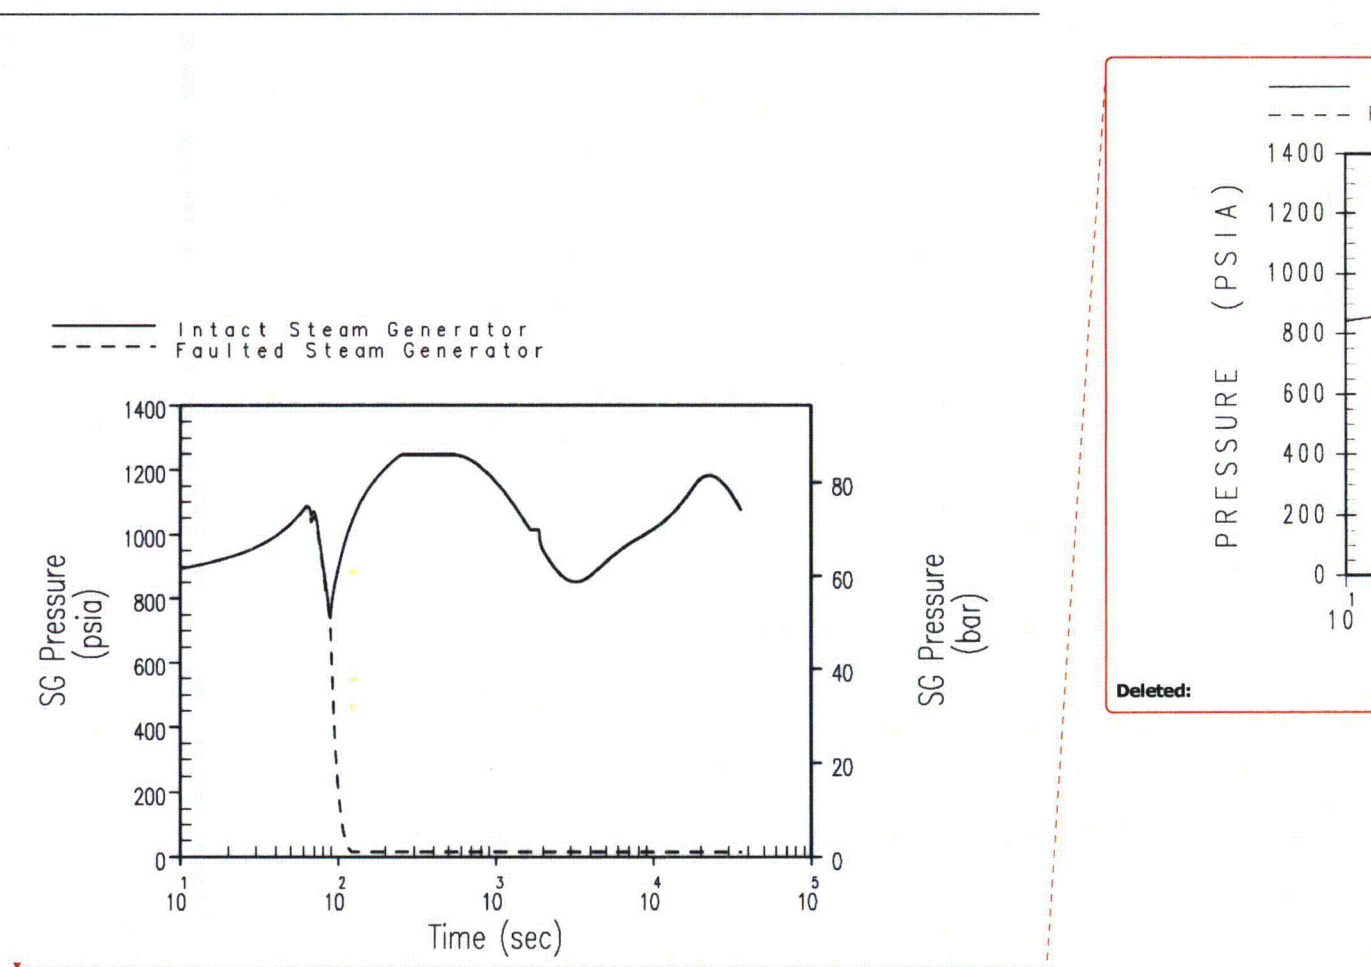


Figure 15.2.8-7

**Steam Generator Pressure Transient for
Main Feedwater Line Rupture**

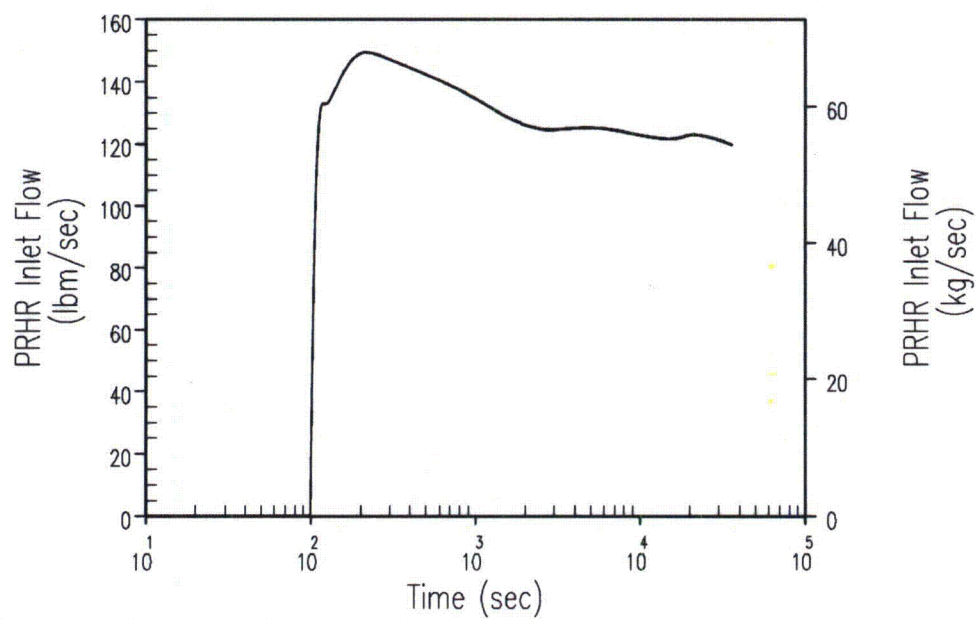

Deleted:

Figure 15.2.8-8

**PRHR Flow Rate Transient for
Main Feedwater Line Rupture**

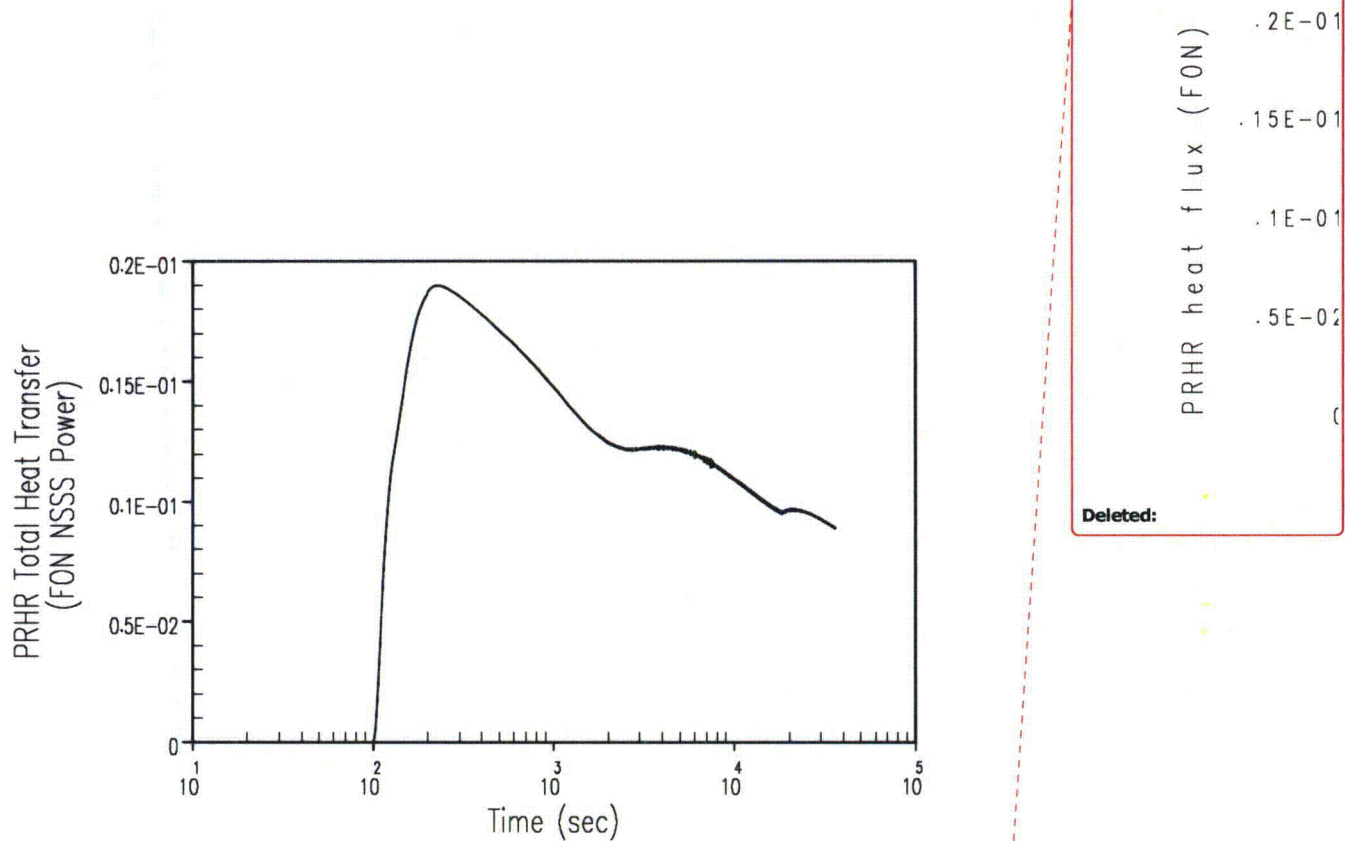


Figure 15.2.8-9

**PRHR Heat Flux Transient for
Main Feedwater Line Rupture**

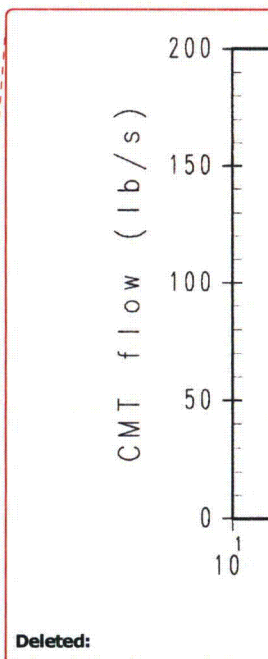
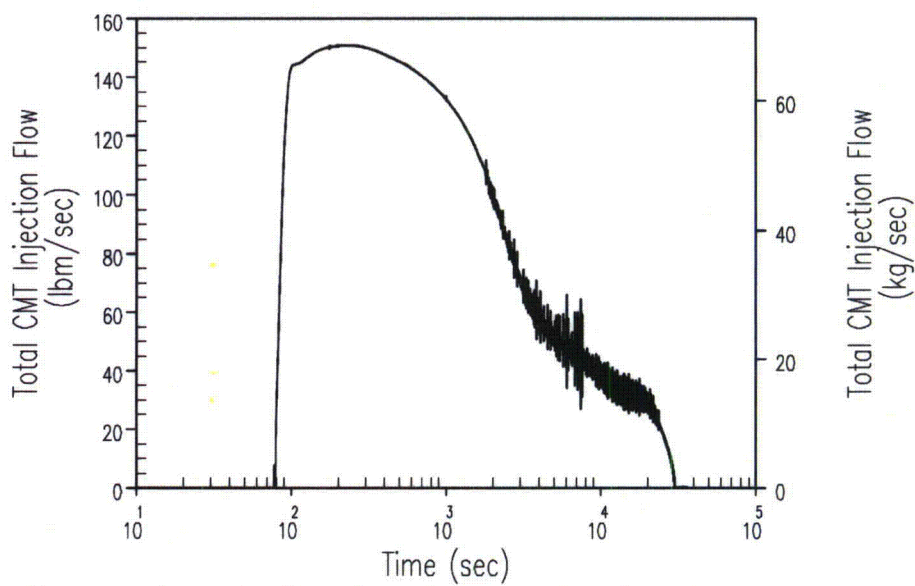


Figure 15.2.8-10

**CMT Injection Flow Rate Transient for
Main Feedwater Line Rupture**