

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8003270369 DOC. DATE: 80/03/24 NOTARIZED: YES DOCKET #  
 FACIL: 50-269 Oconee Nuclear Station, Unit 1, Duke Power Co. 05000269  
 50-270 Oconee Nuclear Station, Unit 2, Duke Power Co. 05000270  
 50-287 Oconee Nuclear Station, Unit 3, Duke Power Co. 05000287  
 AUTH. NAME AUTHOR AFFILIATION  
 PARKER, W.O. Duke Power Co.  
 RECIP. NAME RECIPIENT AFFILIATION  
 DENTON, H.R. Office of Nuclear Reactor Regulation  
 REID, R.W. Operating Reactors Branch 4

SUBJECT: Forwards proposed amend to Tech Specs, Section 4.3, for approval by 800430, Class 3 fee & affidavit encl.

DISTRIBUTION CODE: A001S COPIES RECEIVED: LTR 3 ENCL 3 SIZE: 2+1  
 TITLE: General Distribution for after Issuance of Operating Lic

NOTES: M. CUNNINGHAM - ALL AMENDS TO FSAR & CHANGES TO TECH SPECS. R. CAPRA - 1 CY. W/ CHECK \$4,800.00.

ACTION:	RECIPIENT		COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTR ENCL	LTR ENCL	ID CODE/NAME		LTR ENCL	
ACTION:	05 BC ORB #4	7	7				
INTERNAL:	01 REG FILE	1	1	02 NRC PDR	1	1	
	12 I&E	2	2	15 CORE PERF. BR	1	1	
	17 ENGR BR	1	1	18 REAC SFTY BR	1	1	
	19 PLANT SYS BR	1	1	20 EEB	1	1	
	21 EFLT TRT SYS	1	1	EPB-DOR	1	1	
	DELD	1	0	STS GROUP LEADR	1	1	
EXTERNAL:	03 LPDR	1	1	04 NSIC	1	1	
	23 ACRS	16	16				

MAR 28 1980

TOTAL NUMBER OF COPIES REQUIRED: LTR

39  
38

ENCL

38  
37

APP  
2

# DUKE POWER COMPANY

POWER BUILDING

422 SOUTH CHURCH STREET, CHARLOTTE, N. C. 28242

WILLIAM O. PARKER, JR.  
VICE PRESIDENT  
STEAM PRODUCTION

March 24, 1980

TELEPHONE: AREA 704  
373-4083

Mr. Harold R. Denton, Director  
Office of Nuclear Reactor Regulation  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

Attention: Mr. Robert W. Reid, Chief  
Operating Reactors Branch No. 4

Re: Oconee Nuclear Station  
Docket Nos. 50-269, -270, -287

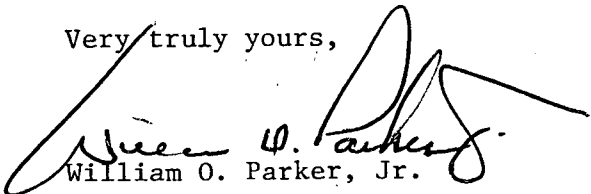
Dear Sir:

- Pursuant to 10CFR 50, §50.90 please find attached a proposed amendment to the Oconee Nuclear Station Technical Specifications. The change requested involves lowering the leak test pressure required in Technical Specification 4.3.2 from current levels to those required by the ASME codes (IWB-5221). This has become a concern due to the changes instituted in response to IE Bulletin 79-05B (RPS setpoint of 2300, error adjusted to 2294 psig). In the Oconee startup sequence, Group 1 control rods are removed to 50% withdrawn, before this test is performed to maintain adequate shutdown margin as heat-up begins. A 2285 psig leak test (currently required in Technical Specification 4.3.2) with a 2294 psig RPS setpoint leaves considerable possibility of tripping Group 1 due to the test.

It is requested that the review of the request be accomplished in an expeditious fashion to preclude this problem during Unit 2's startup following the upcoming outage. This would require approval by April 30, 1980.

- This proposal is considered to constitute no more than one Class III amendment with two Class I amendments. Accordingly a check for \$4,800 is attached herewith. However, it is considered that the review of this request should be quite straightforward and that a substantial portion thereof is expected to be refunded.

Very truly yours,

  
William O. Parker, Jr.

KRW:scs

Attachments

*Acc'l  
3/3  
w/c check  
\$ 4,800.00*

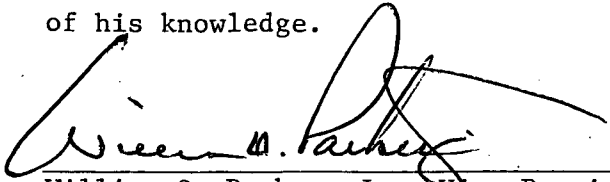
P

8003270


369

Mr. Harold R. Denton, Director  
March 24, 1980  
Page Two

WILLIAM O. PARKER, JR., being duly sworn, states that he is Vice President of Duke Power Company; that he is authorized on the part of said Company to sign and file with the Nuclear Regulatory Commission this request for amendment of the Oconee Nuclear Station Technical Specifications, Appendix A to Facility Operating Licenses DPR-38, DPR-47 and DPR-55; and that all statements and matters set forth therein are true and correct to the best of his knowledge.

  
William O. Parker, Jr., Vice President

Subscribed and sworn to before me this 24th day of March, 1980.

  
Notary Public

My Commission Expires:

September 20, 1984