

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8108280180. DOC. DATE: 81/08/25 NOTARIZED: YES
 FACIL: 50-269 Oconee Nuclear Station, Unit 1, Duke Power Co.
 50-270 Oconee Nuclear Station, Unit 2, Duke Power Co.
 50-287 Oconee Nuclear Station, Unit 3, Duke Power Co.

DOCKET #
05000269
 05000270
 05000287

AUTH. NAME: PARKER, W.O. AUTHOR AFFILIATION: Duke Power Co.
 RECIP. NAME: DENTON, H.R. RECIPIENT AFFILIATION: Office of Nuclear Reactor Regulation, Director
 STOLZ, J.F. Operating Reactors Branch 4

SUBJECT: Application for amend to Licenses DPR-38, DPR-47 & DPR-55
 submitted as proposed revision to Tech Specs increasing min
 allowable borated water storage tank temp.

DISTRIBUTION CODE: A001S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2+3
 TITLE: General Distribution for after Issuance of Operating License

NOTES: AEOD, Ornstein: 1cc.
 AEOD, Ornstein: 1cc
 AEOD, Ornstein: 1cc

05000269
 05000270
 05000287

W/CHECK \$2,000

ACTION:	RECIPIENT		COPIES		RECIPIENT	COPIES		
	ID	CODE/NAME	LTTR	ENCL		ID	CODE/NAME	LTTR
	ORB #4	BC 04	13	13				
INTERNAL:	D/DIR, HUM	FAC08	1	1	DIR, DIV OF LIC		1	1
	I&E	06	2	2	OELD	11	1	0
	OR ASSESS	BR 10	1	0	RAD ASMT BR		1	1
	<u>REG FILE</u>	01	1	1				
EXTERNAL:	ACRS	09	16	16	LPDR	03	1	1
	NRC PDR	02	1	1	NSIC	05	1	1
	NTIS		1	1				

SEP 1 1981

TOTAL NUMBER OF COPIES REQUIRED: LTTR

42

40

41

ENCL

3

20

DUKE POWER COMPANY

POWER BUILDING

422 SOUTH CHURCH STREET, CHARLOTTE, N. C. 28242

WILLIAM O. PARKER, JR.
VICE PRESIDENT
STEAM PRODUCTION

TELEPHONE: AREA 704
373-4083

August 25, 1981

Mr. Harold R. Denton, Director
Office of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Attention: Mr. J. F. Stolz, Chief
Operating Reactors Branch No. 4

Re: Oconee Nuclear Station
Docket Nos. 50-269, -270, -287



Dear Sir:

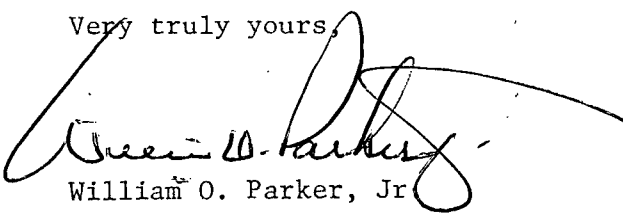
Pursuant to 10 CFR 50, §50.90, please find attached a proposed amendment to the Oconee Nuclear Station Facility Operating License and revision to the Technical Specifications. This proposed change increases the minimum allowable BWST temperature to 50°F.

The supply of borated water is maintained at a temperature above 50°F to lessen the potential for thermal shock of the reactor vessel during high pressure system operation.

This temperature will be used in specific analyses being performed to address the concern of reactor vessel thermal shock. Based on the results of these analyses, additional increases in the BWST minimum temperature may be warranted.

Pursuant to 10 CFR 170, §170.22, this request has been determined to consist of one Class II and two Class I license fees. This amendment is administrative in nature. As such, please find attached a check in the amount of \$2,000.00.

Very truly yours,

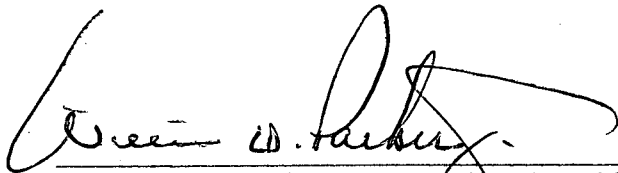

William O. Parker, Jr.

RLG/php
Attachments

Handwritten:
w/check
\$2,000
Aool
6/11

8108280180 810825
PDR ADOCK 05000269
PDR

WILLIAM O. PARKER, JR., being duly sworn, states that he is Vice President of Duke Power Company; that he is authorized on the part of said Company to sign and file with the Nuclear Regulatory Commission this request for amendment of the Oconee Nuclear Station Technical Specifications, Appendix A to Facility Operating Licenses DPR-38, DPR-47, and DPR-55; and that all statements and matters set forth therein are true and correct to the best of his knowledge.



William O. Parker, Jr., Vice President

Subscribed and sworn to before me this

25th day of August, 1981.



Notary Public

My Commission Expires:

September 20, 1984