

CATEGORY 1

REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9612310002	DOC. DATE: 96/12/19	NOTARIZED: NO	DOCKET #
FACIL: 50-269 Oconee Nuclear Station, Unit 1, Duke Power Co.			05000269
50-270 Oconee Nuclear Station, Unit 2, Duke Power Co.			05000270
50-287 Oconee Nuclear Station, Unit 3, Duke Power Co.			05000287

AUTH. NAME	AUTHOR AFFILIATION
HAMPTON, J.W.	Duke Power Co.
RECIP. NAME	RECIPIENT AFFILIATION
	Document Control Branch (Document Control Desk)

SUBJECT: Forwards supplemental info re Emergency Power Engineered Safeguards Functional Test amend request.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 6
 TITLE: OR Submittal: General Distribution

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD2-2 LA	1 1	PD2-2 PD	1 1
	LABARGE, D	1 1		
INTERNAL:	ACRS	1 1	<u>FILE CENTER</u> 01	1 1
	NRR/DE/ECGB/A	1 1	NRR/DE/EMCB	1 1
	NRR/DRCH/HICB	1 1	NRR/DSSA/SPLB	1 1
	NRR/DSSA/SRXB	1 1	NUDOCS-ABSTRACT	1 1
	OGC/HDS2	1 0		
EXTERNAL:	NOAC	1 1	NRC PDR	1 1

NOTE TO ALL "RIDS" RECIPIENTS:
 PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,
 ROOM OWFN 5D-5 (EXT. 415-2083) TO ELIMINATE YOUR NAME FROM
 DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 14 ENCL 13

MAF

C
A
T
E
G
O
R
Y

1

D
O
C
U
M
E
N
T

Duke Power Company
Oconee Nuclear Site
P.O. Box 1439
Seneca, SC 29679

J. W. HAMPTON
Vice President
(864)885-3499 Office
(864)885-3564 Fax



DUKE POWER

December 19, 1996

U. S. Nuclear Regulatory Commission
Attention: Document Control Desk
Washington, DC 20555

Subject: Oconee Nuclear Station
Docket Nos. 50-269, -270, -287
Supplemental Information Regarding Oconee
Emergency Power Engineered Safeguards
Functional Test Amendment Request

Due to an administrative oversight, Figures 1-5 were not included in the copies of the December 17, 1996, Duke Power submittal to the NRC. These figures, which provide information related to the Emergency Power Engineered Safeguards Functional test, are attached to this letter.

Very truly yours,

J. W. Hampton, Site Vice President
Oconee Nuclear Station

cc: S. D. Ebnetter, Regional Administrator
Region II

M. A. Scott, Senior Resident Inspector
Oconee Nuclear Site

D. E. LaBarge, Project Manager
NRR

M. Batavia,
DHEC

ADDI/

9612310002 961219
PDR ADDCK 05000269
P PDR

LOSS OF DHR 75 DAYS AFTER UNIT SHUTDOWN

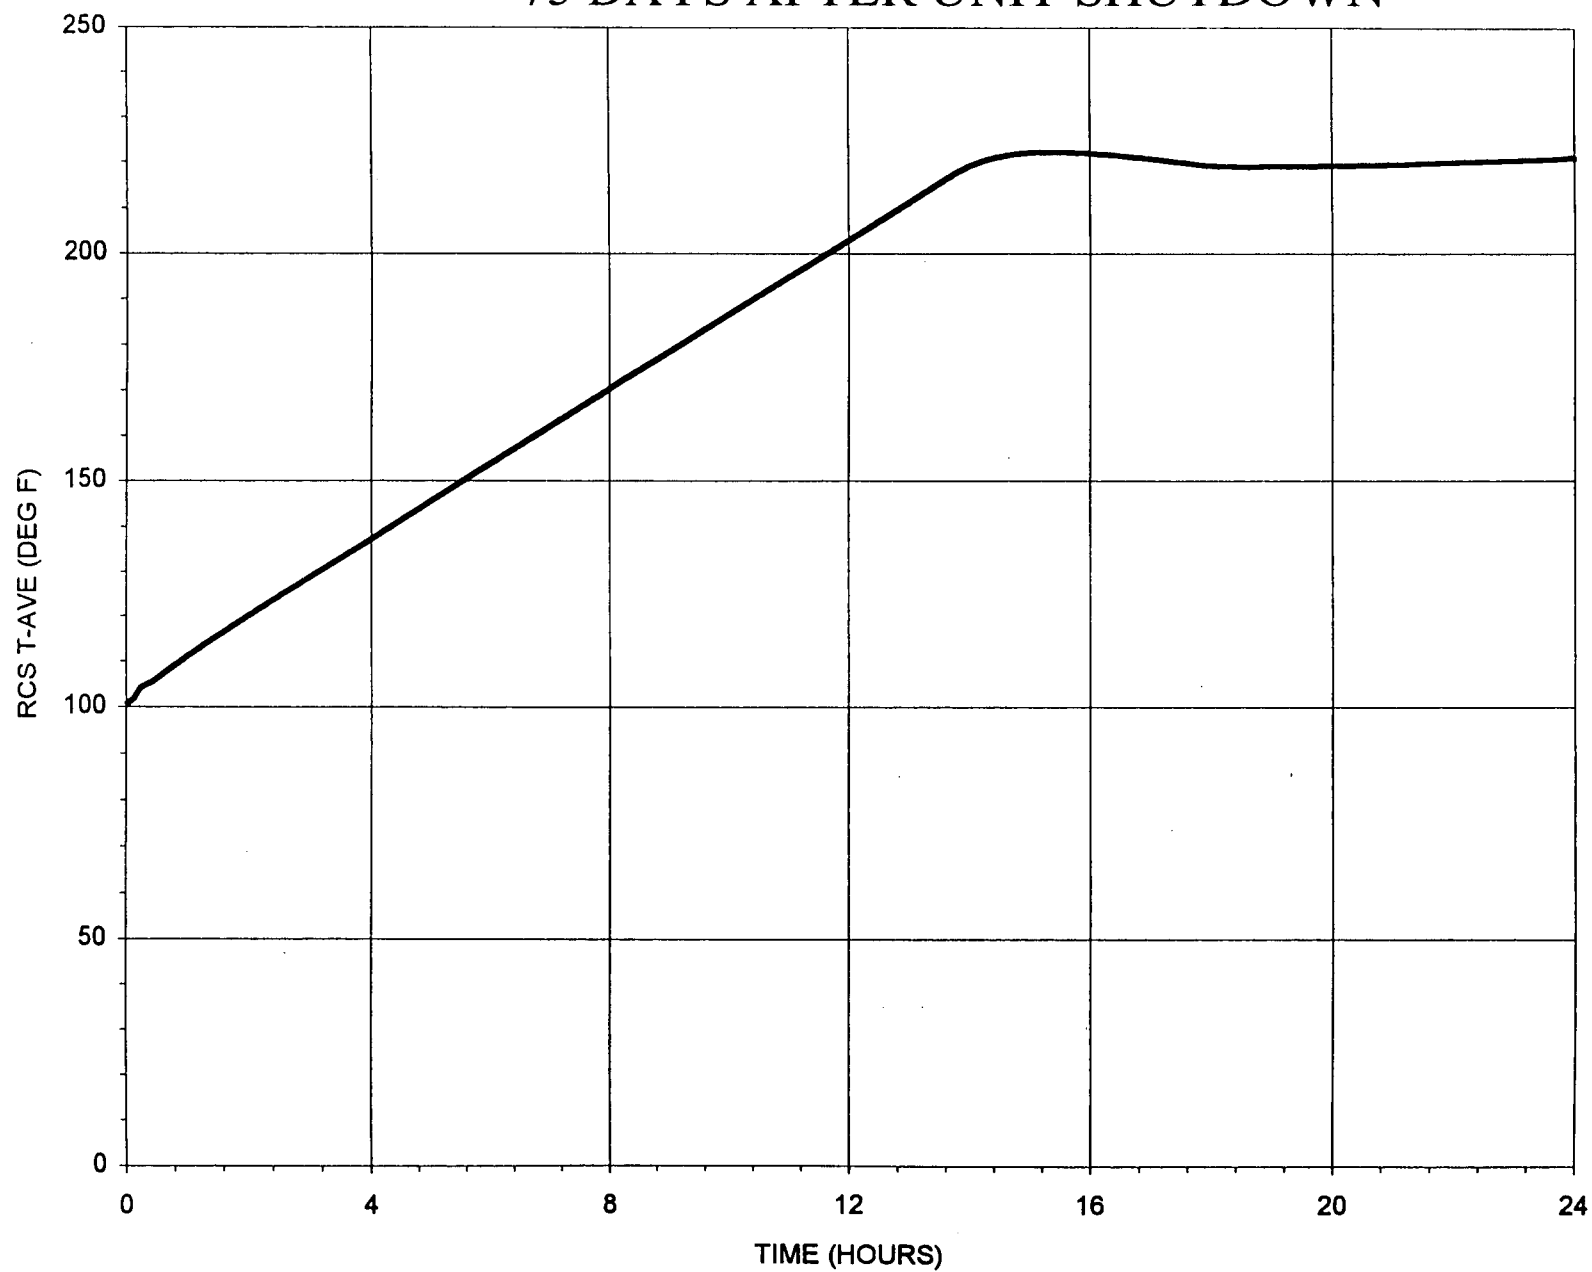


FIGURE 1

LOSS OF DHR 75 DAYS AFTER UNIT SHUTDOWN

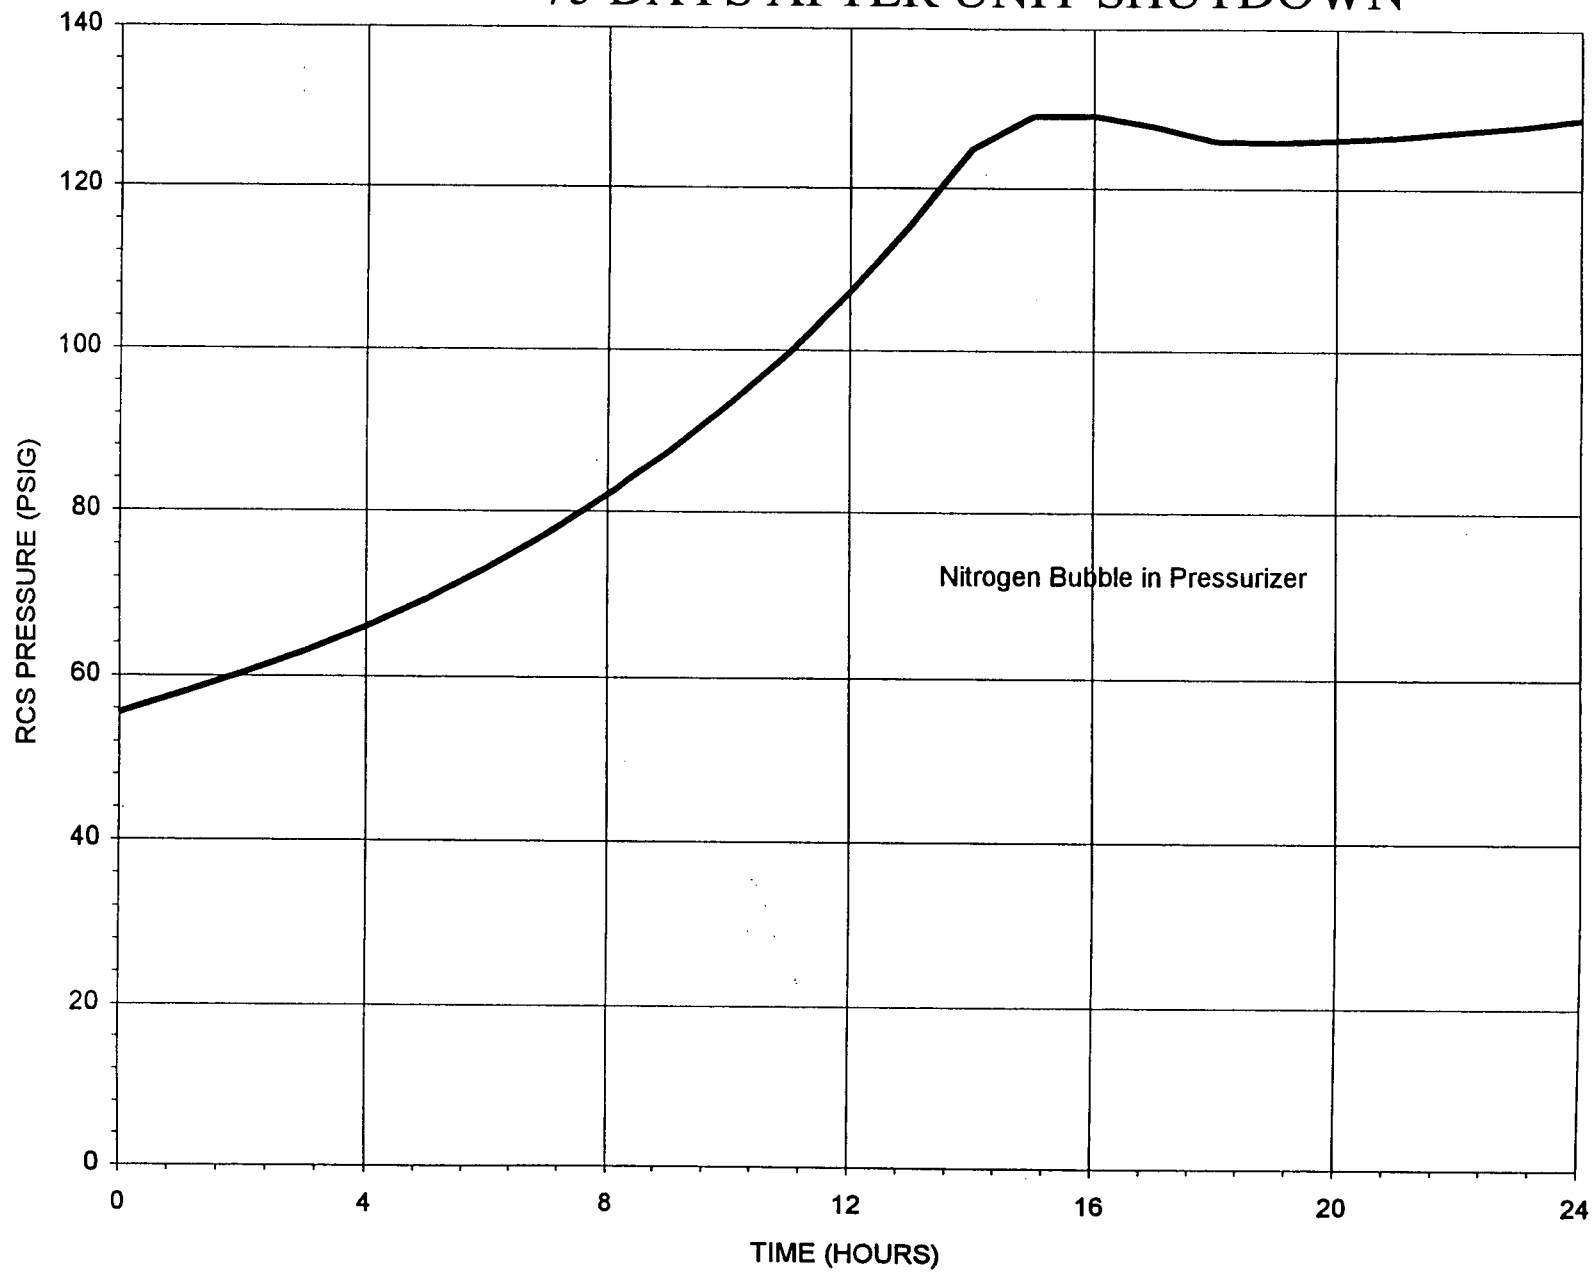


FIGURE 2

LOSS OF DHR 75 DAYS AFTER UNIT SHUTDOWN

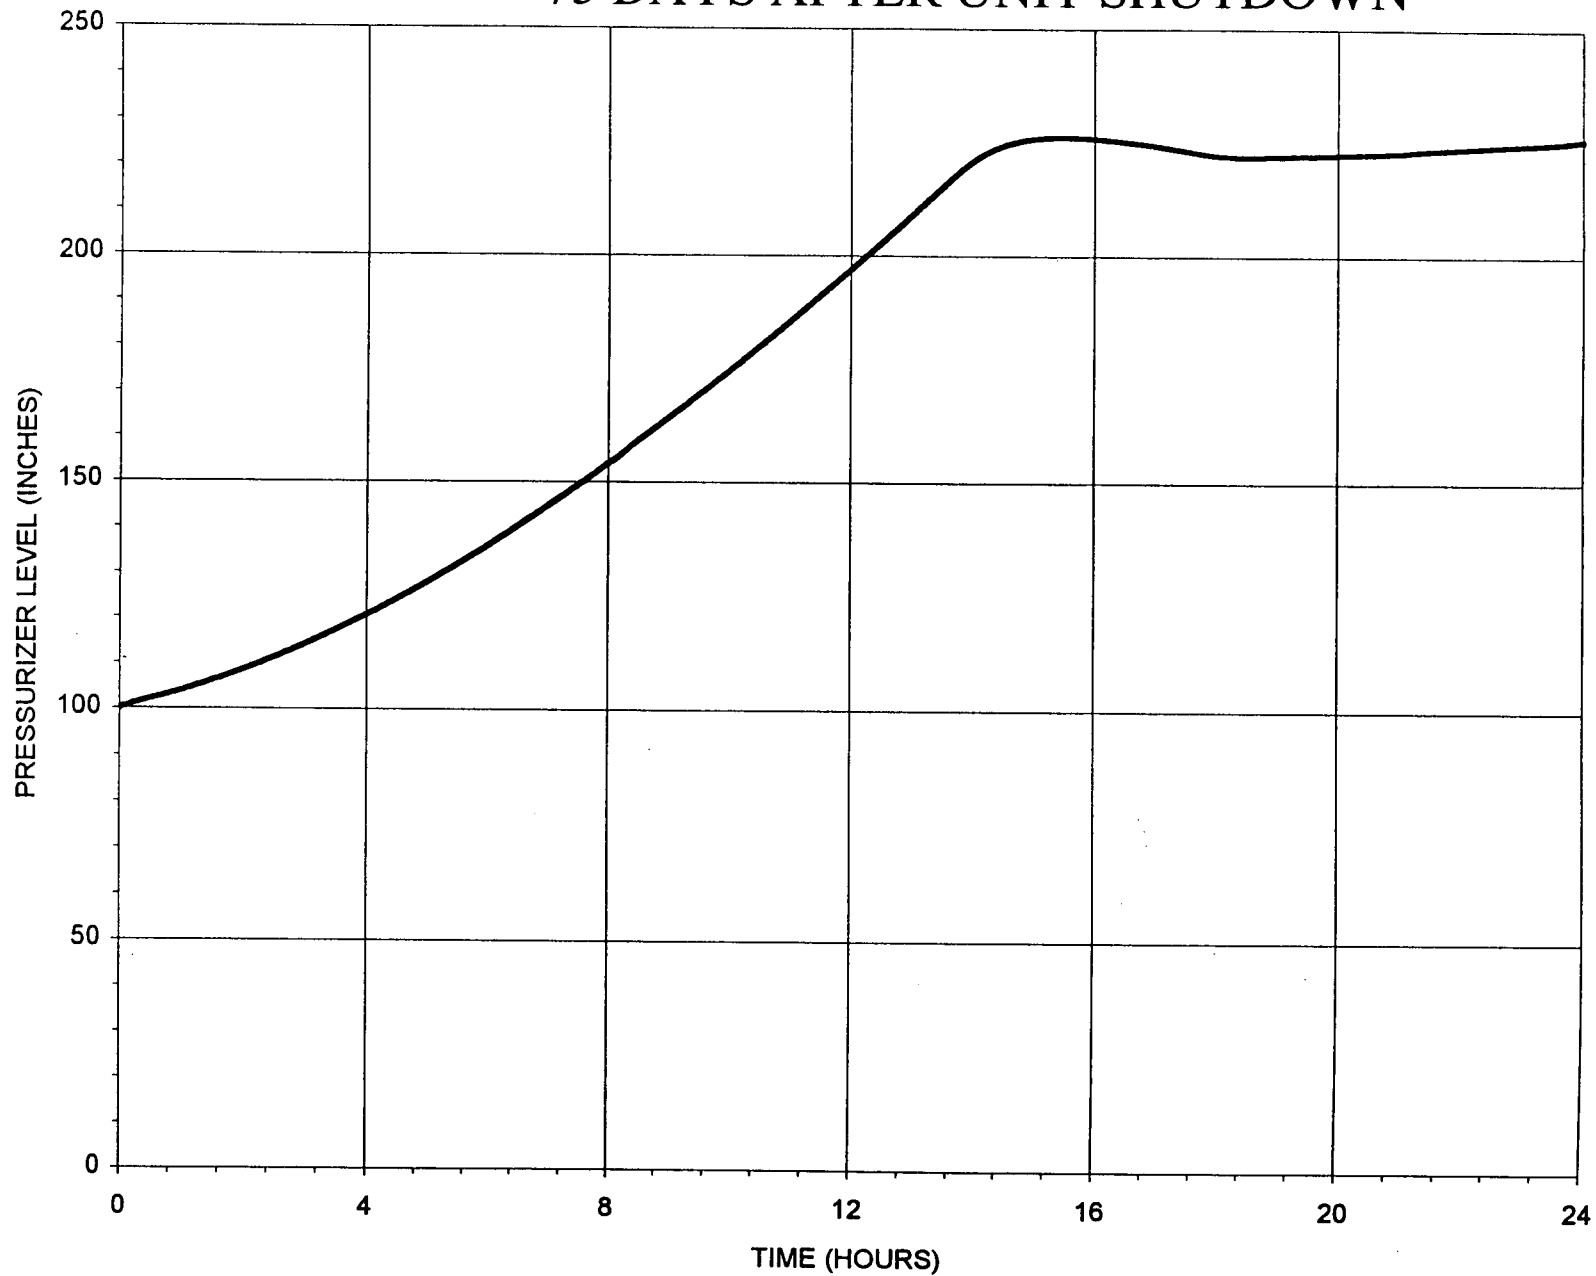


FIGURE 3

LOSS OF DHR 75 DAYS AFTER UNIT SHUTDOWN

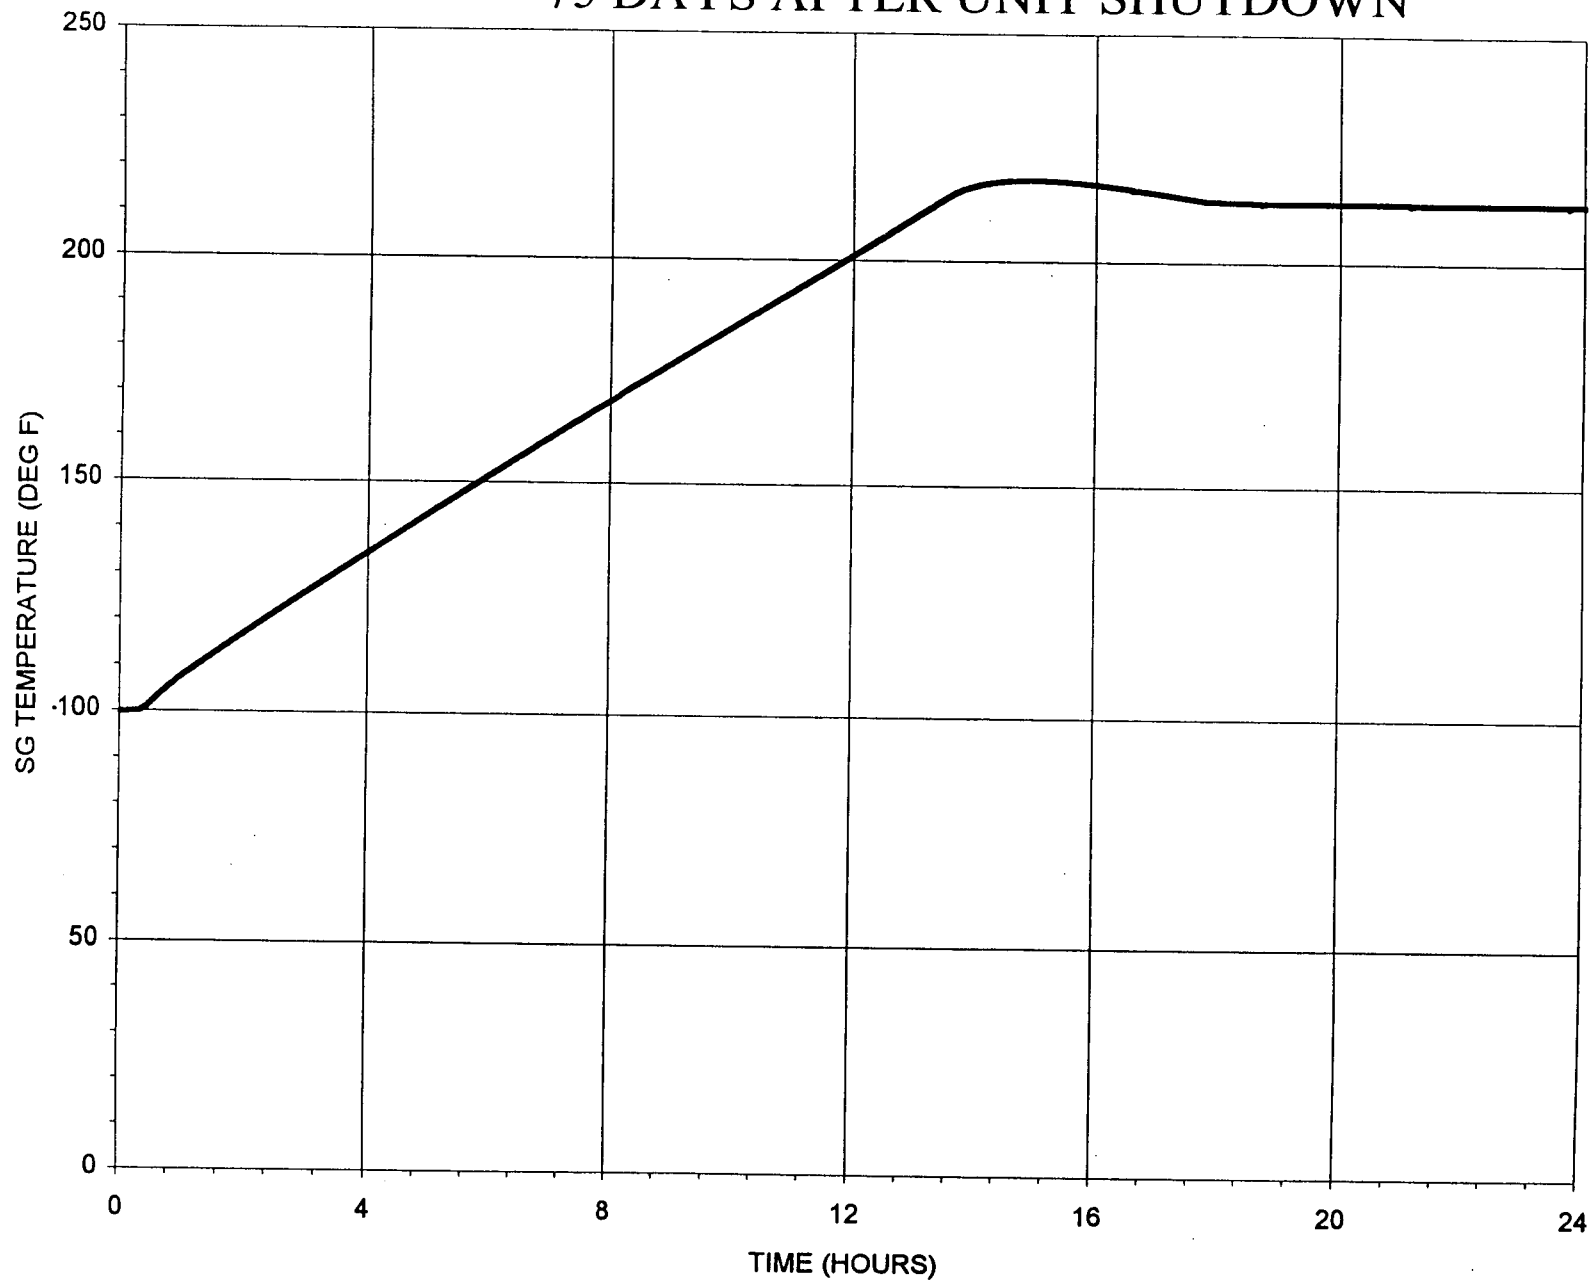


FIGURE 4

LOSS OF DHR 75 DAYS AFTER UNIT SHUTDOWN

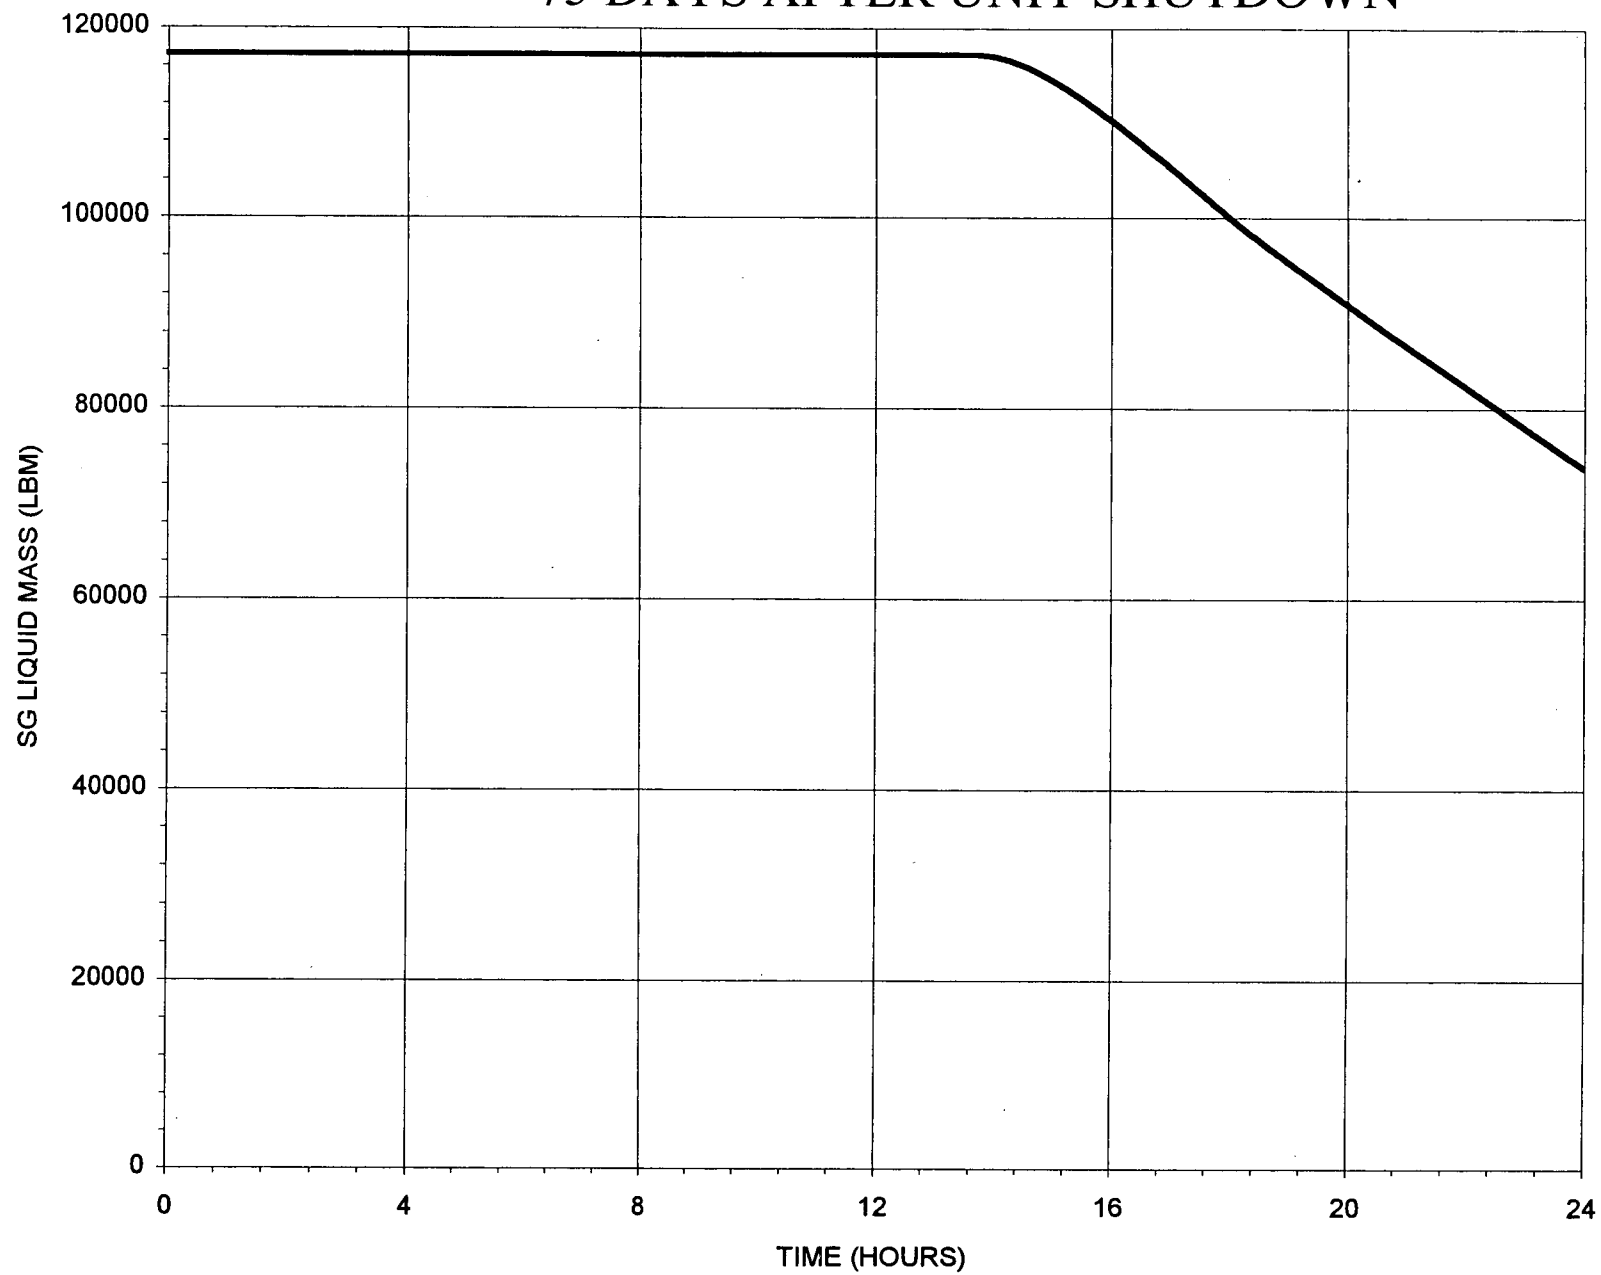


FIGURE 5