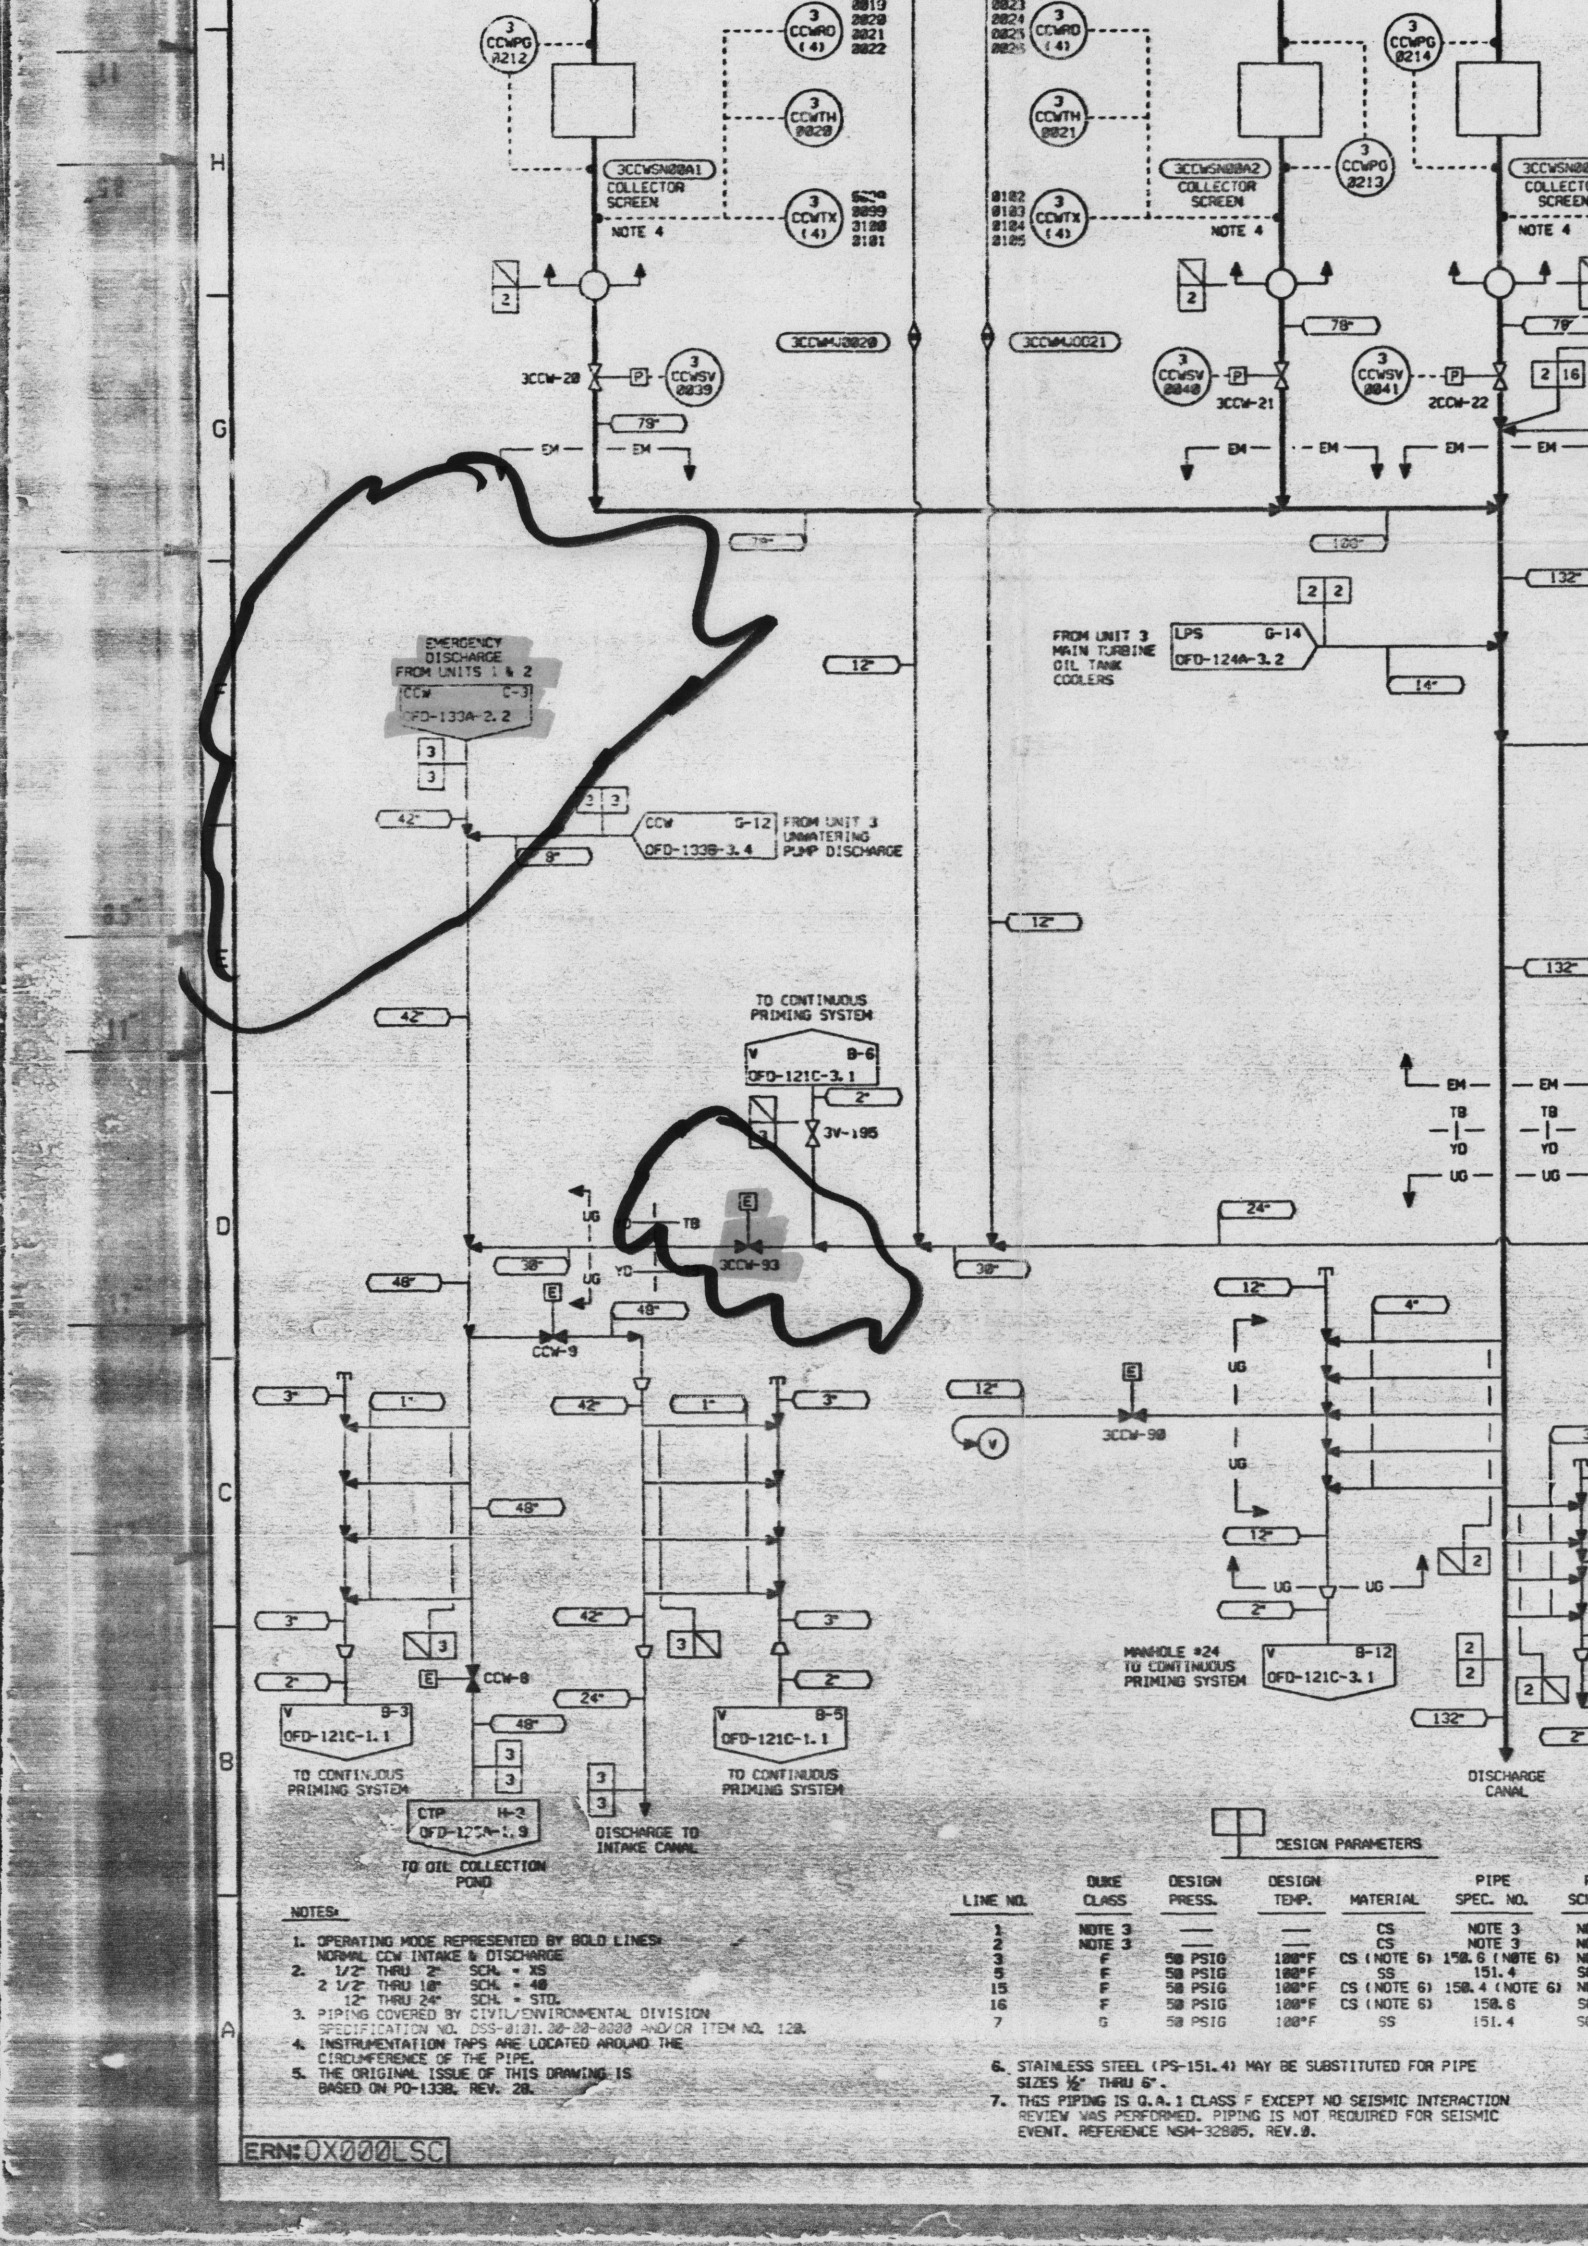

LINE NO.	DUKE CLASS	DESIGN PRESS.	DESIGN TEMP.	MATERIAL	PIPE SPEC. NO.
1	NOTE 3	—	—	CS	NOTE 3
2	NOTE 3	—	—	CS	NOTE 3
3	F	50 PSIG	100°F	CS (NOTE 6)	150.6 (NOTE 6)
5	F	50 PSIG	100°F	SS	151.4
15	F	50 PSIG	100°F	CS (NOTE 6)	150.4 (NOTE 6)
16	F	50 PSIG	100°F	CS (NOTE 6)	150.6
7	G	50 PSIG	100°F	SS	151.4

NOTES:

1. OPERATING MODE REPRESENTED BY BOLD LINES: NORMAL CCW INTAKE & DISCHARGE
2. 1/2" THRU 2" SCH. = XS
   2 1/2" THRU 10" SCH. = 40
   12" THRU 24" SCH. = STD.
3. PIPING COVERED BY CIVIL/ENVIRONMENTAL DIVISION SPECIFICATION NO. CSS-0101.00-00-0000 AND/OR ITEM NO. 128.
4. INSTRUMENTATION TAPS ARE LOCATED AROUND THE CIRCUMFERENCE OF THE PIPE.
5. THE ORIGINAL ISSUE OF THIS DRAWING IS BASED ON PO-1338, REV. 28.
6. STAINLESS STEEL (PS-151.4) MAY BE SUBSTITUTED FOR PIPE SIZES ½" THRU 6".
7. THIS PIPING IS Q.A.1 CLASS F EXCEPT NO SEISMIC INTERACTION REVIEW WAS PERFORMED. PIPING IS NOT REQUIRED FOR SEISMIC EVENT. REFERENCE NSM-32805, REV.0.

ERN: 0X000LSC