

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8902240369 DOC. DATE: 89/01/31<sup>02 15</sup> NOTARIZED: NO DOCKET #  
 FACIL: 50-269 Oconee Nuclear Station, Unit 1, Duke Power Co. 05000269  
 50-270 Oconee Nuclear Station, Unit 2, Duke Power Co. 05000270  
 50-287 Oconee Nuclear Station, Unit 3, Duke Power Co. 05000287  
 AUTH. NAME AUTHOR AFFILIATION  
 WILLIAMS, R.A. Duke Power Co.  
 TUCKER, H.B. Duke Power Co.  
 RECIP. NAME RECIPIENT AFFILIATION

SUBJECT: Monthly operating repts for Jan 1989 fo Oconee Nuclear Station. W/ (890215) ltr.

DISTRIBUTION CODE: IE24D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 17  
 TITLE: Monthly Operating Report (per Tech Specs)

### NOTES:

RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
PD2-3 LA	1 0	PD2-3 PD	5 5
PASTIS, H	1 0		
INTERNAL: ACRS	10 10	AEOD/DOA	1 1
AEOD/DSP/TPAB	1 1	ARM TECH ADV	2 2
NRR/DLPQ/PEB 11	1 1	NRR/DOEA/EAB 11	1 1
NRR/DREP/RPB 10	1 1	NUDOCS-ABSTRACT	1 1
<del>REG FILE</del> 01	1 1	RGN2	1 1
EXTERNAL: EG&G SIMPSON, F	1 1	EG&G WILLIAMS, S	1 1
LPDR	1 1	NRC PDR	1 1
NSIC	1 1		

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 32 ENCL 30

M/R  
cc

Duke Power Company  
P.O. Box 33198  
Charlotte, N.C. 28242

HAL B. Tucker  
Vice President  
Nuclear Production  
(704)373-4531



**DUKE POWER**

February 15, 1989

U. S. Nuclear Regulatory Commission  
Attention: Document Control Desk  
Washington, D. C. 20555

Re: Oconee Nuclear Station  
Docket No. 50-269, -270, -287

Dear Sir:

Please find attached information concerning the performance and operating status of the Oconee Nuclear Station for the month of January, 1989.

Very truly yours,

Hal B. Tucker

JAR/15/lcs

Attachment

xc: Mr. M. L. Ernst, Acting  
Regional Administrator/Region II  
U. S. Nuclear Regulatory Commission  
101 Marietta Street, NW, Suite 2900  
Atlanta, Georgia 30323

Mr. Phil Ross  
U. S. Nuclear Regulatory Commission  
MNBB-5715  
Washington, D. C. 20555

Ms. Helen Pastis, Project Manager  
Office of Nuclear Reactor Regulation  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

Mr. P. H. Skinner  
NRC Resident Inspector  
Oconee Nuclear Station

American Nuclear Insurers  
c/o Dottie Sherman, ANI Library  
The Exchange, Suite 245  
270 Farmington Avenue  
Farmington, CT 06032

INPO Records Center  
Suite 1500  
1100 Circle 75 Parkway  
Atlanta, Georgia 30323

Mr. Robert G. Rogers  
Nuclear Assurance Corporation  
6251 Crooked Creek Road  
Norcross, Georgia 30092

IE24  
11

# OPERATING DATA REPORT

## OPERATING STATUS

DOCKET NO 50-269  
 DATE February 15, 1989  
 COMPLETED BY R.A. Williams  
 TELEPHONE 704-373-5987

1. Unit Name: Oconee 1
2. Reporting Period: January 1, 1989-January 31, 1989
3. Licensed Thermal Power (MWt): 2568
4. Nameplate Rating (Gross MWe): 934
5. Design Electrical Rating (Net MWe): 886
6. Maximum Dependable Capacity (Gross MWe): 886
7. Maximum Dependable Capacity (Net MWe): 846
8. If Changes Occur in Capacity Ratings (Items Number 3 Through 7) Since Last Report. Give Reasons: \_\_\_\_\_

Notes Year-to date and cumulative capacity factors are calculated using a weighted average for maximum dependable capacity.

9. Power Level To Which Restricted, If Any (Net MWe): \_\_\_\_\_
10. Reason For Restrictions, If any: \_\_\_\_\_

	This Month	Yr.-to-Date	Cumulative
11. Hours In Reporting Period	744.0	744.0	136297.0
12. Number Of Hours Reactor Was Critical	57.9	57.9	100833.5
13. Reactor Reserve Shutdown Hours	--0--	--0--	--0--
14. Hours Generator On-Line	46.3	46.3	98492.3
15. Unit Reserve Shutdown Hours	--0--	--0--	--0--
16. Gross Thermal Energy Generated (MWH)	106632	106632	238647906
17. Gross Electrical Energy Generated (MWH)	35322	35322	82678253
18. Net Electrical Energy Generated (MWH)	29198	29198	78432490
19. Unit Service Factor	6.2	6.2	72.3
20. Unit Availability Factor	6.2	6.2	72.3
21. Unit Capacity Factor (Using MDC Net)	4.6	4.6	66.9
22. Unit Capacity Factor (Using DER Net)	4.4	4.4	64.9
23. Unit Forced Outage Rate	44.9	44.9	12.9

24. Shutdown Scheduled Over Next 6 Months (Type, Date, and Duration of Each):

Currently Refueling

25. If Shut Down At End Of Report Period. Estimated Date of Startup: February 15, 1989

26. Units In Test Status (Prior to Commercial Operation):

Forecast      Achieved

INITIAL CRITICALITY  
 INITIAL ELECTRICITY  
 COMMERCIAL OPERATION

\_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

8902240369 890131  
 PDR ADOCK 05000269  
 R PDC

IE24  
 11

# OPERATING DATA REPORT

DOCKET NO 50-269  
 UNIT Oconee 1  
 DATE February 15, 1989  
 COMPLETED BY R.A. Williams  
 TELEPHONE 704-373-5987

MONTH January, 1989

<u>DAY</u>	AVERAGE DAILY POWER LEVEL (MWe-Net)	<u>DAY</u>	AVERAGE DAILY POWER LEVEL (MWe-Net)
1	<u>838</u>	17	<u>0</u>
2	<u>524</u>	18	<u>0</u>
3	<u>0</u>	19	<u>0</u>
4	<u>0</u>	20	<u>0</u>
5	<u>0</u>	21	<u>0</u>
6	<u>0</u>	22	<u>0</u>
7	<u>0</u>	23	<u>0</u>
8	<u>0</u>	24	<u>0</u>
9	<u>0</u>	25	<u>0</u>
10	<u>0</u>	26	<u>0</u>
11	<u>0</u>	27	<u>0</u>
12	<u>0</u>	28	<u>0</u>
13	<u>0</u>	29	<u>0</u>
14	<u>0</u>	30	<u>0</u>
15	<u>0</u>	31	<u>0</u>
16	<u>0</u>		

## UNIT SHUTDOWNS AND POWER REDUCTIONS

DOCKET NO. 50-269  
 UNIT NAME OCONEE 1  
 DATE 02/15/89  
 COMPLETED BY J. J. MEAD  
 TELEPHONE (704)-373-5762

REPORT MONTH January 1989

N O .	DATE	(1) T Y P E	DURATION HOURS	(2) R E A S O N	(3) M E T H O D O F S H U T D O W N R / X	LICENSE EVENT REPORT NO.	(4) S Y S T E M C O D E	(5) C O M P O N E N T C O D E	CAUSE AND CORRECTIVE ACTION TO PREVENT RECURRENCE
1	89- 1- 2	F	20.97	B	3		ZZ	CKTBKR	CRD BREAKER TRIPPED BY CHANNEL 'D' BEING IN TEST WHILE CHANNEL 'A' WAS TRIPPED
1-P	89- 1- 3	F	--	A	--		HH	VALVEX	HOLDING POWER TO REPAIR FEEDWATER MAIN BLOCK VALVE '1FDW31'
2	89- 1- 3	F	16.72	A	4		EB	ELECON	A FIRE IN 6900 VOLT BUS '1TA' CAUSED TURBINE TRIP AND REACTOR RUNBACK, (REACTOR NOT SHUTDOWN)
3	89- 1- 4	S	660.00	C	1		RC	FUELXX	END OF CYCLE 11 REFUELING OUTAGE

(1)

F Forced  
S Scheduled

(2)

Reason:  
 A-Equipment Failure (Explain)  
 B-Maintenance or test  
 C-Refueling  
 D-Regulatory Restriction  
 E-Operator Training & License Examination  
 F-Administrative  
 G-Operator Error (Explain)  
 H-Other (Explain)

(3)

Method:  
 1-Manual  
 2-Manual Scram  
 3-Automatic Scram  
 4-Other (Explain)

(4)

Exhibit G - Instructions  
 for Preparation of Data  
 Entry Sheets For Licensee  
 Event Report (LER)  
 File (NUREG-0161)

(5)

Exhibit I - Same Source

DOCKET NO: 50-269

UNIT: Oconee 1

DATE: 02/15/89

#### NARRATIVE SUMMARY

Month: January, 1989

Oconee Unit 1 began the month of January at 100% full power. At 1523 on 01/02, the Reactor tripped during a Reactor Protection System Test. The unit returned to service at 1221 on 01/03, and subsequently held power at 15% to repair a Main Feedwater Block Valve. At 1917, on 01/03, while increasing power, the Turbine tripped due to a fire in the 6900 volt bus. Following a review of the damage caused by the fire, the unit entered its End of Cycle 11 Refueling Outage 24 days early. The unit remained off line at month's end for its End of Cycle 11 Refueling Outage.

Prepared by: J. J. Mead  
Telephone: 704-373-5762

MONTHLY REFUELING INFORMATION REQUEST

1. Facility name: Oconee, Unit 1
2. Scheduled next refueling shutdown: Currently Refueling
3. Scheduled restart following refueling: February, 1989
4. Will refueling or resumption of operation thereafter require a technical specification change or other license amendment? No

If yes, what will these be? \_\_\_\_\_

If no, has reload design and core configuration been reviewed by Safety Review Committee regarding unreviewed safety questions? N/A

5. Scheduled date(s) for submitting proposed licensing action and supporting information: N/A
6. Important licensing considerations (new or different design or supplier, unreviewed design or performance analysis methods, significant changes in design or new operating procedures).
7. Number of fuel assemblies (a) in the core: 177  
(b) in the spent fuel pool: 985\*
8. Present licensed fuel pool capacity: 1312  
Size of requested or planned increase: \*\*
9. Projected date of last refueling which can be accommodated by present licensed capacity: August, 1991

DUKE POWER COMPANY

DATE: February 15, 1989

Name of Contact: J. A. Reavis

Phone: 704-373-7567

\*Represents the combined total for Units 1 and 2.

\*\* On March 31, 1988, submitted a license application for an ISFSI which will store 2112 assemblies.

# OPERATING DATA REPORT

## OPERATING STATUS

DOCKET NO 50-270

DATE February 15, 1989

COMPLETED BY R.A. Williams

TELEPHONE 704-373-5987

1. Unit Name: Oconee 2
2. Reporting Period: January 1, 1989-January 31, 1989
3. Licensed Thermal Power (MWT): 2568
4. Nameplate Rating (Gross MWe): 934
5. Design Electrical Rating (Net MWe): 886
6. Maximum Dependable Capacity (Gross MWe): 886
7. Maximum Dependable Capacity (Net MWe): 846
8. If Changes Occur in Capacity Ratings (Items Number 3 Through 7) Since Last Report. Give Reasons: \_\_\_\_\_

Notes Year-to date and cumulative capacity factors are calculated using a weighted average for maximum dependable capacity.

9. Power Level To Which Restricted, If Any (Net MWe): \_\_\_\_\_
10. Reason For Restrictions, If any: \_\_\_\_\_

	This Month	Yr.-to-Date	Cumulative
11. Hours In Reporting Period	744.0	744.0	126217.0
12. Number Of Hours Reactor Was Critical	744.0	744.0	96437.4
13. Reactor Reserve Shutdown Hours	--0--	--0--	--0--
14. Hours Generator On-Line	744.0	744.0	94918.6
15. Unit Reserve Shutdown Hours	--0--	--0--	--0--
16. Gross Thermal Energy Generated (MWH)	1909968	1909968	226710302
17. Gross Electrical Energy Generated (MWH)	652858	652858	77146402
18. Net Electrical Energy Generated (MWH)	625715	625715	73361067
19. Unit Service Factor	100.0	100.0	75.2
20. Unit Availability Factor	100.0	100.0	75.2
21. Unit Capacity Factor (Using MDC Net)	99.4	99.4	67.5
22. Unit Capacity Factor (Using DER Net)	94.9	94.9	65.5
23. Unit Forced Outage Rate	0.0	0.0	11.1
24. Shutdown Scheduled Over Next 6 Months (Type, Date, and Duration of Each):			
Refueling - May 9, 1989 - 6 weeks			

25. If Shut Down At End Of Report Period. Estimated Date of Startup: \_\_\_\_\_
26. Units In Test Status (Prior to Commercial Operation):

Forecast Achieved

INITIAL CRITICALITY  
INITIAL ELECTRICITY  
COMMERCIAL OPERATION

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_



# OPERATING DATA REPORT

DOCKET NO 50-270  
UNIT Oconee 2  
DATE February 15, 1989  
COMPLETED BY R.A. Williams  
TELEPHONE 704-373-5987

MONTH January, 1989

<u>DAY</u>	<u>AVERAGE DAILY POWER LEVEL</u> <u>(MWe-Net)</u>	<u>DAY</u>	<u>AVERAGE DAILY POWER LEVEL</u> <u>(MWe-Net)</u>
1	<u>842</u>	17	<u>843</u>
2	<u>839</u>	18	<u>843</u>
3	<u>837</u>	19	<u>843</u>
4	<u>838</u>	20	<u>843</u>
5	<u>839</u>	21	<u>843</u>
6	<u>841</u>	22	<u>843</u>
7	<u>842</u>	23	<u>842</u>
8	<u>842</u>	24	<u>842</u>
9	<u>841</u>	25	<u>843</u>
10	<u>841</u>	26	<u>843</u>
11	<u>842</u>	27	<u>843</u>
12	<u>837</u>	28	<u>843</u>
13	<u>835</u>	29	<u>842</u>
14	<u>835</u>	30	<u>842</u>
15	<u>839</u>	31	<u>843</u>
16	<u>843</u>		

## UNIT SHUTDOWNS AND POWER REDUCTIONS

DOCKET NO. 50-270UNIT NAME OCONEE 2DATE 02/15/89REPORT MONTH January 1989COMPLETED BY J. J. MEADTELEPHONE (704)-373-5762

N O .	DATE	(1)  T Y P E	DURATION HOURS	(2) R E A S O N	(3) M E T H O D O F S H U T D O W N R / X	LICENSE EVENT REPORT NO.	(4)  S Y S - T E M C O D E	(5)  C O M P O N E N T C O D E	CAUSE AND CORRECTIVE ACTION TO PREVENT RECURRENCE
		NO	SHUTDOWNS	OR		REDUCTIONS			


(1)  
F Forced  
S Scheduled

(2)  
Reason:  
A-Equipment Failure (Explain)  
B-Maintenance or test  
C-Refueling  
D-Regulatory Restriction  
E-Operator Training & License Examination  
F-Administrative  
G-Operator Error (Explain)  
H-Other (Explain)

(3)  
Method:  
1-Manual  
2-Manual Scram  
3-Automatic Scram  
4-Other (Explain)

(4)  
Exhibit G - Instructions  
for Preparation of Data  
Entry Sheets For License  
Event Report (LER)  
File (NUREG-0161)

(5)  
Exhibit I - Same Source

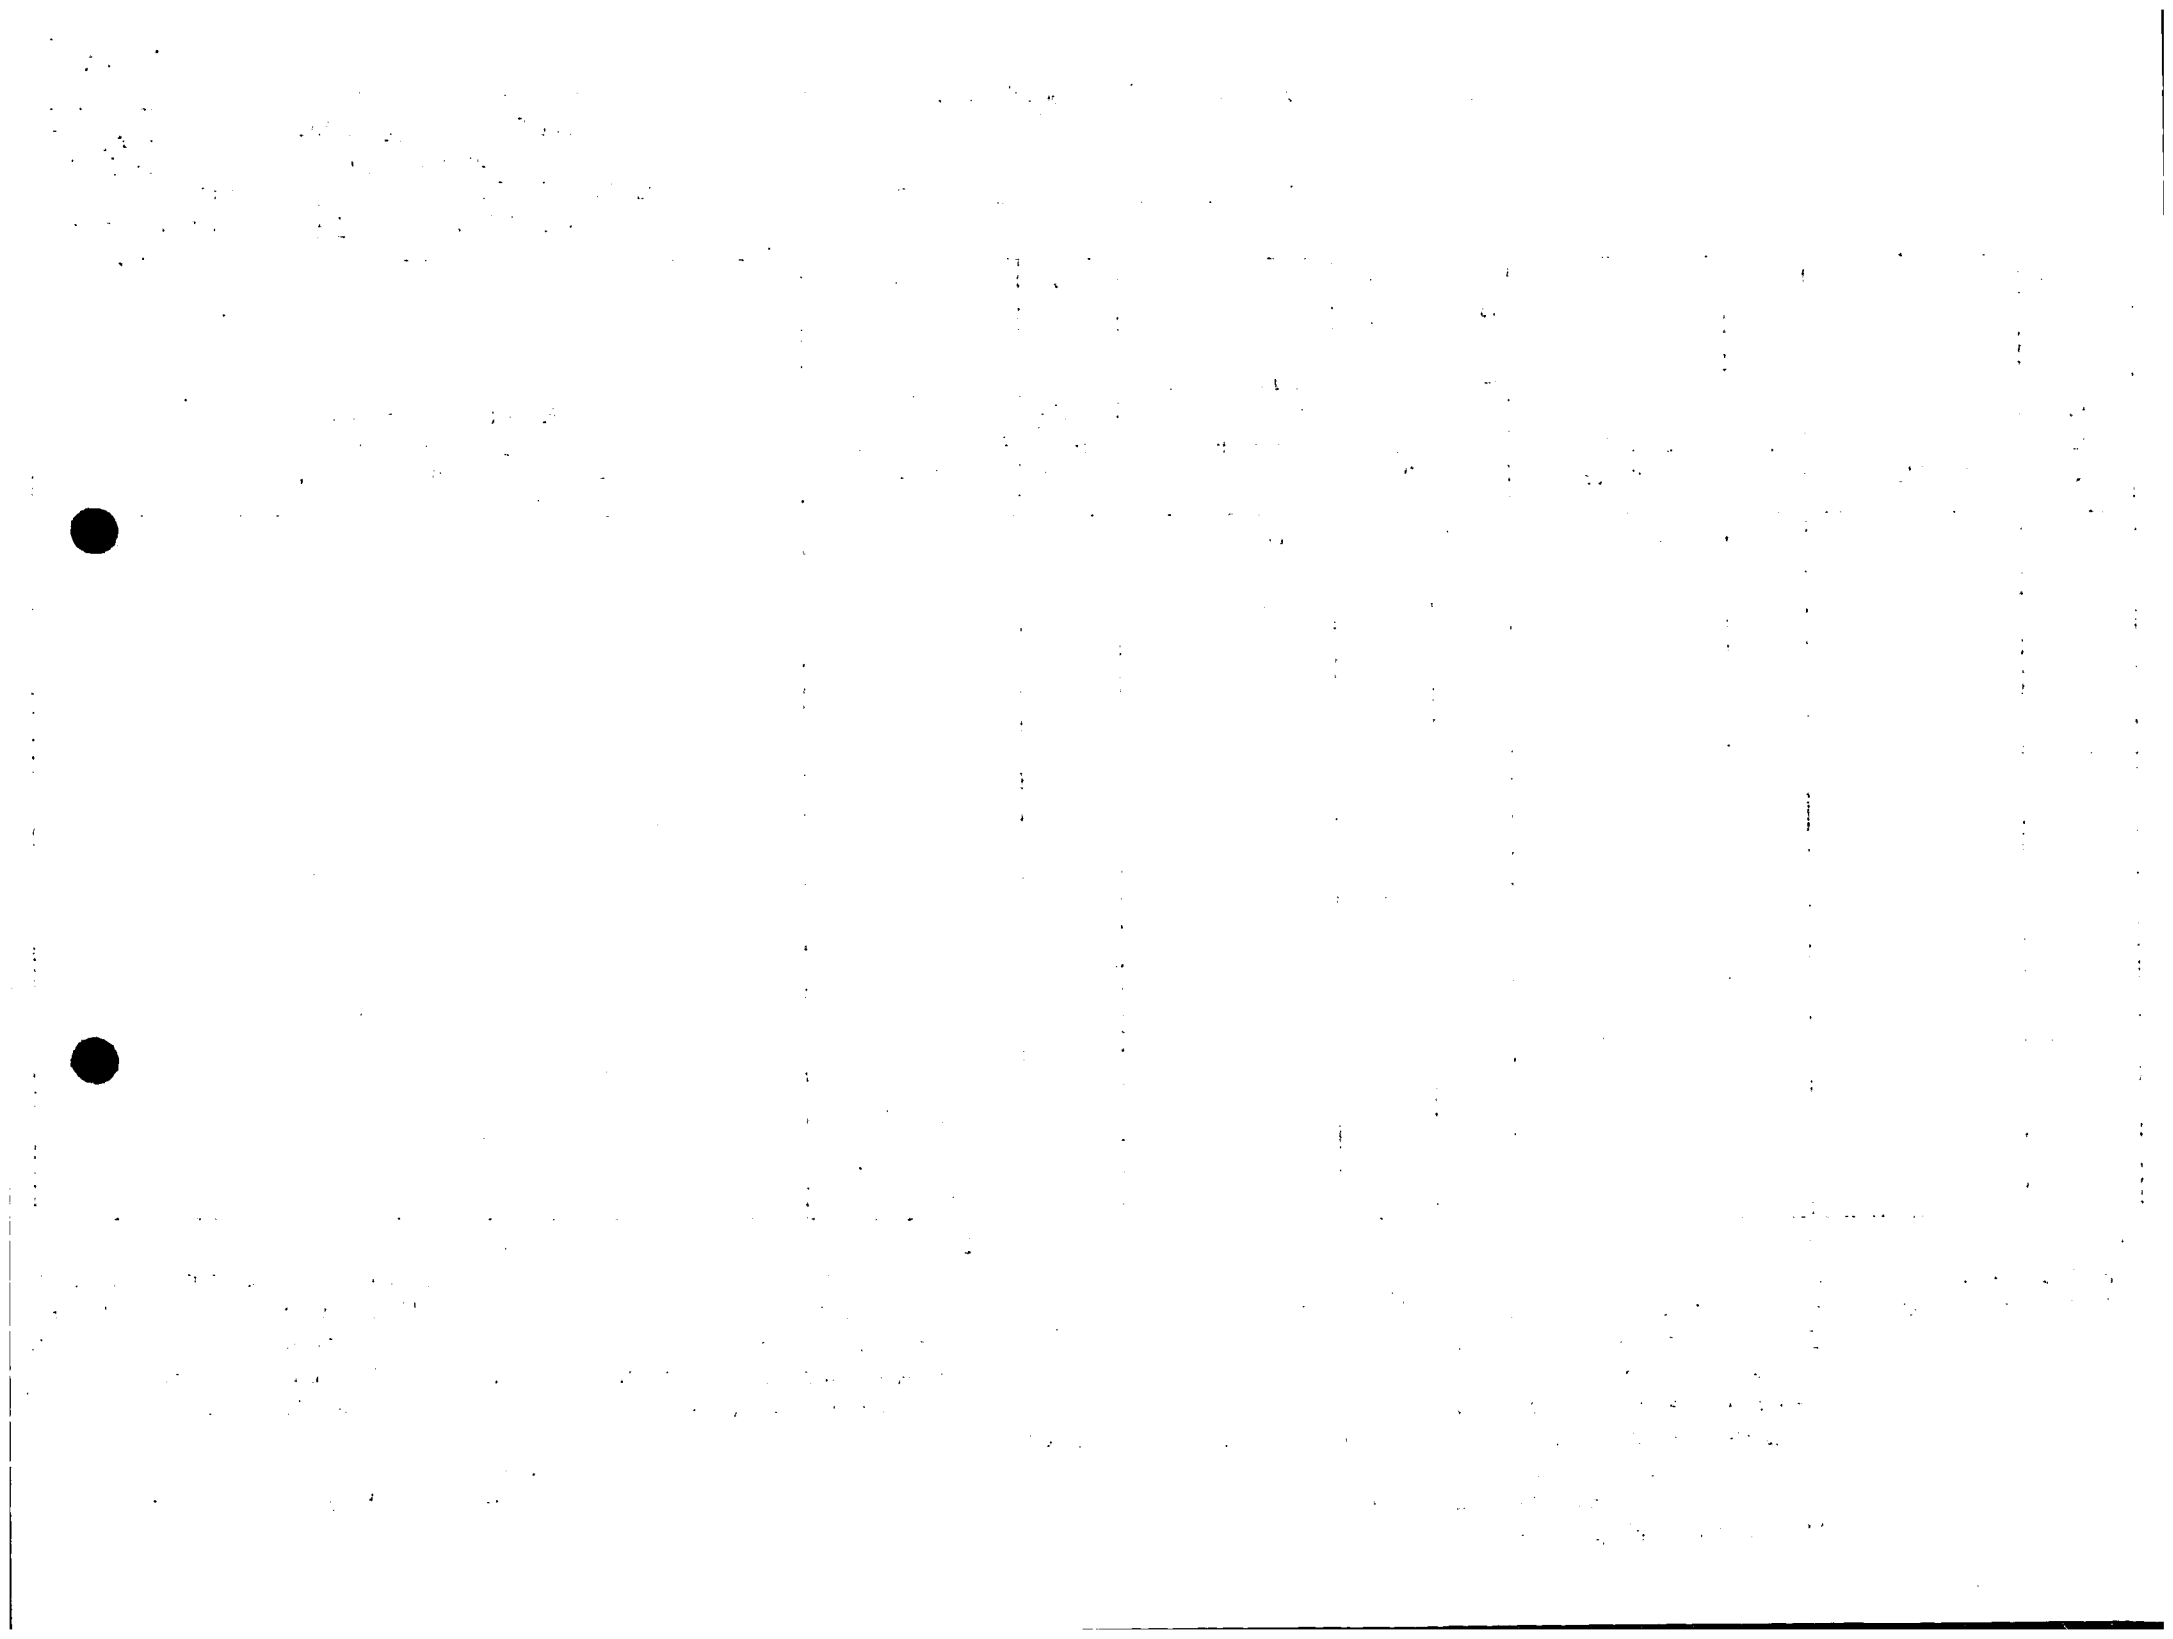

DOCKET NO: 50-270

UNIT: Ocone 2

DATE: 02/15/89

#### NARRATIVE SUMMARY

Month: January, 1989

Ocone Unit 2 operated at 100% full power for the entire month of January, 1989.

Prepared by: J. J. Mead  
Telephone: 704-373-5762

MONTHLY REFUELING INFORMATION REQUEST

1. Facility name: Oconee, Unit 2
2. Scheduled next refueling shutdown: May, 1989
3. Scheduled restart following refueling: July, 1989
4. Will refueling or resumption of operation thereafter require a technical specification change or other license amendment? No

If yes, what will these be? \_\_\_\_\_

If no, has reload design and core configuration been reviewed by Safety Review Committee regarding unreviewed safety questions? N/A

5. Scheduled date(s) for submitting proposed licensing action and supporting information: N/A
6. Important licensing considerations (new or different design or supplier, unreviewed design or performance analysis methods, significant changes in design or new operating procedures).
7. Number of fuel assemblies (a) in the core: 177  
(b) in the spent fuel pool: 985\*
8. Present licensed fuel pool capacity: 1312  
Size of requested or planned increase: \*\*
9. Projected date of last refueling which can be accommodated by present licensed capacity: August, 1991

DUKE POWER COMPANY

DATE: February 15, 1989

Name of Contact: J. A. Reavis

Phone: 704-373-7567

\*Represents the combined total for Units 1 and 2.

\*\* See footnote on Unit 1

# OPERATING DATA REPORT

## OPERATING STATUS

DOCKET NO 50-287

DATE February 15, 1989

COMPLETED BY R.A. Williams

TELEPHONE 704-373-5987

1. Unit Name: Oconee 3
2. Reporting Period: January 1, 1989-January 31, 1989
3. Licensed Thermal Power (Mwt): 2568
4. Nameplate Rating (Gross MWe): 934
5. Design Electrical Rating (Net MWe): 886
6. Maximum Dependable Capacity (Gross MWe): 886
7. Maximum Dependable Capacity (Net MWe): 846
8. If Changes Occur in Capacity Ratings (Items Number 3 Through 7) Since Last Report. Give Reasons: \_\_\_\_\_

Notes Year-to date and cumulative capacity factors are calculated using a weighted average for maximum dependable capacity.

9. Power Level To Which Restricted, If Any (Net MWe): \_\_\_\_\_

10. Reason For Restrictions, If any: \_\_\_\_\_

	This Month	Yr.-to-Date	Cumulative
11. Hours In Reporting Period	744.0	744.0	123864.0
12. Number Of Hours Reactor Was Critical	682.9	682.9	91261.4
13. Reactor Reserve Shutdown Hours	--0--	--0--	--0--
14. Hours Generator On-Line	673.0	673.0	89851.0
15. Unit Reserve Shutdown Hours	--0--	--0--	--0--
16. Gross Thermal Energy Generated (MWH)	1748496	1748496	220648231
17. Gross Electrical Energy Generated (MWH)	591980	591980	76035424
18. Net Electrical Energy Generated (MWH)	565190	565190	72450570
19. Unit Service Factor	90.5	90.5	72.5
20. Unit Availability Factor	90.5	90.5	72.5
21. Unit Capacity Factor (Using MDC Net)	89.8	89.8	68.0
22. Unit Capacity Factor (Using DER Net)	85.7	85.7	66.0
23. Unit Forced Outage Rate	9.6	9.6	12.7
24. Shutdown Scheduled Over Next 6 Months (Type, Date, and Duration of Each):			
None			

25. If Shut Down At End Of Report Period. Estimated Date of Startup: \_\_\_\_\_

26. Units In Test Status (Prior to Commercial Operation):

Forecast Achieved

INITIAL CRITICALITY  
INITIAL ELECTRICITY  
COMMERCIAL OPERATION

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

# OPERATING DATA REPORT

DOCKET NO 50-287  
UNIT Oconee 3  
DATE February 15, 1989  
COMPLETED BY R.A. Williams  
TELEPHONE 704-373-5987

MONTH January, 1989

<u>DAY</u>	<u>AVERAGE DAILY POWER LEVEL</u> <u>(MWe-Net)</u>	<u>DAY</u>	<u>AVERAGE DAILY POWER LEVEL</u> <u>(MWe-Net)</u>
1	<u>853</u>	17	<u>853</u>
2	<u>853</u>	18	<u>854</u>
3	<u>852</u>	19	<u>853</u>
4	<u>852</u>	20	<u>853</u>
5	<u>852</u>	21	<u>853</u>
6	<u>852</u>	22	<u>853</u>
7	<u>852</u>	23	<u>853</u>
8	<u>852</u>	24	<u>852</u>
9	<u>851</u>	25	<u>852</u>
10	<u>852</u>	26	<u>853</u>
11	<u>852</u>	27	<u>853</u>
12	<u>196</u>	28	<u>853</u>
13	<u>0</u>	29	<u>853</u>
14	<u>0</u>	30	<u>852</u>
15	<u>403</u>	31	<u>853</u>
16	<u>853</u>		

## UNIT SHUTDOWNS AND POWER REDUCTIONS

REPORT MONTH January 1989DOCKET NO. 50-287UNIT NAME OCONEE 3DATE 02/15/89COMPLETED BY J. J. MEADTELEPHONE (704)-373-5762

N O .	DATE	(1)  T Y P E	DURATION HOURS	(2) R E A S O N	(3) M E T H O D O F S H U T D O W N R / X	LICENSE EVENT REPORT NO.	(4)  S Y S - T E M C O D E	(5)  C O M P O N E N T C O D E	CAUSE AND CORRECTIVE ACTION TO PREVENT RECURRENCE
1	89- 1-12	F	71.02	A	1		SB	XXXXXX	REACTOR BUILDING COOLING UNITS 'A' & 'C' DECLARED INOPERABLE

(1)

F Forced  
S Scheduled

(2)

Reason:  
A-Equipment Failure (Explain)  
B-Maintenance or test  
C-Refueling  
D-Regulatory Restriction  
E-Operator Training & License Examination  
F-Administrative  
G-Operator Error (Explain)  
H-Other (Explain)

(3)

Method:  
1-Manual  
2-Manual Scram  
3-Automatic Scram  
4-Other (Explain)

(4)

Exhibit G - Instructions  
for Preparation of Data  
Entry Sheets For Licensee  
Event Report (LER)  
File (NUREG-0161)

(5)

Exhibit I - Same Source



DOCKET NO: 50-287

UNIT: Ocone 3

DATE: 02/15/89

#### NARRATIVE SUMMARY

Month: January, 1989

Ocone Unit 3 began the month of January operating at 100% full power. At 0303 on 1/12, a controlled unit shutdown was commenced due to inoperable Reactor Building Cooling Units. The unit was removed from service at 0857 that same day, and returned to service at 0758 on 01/15. The unit returned to 100% full power at 1933 on 01/15, where it then operated for the remainder of the month.

Prepared by: J. J. Mead  
Telephone: 704-373-5762

MONTHLY REFUELING INFORMATION REQUEST

1. Facility name: Oconee, Unit 3
2. Scheduled next refueling shutdown: November, 1989
3. Scheduled restart following refueling: January, 1989
4. Will refueling or resumption of operation thereafter require a technical specification change or other license amendment? No

If yes, what will these be?

If no, has reload design and core configuration been reviewed by Safety Review Committee regarding unreviewed safety questions? N/A

5. Scheduled date(s) for submitting proposed licensing action and supporting information: N/A
6. Important licensing considerations (new or different design or supplier, unreviewed design or performance analysis methods, significant changes in design or new operating procedures).
7. Number of fuel assemblies (a) in the core: 177  
(b) in the spent fuel pool: 548
8. Present licensed fuel pool capacity: 875  
Size of requested or planned increase: \*\*
9. Projected date of last refueling which can be accommodated by present licensed capacity: August, 1991

DUKE POWER COMPANY

DATE: February 15, 1989

Name of Contact: J. A. Reavis

Phone: 704-373-7567

\*\* See footnote on Unit 1

OCONEE NUCLEAR STATION  
MONTHLY OPERATING STATUS REPORT

December 1988

1. Personnel Exposure

For the month of December, no individuals exceeded 10 percent of their allowable annual radiation dose limit.

2. The total station liquid release for December has been compared with the Technical Specifications maximum annual dose commitment and was less than 10 percent of this limit.

The total station gaseous release for December has been compared with the Technical Specifications maximum annual dose commitment and was less than 10 percent of this limit.