

DISTRIBUTION AFTER ISSUANCE OF OPERATING LICENSE

NRC FORM 195
(2-76)

U.S. NUCLEAR REGULATORY COMMISSION

DOCKET NUMBER

FILE NUMBER

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

TO:

Mr. E. G. Case

FROM:

Duke Power Company
Charlotte, North Carolina
William O. Parker, Jr.

DATE OF DOCUMENT

8/11/77

DATE RECEIVED

8/18/77

☒ LETTER☐ NOTORIZED

PROP

INPUT FORM

NUMBER OF COPIES RECEIVED

☒ ORIGINAL
☐ COPY☒ UNCLASSIFIED

1 Signed

DESCRIPTION

Response to NRC's ltr. of 7/18/77 concerning
the use of throttle valves to obtain the
required flow distribution in the HPSI or
LPSI systems.....

DO NOT REMOVE

(1-P)

ACKNOWLEDGED

PLANT NAME: Oconee Units 1-2-3

RJL 8/18/77

ENCLOSURE

SAFETY

FOR ACTION/INFORMATION

BRANCH CHIEF: (7)

Schwenger

INTERNAL DISTRIBUTION

☒ REG FILE

NRC PDR

I & E (2)

OELD

HANAUER

CHECK

STELLO

EISENHUT

SHAO

BAER

BUTLER

GRIMES

J. COLLINS

EXTERNAL DISTRIBUTION

CONTROL NUMBER

LPDR: WALHALLA, SC

TIC

NSIC

16 CYS ACRS SENT CATEGORY B

misc
772300217

B

DUKE POWER COMPANY

POWER BUILDING

422 SOUTH CHURCH STREET, CHARLOTTE, N. C. 28242

WILLIAM O. PARKER, JR.
VICE PRESIDENT
STEAM PRODUCTION

August 11, 1977

TELEPHONE: AREA 704
373-4083


Mr. E. G. Case, Acting Director
Office of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Regulatory

File Cy.

Attention: Mr. A. Schwencer, Chief
Operating Reactors Branch #1


Reference: Oconee Nuclear Station
Docket Nos. 50-269, -270, -287

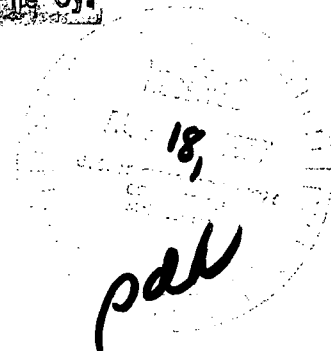

Dear Sir:

In response to your letter of July 18, 1977 concerning the use of throttle valves to obtain the required flow distribution in the HPSI or LPSI systems, a review of the Oconee design was performed. The design of the Oconee Nuclear Station does not require the use of either manual or motor operated valves in these lines that have electrical or mechanical stops which must be adjusted to insure that flow requirements are satisfied.

Very truly yours,

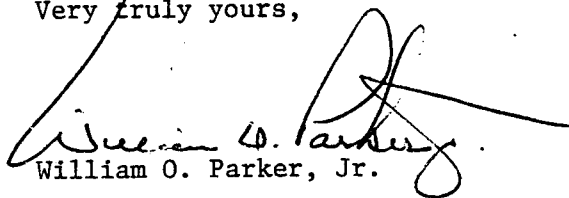
William O. Parker, Jr.

MST:ge

772300217