
PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 1

LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|---------------------------------------|------|-----------|
| Document Control | NA | |
| | | |
| <u>LIST OF EFFECTIVE PAGES</u> | | |
| | | |
| LEFF-1 through LEFF-32 | 17 | |
| | | |
| <u>TABLE OF CONTENTS</u> | NA | |
| | | |
| i through lx | 17 | |
| | | |
| <u>SECTION 1</u> | NA | |
| | | |
| 1.1-1 through 1.1-2 | 13 | |
| 1.2-1 through 1.2-2 | 17 | 01505901 |
| 1.3-1 through 1.3-2 | 16 | |
| 1.4-1 through 1.4-2 | 12 | |
| 1.5-1 through 1.5-2 | 14 | |
| Table 1.3-1 | 9 | |
| Table 1.3-2 | 10 | |
| Figure 1.2-1 | 2 | |
| Figure 1.3-1 | 3 | |
| Figure 1.3-2 | 8 | |
| Figure 1.3-3 | 8 | |
| Figure 1.3-4 | 8 | |
| Figure 1.3-5 | 8 | |
| Figure 1.3-6 | 8 | |
| Figure 1.3-7 | 8 | |
| Figure 1.3-8 | 3 | |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 2

LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|-------------------------|------|-----------|
| | | |
| <u>SECTION 2</u> | NA | |
| | | |
| 2.1-1 through 2.1-2 | 12 | |
| 2.2-1 through 2.2-2 | 17 | 01505824 |
| 2.3-1 through 2.3-4 | 9 | |
| 2.4-1 through 2.4-4 | 9 | |
| 2.5-1 through 2.5-7 | 9 | |
| 2.6-1 | 17 | 01441968 |
| Table 2.1-1 | 17 | 01441968 |
| Table 2.3-1 | 9 | |
| Table 2.3-2 | 9 | |
| Figure 2.1-1 | 0 | |
| Figure 2.1-2 | 3 | |
| Figure 2.1-3 | 3 | |
| Figure 2.3-1 | 0 | |
| Figure 2.3-2 | 0 | |
| Figure 2.4-1 | 0 | |
| Figure 2.4-2 | 0 | |
| Figure 2.4-3 | 0 | |
| Figure 2.4-4 | 0 | |
| Figure 2.5-1 | 0 | |
| Figure 2.5-2 | 0 | |
| Figure 2.5-3 | 0 | |
| Figure 2.5-4 | 0 | |
| Figure 2.5-5 | 2 | |
| Figure 2.5-6 | 3 | |
| Figure 2.5-7 | 3 | |
| Figure 2.5-8 | 3 | |
| Figure 2.5-9 | 2 | |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17

LEFF Page 3

LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|---------------------------|------|--------------------|
| | | |
| <u>APPENDIX 2A</u> | NA | |
| | | |
| 2A-1 through 2A-27 | 2 | |
| | | |
| | | |
| <u>APPENDIX 2B</u> | NA | |
| | | |
| 2B-1 through 2B-28 | 2 | |
| | | |
| <u>SECTION 3</u> | NA | |
| | | |
| 3.1-1 through 3.1-4 | 16 | |
| 3.2-1 through 3.2-20 | 17 | 01505901 |
| 3.3-1 through 3.3-24 | 17 | 01505901, 01514587 |
| 3.4-1 through 3.4-2 | 17 | 01505901 |
| 3.5-1 through 3.5-4 | 17 | 01505901 |
| Table 3.1-1 | 9 | |
| Table 3.1-2 | 9 | |
| Table 3.2-1 | 9 | |
| Table 3.2-2 | 9 | |
| Table 3.2-3 | 9 | |
| Table 3.2-4 | 9 | |
| Table 3.2-5 | 9 | |
| Table 3.2-6 | 9 | |
| Table 3.2-7 | 9 | |
| Table 3.2-8 | 9 | |
| Table 3.2-9 | 9 | |
| Table 3.3-1 | 9 | |
| Table 3.3-2 | 9 | |
| Table 3.3-3 | 9 | |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17

LEFF Page 4

LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|-------------------------------------|------|-----------|
| | | |
| <u>SECTION 3</u> (continued) | NA | |
| | | |
| Table 3.3-4 | 9 | |
| Table 3.3-5 | 9 | |
| Table 3.3-6 | 9 | |
| Table 3.3-7 | 9 | |
| Table 3.3-8 | 9 | |
| Table 3.4-1 | 17 | 01505901 |
| Table 3.4-2 | 13 | |
| Figure 3.1-1 | 0 | |
| Figure 3.1-2 | 0 | |
| Figure 3.1-3 | 0 | |
| Figure 3.1-4 | 2 | |
| Figure 3.2-1 | 0 | |
| Figure 3.2-2 | 0 | |
| Figure 3.2-3 | 0 | |
| Figure 3.2-4 | 0 | |
| Figure 3.3-1 | 3 | |
| Figure 3.3-2 | 2 | |
| Figure 3.3-3 | 0 | |
| Figure 3.3-4 | 0 | |
| Figure 3.3-5 | 0 | |
| Figure 3.3-6 | 0 | |
| Figure 3.3-7 | 0 | |
| Figure 3.3-8 | 0 | |
| Figure 3.3-9 | 3 | |
| Figure 3.3-10 | 3 | |
| Figure 3.3-11 | 3 | |
| Figure 3.3-12 | 3 | |
| Figure 3.3-13 | 3 | |
| Figure 3.3-14 | 3 | |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17

LEFF Page 5

LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|-------------------------------------|------|-----------|
| | | |
| <u>SECTION 3</u> (continued) | NA | |
| | | |
| Figure 3.3-15 | 0 | |
| Figure 3.3-16 | 0 | |
| Figure 3.3-17 | 3 | |
| Figure 3.3-18 | 0 | |
| Figure 3.3-19 | 0 | |
| Figure 3.3-20 | 3 | |
| Figure 3.3-21 | 3 | |
| | | |
| | | |
| <u>APPENDIX 3A</u> | NA | |
| Cover page, 3A-1 – 3A-16 | 14 | |
| | | |
| | | |
| <u>SECTION 4</u> | NA | |
| | | |
| 4.1-1 through 4.1-2 | 9 | |
| 4.2-1 through 4.2-12 | 12 | |
| 4.3-1 through 4.3-12 | 17 | 01505901 |
| 4.4-1 through 4.4-4 | 11 | |
| 4.5-1 through 4.5-4 | 13 | |
| 4.6-1 through 4.6-2 | 17 | 01505901 |
| 4.7-1 through 4.7-2 | 13 | |
| Table 4.2-1 | 12 | |
| Table 4.2-2 | 9 | |
| Table 4.2-3 | 9 | |
| Table 4.2-4 | 9 | |
| Table 4.2-5 | 9 | |
| Table 4.2-6 | 9 | |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17

LEFF Page 6

LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|-------------------------------------|------|-----------|
| | | |
| <u>SECTION 4</u> (continued) | NA | |
| | | |
| Table 4.2-6a | 9 | |
| Table 4.2-7 | 9 | |
| Table 4.2-8 | 9 | |
| Table 4.2-9 | 9 | |
| Table 4.2-10 | 9 | |
| Table 4.2-11 | 9 | |
| Table 4.2-12 | 9 | |
| Table 4.2-13 | 9 | |
| Table 4.2-14 | 9 | |
| Table 4.2-15 | 12 | |
| Table 4.5-1 | 13 | |
| Table 4.6-1 | 9 | |
| Table 4.6-2 | 17 | 01505901 |
| Table 4.6-3 | 17 | 01505901 |
| Figure 4.1-1 (DELETED) | 2 | |
| Figure 4.2-1 | 3 | |
| Figure 4.2-1a | 3 | |
| Figure 4.2-2 (DELETED) | 1 | |
| Figure 4.2-3 (DELETED) | 1 | |
| Figure 4.2-4 (DELETED) | 1 | |
| Figure 4.2-5 (DELETED) | 1 | |
| Figure 4.2-6 | 0 | |
| Figure 4.3-1 | 3 | |
| Figure 4.3-2 | 3 | |
| Figure 4.3-3 | 3 | |
| Figure 4.3-4 | 3 | |
| Figure 4.3-5 | 3 | |
| Figure 4.3-6 | 3 | |
| Figure 4.3-7 | 3 | |
| Figure 4.4-1 | 0 | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17

LEFF Page 7

LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|-------------------------------------|------|-----------|
| | | |
| <u>SECTION 4</u> (continued) | NA | |
| | | |
| Figure 4.4-2 | 0 | |
| Figure 4.4-3 | 0 | |
| | | |
| | | |
| <u>APPENDIX 4A</u> | NA | |
| | | |
| 4A-1 through 4A-22 | 12 | |
| Table 4A.2-1 | 10 | |
| Table 4A.2-2 | 11 | |
| Table 4A.2-3 | 9 | |
| Table 4A.3.3-1 | 9 | |
| Table 4A.3.3-2 | 9 | |
| Table 4A.3.3-3 | 9 | |
| Table 4A.3.3-4 | 9 | |
| Table 4A.3.3-5 | 9 | |
| Table 4A.3.3-6 | 9 | |
| Table 4A.3.3-7 | 9 | |
| Table 4A.3.4.1-1 | 9 | |
| Table 4A.3.4.1-2 | 9 | |
| Table 4A.3.4.1-3 | 9 | |
| Table 4A.3.5-1 | 9 | |
| Table 4A.3.5-2 | 9 | |
| Table 4A.3.5-3 | 9 | |
| Table 4A.3.5-4 | 9 | |
| Table 4A.3.5-5 | 9 | |
| Table 4A.3.5-6 | 9 | |
| Table 4A.3.5-7 | 9 | |
| Table 4A.3.5-8 | 9 | |
| Table 4A.6-1 | 9 | |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17

LEFF Page 8

LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|---------------------------------------|------|-----------|
| | | |
| <u>APPENDIX 4A</u> (continued) | NA | |
| | | |
| Table 4A.6-2 | 9 | |
| Table 4A.7-1 | 12 | |
| Figure 4A.1-1 | 3 | |
| Figure 4A.3-1 | 0 | |
| Figure 4A.3-2 | 0 | |
| Figure 4A.3-3 | 2 | |
| Figure 4A.3-4 | 0 | |
| Figure 4A.3-5 | 0 | |
| Figure 4A.3-6 | 0 | |
| Figure 4A.3-7 | 0 | |
| Figure 4A.3-8 | 0 | |
| Figure 4A.3-9 | 0 | |
| Figure 4A.3-10 | 0 | |
| Figure 4A.3-11 | 0 | |
| Figure 4A.3-12 | 3 | |
| Figure 4A.3-12a | 0 | |
| Figure 4A.3-12b | 2 | |
| Figure 4A.3-13 | 0 | |
| Figure 4A.3-14 | 0 | |
| Figure 4A.4-1 | 0 | |
| Figure 4A.4-2 | 0 | |
| Figure 4A.5-1 (DELETED) | 1 | |
| Figure 4A.5-2 (DELETED) | 1 | |
| Figure 4A.5-3 (DELETED) | 1 | |
| Figure 4A.5-4 (DELETED) | 1 | |
| Figure 4A.5-5 (DELETED) | 1 | |
| Figure 4A.5-6 (DELETED) | 1 | |
| Figure 4A.5-7 (DELETED) | 1 | |
| Figure 4A.6-1 | 4 | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17

LEFF Page 9

LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|---------------------------------------|------|-----------|
| | | |
| <u>APPENDIX 4A</u> (continued) | NA | |
| | | |
| Figure 4A.7-1 | 0 | |
| Figure 4A.7-2 | 0 | |
| | | |
| | | |
| <u>APPENDIX 4B</u> | NA | |
| | | |
| 4B-1 through 4B-12 | 9 | |
| Table 4B.1-1 | 9 | |
| Table 4B.1-2 | 9 | |
| Table 4B.1-3 | 9 | |
| Table 4B.1-4 | 9 | |
| Figure 4B.2-1 | 8 | |
| Figure 4B.2-2 | 1 | |
| Figure 4B.2-3 | 1 | |
| Figure 4B.2-4 | 1 | |
| Figure 4B.2-5 | 1 | |
| Figure 4B.2-6 | 1 | |
| Figure 4B.2-7 | 1 | |
| Figure 4B.2-8 | 1 | |
| Figure 4B.2-9 | 1 | |
| Figure 4B.3-12 | 1 | |
| Figure 4B.3-13 | 1 | |
| Figure 4B.6-1 | 1 | |
| Figure 4B.6-2 | 1 | |
| Figure 4B.6-3 | 8 | |
| Figure 4B.6-4 | 8 | |
| Figure 4B.6-5 | 1 | |
| Figure 4B.6-6 | 8 | |
| Figure 4B.6-7 | 8 | |
| Figure 4B.7-1 | 8 | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 10

LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|---------------------------|------|-----------|
| | | |
| <u>APPENDIX 4C</u> | NA | |
| | | |
| 4C-1 through 4C-4 | 9 | |
| Figure 4C.1-1 | 1 | |
| Figure 4C.1-2 | 1 | |
| Figure 4C.1-3 | 1 | |
| Figure 4C.1-4 | 1 | |
| Figure 4C.1-5 | 1 | |
| Figure 4C.1-6 | 1 | |
| Figure 4C.2-1 | 1 | |
| | | |
| | | |
| <u>SECTION 5</u> | NA | |
| | | |
| 5.1-1 through 5.1-3 | 11 | |
| 5.2-1 | 9 | |
| 5.3-1 | 9 | |
| 5.4-1 | 9 | |
| 5.5-1 | 9 | |
| 5.6-1 | 9 | |
| Table 5.1-1 | 11 | |
| Table 5.1-2 | 17 | 01505901 |
| Figure 5.1-1 | 3 | |
| Figure 5.4-1 | 3 | |
| | | |
| | | |
| <u>SECTION 6</u> | NA | |
| | | |
| 6.1-1 through 6.1-2 | 9 | |
| 6.2-1 through 6.2-2 | 9 | |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 11

LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|-------------------------|------|-----------|
| | | |
| <u>SECTION 7</u> | NA | |
| | | |
| 7.1-1 through 7.1-6 | 12 | |
| 7.2-1 through 7.2-2 | 9 | |
| 7.3-1 through 7.3-2 | 13 | |
| 7.4-1 through 7.4-2 | 13 | |
| 7.5-1 through 7.5-2 | 13 | |
| 7.6-1 through 7.6-2 | 11 | |
| 7.7-1 through 7.7-2 | 9 | |
| 7.8-1 through 7.8-2 | 9 | |
| Table 7.2-1 | 9 | |
| Table 7.2-2 | 9 | |
| Table 7.2-3 | 9 | |
| Table 7.2-3a | 9 | |
| Table 7.2-4 | 9 | |
| Table 7.2-5 | 9 | |
| Table 7.2-6 | 9 | |
| Table 7.2-7 | 9 | |
| Table 7.4-1 | 9 | |
| Table 7.4-2 | 9 | |
| Table 7.4-3 (DELETED) | 13 | |
| Table 7.4-4 (DELETED) | 13 | |
| Table 7.4-6 (DELETED) | 13 | |
| Figure 7.4-1 (DELETED) | 13 | |
| | | |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 12

LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|---------------------------|------|-----------|
| | | |
| <u>APPENDIX 7A</u> | NA | |
| | | |
| 7A-1 through 7A-4 | 13 | |
| Table 7A-1 | 9 | |
| Table 7A-2 | 9 | |
| Table 7A-3 | 9 | |
| Table 7A-4 | 9 | |
| Table 7A-5 (DELETED) | 13 | |
| Table 7A-5a (DELETED) | 13 | |
| Table 7A-5b (DELETED) | 13 | |
| Table 7A-6 (DELETED) | 13 | |
| Table 7A-7 (DELETED) | 13 | |
| Table 7A-8 (DELETED) | 13 | |
| Figure 7A-1 | 3 | |
| Figure 7A-2 | 3 | |
| Figure 7A-3 | 0 | |
| Figure 7A-4 | 0 | |
| Figure 7A-5 | 0 | |
| Figure 7A-6 | 2 | |
| Figure 7A-7 (DELETED) | 13 | |
| Figure 7A-8 (DELETED) | 2 | |
| Figure 7A-9 (DELETED) | 2 | |
| Figure 7A-10 (DELETED) | 13 | |
| Figure 7A-11 (DELETED) | 13 | |
| | | |
| <u>APPENDIX 7B</u> | NA | |
| | | |
| Cover page, 7B-1 – 7B-5 | 14 | |
| | | |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 13

LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|-------------------------|------|-----------|
| <u>SECTION 8</u> | NA | |
| | | |
| 8.1-1 through 8.1-2 | 9 | |
| 8.2-1 through 8.2-14 | 11 | |
| 8.3-1 through 8.3-2 | 9 | |
| 8.4-1 through 8.4-2 | 9 | |
| Table 8.2-1 | 9 | |
| Figure 8.2.1 (DELETED) | 1 | |
| Figure 8.2-1A | 3 | |
| Figure 8.2-1B | 5 | |
| Figure 8.2-1C | 3 | |
| Figure 8.2-1D | 3 | |
| Figure 8.2.2 (DELETED) | 1 | |
| Figure 8.2-5 | 8 | |
| Figure 8.2.20 (DELETED) | 1 | |
| Figure 8.2.21 (DELETED) | 1 | |
| Figure 8.2.22 (DELETED) | 1 | |
| Figure 8.2-33 | 0 | |
| | | |
| | | |
| <u>SECTION 9</u> | NA | |
| | | |
| 9.1-1 through 9.1-2 | 12 | |
| 9.2-1 through 9.2-2 | 11 | |
| 9.3-1 | 9 | |
| 9.4-1 through 9.4-2 | 15 | |
| 9.5-1 | 11 | |
| 9.6-1 | 15 | |
| 9.7-1 | 9 | |
| 9.8-1 through 9.8-3 | 17 | 01505901 |
| 9.9 | 17 | 01505901 |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 14

LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|-------------------------------------|------|-----------|
| <u>SECTION 9</u> (continued) | | |
| | | |
| Table 9.8-1 | 17 | 01505901 |
| Figure 9.1-1 | 12 | |
| Figure 9.1-2 | 12 | |
| Figure 9.1-3 | 12 | |
| Figure 9.1-4 | 12 | |
| | | |
| | | |
| <u>SECTION 10</u> | NA | |
| | | |
| 10.1-1 through 10.1-4 | 9 | |
| 10.2-1 through 10.2-2 | 9 | |
| 10.3-1 through 10.3-2 | 9 | |
| 10.4-1 through 10.4-2 | 9 | |
| 10.5-1 through 10.5-2 | 9 | |
| 10.6-1 through 10.6-2 | 9 | |
| | | |
| | | |
| <u>SECTION 11</u> | NA | |
| | | |
| 11.1-1 through 11.1-6 | 12 | |
| 11.2-1 through 11.2-2 | 12 | |
| 11.3-1 through 11.3-2 | 12 | |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 15

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|---|------|-----------|
| | | |
| <u>SECTION A1</u> | NA | |
| | | |
| A1.1-1 through A1.1-2 | 13 | |
| A1.2-1 through A1.2-2 | 13 | |
| A1.3-1 through A1.3-4 | 13 | |
| A1.4-1 through A1.4-2 | 13 | |
| A1.5-1 through A1.5-2 | 13 | |
| A1.6-1 through A1.6-2 | 13 | |
| Table A1.3-1 | 13 | |
| Figure A1.3-1 | 13 | |
| Figure TN-40HT-72-1 | 16 | 01514258 |
| Figure TN-40HT-72NP-1 | 17 | |
| Figure TN-40HT-72-2 | 16 | |
| Figure TN-40HT-72-3 | 16 | |
| Figure TN-40HT-72-4 | 16 | |
| Figure TN-40HT-72-5 | 16 | |
| Figure TN-40HT-72-6 | 16 | |
| Figure TN-40HT-72-7 | 16 | |
| Figure TN-40HT-72-8 | 16 | 01514587 |
| Figure TN-40HT-72NP-8 | 17 | |
| Figure TN-40HT-72-9 | 13 | |
| Figure TN-40HT-72-10 | 16 | |
| Figure TN-40HT-72NP-21 | 16 | 01514587 |
| Figure TN-40HT-72-21 (1 of 7 pages) | 17 | |
| Figure TN-40HT-72-21 | 16 | 01514587 |
| Figure TN-40HT-72-21 (NP) (2 of 7 pages) | 17 | |
| Figure TN-40HT-72-21 (3 of 7 pages) | 16 | |
| Figure TN-40HT-72-21 (4 of 7 pages) | 16 | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 16

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|--|----------|-----------|
| | | |
| <u>SECTION A1</u> (continued) | NA | |
| | | |
| Figure TN-40HT-72-21 (5 of 7 pages) | 16 | |
| Figure TN-40HT-72-21 (6 of 7 pages) | 16 | |
| Figure TN-40HT-72-21 (7 of 7 pages) | 16 | |
| Figure TN-40HT-72-22 Figure TN-40HT-72NP-22 (1 of 8 pages) | 17 16 | 01514587 |
| Figure TN-40HT-72-22 (2 of 8 pages) | 16 | |
| Figure TN-40HT-72-22 Figure TN-40HT-72NP-22 (3 of 8 pages) | 17 16 | 01514587 |
| Figure TN-40HT-72-22 Figure TN-40HT-72NP-22 (4 of 8 pages) | 17 16 | 01514587 |
| Figure TN-40HT-72-22 Figure TN-40HT-72NP-22 (5 of 8 pages) | 17 16 | 01514587 |
| Figure TN-40HT-72-22 Figure TN-40HT-72NP-22 (6 of 8 pages) | 17 16 | 01514587 |
| Figure TN-40HT-72-22 Figure TN-40HT-72NP-22 (7 of 8 pages) | 17 16 | 01514587 |
| Figure TN-40HT-72-22 Figure TN-40HT-72NP-22 (8 of 8 pages) | 17 16 | 01514587 |
| | | |
| | | |
| | | |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 17

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|---------------------------|------|-----------|
| | | |
| <u>SECTION A2</u> | NA | |
| | | |
| A2.1-1 through A2.1-2 | 13 | |
| A2.2-1 through A2.2-2 | 13 | |
| A2.3-1 through A2.3-2 | 13 | |
| A2.4-1 through A2.4-2 | 13 | |
| A2.5-1 through A2.5-2 | 13 | |
| A2.6-1 through A2.6-2 | 13 | |
| | | |
| | | |
| <u>SECTION A2A</u> | NA | |
| | | |
| A2A-1 through A2A-2 | 13 | |
| | | |
| <u>SECTION A2B</u> | NA | |
| | | |
| A2B-1 through A2B-2 | 13 | |
| | | |
| | | |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 18

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|--------------------------|------|-----------|
| | | |
| <u>SECTION A3</u> | NA | |
| | | |
| A3.1-1 through A3.1-3 | 16 | |
| A3.2-1 through A3.2-24 | 16 | |
| A3.3-1 through A3.3-62 | 17 | 01505901 |
| A3.4-1 | 17 | 01505901 |
| A3.5-1 through A3.5-3 | 13 | |
| A3.6-1 through A3.6-4 | 16 | |
| Table A3.1-1 | 13 | |
| Table A3.1-2 | 13 | |
| Table A3.1-3 | 13 | |
| Table A3.2-1 | 13 | |
| Table A3.2-2 | 15 | |
| Table A3.2-3 | 13 | |
| Table A3.2-4 | 13 | |
| Table A3.2-5 | 13 | |
| Table A3.2-6 | 13 | |
| Table A3.2-7 | 13 | |
| Table A3.2-8 | 13 | |
| Table A3.2-9 | 13 | |
| Table A3.2-10 | 13 | |
| Table A3.3-1 | 13 | |
| Table A3.3-2 | 13 | |
| Table A3.3-3 | 15 | |
| Table A3.3-4 | 15 | |
| Table A3.3-5 | 15 | |
| Table A3.3-6 | 15 | |
| Table A3.3-7 | 15 | |
| Table A3.3-8 | 13 | |
| Table A3.3-9 | 13 | |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 19

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|--------------------------------------|------|-----------|
| | | |
| <u>SECTION A3</u> (continued) | NA | |
| | | |
| Table A3.3-10 | 13 | |
| Table A3.3-11 | 13 | |
| Table A3.3-12 | 13 | |
| Table A3.3-13 | 15 | |
| Table A3.3-14 | 15 | |
| Table A3.3-15 | 15 | |
| Table A3.3-16 | 15 | |
| Table A3.3-17 | 13 | |
| Table A3.3-18 | 13 | |
| Table A3.3-19 | 13 | |
| Table A3.3-20 | 13 | |
| Table A3.3-21 | 13 | |
| Table A3.3-22 | 13 | |
| Table A3.3-23 | 13 | |
| Table A3.3-24 | 13 | |
| Table A3.3-25 | 13 | |
| Table A3.3-26 | 13 | |
| Table A3.3-27 | 13 | |
| Table A3.3-28 | 13 | |
| Table A3.3-29 | 13 | |
| Table A3.3-30 | 13 | |
| Table A3.3-31 | 13 | |
| Table A3.3-32 | 13 | |
| Table A3.3-33 | 15 | |
| Table A3.3-34 | 16 | |
| Table A3.3-35 | 16 | |
| Table A3.3-36 | 16 | |
| Table A3.3-37 | 16 | |
| Table A3.3-38 | 16 | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 20

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|--------------------------------------|------|-----------|
| | | |
| <u>SECTION A3</u> (continued) | NA | |
| | | |
| Table A3.3-39 | 16 | |
| Table A3.4-1 | 17 | 01505901 |
| Table A3.4-2 | 16 | |
| Figure A3.2-1 | 13 | |
| Figure A3.2-2 | 13 | |
| Figure A3.2-3 | 13 | |
| Figure A3.3-1 | 13 | |
| Figure A3.3-2 | 13 | |
| Figure A3.3-3 | 13 | |
| Figure A3.3-4 | 13 | |
| Figure A3.3-5 | 15 | |
| Figure A3.3-6 | 13 | |
| Figure A3.3-7 | 13 | |
| Figure A3.3-8 | 13 | |
| Figure A3.3-9 | 13 | |
| Figure A3.3-10 | 13 | |
| Figure A3.3-11 | 15 | |
| Figure A3.3-12 | 15 | |
| Figure A3.3-13 | 13 | |
| Figure A3.3-14 | 15 | |
| Figure A3.3-15 | 15 | |
| Figure A3.3-16 | 13 | |
| Figure A3.3-17 | 13 | |
| Figure A3.3-18 | 13 | |
| Figure A3.3-19 | 13 | |
| Figure A3.3-20 | 13 | |
| Figure A3.3-21 | 13 | |
| Figure A3.3-22 | 13 | |
| Figure A3.3-23 | 13 | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 21

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|--------------------------------------|------|-----------|
| | | |
| <u>SECTION A3</u> (continued) | NA | |
| | | |
| Figure A3.3-24 | 13 | |
| Figure A3.3-25 | 13 | |
| Figure A3.3-26 | 15 | |
| Figure A3.3-27 | 15 | |
| Figure A3.3-28 | 13 | |
| Figure A3.3-29 | 13 | |
| Figure A3.3-30 | 13 | |
| Figure A3.3-31 | 13 | |
| Figure A3.3-32 | 13 | |
| Figure A3.3-33 | 13 | |
| Figure A3.3-34 | 13 | |
| Figure A3.3-35 | 13 | |
| Figure A3.3-36 | 13 | |
| Figure A3.3-37 | 13 | |
| Figure A3.3-38 | 13 | |
| Figure A3.3-39 | 13 | |
| Figure A3.3-40 | 13 | |
| Figure A3.3-41 | 13 | |
| Figure A3.3-42 | 16 | |
| Figure A3.3-43 | 16 | |
| Figure A3.3-44 | 16 | |
| | | |
| <u>SECTION A3A</u> | NA | |
| | | |
| A3A-1 through A3A-2 | 13 | |
| A3A.1-1 through A3A.1-10 | 13 | |
| A3A.2-1 through A3A.2-10 | 13 | |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 22

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|--------------------------|------|-----------|
| | | |
| <u>SECTION A4</u> | NA | |
| | | |
| A4.1-1 | 13 | |
| A4.2-1 through A4.2-30 | 17 | 01505901 |
| A4.3-1 through A4.3-2 | 13 | |
| A4.4-1 through A4.4-2 | 13 | |
| A4.5-1 through A4.5-2 | 13 | |
| A4.6-1 through A4.6-4 | 17 | 01505901 |
| A4.7-1 through A4.7-2 | 13 | |
| Table A4.2-1 | 13 | |
| Table A4.2-2 | 13 | |
| Table A4.2-3 | 13 | |
| Table A4.2-4 | 13 | |
| Table A4.2-5 | 13 | |
| Table A4.2-6 | 13 | |
| Table A4.2-7 | 13 | |
| Table A4.2-8 | 13 | |
| Table A4.2-9 | 13 | |
| Table A4.2-10 | 13 | |
| Table A4.2-11 | 13 | |
| Table A4.2-12 | 13 | |
| Table A4.2-13 | 13 | |
| Table A4.2-14 | 13 | |
| Table A4.2-15 | 13 | |
| Table A4.2-16 | 13 | |
| Table A4.2-17 | 13 | |
| Table A4.2-18 | 13 | |
| Table A4.2-19 | 13 | |
| Table A4.2-20 | 15 | |
| Table A4.2-21 | 15 | |
| Table A4.2-22 | 15 | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 23

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|---------------------------------------|------|-----------|
| | | |
| <u>SECTION A4A</u> (continued) | NA | |
| | | |
| Table A4.2-23 | 15 | |
| Table A4.2-24 | 15 | |
| Table A4.2-25 | 13 | |
| Table A4.2-26 | 13 | |
| Table A4.5-1 | 13 | |
| Table A4.6-1 | 17 | 01505901 |
| Table A4.6-2 | 17 | 01505901 |
| Figure A4.2-1 | 13 | |
| Figure A4.2-2 | 13 | |
| Figure A4.2-3 | 13 | |
| Figure A4.2-4 | 13 | |
| Figure A4.2-5 | 13 | |
| Figure A4.2-6 | 13 | |
| Figure A4.2-7 | 13 | |
| Figure A4.2-8 | 13 | |
| Figure A4.2-9 | 13 | |
| Figure A4.2-10 | 13 | |
| Figure A4.2-11 | 13 | |
| Figure A4.2-12 | 13 | |
| Figure A4.2-13 | 13 | |
| Figure A4.2-14 | 13 | |
| Figure A4.2-15 | 13 | |
| Figure A4.2-16 | 13 | |
| | | |
| <u>SECTION A4A</u> | NA | |
| | | |
| A4A.1-1 through A4A.1-2 | 13 | |
| A4A.2-1 through A4A.2-2 | 13 | |
| A4A.3-1 through A4A.3-10 | 13 | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 24

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|---------------------------------------|------|-----------|
| | | |
| <u>SECTION A4A</u> (continued) | NA | |
| | | |
| A4A.4-1 through A4A.4-10 | 13 | |
| A4A.5-1 through A4A.5-8 | 15 | |
| A4A.6-1 through A4A.6-6 | 13 | |
| A4A.7-1 through A4A.7-4 | 13 | |
| A4A.8-1 through A4A.8-4 | 13 | |
| A4A.9-1 through A4A.9-4 | 13 | |
| A4A.10-1 through A4A.10-6 | 13 | |
| A4A.11-1 through A4A.11-2 | 13 | |
| Table A4A.2-1 | 13 | |
| Table A4A.3-1 | 13 | |
| Table A4A.3-2 | 13 | |
| Table A4A.4-1 | 15 | |
| Table A4A.4-2 | 13 | |
| Table A4A.4-3 | 13 | |
| Table A4A.4-4 | 13 | |
| Table A4A.4-5 | 13 | |
| Table A4A.4-6 | 13 | |
| Table A4A.4-7 | 13 | |
| Table A4A.5-1 | 13 | |
| Table A4A.5-2 | 13 | |
| Table A4A.5-3 | 15 | |
| Table A4A.5-4 | 15 | |
| Table A4A.5-5 | 15 | |
| Table A4A.6-1 | 13 | |
| Table A4A.6-2 | 13 | |
| Table A4A.6-3 | 13 | |
| Table A4A.6-4 | 13 | |
| Table A4A.7-1 | 13 | |
| Table A4A.7-2 | 13 | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 25

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|---------------------------------------|------|-----------|
| | | |
| <u>SECTION A4A</u> (continued) | NA | |
| | | |
| Table A4A.8-1 | 13 | |
| Table A4A.8-2 | 13 | |
| Table A4A.8-3 | 13 | |
| Table A4A.9-1 | 13 | |
| Table A4A.9-2 | 13 | |
| Table A4A.9-3 | 13 | |
| Table A4A.9-4 | 13 | |
| Figure A4A.3-1 | 13 | |
| Figure A4A.3-2 | 13 | |
| Figure A4A.3-3 | 13 | |
| Figure A4A.3-4 | 13 | |
| Figure A4A.3-5 | 13 | |
| Figure A4A.3-6 | 13 | |
| Figure A4A.3-7 | 13 | |
| Figure A4A.3-8 | 13 | |
| Figure A4A.3-9 | 13 | |
| Figure A4A.3-10 | 13 | |
| Figure A4A.3-11 | 13 | |
| Figure A4A.3-12 | 13 | |
| Figure A4A.3-13 | 13 | |
| Figure A4A.3-14 | 13 | |
| Figure A4A.3-15 | 13 | |
| Figure A4A.6-1 | 13 | |
| Figure A4A.6-2 | 13 | |
| Figure A4A.7-1 | 13 | |
| Figure A4A.7-2 | 13 | |
| Figure A4A.9-1 | 13 | |
| Figure A4A.9-2 | 13 | |
| Figure A4A.10-1 | 13 | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 26

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|---------------------------------------|------|-----------|
| | | |
| <u>SECTION A4A</u> (continued) | NA | |
| | | |
| Figure A4A.10-2 | 13 | |
| Figure A4A.10-3 | 13 | |
| Figure A4A.10-4 | 13 | |
| Figure A4A.10-5 | 13 | |
| Figure A4A.10-6 | 13 | |
| | | |
| <u>SECTION A4B</u> | NA | |
| | | |
| A4B.1-1 through A4B.1-12 | 13 | |
| A4B.2-1 through A4B.2-2 | 13 | |
| Table A4B.1-1 | 13 | |
| Table A4B.1-2 | 13 | |
| Table A4B.1-3 | 13 | |
| Table A4B.1-4 | 13 | |
| Table A4B.1-5 | 13 | |
| Table A4B.1-6 | 13 | |
| Figure A4B.1-1 | 13 | |
| Figure A4B.1-2 | 13 | |
| Figure A4B.1-3 | 13 | |
| Figure A4B.1-4 | 13 | |
| Figure A4B.1-5 | 13 | |
| Figure A4B.1-6 | 13 | |
| Figure A4B.1-7 | 13 | |
| Figure A4B.1-8 | 13 | |
| Figure A4B.1-9 | 13 | |
| Figure A4B.1-10 | 13 | |
| Figure A4B.1-11 | 13 | |
| Figure A4B.1-12 | 13 | |
| Figure A4B.1-13 | 13 | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 27

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|---------------------------------------|------|-----------|
| | | |
| <u>SECTION A4B</u> (continued) | NA | |
| | | |
| Figure A4B.1-14 | 13 | |
| Figure A4B.1-15 | 13 | |
| Figure A4B.1-16 | 13 | |
| Figure A4B.1-17 | 13 | |
| Figure A4B.1-18 | 13 | |
| Figure A4B.1-19 | 13 | |
| Figure A4B.1-20 | 13 | |
| Figure A4B.1-21 | 13 | |
| Figure A4B.1-22 | 13 | |
| | | |
| <u>SECTION A5</u> | NA | |
| | | |
| A5.1-1 through A5.1-2 | 13 | |
| A5.2-1 through A5.2-2 | 13 | |
| A5.3-1 through A5.3-2 | 13 | |
| A5.4-1 through A5.4-2 | 13 | |
| A5.5-1 through A5.5-2 | 13 | |
| A5.6-1 through A5.6-2 | 13 | |
| | | |
| <u>SECTION A6</u> | NA | |
| | | |
| A6.1-1 through A6.1-2 | 13 | |
| | | |
| <u>SECTION A7</u> | NA | |
| | | |
| A7.1-1 | 13 | |
| A7.2-1 through A7.2-9 | 13 | |
| A7.3-1 through A7.3-2 | 13 | |
| A7.4-1 through A7.4-2 | 13 | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 28

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|--------------------------------------|------|-----------|
| | | |
| <u>SECTION A7</u> (continued) | NA | |
| | | |
| A7.5-1 | 17 | 01441968 |
| A7.6-1 | 13 | |
| A7.7-1 | 13 | |
| A7.8-1 | 17 | 01441968 |
| Table A7.2-1 | 13 | |
| Table A7.2-2 | 13 | |
| Table A7.2-3 | 13 | |
| Table A7.2-4 | 13 | |
| Table A7.2-5 | 13 | |
| Table A7.2-6 | 13 | |
| Table A7.2-7 | 13 | |
| Table A7.2-8 | 13 | |
| Table A7.2-9 | 13 | |
| Table A7.2-10 | 13 | |
| Table A7.2-11 | 13 | |
| Table A7.2-12 | 13 | |
| Table A7.4-1 | 13 | |
| Table A7.4-2 | 13 | |
| Table A7.4-3 | 13 | |
| Table A7.4-4 | 13 | |
| Table A7.5-1 | 17 | 01441968 |
| Table A7.5-2 | 17 | 01441968 |
| Figure A7.2-1 | 13 | |
| Figure A7.2-2 | 13 | |
| Figure A7.4-A | 13 | |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 29

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|---------------------------|------|-----------|
| | | |
| <u>SECTION A7A</u> | NA | |
| | | |
| A7A.1-1 | 13 | |
| A7A.2-1 | 13 | |
| A7A.3-1 | 13 | |
| A7A.4-1 through A7A.4-4 | 13 | |
| A7A.5-1 | 13 | |
| A7A.6-1 | 13 | |
| A7A.7-1 through A7A.7-3 | 13 | |
| A7A.8-1 through A7A.8-13 | 17 | 01505901 |
| A7A.9-1 through A7A.9-2 | 13 | |
| Table A7A.1-1 | 13 | |
| Table A7A.2-1 | 13 | |
| Table A7A.2-2 | 13 | |
| Table A7A.4-1 | 13 | |
| Table A7A.4-2 | 13 | |
| Table A7A.4-3 | 13 | |
| Table A7A.5-1 | 13 | |
| Table A7A.5-2 | 13 | |
| Table A7A.5-3 | 13 | |
| Table A7A.5-4 | 13 | |
| Table A7A.6-1 | 13 | |
| Table A7A.7-1 | 13 | |
| Table A7A.7-2 | 13 | |
| Table A7A.7-3 | 13 | |
| Table A7A.7-4 | 13 | |
| Table A7A.8-1 | 13 | |
| Table A7A.8-2 | 13 | |
| Table A7A.8-3 | 13 | |
| Table A7A.8-4 | 13 | |
| Table A7A.8-5 | 13 | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 30

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|---------------------------------------|------|-----------|
| | | |
| <u>SECTION A7A</u> (continued) | NA | |
| | | |
| Table A7A.8-6 | 13 | |
| Figure A7A.1-1 | 13 | |
| Figure A7A.2-1 | 13 | |
| Figure A7A.4-1 | 13 | |
| Figure A7A.4-2 | 13 | |
| Figure A7A.4-3 | 13 | |
| Figure A7A.4-4 | 13 | |
| Figure A7A.5-1 | 13 | |
| Figure A7A.5-2 | 13 | |
| Figure A7A.5-3 | 13 | |
| Figure A7A.5-4 | 13 | |
| Figure A7A.5-5 | 13 | |
| Figure A7A.5-6 | 13 | |
| Figure A7A.5-7 | 13 | |
| Figure A7A.5-8 | 13 | |
| Figure A7A.5-9 | 13 | |
| Figure A7A.6-1 | 13 | |
| Figure A7A.7-1 | 13 | |
| Figure A7A.8-1 | 13 | |
| Figure A7A.8-2 | 13 | |
| | | |
| <u>SECTION A7B</u> | NA | |
| | | |
| A7B-1 through A7B-2 | 13 | |
| A7B.1-1 through A7B.1-4 | 13 | |
| A7B.2-1 through A7B.2-18 | 13 | |
| A7B.3-1 through A7B.3-18 | 13 | |
| A7B.4-1 through A7B.4-24 | 13 | |
| | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 31

ADDENDUM
LIST OF EFFECTIVE PAGES

| Page | Rev. | AR Number |
|---------------------------|------|-----------|
| | | |
| <u>SECTION A8</u> | NA | |
| | | |
| A8.1-1 through A8.1-2 | 13 | |
| A8.2-1 through A8.2-10 | 13 | |
| A8.3-1 through A8.3-2 | 13 | |
| A8.4-1 through A8.4-2 | 13 | |
| | | |
| <u>SECTION A9</u> | NA | |
| | | |
| A9.1-1 | 13 | |
| A9.2-1 | 13 | |
| A9.3-1 | 13 | |
| A9.4-1 | 13 | |
| A9.5-1 | 13 | |
| A9.6-1 | 13 | |
| A9.7-1 through A9.7-12 | 16 | |
| A9.8-1 through A9.8-4 | 17 | 01505901 |
| A9.9-1 through A9.9-2 | 17 | 01505901 |
| Table A9.7-1 | 13 | |
| Table A9.7-2 | 16 | |
| | | |
| <u>SECTION A10</u> | NA | |
| | | |
| A10-1 through A10-2 | 13 | |
| | | |
| <u>SECTION A11</u> | NA | |
| | | |
| A11.1-1 through A11.1-4 | 13 | |
| A11.2-1 through A11.2-2 | 13 | |
| A11.3-1 through A11.3-2 | 13 | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 17
LEFF Page 32

LIST OF EFFECTIVE PAGES

RECORD OF REVISIONS

| Revision (Rev) No. | Effective Date | Date of Issue | Remarks |
|-------------------------------|---------------------------|--------------------------|----------------|
| ORIGINAL | 8/90 | 8/31/90 | |
| 1 | 4/91 | 4/2/91 | |
| 2 | 9/91 | 9/26/91 | |
| 3 | 4/94 | 4/18/94 | |
| 4 | 10/95 | 10/19/95 | |
| 5 | 10/96 | 10/21/96 | |
| 6 | 10/97 | 10/20/97 | |
| 7 | 10/98 | 10/19/98 | |
| 8 | 10/99 | 10/19/99 | |
| 9 | 10/01 | 10/01 | |
| 10 | 10/05 | 10/05 | |
| 11 | 10/07 | 10/07 | |
| 12 | 10/09 | 10/09 | |
| 13 | 8/10 | 10/10 | |
| 14 | 9/11 | 9/11 | |
| 15 | 2/14 | 2/14 | |
| 16 | 11/15 | 11/15 | |
| 17 | 3/8/16 | 3/8/16 | |

TABLE OF CONTENTS

SECTION 1 – INTRODUCTION AND GENERAL DESCRIPTION OF STORAGE SYSTEM

- 1.1 INTRODUCTION
- 1.2 GENERAL DESCRIPTION OF LOCATION
- 1.3 GENERAL STORAGE SYSTEM DESCRIPTION
- 1.4 IDENTIFICATION OF AGENTS AND CONTRACTORS
- 1.5 REFERENCES

SECTION 1 TABLES

- TABLE 1.3-1 DIMENSIONS AND WEIGHT OF TN-40 CASK
- TABLE 1.3-2 LISTS OF TN-40 CASK COMPONENTS

SECTION 1 FIGURES

- FIGURE 1.2-1 ISFSI SITE LOCATION
- FIGURE 1.3-1 ISFSI SITE PLAN
- FIGURE 1.3-2 TN-40 CASK LONGITUDINAL SECTION
- FIGURE 1.3.3 TN-40 CASK CROSS SECTION
- FIGURE 1.3-4 TN-40 CASK LID ASSEMBLY AND DETAILS
- FIGURE 1.3-5 TN-40 CASK PROTECTIVE COVER
- FIGURE 1.3-6 TN-40 BASKET GENERAL ARRANGEMENT
- FIGURE 1.3-7 TN-40 BASKET CROSS SECTION
- FIGURE 1.3-8 EQUIPMENT STORAGE BUILDING

TABLE OF CONTENTS

SECTION 2 – SITE CHARACTERISTICS

- 2.1 GEOGRAPHY AND DEMOGRAPHY OF SITE SELECTED
 - 2.1.1 SITE LOCATION
 - 2.1.2 SITE DESCRIPTION
 - 2.1.3 POPULATION DISTRIBUTION AND TRENDS
 - 2.1.4 USES OF NEARBY LAND AND WATERS
- 2.2 NEARBY INDUSTRIAL, TRANSPORTATION AND MILITARY FACILITIES
- 2.3 METEOROLOGY
 - 2.3.1 REGIONAL CLIMATOLOGY
 - 2.3.2 LOCAL METEOROLOGY
 - 2.3.3 ONSITE METEOROLOGICAL MEASUREMENT PROGRAM
 - 2.3.4 DIFFUSION ESTIMATES
- 2.4 HYDROLOGY
 - 2.4.1 SURFACE WATER
 - 2.4.2 GROUND WATER
- 2.5 GEOLOGY AND SEISMOLOGY
 - 2.5.1 BASIC GEOLOGIC AND SEISMIC INFORMATION
 - 2.5.2 VIBRATING GROUND MOTION
 - 2.5.3 SURFACE FAULTING
 - 2.5.4 STABILITY OF SUBSURFACE MATERIALS
 - 2.5.5 SLOPE STABILITY
- 2.6 REFERENCES

TABLE OF CONTENTS**SECTION 2 – SITE CHARACTERISTICS (CONT'D)****SECTION 2 TABLES**

| | |
|-------------|---|
| TABLE 2.1-1 | ESTIMATED 2010 POPULATION DIST. WITHIN THE PRAIRIE ISLAND EMERGENCY PLANNING ZONE |
| TABLE 2.3-1 | SITE BOUNDARY DISPERSION FACTOR (X/Q) – FROM CENTER OF ISFSI SITE |
| TABLE 2.3-2 | DOWNWARD DISPERSION FACTOR (X/Q) |

SECTION 2 FIGURES

| | |
|--------------|--|
| FIGURE 2.1-1 | REGIONAL MAP |
| FIGURE 2.1-2 | AREA TOPOGRAPHY |
| FIGURE 2.1-3 | SITE TOPOGRAPHY |
| FIGURE 2.3-1 | CLIMATIC DATA |
| FIGURE 2.3-2 | REGIONAL TOPOGRAPHY |
| FIGURE 2.4-1 | LOCATION OF STREAM GAGING STATIONS |
| FIGURE 2.4-2 | FLOW DURATION CURVES FOR MISSISSIPPI RIVER |
| FIGURE 2.4-3 | STREAM PROFILE |
| FIGURE 2.4-4 | LOCATION OF WELLS |
| FIGURE 2.5-1 | BORING LOG |
| FIGURE 2.5-2 | REGIONAL GEOLOGIC MAP |
| FIGURE 2.5-3 | REGIONAL GEOLOGIC STRUCTURE |
| FIGURE 2.5-4 | REGIONAL GEOLOGIC CROSS SECTION |
| FIGURE 2.5-5 | SITE BORING LOCATIONS |
| FIGURE 2.5-6 | SITE GRADING PLAN |
| FIGURE 2.5-7 | SITE GRADING – SECTIONS AND DETAILS |
| FIGURE 2.5-8 | ISFSI DESIGN EARTHQUAKE RESPONSE SPECTRA |
| FIGURE 2.5-9 | LIQUEFACTION ANALYSIS |

TABLE OF CONTENTS

SECTION 2A – BORING LOGS

SECTION 2B – GRAIN SIZE DISTRIBUTION TEST REPORTS

SECTION 3 – PRINCIPAL CASK DESIGN CRITERIA

- 3.1 PURPOSE OF CASK
 - 3.1.1 SPENT FUEL TO BE STORED
 - 3.1.2 GENERAL OPERATING FUNCTIONS
- 3.2 DESIGN CRITERIA FOR ENVIRONMENTAL CONDITIONS AND NATURAL PHENOMENA
 - 3.2.1 TORNADO AND WIND LOADINGS
 - 3.2.2 WATER LEVEL (FLOOD) DESIGN
 - 3.2.3 SEISMIC DESIGN
 - 3.2.4 SNOW AND ICE LOADINGS
 - 3.2.5 COMBINED LOAD CRITERIA
- 3.3 SAFETY PROTECTION SYSTEMS
 - 3.3.1 GENERAL
 - 3.3.2 PROTECTION BY MULTIPLE CONFINEMENT BARRIERS AND SYSTEMS
 - 3.3.3 PROTECTION BY EQUIPMENT AND INSTRUMENTATION SELECTION
 - 3.3.4 NUCLEAR CRITICALITY SAFETY
 - 3.3.5 RADIOLOGICAL PROTECTION
 - 3.3.6 FIRE AND EXPLOSION PROTECTION
 - 3.3.7 MATERIAL HANDLING AND STORAGE
- 3.4 SUMMARY OF STORAGE CASK DESIGN CRITERIA
 - 3.4-1 CASK DESIGN CRITERIA
 - 3.4-2 DESIGN BASIS LIMITS FOR FISSION PRODUCT BARRIERS (DBLFPBs)
- 3.5 REFERENCES

TABLE OF CONTENTS**SECTION 3 – PRINCIPAL CASK DESIGN CRITERIA (CONT'D)****SECTION 3 TABLES**

| | |
|-------------|---|
| TABLE 3.1-1 | FUEL ASSEMBLY PARAMETERS |
| TABLE 3.1-2 | THERMAL, GAMMA AND NEUTRON SOURCES FOR THE DESIGN BASIS 14 X 14 WESTINGHOUSE OF A FUEL ASSEMBLY |
| TABLE 3.2-1 | SUMMARY OF TN-40 WEIGHTS |
| TABLE 3.2-2 | SUMMARY OF LIFTING LOADS USED IN UPPER TRUNNION ANSI N14.6 ANALYSIS OF TN-40 CASK |
| TABLE 3.2-3 | SUMMARY OF INTERNAL AND EXTERNAL PRESSURES ACTING ON TN-40 CASK |
| TABLE 3.2-4 | SUMMARY OF LOADS ACTING ON TN-40 CASK DUE TO ENVIRONMENTAL AND NATURAL PHENOMENA |
| TABLE 3.2-5 | TN-40 CASK LOADING CONDITIONS |
| TABLE 3.2-6 | TN-40 CASK DESIGN LOADS |
| TABLE 3.2-7 | LEVEL A SERVICE LOADS (TN-40 CASK) |
| TABLE 3.2-8 | LEVEL D SERVICE LOADS (TN-40 CASK) |
| TABLE 3.2-9 | LOAD COMBINATIONS FOR TN-40 CASK BODY |
| TABLE 3.3-1 | SUMMARY OF THERMAL ANALYSES (TN-30 CASK) |
| TABLE 3.3-2 | PROPERTIES OF MATERIALS USED IN THERMAL ANALYSES (TN-40 CASK) |
| TABLE 3.3-3 | MATERIAL COMPOSITION FOR KENO MODEL (TN-40 CASK) |
| TABLE 3.3-4 | TN-40 REACTIVITY DURING DRAINING |
| TABLE 3.3-5 | TN-40 REACTIVITY VERSUS WATER DENSITY |
| TABLE 3.3-6 | PNL BENCHMARK EXPERIMENTS |
| TABLE 3.3-7 | KENO-V.A BENCHMARK RESULTS |
| TABLE 3.3-8 | MAXIMUM TRANSIENTS TEMPERATURES – FIRE ACCIDENT |
| TABLE 3.4-1 | DESIGN CRITERIA FOR TN-40 CASKS |
| TABLE 3.4-2 | DESIGN BASIS LIMITS FOR FISSION PRODUCT BARRIERS FOR 72.48 REVIEWS |

TABLE OF CONTENTS**SECTION 3 – PRINCIPAL CASK DESIGN CRITERIA (CONT'D)****SECTION 3 FIGURES**

| | |
|---------------|--|
| FIGURE 3.1-1 | DECAY HEAT DESIGN BASIS FUEL ASSEMBLY |
| FIGURE 3.1-2 | GAMMA SOURCE DESIGN BASIS FUEL ASSEMBLY |
| FIGURE 3.1-3 | NEUTRON SOURCE DESIGN BASIS FUEL ASSEMBLY |
| FIGURE 3.1-4 | NSP – PRAIRIE ISLAND WESTINGHOUSE OFA FUEL ASSEMBLY DIMENSIONAL DATA |
| FIGURE 3.2-1 | EARTHQUAKE, WIND, AND WATER LOADS (TN-40 CASK) |
| FIGURE 3.2-2 | TORNADO MISSILE IMPACT LOADS (TN-40 CASK) |
| FIGURE 3.2-3 | LIFTING LOADS (TN-40 CASK) |
| FIGURE 3.2-4 | DESIGN LOADS ON TN-40 CASK DUE TO LIFTING |
| FIGURE 3.3-1 | TN-40 CASK SEAL AND PRESSURE MONITORING SYSTEM |
| FIGURE 3.3-2 | TN-40 CASK PRESSURE MONITORING SYSTEM TEST LEAKAGE RATE |
| FIGURE 3.3-3 | TN-40 CASK PRESSURE MONITORING SYSTEM – SYSTEM PRESSURE |
| FIGURE 3.3-4 | TN-40 CASK THERMAL MODEL RADIAL CROSS SECTION |
| FIGURE 3.3-5 | TN-40 CASK THERMAL MODEL AXIAL CROSS SECTION |
| FIGURE 3.3-6 | TN-40 CASK FINITE ELEMENT THERMAL MODEL |
| FIGURE 3.3-7 | AXIAL POWER DISTRIBUTION (TN-40 CASK) |
| FIGURE 3.3-8 | TN-40 CASK STORAGE CONFIGURATION |
| FIGURE 3.3-9 | TN-40 CASK TEMPERATURE DISTRIBUTION – OFF NORMAL CONDITIONS |
| FIGURE 3.3-10 | TN-40 CASK TEMPERATURE DISTRIBUTION – HOTTEST CROSS SECTION |
| FIGURE 3.3-11 | TN-40 BASKET SECTION TEMPERATURE DISTRIBUTION – HOTTEST REGION |

TABLE OF CONTENTS

SECTION 3 – PRINCIPAL CASK DESIGN CRITERIA (CONT'D)

SECTION 3 FIGURES (CONT'D)

| | |
|---------------|--|
| FIGURE 3.3-12 | TN-40 BASKET TEMPERATURE DISTRIBUTION - TOP 5 INCHES |
| FIGURE 3.3-13 | TN-40 CASK BODY TEMPERATURE DISTRIBUTION |
| FIGURE 3.3-14 | TN-40 CASK TEMPERATURE DISTRIBUTION – NORMAL CONDITIONS |
| FIGURE 3.3-15 | BURIED CASK TEMPERATURE RESPONSE (TN-40 CASK) |
| FIGURE 3.3-16 | KENO V.A. FUEL ASSEMBLY MODEL |
| FIGURE 3.3-17 | KENO V.A. CASK MODEL (TN-40 CASK) |
| FIGURE 3.3-18 | BENCHMARK FUEL RODS |
| FIGURE 3.3-19 | BENCHMARK EXPERIMENT |
| FIGURE 3.3-20 | TN-40 LID SEAL THERMAL MODEL |
| FIGURE 3.3-21 | TN-40 LID SEAL REGION FINITE ELEMENT THERMAL MODEL |

APPENDIX 3A – TN-40 CRITICALLY EVALUATION COMPUTER INPUT

TABLE OF CONTENTS

SECTION 4 – STORAGE SYSTEM

- 4.1 LOCATION AND LAYOUT
- 4.2 STORAGE SITE
 - 4.2.1 STRUCTURES
 - 4.2.2 STORAGE SITE LAYOUT
 - 4.2.3 STORAGE CASK DESCRIPTION
 - 4.2.4 INSTRUMENTATION SYSTEM DESCRIPTION
- 4.3 TRANSPORT SYSTEM
 - 4.3.1 FUNCTION
 - 4.3.2 COMPONENTS
 - 4.3.3 DESIGN BASIS AND SAFETY ASSURANCE
 - 4.3.4 DETERMINATION OF NATURAL FORCES ON A LOADED TRANSPORT VEHICLE
- 4.4 OPERATING SYSTEMS
 - 4.4.1 LOADING AND UNLOADING SYSTEMS
 - 4.4.2 DECONTAMINATION SYSTEMS
 - 4.4.3 STORAGE CASK REPAIR AND MAINTENANCE
 - 4.4.4 UTILITY SUPPLIES AND SYSTEMS
 - 4.4.5 OTHER SYSTEMS
- 4.5 CLASSIFICATION OF STRUCTURES, SYSTEMS, AND COMPONENTS
 - 4.5.1 CONTAINMENT VESSEL
 - 4.5.2 PENETRATION GASKETS
 - 4.5.3 SHIELDING
 - 4.5.4 PROTECTIVE COVER AND OVERPRESSURE SYSTEM
 - 4.5.5 CONCRETE STORAGE PADS
- 4.6 DECOMMISSIONING PLAN
- 4.7 REFERENCES

TABLE OF CONTENTS**SECTION 4 – STORAGE SYSTEM (CONT'D)****SECTION 4 TABLES**

| | |
|--------------|--|
| TABLE 4.2-1 | COMPLIANCE WITH GENERAL DESIGN CRITERIA |
| TABLE 4.2-2 | DYNAMIC SPRING CONSTANTS |
| TABLE 4.2-3 | INDIVIDUAL LOAD CASES ANALYZED |
| TABLE 4.2-4 | CONTAINMENT VESSEL STRESS LIMITS |
| TABLE 4.2-5 | CONTAINMENT BOLT STRESS LIMITS |
| TABLE 4.2-6 | NON-CONTAINMENT STRUCTURE STRESS LIMITS |
| TABLE 4.2-6a | BASKET STRESS LIMITS |
| TABLE 4.2-7 | LOAD COMBINATIONS FOR CASK BODY |
| TABLE 4.2-8 | COMPARISON OF ACTUAL WITH ALLOWABLE STRESS INTENSITY CONTAINMENT VESSEL |
| TABLE 4.2-9 | SUMMARY OF MAXIMUM STRESS INTENSITIES AND ALLOWABLE STRESS LIMITS FOR THE CONTAINMENT VESSEL |
| TABLE 4.2-10 | COMPARISON OF ACTUAL WITH ALLOWABLE STRESS INTENSITY GAMMA SHIELDING |
| TABLE 4.2-11 | SUMMARY OF MAXIMUM STRESS INTENSITY AND ALLOWABLE STRESS LIMITS FOR LID BOLTS |
| TABLE 4.2-12 | COMPARISON OF ACTUAL WITH ALLOWABLE STRESS INTENSITY IN BASKET |
| TABLE 4.2-13 | COMPARISON OF MAXIMUM LIFTING TRUNNION STRESS INTENSITIES WITH ALLOWABLES |
| TABLE 4.2-14 | COMPARISON OF MAXIMUM TURNING TRUNNION STRESS INTENSITIES WITH ALLOWABLES |
| TABLE 4.2-15 | COMPARISON OF MAXIMUM STRESS INTENSITY WITH ALLOWABLES IN OUTER SHELL |
| TABLE 4.5-1 | CLASSIFICATION OF STRUCTURES, COMPONENT AND SYSTEMS |

TABLE OF CONTENTS**SECTION 4 – STORAGE SYSTEM (CONT'D)****SECTION 4 TABLES (CONT'D)**

| | |
|-------------|---|
| TABLE 4.6-1 | DATA FOR TN-40 ACTIVATION ANALYSIS |
| TABLE 4.6-2 | RESULTS OF ORIGEN2 20 YEAR ACTIVATION CALCULATION |
| TABLE 4.6-3 | COMPARISON OF TN-40 ACTIVITY WITH CLASS A WASTE LIMITS LONG LIVED ISOTOPES, 10CFR61.55, TABLE 1 |

SECTION 4 FIGURES

| | |
|---------------|---|
| FIGURE 4.2-1 | CONCRETE PAD |
| FIGURE 4.2-1a | IMAGES – 3D COMPUTER MODEL |
| FIGURE 4.2-6 | STANDARD REPORTING LOCATIONS FOR CASK BODY (TN-40 CASK) |
| FIGURE 4.3-1 | TRANSPORT VEHICLE – SIDE VIEW |
| FIGURE 4.3-2 | TRANSPORT VEHICLE – PLAN VIEW |
| FIGURE 4.3-3 | CYCLIC LOADING TIRE VERTICAL REACTIONS (RIDGE UNDER T1 AND T8) |
| FIGURE 4.3-4 | CYCLIC LOADING TIRE VERTICAL REACTIONS (RIDGE UNDER T2 AND T7) |
| FIGURE 4.3-5 | WORST CASE LOAD TIRE VERTICAL REACTIONS (4" BUMP UNDER T1 AND T8) |
| FIGURE 4.3-6 | WORST CASE LOAD TIRE VERTICAL REACTIONS (4" BUMP UNDER T2 AND T7) |
| FIGURE 4.3-7 | WIND, WATER, TORNADO MISSILE IMPACT, AND EARTHQUAKE LOADS |
| FIGURE 4.4-1 | LOAD PATH FOR SPENT FUEL CASK – PLAN VIEW |
| FIGURE 4.4-2 | LOAD PATH FOR SPENT FUEL CASK – ELEVATION A (LOOKING EAST) |
| FIGURE 4.4-3 | LOAD PATH FOR SPENT FUEL CASK – ELEVATION B (LOOKING SOUTH) |

TABLE OF CONTENTS

APPENDIX 4A – STRUCTURAL ANALYSIS OF THE TN-40 CASK BODY

- 4A.1 INTRODUCTION
- 4A.2 MATERIAL PROPERTIES DATA
- 4A.3 CASK BODY STRUCTURAL ANALYSIS
 - 4A.3.1 DESCRIPTION
 - 4A.3.2 ANSYS CASK MODEL
 - 4A.3.3 INDIVIDUAL LOAD CASES
 - 4A.3.4 ADDITIONAL CASK BODY ANALYSES
 - 4A.3.5 EVALUATION (LOAD COMBINATION VS. ALLOWABLES)
- 4A.4 LID BOLT ANALYSIS
 - 4A.4.1 BOLT PRELOAD
 - 4A.4.2 DIFFERENTIAL THERMAL EXPANSION
 - 4A.4.3 BOLT TORSION
 - 4A.4.4 BOLT BENDING
 - 4A.4.5 COMBINED STRESSES
- 4A.5 BASKET ANALYSIS
- 4A.6 TRUNNION ANALYSIS
- 4A.7 OUTER SHELL
- 4A.8 TOP NEUTRON SHIELD BOLTS
- 4A.9 REFERENCES

APPENDIX 4A TABLES

- | | |
|--------------|--|
| TABLE 4A.2-1 | MECHANICAL PROPERTIES OF BODY MATERIALS |
| TABLE 4A.2-2 | TEMPERATURE DEPENDENT MATERIAL PROPERTIES COEFFICIENTS OF THERMAL EXPANSION |
| TABLE 4A.2-3 | REFERENCE TEMPERATURES FOR STRESS ANALYSIS ACCEPTANCE CRITERIA (TN-40 CASK) |

TABLE OF CONTENTS**APPENDIX 4A – STRUCTURAL ANALYSIS OF THE TN-40 CASK BODY (CONT'D)****APPENDIX 4A TABLES (CONT'D)**

| | |
|------------------|---|
| TABLE 4A.3.3-1 | BOLT PRELOAD AND SEAL REACTION (TN-CASK) |
| TABLE 4A.3.3-2 | INTERNAL PRESSURE (100 PSIG) (TN-40 CASK) |
| TABLE 4A.3.3-3 | EXTERNAL PRESSURE (25 PSIG) (TN-40 CASK) |
| TABLE 4A.3.3-4 | 1G DOWN – TN-40 CASK STANDING IN A VERTICAL POSITION ON A CONCRETE PAD |
| TABLE 4A.3.3-5 | LIFTING – 3G VERTICAL-UP (TN-40 CASK) |
| TABLE 4A.3.3-6 | THERMAL STRESSES DUE TO OFF-NORMAL TEMPERATURE DISTRIBUTION (TN-40 CASK) |
| TABLE 4A.3.3-7 | 1G LATERAL AND 1G DOWN BOUNDING LOAD FOR SEISMIC, TORNADO WIND & FLOOD (TN-40 CASK) |
| TABLE 4A.3.4.1-1 | *TRUNNION LOADINGS ON TN-40 FOR USE IN CASK BODY EVALUATION |
| TABLE 4A.3.4.1-2 | COMPUTATION SHEET FOR LOCAL STRESSES IN CYLINDRICAL SHELLS |
| TABLE 4A.3.4.1-3 | STRESSES ON TN-40 CASK BODY DUE TO TRUNNION LOADING |
| TABLE 4A.3.5-1 | DESIGN (1) LOAD COMBINATION (TN-40 CASK) |
| TABLE 4A.3.5-2 | DESIGN (2) LOAD COMBINATION (TN-40 CASK) |
| TABLE 4A.3.5-3 | DESIGN (3) LOAD COMBINATION (TN-40 CASK) |
| TABLE 4A.3.5-4 | LEVEL A (1) LOAD COMBINATION (TN-40 CASK) |
| TABLE 4A.3.5-5 | LEVEL A (2) LOAD COMBINATION (TN-40 CASK) |
| TABLE 4A.3.5-6 | LEVEL A (3) LOAD COMBINATION (TN-40 CASK) |
| TABLE 4A.3.5-7 | LEVEL D (1) LOAD COMBINATION (TN-40 CASK) |
| TABLE 4A.3.5-8 | LEVEL D (2) LOAD COMBINATION (TN-40 CASK) |
| TABLE 4A.6-1 | TRUNNION SECTION PROPERTIES AND LOADS (TN-40 CASK) |
| TABLE 4A.6-2 | TRUNNION STRESSES WHEN LOADED BY *6 **10 TIMES CASK WEIGHT |
| TABLE 4A.7-1 | STRESSES IN OUTER SHELL AND CLOSURE PLATES (TN-40 CASK) |

TABLE OF CONTENTS**APPENDIX 4A – STRUCTURAL ANALYSIS OF THE TN-40 CASK BODY (CONT'D)****APPENDIX 4A FIGURES**

| | |
|-----------------|--|
| FIGURE 4A.1-1 | TN-40 CASK BODY KEY DIMENSIONS |
| FIGURE 4A.3-1 | TN-40 CASK BODY – ANSYS MODEL |
| FIGURE 4A.3-2 | TN-40 CASK BODY BOTTOM CORNER |
| FIGURE 4A.3-3 | TN-40 CASK BODY TOP CORNER |
| FIGURE 4A.3-4 | TN-40 CASK BODY LID TO SHIELD PLATE CONNECTION |
| FIGURE 4A.3-5 | FOURIER COEFFICIENTS |
| FIGURE 4A.3-6 | TN-40 BOLT PRELOAD AND SEAL REACTION |
| FIGURE 4A.3-7 | TN-40 DESIGN INTERNAL PRESSURE (100 PSIG) |
| FIGURE 4A.3-8 | TN-40 EXTERNAL PRESSURE LOADING (25 PSIG) |
| FIGURE 4A.3-9 | TN-40 1 G DOWN LOADING |
| FIGURE 4A.3-10 | TN-40 LIFTING 3 G VERTICAL UP |
| FIGURE 4A.3-11 | TN-40 1 G LATERAL |
| FIGURE 4A.3-12 | STANDARD REPORTING LOCATIONS FOR TN-40 CASK BODY |
| FIGURE 4A.3-12a | STIF 61 CONTAINMENT VESSEL ELEMENT SIGN CONVENTION |
| FIGURE 4A.3-12b | TN-40 WELD STRESS LOCATIONS |
| FIGURE 4A.3-13 | IDEALIZED TORNADO MISSILE IMPACT MODEL ON GAMMA SHIELD CYLINDER |
| FIGURE 4A.3-14 | IDEALIZED TORNADO MISSILE IMPACT MODEL OF LID |
| FIGURE 4A.4-1 | SUMMARIZING THE BOLT END MOTIONS DUE TO 100 PSIG PRESSURE IN THE CASK CAVITY |
| FIGURE 4A.4-2 | LID BODY BENDING DUE TO LID EDGE ROTATION UNDER INTERNAL PRESSURE |
| FIGURE 4A.6-1 | TN-40 TRUNNION GEOMETRY |
| FIGURE 4A.7-1 | TN-40 CASK OUTER SHELL AND CONNECTION WITH CASK BODY |
| FIGURE 4A.7-2 | LOAD DISTRIBUTIONS AND MODELS USED FOR ANALYSIS FOR TN-40 OUTER SHELL |

TABLE OF CONTENTS**APPENDIX 4B – STRUCTURAL ANALYSIS OF THE TN-40 BASKET**

- 4B.1 INTRODUCTION
- 4B.2 BASKET FINITE ELEMENT MODEL DEVELOPMENT (FOR SIDE IMPACT ANALYSIS)
- 4B.3 DELETED
- 4B.4 DELETED
- 4B.5 DELETED
- 4B.6 BASKET ANALYSIS UNDER SUSTAINED LATERAL LOADINGS
- 4B.7 BASKET ANALYSIS UNDER VERTICAL LOADINGS
- 4B.8 REFERENCES

APPENDIX 4B TABLES

- | | |
|--------------|---|
| TABLE 4B.1-1 | MECHANICAL PROPERTIES OF BASKET MATERIALS |
| TABLE 4B.1-2 | TEMPERATURE DEPENDENT MATERIAL PROPERTIES COEFFICIENTS OF THERMAL EXPANSION |
| TABLE 4B.1-3 | MATERIALS PROPERTIES USED FOR TN-40 BASKET FINITE ELEMENT MODEL |
| TABLE 4B.1-4 | REFERENCE TEMPERATURE FOR STRESS ANALYSIS ACCEPTANCE CRITERIA (TN-40 BASKET) |

APPENDIX 4B FIGURES

- | | |
|---------------|--|
| FIGURE 4B.2-1 | REPRESENTATIVE BASKET WALL PANEL |
| FIGURE 4B.2-2 | DETAILED WALL PANEL SUBSTRUCTURE MODEL |
| FIGURE 4B.2-3 | ANSYS COMPUTER PLOT OF DETAILED WALL PANEL SUBSTRUCTURE MODEL |
| FIGURE 4B.2-4 | DEVELOPMENT OF SIMPLIFIED PANEL SIMULATION FOR SYSTEM MODEL |
| FIGURE 4B.2-5 | ANSYS COMPUTER PLOT OF SIMPLIFIED WALL PANEL SUBSTRUCTURE MODEL |

TABLE OF CONTENTS**APPENDIX 4B – STRUCTURAL ANALYSIS OF THE TN-40 BASKET (CONT'D)****APPENDIX 4B FIGURES (CONT'D)**

| | |
|----------------|--|
| FIGURE 4B.2-6 | SIMPLY SUPPORTED EDGES – DISP. & ROTATION COMPARISON |
| FIGURE 4B.2-7 | SIMPLY SUPPORTED EDGES – CENTER MOMENT COMPARISON |
| FIGURE 4B.2-8 | FIXED EDGES – MOMENT COMPARISON |
| FIGURE 4B.2-9 | TN-40 BASKET SYSTEM MODEL |
| FIGURE 4B.3-12 | SYSTEM MODEL PANEL LOCATIONS |
| FIGURE 4B.3-13 | DETAILED WALL PANEL SUBSTRUCTURE STRESS REPORTING LOCATIONS FOR INTERCOMPARTMENT BASKET WALL PANEL |
| FIGURE 4B.6-1 | LOAD DISTRIBUTION AND BOUNDARY CONDITIONS - 3G LOAD |
| FIGURE 4B.6-2 | FORCES AND MOMENTS DUE TO 3G SIDE LOAD (TN-40 CASK) |
| FIGURE 4B.6-3 | BASKET PANEL STRESSES UNDER 3G SIDE LOAD (TN-40 CASK) (PANEL LOCATION 17) |
| FIGURE 4B.6-4 | BASKET PANEL STRESSES UNDER 3G SIDE LOAD (TN-40 CASK) (PANEL LOCATION 14) |
| FIGURE 4B.6-5 | DETAILED PANEL MODEL (THERMAL RUN) |
| FIGURE 4B.6-6 | BASKET PANEL STRESS DUE TO DIFFERENTIAL THERMAL EXPANSION (TN-40 CASK) (PANEL LOCATION 14) |
| FIGURE 4B.6-7 | BASKET PANEL STRESS – THERMAL PLUS 3G SIDE LOAD (TN-40 CASK) (PANEL LOCATION 14) |
| FIGURE 4B.7-1 | BASKET STRESS DUE TO 3G VERTICAL LOAD |

TABLE OF CONTENTS

APPENDIX 4C – TESTS PERFORMED TO SUPPORT DESIGN OF THE TN-40 BASKET

4C.1 COMPRESSION TEST OF THE TN-40 BASKET PANELS

4C.2 AXIAL CRUSH TEST OF STAINLESS STEEL BOX SECTION

APPENDIX 4C FIGURES

FIGURE 4C.1-1 REPRESENTATIVE BASKET WALL PANEL

FIGURE 4C.1-2 TN-40 BASKET PANEL COMPRESSION TEST SETUP

FIGURE 4C.1-3 OBSERVED DEFORMATION MODES

FIGURE 4C.1-4 PANEL LOAD VS DEFLECTION CURVE

FIGURE 4C.1-5 TN-40 BASKET PANEL COMPRESSION TEST RESULTS

FIGURE 4C.1-6 TEST PANEL ALLOWABLE COMPRESSIVE LOAD USING
TN-40 CRITERIA AND ACTUAL TEST PANEL
DIMENSIONS (SLIGHTLY THICKER PLATES THAN
TN-40 DESIGN)

FIGURE 4C.2-1 AXIAL CRUSH TEST OF “BARE” BOX SECTION

TABLE OF CONTENTS

SECTION 5 – STORAGE SYSTEM OPERATIONS

- 5.1 OPERATION DESCRIPTION
 - 5.1.1 NARRATIVE DESCRIPTION
 - 5.1.2 FLOW SHEET
 - 5.1.3 IDENTIFICATION OF SUBJECTS FOR SAFETY AND RELIABILITY ANALYSIS
- 5.2 CONTROL ROOM AND CONTROL AREAS
- 5.3 SPENT FUEL ACCOUNTABILITY PROGRAM
- 5.4 SPENT FUEL TRANSPORT TO ISFSI
- 5.5 SPENT FUEL TRANSFER TO TRANSPORT CASK
- 5.6 REFERENCES

SECTION 5 TABLES

- TABLE 5.1-1 SEQUENCE OF OPERATIONS
- TABLE 5.1-2 ANTICIPATED TIME AND PERSONNEL REQUIREMENTS FOR CASK HANDLING OPERATIONS

SECTION 5 FIGURES

- FIGURE 5.1-1 SEQUENCE OF OPERATIONS
- FIGURE 5.4-1 ACCESS ROAD – PLAN AND PROFILE

SECTION 6 – WASTE MANAGEMENT

- 6.1 DESIGN
- 6.2 REFERENCES

TABLE OF CONTENTS**SECTION 7 – RADIATION PROTECTION**

- 7.1 ENSURING THAT OCCUPATIONAL RADIATION EXPOSURES ARE AS LOW AS REASONABLY ACHIEVABLE (ALARA)
 - 7.1.1 POLICY CONSIDERATION AND ORGANIZATION
 - 7.1.2 DESIGN CONSIDERATIONS
 - 7.1.3 OPERATIONAL CONSIDERATIONS
- 7.2 RADIATION SOURCES
 - 7.2.1 CHARACTERIZATION OF SOURCES
 - 7.2.2 AIRBORNE RADIOACTIVE SOURCES
- 7.3 RADIATION PROTECTION DESIGN FEATURES
 - 7.3.1 STORAGE SYSTEM DESIGN DESCRIPTION
 - 7.3.2 SHIELDING
 - 7.3.3 AREA RADIATION AND AIRBORNE RADIOACTIVITY MONITORING INSTRUCTIONS
- 7.4 ESTIMATED ONSITE COLLECTIVE DOSE ASSESSMENT
- 7.5 OFFSITE COLLECTIVE DOSE ASSESSMENT
- 7.6 RADIATION PROTECTION PROGRAM
- 7.7 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
- 7.8 REFERENCES

SECTION 7 TABLES

| | |
|-------------|--|
| TABLE 7.2-1 | MATERIAL DISTRIBUTION IN WESTINGHOUSE 14X14 OFA FUEL ASSEMBLY |
| TABLE 7.2-2 | GAMMA AND NEUTRON RADIATION SOURCES WESTINGHOUSE OFA 14X14 3.85 W/O U235 45,000 MWD/MTU, 10 YEAR COOLING TIME |
| TABLE 7.2-3 | FISSION PRODUCT ACTIVITIES (CURIES/MTU) WESTINGHOUSE OFA 14X14 3.85 W/O U235, 45,000 MWD/MTU, 10 YEAR COOLING TIME |

TABLE OF CONTENTS**SECTION 7 – RADIATION PROTECTION (CONT'D)****SECTION 7 TABLES (CONT'D)**

| | |
|--------------|---|
| TABLE 7.2-3a | ACTIVATION ACTIVITIES (CURIES/MTU) |
| TABLE 7.2-4 | PRIMARY GAMMA SOURCE SPECTRUM ORIGEN2 GROUP STRUCTURE WESTINGHOUSE OFA 14X14 3.85 W/O U235, 45,000 MWD/MTU, 10 YEAR COOLING TIME |
| TABLE 7.2-5 | NEUTRON SOURCE DISTRIBUTION WESTINGHOUSE OFA 14X14 3.85 W/O U235, 45,000 MWD/MTU, 10 YEAR COOLING TIME |
| TABLE 7.2-6 | PARAMETERS FOR THE SCALE 27N-18G LIBRARY WESTINGHOUSE OFA 14X14 3.85 W/O U235 45,000 MWD/MTU, 10 YEAR COOLING TIME |
| TABLE 7.2-7 | FISSION GAS AND VOLATILE NUCLIDES INVENTORY (CURIES/40 ASSEMBLIES) WESTINGHOUSE OFA 14X14 W/O U235 45,000 MWD/MTU, 10 YEAR COOLING TIME |
| TABLE 7.4-1 | DESIGN BASIS OCCUPATIONAL EXPOSURES FOR CASK LOADING, TRANSPORT AND EMPLACEMENT (ONE TIME EXPOSURE) |
| TABLE 7.4-2 | DESIGN BASIS ISFSI MAINTENANCE OPERATIONS ANNUAL EXPOSURES |
| TABLE 7.4-3 | DELETED |
| TABLE 7.4-4 | DELETED |
| TABLE 7.4-6 | DELETED |

SECTION 7 FIGURES

| | |
|--------------|---------|
| FIGURE 7.4-1 | DELETED |
|--------------|---------|

TABLE OF CONTENTS**APPENDIX 7A – TN-40 CASK DOSE ANALYSIS**

- 7A.1 SHIELDING DESIGN FEATURES
- 7A.2 SHIELDING ANALYSIS
- 7A.3 DIRECT RADIATION N-S
- 7A.4 DIRECT RADIATION E-W
- 7A.5 INDIRECT RADIATION (SKYSHINE)
- 7A.6 EARTH BERM
- 7A.7 DOSE RATE AROUND THE ISFSI
- 7A.8 EXPERIMENTAL RESULTS
- 7A.9 REFERENCES

APPENDIX 7A TABLES

| | |
|-------------|--|
| TABLE 7A-1 | TN-40 CASK SHIELD MATERIALS |
| TABLE 7A-2 | MATERIALS INPUT FOR QAD MODEL (TN-40 CASK) |
| TABLE 7A-3 | MATERIALS INPUT FOR XSDRNPM (TN-40 CASK) |
| TABLE 7A-4 | TN-40 DOSE RATES AT SHORT DISTANCES |
| TABLE 7A-5 | DELETED |
| TABLE 7A-5a | DELETED |
| TABLE 7A-5b | DELETED |
| TABLE 7A-6 | DELETED |
| TABLE 7A-7 | DELETED |
| TABLE 7A-8 | DELETED |

TABLE OF CONTENTS**APPENDIX 7A – TN-40 CASK DOSE ANALYSIS (CONT'D)****APPENDIX 7A FIGURES**

| | |
|--------------|--|
| FIGURE 7A-1 | TN-40 CASK SHIELDING CONFIGURATION |
| FIGURE 7A-2 | QAD MODEL (TN-40 CASK) |
| FIGURE 7A-3 | XSDRN – PM RADIAL MODEL (TN-40 CASK) |
| FIGURE 7A-4 | XSDRN – PM AXIAL MODELS (TN-40 CASK) |
| FIGURE 7A-5 | XSDRN – PM TN-40 SPECIAL MODEL (LONG DISTANCE) |
| FIGURE 7A-6 | DOSE RATES AT LONG DISTANCES (MREM/HR) |
| FIGURE 7A-7 | DELETED |
| FIGURE 7A-8 | DELETED |
| FIGURE 7A-9 | DELETED |
| FIGURE 7A-10 | DELETED |
| FIGURE 7A-11 | DELETED |

APPENDIX 7B – SHIELDING EVALUATION COMPUTER INPUT

TABLE OF CONTENTS

SECTION 8 – ACCIDENT ANALYSIS

8.1 OFF-NORMAL OPERATIONS

8.1.1 LOSS OF ELECTRICAL POWER

8.1.2 RADIOLOGICAL IMPACT FROM OFF-NORMAL OPERATIONS

8.2 ACCIDENTS

8.2.1 EARTHQUAKE

8.2.2 EXTREME WIND

8.2.3 FLOOD

8.2.4 EXPLOSION

8.2.5 FIRE

8.2.6 INADVERTENT LOADING OF A NEWLY DISCHARGED FUEL ASSEMBLY

8.2.7 CASK SEAL LEAKAGE

8.2.8 HYPOTHETICAL CASK DROP ACCIDENT

8.2.9 LOSS OF CONFINEMENT BARRIER

8.3 SITE CHARACTERISTICS AFFECTING SAFETY ANALYSIS

8.4 REFERENCES

SECTION 8 TABLES

| | |
|-------------|---|
| TABLE 8.2-1 | RADIOLOGICAL CONSEQUENCES – LOSS OF CONFINEMENT BARRIER |
|-------------|---|

TABLE OF CONTENTS**SECTION 8 – ACCIDENT ANALYSIS (CONT'D)****SECTION 8 FIGURES**

| | |
|---------------|--|
| FIGURE 8.2-1A | HYPOTHETICAL ACCIDENT – 50 G BOTTOM DROP ON CONCRETE PAD (50G'S) |
| FIGURE 8.2-1B | HYPOTHETICAL ACCIDENT – LOAD COMBINATION (1) |
| FIGURE 8.2-1C | TN-40 CASK BOTTOM CORNER – 50G BOTTOM DROP |
| FIGURE 8.2-1D | TN-40 50G DOWN LOADING & BOUNDARY CONDITIONS |
| FIGURE 8.2-5 | MEMBRANE STRESS INTENSITY AT SECTION 3-4 (TN-40 CASK) |
| FIGURE 8.2-33 | DOSE VS. DISTANCE AT POPULATION SECTOR MIDPOINT DISTANCES BETWEEN 0 AND 50 MILES |

TABLE OF CONTENTS

SECTION 9 – CONDUCT OF OPERATIONS

- 9.1 ORGANIZATIONAL STRUCTURE
 - 9.1.1 CORPORATE ORGANIZATION
 - 9.1.2 OPERATING ORGANIZATION, MANAGEMENT AND ADMINISTRATIVE CONTROL SYSTEM
 - 9.1.3 PERSONNEL QUALIFICATION REQUIREMENTS
 - 9.1.4 LIAISON WITH OUTSIDE ORGANIZATIONS
- 9.2 STARTUP TESTING AND OPERATION
 - 9.2.1 ADMINISTRATIVE PROCEDURES FOR CONDUCTING TEST PROGRAM
 - 9.2.2 TEST PROGRAM DESCRIPTION
 - 9.2.3 TEST DISCUSSION
 - 9.2.4 COMPLETION OF PRE-OPERATIONAL TEST PROGRAM
- 9.3 TRAINING PROGRAM
- 9.4 NORMAL OPERATIONS
 - 9.4.1 PROCEDURES
 - 9.4.2 RECORDS
- 9.5 EMERGENCY PLANNING
- 9.6 PHYSICAL SECURITY PLAN
- 9.7 ADDITIONAL FABRICATION TESTING AND INSPECTIONS
- 9.8 AGING MANAGEMENT
 - 9.8.1 AGING MANAGEMENT REVIEW
 - 9.8.2 ISFSI INSPECTION AND MONITORING ACTIVITIES PROGRAM
 - 9.8.3 TIME-LIMITED AGING ANALYSES
- 9.9 REFERENCES

SECTION 9 TABLES

TABLE 9.8-1 MANAGED AGING EFFECTS

TABLE OF CONTENTS

SECTION 9 FIGURES

| | |
|--------------|-------------------------------------|
| FIGURE 9.1-1 | XCEL CORPORATE ORGANIZATION |
| FIGURE 9.1-2 | PRAIRIE ISLAND PLANT ORGANIZATION |
| FIGURE 9.1-3 | ISFSI CASK FABRICATION ORGANIZATION |
| FIGURE 9.1-4 | ISFSI OPERATING ORGANIZATION |

SECTION 10 – OPERATING CONTROLS AND LIMITS

| | |
|--------|---|
| 10.1 | FUNCTIONAL AND OPERATING LIMITS, MONITORING INSTRUMENTS AND LIMITING CONTROL SETTINGS |
| 10.1.1 | FUEL |
| 10.1.2 | CASKS |
| 10.2 | LIMITING CONDITIONS FOR OPERATION |
| 10.2.1 | CASK INTERNAL HELIUM PRESSURE |
| 10.2.2 | CASK LEAKAGE |
| 10.3 | SURVEILLANCE REQUIREMENTS |
| 10.3.1 | FUEL PARAMETERS |
| 10.3.2 | CASK LOADING |
| 10.3.3 | CASK TEMPERATURE |
| 10.3.4 | CASK SURFACE DOSE RATE |
| 10.3.5 | CASK DECONTAMINATION |
| 10.3.6 | CASK INTERNAL HELIUM PRESSURE |
| 10.3.7 | CASK LEAKAGE |
| 10.3.8 | ISFSI SAFETY STATUS |
| 10.3.9 | ISFSI AREA DOSE RATE |
| 10.4 | DESIGN FEATURES |
| 10.5 | ADMINISTRATIVE CONTROLS |
| 10.6 | REFERENCES |

TABLE OF CONTENTS

SECTION 11 – QUALITY ASSURANCE

11.1 QUALITY ASSURANCE PROGRAM DESCRIPTION

- 11.1.1 ORGANIZATION
- 11.1.2 QUALITY ASSURANCE PROGRAM
- 11.1.3 DESIGN CONTROL
- 11.1.4 PROCUREMENT DOCUMENT CONTROL
- 11.1.5 INSTRUCTIONS, PROCEDURES AND DRAWINGS
- 11.1.6 DOCUMENT CONTROL
- 11.1.7 CONTROL OF PURCHASED MATERIALS, EQUIPMENT AND SERVICES
- 11.1.8 IDENTIFICATION AND CONTROL OF MATERIALS, PARTS AND COMPONENTS
- 11.1.9 CONTROL OF SPECIAL PROCESSES
- 11.1.10 INSPECTION
- 11.1.11 TEST CONTROL
- 11.1.12 CONTROL OF MEASURING AND TEST EQUIPMENT
- 11.1.13 HANDLING, STORAGE AND SHIPPING
- 11.1.14 INSPECTION, TEST AND OPERATING STATUS
- 11.1.15 NON-CONFORMING MATERIALS, PARTS OR COMPONENTS
- 11.1.16 CORRECTIVE ACTION
- 11.1.17 QUALITY ASSURANCE RECORDS
- 11.1.18 AUDITS

11.2 QUALITY ASSURANCE PROGRAM – CONTRACTORS

- 11.2.1 ARCHITECT ENGINEER
- 11.2.2 CASK SUPPLIER
- 11.2.3 CONCRETE STORAGE PAD CONTRACTOR

11.3 REFERENCES

**TABLE OF CONTENTS
ADDENDUM**

**SECTION A1 – INTRODUCTION AND GENERAL DESCRIPTION OF STORAGE
SYSTEM**

- A1.1 INTRODUCTION
- A1.2 GENERAL DESCRIPTION OF LOCATION
- A1.3 GENERAL STORAGE SYSTEM DESCRIPTION
- A1.4 IDENTIFICATION OF AGENTS AND CONTRACTORS
- A1.5 SUPPLEMENTAL DATA
- A1.6 REFERENCES

SECTION A1 TABLES

TABLE A1.3-1 NOMINAL DIMENSIONS AND WEIGHT OF THE TN-40HT
CASK

SECTION A1 FIGURES

- FIGURE A1.3-1 TN-40HT CONTAINMENT BOUNDARY COMPONENTS
- FIGURE TN40HT-72-1 TN-40HT HIGH BURNUP DRY STORAGE CASK
PARTS LIST AND NOTES
- FIGURE TN40HT-72-2 TN-40HT HIGH BURNUP DRY STORAGE CASK
ASSEMBLY
- FIGURE TN40HT-72-3 TN-40HT HIGH BURNUP DRY STORAGE CASK
SHELL ASSEMBLY
- FIGURE TN40HT-72-4 TN-40HT HIGH BURNUP DRY STORAGE CASK
SHELL ASSEMBLY
- FIGURE TN40HT-72-5 TN-40HT HIGH BURNUP DRY STORAGE CASK
LID ASSEMBLY
- FIGURE TN40HT-72-6 TN-40HT HIGH BURNUP DRY STORAGE CASK
LID DETAILS
- FIGURE TN40HT-72-7 TN-40HT HIGH BURNUP DRY STORAGE CASK
PROTECTIVE COVER
- FIGURE TN40HT-72-8 TN-40HT HIGH BURNUP DRY STORAGE CASK
OVERPRESSURE TANK ASSEMBLY
- FIGURE TN40HT-72-9 TN-40HT HIGH BURNUP DRY STORAGE CASK
TOP NEUTRON SHIELD

**TABLE OF CONTENTS
ADDENDUM**

**SECTION A1 – INTRODUCTION AND GENERAL DESCRIPTION OF STORAGE
SYSTEM (CONT'D)**

SECTION A1 FIGURES (CONT'D)

| | |
|---------------------|---|
| FIGURE TN40HT-72-10 | TN-40HT HIGH BURNUP DRY STORAGE CASK PARTS |
| FIGURE TN40HT-72-21 | TN-40HT BASKET ASSEMBLY AND DETAIN |
| FIGURE TN40HT-72-22 | R180 RAIL ELEVATION |

SECTION A2 – SITE CHARACTERISTICS

A2.1 GEOGRAPHY AND DEMOGRAPHY OF SITE SELECTED

- A2.1.1 SITE LOCATION
- A2.1.2 SITE DESCRIPTION
- A2.1.3 POPULATION DISTRIBUTION AND TRENDS
- A2.1.4 USES OF NEARBY LAND AND WATERS

A2.2 NEARBY INDUSTRIAL, TRANSPORTATION AND MILITARY FACILITIES

A2.3 METEOROLOGY

- A2.3.1 REGIONAL CLIMATOLOGY
- A2.3.2 LOCAL METEOROLOGY
- A2.3.3 ONSITE METEOROLOGICAL MEASUREMENT PROGRAM
- A2.3.4 DIFFUSION ESTIMATES

A2.4 HYDROLOGY

- A2.4.1 SURFACE WATER
- A2.4.2 GROUND WATER

**TABLE OF CONTENTS
ADDENDUM**

SECTION A2 – SITE CHARACTERISTICS (cont'd)

A2.5 GEOLOGY AND SEISMOLOGY

- A2.5.1 BASIC GEOLOGIC AND SEISMIC INFORMATION
- A2.5.2 VIBRATING GROUND MOTION
- A2.5.3 SURFACE FAULTING
- A2.5.4 STABILITY OF SUBSURFACE MATERIALS
- A2.5.5 SLOPE STABILITY

A2.6 REFERENCES

SECTION A2A – BORING LOGS

SECTION A2B – GRAIN SIZE DISTRIBUTION TEST REPORTS

**TABLE OF CONTENTS
ADDENDUM**

SECTION A3 – PRINCIPAL TN-40HT CASK DESIGN CRITERIA

A3.1 PURPOSE OF CASK

A3.1.1 SPENT FUEL TO BE STORED

A3.1.2 GENERAL OPERATING FUNCTIONS

A3.2 DESIGN CRITERIA FOR ENVIRONMENTAL CONDITIONS AND NATURAL PHENOMENA

A3.2.1 TORNADO AND WIND LOADINGS

A3.2.2 WATER LEVEL (FLOOD) DESIGN

A3.2.3 SEISMIC DESIGN

A3.2.4 SNOW AND ICE LOADINGS

A3.2.5 COMBINED LOAD CRITERIA

A3.3 SAFETY PROTECTION SYSTEMS

A3.3.1 GENERAL

A3.3.2 PROTECTION BY MULTIPLE CONFINEMENT BARRIERS AND SYSTEMS

A3.3.3 PROTECTION BY EQUIPMENT AND INSTRUMENTATION SELECTION

A3.3.4 NUCLEAR CRITICALITY SAFETY

A3.3.5 RADIOLOGICAL PROTECTION

A3.3.6 FIRE AND EXPLOSION PROTECTION

A3.3.7 MATERIAL HANDLING AND STORAGE

A3.4 SUMMARY OF STORAGE CASK DESIGN CRITERIA

A3.5 ASME CODE ALTERNATIVES

A3.6 REFERENCES

**TABLE OF CONTENTS
ADDENDUM****SECTION A3 – PRINCIPAL TN-40HT CASK DESIGN CRITERIA (CONT'D)****SECTION A3 TABLES**

| | |
|---------------|---|
| TABLE A3.1-1 | PRAIRIE ISLAND FUEL ASSEMBLY DESIGN CHARACTERISTICS |
| TABLE A3.1-2 | THERMAL, GAMMA AND NEUTRON SOURCES FOR THE DESIGN BASIS 14 X 14 WESTINGHOUSE STANDARD FUEL ASSEMBLY |
| TABLE A3.2-3 | FUEL QUALIFICATION CRITERIA |
| TABLE A3.2-1 | TN-40HT CASK COMPONENT WEIGHTS AND CENTER OF GRAVITY LOCATIONS |
| TABLE A3.2-2 | SUMMARY OF INTERNAL AND EXTERNAL PRESSURES ACTING ON THE TN-40HT CASK |
| TABLE A3.2-3 | SUMMARY OF LIFTING LOADS USED FOR UPPER TRUNNIONS |
| TABLE A3.2-4 | SUMMARY OF LOADS ACTING ON THE TN-40HT CASK DUE TO ENVIRONMENTAL AND NATURAL PHENOMENA |
| TABLE A3.2-5 | TN-40HT CASK LOADING CONDITIONS |
| TABLE A3.2-6 | TN-40HT CASK DESIGN LOADS (NORMAL CONDITIONS) |
| TABLE A3.2-7 | LEVEL A SERVICE LOADS (NORMAL CONDITIONS) |
| TABLE A3.2-8 | LEVEL D SERVICE LOADS (ACCIDENT CONDITIONS) |
| TABLE A3.2-9 | NORMAL CONDITION LOAD COMBINATIONS |
| TABLE A3.2.10 | ACCIDENT CONDITION LOAD COMBINATIONS |
| TABLE A3.3-1 | AXIAL DECAY HEAT PROFILE |
| TABLE A3.3-2 | PEAKING FACTORS APPLIED IN THE FINITE ELEMENT MODEL |
| TABLE A3.3-3 | MATERIAL TEMPERATURES FOR HOT NORMAL/OFF NORMAL CONDITIONS |
| TABLE A3.3-4 | AVERAGE TEMPERATURES AT THE HOTTEST CROSS SECTION FOR 100°F STORAGE CONDITIONS |
| TABLE A3.3-5 | MAXIMUM TEMPERATURE FOR COLD NORMAL/OFF NORMAL CONDITIONS |

**TABLE OF CONTENTS
ADDENDUM****SECTION A3 – PRINCIPAL TN-40HT CASK DESIGN CRITERIA (CONT'D)****SECTION A3 TABLES (CONT'D)**

| | |
|---------------|--|
| TABLE A3.3-6 | MAXIMUM COMPONENT TEMPERATURE FOR FIRE ACCIDENTS |
| TABLE A3.3-7 | MAXIMUM COMPONENT TEMPERATURES FOR BURIED CASK |
| TABLE A3.3-8 | MATERIAL THERMAL PROPERTIES |
| TABLE A3.3-9 | TRANSVERSE EFFECTIVE FUEL CONDUCTIVITY IN HELIUM |
| TABLE A3.3-10 | COMPARISON OF MAXIMUM AND AVERAGE TEMPERATURES |
| TABLE A3.3-11 | COMPARISON OF VIEW FACTORS |
| TABLE A3.3-12 | EFFECTIVE CONDUCTIVITIES FOR CASK SECTIONS |
| TABLE A3.3-13 | AVERAGE TEMPERATURES AT THE HOTTEST CROSS SECTION FOR VACUUM DRYING CONDITIONS WITH ZERO GAP BETWEEN BASKET AND CASK INNER SHELL |
| TABLE A3.3-14 | MAXIMUM COMPONENT TEMPERATURE AT THE END OF VACUUM DRYING OPERATIONS |
| TABLE A3.3-15 | CASK INTERNAL PRESSURE (FUEL ASSEMBLY WITHOUT BPRAS) |
| TABLE A3.3-16 | CASK INTERNAL PRESSURE (FUEL ASSEMBLY WITH BPRAS) |
| TABLE A3.3-17 | MAXIMUM ENRICHMENT AND MINIMUM B10 CONTENT |
| TABLE A3.3-18 | AUTHORIZED CONTENTS FOR TN-40HT SYSTEM |
| TABLE A3.3-19 | PARAMETERS FOR WE 14X14 CLASS FUEL ASSEMBLIES |
| TABLE A3.3-20 | TN-40HT BASKET DIMENSIONS |
| TABLE A3.3-21 | DESCRIPTION OF THE BASIC KENO MODEL UNITS |
| TABLE A3.3-22 | MATERIAL PROPERTY DATA |
| TABLE A3.3-23 | MOST REACTIVE FUEL TYPE EVALUATION RESULTS |
| TABLE A3.3-24 | FUEL COMPARTMENT TUBE INTERNAL DIMENSION EVALUATION RESULTS |

**TABLE OF CONTENTS
ADDENDUM****SECTION A3 – PRINCIPAL TN-40HT CASK DESIGN CRITERIA (CONT'D)****SECTION A3 TABLES (CONT'D)**

| | |
|---------------|---|
| TABLE A3.3-25 | COMPARTMENT TUBE AND STEEL BAR THICKNESS EVALUATION RESULTS |
| TABLE A3.3-26 | POISON BAR THICKNESS AND MATERIAL EVALUATION RESULTS |
| TABLE A3.3-27 | RAIL, MODELING EVALUATION RESULTS |
| TABLE A3.3-28 | WE 14X14 CLASS ASSEMBLY WITHOUT CCS FINAL RESULTS |
| TABLE A3.3-29 | WE 14X14 CLASS ASSEMBLY WITH CCS FINAL RESULTS |
| TABLE A3.3-30 | BENCHMARKING RESULTS |
| TABLE A3.3-31 | USL-1 RESULTS |
| TABLE A3.3-32 | USL DETERMINATION FOR CRITICALITY ANALYSIS |
| TABLE A3.3-33 | THERMAL CONDUCTIVITY WITH A 75% HELIUM, 25% AIR AND WATER VAPOR MIXTURE |
| TABLE A3.3-34 | MAXIMUM COMPONENT TEMPERATURES WITH A 75% HELIUM, 25% AIR AND WATER VAPOR MIXTURE |
| TABLE A3.4-1 | DESIGN CRITERIA FOR TN-40HT CASKS |

SECTION A3 FIGURES

| | |
|---------------|--|
| FIGURE A3.2-1 | EARTHQUAKE, WIND, AND WATER LOADS |
| FIGURE A3.2-2 | TORNADO MISSILE IMPACT LOADS |
| FIGURE A3.2-3 | LIFTING LOADS |
| FIGURE A3.3-1 | TN-40HT CASK SEAL PRESSURE MONITORING SYSTEM |
| FIGURE A3.3-2 | FULL-LENGTH CASK MODEL |
| FIGURE A3.3-3 | MESH DENSITY OF FINITE ELEMENT MODEL |
| FIGURE A3.3-4 | GAPS IN AXIAL DIRECTION |
| FIGURE A3.3-5 | GAPS IN RADIAL DIRECTION |

**TABLE OF CONTENTS
ADDENDUM**

SECTION A3 – PRINCIPAL TN-40HT CASK DESIGN CRITERIA (CONT'D)

SECTION A3 FIGURES (CONT'D)

| | |
|----------------|---|
| FIGURE A3.3-6 | TOP CASK SUB MODEL |
| FIGURE A3.3-7 | BOUNDARY CONDITIONS FOR FULL-LENGTH CASK MODEL |
| FIGURE A3.3-8 | BOUNDARY CONDITIONS FOR CASK TOP SUB-MODEL |
| FIGURE A3.3-9 | FINITE ELEMENT MODELS FOR ACCIDENT CONDITIONS |
| FIGURE A3.3-10 | COMPARISON OF THE AXIAL HEAT PROFILES IN THE MODEL |
| FIGURE A3.3-11 | TEMPERATURE DISTRIBUTIONS FOR FULL-LENGTH MODEL NORMAL/OFF-NORMAL STORAGE CONDITIONS |
| FIGURE A3.3-12 | NORMAL / OFF-NORMAL TEMPERATURE DISTRIBUTION FOR COMPONENTS OF FULL-LENGTH MODEL |
| FIGURE A3.3-13 | NORMAL / OFF-NORMAL TEMPERATURE DISTRIBUTION FOR CASK TOP SUB-MODEL |
| FIGURE A3.3-14 | COMPONENT TIME TEMPERATURE HISTORY FOR FIRE ACCIDENT |
| FIGURE A3.3-15 | TEMPERATURE DISTRIBUTION FOR FIRE ACCIDENT STEADY STATE, CROSS-SECTION MODEL |
| FIGURE A3.3-16 | TEMPERATURE DISTRIBUTION FOR FIRE ACCIDENT TRANSIENT RUN FOR LIP SEAL REGION MODEL |
| FIGURE A3.3-17 | FINITE ELEMENT MODEL OF WE14X14 FUEL ASSEMBLY |
| FIGURE A3.3-18 | TEMPERATURE PLOT FOR WE14X14 FA IN HELIUM |
| FIGURE A3.3-19 | COMPARISON OF TRANSVERSE EFFECTIVE CONDUCTIVITIES |
| FIGURE A3.3-20 | STORAGE CONFIGURATION FOR TN-40HT CASKS |
| FIGURE A3.3-21 | STORAGE ARRAY MODEL FOR TN-40HT CASKS |
| FIGURE A3.3-22 | CASK SECTION FOR EFFECTIVE CONDUCTIVITIES |
| FIGURE A3.3-23 | TEMPERATURE DISTRIBUTION ON CASK OUTER SURFACES ON STORAGE PADS |
| FIGURE A3.3-24 | TEMPERATURE DISTRIBUTION ON STORAGE PAD SURFACE |

**TABLE OF CONTENTS
ADDENDUM**

SECTION A3 – PRINCIPAL TN-40HT CASK DESIGN CRITERIA (CONT'D)

SECTION A3 FIGURES (CONT'D)

- FIGURE A3.3-25 TEMPERATURE DISTRIBUTION ON HALVES OF CASK
INNER SHELL (MIDDLE CASK)
- FIGURE A3.3-26 MAXIMUM FUEL CLADDING TEMPERATURE DURING
VACUUM DRYING OPERATIONS
- FIGURE A3.3-27 TEMPERATURE DISTRIBUTION AT THE END OF VACUUM
DRYING OPERATION
- FIGURE A3.3-28 TN-40HT BASKET CROSS SECTION
- FIGURE A3.3-29 BASKET VIEWS AND DIMENSIONS
- FIGURE A3.3-30 BASKET MODEL COMPARTMENT WALL (VIEW G)
- FIGURE A3.3-31 BASKET MODEL COMPARTMENT WALL (VIEW F)
- FIGURE A3.3-32 BASKET MODEL COMPARTMENT WALL WITH FUEL
ASSEMBLY (VIEW G)
- FIGURE A3.3-33 BASKET MODEL COMPARTMENT WALL WITH FUEL
ASSEMBLY (VIEW F)
- FIGURE A3.3-34 BASKET COMPARTMENT WITH WE 14X14 FUEL
ASSEMBLY (SECTION A)
- FIGURE A3.3-35 BASKET COMPARTMENT WITH WE 14X14 FUEL
ASSEMBLY (SECTION B)
- FIGURE A3.3-36 FULL POSITION AND POISON PLATE LOCATION IN
THE TN-40HT BASKET
- FIGURE A3.3-37 TN-40HT CASK DESCRIPTION IN THE KENO MODEL
- FIGURE A3.3-38 EXXON 14X14 TOP ROD FUEL ASSEMBLY (CENTERED)
KENO MODEL
- FIGURE A3.3-39 WE 14X14 STANDARD FUEL ASSEMBLY (INWARD)
KENO MODEL
- FIGURE A3.3-40 TN-40HT DESIGN BASIS KENO MODEL WITHOUT CCS
- FIGURE A3.3-41 TN-40HT DESIGN BASIS KENO MODEL WITH CCS

**TABLE OF CONTENTS
ADDENDUM**

APPENDIX A3A – TN-40HT CRITICALITY EVALUATION COMPUTER INPUT

A3A.1 MOST REACTIVE FUEL TYPE EXAMPLE INPUT FILE

A3A.2 INPUT LISTING FOR CASE WITH MAXIMUM CALCULATED K_{EFF}

SECTION A4 – STORAGE SYSTEM

A4.1 LOCATION AND LAYOUT

A4.2 STORAGE SITE

A4.2.1 STRUCTURES

A4.2.2 STORAGE SITE LAYOUT

A4.2.3 STORAGE CASK DESCRIPTION

A4.2.4 INSTRUMENTATION SYSTEM DESCRIPTION

A4.3 TRANSPORT SYSTEM

A4.3.1 FUNCTION

A4.3.2 COMPONENTS

A4.3.3 DESIGN BASIS AND SAFETY ASSURANCE

A4.3.4 DETERMINATION OF NATURAL FORCES ON A LOADED
TRANSPORT VEHICLE

A4.4 OPERATING SYSTEMS

A4.4.1 LOADING AND UNLOADING SYSTEMS

A4.4.2 DECONTAMINATION SYSTEMS

A4.4.3 STORAGE CASK REPAIR AND MAINTENANCE

A4.4.4 UTILITY SUPPLIES AND SYSTEMS

A4.4.5 OTHER SYSTEMS

**TABLE OF CONTENTS
ADDENDUM**

SECTION A4 – STORAGE SYSTEM (CONT'D)

A4.5 CLASSIFICATION OF STRUCTURES, SYSTEMS, AND COMPONENTS

- A4.5.1 CONTAINMENT VESSEL
- A4.5.2 PENETRATION GASKETS
- A4.5.3 SHIELDING
- A4.5.4 PROTECTIVE COVER AND OVERPRESSURE SYSTEM
- A4.5.5 CONCRETE STORAGE PADS

A4.6 DECOMMISSIONING PLAN

A4.7 REFERENCES

SECTION A4 TABLES

- TABLE A4.2-1 INDIVIDUAL LOAD CASES ANALYZED
- TABLE A4.2-2 CONTAINMENT VESSEL STRESS LIMITS
- TABLE A4.2-3 NON-CONTAINMENT STRUCTURE STRESS LIMITS
- TABLE A4.2-4 BASKET STRESS LIMITS
- TABLE A4.2-5 SUMMARY OF LOAD COMBINATIONS FOR NORMAL CONDITIONS
- TABLE A4.2-6 SUMMARY OF LOAD COMBINATIONS FOR ACCIDENT CONDITIONS
- TABLE A4.2-7 BASKET NORMAL AND ACCIDENT CONDITION LOAD COMBINATIONS
- TABLE A4.2-8 SUMMARY OF LOAD COMBINATION STRESSES FOR NORMAL CONDITIONS
- TABLE A4.2-9 SUMMARY OF LOAD COMBINATION STRESSES FOR ACCIDENT CONDITIONS
- TABLE A4.2-10 LINEARIZED STRESS EVALUATIONS FOR NORMAL CONDITION LOAD COMBINATIONS
- TABLE A4.2-11 WELD STRESSES

**TABLE OF CONTENTS
ADDENDUM****SECTION A4 – STORAGE SYSTEM (CONT'D)****SECTION A4 TABLES (CONT'D)**

| | |
|---------------|--|
| TABLE A4.2-12 | SUMMARY OF LID BOLT STRESSES |
| TABLE A4.2-13 | NORMAL CONDITION LOADS AND BASKET STRESS ANALYSIS RESULTS |
| TABLE A4.2-14 | ACCIDENT CONDITION BASKET STRESS ANALYSIS RESULTS |
| TABLE A4.2-15 | SUMMARY OF UPPER TRUNNION STRESSES (YIELD STRENGTH CASE) |
| TABLE A4.2-16 | SUMMARY OF UPPER TRUNNION STRESSES (ULTIMATE STRENGTH CASE) |
| TABLE A4.2-17 | SUMMARY OF NEUTRON SHIELD OUTER SHELL STRESSES |
| TABLE A4.2-18 | TEMPERATURE DEPENDENT CASK BODY PROPERTIES OF MATERIALS |
| TABLE A4.2-19 | TEMPERATURE DEPENDENT BASKET MATERIAL PROPERTIES |
| TABLE A4.2-20 | LENGTH GROWTH BETWEEN FUEL AND CASK |
| TABLE A4.2-21 | DIAMETRICAL GROWTH BETWEEN THE BASKET AND THE CASK |
| TABLE A4.2-22 | AXIAL GROWTH BETWEEN BASKET AND ALUMINUM PLATES AND SS SUPPORT BARS |
| TABLE A4.2-23 | LENGTH GROWTH BETWEEN ALUMINUM PLATES AND SS SUPPORT BARS |
| TABLE A4.2-24 | SUMMARY OF HOT GAPS FOR THE TN-40HT CASK |
| TABLE A4.2-25 | MODULUS OF ELASTICITY AND YIELD STRESS (0.5 S ⁻¹ STRAIN RATE) |
| TABLE A4.2-26 | FUEL ASSEMBLY DATA |
| TABLE A4.5-1 | CLASSIFICATION OF TN-40HT MAJOR COMPONENTS |
| TABLE A4.6-1 | RESULTS OF 40 YR ACTIVATION ANALYSIS |
| TABLE A4.6-2 | COMPARISON OF TN-40HT ACTIVITY WITH CLASS A WASTE LIMITS |

**TABLE OF CONTENTS
ADDENDUM**

SECTION A4 – STORAGE SYSTEM (CONT'D)

SECTION A4 FIGURES

- FIGURE A4.2-1 TN-40HT CASK BODY KEY DIMENSIONS
- FIGURE A4.2-2 SHIELD SHELL TO BOTTOM SHIELD PLATE WELD
- FIGURE A4.2-3 SHIELD SHELL TO SHELL FLANGE WELD
- FIGURE A4.2-4 LID OUTER PLATE TO LID SHIELD PLATE WELD
- FIGURE A4.2-5 STEADY TEMPERATURE DISTRIBUTION (SCALED UP TO 725°F MAX.)
- FIGURE A4.2-6 VARIATION OF MODULUS OF ELASTICITY WITH TEMPERATURE
- FIGURE A4.2-7 VARIATION OF YIELD STRESS WITH TEMPERATURE
- FIGURE A4.2-8 FUEL CLADDING GEOMETRY
- FIGURE A4.2-9 SINGLE FUEL ROD MODEL
- FIGURE A4.2-10 DETAILS OF SINGLE FUEL ROD MODEL
- FIGURE A4.2-11 DISPLACEMENT TIME HISTORY RESPONSE
- FIGURE A4.2-12 MAXIMUM PRINCIPLE STRAIN AT TIME OF MAXIMUM RESPONSE
- FIGURE A4.2-13 TN40HT FUEL CLADDING OUTER SURFACE TEMPERATURE
- FIGURE A4.2-14 TN40HT FUEL CLADDING FINITE ELEMENT MODEL
- FIGURE A4.2-15 TN40HT FUEL CLADDING TEMPERATURE DISTRIBUTION
- FIGURE A4.2-16 TN40HT FUEL CLADDING STRESS INTENSITY

**TABLE OF CONTENTS
ADDENDUM**

APPENDIX A4A – STRUCTURAL ANALYSIS OF THE TN-40HT CASK BODY

A4A.1 INTRODUCTION

A4A.2 MATERIAL PROPERTIES DATA

A4A.3 CASK BODY STRUCTURAL ANALYSIS

A4A.3.1 DESCRIPTION

A4A.3.2 ANSYS CASK MODEL

A4A.3.3 INDIVIDUAL LOAD CASES

A4A.3.4 TRUNNION LOCAL STRESSES

A4A.3.5 EVALUATION (LOAD COMBINATION VS. ALLOWABLES)

A4A.3.6 PRESSURE DISTRIBUTION OVER CONTACT AREA OF CASK
FOR IMPACT IN TRANSVERSE DIRECTION

A4A.4 LID BOLT ANALYSIS

A4A.4.1 INTRODUCTION

A4A.4.2 LID BOLT LOAD CALCULATION

A4A.4.3 LID BOLT TEMPERATURE LOADS

A4A.4.4 LID BOLT LOAD COMBINATIONS

A4A.4.5 LID BOLT ADDITIONAL PRYING BOLT FORCE

A4A.4.6 LID BOLT BENDING MOVEMENT BOLT

A4A.4.7 LID BOLT STRESS CALCULATIONS

A4A.4.8 LID BOLT BEARING STRESS (UNDER BOLT HEAD)

A4A.4.9 SUMMARY OF LID BOLT STRESSES

A4A.4.10 MINIMUM ENGAGEMENT LENGTH FOR LID BOLT AND FLANGE

A4A.5 VENT AND DRAIN COVER BOLT ANALYSES

A4A.5.1 INTRODUCTION

A4A.5.2 VENT AND DRAIN BOLT LOAD CALCULATIONS

A4A.5.3 VENT AND DRAIN BOLT INTERNAL PRESSURE LOADS

A4A.5.4 VENT AND DRAIN BOLT TEMPERATURE LOADS

A4A.5.5 VENT AND DRAIN COVER BOLT LOAD COMBINATIONS

A4A.5.6 VENT AND DRAIN COVER BOLT ADDITIONAL PRYING BOLT
FORCE

**TABLE OF CONTENTS
ADDENDUM**

**APPENDIX A4A – STRUCTURAL ANALYSIS OF THE TN-40HT CASK BODY
(CONT'D)**

| | |
|---------|--|
| A4A.5.7 | VENT AND DRAIN COVER BOLT BENDING MOVEMENT BOLT |
| A4A.5.8 | VENT AND DRAIN BOLT STRESS CALCULATIONS |
| A4A.5.9 | SUMMARY OF VENT AND DRAIN BOLT STRESSES |
| 4A.6 | TRUNNION ANALYSIS |
| A4A.6.1 | INTRODUCTION |
| A4A.6.2 | MATERIAL PROPERTIES |
| A4A.6.3 | STRESS CRITERIA |
| A4A.6.4 | TRUNNION STRESS ANALYSIS |
| A4A.6.5 | TRUNNION LOCAL STRESS ANALYSIS |
| A4A.6.6 | CONCLUSIONS |
| A4A.7 | OUTER SHELL |
| A4A.7.1 | INTRODUCTION |
| A4A.7.2 | DESCRIPTION |
| A4A.7.3 | MATERIALS INPUT DATA |
| A4A.7.4 | APPLIED LOADS |
| A4A.7.5 | METHOD OF ANALYSIS |
| A4A.7.6 | ANALYSIS RESULTS |
| A4A.8 | TOP NEUTRON SHIELD BOLTS |
| A4A.8.1 | INTRODUCTION |
| A4A.8.2 | TOP NEUTRON SHIELD COVER BOLT LOAD CALCULATIONS |
| A4A.8.3 | TOP NEUTRON SHIELD COVER BOLT TEMPERATURE LOADS |
| A4A.8.4 | TOP NEUTRON SHIELD COVER BOLT 3G ACCELERATION LOAD |
| A4A.8.5 | TOP NEUTRON SHIELD COVER BOLT LOAD COMBINATIONS |
| A4A.8.6 | TOP NEUTRON SHIELD COVER BOLT STRESS CALCULATIONS |
| A4A.8.7 | SUMMARY OF TOP NEUTRON SHIELD COVER BOLT STRESSES |

**TABLE OF CONTENTS
ADDENDUM**

**APPENDIX A4A – STRUCTURAL ANALYSIS OF THE TN-40HT CASK BODY
(CONT'D)**

A4A.9 FRACTURE TOUGHNESS

- A4A.9.1 FRACTURE TOUGHNESS REQUIREMENTS OF THE CASK
CONTAINMENT BOUNDARY
- A4A.9.2 FRACTURE TOUGHNESS EVALUATION OF CASK
COMPONENTS AND WELDS
- A4A.9.3 METHODOLOGY
- A4A.9.4 LOADINGS
- A4A.9.5 MATERIAL FRACTURE TOUGHNESS
- A4A.9.6 FRACTURE TOUGHNESS CRITERIA
- A4A.9.7 STRESS INTENSITY FACTOR CALCULATIONS
- A4A.9.8 CONCLUSIONS

A4A.10 TN-40HT STORAGE CASK END DROP ANALYSIS

- A4A.10.1 FINITE ELEMENT MODEL DESCRIPTION
- A4A.10.2 MATERIAL PROPERTIES
- A4A.10.3 BOUNDARY CONDITIONS
- A4A.10.4 INITIAL CONDITIONS AND LOADING
- A4A.10.5 RESULTS OF LS DYNA ANALYSES

A4.11 REFERENCES

**TABLE OF CONTENTS
ADDENDUM****APPENDIX A4A – STRUCTURAL ANALYSIS OF THE TN-40HT CASK BODY
(CONT'D)****APPENDIX A4A TABLES**

| | |
|---------------|--|
| TABLE A4A.2-1 | MECHANICAL PROPERTIES OF CASK BODY MATERIALS |
| TABLE A4A.3-1 | NORMAL AND HYPOTHETICAL ACCIDENT CONDITION INDIVIDUAL LOADS |
| TABLE A4A.3-2 | SUMMARY MAXIMUM NODAL STRESS INTENSITIES IN CASK COMPONENTS |
| TABLE A4A.4-1 | BOLT SPECIFICATIONS AND DESIGN LOADS |
| TABLE A4A.4-2 | DESIGN PARAMETERS FOR LID CLOSURE BOLTS |
| TABLE A4A.4-3 | ALLOWABLE STRESSES IN LID CLOSURE BOLTS FOR NORMAL CONDITIONS |
| TABLE A4A.4-4 | ALLOWABLE STRESSES IN LID CLOSURE BOLTS FOR ACCIDENT CONDITIONS |
| TABLE A4A.4-5 | LID BOLT INDIVIDUAL LOAD SUMMARY |
| TABLE A4A.4-6 | LID BOLT LOAD COMBINATIONS |
| TABLE A4A.4-7 | LID BOLT STRESS SUMMARY |
| TABLE A4A.5-1 | ALLOWABLE STRESSES IN VENT/DRAIN AND TOP NEUTRON SHIELDBOLTS FOR NORMAL CONDITIONS |
| TABLE A4A.5-2 | ALLOWABLE STRESSES IN VENT/DRAIN AND TOP NEUTRON SHIELDBOLTS FOR ACCIDENT CONDITIONS |
| TABLE A4A.5-3 | VENT AND DRAIN COVER BOLT INDIVIDUAL LOAD SUMMARY |
| TABLE A4A.5-4 | VENT AND DRAIN COVER BOLT LOAD COMBINATION |
| TABLE A4A.5-5 | VENT AND DRAIN COVER BOLT STRESS SUMMARY |
| TABLE A4A.6-1 | SUMMARY OF UPPER TRUNNION STRESSES (YIELD STRENGTH CASE) |
| TABLE A4A.6-2 | SUMMARY OF UPPER TRUNNION STRESSES (ULTIMATE STRENGTH CASE) |

**TABLE OF CONTENTS
ADDENDUM****APPENDIX 4A – STRUCTURAL ANALYSIS OF THE TN-40 CASK BODY (CONT'D)****APPENDIX A4A TABLES (CONT'D)**

| | |
|---------------|--|
| TABLE A4A.6-3 | UPPER TRUNNION SHIELD SHELL LOCAL STRESS SUMMARY FOR 3G LIFTING LOAD |
| TABLE A4A.6-4 | UPPER TRUNNION LOCAL STRESS DUE TO 3G LONGITUDINAL LIFTING LOAD |
| TABLE A4A.7-1 | MAXIMUM STRESS INTENSITIES FOR EACH LOADING CONDITION |
| TABLE A4A.7-2 | STRESS AT WELD LOCATIONS |
| TABLE A4A.8-1 | TOP NEUTRON SHIELD COVER BOLT INDIVIDUAL LOAD SUMMARY |
| TABLE A4A.8-2 | TOP NEUTRON SHIELD COVER BOLT LOAD COMBINATIONS |
| TABLE A4A.8-3 | TOP NEUTRON SHIELD COVER BOLT STRESS SUMMARY |
| TABLE A4A.9-1 | SUMMARY LINEARIZED STRESS COMPONENTS – NORMAL CONDITION |
| TABLE A4A.9-2 | SUMMARY LINEARIZED STRESS COMPONENTS – ACCIDENT CONDITION |
| TABLE A4A.9-3 | SUMMARY STRESS INTENSITY FACTORS FOR NORMAL CONDITION |
| TABLE A4A.9-4 | SUMMARY STRESS INTENSITY FACTORS FOR ACCIDENT CONDITION |

**TABLE OF CONTENTS
ADDENDUM****APPENDIX A4A – STRUCTURAL ANALYSIS OF THE TN-40 CASK BODY (CONT'D)****APPENDIX A4A FIGURES**

| | |
|-----------------|---|
| FIGURE A4A.3-1 | TN-40HT STORAGE CASK FEM REPRESENTATION |
| FIGURE A4A.3-2 | FINITE ELEMENT MODEL—LID OUTER PLATE AND SHIELD PLATE |
| FIGURE A4A.3-3 | FINITE ELEMENT MODEL – SHELL FLANGE |
| FIGURE A4A.3-4 | FINITE ELEMENT MODEL – INNER SHELL AND BOTTOM INNER PLATE |
| FIGURE A4A.3-5 | FINITE ELEMENT MODEL – SHIELD SHELL |
| FIGURE A4A.3-6 | FINITE ELEMENT MODEL – BOTTOM SHIELD |
| FIGURE A4A.3-7 | COUPLING AND BOUNDARY CONDITION |
| FIGURE A4A.3-8 | BOLT PRELOAD AND LID SEATING PRESSURE – LOADING AND DISPLACEMENT BOUNDARY CONDITION |
| FIGURE A4A.3-9 | FABRICATION STRESS – LOADING AND DISPLACEMENT BOUNDARY CONDITIONS |
| FIGURE A4A.3-10 | 1G DOWN – LOADING AND DISPLACEMENT BOUNDARY CONDITIONS |
| FIGURE A4A.3-11 | INTERNAL PRESSURE – LOADING AND DISPLACEMENT BOUNDARY CONDITIONS |
| FIGURE A4A.3-12 | THERMAL STRESS 100° F ENVIRONMENT – LOADING AND DISPLACEMENT BOUNDARY CONDITIONS |
| FIGURE A4A.3-13 | THERMAL STRESS -40° F ENVIRONMENT – LOADING AND DISPLACEMENT BOUNDARY CONDITIONS |
| FIGURE A4A.3-14 | 3G VERTICAL LIFTING – LOADING AND DISPLACEMENT BOUNDARY CONDITIONS |
| FIGURE A4A.3-15 | SEISMIC – LOADING AND DISPLACEMENT BOUNDARY CONDITIONS |
| FIGURE A4A.6-1 | TN-40HT TRUNNION DIMENSIONS |
| FIGURE A4A.6-2 | ILLUSTRATION OF DEFINING FORCES, MOMENTS, AND STRESS LOCATIONS |

**TABLE OF CONTENTS
ADDENDUM**

APPENDIX A4A – STRUCTURAL ANALYSIS OF THE TN-40 CASK BODY (CONT'D)

APPENDIX A4A FIGURES (CONT'D)

| | |
|-----------------|---|
| FIGURE A4A.7-1 | CASK OUTER SHELL AND CONNECTION TO CASK BODY |
| FIGURE A4A.7-2 | FINITE ELEMENT MODEL - BOUNDARY CONDITIONS |
| FIGURE A4A.9-1 | CASK BODY CRITICAL LOCATIONS FOR STRESS AND FRACTURE EVALUATION |
| FIGURE A4A.9-2 | CHARPY V-NOTCH TEST RESULTS FOR SA-266 FORGING |
| FIGURE A4A.10.1 | OVERVIEW OF FINITE ELEMENT MODEL |
| FIGURE A4A.10.2 | OVERVIEW OF TN-40HT CASK FINITE ELEMENT MODEL |
| FIGURE A4A.10.3 | PARTS ANALYZED FOR ACCELERATION TIME HISTORY |
| FIGURE A4A.10-4 | CASK SHELL ACCELERATION TIME HISTORY (350HZ FILTER) |
| FIGURE A4A.10-5 | CASK BOTTOM PLATE ACCELERATION TIME HISTORY (350HZ FILTER) |
| FIGURE A4A.10-6 | CASK BASKET ACCELERATION TIME HISTORY (350HZ FILTER) |

**TABLE OF CONTENTS
ADDENDUM****APPENDIX A4B – STRUCTURAL ANALYSIS OF THE TN-40HT BASKET****A4B.1 INTRODUCTION**

- A4B.1.1 TN-40HT FUEL BASKET GEOMETRY
- A4B.1.2 FUEL BASKET ANALYSIS OVERVIEW
- A4B.1.3 WEIGHT
- A4B.1.4 TEMPERATURE
- A4B.1.5 TN-40HT FUEL BASKET STRESS ANALYSIS

A4B.2 REFERENCES**APPENDIX A4B TABLES**

| | |
|---------------|---|
| TABLE A4B.1-1 | SUMMARY OF INDIVIDUAL LOADS FOR STORAGE CONDITIONS-BASKET |
| TABLE A4B.1-2 | MATERIAL PROPERTIES FOR TN-40HT FUEL BASKET |
| TABLE A4B.1-3 | BASKET STRUCTURAL ALLOWABLE STRESSES, NORMAL CONDITIONS |
| TABLE A4B.1-4 | BASKET STRUCTURAL ALLOWABLE STRESSES, ACCIDENT CONDITIONS |
| TABLE A4B.1-5 | SUMMARY OF BASKET STRESS ANALYSIS RESULTS |
| TABLE A4B.1-6 | SUMMARY OF STRESSES IN FUEL COMPARTMENTS AND RAILS |

APPENDIX A4B FIGURES

| | |
|----------------|---|
| FIGURE A4B.1-1 | TYPICAL TN-40HT BASKET FUEL COMPARTMENT CONFIGURATION |
| FIGURE A4B.1-2 | TN-40HT BASKET LOADING ORIENTATION DEFINITIONS |
| FIGURE A4B.1-3 | BASKET FINITE ELEMENT MODEL |
| FIGURE A4B.1-4 | FUEL COMPARTMENT FINITE ELEMENT MODEL TEMPERATURE DISTRIBUTION 100 °F AMBIENT |

**TABLE OF CONTENTS
ADDENDUM****APPENDIX A4B – STRUCTURAL ANALYSIS OF THE TN-40HT BASKET (CONT'D)****APPENDIX A4B FIGURES (CONT'D)**

| | |
|-----------------|--|
| FIGURE A4B.1-5 | FUEL COMPARTMENT FINITE ELEMENT MODEL TEMPERATURE DISTRIBUTION -40 °F AMBIENT |
| FIGURE A4B.1-6 | TRANSITION RAILS FINITE ELEMENT MODEL TEMPERATURE DISTRIBUTION 100 °F AMBIENT |
| FIGURE A4B.1-7 | TRANSITION RAILS FINITE ELEMENT MODEL TEMPERATURE DISTRIBUTION -40 °F AMBIENT |
| FIGURE A4B.1-8 | BASKET FINITE ELEMENT MODEL APPLIED PRESSURES – 0° AZIMUTH |
| FIGURE A4B.1-9 | BASKET FINITE ELEMENT MODEL APPLIED PRESSURES – 30° AZIMUTH |
| FIGURE A4B.1-10 | BASKET FINITE ELEMENT MODEL APPLIED PRESSURES – 45° AZIMUTH |
| FIGURE A4B.1-11 | BASKET FINITE ELEMENT MODEL APPLIED PRESSURES – 60° AZIMUTH |
| FIGURE A4B.1-12 | BASKET FINITE ELEMENT MODEL APPLIED PRESSURES – 90° AZIMUTH |
| FIGURE A4B.1-13 | NORMAL CONDITION 45° AZIMUTH LATERAL LOAD – FUEL COMPARTMENTS – TOP SURFACE MEMBRANE PLUS BENDING STRESS INTENSITY |
| FIGURE A4B.1-14 | NORMAL CONDITION 45° AZIMUTH LATERAL LOAD – PERIPHERAL RAILS TOP SURFACE MEMBRANE PLUS BENDING STRESS INTENSITY |
| FIGURE A4B.1-15 | THERMAL STRESS ANALYSIS FINITE ELEMENT MODEL – FUEL COMPARTMENT |
| FIGURE A4B.1-16 | THERMAL STRESS ANALYSIS FINITE ELEMENT MODEL – RAILS |
| FIGURE A4B.1-17 | THERMAL STRESS ANALYSIS – MAXIMUM FUEL COMPARTMENT STRESS INTENSITY FOR 100° F AMBIENT TOP SURFACE |

**TABLE OF CONTENTS
ADDENDUM**

APPENDIX A4B – STRUCTURAL ANALYSIS OF THE TN-40HT BASKET (CONT'D)

APPENDIX A4B FIGURES (CONT'D)

- FIGURE A4B.1-18 THERMAL STRESS ANALYSIS – MAXIMUM FUEL
COMPARTMENT STRESS INTENSITY FOR -40° F
AMBIENT BOTTOM SURFACE
- FIGURE A4B.1-19 THERMAL STRESS ANALYSIS – MAXIMUM RAILS
STRESS INTENSITY FOR 100 °F AMBIENT BOTTOM
SURFACE
- FIGURE A4B.1-20 THERMAL STRESS ANALYSIS – MAXIMUM RAILS
STRESS INTENSITY FOR -40 °F AMBIENT BOTTOM
SURFACE
- FIGURE A4B.1-21 INTERFACES FOR TYPICAL FUEL COMPARTMENT
TUBE
- FIGURE A4B.1-22 BOUNDARY CONDITIONS FOR THE BASKET ANALYSIS

SECTION A5 – STORAGE SYSTEM OPERATIONS

- A5.1 OPERATION DESCRIPTION
- A5.1.1 NARRATIVE DESCRIPTION
 - A5.1.2 FLOW SHEETS
 - A5.1.3 IDENTIFICATION OF SUBJECTS FOR SAFETY AND RELIABILITY
ANALYSIS
- A5.2 CONTROL ROOM AND CONTROL AREAS
- A5.3 SPENT FUEL ACCOUNTABILITY PROGRAM
- A5.4 SPENT FUEL TRANSPORT TO ISFSI
- A5.5 SPENT FUEL TRANSFER TO TRANSPORT CASK
- A5.6 REFERENCES

**TABLE OF CONTENTS
ADDENDUM**

SECTION A6 – WASTE MANAGEMENT

- A6.1 DESIGN
- A6.2 REFERENCES

SECTION A7 – RADIATION PROTECTION

- A7.1 ENSURING THAT OCCUPATIONAL RADIATION EXPOSURES ARE AS LOW AS REASONABLY ACHIEVABLE (ALARA)
 - A7.1.1 POLICY CONSIDERATIONS AND ORGANIZATION
 - A7.1.2 DESIGN CONSIDERATIONS
 - A7.1.3 OPERATIONAL CONSIDERATIONS
- A7.2 RADIATION SOURCES
 - A7.2.1 CHARACTERIZATION OF SOURCES
 - A7.2.2 AIRBORNE RADIOACTIVE SOURCES
 - A7.2.3 AXIAL SOURCE DISTRIBUTION
 - A7.2.4 GAMMA SOURCE
 - A7.2.5 NEUTRON SOURCE
 - A7.2.6 FUEL QUALIFICATION
 - A7.2.7 RECONSTITUTED FUEL ASSEMBLIES
- A7.3 RADIATION PROTECTION DESIGN FEATURES
 - A7.3.1 STORAGE SYSTEM DESIGN DESCRIPTION
 - A7.3.2 SHIELDING
 - A7.3.3 AREA RADIATION AND AIRBORNE RADIOACTIVITY MONITORING INSTRUMENTATION
- A7.4 ESTIMATED ONSITE COLLECTIVE DOSE ASSESSMENT
- A7.5 OFFSITE COLLECTIVE DOSE ASSESSMENT
- A7.6 RADIATION PROTECTION PROGRAM
- A7.7 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
- A7.8 REFERENCES

**TABLE OF CONTENTS
ADDENDUM****SECTION A7 – RADIATION PROTECTION (CONT'D)****SECTION A7 TABLES**

| | |
|---------------|---|
| TABLE A7.2-1 | PRAIRIE ISLAND FUEL ASSEMBLY DESIGN CHARACTERISTICS |
| TABLE A7.2-2 | WESTINGHOUSE 14X14 STANDARD FUEL ASSEMBLY HARDWARE CHARACTERISTICS |
| TABLE A7.2-3 | MATERIAL COMPOSITIONS FOR FUEL ASSEMBLY HARDWARE MATERIALS |
| TABLE A7.2-4 | MATERIAL COMPOSITIONS FOR THE WESTINGHOUSE STANDARD 14X14 FUEL ASSEMBLY |
| TABLE A7.2-5 | FUEL INSERTS - MATERIALS AND MASSES |
| TABLE A7.2-6 | RADIOACTIVE INVENTORY FOR 14X14 DESIGN BASIS FUEL ASSEMBLY |
| TABLE A7.2-7 | AXIAL SOURCE TERM PEAKING FACTOR |
| TABLE A7.2-8 | SOURCE DISTRIBUTION FOR 14X14 FUEL ASSEMBLY |
| TABLE A7.2-9 | GAMMA SOURCE TERMS FOR FUEL INSERTS |
| TABLE A7.2-10 | RESPONSE FUNCTION FOR TN-40HT CASK |
| TABLE A7.2-11 | FUEL QUALIFICATION CALCULATIONS FOR TN-40HT CASK\ |
| TABLE A7.2-12 | FUEL QUALIFICATION SENSITIVITY CALCULATIONS FOR TN-40HT CASK |
| TABLE A7.4-1 | OCCUPATIONAL EXPOSURES FOR CASK LOADING, TRANSPORT, AND EMPLACEMENT |
| TABLE A7.4-2 | DESIGN BASIS ISFSI MAINTENANCE OPERATIONS ANNUAL EXPOSURES |
| TABLE A7.4-3 | STATION PERSONAL LOCATION AND DOSE RATES |
| TABLE A7.4-4 | STATION PERSONAL COLLECTIVE DOSE |
| TABLE A7.5-1 | OFFSITE POPULATION: LOCATION, DISTANCE, OCCUPANCY TIME |
| TABLE A7.5-2 | OFFSITE POPULATION: DOSE RATES AND COLLECTIVE DOSE |

**TABLE OF CONTENTS
ADDENDUM**

SECTION A7 – RADIATION PROTECTION (CONT'D)

SECTION A7 FIGURES

FIGURE A7.2-1 AXIAL BURNUP PROFILE FOR DESIGN BASIS FUEL

FIGURE A7.2-2 AXIAL NEUTRON AND GAMMA POWER PROFILES

FIGURE A7.4-A PRAIRIE ISLAND NUCLEAR GEN PLANT SITE LAYOUT
OF THE OWNER CONTROLLED AREA

APPENDIX A7A – TN-40HT CASK DOSE ANALYSIS

A7A.1 SHIELDING DESIGN FEATURES

A7A.2 DISCUSSION AND SUMMARY OF RESULTS

A7A.3 METHODOLOGY

A7A.4 MODEL SPECIFICATION

A7A.4.1 MCNP MODEL FOR NORMAL AND OFF-NORMAL CONDITIONS

A7A.4.2 MCNP MODEL FOR ACCIDENT CONDITIONS

A7A.4.3 MCNP MODEL FOR LONG DISTANCES FROM THE CASK

A7A.4.4 SHIELD REGIONAL DENSITIES

A7A.4.5 NEAR FIELD DOSE RATE CALCULATIONS

A7A.5 NEAR FIELD DOSE RATE CALCULATIONS

A7A.6 FAR FIELD DOSE RATE CALCULATION

A7A.7 OFFSITE DOSE RATE CALCULATIONS

A7A.7.1 MCNP ARRAY METHOD – METHODOLOGY, MODEL AND
ASSUMPTIONS

A7A.7.2 MCNP ARRAY METHOD – DOSE RATE AS A FUNCTION OF
DISTANCE

**TABLE OF CONTENTS
ADDENDUM****APPENDIX A7A – TN-40HT CASK DOSE ANALYSIS (CONT'D)****A7A.8 CONFINEMENT**

- A7A.8.1 CONTAINMENT BOUNDARY
- A7A.8.2 SEALS AND WELDS
- A7A.8.3 CLOSURE
- A7A.8.4 MONITORING OF SYSTEM CONFINEMENT
- A7A.8.5 CONFINEMENT REQUIREMENTS FOR NORMAL CONDITIONS OF STORAGE
- A7A.8.6 CONFINEMENT REQUIREMENTS FOR HYPOTHETICAL ACCIDENT CONDITIONS

A7A.9 REFERENCES**APPENDIX A7A TABLES**

- TABLE A7A.1-1 TN-40HT CASK SHIELD MATERIALS
- TABLE A7A.2-1 SUMMARY OF AVERAGE DOSE RATES
- TABLE A7A.2-2 DOSE RATES AT A DISTANCE FROM ONE TN-40HT CASK
- TABLE A7A.4-1 ANSI STANDARD-6.1.1-1977 FLUX-TO-DOSE FACTORS
- TABLE A7A.4-2 ATOMIC FRACTIONS FOR THE HOMOGENIZED DESIGN BASIS 14X14 FUEL
- TABLE A7A.4-3 SHIELD REGIONAL DENSITIES FOR TN-40HT MCNP MODEL
- TABLE A7A.5-1 TN-40HT NEAR FIELD DOSE RATES – NORMAL AND OFF-NORMAL CONDITIONS
- TABLE A7A.5-2 TN-40HT NEAR FIELD DOSE RATES – NORMAL AND OFF-NORMAL CONDITION
- TABLE A7A.5-3 TN-40HT NEAR FIELD DOSE RATES – NORMAL AND OFF-NORMAL CONDITIONS (DOSE RATES ABOVE AND BELOW THE RADIAL NEUTRON SHIELD)
- TABLE A7A.5-4 TN-40HT NEAR FIELD DOSE RATES – ACCIDENT CONDITIONS

**TABLE OF CONTENTS
ADDENDUM****APPENDIX A7A – TN-40HT CASK DOSE ANALYSIS (CONT'D)****APPENDIX A7A TABLES (CONT'D)**

| | |
|---------------|---|
| TABLE A7A.6-1 | TN-40HT - SINGLE CASK FARFIELD DOSE RATES |
| TABLE A7A.7-1 | TN-40HT ISFSI DETECTOR LOCATIONS FOR SITE DOSE EVALUATION |
| TABLE A7A.7-2 | DOSE RATES AS A FUNCTION OF DISTANCE FROM THE ISFSI |
| TABLE A7A.7-3 | SKYSHINE DOSE RATES AS A FUNCTION OF DISTANCE FROM THE ISFSI |
| TABLE A7A.7-4 | SAS2H SOURCE TERMS AS A FUNCTION OF COOLING TIME |
| TABLE A7A.8-1 | TN-40HT RELEASABLE SOURCE TERM FOR OFF-NORMAL CONDITIONS – DESIGN BASIS 14X14 FUEL\ |
| TABLE A7A.8-2 | TN-40HT RELEASABLE SOURCE TERM FOR ACCIDENT CONDITIONS – DESIGN BASIS 14X14 FUEL |
| TABLE A7A.8-3 | OFF-SITE AIRBORNE DOSES FROM OFF-NORMAL CONDITIONS AT 110 M (INTERNAL + EXTERNAL) |
| TABLE A7A.8-4 | OFF-SITE AIRBORNE DOSES FROM OFF-NORMAL CONDITIONS AT 110 M (EXTERNAL) |
| TABLE A7A.8-5 | OFF-SITE AIRBORNE DOSES FROM ACCIDENT CONDITIONS AT 110 M (INTERNAL) |
| TABLE A7A.8-6 | OFF-SITE AIRBORNE DOSES FROM ACCIDENT CONDITIONS AT 110 M (EXTERNAL) |

**TABLE OF CONTENTS
ADDENDUM**

APPENDIX A7A – TN-40HT CASK DOSE ANALYSIS (CONT'D)

APPENDIX A7A FIGURES

- FIGURE A7A.1-1 TN-40HT CASK SHIELDING CONFIGURATION
- FIGURE A7A.2-1 TN-40HT NORMAL CONDITIONS DOSE POINT LOCATIONS
- FIGURE A7A.4-1 TN-40HT MCNP GAMMA MODEL YZ PLOT
- FIGURE A7A.4-2 TN-40HT MCNP GAMMA MODEL – XY PLOT AT Z=181 CM
- FIGURE A7A.4-3 TN-40HT MCNP QUARTER GAMMA MODEL – XY PLOT AT Z=0 CM
- FIGURE A7A.4-4 TN-40HT FAR FIELD MCNP MODEL
- FIGURE A7A.5-1 TN-40HT CASK SIDE SURFACE DOSE RATES NORMAL AND OFF-NORMAL CONDITIONS
- FIGURE A7A.5-2 TN-40HT CASK PROTECTIVE COVER SURFACE DOSE RATES NORMAL AND OFF-NORMAL CONDITIONS
- FIGURE A7A.5-3 TN-40HT CASK BOTTOM SURFACE DOSE RATES NORMAL AND OFF-NORMAL CONDITIONS
- FIGURE A7A.5-4 TN-40HT CASK DOSE RATES 1 M FROM SIDE SURFACE NORMAL AND OFF-NORMAL CONDITIONS
- FIGURE A7A.5-5 TN-40HT CASK DOSE RATES 2 M FROM SIDE SURFACE NORMAL AND OFF-NORMAL CONDITIONS
- FIGURE A7A5-6 TN-40HT CASK SIDE SURFACE DOSE RATES – ACCIDENT CONDITIONS
- FIGURE A7A.5-7 TN-40HT CASK DOSE RATES 1 M FROM SIDE SURFACE – ACCIDENT CONDITIONS
- FIGURE A7A.5-8 TN-40HT CASK DOSE RATES 2 M FROM SIDE SURFACE – ACCIDENT CONDITIONS
- FIGURE A7A.5-9 TN-40HT CASK LID SURFACE DOSE RATES – NORMAL AND ACCIDENT CONDITIONS
- FIGURE A7A.6-1 TN-40HT CASK – DOSE RATE AS A FUNCTION OF DISTANCE

**TABLE OF CONTENTS
ADDENDUM**

APPENDIX A7A – TN-40HT CASK DOSE ANALYSIS (CONT'D)

APPENDIX A7A FIGURES (CONT'D)

FIGURE A7A.7-1 ARRANGEMENT OF CASKS AND “DETECTORS” IN MCNP
CALCULATION MODEL FOR ISFSI DOSE RATE
ESTIMATES

FIGURE A7A.8-1 LID, VENT PORT AND DRAIN PORT METAL SEALS

FIGURE A7A.8-2 OVERPRESSURE MONITORING SYSTEM PRESSURE
DROP WITH TIME

APPENDIX A7B – TN-40HT SHIELDING EVALUATION COMPUTER INPUT

A7B SAMPLE SHIELDING INPUT FILES

A7B.1 SAS2H INPUT FILE FOR DESIGN BASIS FUEL (IN-CORE ZONE)

A7B.2 MCNP INPUT FOR PRIMARY GAMMA DOSE (NEAR FIELD, NORMAL AND
OFF-NORMAL STORAGE CONDITIONS)

A7B.3 MCNP INPUT FOR PRIMARY GAMMA DOSE (NEAR FIELD, ACCIDENT
STORAGE CONDITIONS)

A7B4 MCNP INPUT FOR GAMMA DOSE (FAR FIELD)

**TABLE OF CONTENTS
ADDENDUM**

SECTION A8 – ACCIDENT ANALYSIS

A8.1 OFF-NORMAL OPERATIONS

A8.1.1 LOSS OF ELECTRICAL POWER

A8.1.2 RADIOLOGICAL IMPACT FROM OFF-NORMAL OPERATIONS

A8.2 ACCIDENTS

A8.2.1 EARTHQUAKE

A8.2.2 EXTREME WIND

A8.2.3 FLOOD

A8.2.4 EXPLOSION

A8.2.5 FIRE

A8.2.6 INADVERTENT LOADING OF A NEWLY DISCHARGED FUEL
ASSEMBLY

A8.2.7 CASK SEAL LEAKAGE

A8.2.8 HYPOTHETICAL CASK DROP ACCIDENT

A8.2.9 LOSS OF CONFINEMENT BARRIER

A8.3 SITE CHARACTERISTICS AFFECTING SAFETY ANALYSIS

A8.4 REFERENCES

**TABLE OF CONTENTS
ADDENDUM**

SECTION A9 – CONDUCT OF OPERATIONS

A9.1 ORGANIZATIONAL STRUCTURE

- A9.1.1 CORPORATE ORGANIZATION
- A9.1.2 OPERATING ORGANIZATION, MANAGEMENT AND ADMINISTRATIVE CONTROL SYSTEM
- A9.1.3 PERSONNEL QUALIFICATION REQUIREMENTS
- A9.1.4 LIAISON WITH OUTSIDE ORGANIZATIONS

A9.2 STARTUP TESTING AND OPERATION

- A9.2.1 ADMINISTRATIVE PROCEDURES FOR CONDUCTING TEST PROGRAM
- A9.2.2 TEST PROGRAM DESCRIPTION
- A9.2.3 TEST DISCUSSION
- A9.2.4 COMPLETION OF PRE-OPERATIONAL TEST PROGRAM

A9.3 TRAINING PROGRAM

A9.4 NORMAL OPERATIONS

- A9.4.1 PROCEDURES
- A9.4.2 RECORDS

A9.5 EMERGENCY PLANNING

A9.6 PHYSICAL SECURITY PLAN

A9.7 ADDITIONAL FABRICATION TESTING AND INSPECTIONS

- A9.7.1 CHARPY IMPACT TESTING
- A9.7.2 WELDING REQUIREMENTS AND INSPECTIONS
- A9.7.3 NEUTRON ABSORBER REQUIREMENTS
- A9.7.4 NEUTRON ABSORBERS ACCEPTANCE TESTING
- A9.7.5 QUALIFICATION TESTING OF METAL MATRIX COMPOSITES
- A9.7.6 PROCESS CONTROLS FOR METAL MATRIX COMPOSITES
- A9.7.7 RADIAL NEUTRON SHIELDING TESTS
- A9.7.8 FABRICATION LEAK TEST REQUIREMENTS

**TABLE OF CONTENTS
ADDENDUM**

SECTION A9 – CONDUCT OF OPERATIONS (CONT'D)

A9.8 AGING MANAGEMENT

- A9.8.1 AGING MANAGEMENT REVIEW
- A9.8.2 ISFSI INSPECTION AND MONITORING ACTIVITIES PROGRAM
- A9.8.3 TIME-LIMITED AGING ANALYSES
- A9.8.4 HIGH BURNUP FUEL MONITORING PROGRAM

A9.9 REFERENCES

SECTION A9 TABLES

- TABLE A9.7-1 THERMAL CONDUCTIVITY FOR SAMPLE NEUTRON ABSORBERS
- TABLE A9.7-2 SAMPLE DETERMINATION OF THERMAL CONDUCTIVITY ACCEPTANCE CRITERION

SECTION A10 – OPERATING CONTROLS AND LIMITS

**TABLE OF CONTENTS
ADDENDUM**

SECTION A11 – QUALITY ASSURANCE

A11.1 QUALITY ASSURANCE PROGRAM DESCRIPTION

- A11.1.1 ORGANIZATION
- A11.1.2 QUALITY ASSURANCE PROGRAM
- A11.1.3 DESIGN CONTROL
- A11.1.4 PROCUREMENT DOCUMENT CONTROL
- A11.1.5 INSTRUCTIONS, PROCEDURES AND DRAWINGS
- A11.1.6 DOCUMENT CONTROL
- A11.1.7 CONTROL OF PURCHASED MATERIALS, EQUIPMENT AND SERVICES
- A11.1.8 IDENTIFICATION AND CONTROL OF MATERIALS, PARTS AND COMPONENTS
- A11.1.9 CONTROL OF SPECIAL PROCESSES
- A11.1.10 INSPECTION
- A11.1.11 TEST CONTROL
- A11.1.12 CONTROL OF MEASURING AND TEST EQUIPMENT
- A11.1.13 HANDLING, STORAGE AND SHIPPING
- A11.1.14 INSPECTION, TEST AND OPERATING STATUS
- A11.1.15 NON-CONFORMING MATERIALS, PARTS OR COMPONENTS
- A11.1.16 CORRECTIVE ACTION
- A11.1.17 QUALITY ASSURANCE RECORDS
- A11.1.18 AUDITS

SECTION A11 – QUALITY ASSURANCE

A11.2 QUALITY ASSURANCE PROGRAM – CONTRACTORS

- A11.2.1 ARCHITECT-ENGINEER
- A11.2.2 CASK SUPPLIER
- A11.2.3 CONCRETE STORAGE PAD CONTRACTOR

A11.3 REFERENCES

SECTION 1**INTRODUCTION AND GENERAL DESCRIPTION OF STORAGE SYSTEM****1.1 INTRODUCTION**

Discharged spent fuel assemblies from Prairie Island Nuclear Generating Plant, Units 1 and 2, are currently stored on-site in a spent fuel pool. The spent fuel pool provides for long term storage of 1,386 assemblies in high-density storage racks. Typically, 48 spent fuel assemblies per unit are discharged to the spent fuel pool each cycle, which occurs approximately every 16 months. Section 3.1.1 provides a detailed description of the spent fuel. Additional information is contained in the Prairie Island Updated Safety Analysis Report (USAR) (Reference 1).

Under the current fuel cycle management strategy, the spent fuel pool will lose capacity for discharge of a full core in 1993. Storage capacity will be exhausted completely in 1994. Accordingly, additional spent fuel storage capacity is needed.

To support this need and provide storage until the Department of Energy (DOE) accepts title to spent fuel under the requirements of the Nuclear Waste Policy Act of 1982, as amended in 1987, Northern States Power Company (NSP) requested permission to build and operate an on-site Independent Spent Fuel Storage Installation (ISFSI) in compliance with restrictions and requirements of 10CFR72.

NSP chose the TN-40 and TN-40HT dry cask storage system designed by Transnuclear, Inc. The TN-40 system is more fully described in Sections 3.3 and 4.2.3 and Appendix 4A.

The TN-40HT system is described in Addendum A. The Sections in Addendum A also contain the analyses and evaluations associated with the design and operation of the TN-40HT system.

The Prairie Island ISFSI includes an Equipment Storage Building which will be used to store the cask lifting yoke and transport vehicle.

Construction of the ISFSI is scheduled to commence in March 1992. The ISFSI is scheduled to begin operation in February 1993.

The capacity of the ISFSI will enable Prairie Island to store an additional 1,920 spent fuel assemblies in 48 casks. The ISFSI will provide adequate capacity to enable Units 1 and 2 to continue operation until expiration of their respective Operating Licenses in 2013 and 2014.

01244873

01244873

The ISFSI will be licensed in accordance with the requirements set forth in 10CFR72, Licensing Requirements for the Independent Storage of Spent Nuclear Fuel and High-Level Radioactive Waste. This Safety Analysis Report has been prepared pursuant to guidelines contained in Regulatory Guide 3.62 (Reference 2). An amendment to the Prairie Island Operating License and Technical Specifications will also be required to provide for cask handling and fuel loading in the Auxiliary Building and spent fuel pool.

Per the requirements of 10CFR72, a Safety Evaluation addressing the impact of the operation of the Prairie Island ISFSI on the Prairie Island Nuclear Generating Plant was completed (Reference 5). This Safety Evaluation, prepared in accordance with the requirements of 10CFR50.59, concludes that operation of the ISFSI will not pose an undue risk to the safe operation of the Prairie Island Nuclear Generating Plant.

1.2 GENERAL DESCRIPTION OF LOCATION

The Prairie Island Nuclear Generating Plant site encompasses about 578 acres and is located within the city limits of Red Wing, Minnesota, in Goodhue County. Northern States Power Company, Minnesota (NSPM^{*}) owns most of the land in the site in fee. The U.S. Army Corps of Engineers controls the land that is not owned by NSPM. The Corps has entered into an agreement with NSPM to prevent residential construction on this land for the life of the power plant.

The Prairie Island site is located on a low island terrace associated with the Mississippi flood plain. It is surrounded by the Vermillion River on the west and by the Mississippi River on the east. The site has been evaluated under the criteria of 10CFR100 prior to issuance of an Operating License for each unit (References 3 and 4).

NSP began commercial operation of Prairie Island Nuclear Generating Plant Units 1 and 2, on December 16, 1973, and December 21, 1974, respectively. Westinghouse Electric Corporation designed and supplied the nuclear steam supply system for each unit. Each reactor was originally rated at 1,650 MWt, which is equivalent to approximately 575 MWe (gross), and was uprated in 2010 through a measurement uncertainty recapture power uprate to 1,677 MWt, which is equivalent to approximately 584 MWe (gross) (Reference 8). A complete description of the power plants is contained in the Prairie Island USAR.

Figure 1.2-1 shows the location of the ISFSI and cask transporter access road in relation to other facilities on the Prairie Island site. The protected area fence surrounding the ISFSI is within the Prairie Island site boundary and exclusion area. The controlled area, which is required by 10CFR72.106 to be established around the ISFSI, corresponds to the site exclusion area boundary. Earthen berms surrounding the ISFSI provide radiological shielding.

^{*} Northern States Power Company was incorporated in Minnesota as a wholly owned subsidiary of Xcel Energy, Inc. effective August 18, 2008.

THIS PAGE IS LEFT INTENTIONALLY BLANK

1.3 GENERAL STORAGE SYSTEM DESCRIPTION

Figure 1.3-1 shows the general arrangement of the ISFSI. Two concrete pads provide for two parallel rows of 12 casks per row on each pad. Both concrete pads will be installed prior to initial operation of the ISFSI in order to minimize future dose and security considerations resulting from staged construction. Casks will be placed on the concrete storage pads in a sequence which will provide for future access to any individual cask.

Each storage cask consists of the following components:

- basket assembly for support of the fuel assemblies
- containment vessel enclosing basket assembly and fuel
- gamma shield
- neutron shield
- outer shell
- weather cover
- pressure monitoring system
- trunnions

A set of reference drawings is presented in Figures 1.3-2 through 1.3-7. The casks are self-supporting cylindrical vessels. Dimensions and design characteristics are shown in Table 1.3-1. Table 1.3-2 is a list of components of the TN-40 cask.

The containment vessel for the TN-40 cask consists of: an inner shell which is a welded, carbon steel cylinder with an integrally-welded, carbon steel bottom closure; a welded flange forging; a flanged and bolted carbon steel lid with bolts; and penetration assemblies with bolts. The overall containment vessel length is 175.0 in. with a wall thickness of 1.5 in. The cylindrical cask cavity has a diameter of 72.0 in. and a length of 163.0 in.

There are two penetrations through the containment vessel, both in the lid: one is for a drain opening and the other is for venting. A double-seal mechanical closure is provided for each penetration. The containment lid is 4.50 in. thick and is fastened to the body by 48 bolts. Double metallic O-ring seals with interspace leakage monitoring are provided for lid closure. The interspace between the metallic seals is monitored and pressurized with helium to a higher level than the cavity so that any seal leakage would be into rather than out of the cavity. For additional protection a toruspherical weather cover with a viton O-ring is provided above the lid.

A gamma shield is provided around the walls of the containment vessel by an independent shell of carbon steel which is welded to a bottom shield plate and to the closure flange. The gamma shield completely encloses the containment vessel inner shell and bottom closure.

Neutron shielding is provided by a resin compound surrounding the body. The resin compound is enclosed in long, slender aluminum containers. The array of resin-filled containers is enclosed within a smooth outer steel shell constructed of two half cylinders. In addition to serving as neutron shield containers, the aluminum also provides a conduction path for heat transfer from the cask body to the outer shell. A disk of polypropylene is attached to the cask lid to provide neutron shielding during storage.

The basket structure consists of an assembly of stainless steel cells joined by a proprietary fusion welding process and separated by aluminum and poison plates which form a sandwich panel. The panel consists of two 0.25 in. thick aluminum plates which sandwich a poison plate 0.075 in. thick. The aluminum provides the heat conduction paths from the fuel assemblies to the cask cavity wall. The poison material provides the necessary criticality control. This method of construction forms a very strong honeycomb-like structure of cell liners which provide compartments for 40 fuel assemblies. The open dimension of each cell is 8.05 in. x 8.05 in. which provides a minimum of 1/8 in. clearance around the fuel assemblies. The overall basket length (160 in.) is less than the cask cavity length to allow for thermal expansion and fuel assembly handling.

The cask cavity surfaces and the outer shell have a sprayed metallic coating of Zn/Al for corrosion protection. The external surfaces of the cask are also painted for ease of decontamination. A stainless steel overlay is applied to the O-ring seating surfaces on the body.

Four trunnions are attached to the cask body for lifting and rotation of the cask. Two of the trunnions are located near the top of the body and two near the lower end of the body. The lower trunnions may be used for rotating the unloaded cask between vertical and horizontal positions.

An Equipment Storage Building is located on the ISFSI site. Figure 1.3-8 shows the plan and elevation drawings for this building. The building is a steel frame structure with painted steel walls and roof panels. Two smaller block buildings house the security system equipment and the alarm monitoring equipment.

The ISFSI is surrounded by 8 ft. high security and nuisance chain link fences. In addition, a 17 ft. high earthen berm surrounds the ISFSI, except for the access road opening. The berm is designed for radiation shielding but also visually screens the facility from plant exclusion area boundaries.

The ISFSI is designed as a passive installation with no requirement for active controls. The facility is not continuously staffed. Periodic surveillance of the facility will be performed as described in Section 10.3 and the ISFSI Technical Specifications.

1.4 IDENTIFICATION OF AGENTS AND CONTRACTORS

Transnuclear, Inc. was contracted to provide the casks for use in the ISFSI. Transnuclear is responsible for the design of the casks. Transnuclear subcontracted the fabrication, testing, and delivery of the casks.

Stone & Webster Engineering Corporation was contracted to provide engineering design of the ISFSI, excluding the casks, and to assist in the preparation of the license application, excluding the Security Plan. Stone & Webster also developed a specification used by NSP for cask transport vehicle procurement.

Ederer, Inc. was contracted to provide a cask transport vehicle for use in transporting the casks from the Auxiliary Building to the ISFSI. Ederer is responsible for the fabrication, testing, and delivery of the transport vehicle. The design of the transport vehicle was subcontracted to Nova-Tech Engineering.

Northern States Power Company, Minnesota (NSPM) is responsible for all equipment procurement, development of security plans, construction management and construction services using specialty subcontractors, as required.

THIS PAGE IS LEFT INTENTIONALLY BLANK

1.5 REFERENCES

1. Northern States Power Company, Prairie Island Nuclear Generating Plant Updated Safety Analysis Report, Revision 10, Docket 50-282 (Unit 1) and 50-306 (Unit 2).
2. U.S. Nuclear Regulatory Commission, Regulatory Guide 3.62, Standard Format and Content for the Safety Analysis Report for On-site Storage of Spent Fuel Casks, February 1989.
3. U.S. Atomic Energy Commission, Prairie Island Nuclear Generating Plant, Unit 1, Facility Operating License, License No. DPR-42, August 9, 1973
4. U.S. Atomic Energy Commission, Prairie Island Nuclear Generating Plant, Unit 2, Facility Operating License, License No. DPR-60, October 29, 1974
5. Northern States Power Company, Prairie Island Nuclear Generating Plant Safety Evaluation No. 344, Independent Spent Fuel Storage Installation, May 4, 1993.
6. Safety Evaluation 72-448, TN-40 Cask Weight/Storage Slab Design, May 4, 1996.
7. Safety Evaluation 72-423, TN-40 Cask Lid Alignment Pin Material, October 31, 1995.
8. Letter, T. Wengert (NRC) to M. Schimmel (NSPM), Prairie Island Nuclear Generating Plant, Units 1 and 2 – Amendment Re: Measurement Uncertainty Recapture Power Uprate,” August 18, 2010.

THIS PAGE IS LEFT INTENTIONALLY BLANK

**TABLE 1.3-1
DIMENSIONS AND WEIGHT OF TN-40 CASK**

| | |
|--|---------|
| Overall length (with protective cover, in.) | 202.00 |
| Outside diameter (in.) | 103.50 |
| Cavity Diameter (in.) | 72.00 |
| Cavity length (in.) | 163.00 |
| Body wall thickness (in.) | 9.50 |
| Lid thickness (in.) | 10.50 |
| Bottom thickness (in.) | 10.25 |
| Resin compound thickness (in.) | 4.26 |
| Outer shell thickness (in.) | 0.50 |
| Top neutron shield (in.) | 4.50 |
| Cask weight: | |
| Loaded on storage pad (lbs.)(1) | 240,690 |
| Loaded on Auxiliary Building crane hook (lbs.) | 237,533 |

- (1) Actual weight(s) will vary. Fully loaded cask weight is 244,000 lbs. max.
(Reference 6).

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 10

TABLE 1.3-2
LIST OF TN-40 CASK COMPONENTS

| <u>Item No.</u> | <u>No. Req'd</u> | <u>Shown On Figure No.</u> | <u>Description</u> | <u>Material</u> |
|-----------------|------------------|----------------------------|--------------------------------|---|
| 1 | 1 | 1.3-2 | Shell | SA-105 or SA-516, Gr 70 (Note 1) |
| 2 | 1 | 1.3-2 | Lid | SA-350, Gr LF3 |
| 3 | 1 | 1.3-2 | Inner Containment | SA-203, Gr D or Gr E |
| 4 | 1 | 1.3-2 | Bottom | SA-105 or SA-516, Gr 70 (Note 1) |
| 5 | 1 | 1.3-2 | Bottom Inner Containment | SA-203, Gr D or Gr E |
| 6 | 2 | 1.3-2 | Upper Trunnion | SA-105 or SA-266 Class 4 |
| 7 | 2 | 1.3-2 | Lower Trunnion | SA-105 or SA-266 Class 4 |
| 8 | 1 | 1.3-2 | Radial Neutron Shield | Borated Polyester |
| 9 | 1 | 1.3-2 | Outer Shell | SA-516, Gr 55 (Note 2) |
| 10 | 1 | 1.3-2 | Protective Cover | SA-516, Gr 55 (Note 3) |
| 11 | 1 | 1.3-2 | Top Neutron Shield | Polypropylene SA-516, Gr 55 Shell (Note 2) |
| 12 | 60 | 1.3-3 | Radial n-Shield Box | Aluminum Alloy |
| 13 | 48 | 1.3-4 | Lid Bolt | SA-320, Gr L43 |
| 14 | 48 | 1.3-4 | Protective Cover Bolt | SA-193, Gr B-8 |
| 15 | 1 | 1.3-4 | Lid Seal | Aluminum Jacketed Double Metallic O-ring |
| 16 | 1 | 1.3-4 | Protective Cover Seal | Viton O-ring |
| 17 | 1 | 1.3-2 | Over Pressure Port Cover | SA-240, TP 304 |
| 18 | 1 | 1.3-2 | Over Pressure Port Cover Seal | Aluminum Jacketed Single Metallic O-ring |
| 19 | 8 | 1.3-2 | Top Neutron Shield Bolt | SA-193, Gr B-8 |
| 20 | 1 | 1.3-2 | Over Pressure Tank | SA-106, Gr B Pipe; SA-234 Caps |
| 21 | 1 | 1.3-2 | Drain Port Cover | SA-240, TP 304 |
| 22 | 1 | 1.3-2 | Vent Port Cover | SA-240, TP 304 |
| 23 | 2 | 1.3-2 | Drain and Vent Port Cover Seal | Aluminum Jacketed Double Metallic O-ring |
| 24 | 11 | 1.3-2 | Drain and Vent Port Cover Bolt | SA-193, Gr B-8 |
| 25 | 4 | 1.3-2 | Over Pressure Port Cover Bolts | SA-193, Gr B-8 |
| 26 | 1 | 1.3-2 | Lid Alignment Pin | A-193 Gr B16 (Note 4) |
| 27 | 40 | 1.3-7 | Fuel Compartment | SA-240, TP 304 |
| 28 | 78 | 1.3-7 | Aluminum Plate | 6061, T651 |
| 29 | 78 | 1.3-7 | Poison Plate | boral |
| 30 | 1 | 1.3-4 | Shield Plate | SA-105 or SA-516, Gr 70 |

Notes:

Note 1: SA-266 Class 4 is an equivalent substitution for SA-105.

Note 2: or equivalent.

Note 3: or equivalent.

Note 4: A 479 Type 316 or similar low carbon steel is preferred (Reference 7).

Security-Related Information Figure Withheld Under 10 CFR 2.390.

Figure 1.2-1
ISFSI SITE LOCATION
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

ISFSI SITE LOCATION

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

| | | | |
|-----------|-----|-----------|----------|
| DRAWN BY: | VLS | REVISION: | 2 |
| PAGE NO. | | DATE: | 03-28-06 |

FIG1.2-1

ISFSI SITE PLAN

Security-Related Information Figure
Withheld Under 10 CFR 2.390.

Figure 1.3-1

ISFSI SITE PLAN

PRAIRIE ISLAND ISFSI Rev 3 4/94
SAFETY ANALYSIS REPORT

8 7/24 SEE DCN 1092-162 JB PS PS LA 1

Security-Related Information Figure
Withheld Under 10 CFR 2.390.

| | | | | | | | | |
|-----|-----|------------------|-----|----|----|----|----|---|
| 7 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 6 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 5 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 4 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 3 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 2 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 1 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 0 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 1 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 2 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 3 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 4 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 5 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 6 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 7 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 8 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 9 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 10 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 11 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 12 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 13 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 14 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 15 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 16 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 17 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 18 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 19 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 20 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 21 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 22 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 23 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 24 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 25 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 26 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 27 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 28 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 29 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 30 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 31 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 32 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 33 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 34 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 35 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 36 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 37 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 38 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 39 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 40 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 41 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 42 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 43 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 44 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 45 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 46 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 47 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 48 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 49 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 50 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 51 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 52 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 53 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 54 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 55 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 56 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 57 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 58 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 59 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 60 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 61 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 62 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 63 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 64 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 65 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 66 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 67 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 68 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 69 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 70 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 71 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 72 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 73 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 74 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 75 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 76 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 77 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 78 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 79 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 80 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 81 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 82 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 83 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 84 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 85 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 86 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 87 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 88 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 89 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 90 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 91 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 92 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 93 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 94 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 95 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 96 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 97 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 98 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 99 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |
| 100 | REV | SEE DCN 1092-162 | JTB | AS | PS | PS | LA | 1 |

TRANSNUCLEAR, INC.
MEMPHIS, TN

TN-40 DRY STORAGE CASK
LONGITUDINAL SECTION

FIG 1.3-2_REV_8

TN-40 DRY STORAGE CASK LONGITUDINAL SECTION

NORTHERN STATES POWER COMPANY
Prairie Island Nuclear Generating Plant
180 WINDY HARBOR AV
PRAIRIE ISLAND NUCLEAR GENERATING PLANT

DRAWN BY: VLS
PAGE NO.
REVISION: 8
DATE: 03-28-06

FIG1.3-2_REV_8

Security-Related Information Figure
Withheld Under 10 CFR 2.390.

[illegible]

FIGURE 1.3-3

REVISION 8 10/99

TN-40 DRY STORAGE LID ASSEMBLY & DETAILS

Security-Related Information Figure
 Withheld Under 10 CFR 2.390.


| | | | | | | | |
|---|---------|------------------|-----------|----|----|----|-----|
| 5 | 7/1/04 | SEE DEN 1072-163 | JTG | PS | PS | PS | A-2 |
| 4 | 1/10/04 | SEE DEN 1072-160 | JTG | PS | PS | PS | B-2 |
| 3 | 1/10/04 | SEE DEN 1072-158 | JTG | PS | PS | PS | A-1 |
| 2 | 1/10/04 | SEE DEN 1072-156 | JTG | PS | PS | PS | A-1 |
| 1 | 1/10/04 | SEE DEN 1072-154 | JTG | PS | PS | PS | A-1 |
| 0 | 1/10/04 | SEE DEN 1072-152 | JTG | PS | PS | PS | A-1 |
| <div> <div>APPROVED</div> <div>DATE</div> <div> </div> </div> <div> <div> </div> <div> </div> </div> | | | | | | | |
| <div> TRANSNUCLEAR, INC. <small>CHICAGO, IL</small> </div> <div> TN-40 DRY STORAGE CASK LID ASSEMBLY & DETAILS </div> <div> <div> </div> <div> </div> </div> | | | | | | | |
| JTG | 1/10/04 | 40, 44, D | 1002-20-3 | 5 | | | |

FIGURE 1.3-4 REVISION 8 10/99

Security-Related Information Figure Withheld Under 10 CFR 2.390.

FIGURE 1.3-5

REVISION 8 10/99

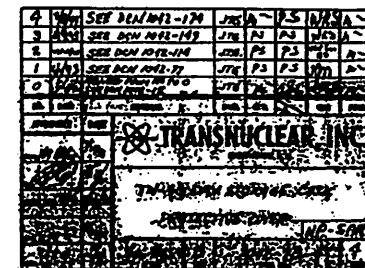

TN-40 DRY STORAGE CASK PRETECTIVE COVER

NORTHERN STATES POWER COMPANY
PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WALK, ILLINOIS 61751

DRAWN BY: VLS
PAGE NO.
REVISION: 8
DATE: 03-28-06


FIG1.3-5_REV_8

TN-40 DRY STORAGE CASK BASKET GENERAL ARRANGEMENT

Security-Related Information Figure
 Withheld Under 10 CFR 2.390.

FIGURE 1.3-6

REVISION 8 10/99

| | | | | | | |
|--|-------|------------------|-----|-------|------|-------|
| 5 | 1/1 | SEE DCR 1042-104 | 022 | 10 | 05 | 10/99 |
| 4 | 4/10 | SEE DCR 1042-78 | 022 | 10 | 05 | 10/99 |
| 3 | 10/99 | SEE DCR 1042-32 | 022 | 10 | 05 | 10/99 |
| 2 | 10/99 | SEE DCR 1042-32 | 022 | 10 | 05 | 10/99 |
| 1 | 10/99 | SEE DCR 1042-32 | 022 | 10 | 05 | 10/99 |
| 0 | 10/99 | SEE DCR 1042-32 | 022 | 10 | 05 | 10/99 |
| NO. | DATE | DESCRIPTION | BY | CHKD. | DATE | BY |
|  TRANSNUCLEAR, INC. PATENTED U.S. TN-40 DRY STORAGE CASK BASKET GENERAL ARRANGEMENT SAR | | | | | | |
| A.E. | 10/99 | | | | | |
| M.H. | 10/99 | | | | | |
| J.T.G. | 10/99 | | | | | |
| NO. | DATE | DESCRIPTION | BY | CHKD. | DATE | BY |
| 1042-70-5 | | | | | | |
| 5 | | | | | | |

Security-Related Information Figure
Withheld Under 10 CFR 2.390.

FIGURE 1.3-7

REVISION 8 10/99

[illegible]

EQUIPMENT STORAGE BUILDING

Security-Related Information Figure
Withheld Under 10 CFR 2.390.

Rev 3 4/94

Figure 1.3-8
EQUIPMENT STORAGE BUILDING
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

SECTION 2

SITE CHARACTERISTICS

2.1 GEOGRAPHY AND DEMOGRAPHY OF SITE SELECTED

2.1.1 SITE LOCATION

Information concerning site geography and demography is contained in the Prairie Island USAR (Reference 1). This information is summarized and supplemented below.

The ISFSI is located within the site boundary of the Prairie Island Nuclear Generating Plant, which encompasses about 578 acres. The Prairie Island site is located in the city limits of the City of Red Wing, Minnesota (population 15,134 according to 1990 census figures) on the west bank of the Mississippi River. The ISFSI site and all appurtenant facilities are located in Section 5, T113N, R15W in Goodhue County, Minnesota, at approximately 92° 37.9' west longitude and 44° 37.3' north latitude.

The ground surface near the Prairie Island site is fairly level to slightly rolling, ranging in elevation from 675 ft. to 706 ft. above mean seal level (msl) (1929 adjustment). The surface slopes gradually toward the Mississippi River to the northeast and Vermillion River on the southwest. Normal water level is 674.5 ft.

Steep bluffs run parallel to this stretch of the Mississippi River and rise to an elevation of over 1,000 ft. above mean sea level approximately 1.5 miles northeast and southwest of the site. Northeast and southwest of these bluffs, the ground elevation above mean sea level ranges from 1,000 to 1,200 ft. and is marked by many eroded coulees.

Figure 2.1-1 is a regional map showing the site location. Figure 2.1-2 is an area map showing topography in the site vicinity. The protected area fence is shown to define the ISFSI site area. The controlled area for the ISFSI, as defined in 10CFR72.3, corresponds to the exclusion area of the nuclear station.

2.1.2 SITE DESCRIPTION

Figure 2.1-3, sheets 1-3, are maps showing local topography in the vicinity of the ISFSI. The figures also show the topography in the vicinity of the access road which will be used for transportation of the casks from the Auxiliary Building to the ISFSI.

The overburden materials in the site are sandy alluvial soils. Vegetation in the site area consists of prairie grass and brush, with some isolated stands of trees. Accordingly, there is potential for grass fires and soil erosion in the vicinity of the ISFSI, although the ISFSI itself is covered with a gravel surface. Additional information concerning soil and vegetative cover is contained in the Environmental Report filed in conjunction with the ISFSI license application.

The Prairie Island Nuclear Generating Plant site and exclusion area is owned in fee by Northern States Power Company, Minnesota with the exception of areas controlled by the U.S. Army Corps of Engineers. The protected area of the ISFSI and the access road connecting the ISFSI and Auxiliary Building is on land owned by NSPM.

01153239

2.1.3 POPULATION DISTRIBUTION AND TRENDS

The nearest population centers are Eagan (1990 population of 47,409) 26 miles northwest of the site; Minneapolis – St. Paul metropolitan area (1990 population of 2,407,090), 30 miles northwest of the site; and Rochester (1990 population of 70,745), 41 miles south of the site. No other population centers with more than 25,000 people lie within 50 miles of the site. Table 2.1-1 shows the estimated 1998 population distribution within a 50 mile radius of the plant. The Environmental Report submitted in conjunction with this license application provides additional information concerning population projections.

2.1.4 USES OF NEARBY LAND AND WATERS

Goodhue County, in which the site is located, and the adjacent counties of Dakota and Pierce (in Wisconsin) are predominantly rural. Dairy products and live stock account for most of the three-county farm products with field crops and vegetables accounting for most of the remainder. Principal crops are corn, oats, hay, soybeans and barley.

The region within a radius of five miles of the site is devoted almost exclusively to agricultural pursuits. Principal crops include soybeans, corn, oats, hay and some cannery crops at about four miles from the plant site. The nearest dairy farm is located more than two miles southwest of the plant site. Some beef cattle are raised approximately two miles southwest of the site. Cattle are on pasture from early June to late September or early October. During the winter, cows are fed on locally produced hay and silage. Beyond the site boundary and within a one-mile radius of the plant, there are approximately 30 permanent residences or summer cottages. The closest occupied offsite residence is approximately 0.45 mi. northwest of the ISFSI site.

Approximately one mile northwest of the ISFSI site, the Mdewakanton Sioux Indian community owns and operates a combination resort hotel/bingo/casino gambling facility. Another business facility consisting of a gasoline station, convenience store and lounge is located about two miles west-northwest of the ISFSI site.

2.2 NEARBY INDUSTRIAL, TRANSPORTATION AND MILITARY FACILITIES

The following industrial facilities (workforce population greater than 30) are located within 5 miles of the ISFSI site (Reference 2):

- Advertising Unlimited, 3-4 miles South
- DB Industries, 3-4 miles SSE
- IRC Industries, 3-4 miles SSE
- Josten's, 3-4 miles SSE
- Dayco PTI, 3-4 miles SSE
- Protein Technologies, 4-5 miles SSE
- RAM Center, Inc., 3-4 miles South
- Red Wing Shoe Company, 3-4 miles SSE
- Republican Eagle (Manufacturing), 4-5 miles SSE
- Riedell Shoe Company, 3-4 miles SSE
- Riviera Cabinets, 3-4 miles SSE
- Central Research Laboratory, 3-4 miles South

No activities at the above facilities present a hazard to the safe operation of the ISFSI.

A buried natural gas supply line from Xcel Gas Energy is located in the west plant area, approximately 864 ft northwest of the ISFSI outer fence at its nearest point. Explosion hazard from this line is bounded by the barge explosion described below.

No military installations are within 5 miles of the ISFSI site. Transportation activities which could potentially have an effect on the ISFSI are described below.

The Red Wing airport is located about 7 miles ESE of the ISFSI site in Bay City, Wisconsin, at 44° 35' 15" north, 92° 29' 30" west. It is at elevation 781 ft. msl and has one asphalt paved runway which is 4,000 ft. long by 75 ft. wide and an adjacent taxiway. The runway designation is 09/27 with a 50/1 glide path. There are 30 aircraft based at the airport.

SAFETY ANALYSIS REPORT

Revision: 17

Page 2.2-2

Railroad traffic occurs on the following railroads, which pass within five miles of the site:

- CP Line Railroad (Soo Line) runs across the southwest portion of the Prairie Island Nuclear Generating Plant site.
- Burlington Northern Railroad runs within 2 miles east of the ISFSI in Wisconsin.

Truck traffic occurs on Minnesota State Highway 61, which runs within 2 ½ miles of the ISFSI site to the south. In addition, a number of country roads and truck highways are located within 5 miles of the site.

Barge traffic occurs on the Mississippi River, which flows in its main channel no closer than ½ mile from the ISFSI site. A transportation accident involving a barge explosion has been postulated as having the worst case impact on the safe operation of the ISFSI. This analysis is considered to conservatively bound the impacts which might be postulated for railroad, highway or barge accidents on the routes described above.

A munitions explosion on a barge at a mid-channel location opposite the plant along the Minnesota-Wisconsin line was analyzed in the Prairie Island USAR. The explosion was postulated to occur at a distance of 2,600 ft. from the existing Prairie Island control room, at a point nearly due east from it. An overestimate of the blast effect is given by assuming impacts calculated at the control room would occur at the ISFSI site, which is farther away from mid-channel.

The size and nature of a hypothetical cargo explosion was postulated in the Prairie Island USAR. It was conservatively assumed that an explosion of a jumbo barge took place. A jumbo barge (195 ft. long, 35 ft. wide, 8 ½ ft. draft), is the largest hauler of dry cargo. It was assumed that the barge was completely laden with 1,400 tons of TNT. It was assumed that this cargo detonated in mid-channel directly opposite the plant. The resulting 1.4 kiloton explosion would be comparable to the Texas City disaster which resulted from detonation of 2 to 4 kilotons of equivalent explosive. Surface detonation of 1.4 kilotons was calculated to result in a peak overpressure of 2 ¼ psi at 2,600 ft. distance, plus minor dynamic pressure due to 78 mph transient wind. Cask design for external pressure is discussed in Section 3.2.5.3.4.

2.3 METEOROLOGY

2.3.1 REGIONAL CLIMATOLOGY

Regional climatology is described in the Prairie Island USAR, Section 2.3. Information from the USAR concerning climatology is summarized and supplemented below.

The climate of the site region is basically continental and influenced by the general storms which move eastward along the northern tier of the United States. The geographical location results in frequent changes in weather systems as polar and tropical air masses alternate. Climatic characteristics are illustrated in Figure 2.3-1 which shows average and extreme temperatures, precipitation, and extreme winds at Minneapolis, Minnesota. Rainfall averages about 25 in. per year, with 65% falling in the months of May through September. Figure 2.3-1, based on records through 1969, shows maximum rainfall during 24 hours was 7.80 inches in July 1892. This record was exceeded in July 1987, when 10.0 in. of rain fell within a 6-hour period (Reference 3). Snowfall averages about 44 in. per year with a maximum of 19.9 in. in 24 hours in January 1982.

Minnesota lies to the north of the principal tornado belt in the United States. During the seven-year period 1963-1969, 15 tornadoes and 21 funnel clouds were reported in the 1° square centered about the site and encompassing nearby Wisconsin and Minnesota. Over 90% of these occurrences were reported in the months of May, June and July. The probability of a tornado striking a point in the 1° square has been calculated to be between 5.8×10^{-3} /year and 3.8×10^{-3} /year with 95% confidence limits. At these confidence limits, the recurrence intervals are between 170 and 260 years. Section 2.3.3.2 of the Prairie Island USAR specifies that the design basis tornado results in a wind speed of 300 mph with a forward progression of 60 mph.

The site area is subject to 30-40 thunderstorm days per year. The number of lightning flashes to ground per year per square mile is estimated to be between 0.05 and 0.8 times the number of thunderstorm days per year (Reference 4).

2.3.2 LOCAL METEOROLOGY

2.3.2.1 DATA SOURCE

Meteorology in the Prairie Island Nuclear Generating Plant site area was evaluated as part of its Operating License application review. This evaluation was based on 25 months of site data from May 1968 to May 1970. The pre-operational meteorological data program is discussed in Section 2.8 of the Prairie Island FSAR (Reference 5). One year of supplemental data for the period June 1, 1971 through May 31, 1972, using NRC recommended delta-T stability classification, is presented in Appendix H of the Prairie Island USAR.

The Prairie Island Nuclear Generating Plant was provided with a new 60 meter meteorological tower in October 1982. Wind speed, direction, and temperature difference instrumentation is located at approximately 10 meters and at the 60 meter level. In addition, temperature and rainfall instruments are installed. The tower is located about 1,500 ft. north of the ISFSI site.

Recent joint frequency distributions for the 10 and 60 meter tower elevation for the period January 1, 1991 through December 31, 1991 are presented in Tables 2.3-1 through 2.3-16 of the Prairie Island USAR. The distributions are for Stability Classes A through G as defined in Regulatory Guide 1.23.

Meteorological data is used to compute dispersion (χ/Q) and deposition (D/Q) factors and is used in the dose assessment of airborne releases in accordance with the requirements of the Offsite Dose Calculation Manual. Wind speed, direction and atmosphere stability class are averaged over the release period and serve as inputs to a dispersion model. Stability class is determined using temperature difference measurements between the 10 meter elevation and the 60 meter level. Tables 2.3-18 and 2.3-19 of the Prairie Island USAR contain a tabulation of annual average dispersion and deposition factors.

2.3.2.2 TOPOGRAPHY

Figure 2.3-2 is a map showing detailed topographic features within an 8 kilometer (5 mile) radius of the ISFSI site.

2.3.3 ONSITE METEOROLOGICAL MEASUREMENT PROGRAM

The meteorological tower is provided with instrumentation at the 10 meter and 60 meter elevations. The location of the tower is shown on Figure 1.2-1. The purpose of this tower is to collect meteorological data for use in the Prairie Island Nuclear Generating Plant Emergency Response Program. Data from the meteorological tower will not be used to estimate offsite concentrations of airborne effluents from the ISFSI, as no credible mechanism for the release of airborne effluents has been postulated.

The potential impact of spent fuel storage at the site of the ISFSI on meteorological measurements at the meteorological tower have been investigated. The investigation considered possible changes in air temperature, wind speed and direction, and turbulent wind fluctuations that could be induced at the tower location by heat dissipation from the storage casks.

It has been concluded that changes in meteorological parameters, as measured at the tower, will generally be insignificant. The thermal energy contributed to surface layer air by the spent fuel will be of the same order of magnitude as natural energy inputs from solar radiation. Turbulent energy production resulting from the facility heat input will normally be much less than natural energy production from boundary layer wind shear at the earth's surface. Accordingly, effects on air motion will be small. Temperature changes in air reaching the meteorological tower are estimated to be a maximum of 1.0 deg K and usually less than 0.25 deg K.

There are approximately 60 hours per year during which winds are directed from the location of the fuel storage facility to the meteorological tower, and during which ambient wind speeds are low with strong stability (Classes E, F and G). During these hours, enhanced turbulence (larger values of sigma theta) and increased temperature (up to 1.0 deg K increase) may be observed at the 10m level of the tower. These effects could result in an inferred stability classification that is more unstable than general ambient conditions. Because of its lower frequency of occurrence, this potential effect is considered to represent only a minor influence on measured site climatology. However, appropriate plant personnel have been made aware of the possibility of misleading indications of site stability during these specific meteorological conditions.

All evaluations assumed maximum heat dissipation from the spent fuel storage facility, and all heat transfer by conduction to the surface air. Both of these assumptions represent worst-case situations, and will seldom if ever be experienced. Thus, it is believed that the analyzed impacts are likely to be overestimates. Under normal operation conditions with typical meteorology, impacts on meteorological measurements will be less than natural variations due to land surface irregularities at the plant site and typical errors in meteorological measurement.

2.3.4 DIFFUSION ESTIMATES**2.3.4.1 BASIS**

No routine or accidental releases are planned or postulated as a result of ISFSI operation. Nevertheless, 1-to-2 hour χ/Q values have been calculated which can be used to estimate radiological doses from the accidental release analyzed in Section 8.2.9.

2.3.4.2 CALCULATIONS

Table 2.3-1 provides a tabulation of short term χ/Q at the site boundary in each of 16 sectors. Table 2.3-2 provides χ/Q values at varying downwind distances. These values were calculated based on the methodology outlined in Regulatory Guide 1.145 (Reference 6). The values are based on an assumed ground level release with 1.0 meter/second wind speed under conditions of moderate stability.

Plume meander under stable atmospheric conditions (Stability Classes E, F and G) is considered in this methodology. No credit for building wake effect was included, due to the distance of the casks from any large structure.

2.4 HYDROLOGY

Hydrology of the Prairie Island Nuclear Generating Plant site area was evaluated as part of its Operating License application review. Information concerning site area hydrology is contained in the Prairie Island USAR, Section 2.4, and Appendix E. Pertinent information is summarized and supplemented below.

2.4.1 SURFACE WATER

The principal surface waters in the vicinity of the site are the Mississippi River, Sturgeon Lake, the Vermillion River and the Cannon River. The levels of the Mississippi River and Sturgeon Lake are controlled by Lock and Dam Number 3 which is located approximately 1 ½ miles downstream from the plant. The normal pool upstream from the dam is at elevation 674.5 ft. The locations of the major streams and gaging stations are shown on Figure 2.4-1. The Vermillion River enters the main stream of the Mississippi below the dam.

There are no withdrawals of river water for supply of city water for at least 300 miles downstream from the site. Minor withdrawals of river water for irrigation purposes do occur, the nearest being 53 miles downstream.

Stream flow records are available for the Mississippi River at Prescott and at Winona, and for the Cannon River at Welch. Figure 2.4-2 shows flow duration curves for the two stations on the Mississippi River.

Table 2.4-1 of the Prairie Island USAR summarizes the consecutive-day low-flow characteristics of the Mississippi River at Prescott. The discharge characteristics of the Mississippi and Cannon Rivers are summarized in Table 2.4-2 of the Prairie Island USAR.

Siting evaluation factors set forth in 10CFR72.90(f) specify that an ISFSI must be sited to avoid to the extent possible the long term and short term adverse impacts associated with the occupancy and modification of floodplains. Floodplains are defined in 10CFR72.3 to mean the lowland and relatively flat areas adjoining inland waters, subject to a 1% or greater chance of flooding in any given year. The 100-year flood level at Prairie Island has been determined to be 687.7 ft. above mean sea level (Reference 7).

The 1965 flood, which is the highest on record, has a recurrence interval of 150 years. The peak stage at Lock and Dam Number 3 during this flood was about 687.8 ft. above mean sea level. A flood having a 1,000-year recurrence interval would have a peak stage of about 693.5 ft. at Lock and Dam Number 3, and a discharge of about 335,000 cfs.

A stream profile of the section of the river near the site is presented in Figure 2.4-3 showing profiles of the highest and lowest flow of record. An approximate longitudinal and land profile of the Prairie Island site is also shown in Figure 2.4-3.

A study to determine the magnitude of the probable maximum flood has been done. The probable maximum flood is the hypothetical flood that would result if all the factors that contribute to generation of the flood were to concurrently reach their most critical values that could occur. The probable maximum flood is derived from hydrometeorological and hydrological studies and is independent of flood frequency. It is the estimate of the boundary between possible floods and impossible floods. Therefore, it would have a return period approaching infinity and a probability of occurrence in any particular year approaching zero.

The maximum discharge calculated for the probable maximum flood was determined to be 910,300 cfs, with a corresponding peak stage of elevation of 703.6 ft. The flood would result from meteorological conditions which could occur in the spring and could reach maximum river level in about 12 days. It was estimated that the flood stage would remain above elevation 695 ft. for approximately 13 days. The detailed results of the study are presented in Appendix F of the Prairie Island USAR. Wind generated waves would be of maximum height when the wind is from east to west in the direction of the circulating water intake canal. With a persistent wind speed of 45 mph the height of the significant wave would be less than 1.8 ft. (crest to trough). The maximum 1% wave height, consistent with the highest significant wave, is estimated to be less than 3.10 ft. Significant and maximum 1% wave height and run-up are defined in "Shore Protection and Planning and Design," Technical Report No. 4, 3rd edition, 1966, U.S. Army Corps of Engineers Coastal Engineering Research Center. If the conservative assumption is made that run-up equals the approaching wave height, then the maximum water level would be 706.7 ft. above mean sea level.

Lock and Dam Number 2 is located 17 miles upstream of the plant site. The dam consists of a 3,250-foot long dike, two single-lift locks with chambers 110 ft. x 600 ft. and 110 ft. x 500 ft., and a spillway section of 20-30 foot-wide tainter gates. The difference in normal pool elevations is 12.2 ft. An accident to the dam could result in a sudden release of water, temporarily producing the effect of a flood in the river channel downstream of the dam.

Flood-like flows could be produced only by a major failure to the spillway section with initial upper and lower pools at their normal elevations. Even then, the storage effect of the lower channel basin and the resulting loss of head in the upper reservoir will greatly attenuate flooding effects at the ISFSI site.

There is no flood hazard resulting from a dam break at Lock and Dam Number 2. This conclusion was substantiated by determining stable water level elevations at Lock and Dam Number 3 resulting from sustained flow with the loss of 10 tainter gates at Lock and Dam Number 2. Sustained flow will maintain the upper pool elevation at Lock and Dam Number 3, and will provide the volume of water needed in the lower pool to produce the maximum pool level consistent with steady flow supplied through 10 spillway bays. The flow resulting from these postulated extreme conditions would produce a river level at an elevation of 684.5 ft. in the lower pool at Lock and Dam Number 2 with a corresponding level in the upper pool at Lock and Dam Number 3 of 676.5 ft.

2.4.2 GROUND WATER

Regionally, the movement of ground water is toward the Mississippi River and its main tributaries. The ground water table slopes from the higher glaciated bedrock areas toward these surface streams, generally at low gradients. Ground water enters the river valley from along the base of the bordering bedrock bluffs in the form of springs or as subsurface flow.

Beneath the flood plains and low terraces which border the Mississippi River, ground water levels closely coincide with the elevations of the river surface, and vary in accordance with river fluctuations. The average ground water gradient in these bottomlands is downstream, and essentially parallel to the stream gradient.

Pool elevation on the Mississippi River adjacent to the site is controlled by Lock and Dam Number 3. The Vermillion River bypasses the dam and therefore is not directly controlled by it. Elevations on the Vermillion River and connected lakes are therefore lower than the Mississippi River and the ground water table slopes southwestward between the two rivers. Due to the permeable nature of the sandy alluvial soils forming Prairie Island, the ground water table responds quickly to changes in river stage.

There is only minor usage of ground water for domestic, agricultural and irrigation purposes near the site or immediately downstream. A deep well believed to penetrate bedrock aquifers exists at Lock and Dam Number 3. The nearest ground water consumption of important magnitude is in the town of Red Wing, six miles downstream. This community derives its water supply from four deep wells which penetrate sandstone aquifers of the Dresbach and Hinckley formations. The wells pump from depths of 400 to 730 ft., and each well is capable of providing the municipal requirements of about 1,400 gpm. A high degree of hardness is characteristic of the water from these wells.

Several industries in the Red Wing area also utilize ground water in quantities exceeding the municipal consumption, and derive their supplies principally from the bedrock aquifers. Total well production from the bedrock at Red Wing probably exceeds 3,000 gpm, and fairly large quantities may also be extracted from the alluvium for certain industrial uses.

SAFETY ANALYSIS REPORT

Revision: 9

Page 2.4-4

Communities further downstream from the plant site which supply their water needs from wells in bedrock are Lake City, 25 river miles downstream, and Wabasha, 37 miles downstream.

A survey of 58 wells in the vicinity of the plant site is summarized in Table 2.4-3 of the Prairie Island USAR. The location of the wells and an outline of the survey area are shown in Figure 2.4-4. Dispersion of effluents entering the ground water system from the plant would take place principally in the upper portion of the saturated zone of the river alluvium. Due to the numerous surface waterways in the vicinity of the site, the majority of effluents would permanently leave the ground water environment and would mix with surface waters at the borders of Prairie Island.

The coefficient of horizontal permeability for the shallow aquifer beneath the site is 1,000 to 4,000 gallons/day/sq. ft. Vertical permeability is about 30% of horizontal permeability. Due to the relatively permeable nature of the soils at the site a path exists to the deeper bedrock aquifers directly below the site. Silt deposits lining the bottom of the river channels, however, have virtually eliminated exposure of the bedrock aquifers to the main stream of the river. There is no reason to believe effluents will penetrate to the depth of bedrock aquifers. It is very unlikely that significant amounts of effluents could succeed in reaching shallow wells at Red Wing by way of continuous ground water paths.

Any possible recharging of the shallow aquifer at Red Wing by river water would be expected to entail dilution of the river water with stored ground water and other sources, time decay of activity, and removal of activities other than tritium by filtration through the soil.

The annual average dilution factor for the Mississippi River at Red Wing considering substantial use of cooling water is about 18. A minimum factor is 3.3 based on the 7-day average low flow having a once-in-ten-year probability of recurrence. Credit is not taken for the relatively minor flows contributed between the site and Red Wing by the Vermillion and Cannon Rivers.

The overall dilution factor before release to the Mississippi River is expected to result in less than 0.1 MPS discharge to the river. Therefore, an overall minimum dilution factor of at least 33 would occur at Red Wing.

2.5 GEOLOGY AND SEISMOLOGY

2.5.1 BASIC GEOLOGIC AND SEISMIC INFORMATION

The geology and seismology of the Prairie Island Nuclear Generating Plant site area was evaluated as part of its Operating License Application review. Information concerning geology and seismology is contained in the Prairie Island USAR, Sections 2.5 and 2.6, and Appendix E, and is summarized and supplemented below.

2.5.1.1 STORAGE SITE GEOMORPHOLOGY

The Prairie Island site is located on a low island terrace associated with the Mississippi River flood plain. It is separated from other parts of the lowland by the Vermillion River on the west, and by the Mississippi on the east. Ground surface elevations range from approximately 675 to 706 ft. Lowland areas near the site are forested or covered by swamp vegetation.

The Mississippi River flood plain in this area is confined within a valley about 3 miles wide. Rocky bluffs and heavily forested slopes rise abruptly from both sides of the valley to a height of about 300 ft. The uplands immediately surrounding the valley reach elevations ranging from approximately 1,000 to 1,200 ft. They are deeply trenched by numerous streams emptying into the Mississippi River.

The overburden materials at the site are permeable sandy alluvial soils which were deposited as glacial outwash and as recent river sedimentation. Preliminary borings made prior to licensing of the Prairie Island Nuclear Generating Plant, such as that shown in Figure 2.5-1 and other borings included in Appendix E of the Prairie Island USAR, have indicated that the overburden soils at the site vary from 158 to 185 ft. thick.

The uppermost bedrock unit at the site is sandstone and is believed to be part of the Franconia formation (See Table 2.5-1 of Prairie Island USAR). Its thickness at this location is unknown, but would be much less than 180 ft., the total measured thickness of the Franconia formation in complete sections. Underneath the Franconia formation are several hundred feet of lower Cambrian and Precambrian sandstone with minor shale horizons.

2.5.1.2 GEOLOGIC HISTORY OF STORAGE SITE AND SURROUNDING REGION

Precambrian granite, gneiss, schist, and volcanics comprise the oldest bedrock in the Minnesota-Wisconsin region. The basement rock is overlain by as much as 800 ft. of Paleozoic sandstone, shale and dolomite. Younger formations originally present in the region have been removed by erosion, and an irregular topography has been developed on the exposed bedrock surface. Except for local areas in southeastern Minnesota and parts of Wisconsin, bedrock is concealed under 100 to 300 ft. of Pleistocene glacial drift. In contrast, the extreme southeastern tip of Minnesota, including the site vicinity, is covered by only a thin veneer of drift. It is therefore considered a part of the "driftless" area commonly referred to by glacial geologists. In this driftless area of Minnesota and central and southwestern Wisconsin, the unconsolidated materials consist primarily of loess, recent alluvium and residual soil. Drainage in the region is controlled by the Mississippi River. The Mississippi River originated as an outlet for early glacial meltwaters. Its major present day tributaries were developed by the draining of glacial lakes at the close of the Pleistocene.

A geologic column showing the thickness and age relationships of the various bedrock units and surficial deposits of the region is presented on the generalized stratigraphic column presented in Table 2.5-1 of the Prairie Island USAR (Reference 1).

The regional extent of the consolidated strata is shown in Figure 2.5-2.

2.5.1.3 SPECIFIC STRUCTURAL FEATURES OF SIGNIFICANCE

The dominant structural feature in Southeastern Minnesota and adjacent areas of Wisconsin and Iowa is the Keweenawan Basin. The basin was formed in early Precambrian time and extended from Lake Superior into Iowa. It provided a site for the deposition of thick sequences of later Precambrian and Paleozoic strata consisting of volcanics and sediments. These beds were gently warped by subsequent compressive forces into several subordinate structures. A large basin in the Paleozoic rocks extended northward from Iowa into the southeastern corner of Minnesota. This basin is separated from a smaller basin in the Twin Cities area by the Afton-Hudson anticline. The anticline begins at Farmington and trends northeastward through Hastings, Minnesota and Hudson Wisconsin. A syncline lies to the east of the structure in the vicinity of River Falls, Wisconsin. Near the extreme southeastern corner of Minnesota, a second anticline extends from Rochester through Red Wing and is postulated to extend a short distance into Wisconsin. The site is located on the west limb of the Red Wing anticline, as evidenced by a gentle westward dip of the bedrock.

Several major faults in the Minnesota-Wisconsin region have been inferred from geophysical surveys. The principal movements along these faults, which amounted to thousands of ft., appear to have been restricted to Precambrian time. The Douglas fault and the Lake Owen fault penetrate Precambrian rocks along the north and south sides of the Keweenaw Basin, respectively.

A southern extension of the Lake Owen fault, which is known as the Hastings fault, trends southwest near the city of Hastings, about 13 miles northwest of the site. Minor activity occurred along the Hastings fault during both Precambrian and Paleozoic times. Other minor movements occurred in the Paleozoic strata 6 miles southeast of the site near the city of Red Wing, and approximately 20 miles northeast of the site in the River Falls syncline near Waverly, Wisconsin.

There is no evidence of recent activity along any of the known fault zones in the Minnesota-Wisconsin region.

The locations of these structural features are shown in Figure 2.5-2. Regional geology is further shown in Figures 2.5-3 and 2.5-4.

2.5.1.4 LARGE SCALE GEOLOGIC MAP

The locations of the structural features discussed in Section 2.5.1.3 are shown in Figure 2.5-2.

2.5.1.5 PLOT PLAN AND SITE INVESTIGATIONS

A number of borings were made as part of the development of the Prairie Island Nuclear Generating Plant Operating License application. The boring logs and site maps showing the boring locations are contained in the Prairie Island USAR, Appendix E.

Additional field investigations at the ISFSI site were made in June 1991. The field program consisted of drilling 9 borings (B-8 through B-16) located roughly on a grid pattern as shown on Figure 2.5-5. The borings were located utilizing four corner control points. From the control points the borings were located within the blocked out area of interest using a transit and tape. The elevations at the tops of the borings were surveyed in from a point of known elevation.

SAFETY ANALYSIS REPORT

Revision: 9

Page 2.5-4

The drilling and surveying of boring locations and elevations were performed by Twin City Testing, Inc. The borings were drilled utilizing a Central Mining Equipment, Model 55, truck-mounted drilling rig. Borings were advanced using 6 in. diameter, hollow stem augers from the surface down to the intersection with the ground water table. At this point a switch to mud-rotary drilling was undertaken. Borings were advanced below the water table utilizing a 2 15/16 in. diameter tricone bit and gel/water mud. Boring B-8, B-10, B-12, B-14 and B-16 were drilled to 61 ft., and borings B-9, B-11, B-13 and B-15 were drilled to 51 ft. Samples were collected at 5 or 10 foot intervals with a standard split spoon sampler driven with a 140 lb. hammer following the ASTM D1586 standard penetration test (SPT) procedure (Reference 8). Blow counts, sample descriptions and water level elevations were recorded, and samples were collected for testing. Boring logs prepared for the nine borings are shown in Appendix 2A.

Fourteen soil samples, representing the various soil types encountered, were tested by Twin City Testing, Inc., for grain size distribution using ASTM D422 (Reference 9) procedures. The results of these tests are set forth in Appendix 2B.

2.5.1.6 GEOLOGIC PROFILES

Based on the information gathered from the 9 borings and associated samples obtained in June 1991, the following stratigraphic sequence is inferred to underlay the site. The site is covered with a layer of reddish brown silty sand from 0 to 12 ft in depth. Underlying the top layer is a uniform light brown fine sand with intermittent thin gravel seams. The light brown sand is found between depths of 12 ft and 44 to 46 ft. Below the light brown fine sand gravelly sand exists. The gravelly sand contains gravel pieces to 1 3/4 in. in size and is found between depths of 44 to 46 ft and 61 ft, the depth of the deepest boring. This sequence of soil layers was found in all 9 borings.

The density of the soils as measured by Standard Penetration Test (SPT) blow counts generally increases with depth from the surface. Penetration resistance down to the intersection with the marked increase in gravel content (approximately elevation 44 to 46 ft.) ranges from 3 to 28 blows/ft. Below this elevation the penetration resistance generally increases and ranges from 8 to 45 blows/ft.

The depth to ground water table was measured in each of the borings through hollow steam augers prior to switching to mud-rotary drilling. The ground water was measured at depths from 16.0 to 20.7 ft. below ground surface.

2.5.1.7 PLAN AND PROFILE DRAWINGS

Figure 2.5-6 is a site grading plan. Figure 2.5-7 shows site sections and details.

2.5.1.8 LOCAL GEOLOGIC FEATURES AFFECTING SITE LOCATION

There are no zones of alteration, deformation zones, previous earthquakes, zones of structural weakness or unstable rock formations which will affect storage cask placement.

2.5.1.9 SITE GROUNDWATER CONDITIONS

The depth to the unconfined water table was measured in each of the borings taken in June 1991 through hollow stem augers prior to switching to mud-rotary drilling. The ground water table was measured at depths from 16.0 ft. to 20.7 ft.

Site groundwater conditions area discussed in Section 2.4.2. Additional information is provided in the Prairie Island USAR.

2.5.1.10 GEOPHYSICAL SURVEYS AND STUDIES

The Prairie Island USAR, Section 2.5 and Appendix E, summarize geophysical surveys and studies which have been performed to evaluate the stratigraphic structure and bedrock in the Prairie Island site region.

2.5.1.11 SOIL AND ROCK PROPERTIES

Soil and rock properties are as shown on the boring logs in Appendix 2A.

2.5.1.12 ANALYSIS TECHNIQUES

Based on inspection of the gradation curves from the site, some of the soils are expected to be frost susceptible. This is not a significant consideration due to the depth to the water table. To avoid any potential problems footings and slabs will be founded below the anticipated frost depth or on non-frost susceptible fill extending below frost depth.

Analyses were performed to evaluate allowable bearing stresses for the ISFSI slabs and to estimate settlement associated with anticipated loading of the slabs. The allowable net bearing stress for the slabs was based on a depth below grade of 3 ft. It was also assumed that the water table might be at or above ground surface during flooding, since this condition reduces bearing capacity, and that topsoil with significant organic or clay content will be removed. Given the SPT blow counts shown in the boring logs in Appendix 2A, a net allowable bearing stress of 4 ksf is expected to be acceptable if settlement is not a major consideration.

A settlement calculation was performed based on the same conditions, resulting in an estimated settlement of roughly 1 to 1.5 in. for each 1 ksf of net bearing stress up to 4 ksf allowable. It is expected that this rate of settlement will be acceptable since the anticipated bearing stress is near 1 ksf.

Settlement is expected to occur very rapidly upon loading of the slab because sandy soils such as occur at the site are typically relatively free-draining (Reference 10). Flexibility of the slabs was considered, since loaded portions will tend to settle more than adjacent unloaded portions.

2.5.2 VIBRATING GROUND MOTION

For sites that have been evaluated under the criteria of 10CFR100, Appendix A, 10CFR72.102 provides that the design earthquakes (DE) must be equivalent to the safe shutdown earthquake (SSE) of the nuclear power plant. The appropriate response spectrum must also be specified.

The Prairie Island USAR, Section 2.6 and Appendix E, provide information and analyses concerning seismology, including discussions of earthquake history and probability. The SSE has been calculated to be 0.12g maximum ground acceleration. Figure 2.5-8 shows the ground level response spectra associated with the SSE.

Appendix E of the USAR provides detailed discussions of procedures used to determine the SSE. The USAR also summarizes seismic wave propagation and soil structures interaction analyses performed for the Prairie Island site.

2.5.3 SURFACE FAULTING

Section 2.5.1.3 provides a discussion of faults in the site area. Additional analysis is presented in the Prairie Island USAR, Appendix E. The probability of surface faulting in the site area is extremely low.

2.5.4 STABILITY OF SUBSURFACE MATERIALS

Requirements set forth in 10CFR72.102 provide that sites other than bedrock sites must be evaluated for their liquefaction potential or other soil instability due to vibratory ground motion. Site specific investigations and laboratory analyses must show that soil conditions are adequate for the proposed foundation loading.

A liquefaction analysis was performed on the basis of standard penetration test N values (blow counts) obtained during the June 1991 site investigation (Reference 12). The analysis is based on a normal water table elevation of approximately 18 ft. below the ground surface, since it is not intended to evaluate flood and earthquake conditions together. The liquefaction analysis was performed using a procedure developed by Seed, Seed and Idriss (Reference 11). Following this procedure, the stress ratio, which is the ratio of horizontal shear stress to vertical effective stress, is calculated at various depths for the anticipated horizontal acceleration N values which would allow liquefaction, given the expected stress ratio, is then determined. A curve of these critical N values versus depth (Figure 2.5-9) was developed for a maximum horizontal ground acceleration of 0.12g for a Richter magnitude 5 earthquake. This curve is compared with the N value profile for each of the borings as shown in Figure 2.5-9. The comparison shows that two marginally liquefiable zones were found in the borings at depths of 20 ft. and 35 ft. throughout the site.

The potentially liquefiable zone at 20 ft. is only 2 ft. below the groundwater table and any pore water pressure buildup due to strong ground shaking would dissipate quickly due to the short drainage path to the top of the ground water. Therefore, there is little chance of this layer liquefying. The potentially liquefiable zone at 35 ft. was analyzed based on the ratio of the depth of the unliquefiable surface layer to the thickness of the liquefiable sand layer. In comparison to numerous similar sites noted in Reference 11, if the marginally liquefiable (at the 35 ft. depth) is taken to be 5ft. thick, based on the low blow count (N) values shown in Figure 2.5-9, then the ratio between layer depth and layer thickness is 7. According to observations mentioned in Reference 11 surface effects are not expected at ratios above 1.

The studies from Reference 11 also state that no evidence of liquefaction was found when nonliquefiable surface layer has a thickness of greater than 9 ft. For these reasons, even if liquefaction of the sand layer at 35 ft. were to occur, it is anticipated that the effects at the surface will be minor to non-existent and will have no effect on the stability of the ISFSI slabs.

2.5.5 SLOPE STABILITY

The ISFSI site within the perimeter fence is located on both cut and fill material. The berms surrounding the site are constructed of earth fill material. To limit the site area and amount of required fill, a slope of one horizontal to one vertical is used for the berms.

The berms are reinforced with geofabric. Erosion control material and natural vegetation give the berms a natural appearance.

2.6 REFERENCES

1. Northern States Power Company, Prairie Island Nuclear Generating Plant Updated Safety Analysis Report, Revision 18, Docket 50-282 (Unit 1) and 50-306 (Unit 2).
2. KLD Engineering, P.C., Evacuation Time Estimate for the Prairie Island Nuclear Generating Plant Emergency Planning Zone, November 2012.
3. National Oceanic and Atmospheric Administration, Local Climatological Data Minneapolis – St. Paul, MN, July 1987.
4. Uman, Martin A., Understanding Lightning, Bek Technical Publications, Inc., Carnegie, PA 15106.
5. Northern States Power Company, Prairie Island Nuclear Generating Plant Final Safety Analysis Report, May 3, 1974.
6. U.S. Nuclear Regulatory Commission, Regulatory Guide 1.145, Atmospheric Dispersion Models for Potential Accident Consequence Assessments at Nuclear Power Plants, Revision 1, November 1982.
7. Northern States Power Company, Operating Procedure AB-4, Flood, Revision 13.
8. American Society for Testing and Materials, ASTM D1586, Penetration Test and Split-Barrel Sampling of Soils, 1984.
9. American Society for Testing and Materials, ASTM D422, Method for Particle-Size Analysis of Soils, 1963.
10. Peck, Hanson, and Thornburn, Foundation Engineering, 2nd Edition, John Wiley & Sons, 1974.
11. Committee on Earthquake Engineering, Commission on Engineering and Technical Systems, National Research Council, Liquefaction of Soils During Earthquakes, National Academy Press, Washington, D.C., 1985.
12. Estimation of Liquefaction Potential, SWEC Calculation No. 1291154-G-2, Rev. 1, July 20, 1991.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 17

TABLE 2.1-1
ESTIMATED 2010 RESIDENT POPULATION DISTRIBUTION WITHIN THE PRAIRIE ISLAND EMERGENCY
PLANNING ZONE (Reference 2)

| Radius (MILES) | N | NNE | NE | ENE | E | ESE | SE | SSE | S | SSW | SW | WSW | W | WNW | NW | NNW | TOTAL |
|-------------------|-----|-------|-------|-----|-----|-------|--------|-------|-----|-----|-----|-----|-----|-------|-----|-------|--------|
| 0-1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 6 | 164 | 0 | 22 | 192 |
| 1-2 | 27 | 34 | 74 | 0 | 6 | 0 | 0 | 0 | 0 | 21 | 0 | 13 | 0 | 20 | 11 | 0 | 206 |
| 2-3 | 23 | 75 | 75 | 12 | 4 | 0 | 0 | 0 | 7 | 20 | 23 | 30 | 0 | 0 | 0 | 1 | 270 |
| 3-4 | 16 | 59 | 30 | 2 | 165 | 137 | 0 | 614 | 458 | 111 | 1 | 40 | 68 | 84 | 0 | 0 | 1,785 |
| 4-5 | 20 | 21 | 35 | 34 | 50 | 148 | 476 | 901 | 281 | 0 | 17 | 30 | 45 | 5 | 0 | 13 | 2,076 |
| 5-6 | 77 | 35 | 120 | 80 | 172 | 296 | 1,445 | 677 | 4 | 35 | 75 | 0 | 99 | 218 | 46 | 117 | 3,496 |
| 6-7 | 6 | 169 | 101 | 48 | 38 | 601 | 6,655 | 56 | 48 | 73 | 57 | 98 | 239 | 331 | 0 | 0 | 8,520 |
| 7-8 | 171 | 59 | 166 | 74 | 223 | 331 | 4,113 | 146 | 44 | 43 | 51 | 53 | 162 | 461 | 146 | 658 | 6,901 |
| 8-9 | 86 | 166 | 148 | 106 | 41 | 265 | 127 | 107 | 17 | 114 | 57 | 91 | 115 | 593 | 176 | 106 | 2,315 |
| 9-10 | 288 | 260 | 290 | 82 | 24 | 484 | 136 | 78 | 62 | 108 | 98 | 100 | 89 | 109 | 297 | 224 | 2,729 |
| 10-11* | 70 | 394 | 276 | 17 | 78 | 8 | 45 | 12 | 8 | 57 | 74 | 35 | 0 | 595 | 52 | 264 | 1,985 |
| TOTAL | 784 | 1,272 | 1,315 | 455 | 801 | 2,270 | 12,997 | 2,591 | 929 | 582 | 453 | 490 | 823 | 2,580 | 728 | 1,405 | 30,475 |

*Note this population is the remainder of the 10-Mile EPZ due to geopolitical boundaries which extend into the 10-11 mile range.

01441968

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION**SAFETY ANALYSIS REPORT**Revision: 9

TABLE 2.3-1
SITE BOUNDARY DISPERSION FACTOR (χ/Q)
(FROM CENTER OF ISFSI SITE)

| Downwind Sector | Downwind Distance (m) | χ/Q (sec/m^3) |
|--------------------|--------------------------|---|
| N | 1,015 | 1.70×10^{-4} |
| NNE | 905 | 1.99×10^{-4} |
| NE | 650 | 3.18×10^{-4} |
| ENE | 550 | 3.89×10^{-4} |
| E | 550 | 3.89×10^{-4} |
| ESE | 775 | 2.21×10^{-4} |
| SE | 795 | 2.21×10^{-4} |
| SSE | 445 | 5.53×10^{-4} |
| S | 345 | 9.02×10^{-4} |
| SSW | 255 | 1.45×10^{-3} |
| SW | 255 | 1.45×10^{-3} |
| WSW | 195 | 2.49×10^{-3} |
| W | 180 | 2.95×10^{-3} |
| WNW | 195 | 2.49×10^{-3} |
| NW | 245 | 1.45×10^{-3} |
| NNW | 1,055 | 1.55×10^{-4} |

Table 2.3-2
DOWNWIND DISPERSION FACTOR (χ/Q)

| Downwind Distance (miles) | χ/Q (sec/m ³) |
|------------------------------|--------------------------------|
| 0.45 | 2.66 x 10 ⁻⁴ |
| 0.50 | 2.23 x 10 ⁻⁴ |
| 1.50 | 7.45 x 10 ⁻⁵ |
| 2.50 | 4.54 x 10 ⁻⁵ |
| 3.50 | 3.24 x 10 ⁻⁵ |
| 4.50 | 2.50 x 10 ⁻⁵ |
| 7.50 | 1.46 x 10 ⁻⁵ |
| 15.00 | 6.84 x 10 ⁻⁶ |
| 35.00 | 4.35 x 10 ⁻⁶ |
| 35.00 | 3.94 x 10 ⁻⁶ |
| 45.00 | 3.67 x 10 ⁻⁶ |

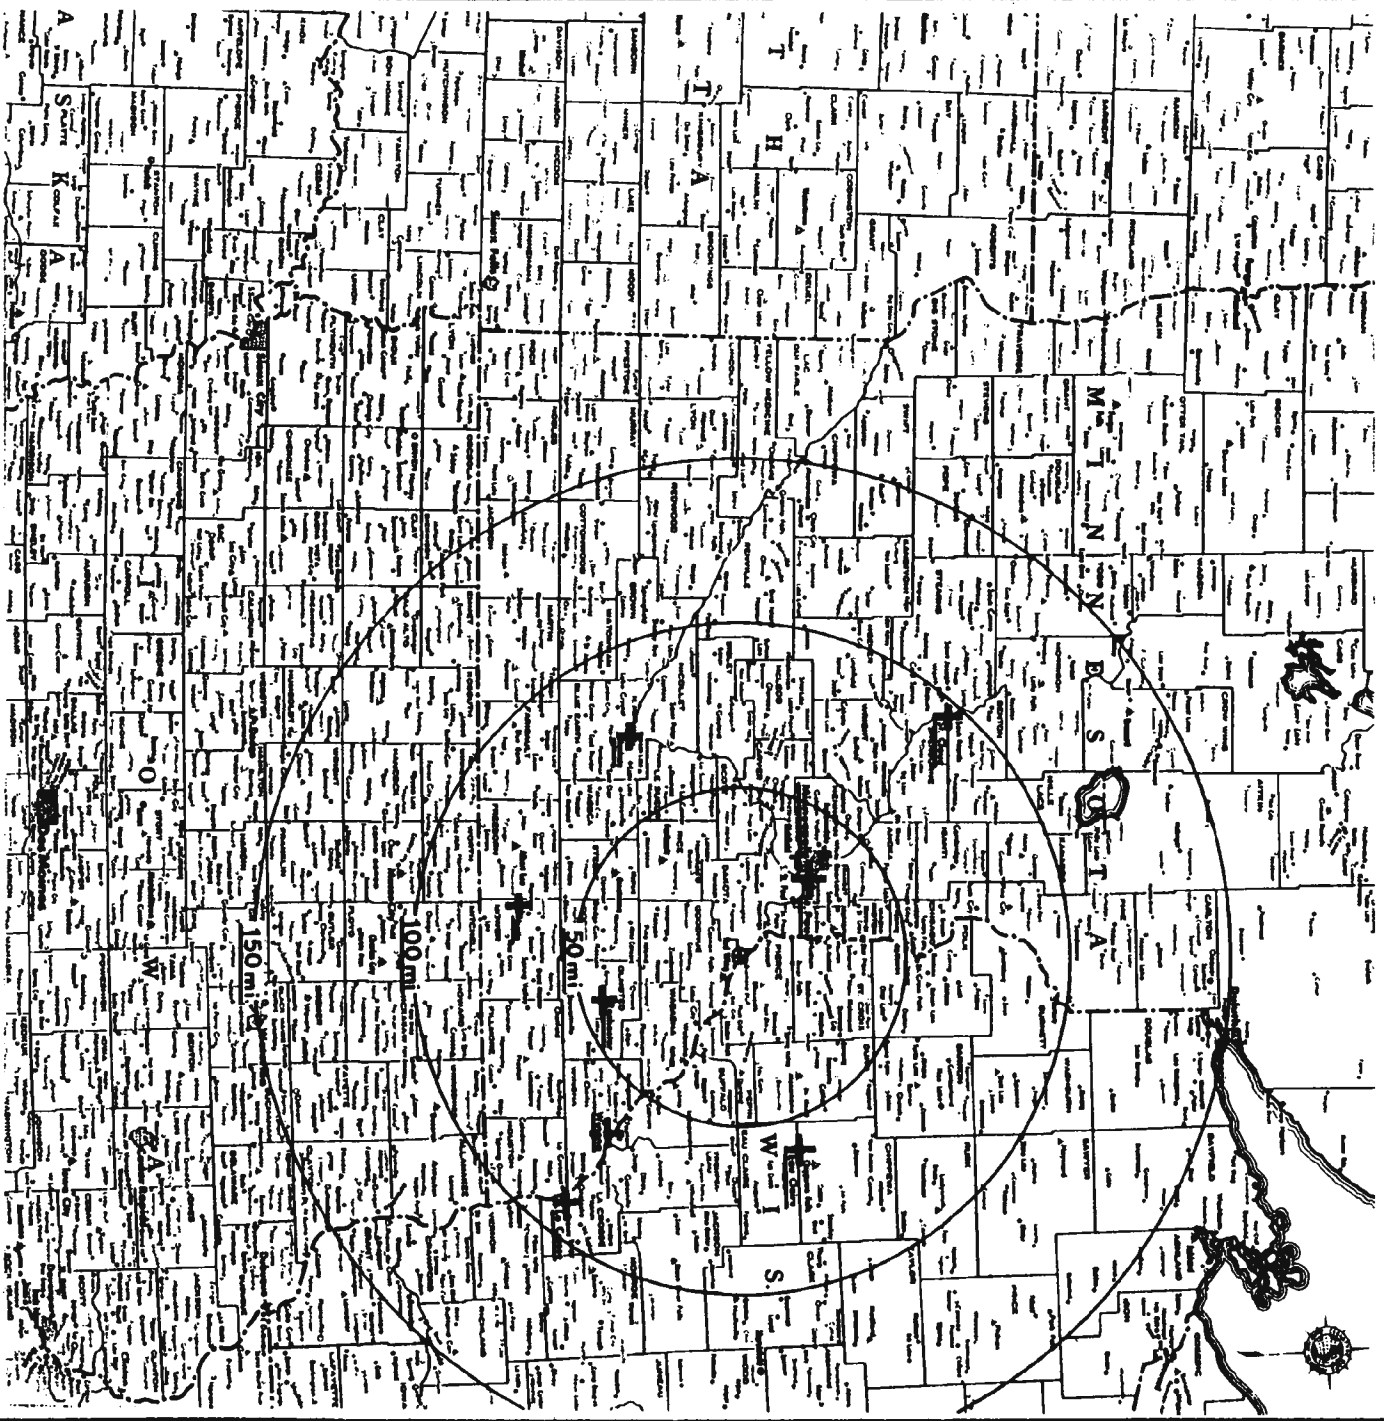


Figure 2.1-1


REGIONAL MAP

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

Rev. 0 8/90

ISFSI SITE LOCATION

NORTHERN STATES POWER COMPANY



PRAIRIE ISLAND NUCLEAR GENERATING PLANT

RED WING, MINNESOTA

DRAWN BY:

VLS

REVISION:

0

PAGE NO.

DATE:

03-29-06

FIG2.1-1_REV_0

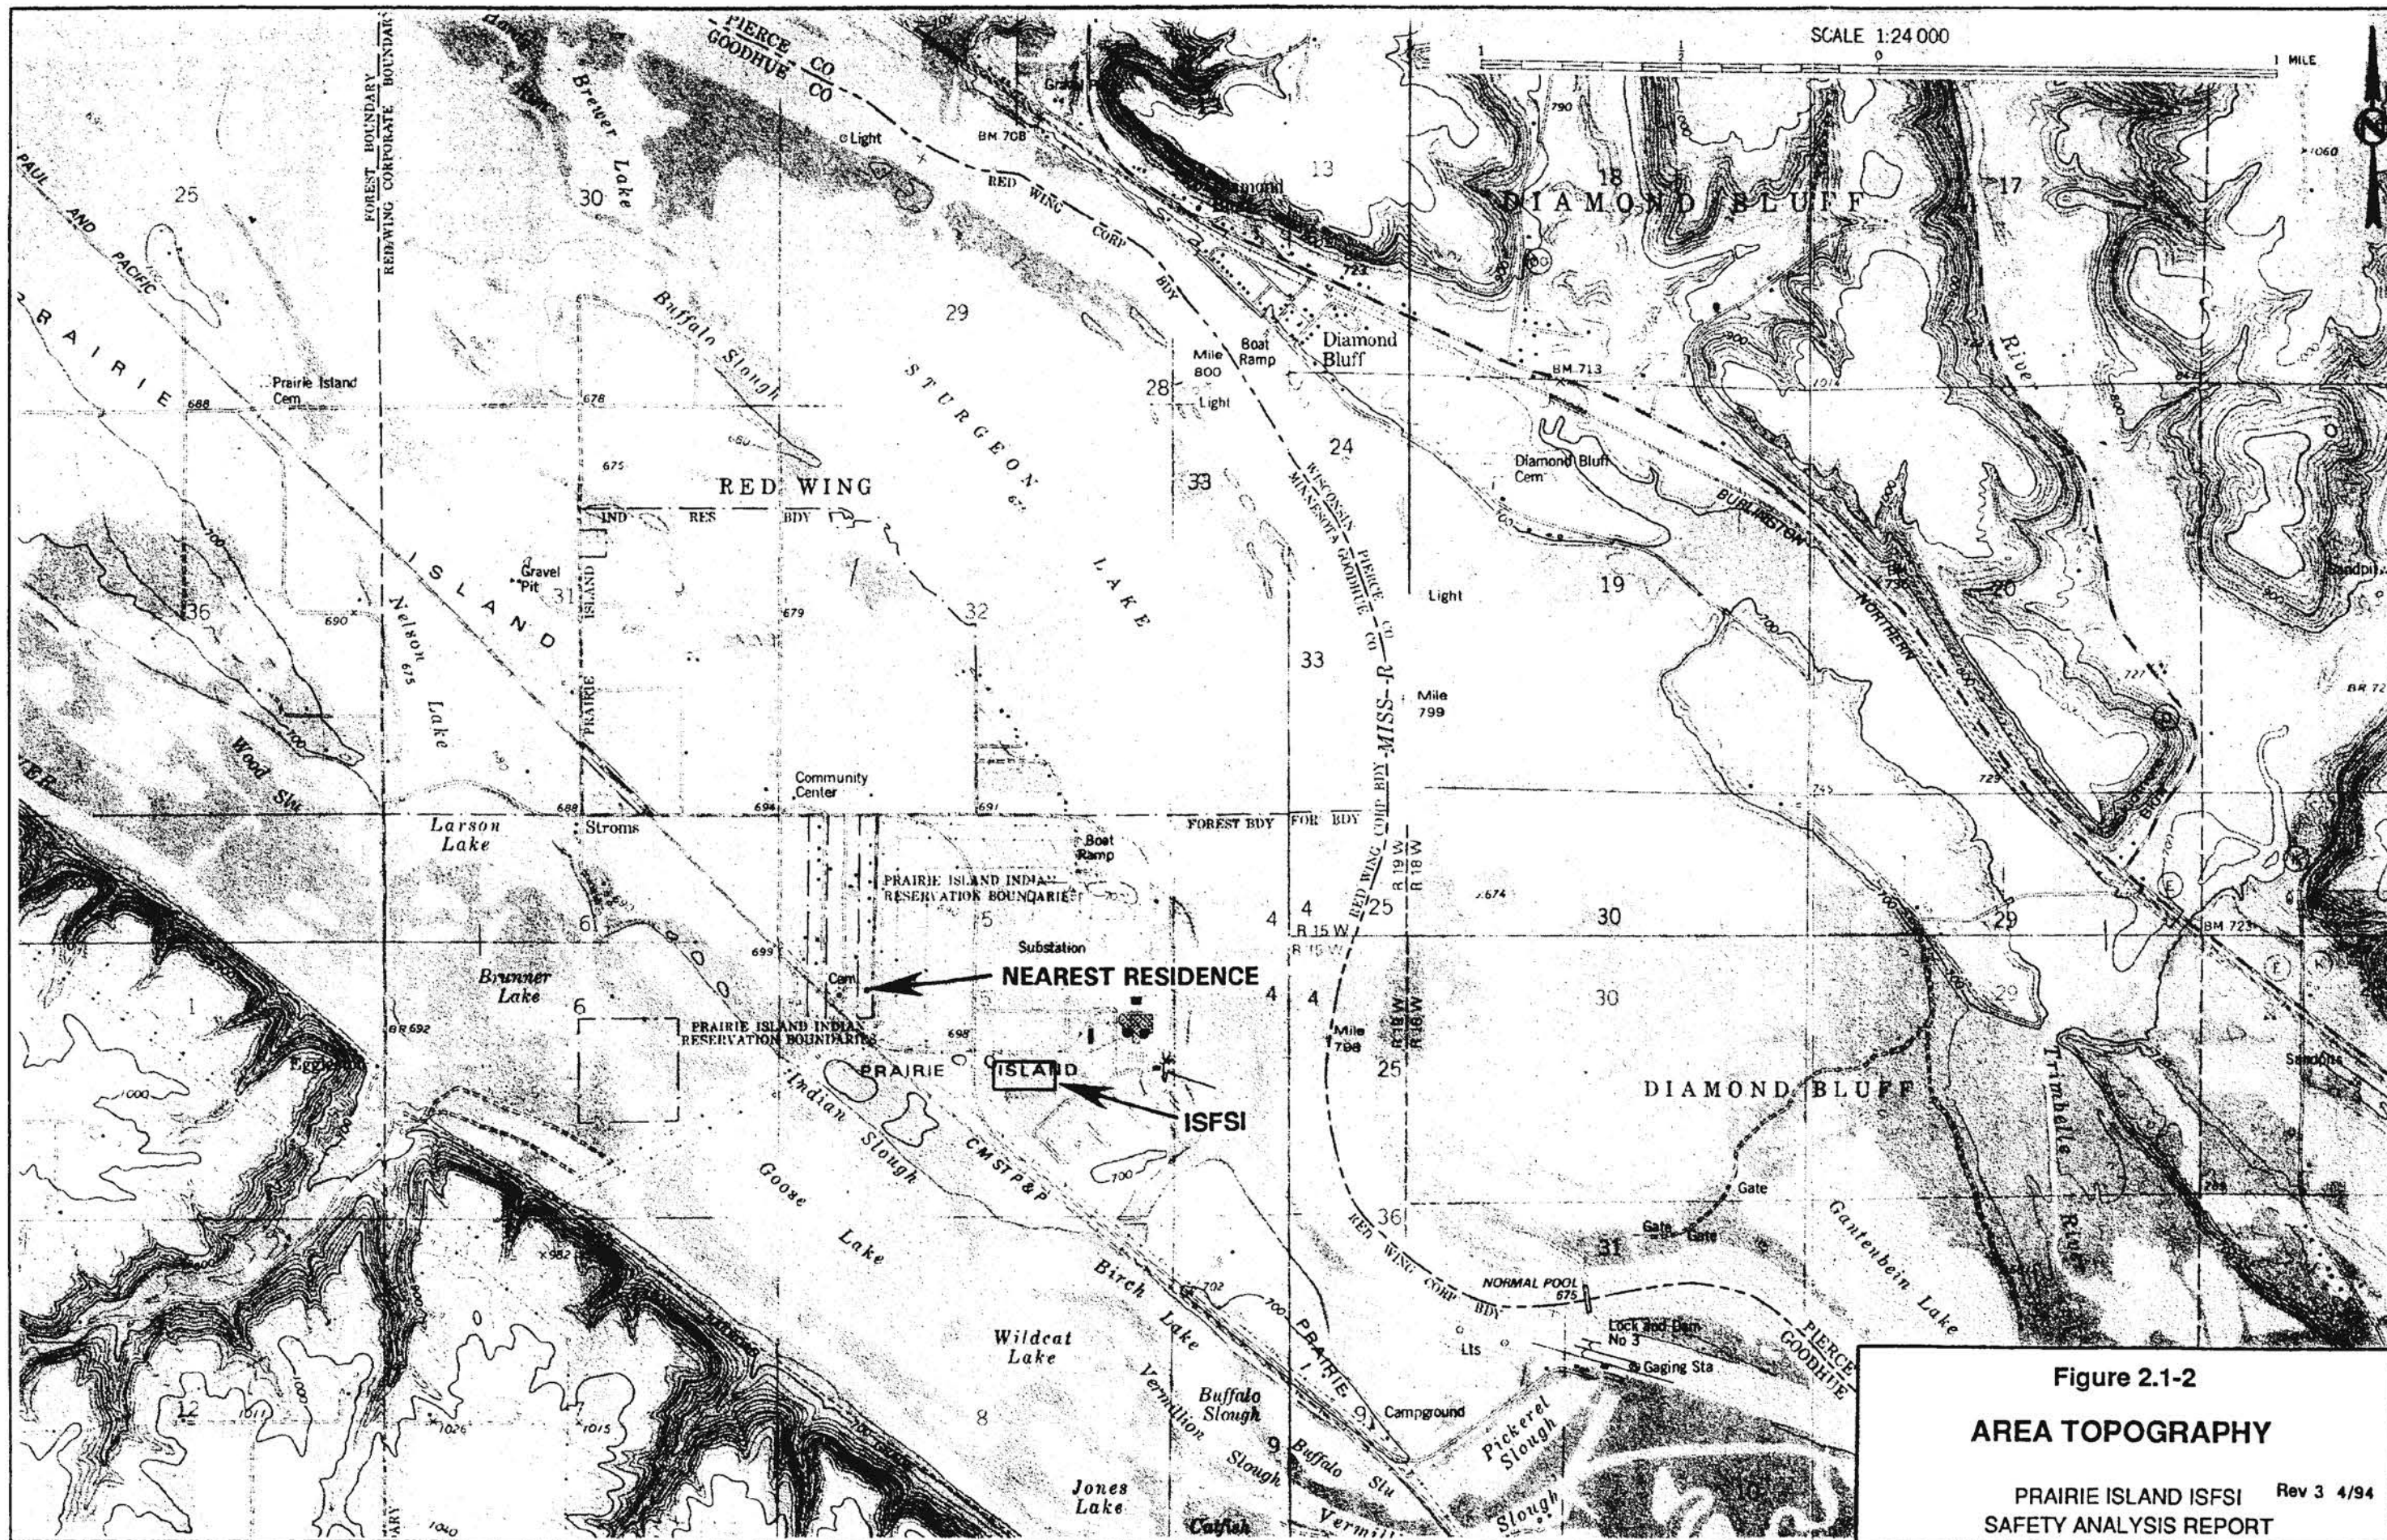


Figure 2.1-2
AREA TOPOGRAPHY

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

Rev 3 4/94

AREA TOPOGRAPHY

DRAWN BY:

VLS

REVISION:


3

NORTHERN STATES POWER COMPANY
Xcel Energy
PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

PAGE NO.

DATE: 03-29-06

FIG2.1-2_REV_3

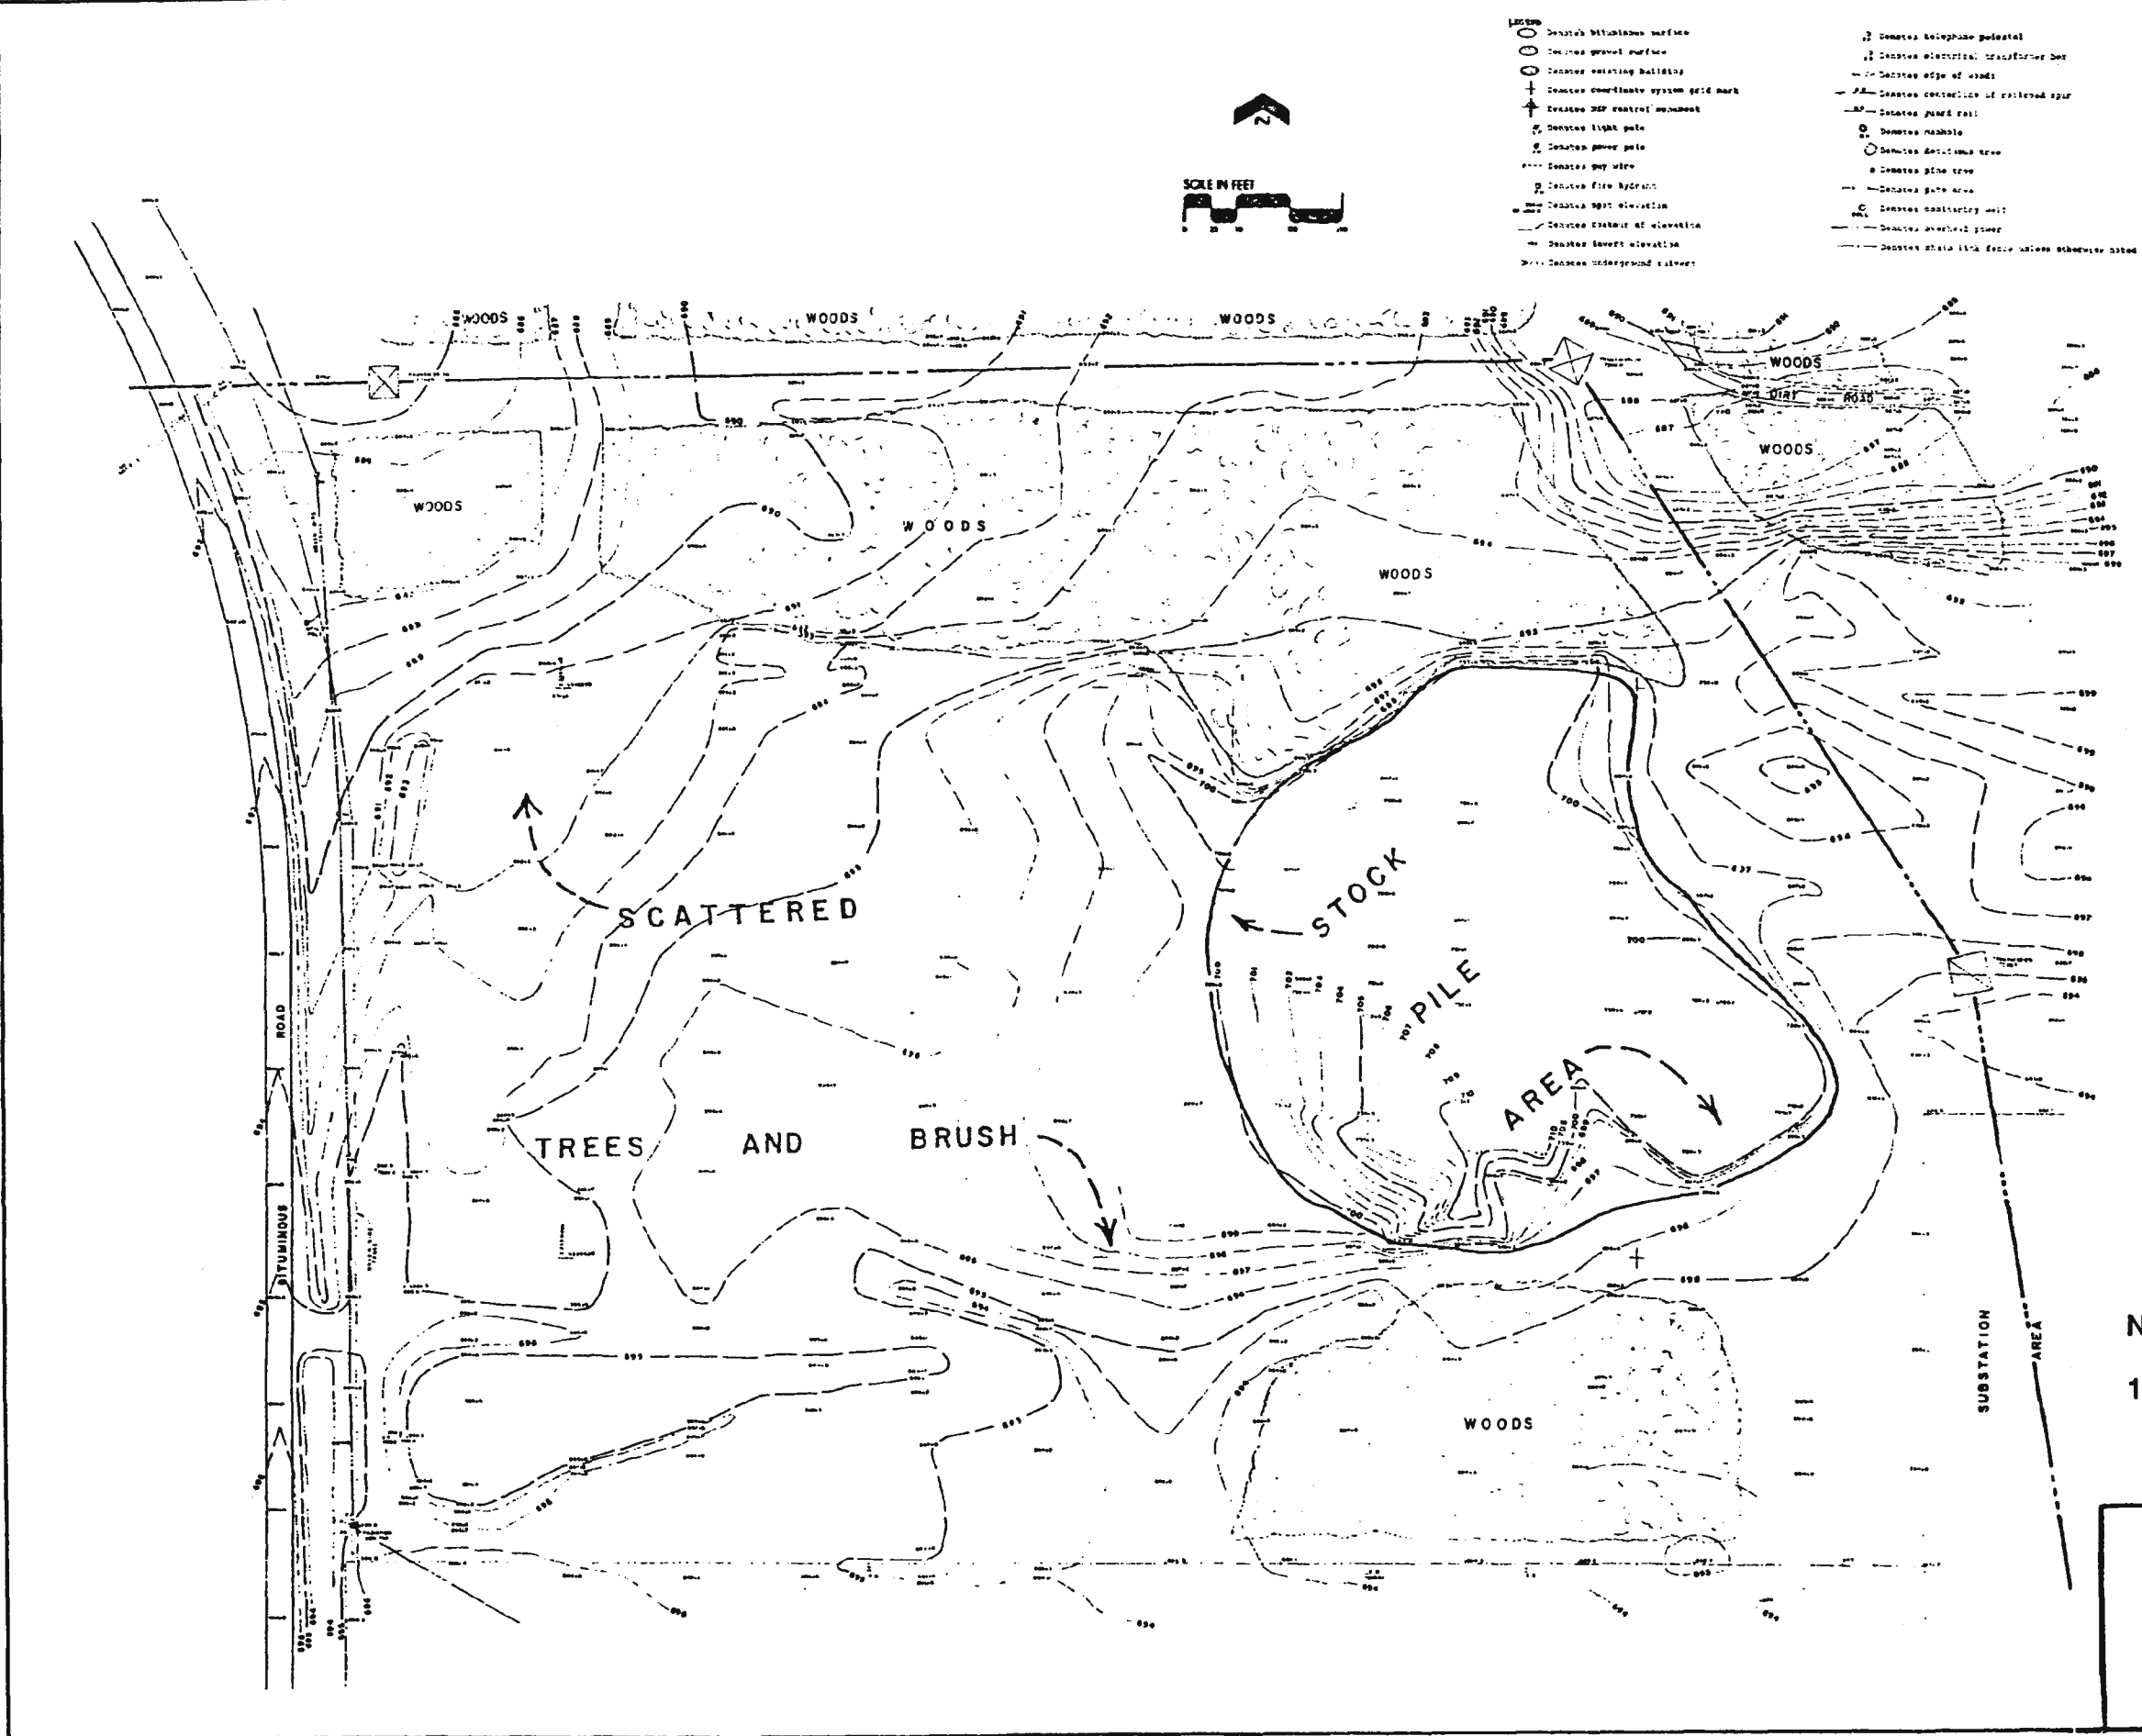


NOTE:

1. REF: NSP PRAIRIE ISLAND
DRAWING NO. NF-159000-1, REV.A

Rev 3 4/94

Figure 2.1-3
SHEET 1
SITE TOPOGRAPHY
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT


SHEET 2 SITE TOPOGRAPHY

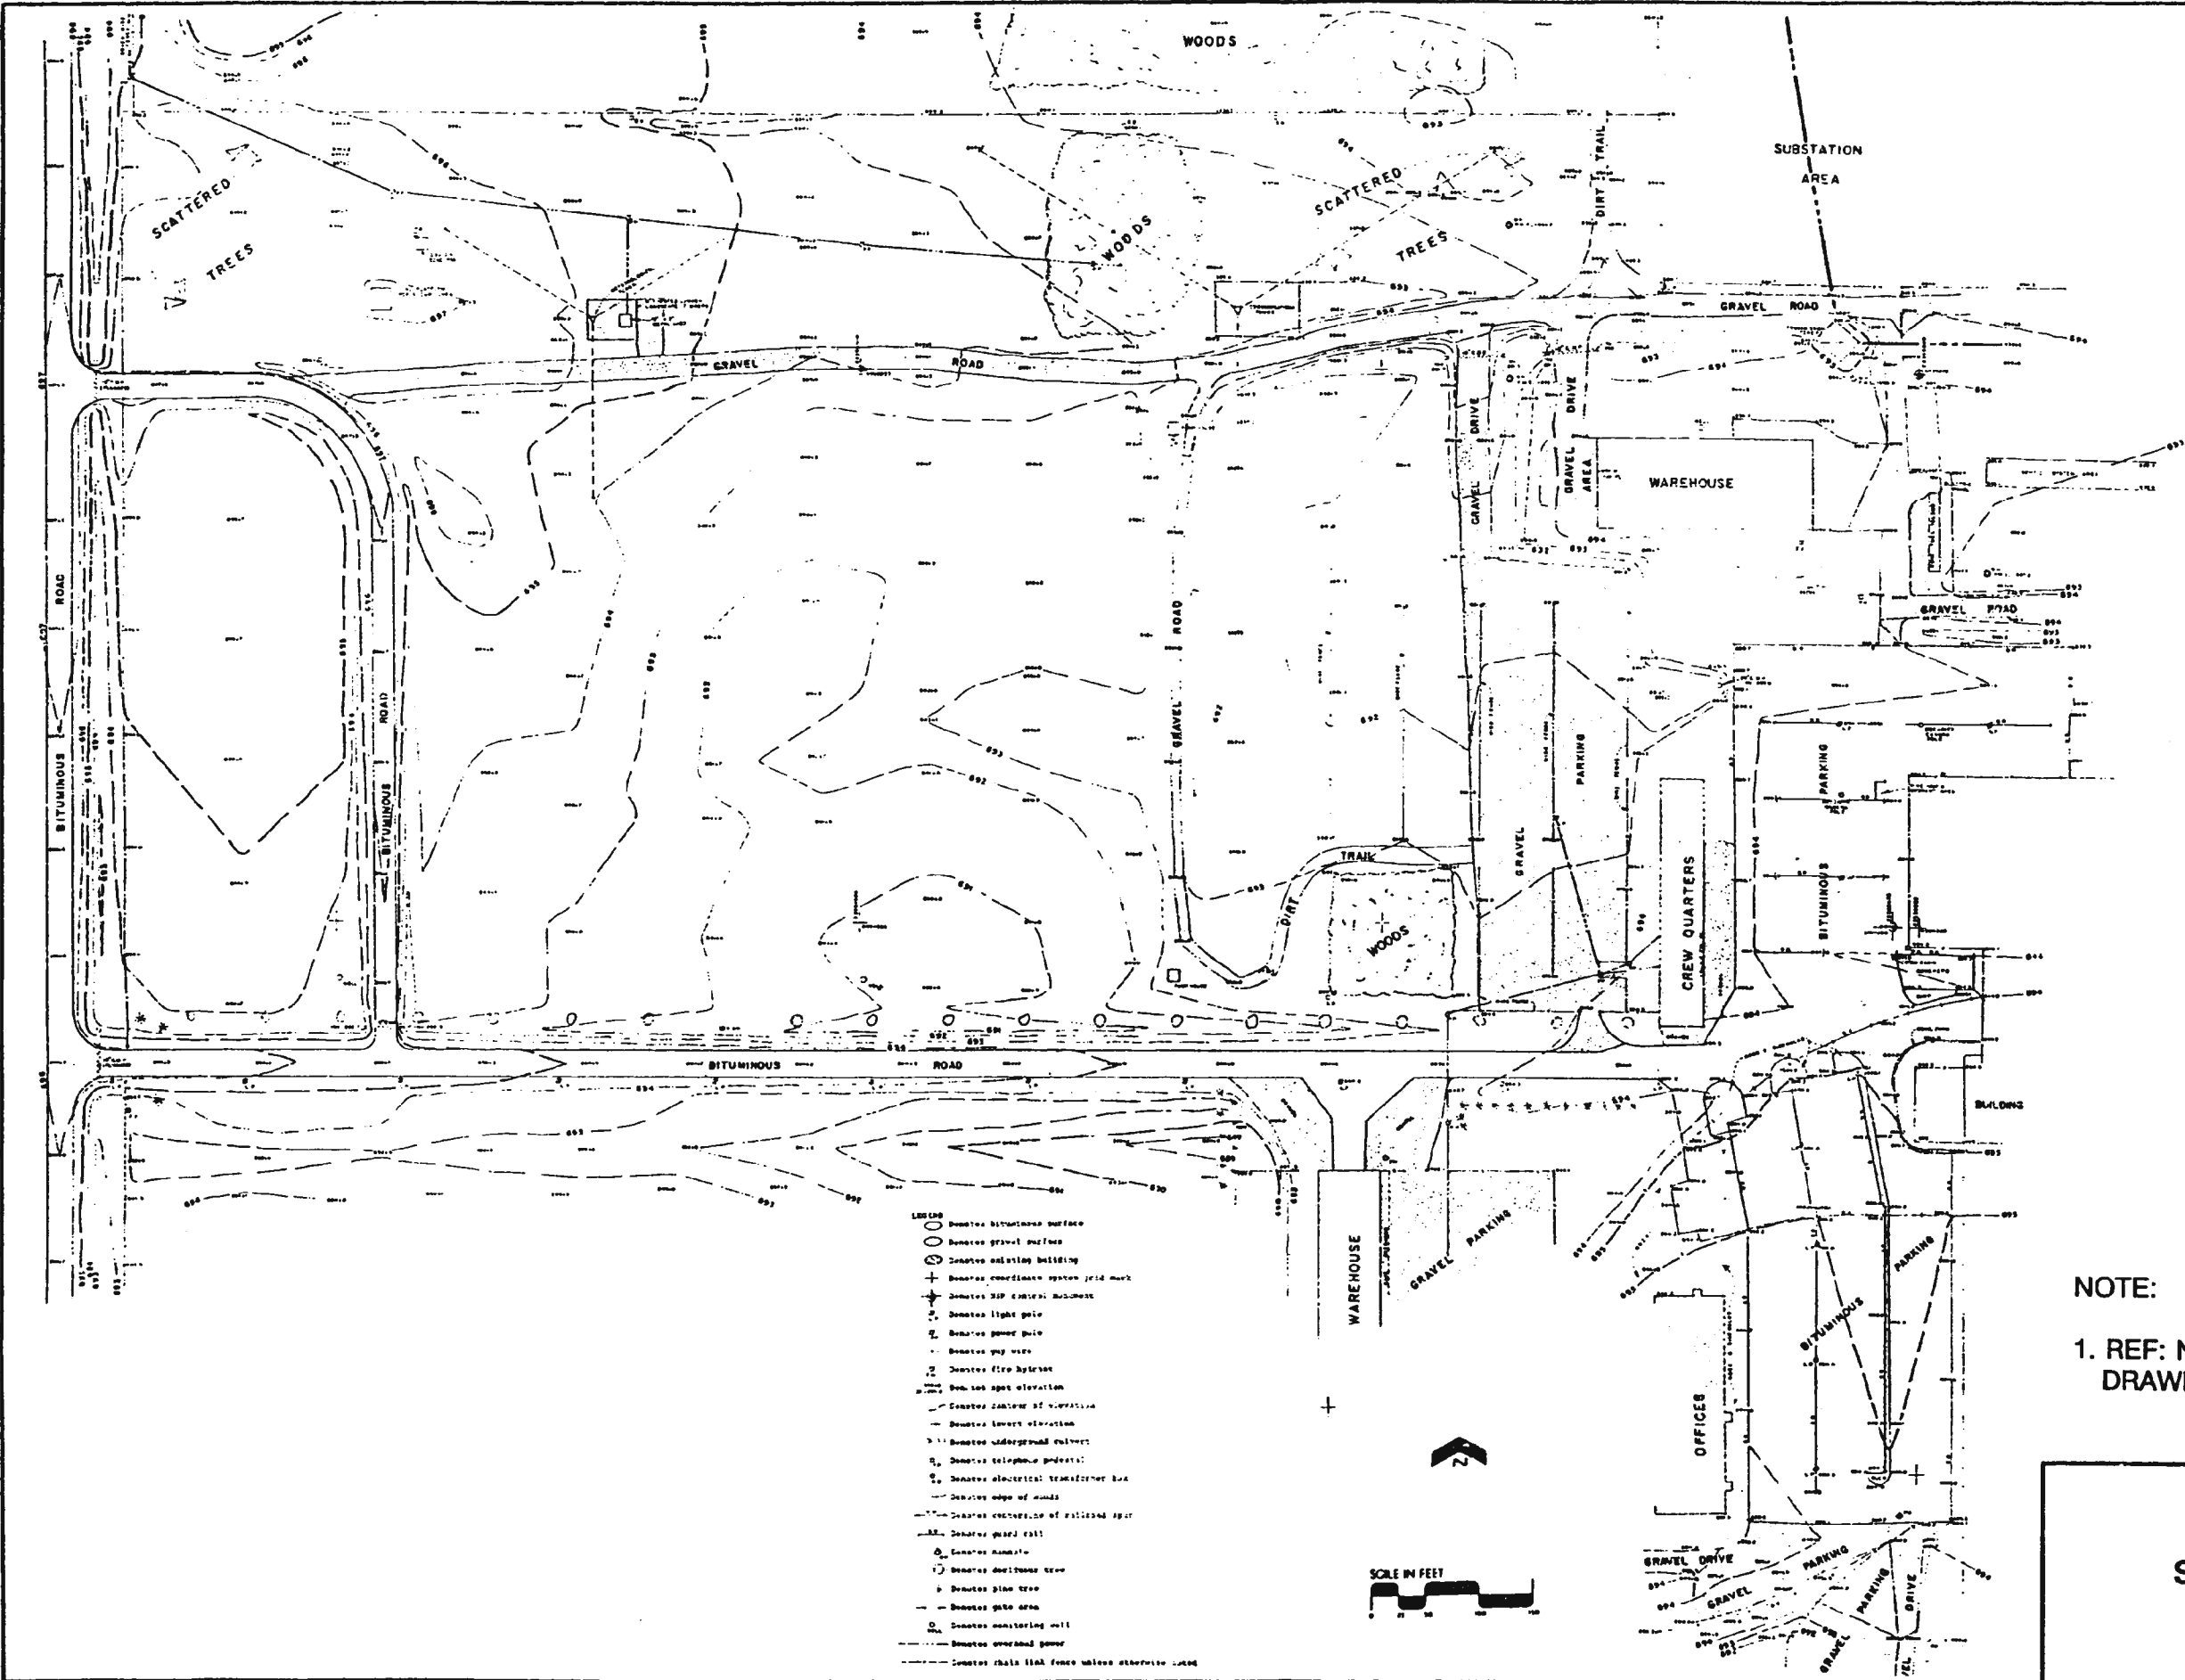

NOTE:
1. REF: NSP PRAIRIE ISLAND
DRAWING NO. NF-159000-2, REV.A

Rev 3 4/94

Figure 2.1-3
SHEET 2
SITE TOPOGRAPHY
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT



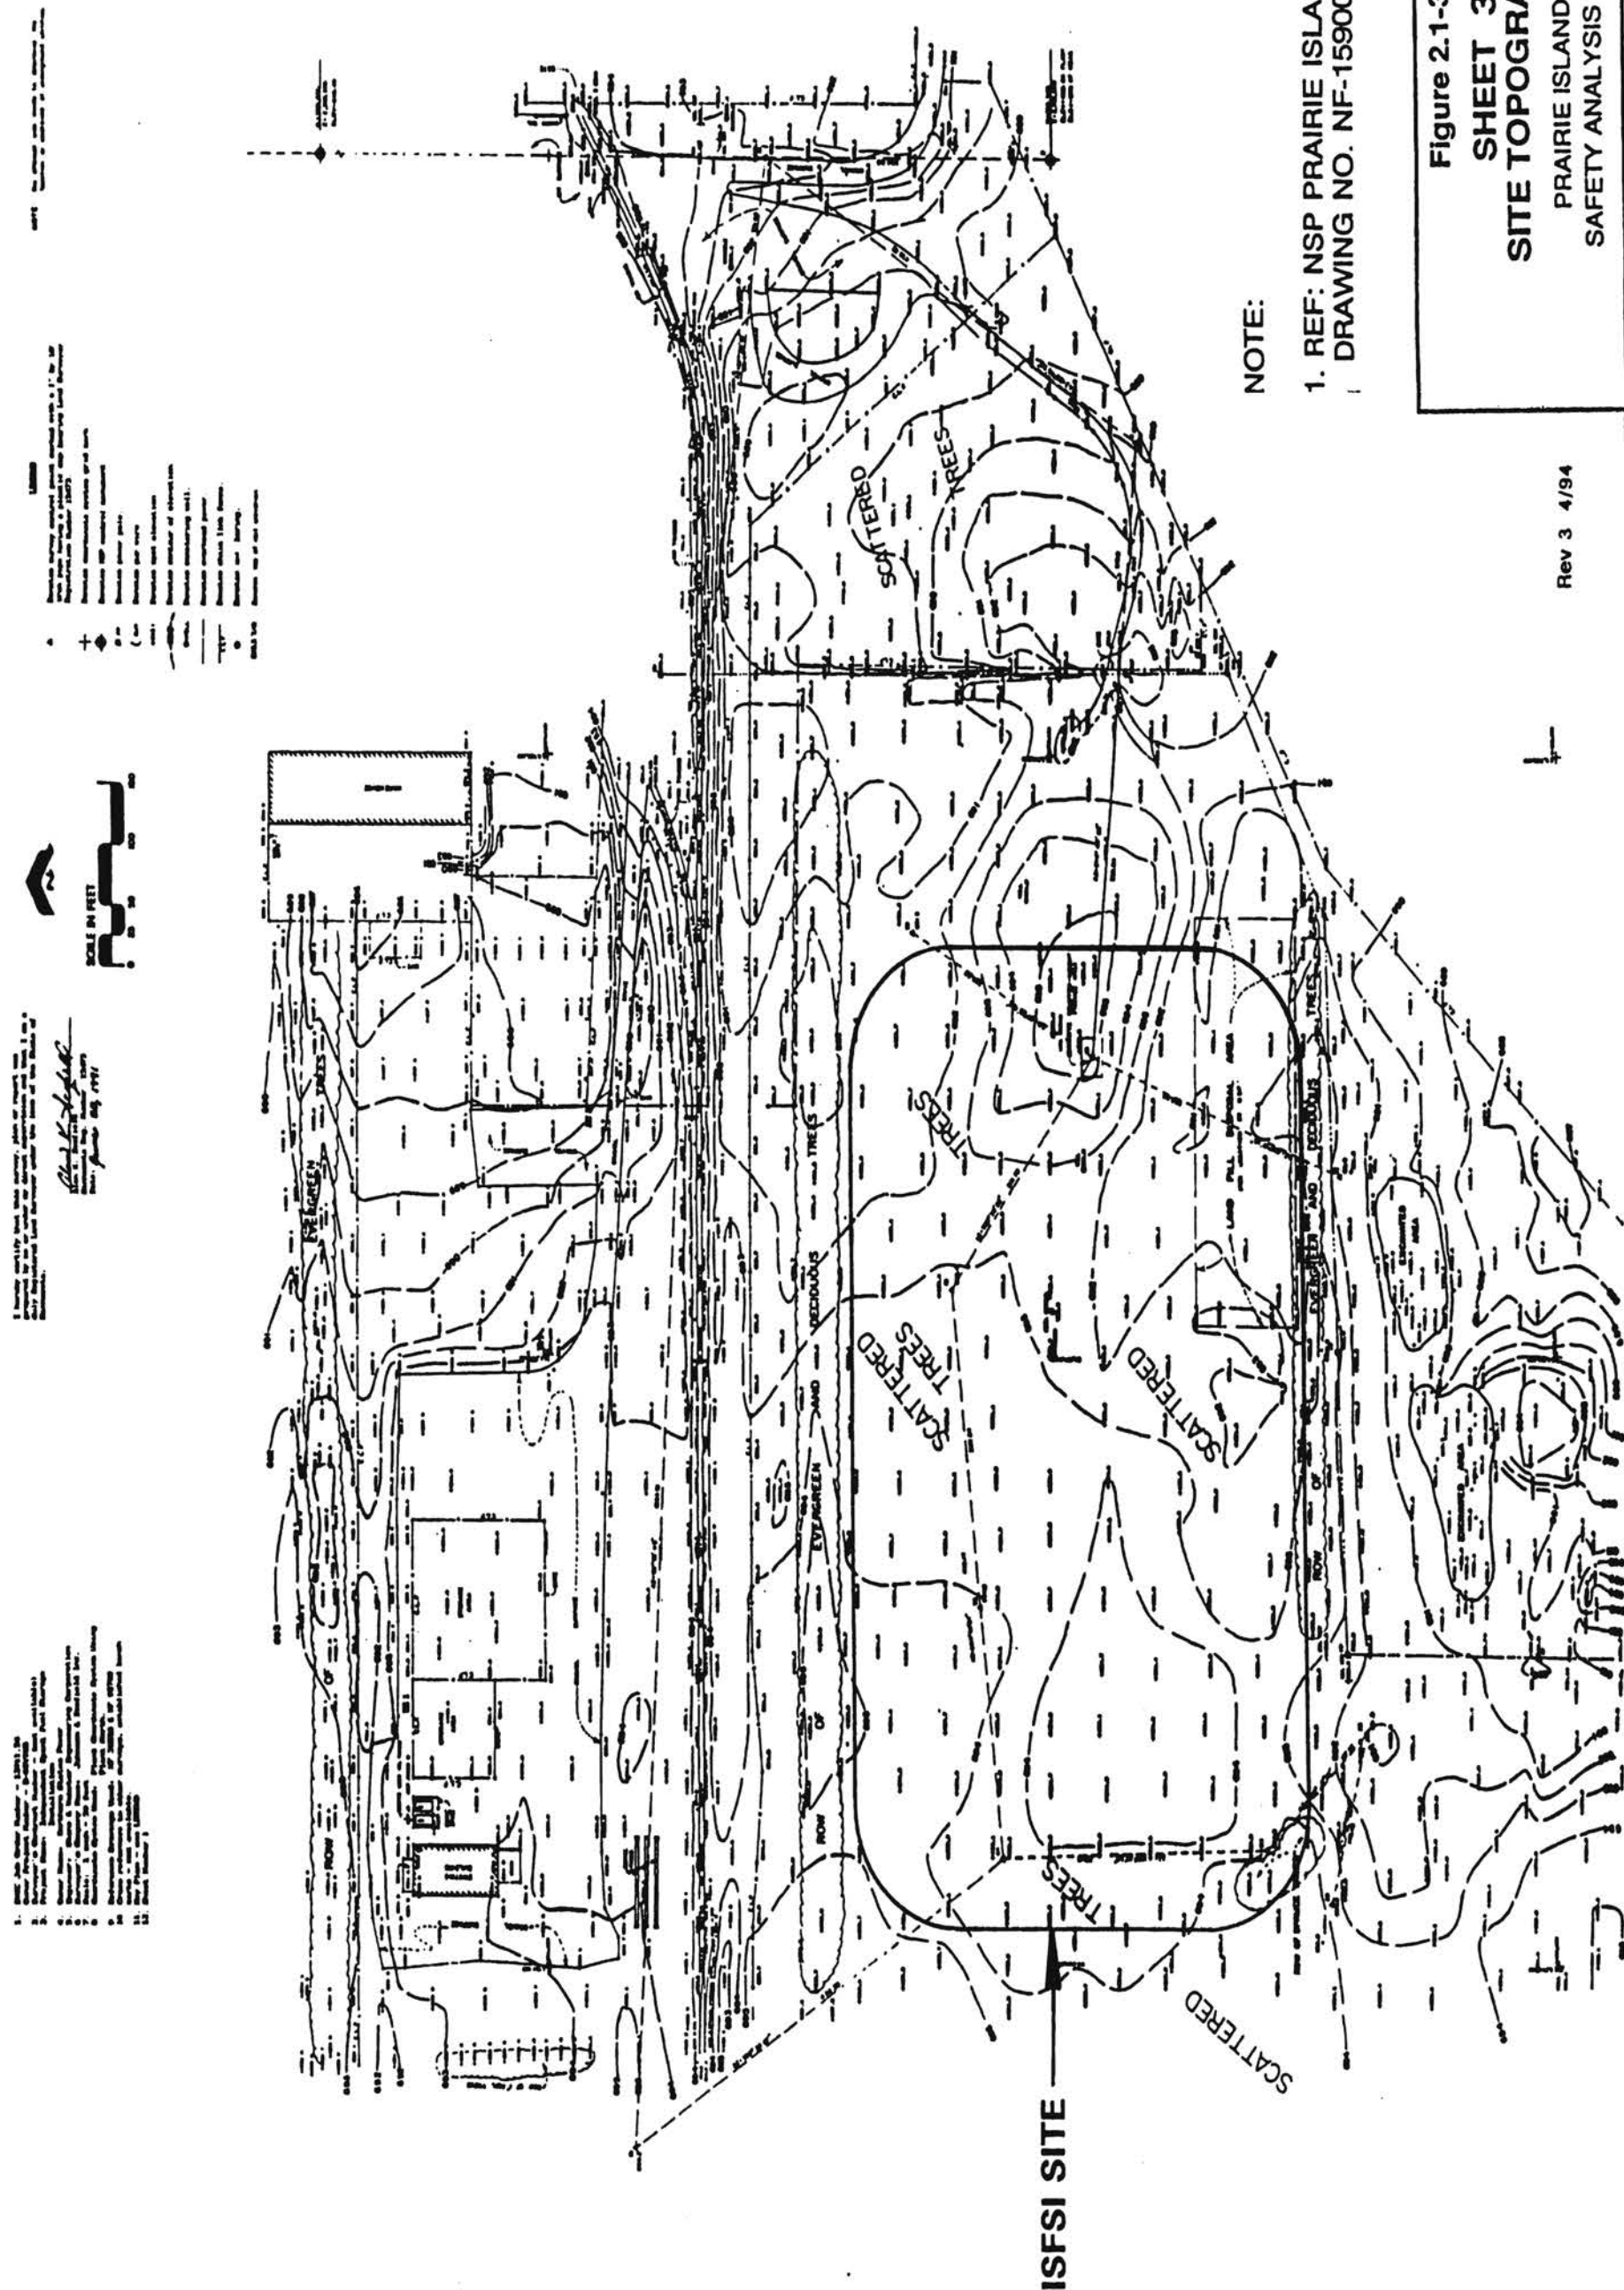


NOTE:

1. REF: NSP PRAIRIE ISLAND
DRAWING NO. NF-159000-3, REV.A

Figure 2.1-3
SHEET 3
SITE TOPOGRAPHY
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT


Rev 3 4/94

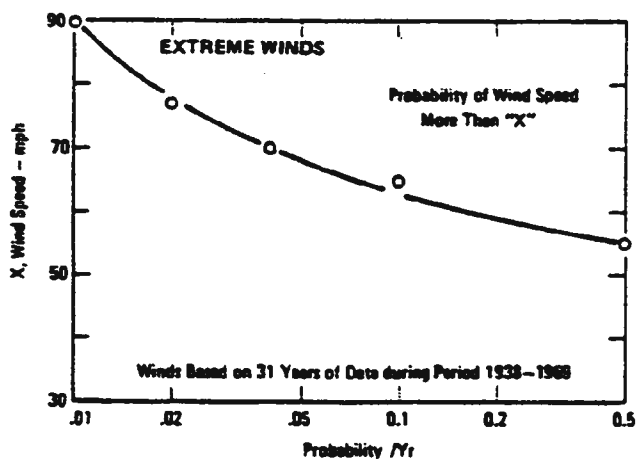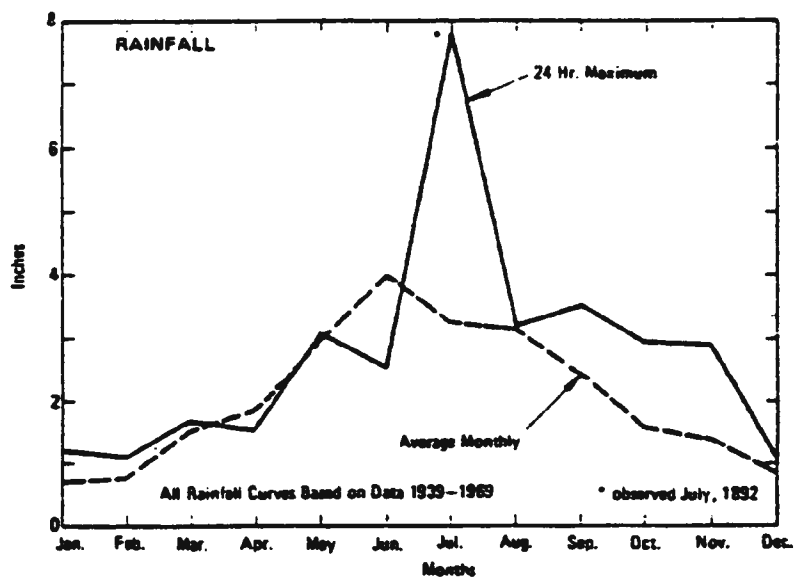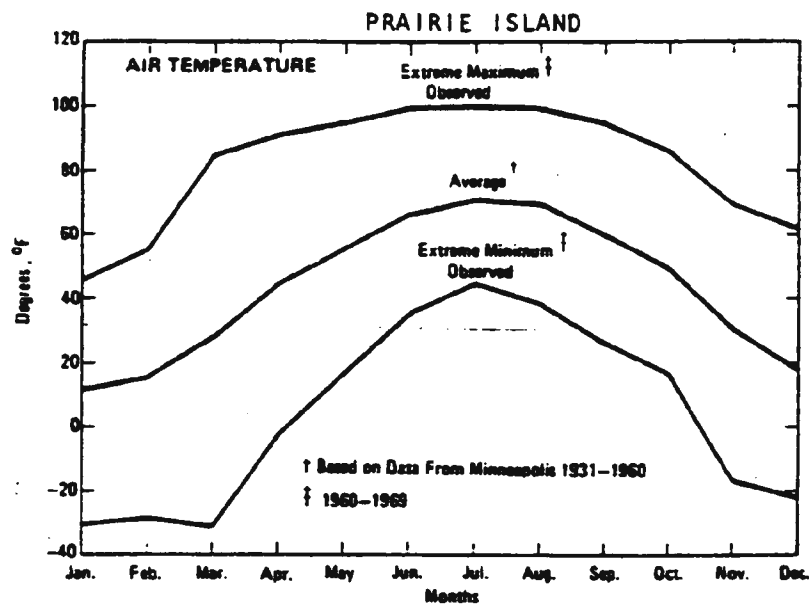

Rev. 0 8/90

Figure 2.3-1
CLIMATIC DATA
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

CLIMATIC DATA

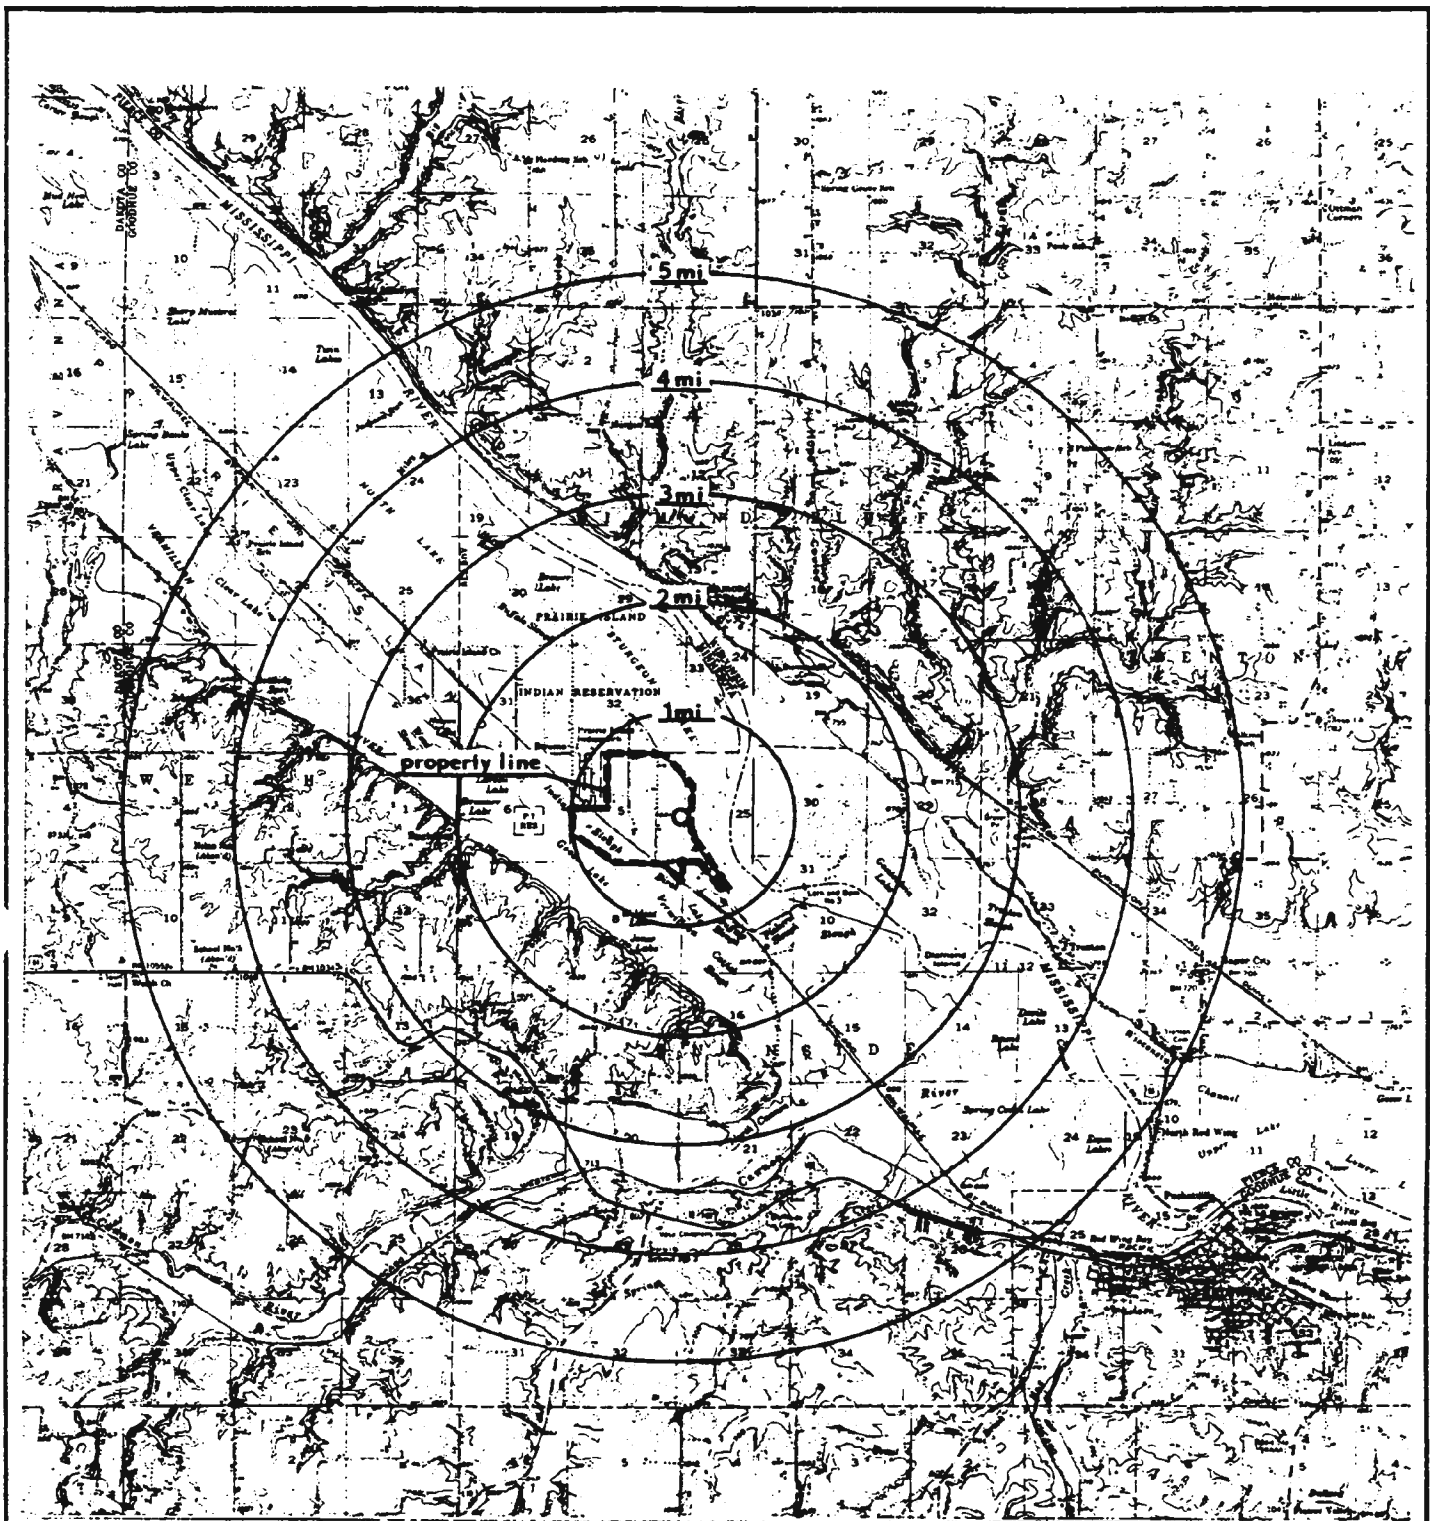

Rev. 0 8/90



Figure 2.3-2 REGIONAL TOPOGRAPHY

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

REGIONAL TOPOGRAPHY

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY: VLS

REVISION: 0

PAGE. NO.

DATE: 03-29-06

FIG2.3-2_REV_0

LOCATION OF STREAM GAGING STATIONS


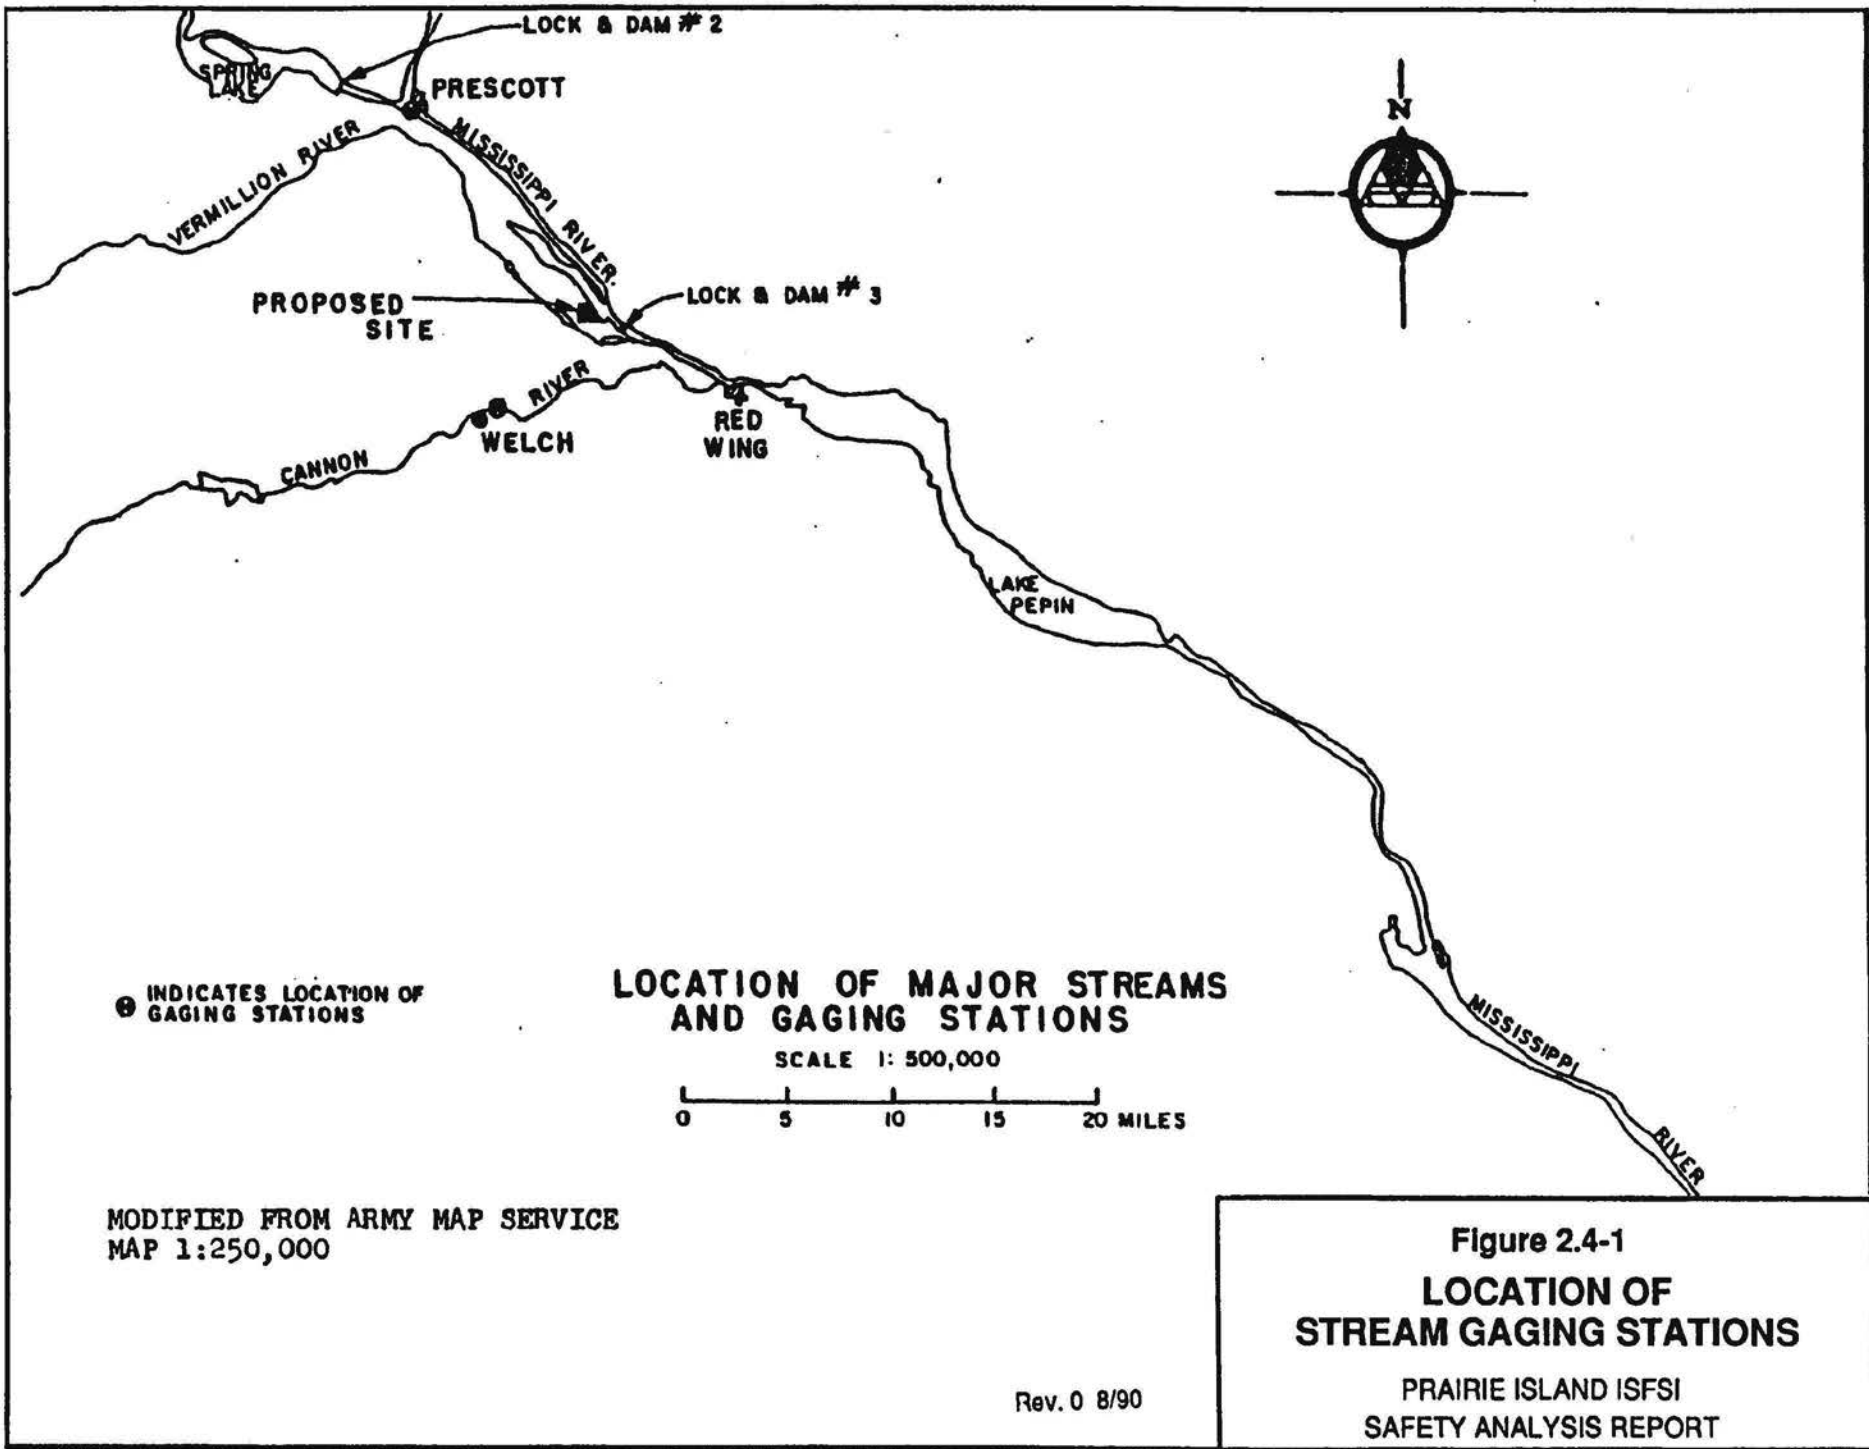


Figure 2.4-1
LOCATION OF
STREAM GAGING STATIONS
 PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

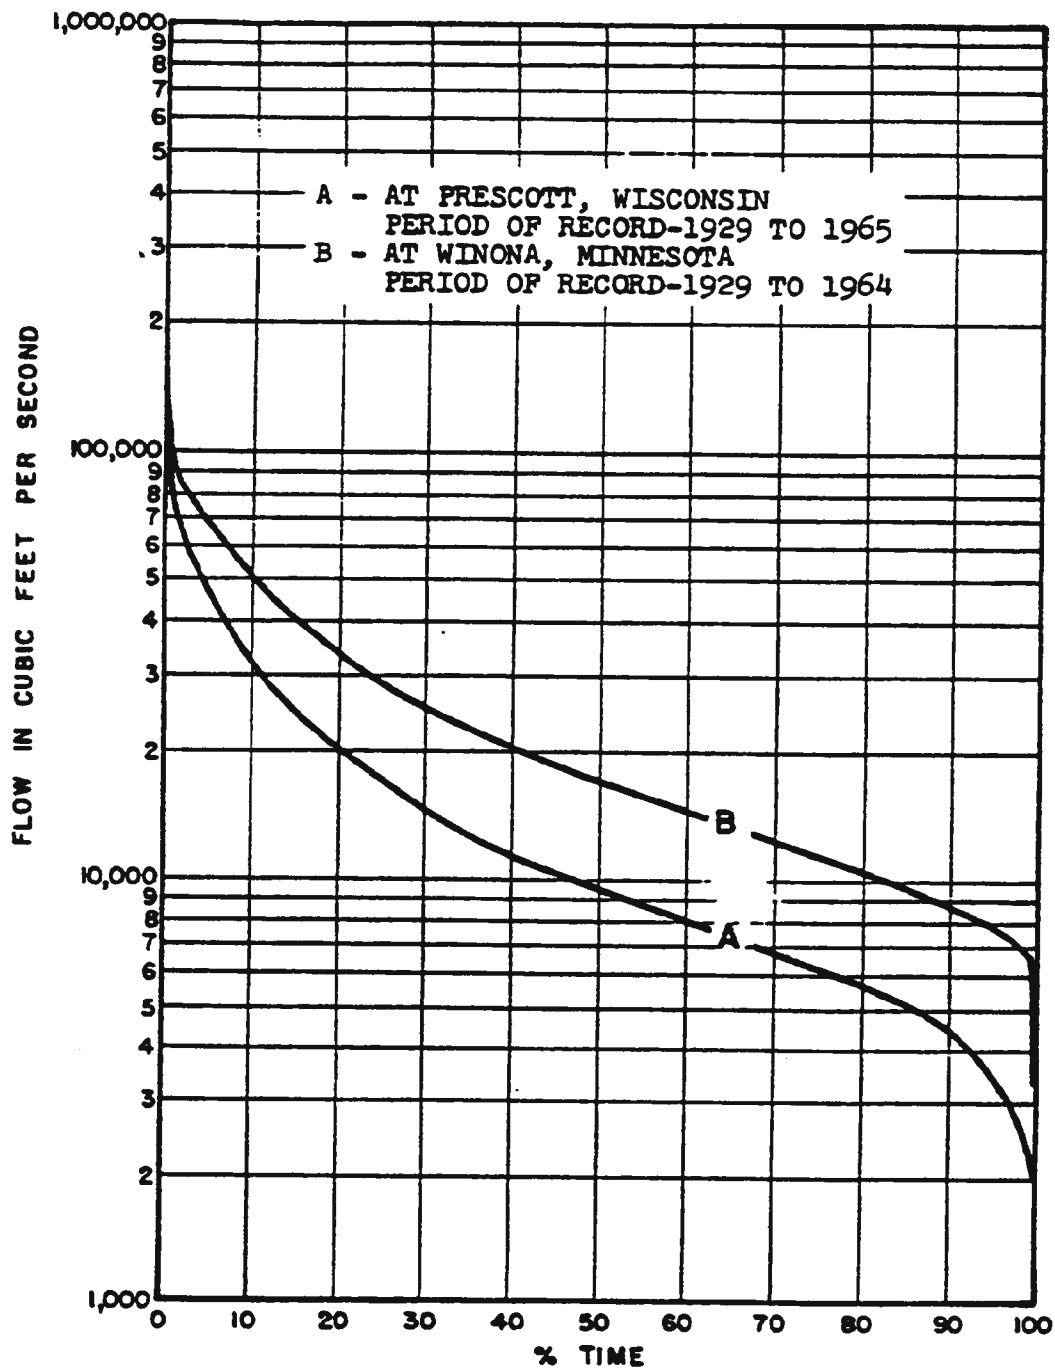

Rev. 0 8/90


GRAPH COMPILED FROM DATA OBTAINED
FROM U.S.GEOLOGICAL SURVEY
STATISTICAL SUMMARIES

Figure 2.4-2
FLOW DURATION CURVES FOR
MISSISSIPPI RIVER

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

FLOW DURATION CURVES FOR MISSISSIPPI RIVER

STREAM PROFILE

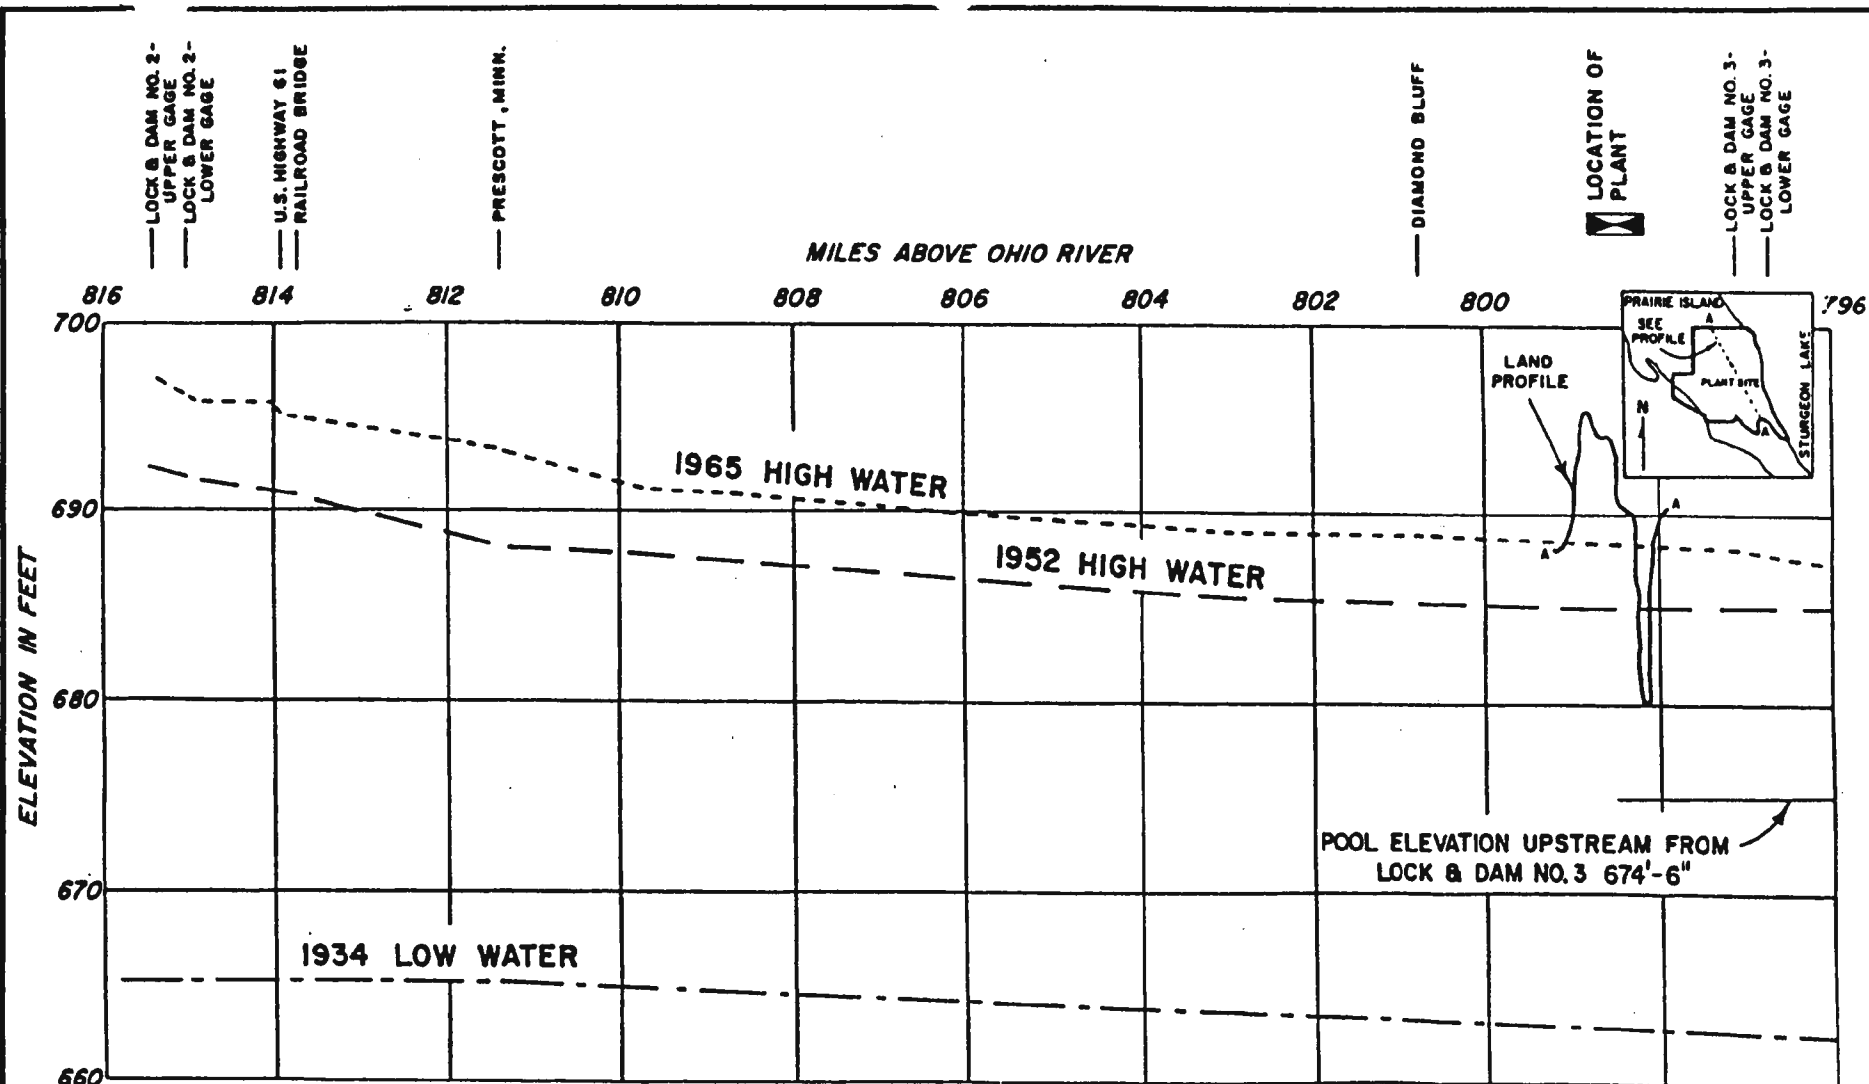

NOTE:


MODIFIED FROM U.S. CORPS OF ENGINEERS
 STREAM PROFILE CURVES

Rev. 0 8/90

Figure 2.4-3

STREAM PROFILE


PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

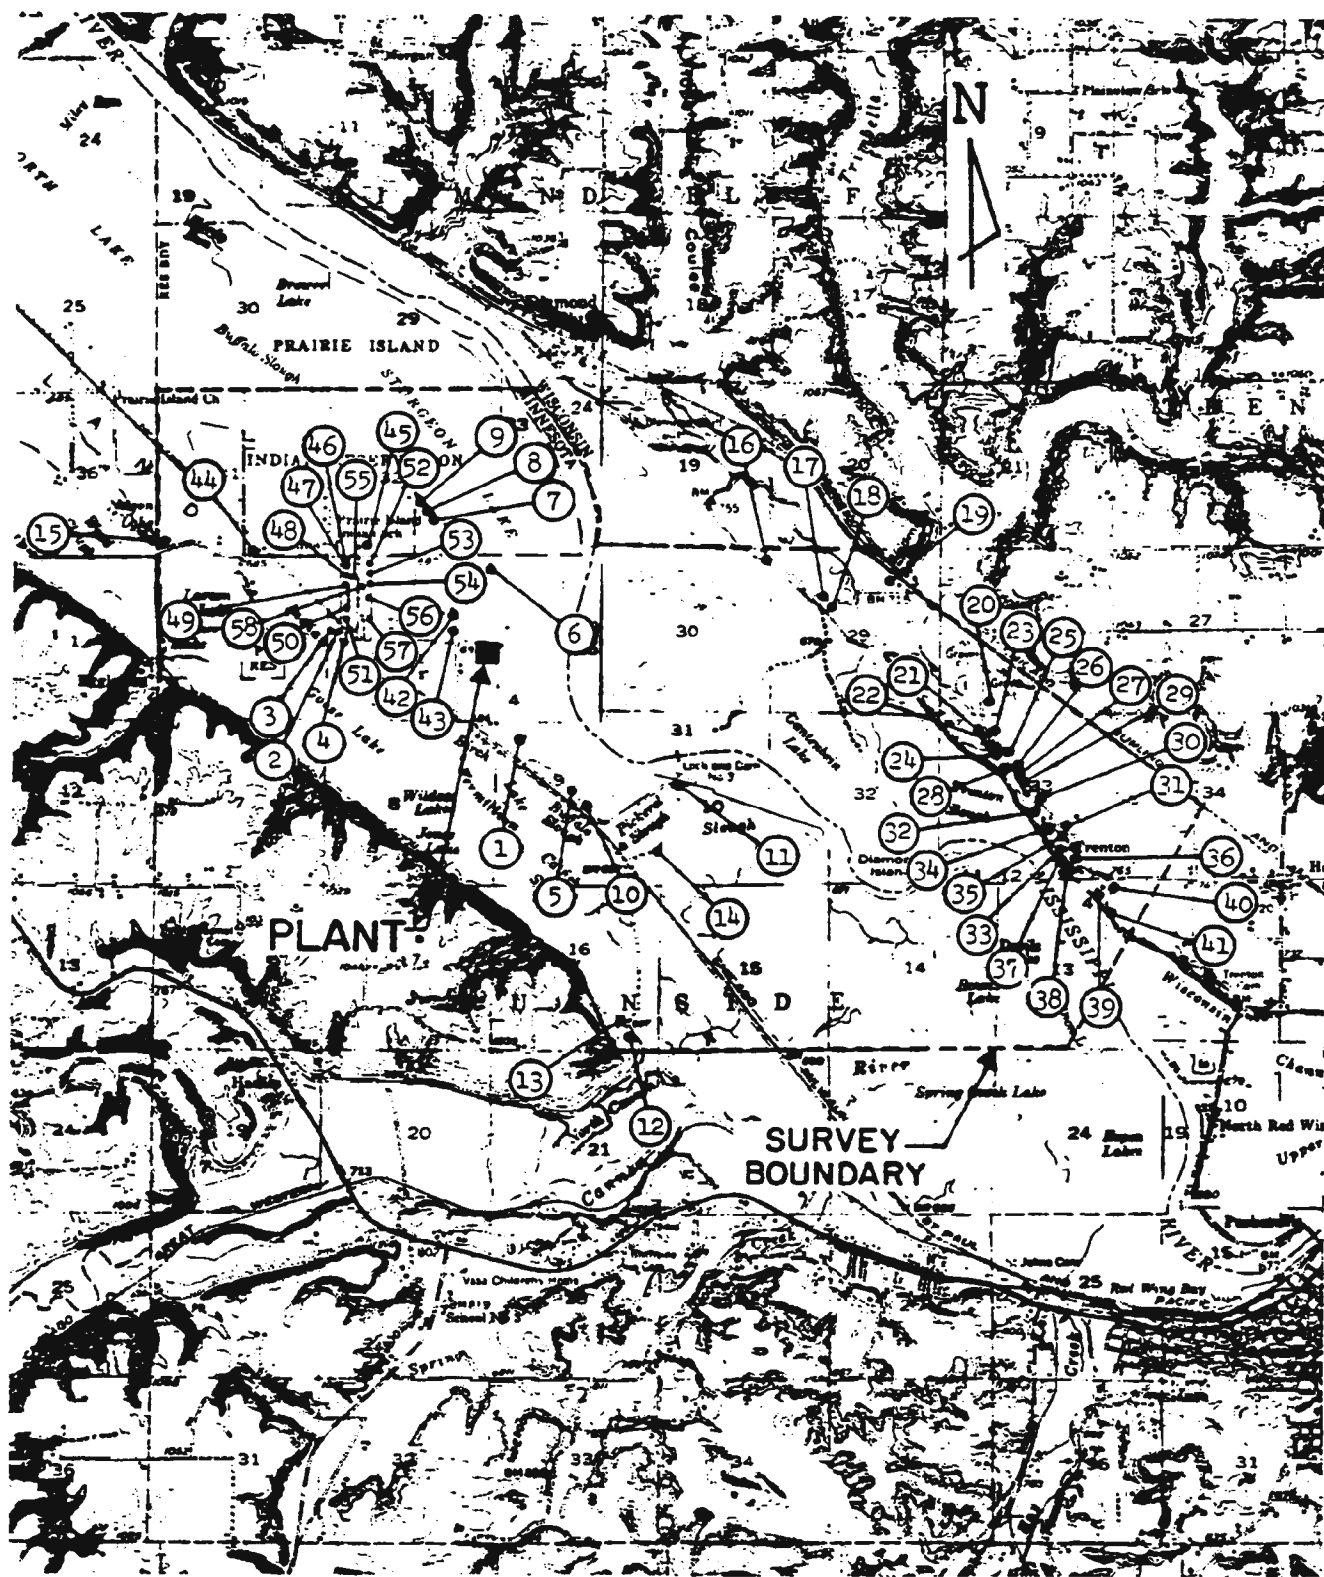

Rev. 0 8/90

Figure 2.4-4
LOCATION OF WELLS
 PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

LOCATION OF WELLS

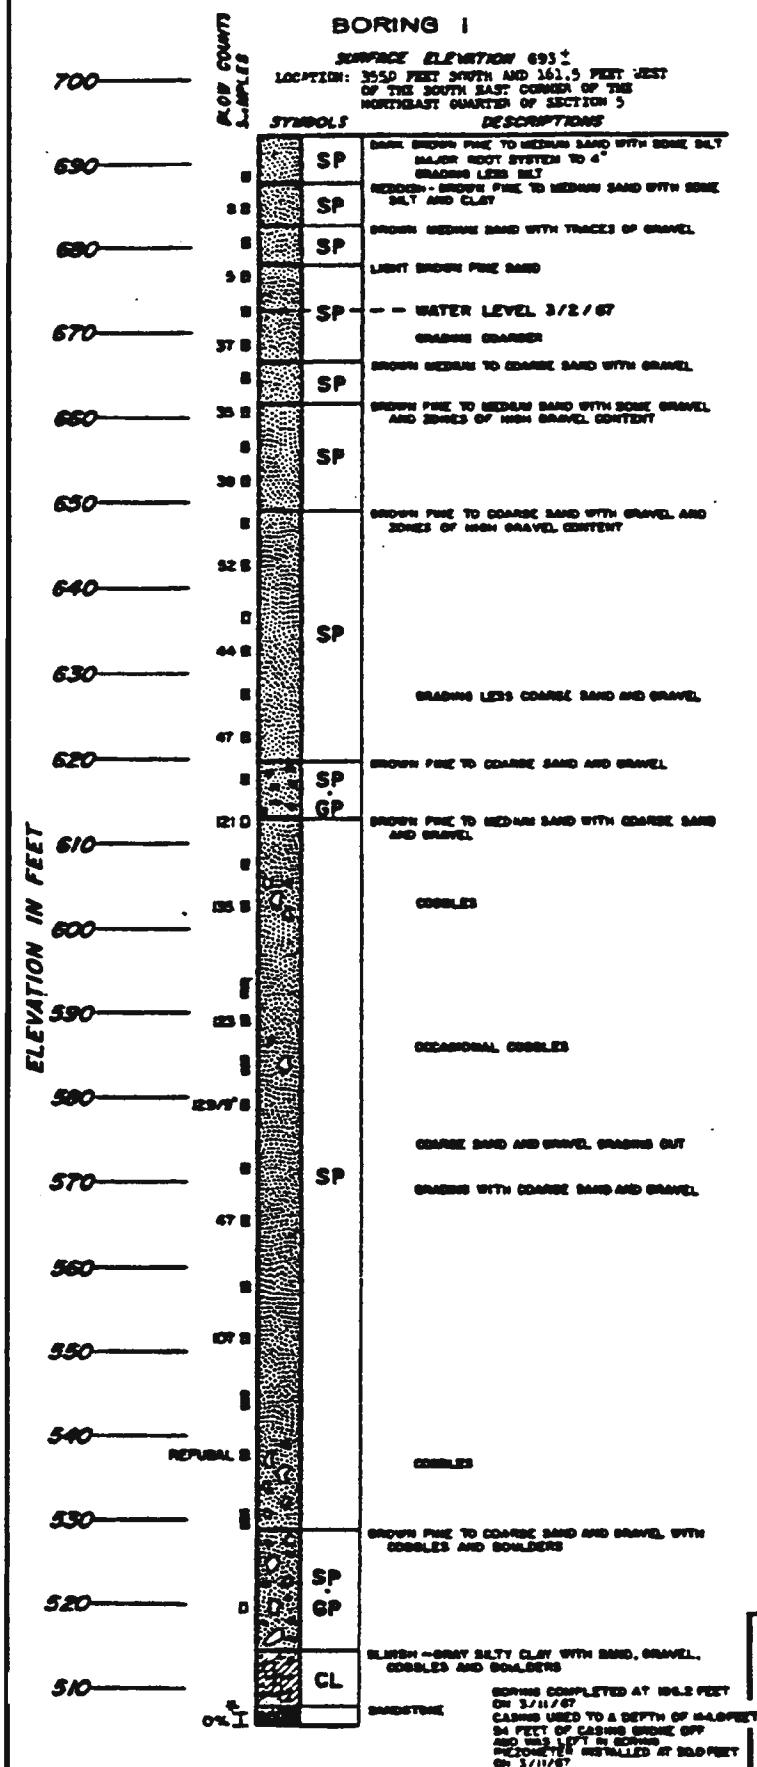

NOTES:

THE GROUND SURFACE ELEVATION WAS INTERPOLATED
FROM DRAMING NUMBER NP-30656-7, TRAILUX ISLAND
GENERATING PLANT, TOPOGRAPHIC MAP OF PLANT
SITE, SHEET 7, DATED 1-28-65 AND REFERS TO
MEAN SEA LEVEL DATUM-1929 ADJUSTMENT.

SP INDICATES A SPHERICAL AND MOORE UNDISTURBED SAMPLE
(TYPE U SAMPLER)

GP INDICATES STANDARD PENETRATION TEST. FIGURES
UNDER THE BLOW COUNT COLUMN INDICATE THE
NUMBER OF BLOWS REQUIRED TO DRIVE A SAMPLER,
WITH AN OUTSIDE DIAMETER OF TWO INCHES, ONE
FOOT WITH A 140 POUND WEIGHT FALLING 30 INCHES.

100% INDICATES DEPTH, LENGTH, AND PERCENT OF CORE
RUN RECOVERED.


BIT OF CORE BARREL SHEARED OFF AND WAS LEFT IN BORING

Rev. 0 8/90

Figure 2.5-1
BORING LOG

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

BORING LOG

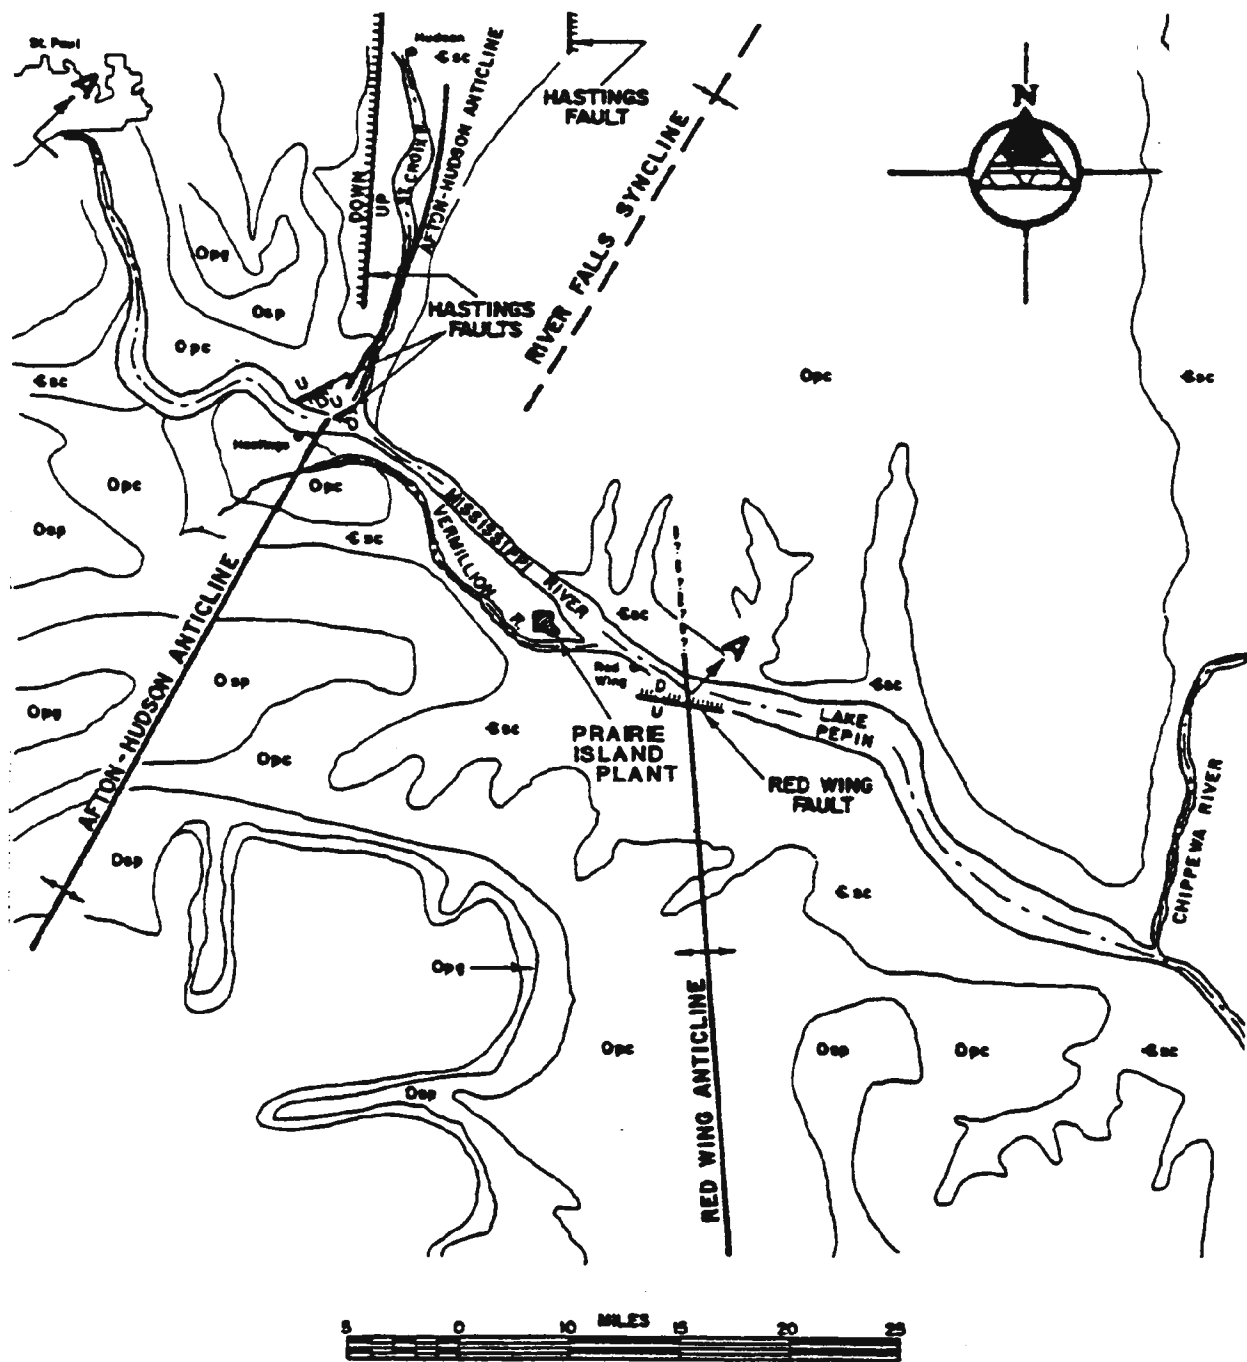

LEGEND

Opg LIMESTONE AND DOLOMITE - PLATTVILLE Fm.
SHALE - GLENWOOD Fm.

Osp SANDSTONE - ST. PETER Fm.

Opc DOLOMITE - SHAKOPEE Fm.
SANDSTONE - NEW RICHMOND Fm.
DOLOMITE - ONOTA Fm.

Soc SANDSTONE - JORDAN Fm.
DOLOMITE AND SILTSTONE - ST. LAWRENCE Fm.
SANDSTONE - FRANCONIA Fm., BRECKBACH Fm.

— FAULT - KNOWN AND IMPLIED

— ANTICLINE AXIS

A A CROSS SECTION A-A -

— SYNCLINE AXIS

REFERENCE: GEOLOGIC MAP OF MINNESOTA
ST. PAUL SHEET 1966


Rev. 0 8/90

Figure 2.5-2

REGIONAL GEOLOGIC MAP

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

REGIONAL GEOLOGIC MAP

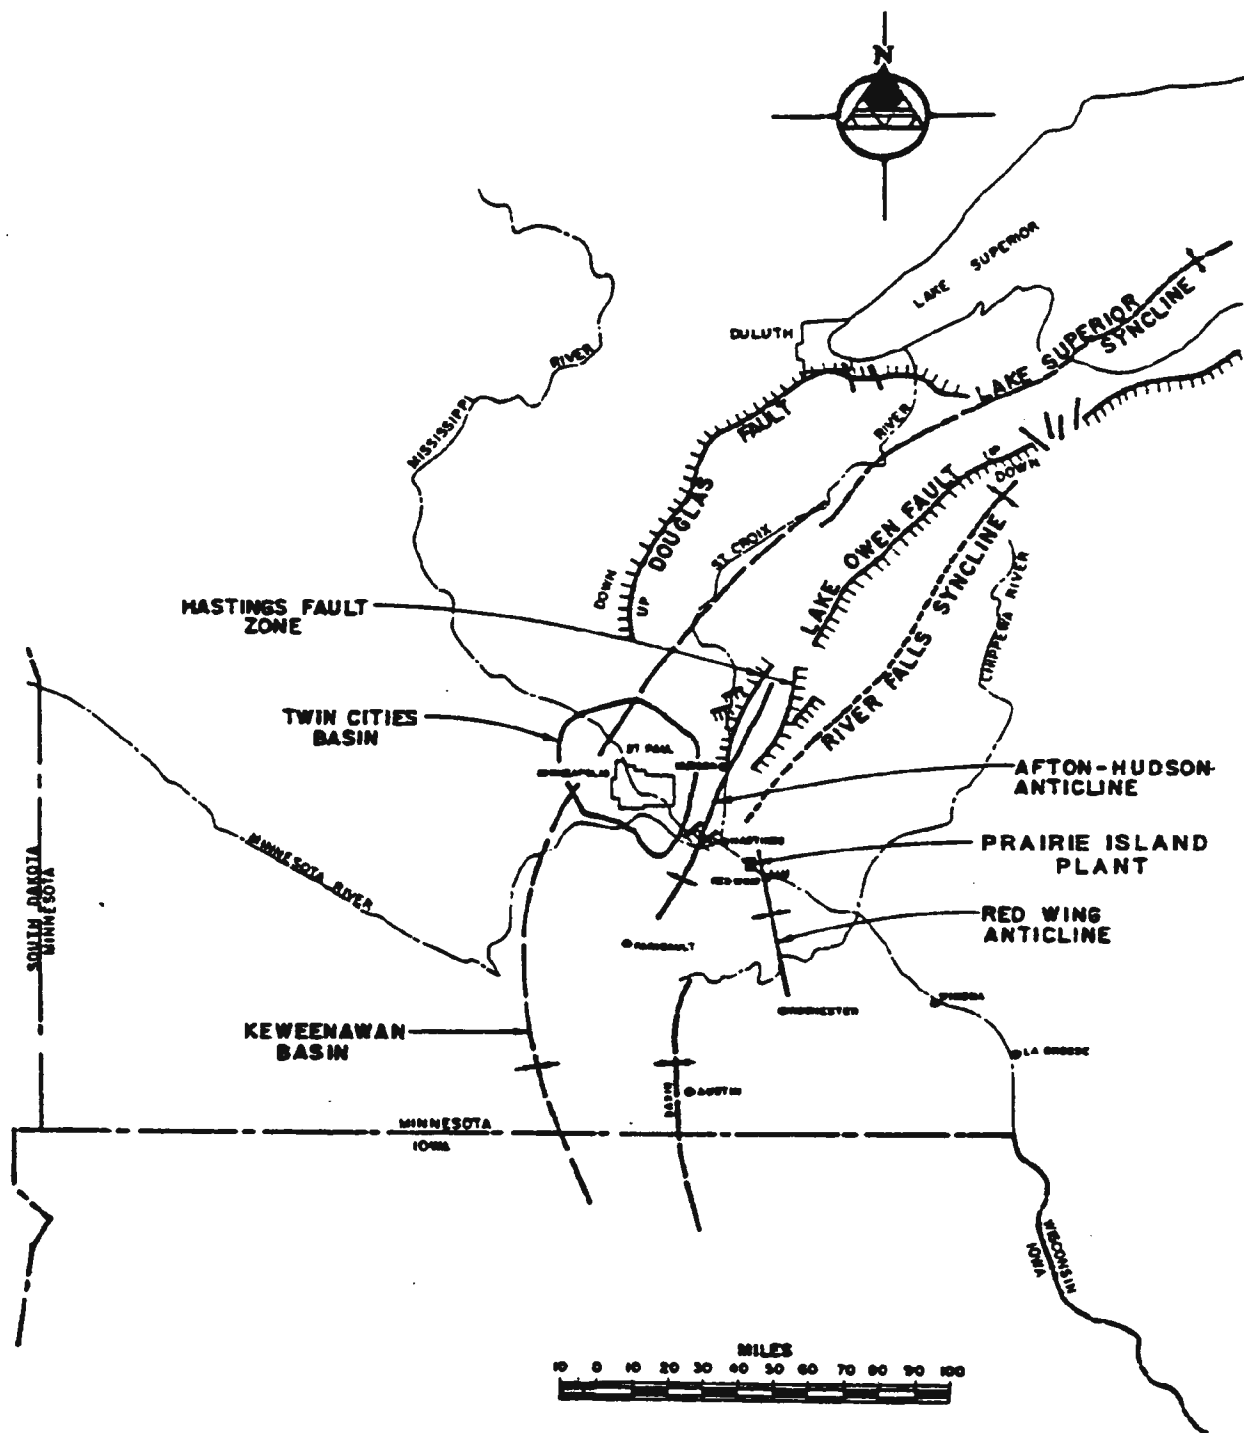

- REFERENCES:**
- 1-TECTONIC MAP OF THE UNITED STATES BY U.S.G.S. AND THE AMERICAN ASSOCIATION OF PETROLEUM GEOLOGISTS 1961
 - 2-UNPUBLISHED STRUCTURE MAP BY MINNESOTA GEOLOGICAL SURVEY


Rev. 0 8/90

Figure 2.5-3 REGIONAL GEOLOGIC STRUCTURE

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

REGIONAL GEOLOGIC STRUCTURE

REGIONAL GEOLOGIC CROSS SECTION

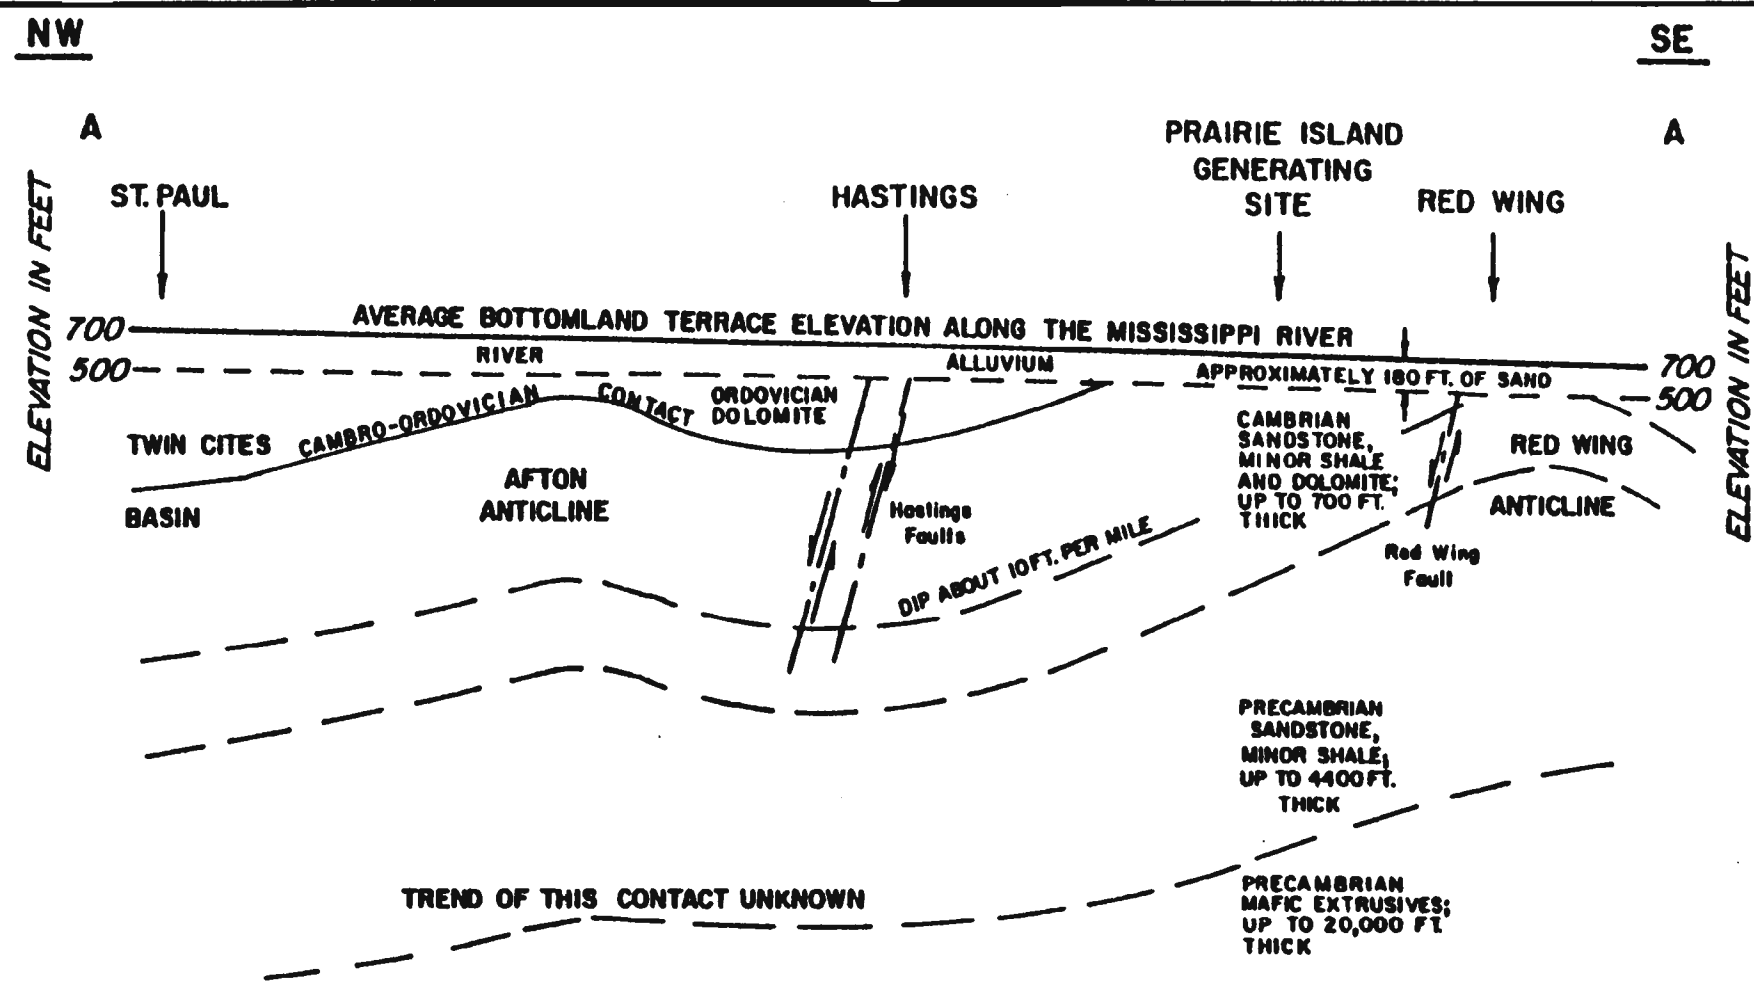


REGIONAL GEOLOGIC CROSS SECTION A-A
PRAIRIE ISLAND GENERATING SITE
RED WING, MINNESOTA

HORIZONTAL SCALE: 1 IN. = APPROX. 6 MILES
 VERTICAL SCALE: VARIABLE AND HIGHLY EXAGGERATED

Rev. 0 8/90

Figure 2.5-4
REGIONAL GEOLOGIC
CROSS SECTION

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

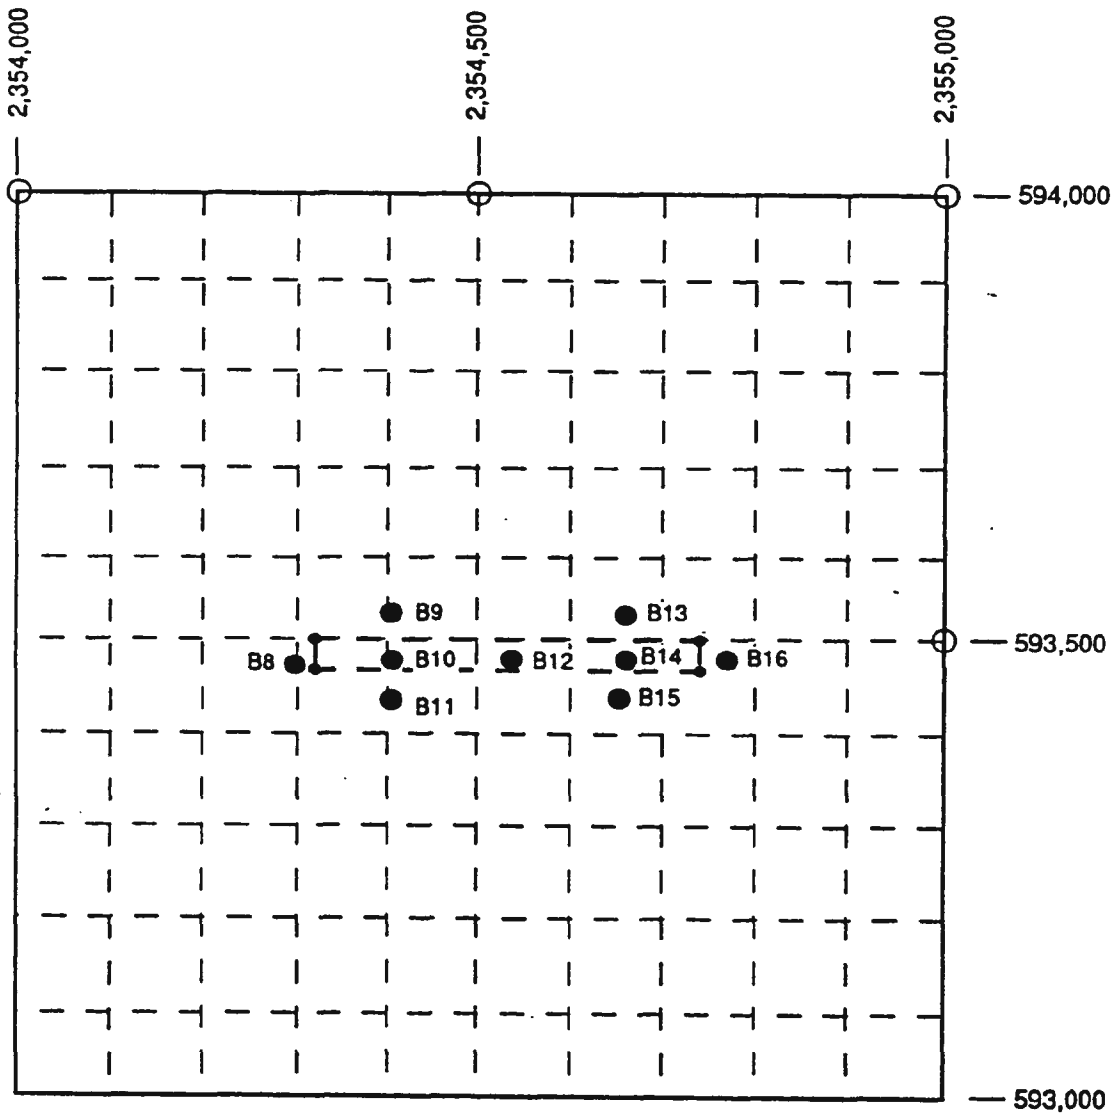

SCALE: 1" = 200'

○ NSP SURVEY CONTROL POINTS

● BORING LOCATION

● NSP SURVEY POINTS CORNERS OF
PORPOSED CONCRETE SLAB



Rev. 2 9/91

Figure 2.5-5
SITE BORING LOCATIONS

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

SITE BORING LOCATIONS

Security-Related Information Figure
Withheld Under 10 CFR 2.390.

Rev 3 4/94

Figure 2.5-6
SITE GRADING PLAN
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

SITE GRADING PLAN

NORTHERN STATES POWER CORPORATION
Nuclear Energy
PRAIRIE ISLAND NUCLEAR GENERATING PLANT
PO BOX 100000
PORTLAND, OREGON 97208

| | | | |
|-----------|-----|-----------|----------|
| DRAWN BY: | VLS | REVISION: | 3 |
| PAGE NO. | | DATE: | 03-30-08 |

FIG2.5-6_REV_3

Security-Related Information Figure Withheld Under 10 CFR 2.390.

REV. 3 4/94

Figure 2.5-7
SITE GRADING -
SECTIONS AND DETAILS
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

SITE GRADING - SECTIONS AND DETAILS

NORTHERN STATES POWER COMPANY
Nuclear Energy
PRAIRIE ISLAND NUCLEAR GENERATING PLANT
220 WEST WASHINGTON
SPokane, Washington 99201

| | | | |
|-----------|-----|-----------|----------|
| DRAWN BY: | VLS | REVISION: | 3 |
| PAGE NO. | | DATE: | 03-30-06 |

FIG2.5-7_REV_3


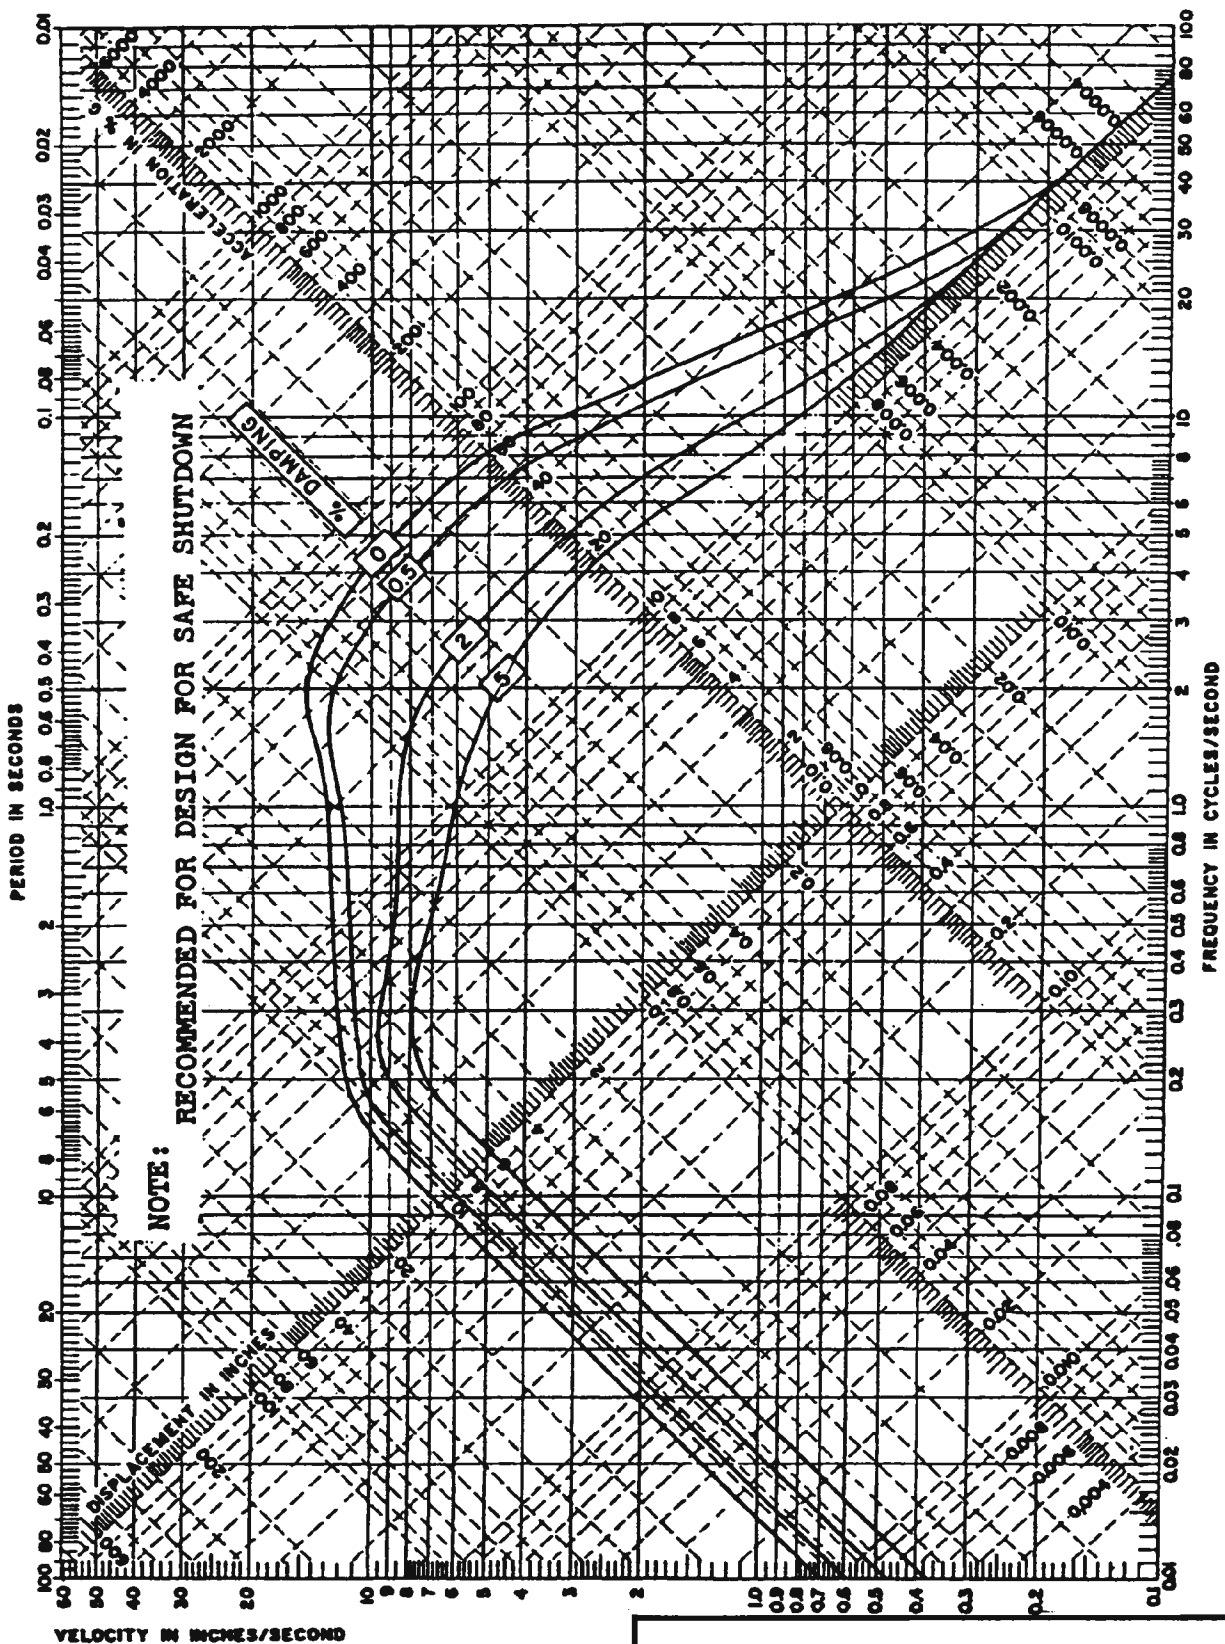


Figure 2.5-8
ISFSI DESIGN EARTHQUAKE
RESPONSE SPECTRA

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

Rev 3 4/94

ISFSI DESIGN EARTHQUAKE RESPONSE SPECTRA

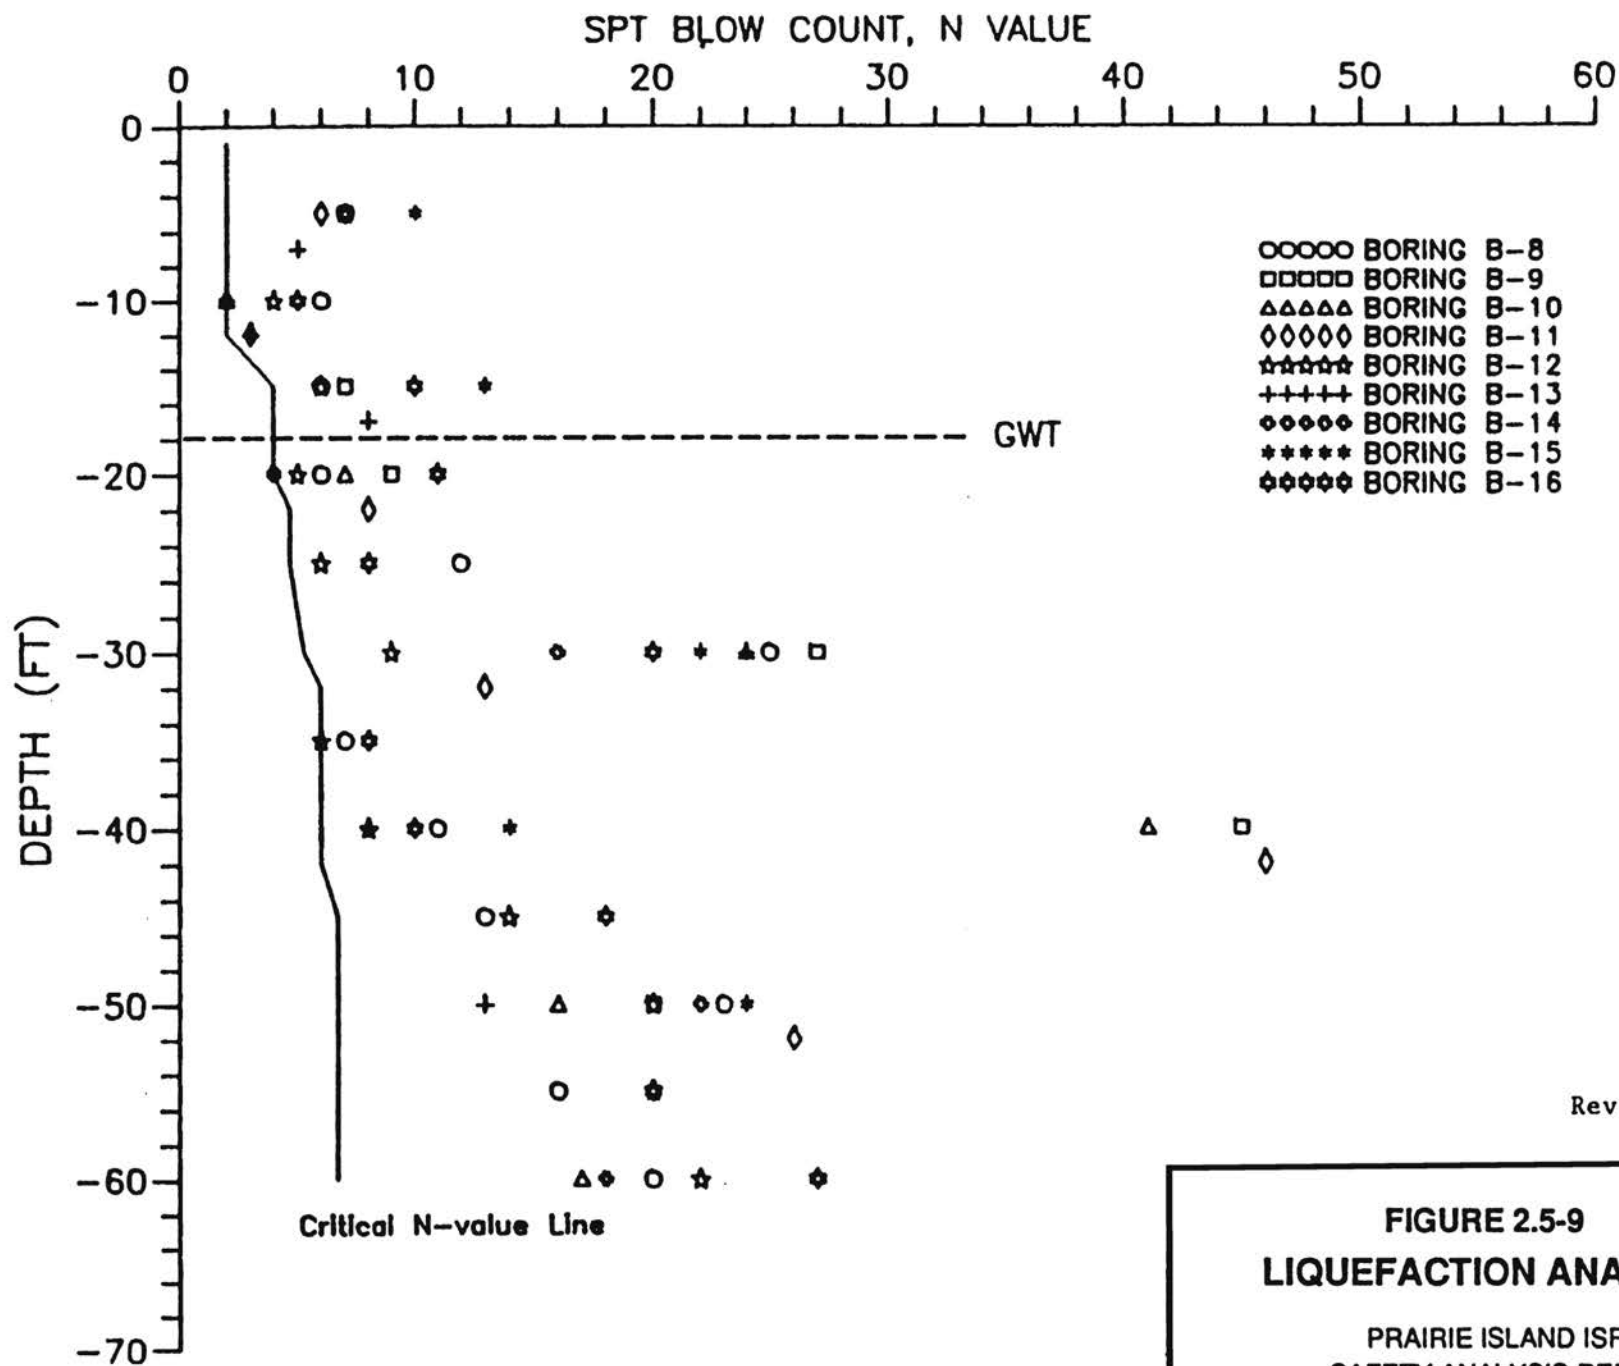

Rev. 2 9/91

FIGURE 2.5-9
LIQUEFACTION ANALYSIS

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

ISFSI SAR

APPENDIX 2A

BORING LOGS

FIELD TEST BORING RECORD COVER SHEET

STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-8

SITE : ISFSI Project Prairie Island (site 2)

J.O. NO. 12911.5401

SHEET 1 OF 3

COORDINATES N 593.482 E 2,354.298 GROUND ELEV. 695.0

INCLINATION Vertical BEARING NA INSPECTOR P. Jacobs

DATE: START/FINISH 6-4-91 / 6-4-91 CONTRACTOR/DRILLER Twin City Testing

STATIC G.W. DEPTH/DATE 19.2 (FT) / 6-4-91 DRILL RIG TYPE CME 55

DEPTH TO BEDROCK NA (FT) TOTAL DEPTH DRILLED 61.0 (FT)

METHODS:

DRILLING SOIL 6" Hollow Stem Augur Above The Water Table, Then Mud Rotary With
2 15/16" Tricone Bit Below The Water Table

SAMPLING SOIL Standard Split Spoon

DRILLING ROCK _____

SPECIAL TESTING OR INSTRUMENTATION _____

COMMENTS:

SUMMARY

SOIL DRILLED 61.0 (FT) ROCK DRILLED NA (FT)

NUMBER SPLIT BARREL SAMPLES 13

NO. & TYPE UNDISTURBED SAMPLES 0

LIST ALL TEST, INSPECTION AND CALIBRATION
 RECORDS ATTACHED: _____

GROUNDWATER (DEPTH BELOW GROUND SURFACE)

DEPTH DATE DEPTH DATE

19.2 6-4-91

NOTES

1. DATUM IS M.S.L. UNLESS OTHERWISE INDICATED
 LEGEND FOR FIELD BORING LOGS

DISTURBED SAMPLES

W - WASH

S - SPLIT BARREL (ASTM - D1586 UNLESS
 OTHERWISE NOTED)

E - ENVIRONMENTAL

Z - OTHER, DESCRIBE:

UNDISTURBED SAMPLES

US - SHELBY TUBE

UF - STATIONARY (FIXED PISTON)

UO - OSTERBERG

UP - FITCHER

UD - DENISON

X - OTHER, DESCRIBE:

N - STD PENETRATION RESISTANCE BLOWS/FT
 (140 LB. HAMMER, UNLESS OTHERWISE NOTED)

REC - RECOVERY

RQD - ROCK QUALITY DESIGNATION

() - INCHES OF SAMPLE RECOVERY

PREPARED BY Paul J. Jacobs

DATE 6-19-91

CHECKED BY M. Gene Zow

DATE 6/19/91

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-8

SITE ISFSI Project Prairie Island (site 2)

J.O. NO.
12911.5401

SHEET 2 OF 3

DRILLER Tom White

INSPECTOR P. Jacobs

| DEPTH (FEET) | SAMPLE TYPE | SAMPLE NUMBER | BLOWS/OR REC/REQ | SPT # VALUE | GROUP SYMBOL | SAMPLE DESCRIPTION |
|-----------------|----------------|------------------|---------------------|----------------|-----------------|---|
| | | | | | | PREPARED BY <i>Paul F. Jacobs</i> CHECKED BY <i>M. Lane Yow 6/19/91</i> |
| 5 | SS | 1 | 1-2-4 (13") | 6 | SM | <u>Silty Sand</u> - Poorly Graded, Fine with silt, Loose, Moist, Reddish Brown |
| 10 | SS | 2 | 1-2-3 (14") | 5 | SP | <u>Sand</u> - Poorly Graded, Fine with minor silt, Loose, Moist, Reddish Brown |
| 15 | SS | 3 | 2-2-3 (15") | 5 | SP | <u>Sand</u> - Poorly Graded, Fine, Med Dense to Loose, Moist, Reddish Brown, sample layered with sands/silty sands |
| 20 | SS | 4 | 2-3-3 (14") | 6 | SP | <u>Sand</u> - Poorly Graded, Fine to Medium, Med Dense to Loose, Moist, Light Brown |
| 25 | SS | 5 | 3-3-3 (16") | 6 | SP | <u>same as above</u> - with a 2" thick gravelly sand seam |
| 30 | SS | 6 | 4-8-5 (13") | 13 | SP | <u>same as above</u> - no gravel |
| 35 | SS | 7 | 8-13-15 (16") | 28 | SP | <u>same as above</u> |
| 40 | SS | 8 | 2-4-4 (12") | 8 | SP | <u>same as above</u> - with one 1" piece of gravel SPT blow count value may not be representative because the rig ran out of gas 1/2 way through the 18" blow count test. Test was resumed after refueling |
| | SS | 9 | 4-6-7 (13") | 13 | SP | <u>same as above</u> - no gravel |
| | SS | 10 | 16-7-9 (9") | 16 | SP | <u>same as above</u> - with sand becoming coarser at the bottom 1" of the sample barrel |

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-8

| | | | | | | | |
|--|----------------|------------------|---------------------|----------------|-----------------|--|---------------------|
| SITE ISFSI Project Prairie Island (site 2) | | | | | | J.O. NO. 12911.5401 | SHEET 3 OF 3 |
| | | | | | | DRILLER Tom White | INSPECTOR P. Jacobs |
| DEPTH (FEET) | SAMPLE TYPE | SAMPLE NUMBER | BLOWS/CR REC/ROD | SPT N VALUE | GROUP SYMBOL | <p align="center">SAMPLE DESCRIPTION</p> <p>PREPARED BY <i>Paul F. Jacobs</i> CHECKED BY <i>M. Gene Zow</i> 6/19/91</p> | |
| 50 | SS | 11 | 12-16-13 (12") | 29 | SW-GW | <p>encountered gravel while drilling at 46.5' (rough drilling)</p> <p><u>Gravelly Sand</u> - Well Graded, Fine to 1" gravel, Dense, wet, Light Brown with Black Gravel</p> | |
| 55 | SS | 12 | 8-11-10 (11") | 21 | SW-GW | <p><u>same as above</u> - with a 1/2" thick lense of silty sand</p> | |
| 60 | SS | 13 | 9-15-13 (14") | 28 | SW-GW | <p><u>same as above</u> - no silt T.D. 61.0'</p> | |
| 65 | | | | | | | |
| 70 | | | | | | | |
| 75 | | | | | | | |
| 80 | | | | | | | |
| 85 | | | | | | | |

FIELD TEST BORING RECORD COVER SHEET

STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-9

SITE : ISFSI Project Prairie Island (site 2)

J.O. NO. 12911.5401

SHEET 1 OF 3

COORDINATES N 593.538 E 2,354.406 GROUND ELEV. 694.6

INCLINATION Vertical BEARING NA INSPECTOR P. Jacobs

DATE: START/FINISH 6-4-91 / 6-5-91 CONTRACTOR/DRILLER Twin City Testing

STATIC G.W. DEPTH/DATE 18.2 (FT) / 6-5-91 DRILL RIG TYPE CME 55

DEPTH TO BEDROCK NA (FT) TOTAL DEPTH DRILLED 51.0 (FT)

METHODS:

DRILLING SOIL 6" Hollow Stem Auger Above The Water Table, Then Mud Rotary With
2 15/16" Tricone Bit Below The Water Table

SAMPLING SOIL Standard Split Spoon

DRILLING ROCK

SPECIAL TESTING OR INSTRUMENTATION

COMMENTS:

SUMMARY

SOIL DRILLED 51.0 (FT) ROCK DRILLED NA (FT)

NUMBER SPLIT BARREL SAMPLES 6

NO. & TYPE UNDISTURBED SAMPLES 0

LIST ALL TEST, INSPECTION AND CALIBRATION
RECORDS ATTACHED:

GROUNDWATER (DEPTH BELOW GROUND SURFACE)

DEPTH DATE DEPTH DATE

18.2 6-5-91

NOTES

1. DATUM IS M.S.L. UNLESS OTHERWISE INDICATED
LEGEND FOR FIELD BORING LOGS

DISTURBED SAMPLES

W - WASH

S - SPLIT BARREL (ASTM - D1586 UNLESS
OTHERWISE NOTED)

E - ENVIRONMENTAL

Z - OTHER, DESCRIBE:

UNDISTURBED SAMPLES

US - SHELBY TUBE

UF - STATIONARY (FIXED PISTON)

UO - OSTERBERG

UP - FITCHER

UD - DENISON

X - OTHER, DESCRIBE:

N - STD PENETRATION RESISTANCE BLOWS/FT
(140 LB. HAMMER, UNLESS OTHERWISE NOTED)

REC - RECOVERY

RQD - ROCK QUALITY DESIGNATION

() - INCHES OF SAMPLE RECOVERY

PREPARED BY Paul F. Jacobs

DATE 6-19-91

CHECKED BY

M. Lane

DATE

6/19/91

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-9

SITE ISFSI Project Prairie Island (site 2)

J.O. NO.
12911.5401

SHEET 2 OF 3

| DEPTH (FEET) | SAMPLE TYPE | SAMPLE NUMBER | BLOWS/OR REC/RQD | SPT N VALUE | GROUP SYMBOL | DRILLER Tom White | INSPECTOR P. Jacobs |
|-----------------|----------------|------------------|---------------------|----------------|-----------------|--|---------------------|
| | | | | | | SAMPLE DESCRIPTION PREPARED BY <i>Paul A. Jacobs</i> CHECKED BY <i>M. Lane 6/19/91</i> | |
| 5 | SS | 1 | 1-2-3 (18") | 5 | SP | <u>Sand</u> - Poorly Graded, Fine, Loose, Moist Reddish Brown | |
| 10 | | | | | | | |
| 15 | SS | 2 | 2-4-3 (18") | 7 | SM | <u>Silty Sand</u> - Poorly Graded, Fine with laminations of silt in fine sand, Loose, Moist, Reddish Brown | |
| 20 | SS | 3 | 3-4-5 (11") | 9 | SP | <u>Sand</u> - Poorly Graded, Fine with 1/4-1/2" gravel, Med Dense to Loose, Wet, Light Brown with Black Gravel | |
| 25 | | | | | | | |
| 30 | SS | 4 | 11-14-16 (16") | 30 | SP | <u>same as above</u> - with no gravel | |
| 35 | | | | | | | |
| 40 | SS | 5 | 15-24-30 (15") | 54 | SP | <u>same as above</u> | |
| | | | | | | encountered gravel while drilling at 44.5' | |

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-9

SITE ISFSI Project Prairie Island (site 2)

J.O. NO.
12911.5401

SHEET 3 OF 3

DRILLER Tom White

INSPECTOR P. Jacobs

DEPTH (FEET) SAMPLE TYPE SAMPLE NUMBER BLOWS/OR REC/RQD SPT N VALUE GROUP SYMBOL

SAMPLE DESCRIPTION

PREPARED BY *Paul F. Jacobs* CHECKED BY *M. Gene Yow* 6/19/91

50 SS 6 10-12-14 (11") 26 SW-GW Gravelly Sand - Well Graded, Fine to 3/4" gravel, Dense, Wet, Tan Brown with Black Gravel
 T.D. 51.0'

SITE : ISFSI Project Prairie Island (site 2)

J.O. NO. 12911.5401

SHEET 1 OF 3

COORDINATES N 593,482 E 2,354,406 GROUND ELEV. 694.6

INCLINATION Vertical BEARING NA INSPECTOR P. Jacobs

DATE: START/FINISH 6-4-91 / 6-4-91 CONTRACTOR/DRILLER Twin City Testing

STATIC G.W. DEPTH/DATE 18.6 (FT) / 6-4-91 DRILL RIG TYPE CME 55

| | | | | | |
|------------------|----|------|---------------------|------|------|
| DEPTH TO BEDROCK | NA | (FT) | TOTAL DEPTH DRILLED | 61.0 | (FT) |
|------------------|----|------|---------------------|------|------|

DRILLING SOIL 6" Hollow Stem Auger Above The Water Table, Then Mud Rotary With
2 15/16" Tricone Bit Below The Water Table

SAMPLING SOIL Standard Split Spoon

DRILLING ROCK

SPECIAL TESTING OR INSTRUMENTATION

COMMENTS:

SOIL DRILLED 61.0 (FT) ROCK DRILLED NA (FT)

NUMBER SPLIT BARREL SAMPLES 7

NO. & TYPE UNDISTURBED SAMPLES

**LIST ALL TEST, INSPECTION AND CALIBRATION
RECORDS ATTACHED:**

GROUNDWATER (DEPTH BELOW GROUND SURFACE)

| DEPTH | DATE | DEPTH | DATE |
|-------|------|-------|------|
|-------|------|-------|------|

18.6

6-4-91

DEPTH

DATE _____

NOTES

1. DATUM IS M.S.L. UNLESS OTHERWISE INDICATED
LEGEND FOR FIELD BORING LOGS

DISTURBED SAMPLES

W - WASH

S - SPLIT BARREL (ASTM - D1586 UNLESS OTHERWISE NOTED)

E - ENVIRONMENTAL

Z - OTHER, DESCRIBE:

UNDISTURBED SAMPLES

US - SHELBY TUBE

UF - STATIONARY (FIXED PISTON)

UO - OSTERBERG

UP - FITCHER

UD - DENLSON

X - OTHER, DESCRIBE:

N - STD PENETRATION RESISTANCE BLOWS/FT

(140 LB. HAMMER, UNLESS OTHERWISE NOTED)

REC - RECOVERY

ROD - ROCK QUALITY DESIGNATION

() - INDICES OF SAMPLE RECOVERY

PREPARED BY *Paul A. Jacobs*

DATE 6-19-91

CHECKED BY *M. Gene You*

DATE 6/19/91

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-10

SITE ISFSI Project Prairie Island (site 2)

J.O. NO.
12911.5401

SHEET 2 OF 3

| DEPTH (FEET) | SAMPLE TYPE | SAMPLE NUMBER | BLOWS/OR REC/REQ | SPT N VALUE | GROUP SYMBOL | DRILLER Tom White | INSPECTOR P. Jacobs |
|--|----------------|------------------|-----------------------|----------------|-----------------|---|---------------------|
| | | | | | | SAMPLE DESCRIPTION PREPARED BY <i>Paul J. Jacobs</i> CHECKED BY <i>M. Gene Young</i> 6/19/91 | |
| 5 | SS | 1 | 1-2-4 (18") | 6 | SM | <u>Silty Sand</u> - Poorly Graded, Fine with silt, Loose, Moist, Reddish Brown | |
| 10 | SS | 2 | 1-1-1 (18") | 2 | SP | <u>Sand</u> - Poorly Graded, Fine with little silt, Loose, Moist, Reddish Brown, Light Brown sand at bottom 1" of sampling barrel | |
| 20 | SS | 3 | 3-3-4 (18") | 7 | SP | <u>Sand</u> - Poorly Graded, Fine, Loose, Wet, Light Brown | |
| 30 | SS | 4 | 10-13-14 (16 1/2") | 27 | SP | <u>same as above</u> | |
| 40 | SS | 5 | 16-23-26 (15") | 49 | SP | <u>same as above</u> | |
| encountered gravel while drilling at 44.0' | | | | | | | |

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-10

SITE ISFSI Project Prairie Island (site 2)

J.O. NO.
12911.5401

SHEET 3 OF 3

| DEPTH (FEET) | SAMPLE TYPE | SAMPLE NUMBER | BLOWS/OR REC/RQD | SPT N VALUE | GROUP SYMBOL | DRILLER Tom White | INSPECTOR P. Jacobs |
|-----------------|----------------|------------------|---------------------|----------------|-----------------|--|---------------------------------------|
| | | | | | | SAMPLE DESCRIPTION | |
| | | | | | | PREPARED BY <i>Paul f. Jacobs</i> | CHECKED BY <i>M. Gene Zow</i> 6/19/91 |
| 50 | SS | 6 | 10-9-11 (12") | 20 | SW-GW | Gravelly Sand - Well Graded, Fine to 1 1/2" gravel, Dense, Wet, Light Brown with Black Gravel | |
| 55 | | | | | | | |
| 60 | SS | 7 | 6-10-13 (9 1/2") | 23 | SW-GW | same as above - with bottom 4" of sample composed of fine sand | |
| 65 | | | | | | T.D. 61.0' | |
| 70 | | | | | | | |
| 75 | | | | | | | |
| 80 | | | | | | | |
| 85 | | | | | | | |

FIELD TEST BORING RECORD COVER SHEET

STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-11

SITE : ISFSI Project Prairie Island (site 2)

J.O. NO. 12911.5401

SHEET 1 OF 3

COORDINATES N 593.432 E 2.354.406 GROUND ELEV. 695.2

INCLINATION Vertical BEARING NA INSPECTOR P. Jacobs

DATE: START/FINISH 6-5-91 / 6-5-91 CONTRACTOR/DRILLER Twin City Testing

STATIC G.W. DEPTH/DATE 20.7 (FT) / 6-5-91 DRILL RIG TYPE CME 55

DEPTH TO BEDROCK NA (FT) TOTAL DEPTH DRILLED 53.5 (FT)

METHODS:

DRILLING SOIL 6" Hollow Stem Auger Above The Water Table. Then Mud Rotary With
2 15/16" Tricone Bit Below The Water Table

SAMPLING SOIL Standard Split Spoon

DRILLING ROCK

SPECIAL TESTING OR INSTRUMENTATION

COMMENTS:

SUMMARY

SOIL DRILLED 53.5 (FT) ROCK DRILLED NA (FT)

NUMBER SPLIT BARREL SAMPLES 6

NO. & TYPE UNDISTURBED SAMPLES 0

LIST ALL TEST, INSPECTION AND CALIBRATION
RECORDS ATTACHED:

GROUNDWATER (DEPTH BELOW GROUND SURFACE)

| DEPTH | DATE | DEPTH | DATE |
|-------|--------|-------|------|
| 20.7 | 6-5-91 | | |
| | | | |
| | | | |

NOTES

1. DATUM IS M.S.L. UNLESS OTHERWISE INDICATED
LEGEND FOR FIELD BORING LOGS

DISTURBED SAMPLES

W - WASH

S - SPLIT BARREL (ASTM - D1586 UNLESS
OTHERWISE NOTED)

E - ENVIRONMENTAL

Z - OTHER, DESCRIBE:

UNDISTURBED SAMPLES

US - SHELBY TUBE

UF - STATIONARY (FIXED PISTON)

UO - OSTERBERG

UP - FITCHER

UD - DENISON

X - OTHER, DESCRIBE:

N - STD PENETRATION RESISTANCE BLOWS/FT

(140 LB. HAMMER, UNLESS OTHERWISE NOTED)

REC - RECOVERY

RQD - ROCK QUALITY DESIGNATION

() - INCHES OF SAMPLE RECOVERY

PREPARED BY Paul A. Jacobs

DATE 6-19-91

CHECKED BY M. Lane Yow

DATE 6/19/91

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-11

SITE ISFSI Project Prairie Island (site 2)

J.O. NO.
12911.5401

SHEET 2 OF 3

DRILLER Tom White

INSPECTOR P. Jacobs

| DEPTH (FEET) | SAMPLE TYPE | SAMPLE NUMBER | BLOWS/CR REC/RQD | SPT N VALUE | GROUP SYMBOL | SAMPLE DESCRIPTION |
|-----------------|----------------|------------------|---------------------|----------------|-----------------|--|
| | | | | | | PREPARED BY <i>Paul A. Jacobs</i> CHECKED BY <i>M. Lane Jones</i> 6/19/91 |
| 5 | SS | 1 | 1-2-2 (18") | 4 | SP | <u>Sand</u> - Poorly Graded, Fine with minor silt, Loose, Moist, Reddish Brown |
| 10 | SS | 2 | 1-1-2 (16") | 3 | SM | <u>Silty Sand</u> - Poorly Graded, Fine with Silt, Loose, Moist, Reddish Brown |
| 15 | | | | | | thin gravel layer encountered while drilling at 17.5' |
| 20 | SS | 3 | 1-2-7 (18") | 9 | SP | <u>Sand</u> - Poorly Graded, Fine, Med Dense to Loose, Wet, Light Brown |
| 25 | | | | | | |
| 30 | SS | 4 | 5-7-8 (10") | 15 | SP | <u>same as above</u> |
| 35 | | | | | | |
| 40 | SS | 5 | 16-26-30 (13") | 56 | SP | <u>same as above</u> - with 8 thin horizontal layers of organic deposits |

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-11

SITE ISFSI Project Prairie Island (site 2)

J.O. NO.
12911.5401

SHEET 3 OF 3

DRILLER Tom White

INSPECTOR P. Jacobs

DEPTH
(FEET)

SAMPLE
TYPE

SAMPLE
NUMBER

BLOWS/OR
REC/RQD

SPT N
VALUE

GROUP
SYMBOL

SAMPLE DESCRIPTION

PREPARED BY *Paul F. Jacobs* CHECKED BY *M. Lane* 6/19/91

gravel encountered while drilling at 46.6'

SS

6

15-16-18
(11")

34

SW-GW

Gravelly Sand - Well Graded, Fine to 1 1/4" Gravel,
 Dense, Wet, Light Brown with Black Gravel
 T.D. 53.3'

FIELD TEST BORING RECORD COVER SHEET

STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-12

SITE : ISFSI Project Prairie Island (site 2)

J.O. NO. 12911.5401

SHEET 1 OF 3

COORDINATES N 593.482 E 2,354.534 GROUND ELEV. 690.5

INCLINATION Vertical BEARING NA INSPECTOR P. Jacobs

DATE: START/FINISH 6-4-91 / 6-4-91 CONTRACTOR/DRILLER Twin City Testing

STATIC G.W. DEPTH/DATE 17.9 (FT) / 6-4-91 DRILL RIG TYPE CME 55

DEPTH TO BEDROCK NA (FT) TOTAL DEPTH DRILLED 61.0 (FT)

METHODS:

DRILLING SOIL 6" Hollow Stem Auger Above The Water Table, Then Mud Rotary With
2 15/16" Tricone Bit Below The Water Table

SAMPLING SOIL Standard Split Spoon

DRILLING ROCK _____

SPECIAL TESTING OR INSTRUMENTATION _____

COMMENTS: _____

SUMMARY

SOIL DRILLED 61.0 (FT) ROCK DRILLED NA (FT)

NUMBER SPLIT BARREL SAMPLES 13

NO. & TYPE UNDISTURBED SAMPLES 0

LIST ALL TEST, INSPECTION AND CALIBRATION
 RECORDS ATTACHED: _____

GROUNDWATER (DEPTH BELOW GROUND SURFACE)

| DEPTH | DATE | DEPTH | DATE |
|-------|--------|-------|------|
| 17.9 | 6-4-91 | | |
| | | | |
| | | | |

NOTES

1. DATUM IS M.S.L. UNLESS OTHERWISE INDICATED
 LEGEND FOR FIELD BORING LOGS

DISTURBED SAMPLES

W - WASH

S - SPLIT BARREL (ASTM - D1586 UNLESS
 OTHERWISE NOTED)

E - ENVIRONMENTAL

Z - OTHER, DESCRIBE:

UNDISTURBED SAMPLES

US - SHELBY TUBE

UF - STATIONARY (FIXED PISTON)

UO - OSTERBERG

UP - FITCHER

UD - DENISON

X - OTHER, DESCRIBE:

N - STD PENETRATION RESISTANCE BLOWS/FT
 (140 LB. HAMMER, UNLESS OTHERWISE NOTED)

REC - RECOVERY

RQD - ROCK QUALITY DESIGNATION

() - INCHES OF SAMPLE RECOVERY

PREPARED BY Paul F. Jacobs

DATE 6-19-91

CHECKED BY M. Lane

DATE 6/19/91

FIELD BORING LOG

STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-12

SITE ISFSI Project Prairie Island (site 2)

J.O. NO.
12911.5401

SHEET 2 OF 3

DRILLER Tom White

INSPECTOR P. Jacobs

| DEPTH (FEET) | SAMPLE TYPE | SAMPLE NUMBER | BLOWS/OR REC/ROD | SPT N VALUE | GROUP SYMBOL | SAMPLE DESCRIPTION |
|-----------------|----------------|------------------|---------------------|----------------|-----------------|--|
| | | | | | | PREPARED BY <i>Paul F. Jacobs</i> CHECKED BY <i>M. Lane Young</i> 6/19/91 |
| | SS | 1 | 1-2-4 (17") | 6 | SM | <u>Silty Sand</u> - Poorly Graded, Fine with silt, Loose, Moist, Reddish Brown |
| 5 | SS | 2 | 1-2-3 (16") | 5 | SP | <u>Sand</u> - Poorly Graded, Fine with minor silt, Loose, Moist, Reddish Brown |
| 10 | SS | 3 | 2-2-1 (18") | 3 | SM | <u>Silty Sand</u> - Poorly Graded, Very Fine, Loose, Moist, Reddish Brown |
| 15 | SS | 4 | 2-2-4 (18") | 6 | SP | <u>Sand</u> - Poorly Graded, Fine to Medium, Med Dense to Loose, Moist, Light Brown |
| 20 | SS | 5 | 1-2-3 (18") | 5 | SP | <u>same as above</u> |
| 25 | SS | 6 | 3-3-4 (12") | 7 | SP | <u>same as above</u> |
| 30 | SS | 7 | 4-4-6 (14 1/2") | 10 | SP | <u>same as above</u> |
| 35 | SS | 8 | 3-3-4 (11") | 7 | SP | <u>same as above</u> |
| 40 | SS | 9 | 4-5-5 (13 1/2") | 10 | SP | <u>same as above</u> |
| | SS | 10 | 13-10-7 (9") | 17 | SW-GW | encountered gravel while drilling at 44.0' <u>Gravelly Sand</u> - Well Graded, Fine to 1" Gravel, Dense, Wet, Light Brown with Black Gravel |

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-12

SITE ISFSI Project Prairie Island (site 2)

J.O. NO.
12911.5401

SHEET 3 OF 3

DRILLER Tom White

INSPECTOR P. Jacobs

DEPTH
(FEET)SAMPLE
TYPESAMPLE
NUMBERBLOWS/OR
REC/RQDSPT N
VALUEGROUP
SYMBOL

SAMPLE DESCRIPTION

PREPARED BY

Paul F. Jacobs

CHECKED BY

M. Gene Young 6/19/91

| | | | | | | |
|----|----|----|-----------------------|----|-------|--|
| 50 | SS | 11 | 10-14-11 (10 1/2") | 25 | SW | <u>Sand</u> - Well Graded, Coarse with minor gravel, Dense, Wet, Light Brown with Black Gravel |
| 55 | SS | 12 | 10-13-14 (12") | 27 | SW-GW | <u>Gravelly Sand</u> - as above |
| 60 | SS | 13 | 7-13-17 (14") | 30 | SW | <u>Sand</u> - Well Graded, Coarse with minor gravel, Dense, Light Brown with Black Gravel T.D. 61.0' |
| 65 | | | | | | |
| 70 | | | | | | |
| 75 | | | | | | |
| 80 | | | | | | |
| 85 | | | | | | |

FIELD TEST BORING RECORD COVER SHEET

STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-13

SITE : ISFSI Project Prairie Island (site 2)

J.O. NO. 12911.5401

SHEET 1 OF 3

COORDINATES N 593.532 E 2,354.662 GROUND ELEV. 690.2

INCLINATION Vertical BEARING NA INSPECTOR P. Jacobs

DATE: START/FINISH 6-6-91 / 6-6-91 CONTRACTOR/DRILLER Twin City Testing

STATIC G.W. DEPTH/DATE 16.0 (FT) / 6-6-91 DRILL RIG TYPE CME 55

DEPTH TO BEDROCK NA (FT) TOTAL DEPTH DRILLED 51.0 (FT)

METHODS:

DRILLING SOIL 6" Hollow Stem Auger Above The Water Table, Then Mud Rotary With
2 15/16" Tricone Bit Below The Water Table

SAMPLING SOIL Standard Split Spoon

DRILLING ROCK

SPECIAL TESTING OR INSTRUMENTATION

COMMENTS:

SUMMARY

SOIL DRILLED 51.0 (FT) ROCK DRILLED NA (FT)

NUMBER SPLIT BARREL SAMPLES 7

NO. & TYPE UNDISTURBED SAMPLES 0

LIST ALL TEST, INSPECTION AND CALIBRATION
RECORDS ATTACHED:

GROUNDWATER (DEPTH BELOW GROUND SURFACE)

DEPTH DATE DEPTH DATE

16.0 6-6-91

NOTES

1. DATUM IS M.S.L. UNLESS OTHERWISE INDICATED
LEGEND FOR FIELD BORING LOGS

DISTURBED SAMPLES

W - WASH

S - SPLIT BARREL (ASTM - D1586 UNLESS
OTHERWISE NOTED)

E - ENVIRONMENTAL

Z - OTHER, DESCRIBE:

UNDISTURBED SAMPLES

US - SHELBY TUBE

UF - STATIONARY (FIXED PISTON)

UO - OSTERBERG

UP - PITCHER

UD - DENISON

X - OTHER, DESCRIBE:

N - STD PENETRATION RESISTANCE BLOWS/FT

(140 LB. HAMMER, UNLESS OTHERWISE NOTED)

REC - RECOVERY

RQD - ROCK QUALITY DESIGNATION

() - INCHES OF SAMPLE RECOVERY

PREPARED BY Paul A. Jacobs

DATE 6-19-91

CHECKED BY M. Gene Young

DATE 6/19/91

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-13

SITE ISFSI Project Prairie Island (site 2)

J.O. NO.
12911.5401

SHEET 2 OF 3

DRILLER Tom White

INSPECTOR P. Jacobs

| DEPTH (FEET) | SAMPLE TYPE | SAMPLE NUMBER | BLOWS/OR REC/ROD | SPT N VALUE | GROUP SYMBOL | SAMPLE DESCRIPTION PREPARED BY <i>Paul A. Jacobs</i> CHECKED BY <i>M. Lane Young</i> 6/19/91 |
|-----------------|----------------|------------------|---------------------|----------------|-----------------|---|
| | | | | | | |
| 5 | SS | 1 | 5-6-8 (18") | 14 | SM | <u>Silty Sand</u> - Poorly Graded, Fine with silt, Loose, Moist, Reddish Brown |
| 10 | SS | 2 | 2-2-2 (18") | 4 | SP | <u>Sand</u> - Poorly Graded, Fine with minor silt, Very Loose, Moist, Reddish Brown |
| 15 | SS | 3 | 1-1-2 (15") | 3 | SM | <u>Silty Sand</u> - Poorly Graded, Fine with silt, Loose, Moist, Reddish Brown |
| 20 | SS | 4 | 2-3-5 (18") | 8 | SP | <u>Sand</u> - Poorly Graded, Fine with traces of gravel, Loose to Med Dense, Wet, Light Brown |
| 30 | SS | 5 | 5-6-5 (11 1/2") | 11 | SP | <u>same as above</u> - no gravel |
| 40 | SS | 6 | 4-5-5 (12") | 10 | SP | <u>same as above</u> |
| | | | | | | encountered gravel while drilling at 44.0' |

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-13

SITE ISFSI Project Prairie Island (site 2)

J.O. NO.
12911.5401

SHEET 3 OF 3

| DEPTH (FEET) | SAMPLE TYPE | SAMPLE NUMBER | BLOWS/OR REC/REQ | SPT N VALUE | GROUP SYMBOL | DRILLER Tom White | INSPECTOR P. Jacobs |
|--|----------------|------------------|---------------------|----------------|-----------------|--|---------------------|
| <p align="center">SAMPLE DESCRIPTION</p> <p>PREPARED BY <i>Paul F. Jacobs</i> CHECKED BY <i>M. Gene Zow</i> 6/19/91</p> | | | | | | | |
| 50 | SS | 7 | 11-10-7 (12") | 17 | SW-GW | <p><u>Gravelly Sand</u> - Well Graded, Fine to 1 1/4" gravel, Dense, Wet, Light Brown with Black Gravel T.D. 51.0'</p> | |
| 55 | | | | | | | |
| 60 | | | | | | | |
| 65 | | | | | | | |
| 70 | | | | | | | |
| 75 | | | | | | | |
| 80 | | | | | | | |
| 85 | | | | | | | |

FIELD TEST BORING RECORD COVER SHEET

STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-14

SITE : ISFSI Project Prairie Island (site 2)

J.O. NO. 12911.5401

SHEET 1 OF 3

COORDINATES N 593.482 E 2.354.662 GROUND ELEV. 690.3

INCLINATION Vertical BEARING NA INSPECTOR P. Jacobs

DATE: START/FINISH 6-5-91 / 6-5-91 CONTRACTOR/DRILLER Twin City Testing

STATIC G.W. DEPTH/DATE 18.0 (FT) / 6-5-91 DRILL RIG TYPE CME 55

DEPTH TO BEDROCK NA (FT) TOTAL DEPTH DRILLED 61.0 (FT)

METHODS:

DRILLING SOIL 6" Hollow Stem Auger Above The Water Table, Then Mud Rotary With
2 15/16" Tricone Bit Below The Water Table

SAMPLING SOIL Standard Split Spoon

DRILLING ROCK

SPECIAL TESTING OR INSTRUMENTATION

COMMENTS:

SUMMARY

SOIL DRILLED 61.0 (FT) ROCK DRILLED NA (FT)

NUMBER SPLIT BARREL SAMPLES 7

NO. & TYPE UNDISTURBED SAMPLES 0

LIST ALL TEST, INSPECTION AND CALIBRATION
RECORDS ATTACHED:

GROUNDWATER (DEPTH BELOW GROUND SURFACE)

| DEPTH | DATE | DEPTH | DATE |
|-------|--------|-------|------|
| 18.0 | 6-5-91 | | |
| | | | |
| | | | |

NOTES

1. DATUM IS M.S.L. UNLESS OTHERWISE INDICATED
LEGEND FOR FIELD BORING LOGS

DISTURBED SAMPLES

W - WASH
 S - SPLIT BARREL (ASTM - D1586 UNLESS
 OTHERWISE NOTED)
 E - ENVIRONMENTAL
 Z - OTHER, DESCRIBE:

UNDISTURBED SAMPLES

US - SHIELBY TUBE
 UF - STATIONARY (FIXED PISTON)
 UO - OSTERBERG
 UP - PITCHER
 UD - DENISON
 X - OTHER, DESCRIBE:

N - STD PENETRATION RESISTANCE BLOWS/FT
 (140 LB. HAMMER, UNLESS OTHERWISE NOTED)
 REC - RECOVERY
 RQD - ROCK QUALITY DESIGNATION
 () - INCHES OF SAMPLE RECOVERY

PREPARED BY *Paul F. Jacobs* DATE 6-19-91
 CHECKED BY *M. Gene Yow* DATE 6/19/91

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-14

SITE ISFSI Project Prairie Island (site 2)

J.O. NO.
12911.5401

SHEET 2 OF 3

| DEPTH (FEET) | SAMPLE TYPE | SAMPLE NUMBER | BLOWS/OR REC/RQD | SPT N VALUE | GROUP SYMBOL | DRILLER Tom White | INSPECTOR P. Jacobs |
|-----------------|----------------|------------------|---------------------|----------------|-----------------|--|---------------------|
| | | | | | | SAMPLE DESCRIPTION PREPARED BY <i>Paul F. Jacobs</i> CHECKED BY <i>M. Bone</i> <i>6/19/91</i> | |
| 5 | SS | 1 | 1-3-6 (17") | 9 | SP | <u>Sand</u> - Poorly Graded, Fine with minor silt, Loose, Moist, Reddish Brown | |
| 10 | SS | 2 | 1-1-1 (18") | 2 | SP | <u>same as above</u> - slightly lighter in color | |
| 20 | SS | 3 | 1-1-3 (18") | 4 | SP | <u>Sand</u> - Poorly Graded, Fine, Loose, Wet, Light Brown | |
| 30 | SS | 4 | 7-9-9 (14") | 18 | SP | <u>same as above</u> | |
| 40 | SS | 5 | 4-6-6 (12") | 12 | SP | <u>same as above</u> | |

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-14

SITE ISFSI Project Prairie Island (site 2)

J.O. NO.
12911.5401

SHEET 3 OF 3

DRILLER Tom White

INSPECTOR P. Jacobs

SAMPLE DESCRIPTION

PREPARED BY *Paul A. Jacobs* CHECKED BY *M. Gene Young* 6/19/91

encountered gravel while drilling at 46.0'

50 SS 6 17-16-12 28 SW-GW Gravely Sand - Well Graded, Fine to 1 3/4" gravel,
(9") Dense, Wet, Light Brown with Black Gravel

60 SS 7 10-12-13 25 SW-GW same as above - with 3/4" gravel max
(9") T.D. 61.0'

FIELD TEST BORING RECORD COVER SHEET

STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-15

SITE : ISFSI Project Prairie Island (site 2)

J.O. NO. 12911.5401

SHEET 1 OF 3

COORDINATES N 593.432 E 2,354.652 GROUND ELEV. 690.0

INCLINATION Vertical BEARING NA INSPECTOR P. Jacobs

DATE: START/FINISH 6-5-91 / 6-5-91 CONTRACTOR/DRILLER Twin City Testing

STATIC G.W. DEPTH/DATE 18.1 (FT) / 6-5-91 DRILL RIG TYPE CME 55

DEPTH TO BEDROCK NA (FT) TOTAL DEPTH DRILLED 51.0 (FT)

METHODS:

DRILLING SOIL 6" Hollow Stem Auger Above The Water Table, Then Mud Rotary With
2 15/16" Tricone Bit Below The Water Table

SAMPLING SOIL Standard Split Spoon

DRILLING ROCK

SPECIAL TESTING OR INSTRUMENTATION

COMMENTS:

SUMMARY

SOIL DRILLED 51.0 (FT) ROCK DRILLED NA (FT)

NUMBER SPLIT BARREL SAMPLES 6

NO. & TYPE UNDISTURBED SAMPLES

LIST ALL TEST, INSPECTION AND CALIBRATION
RECORDS ATTACHED:

GROUNDWATER (DEPTH BELOW GROUND SURFACE)

| DEPTH | DATE | DEPTH | DATE |
|-------|--------|-------|------|
| 18.1 | 6-5-91 | | |
| | | | |
| | | | |

NOTES

1. DATUM IS M.S.L. UNLESS OTHERWISE INDICATED
LEGEND FOR FIELD BORING LOGS

DISTURBED SAMPLES

W - WASH

S - SPLIT BARREL (ASTM - D1586 UNLESS
OTHERWISE NOTED)

E - ENVIRONMENTAL

Z - OTHER, DESCRIBE:

UNDISTURBED SAMPLES

US - SHELBY TUBE

UF - STATIONARY (FIXED PISTON)

UO - OSTERBERG

UP - PITCHER

UD - DENISON

X - OTHER, DESCRIBE:

N - STD PENETRATION RESISTANCE BLOWS/FT

(140 LB. HAMMER, UNLESS OTHERWISE NOTED)

REC - RECOVERY

RQD - ROCK QUALITY DESIGNATION

() - INCHES OF SAMPLE RECOVERY

PREPARED BY Paul J. Anzola

DATE 6-9-91

CHECKED BY M. Lane Yow

DATE 6/19/91

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-15

| | | | | | | | |
|--|----------------|------------------|----------------------|----------------|-----------------|---|---|
| SITE ISFSI Project Prairie Island (site 2) | | | | | | J.O. NO. 12911.5401 | SHEET 2 OF 3 |
| | | | | | | DRILLER Tom White | INSPECTOR P. Jacobs |
| DEPTH (FEET) | SAMPLE TYPE | SAMPLE NUMBER | BLOWS/OR REC/REQ | SPT N VALUE | GROUP SYMBOL | SAMPLE DESCRIPTION | |
| | | | | | | PREPARED BY <i>Paul F. Jacobs</i> | CHECKED BY <i>M. Lane Young</i> 6/19/91 |
| 5 | SS | 1 | 3-4-3 (15") | 7 | SM | <u>Silty Sand</u> - Poorly Graded, Fine with silt, Loose, Moist, Reddish Brown | |
| 10 | | | | | | thin gravel layer encountered while drilling at 12.5' | |
| 15 | SS | 2 | 3-5-7 (16") | 12 | SP | <u>Sand</u> - Poorly Graded, Fine, Loose to Med Dense Moist, Light Brown | |
| 20 | SS | 3 | 1-2-2 (18") | 4 | SP | <u>same as above</u> - wet | |
| 25 | | | | | | | |
| 30 | SS | 4 | 6-12-13 (11 1/2") | 25 | SP | <u>same as above</u> | |
| 35 | | | | | | | |
| 40 | SS | 5 | 5-7-10 (9 1/2") | 17 | SP | <u>same as above</u> | |
| | | | | | | encountered gravel while drilling at 44.0' | |

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-15

SITE ISFSI Project Prairie Island (site 2)

J.O. NO.
12911.5401

SHEET 3 OF 3

DRILLER Tom White

INSPECTOR P. Jacobs

| DEPTH (FEET) | SAMPLE TYPE | SAMPLE NUMBER | BLOWS/OR REC/ROD | SPT N VALUE | GROUP SYMBOL |
|-----------------|----------------|------------------|---------------------|----------------|-----------------|
|-----------------|----------------|------------------|---------------------|----------------|-----------------|

SAMPLE DESCRIPTION

PREPARED BY

Paul F. Jacobs

CHECKED BY

M. Gene Jones 6/19/91

| | | | | | |
|----|----|---|----------------------|----|-------|
| 50 | SS | 6 | 12-16-15 (9 1/2") | 31 | SW-GW |
|----|----|---|----------------------|----|-------|

Gravelly Sand - Well Graded, Fine to 1" gravel, Dense,
 Wet, Light Brown with Black Gravel
 T.D. 51.0'

FIELD TEST BORING RECORD COVER SHEET

STONE & WEBSTER ENGINEERING CORP.

| | | | |
|--|--|---------------------|-----------------|
| SITE : ISPSI Project Prairie Island (site 2) | | J.O. NO. 12911.5401 | BORING NO. B-16 |
| | | | SHEET 1 OF 3 |

COORDINATES N 593.482 E 2.354.770 GROUND ELEV. 693.0

INCLINATION Vertical BEARING NA INSPECTOR P. Jacobs

DATE: START/FINISH 6-3-91 / 6-3-91 CONTRACTOR/DRILLER Twin City Testing

STATIC G.W. DEPTH/DATE 20.4 (FT) / 6-3-91 DRILL RIG TYPE CME 55

DEPTH TO BEDROCK NA (FT) TOTAL DEPTH DRILLED 61.0 (FT)

METHODS:

DRILLING SOIL 6" Hollow Stem Auger Above The Water Table, Then Mud Rotary With
2 15/16" Tricone Bit Below The Water Table

SAMPLING SOIL Standard Split Spoon

DRILLING ROCK _____

SPECIAL TESTING OR INSTRUMENTATION _____

COMMENTS: _____

SUMMARY

SOIL DRILLED 61.0 (FT) ROCK DRILLED NA (FT)

NUMBER SPLIT BARREL SAMPLES 13

NO. & TYPE UNDISTURBED SAMPLES 0

LIST ALL TEST, INSPECTION AND CALIBRATION
 RECORDS ATTACHED: _____

GROUNDWATER (DEPTH BELOW GROUND SURFACE)

| DEPTH | DATE | DEPTH | DATE |
|-------|--------|-------|------|
| 20.4 | 6-3-91 | | |
| | | | |
| | | | |

NOTES

1. DATUM IS M.S.L. UNLESS OTHERWISE INDICATED
 LEGEND FOR FIELD BORING LOGS

DISTURBED SAMPLES

W - WASH

S - SPLIT BARREL (ASTM - D1586 UNLESS
 OTHERWISE NOTED)

E - ENVIRONMENTAL

Z - OTHER, DESCRIBE:

UNDISTURBED SAMPLES

US - SHELBY TUBE

UF - STATIONARY (FIXED PISTON)

UO - OSTERBERG

UP - FITCHER

UD - DENISON

X - OTHER, DESCRIBE:

N - STD PENETRATION RESISTANCE BLOWS/FT
 (140 LB. HAMMER, UNLESS OTHERWISE NOTED)

REC - RECOVERY

RQD - ROCK QUALITY DESIGNATION

() - INCHES OF SAMPLE RECOVERY

PREPARED BY Paul J. Jacob

DATE 6-19-91

CHECKED BY M. Gene Zow

DATE 6/19/91

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-16

SITE ISFSI Project Prairie Island (site 2)

J.O. NO.
12911.5401

SHEET 2 OF 3

| DEPTH (FEET) | SAMPLE TYPE | SAMPLE NUMBER | BLOWS/OR REC/RQD | SPT N VALUE | GROUP SYMBOL | DRILLER Tom White | INSPECTOR P. Jacobs |
|-----------------|----------------|------------------|---------------------|----------------|-----------------|---|---------------------|
| | | | | | | SAMPLE DESCRIPTION | |
| | | | | | | PREPARED BY <i>Paul A. Jacobs</i> CHECKED BY <i>M. Gene Jones</i> 6/19/91 | |
| | SS | 1 | 2-7-12 (13") | 19 | | <u>Fill</u> - Boring located in the middle of a gravel roadway | |
| 5 | SS | 2 | 1-2-3 (15") | 5 | SP | <u>Sand</u> - Poorly Graded, Fine, Loose, Moist Reddish Brown | |
| 10 | SS | 3 | 1-2-2 (13") | 4 | SP | <u>same as above</u> | |
| 15 | SS | 4 | 3-5-4 (14") | 9 | SP | <u>same as above</u> - with a thin gravel seam at 15.1' | |
| 20 | SS | 5 | 3-5-6 (14") | 11 | SP | <u>same as above</u> | |
| 25 | SS | 6 | 3-4-5 (7") | 9 | SP | <u>Sand</u> - Poorly Graded, Fine, Med Dense, Wet, Light Brown | |
| 30 | SS | 7 | 7-10-12 (13") | 22 | SP | <u>same as above</u> | |
| 35 | SS | 8 | 3-5-5 (8 1/2") | 10 | SP | <u>same as above</u> | |
| 40 | SS | 9 | 3-5-7 (9") | 12 | SP | <u>same as above</u> - with thin reddish brown sand layer at 40.5' | |
| | SS | 10 | 5-10-12 (11") | 22 | SP | <u>same as above</u> | |

FIELD BORING LOG
STONE & WEBSTER ENGINEERING CORP.

BORING NO. B-16

SITE ISFSI Project Prairie Island (site 2)

J.O. NO.
12911.5401

SHEET 3 OF 3

DRILLER Tom White

INSPECTOR P. Jacobs

| DEPTH (FEET) | SAMPLE TYPE | SAMPLE NUMBER | BLOWS/OR REC/ROD | SPT N VALUE | GROUP SYMBOL | SAMPLE DESCRIPTION PREPARED BY <i>Paul F. Jacobs</i> CHECKED BY <i>M. Gene Yow</i> 6/19/91 |
|-----------------|----------------|------------------|----------------------|----------------|-----------------|---|
| | | | | | | |
| 50 | SS | 11 | 22-18-15 (5") | 33 | SW-GW | <u>Gravelly Sand</u> - Well Graded, Fine to 1" gravel, Dense, Wet, Light Brown with Black Gravel |
| 55 | SS | 12 | 10-14-13 (11") | 27 | SW-GW | <u>same as above</u> |
| 60 | SS | 13 | 10-14-17 (9 1/2") | 31 | SW-GW | <u>same as above</u> T.D. 61.0' |
| 65 | | | | | | |
| 70 | | | | | | |
| 75 | | | | | | |
| 80 | | | | | | |
| 85 | | | | | | |


This page is intentionally blank

ISFSI SAR

APPENDIX 2B

GRAIN SIZE DISTRIBUTION TEST REPORTS

GRAIN SIZE DISTRIBUTION TEST REPORT

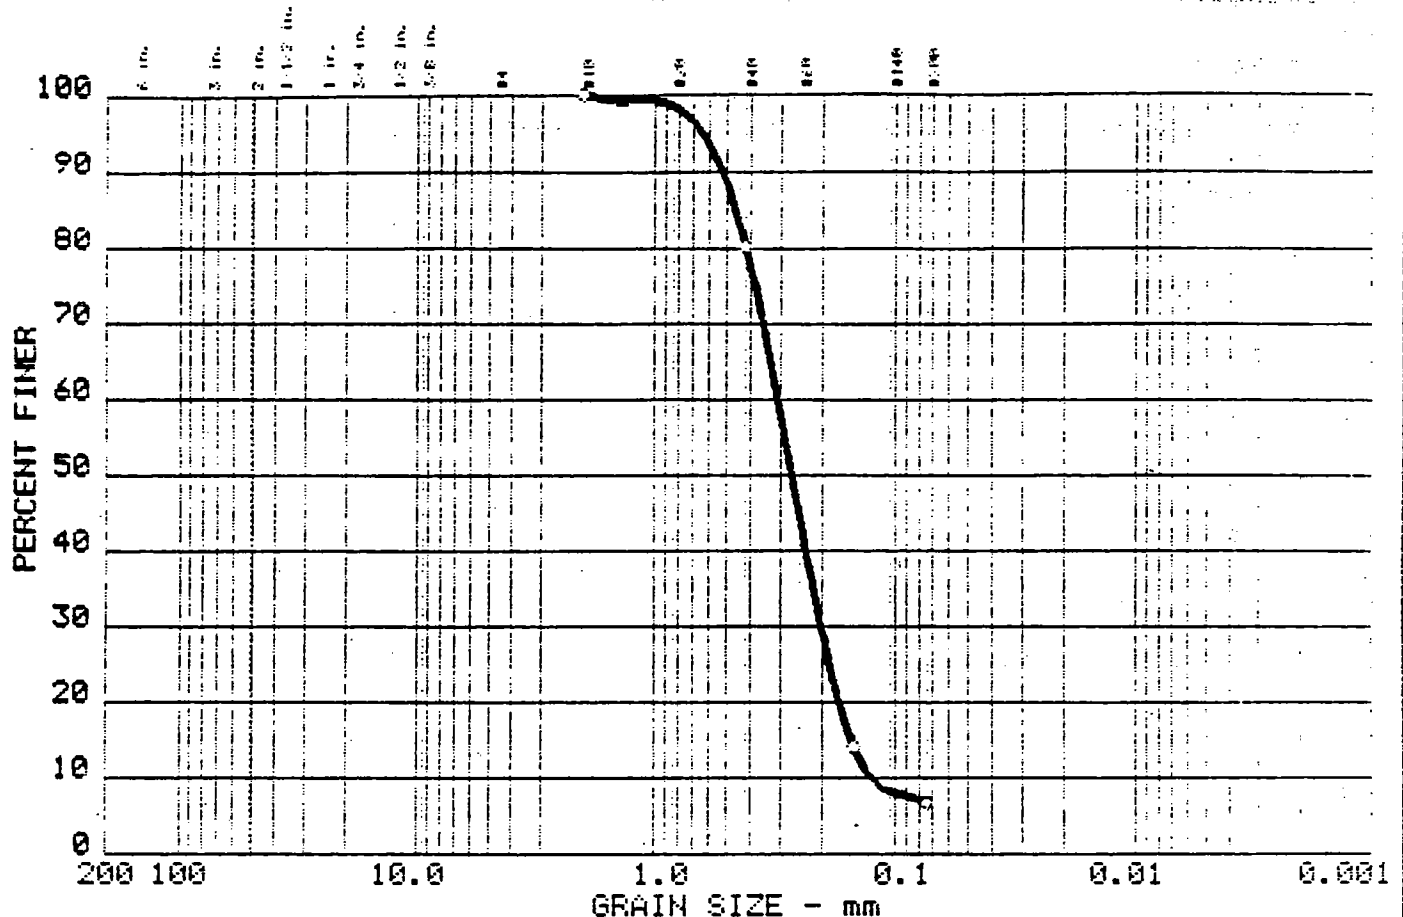

| Test | %+75 _{um} | % GRAVEL | % SAND | % SILT | % CLAY |
|------|--------------------|----------|--------|--------|--------|
| 1 | 0.0 | 0.0 | 93.2 | 6.8 | |

| LL | PI | D ₈₅ | D ₆₀ | D ₅₀ | D ₃₀ | D ₁₅ | D ₁₀ | C _c | C _u |
|----|----|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|
| | | 0.46 | 0.31 | 0.27 | 0.203 | 0.1531 | 0.1259 | 1.07 | 2.4 |

| MATERIAL DESCRIPTION | USCS | AASHTO |
|-----------------------------|-------|--------|
| ○ SAND W/SILT, FINE GRAINED | SP-SM | |

| | |
|--|---|
| Project No.: 4220 91-1181 Project: SPENT FUEL ROD VAULT Location: PRAIRIE ISLAND NUCLEAR PLANT Date: 06/21/91 | Remarks: BORING NO.: 8 SAMPLE NO.: 1 DEPTH (ft): 0 - 1.5 |
| GRAIN SIZE DISTRIBUTION TEST REPORT TWIN CITY TESTING CORPORATION | |
| Figure No. | |

=====

GRAIN SIZE DISTRIBUTION TEST DATA

=====

Test No.: 1

Date: 06/21/91
 Project No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT

=====

Sample Data

Location of Sample: PRAIRIE ISLAND NUCLEAR PLANT
 Sample Description: SAND W/SILT, FINE GRAINED
 SCS Class: SP-SM Liquid limit:
 ASHTO Class: Plasticity index:

Notes

Remarks: BORING NO.: 18 SAMPLE NO.: 1
 DEPTH (ft): 0 - 1.5
 Log. No.:

Mechanical Analysis Data


| Sieve | Size, mm | Percent finer |
|-------|----------|---------------|
| # 10 | 2.000 | 100.0 |
| # 40 | 0.420 | 80.3 |
| 100 | 0.149 | 14.0 |
| 200 | 0.074 | 6.8 |

Fractional Components

% + 3 in. = 0.0 % GRAVEL = 0.0 % SAND = 93.2
 % FINES = 6.8

W₃₅ = 0.46 D₆₀ = 0.307 D₅₀ = 0.269
 D₃₀ = 0.2020 D₁₅ = 0.15311 D₁₀ = 0.12589
 C_u = 1.0654 C_u = 2.4406

GRAIN SIZE DISTRIBUTION TEST REPORT

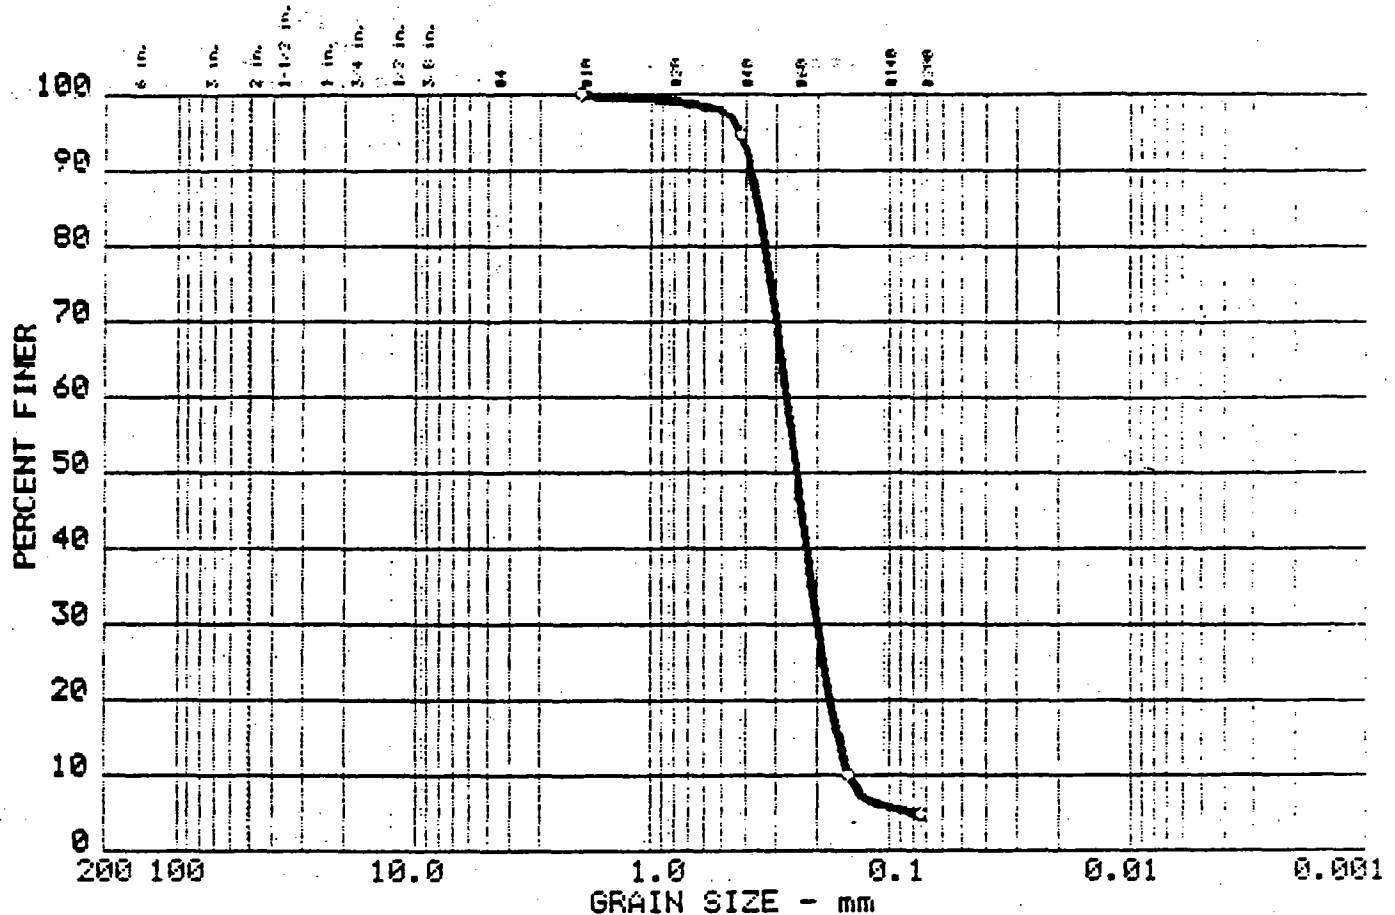

| Test | %+75 | % GRAVEL | % SAND | % SILT | % CLAY |
|------|------|----------|--------|--------|--------|
| 2 | 0.0 | 0.0 | 95.2 | 4.8 | |

| LL | PI | D ₈₅ | D ₆₀ | D ₅₀ | D ₃₀ | D ₁₅ | D ₁₀ | C _c | C _u |
|----|----|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|
| | | 0.35 | 0.27 | 0.24 | 0.200 | 0.1646 | 0.1484 | 1.00 | 1.8 |

| MATERIAL DESCRIPTION | USCS | AASHTO |
|----------------------|------|--------|
| SAND, FINE GRAINED | SP | |

Project No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT
 Location: PRAIRIE ISLAND NUCLEAR PLANT

Remarks:
 BORING NO.: 9
 SAMPLE NO.: 4
 DEPTH (ft): 29.5 - 31

Date: 06/21/91

GRAIN SIZE DISTRIBUTION TEST REPORT
 TWIN CITY TESTING CORPORATION

Figure No.

GRAIN SIZE DISTRIBUTION TEST DATA

Test No.: 2

Date: 06/21/91
 Project No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT

Sample Data

Location of Sample: PRAIRIE ISLAND NUCLEAR PLANT
 Sample Description: SAND, FINE GRAINED
 CS Class: SP Liquid limit:
 SHTO Class: Plasticity index:

Notes

Remarks: BORING NO.: 9 SAMPLE NO.: 4
 DEPTH (ft): 29.5 - 31
 Log No.:

Mechanical Analysis Data


| Sieve | Size, mm | Percent finer |
|-------|----------|---------------|
| 10 | 2.000 | 100.0 |
| 40 | 0.120 | 94.8 |
| 100 | 0.149 | 10.1 |
| 200 | 0.074 | 4.8 |

Fractional Components

+ 3 in. = 0.0 % GRAVEL = 0.0 % SAND = 95.2
 FINES = 4.8

5= 0.35 D60= 0.268 D50= 0.244
 0= 0.1995 D15= 0.16463 D10= 0.14842
 = 1.0000 Cu = 1.8072

GRAIN SIZE DISTRIBUTION TEST REPORT

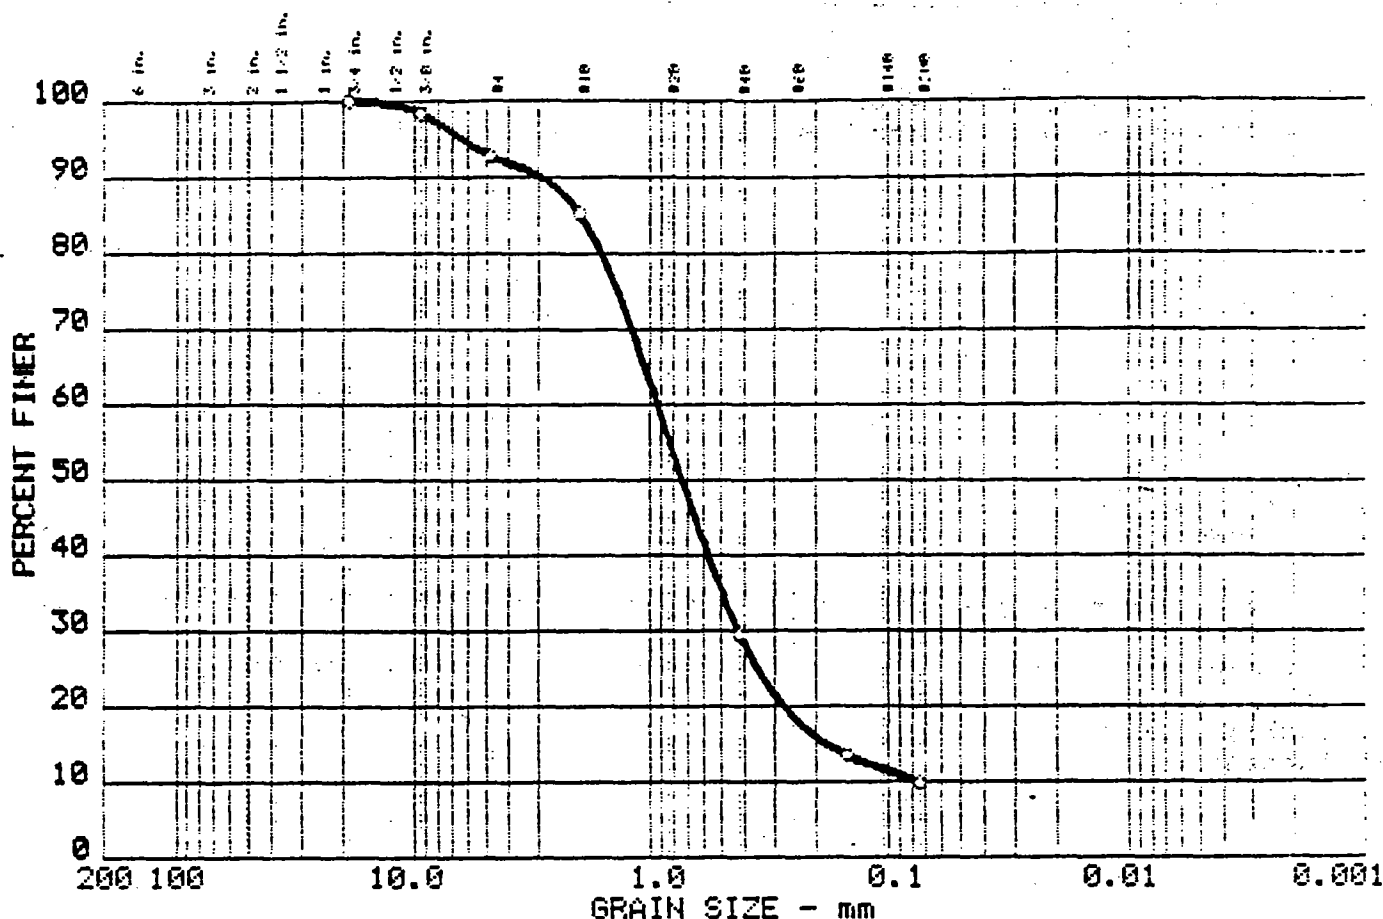

| Test No. | % +75 | % GRAVEL | % SAND | % SILT | % CLAY |
|----------|-------|----------|--------|--------|--------|
| 3 | 0.0 | 7.3 | 82.8 | 9.9 | |

| LL | PI | D ₈₅ | D ₆₀ | D ₅₀ | D ₃₀ | D ₁₅ | D ₁₀ | C _c | C _u |
|----|----|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|
| | | 1.97 | 0.94 | 0.74 | 0.429 | 0.1807 | 0.0745 | 2.63 | 12.6 |

| MATERIAL DESCRIPTION | USCS | AASHTO |
|---|-------|--------|
| SAND W/SILT & W/A LITTLE GRAVEL, MEDIUM GRAINED | SP-SM | |

| | |
|--|---|
| Project No.: 4220 91-1181 Project: SPENT FUEL ROD VAULT Location: PRAIRIE ISLAND NUCLEAR PLANT Date: 06/21/91 | Remarks: BORING NO.: 9 SAMPLE NO.: 6 DEPTH (ft): 49.5 - 51 |
| GRAIN SIZE DISTRIBUTION TEST REPORT TWIN CITY TESTING CORPORATION | Figure No. |

GRAIN SIZE DISTRIBUTION TEST DATA

Test No.: 3

Date: 06/21/91
 Test No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT

Sample Data

Location of Sample: PRAIRIE ISLAND NUCLEAR PLANT
 Sample Description: SAND W/SILT & W/A LITTLE GRAVEL, MEDIUM GRAINED
 SCS Class: SP-SM Liquid limit:
 ASHTO Class: Plasticity index:

Notes

Remarks: BORING NO.: 9 SAMPLE NO.: 6
 DEPTH (ft): 49.5 - 51
 Log No.:

Mechanical Analysis Data


| Sieve | Size, mm | Percent finer |
|------------|----------|---------------|
| 75 inches | 19.05 | 100.0 |
| 375 inches | 9.53 | 98.4 |
| 4 | 4.760 | 92.7 |
| 10 | 2.000 | 85.2 |
| 40 | 0.420 | 29.4 |
| | 0.149 | 13.5 |
| 200 | 0.074 | 9.9 |

Fractional Components

+ 3 in. = 0.0 % GRAVEL = 7.3 % SAND = 82.8
 FINES = 9.9

5= 1.97 D60= 0.938 D50= 0.736
 0= 0.4285 D15= 0.18072 D10= 0.07447
 = 2.6303 Cu = 12.5893

GRAIN SIZE DISTRIBUTION TEST REPORT

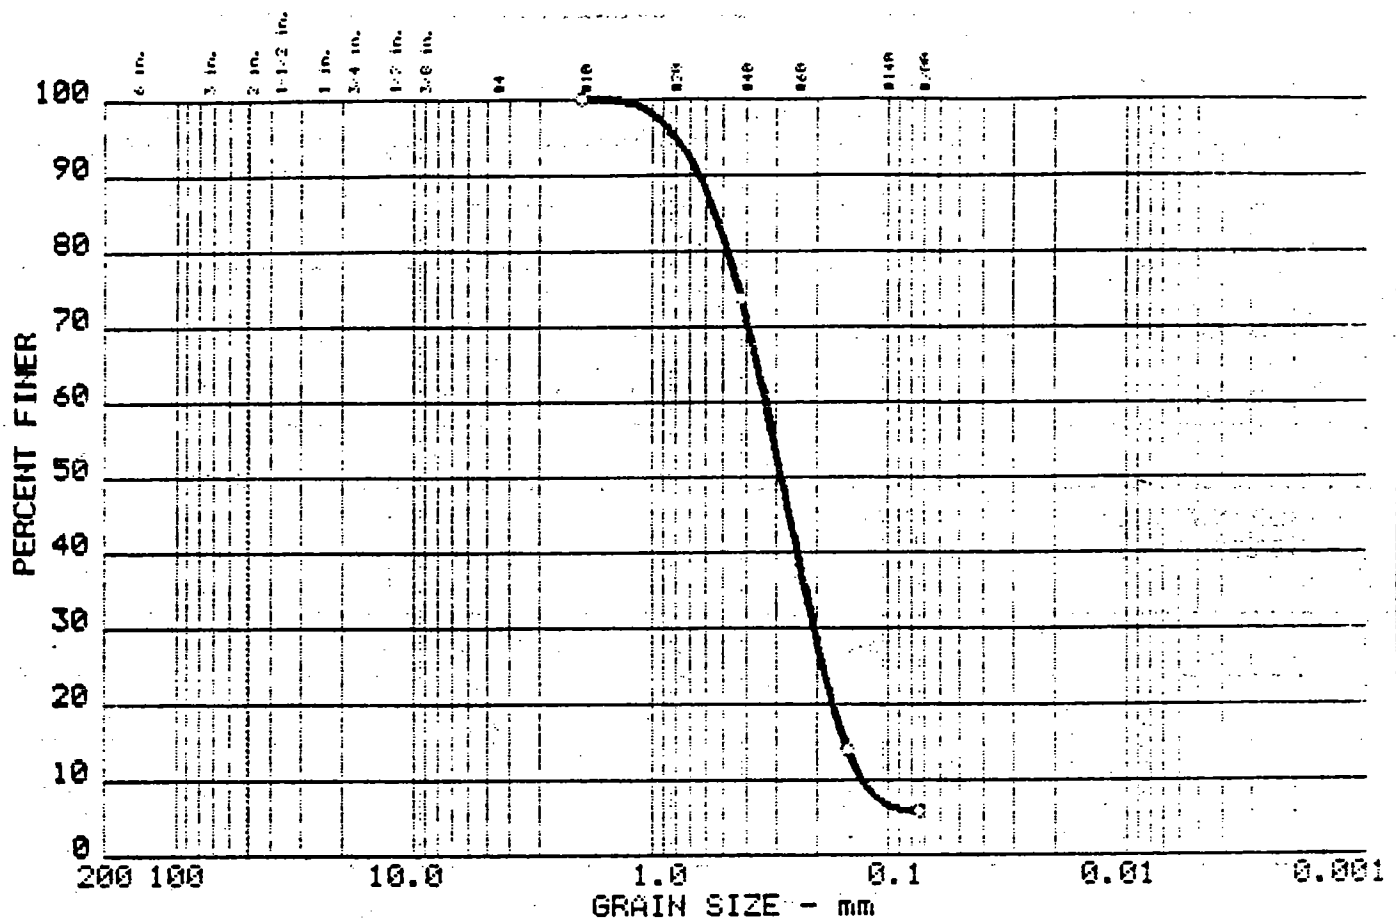

| Test | %+75 _u | % GRAVEL | % SAND | % SILT | % CLAY |
|------|-------------------|----------|--------|--------|--------|
| 4 | 0.0 | 0.0 | 94.1 | 5.9 | |

| LL | PI | D ₈₅ | D ₆₀ | D ₅₀ | D ₃₀ | D ₁₅ | D ₁₀ | C _c | C _u |
|----|----|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|
| | | 0.54 | 0.33 | 0.28 | 0.207 | 0.1531 | 0.1288 | 1.01 | 2.6 |

| MATERIAL DESCRIPTION | USCS | AASHTO |
|---------------------------|-------|--------|
| SAND W/SILT, FINE GRAINED | SP-SM | |

| | |
|--|--|
| Project No.: 4220 91-1181 Project: SPENT FUEL ROD VAULT Location: PRAIRIE ISLAND NUCLEAR PLANT Date: 06/21/91 | Remarks: BORING NO.: 10 SAMPLE NO.: 1 DEPTH (ft): 0 - 1.5 |
| GRAIN SIZE DISTRIBUTION TEST REPORT TWIN CITY TESTING CORPORATION | |
| Figure No. | |

GRAIN SIZE DISTRIBUTION TEST DATA

Test No.: 4

Date: 06/21/91
 Sample No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT

Sample Data

Location of Sample: PRAIRIE ISLAND NUCLEAR PLANT
 Sample Description: SAND W/SILT, FINE GRAINED
 SCS Class: SP-SM Liquid limit:
 ASHTO Class: Plasticity index:

Notes

Remarks: BORING NO.: 10 SAMPLE NO.: 1
 DEPTH (ft): 0 - 1.5
 Fig. No.:

Mechanical Analysis Data


| sieve | Size, mm | Percent finer |
|-------|----------|---------------|
| 10 | 2.000 | 100.0 |
| 40 | 0.420 | 73.7 |
| 100 | 0.149 | 14.0 |
| 200 | 0.074 | 5.9 |

Fractional Components

+ 3 in. = 0.0 % GRAVEL = 0.0 % SAND = 94.1
 FINES = 5.9

W5= 0.54 D60= 0.331 D50= 0.284
 W30= 0.2073 D15= 0.15311 D10= 0.12882
 Cu = 1.0069 Cu = 2.5704

GRAIN SIZE DISTRIBUTION TEST REPORT

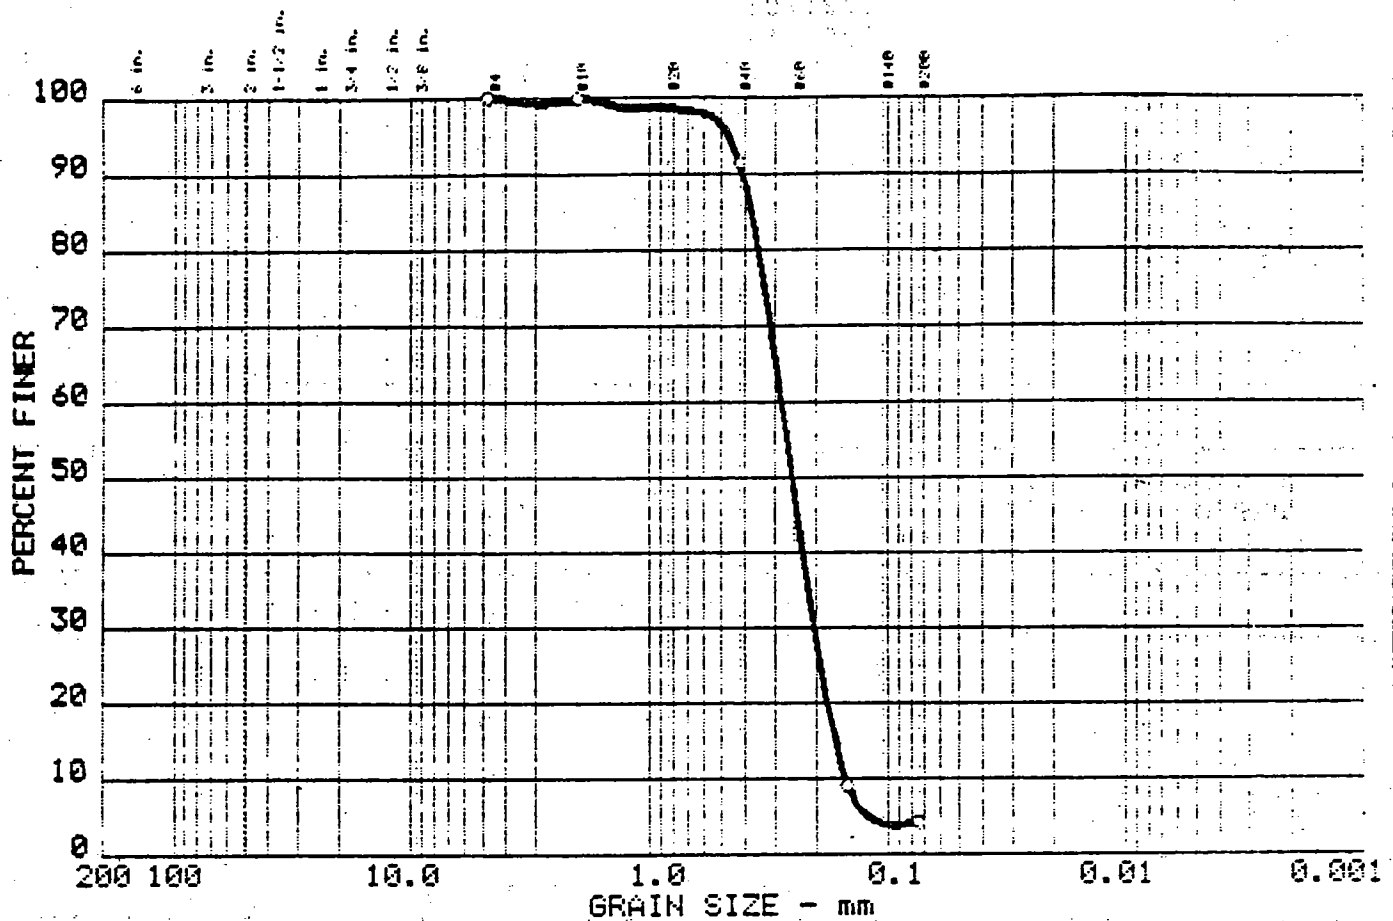

| Test | %+75 | % GRAVEL | % SAND | % SILT | % CLAY |
|------|------|----------|--------|--------|--------|
| 5 | 0.0 | 0.0 | 95.7 | 4.3 | |

| LL | PI | D ₈₅ | D ₆₀ | D ₅₀ | D ₃₀ | D ₁₅ | D ₁₀ | C _c | C _u |
|----|----|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|
| | | 0.37 | 0.28 | 0.25 | 0.204 | 0.1679 | 0.1528 | 0.98 | 1.8 |

| MATERIAL DESCRIPTION | USCS | AASHTO |
|----------------------|------|--------|
| SAND, FINE GRAINED | SP | |

Project No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT
 Location: PRAIRIE ISLAND NUCLEAR PLANT

Remarks:
 BORING NO.: 11
 SAMPLE NO.: 5
 DEPTH (ft): 22 - 23.5

Date: 06/21/91

GRAIN SIZE DISTRIBUTION TEST REPORT
 TWIN CITY TESTING CORPORATION

Figure No.

GRAIN SIZE DISTRIBUTION TEST DATA

Test No.: 5

Date: 06/21/91
 Project No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT

Sample Data

Location of Sample: PRAIRIE ISLAND NUCLEAR PLANT
 Sample Description: SAND, FINE GRAINED
 SCS Class: SP Liquid limit:
 ASHTO Class: Plasticity index:

Notes

Remarks: BORING NO.: 11 SAMPLE NO.: 5
 DEPTH (ft): 22 - 23.5
 Log. No.:

Mechanical Analysis Data


| Size, mm | Percent finer |
|----------|---------------|
| 4.760 | 100.0 |
| 2.000 | 99.9 |
| 0.420 | 91.4 |
| 0.149 | 9.0 |
| 0.074 | 4.3 |

Fractional Components

+ 3 in. = 0.0 % GRAVEL = 0.0 % SAND = 95.7
 FINES = 4.3

R5= 0.37 D60= 0.279 D50= 0.252
 R0= 0.2044 D15= 0.16788 D10= 0.15276
 C = 0.9795 Cu = 1.8281

GRAIN SIZE DISTRIBUTION TEST REPORT

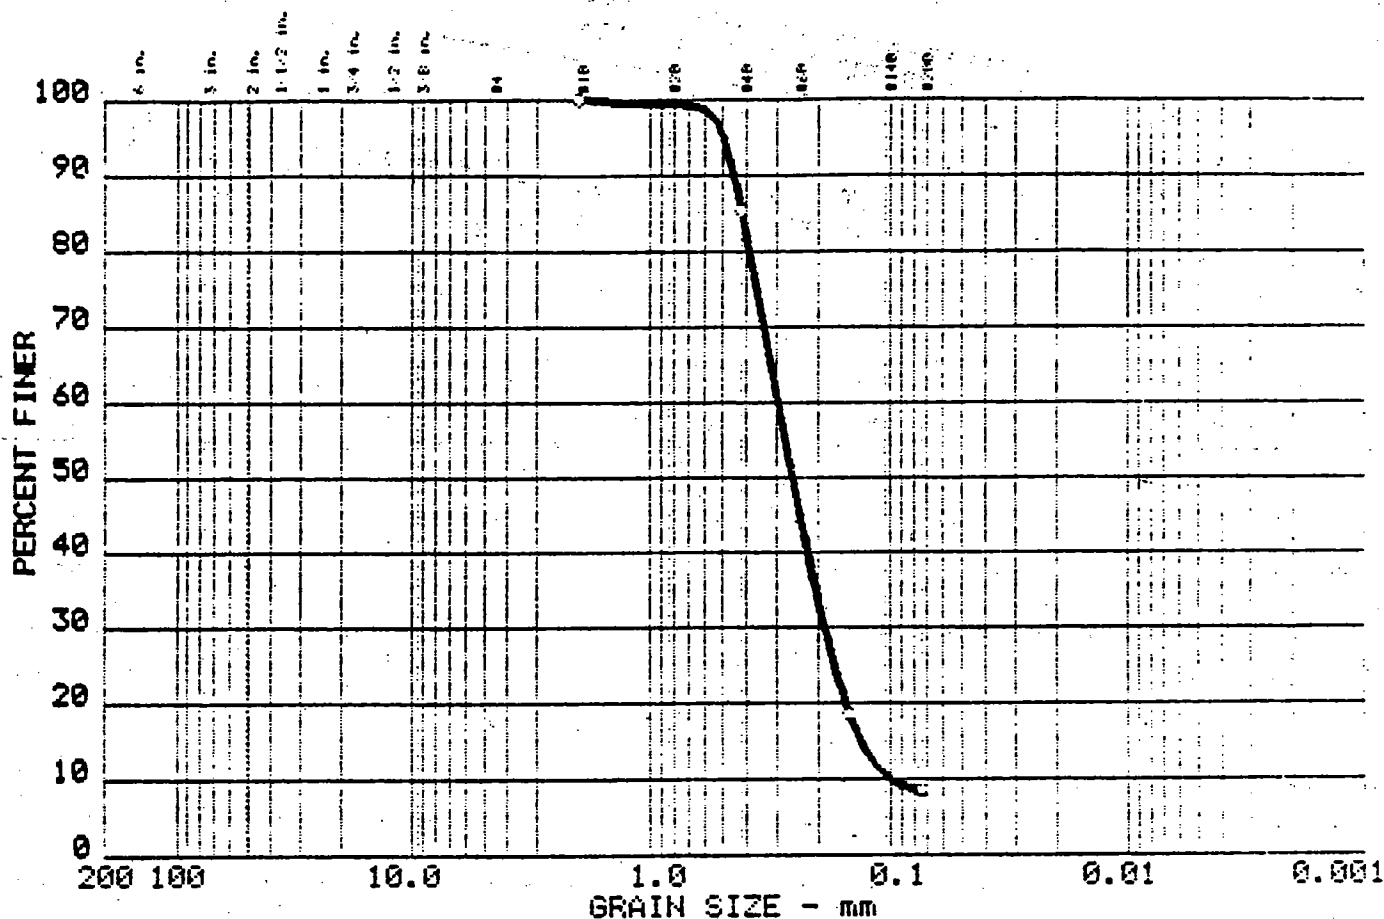

| Test No. | % +75 | % GRAVEL | % SAND | % SILT | % CLAY |
|----------|-------|----------|--------|--------|--------|
| 6 | 0.0 | 0.0 | 91.5 | 8.5 | |

| LL | PI | D ₈₅ | D ₆₀ | D ₅₀ | D ₃₀ | D ₁₅ | D ₁₀ | C _c | C _u |
|----|----|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|
| | | 0.42 | 0.29 | 0.26 | 0.189 | 0.1338 | 0.1003 | 1.21 | 2.9 |

| MATERIAL DESCRIPTION | USCS | AASHTO |
|---------------------------|-------|--------|
| SAND W/SILT, FINE GRAINED | SP-SM | |

| | |
|--|--|
| Project No.: 4220 91-1181 Project: SPENT FUEL ROD VAULT Location: PRAIRIE ISLAND NUCLEAR PLANT Date: 06/21/91 | Remarks: BORING NO.: 12 SAMPLE NO.: 1 DEPTH (ft): 0 - 1.5 |
| GRAIN SIZE DISTRIBUTION TEST REPORT TWIN CITY TESTING CORPORATION | |
| Figure No. | |

GRAIN SIZE DISTRIBUTION TEST DATA

Test No.: 6

Date: 06/21/91
 Project No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT

Sample Data

Location of Sample: PRAIRIE ISLAND NUCLEAR PLANT
 Sample Description: SAND W/SILT, FINE GRAINED
 UCS Class: SP-SM Liquid limit:
 AASHTO Class: Plasticity index:

Notes

Remarks: BORING NO.: 12 SAMPLE NO.: 1
 DEPTH (ft): 0 - 1.5

Fig. No.:

Mechanical Analysis Data


| sieve | Size, mm | Percent finer |
|-------|----------|---------------|
| # 10 | 2.000 | 100.0 |
| # 40 | 0.420 | 85.5 |
| # 100 | 0.149 | 18.5 |
| # 200 | 0.074 | 8.5 |

Fractional Components

% + 3 in. = 0.0 % GRAVEL = 0.0 % SAND = 91.5
 FINES = 8.5

D85= 0.42 D60= 0.294 D50= 0.256
 D30= 0.1890 D15= 0.13381 D10= 0.10035
 Cu = 1.2106 Cu = 2.9309

GRAIN SIZE DISTRIBUTION TEST REPORT

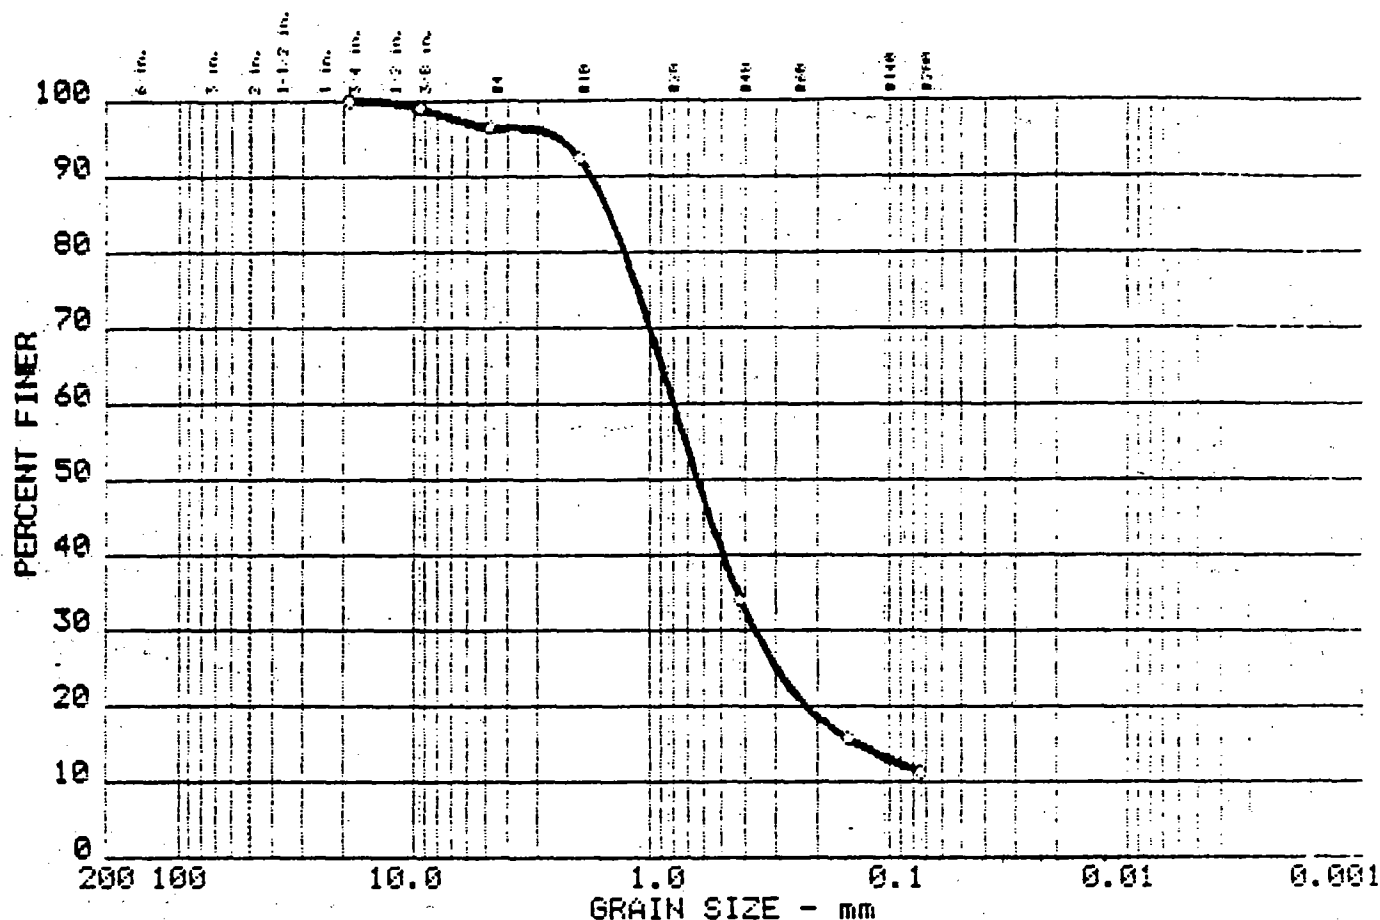

| Test No. | % +75 | % GRAVEL | % SAND | % SILT | % CLAY |
|----------|-------|----------|--------|--------|--------|
| 7 | 0.0 | 3.6 | 85.2 | 11.2 | |

| LL | PI | D ₈₅ | D ₆₀ | D ₅₀ | D ₃₀ | D ₁₅ | D ₁₀ | C _c | C _u |
|----|----|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|
| | | 1.50 | 0.80 | 0.64 | 0.366 | 0.1358 | | | |

| MATERIAL DESCRIPTION | USCS | AASHTO |
|---|-------|--------|
| SAND W/SILT & W/A LITTLE GRAVEL, MEDIUM GRAINED | SP-SM | |

| | |
|--|---|
| Project No.: 4220 91-1181 Project: SPENT FUEL ROD VAULT Location: PRAIRIE ISLAND NUCLEAR PLANT Date: 06/21/91 | Remarks: BORING NO.: 12 SAMPLE NO.: 12 DEPTH (ft): 54.5 - 56 |
|--|---|

GRAIN SIZE DISTRIBUTION TEST REPORT
TWIN CITY TESTING CORPORATION

Figure No.

GRAIN SIZE DISTRIBUTION TEST DATA

Test No.: 7

Date: 06/21/91
 Project No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT

Sample Data

Location of Sample: PRAIRIE ISLAND NUCLEAR PLANT
 Sample Description: SAND W/SILT & W/A LITTLE GRAVEL, MEDIUM GRAINED
 UCS Class: SP-SM Liquid limit:
 ASHTO Class: Plasticity index:

Notes

Remarks: BORING NO.: 12 SAMPLE NO.: 12
 DEPTH (ft): 54.5 - 56
 Log No.:

Mechanical Analysis Data


| Size, mm | Percent finer |
|------------|---------------|
| 75 inches | 100.0 |
| 375 inches | 99.0 |
| 4 | 96.4 |
| 10 | 92.4 |
| 40 | 34.1 |
| 0.149 | 15.7 |
| 0.074 | 11.2 |

Fractional Components

% + 3 in. = 0.0 % GRAVEL = 3.6 % SAND = 85.2
 % FINES = 11.2

D35= 1.50 D60= 0.800 D50= 0.635
 D30= 0.3656 D15= 0.13583

GRAIN SIZE DISTRIBUTION TEST REPORT

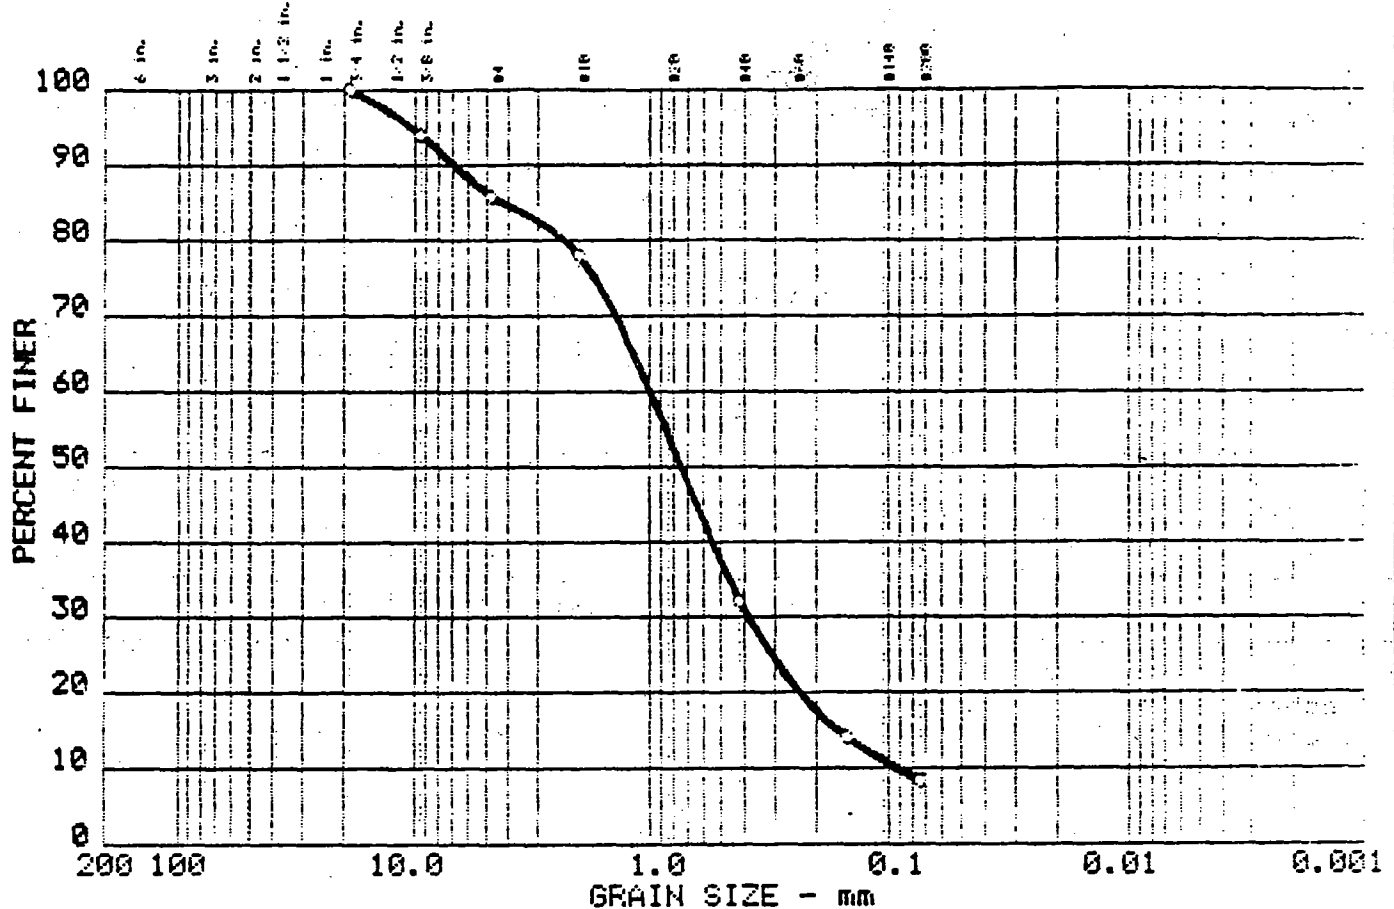

| Test | %+75 _μ | % GRAVEL | % SAND | % SILT | % CLAY |
|------|-------------------|----------|--------|--------|--------|
| 0 | 0.0 | 14.1 | 77.5 | 8.4 | |

| LL | PI | D ₈₅ | D ₆₀ | D ₅₀ | D ₃₀ | D ₁₅ | D ₁₀ | C _c | C _u |
|----|----|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|
| | | 4.22 | 1.00 | 0.74 | 0.385 | 0.1622 | 0.0923 | 1.60 | 10.8 |

| MATERIAL DESCRIPTION | USCS | AASHTO |
|---|-------|--------|
| 0 SAND W/SILT & W/A LITTLE GRAVEL, MEDIUM GRAINED | SP-SM | |

| | |
|--|---------------------|
| Project No.: 4220 91-1181 | Remarks: |
| Project: SPENT FUEL ROD VAULT | BORING NO.: 13 |
| 0 Location: PRAIRIE ISLAND NUCLEAR PLANT | SAMPLE NO.: 7 |
| Date: 06/21/91 | DEPTH (ft): 49 - 51 |

GRAIN SIZE DISTRIBUTION TEST REPORT
TWIN CITY TESTING CORPORATION

Figure No.

GRAIN SIZE DISTRIBUTION TEST DATA

Test No.: 8

Date: 06/21/91
 Test No.: 4220 91-1181
 Location: SPENT FUEL ROD VAULT

Sample Data

Location of Sample: PRAIRIE ISLAND NUCLEAR PLANT
 Sample Description: SAND W/SILT & W/A LITTLE GRAVEL, MEDIUM GRAINED
 CS Class: SP-SM Liquid limit:
 SHTO Class: Plasticity index:

Notes

Remarks: BORING NO.: 13 SAMPLE NO.: 7
 DEPTH (ft): 49 - 51
 Log No.:

Mechanical Analysis Data


| sieve | Size, mm | Percent finer |
|------------|----------|---------------|
| 75 inches | 19.05 | 100.0 |
| 375 inches | 9.53 | 94.0 |
| 4 | 4.760 | 85.9 |
| 10 | 2.000 | 77.9 |
| 40 | 0.420 | 32.2 |
| | 0.149 | 14.0 |
| | 0.074 | 8.4 |

Fractional Components

+ 3 in. = 0.0 % GRAVEL = 14.1 % SAND = 77.5
 FINES = 8.4

D5= 4.22 D60= 1.000 D50= 0.741
 D80= 0.3846 D15= 0.16218 D10= 0.09226
 = 1.6032 Cu = 10.8393

GRAIN SIZE DISTRIBUTION TEST REPORT

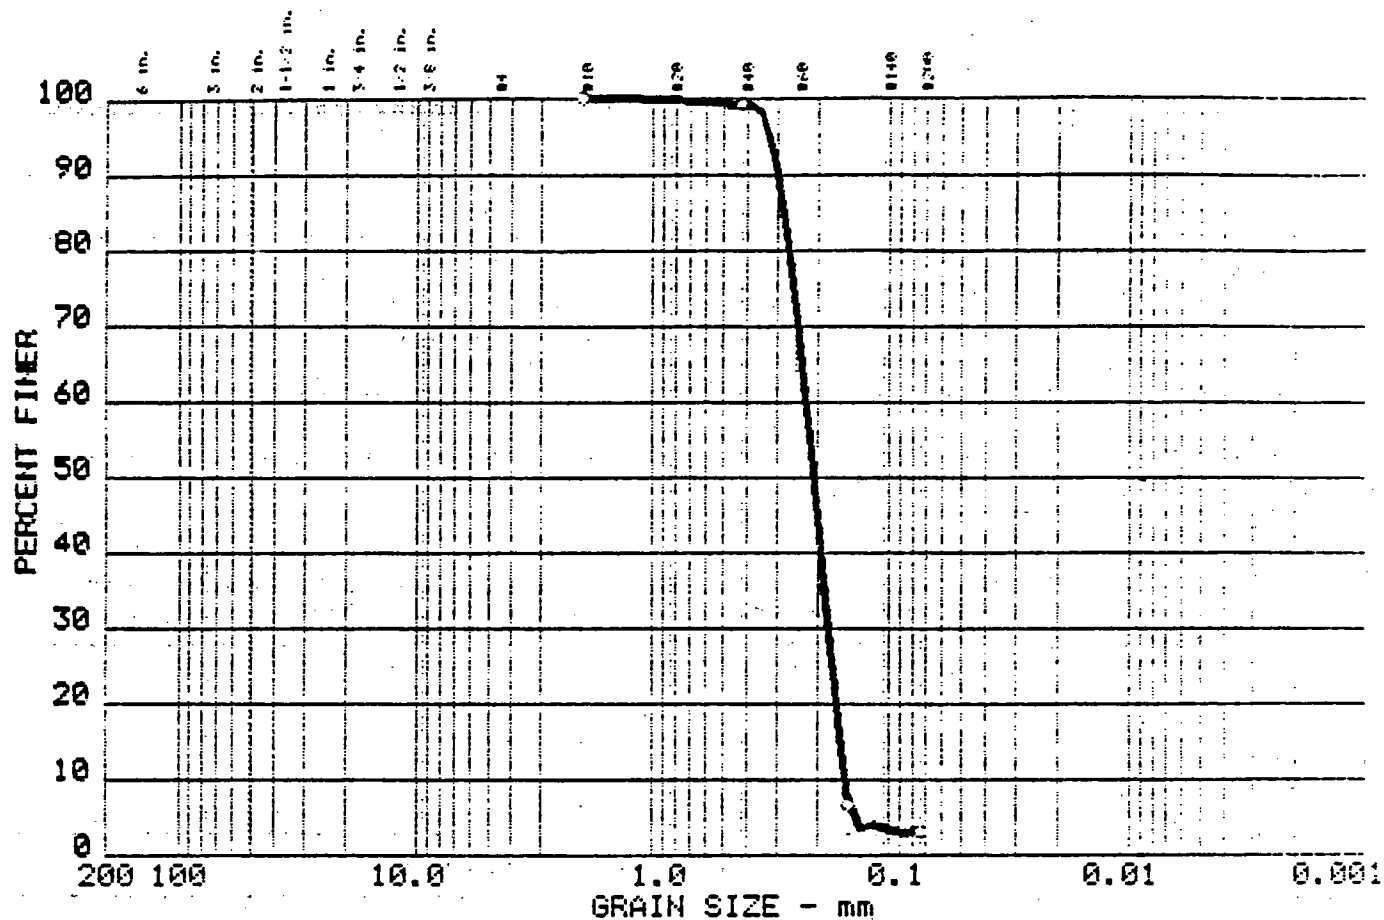

| Test | %+75 _μ | % GRAVEL | % SAND | % SILT | % CLAY |
|------|-------------------|----------|--------|--------|--------|
| 9 | 0.0 | 0.0 | 96.8 | 3.2 | |

| LL | PI | D ₈₅ | D ₆₀ | D ₅₀ | D ₃₀ | D ₁₅ | D ₁₀ | C _c | C _u |
|----|----|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|
| | | 0.28 | 0.22 | 0.21 | 0.180 | 0.1607 | 0.1542 | 0.93 | 1.5 |

| MATERIAL DESCRIPTION | USCS | AASHTO |
|----------------------|------|--------|
| SAND, FINE GRAINED | SP | |

| | |
|--|-----------------------|
| Project No.: 4220 91-1181 | Remarks: |
| Project: SPENT FUEL ROD VAULT | BORING NO.: 14 |
| Location: PRAIRIE ISLAND NUCLEAR PLANT | SAMPLE NO.: 5 |
| Date: 06/21/91 | DEPTH (ft): 29.5 - 31 |

GRAIN SIZE DISTRIBUTION TEST REPORT
TWIN CITY TESTING CORPORATION

Figure No.

=====

GRAIN SIZE DISTRIBUTION TEST DATA

Test No.: 9

te: 06/21/91

ct No.: 4220 91-1181

ct: SPENT FUEL ROD VAULT

=====

Sample Data

ocation of Sample: PRAIRIE ISLAND NUCLEAR PLANT

mple Description: SAND, FINE GRAINED

CS Class: SP Liquid limit:

SHTO Class: Plasticity index:

Notes

marks: BORING NO.: 14 SAMPLE NO.: 5

DEPTH (ft): 29.5 - 31

g. No.:

Mechanical Analysis Data

| Sieve | Size, mm | Percent finer |
|-------|----------|---------------|
| 10 | 2.000 | 100.0 |
| 40 | 0.420 | 99.3 |
| 100 | 0.149 | 6.7 |
| 200 | 0.074 | 3.2 |

Fractional Components

+ 3 in. = 0.0 % GRAVEL = 0.0 % SAND = 96.8


FINES = 3.2

5= 0.28 D60= 0.224 D50= 0.208

0= 0.1797 D15= 0.16069 D10= 0.15417

= 0.9343 Cu = 1.4538

GRAIN SIZE DISTRIBUTION TEST REPORT

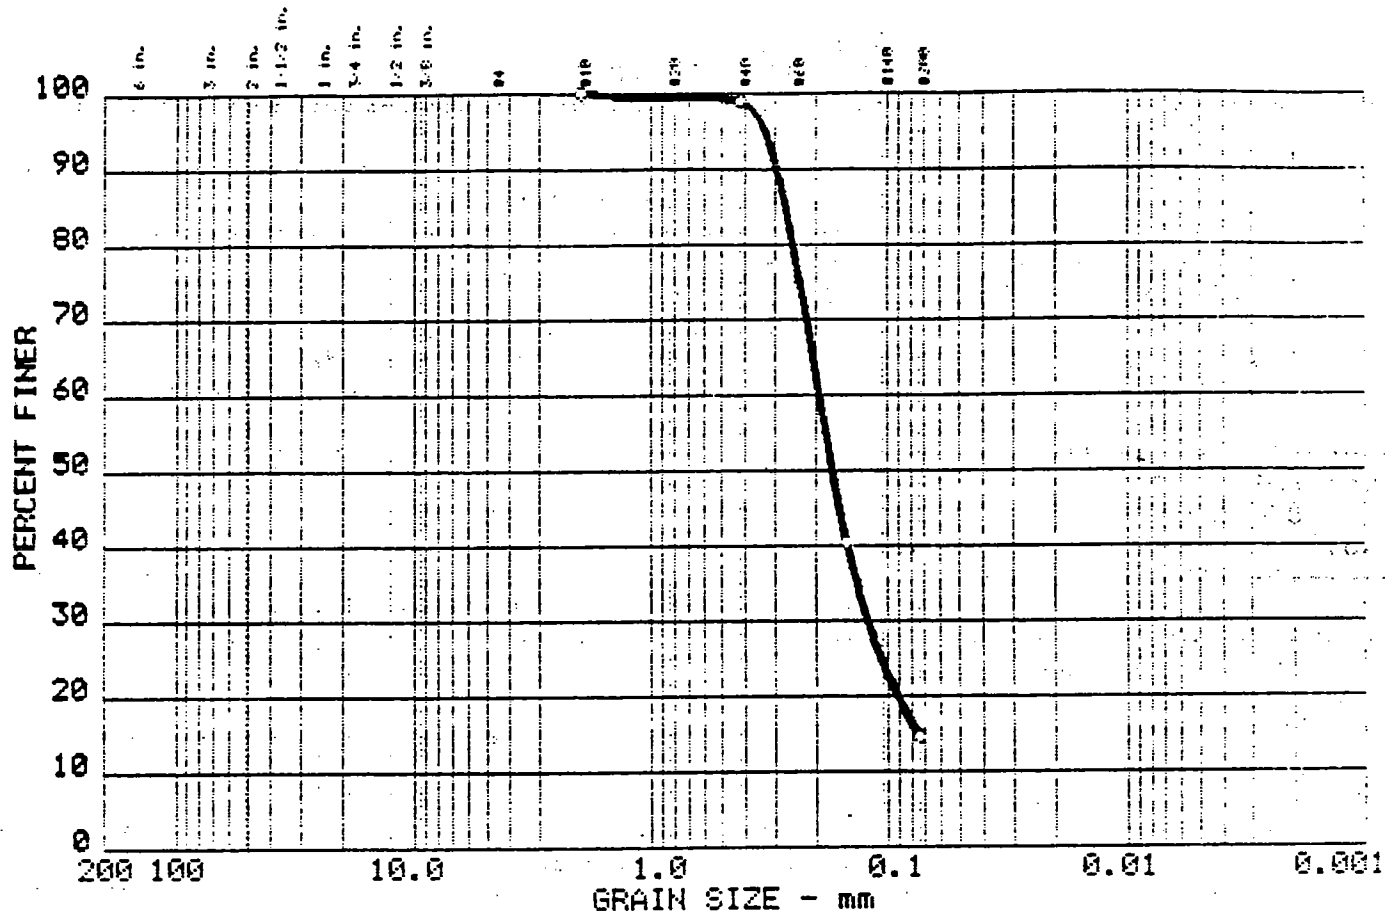

| Test | %+75 _μ | % GRAVEL | % SAND | % SILT | % CLAY |
|------|-------------------|----------|--------|--------|--------|
| 10 | 0.0 | 0.0 | 85.3 | 14.7 | |

| LL | PI | D ₈₅ | D ₆₀ | D ₅₀ | D ₃₀ | D ₁₅ | D ₁₀ | C _c | C _u |
|----|----|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|
| | | 0.27 | 0.19 | 0.17 | 0.122 | 0.0745 | | | |

| MATERIAL DESCRIPTION | USCS | AASHTO |
|-----------------------------|------|--------|
| 10 SILTY SAND, FINE GRAINED | SM | |

Project No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT
 10 Location: PRAIRIE ISLAND NUCLEAR PLANT

Date: 06/21/91

Remarks:
 BORING NO.: 15
 SAMPLE NO.: 4
 DEPTH (ft): 4.5 - 6

GRAIN SIZE DISTRIBUTION TEST REPORT
 TWIN CITY TESTING CORPORATION

Figure No.

GRAIN SIZE DISTRIBUTION TEST DATA

Test No.: 10

Date: 06/21/91
 Project No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT

Sample Data

Location of Sample: PRAIRIE ISLAND NUCLEAR PLANT
 Sample Description: SILTY SAND, FINE GRAINED
 SCS Class: SM Liquid limit:
 ASHTO Class: Plasticity index:

Notes

Remarks: BORING NO.: 15 SAMPLE NO.: 4
 DEPTH (ft): 4.5 - 6
 Log. No.:

Mechanical Analysis Data


| Sieve | Size, mm | Percent finer |
|-------|----------|---------------|
| 10 | 2.000 | 100.0 |
| 40 | 0.420 | 98.9 |
| 100 | 0.149 | 40.5 |
| 200 | 0.074 | 14.7 |

Fractional Components

+ 3 in. = 0.0 % GRAVEL = 0.0 % SAND = 85.3
 FINES = 14.7

D5= 0.27 D60= 0.194 D50= 0.171
 D30= 0.1222 D15= 0.07447

GRAIN SIZE DISTRIBUTION TEST REPORT

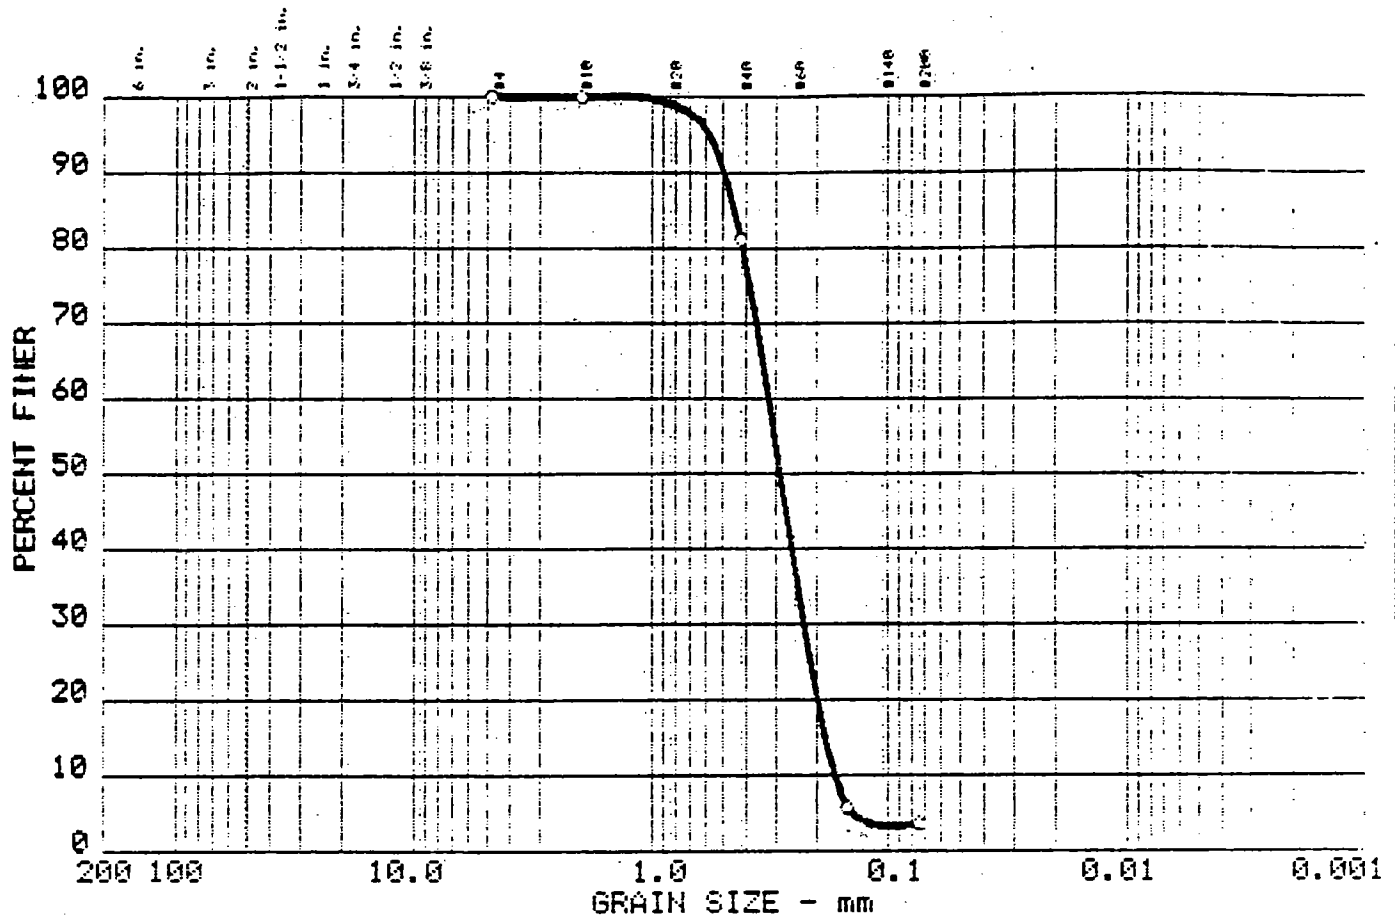

| Test | %+75 _μ | % GRAVEL | % SAND | % SILT | % CLAY |
|------|-------------------|----------|--------|--------|--------|
| 11 | 0.0 | 0.0 | 96.4 | 3.6 | |

| LL | PI | D ₆₅ | D ₆₀ | D ₅₀ | D ₃₀ | D ₁₅ | D ₁₀ | C _c | C _u |
|----|----|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|
| | | 0.45 | 0.32 | 0.29 | 0.227 | 0.1843 | 0.1681 | 0.96 | 1.9 |

| MATERIAL DESCRIPTION | USCS | AASHTO |
|----------------------|------|--------|
| SAND, FINE GRAINED | SP | |

Project No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT
 Location: PRAIRIE ISLAND NUCLEAR PLANT
 Date: 06/21/91

Remarks:
 BORING NO.: 15
 SAMPLE NO.: 5
 DEPTH (ft): 14.5 - 16

GRAIN SIZE DISTRIBUTION TEST REPORT
 TWIN CITY TESTING CORPORATION

Figure No.

=====

GRAIN SIZE DISTRIBUTION TEST DATA

Test No.: 11

Date: 06/21/91
 Project No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT

=====

Sample Data

Location of Sample: PRAIRIE ISLAND NUCLEAR PLANT
 Sample Description: SAND, FINE GRAINED
 UCS Class: SP Liquid limit:
 SHSO Class: Plasticity index:

Notes

Remarks: BORING NO.: 15 SAMPLE NO.: 5
 DEPTH (ft): 14.5 - 16
 Log No.:

Mechanical Analysis Data


| sieve | Size, mm | Percent finer |
|-------|----------|---------------|
| 4 | 4.760 | 100.0 |
| 10 | 2.000 | 99.8 |
| 40 | 0.420 | 81.3 |
| 100 | 0.149 | 5.7 |
| 200 | 0.074 | 3.6 |

Fractional Components

+ 3 in. = 0.0 % GRAVEL = 0.0 % SAND = 96.4
 FINES = 3.6

W₈₅ = 0.45 D₆₀ = 0.319 D₅₀ = 0.285
 W₁₀ = 0.2267 D₁₅ = 0.18429 D₁₀ = 0.16807
 W₅ = 0.9583 Cu = 1.8989

GRAIN SIZE DISTRIBUTION TEST REPORT

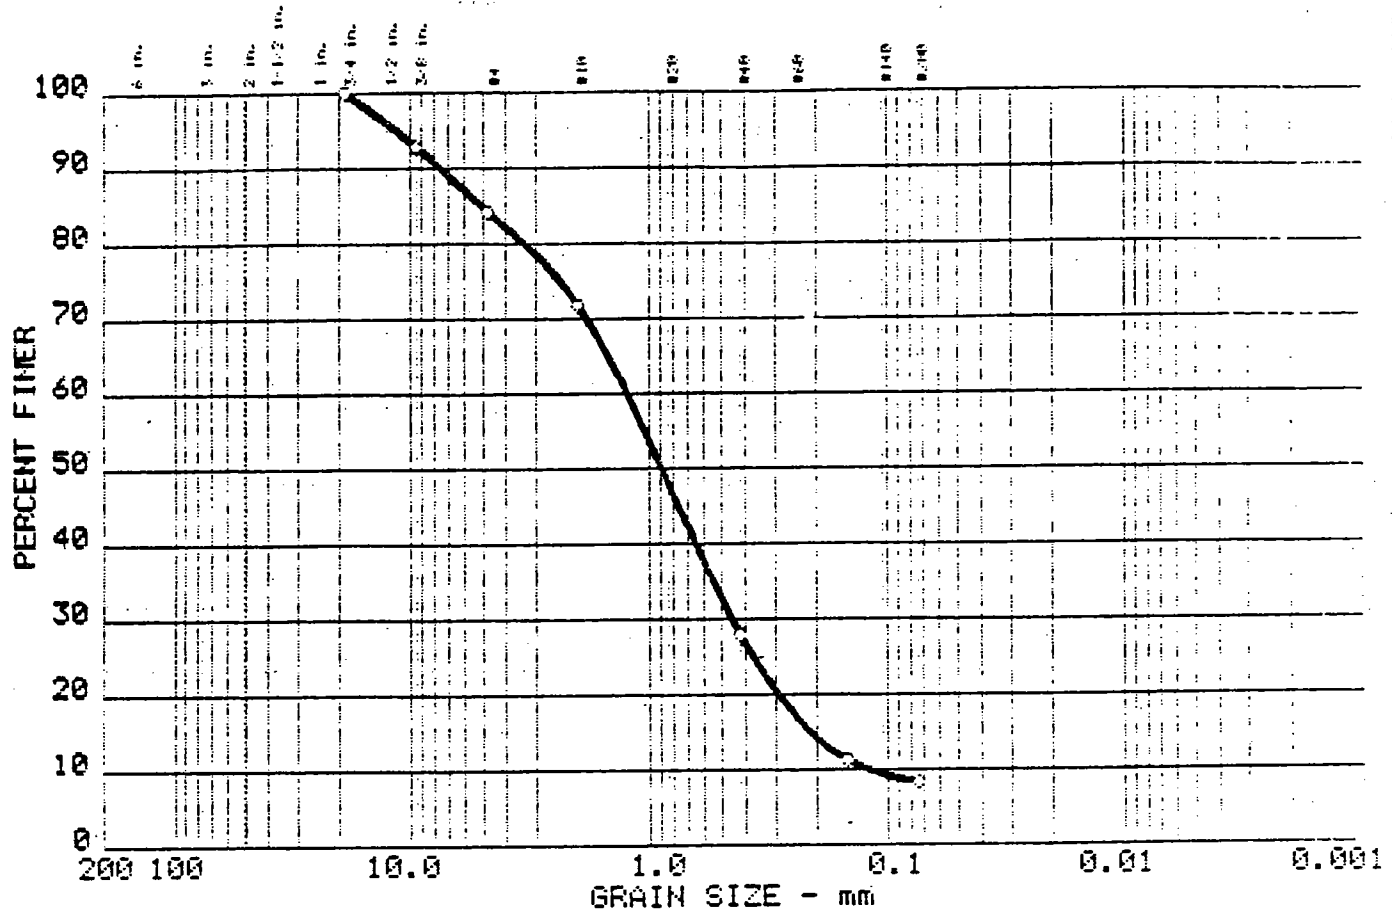

| Test | %+75 _{um} | % GRAVEL | % SAND | % SILT | % CLAY |
|------|--------------------|----------|--------|--------|--------|
| 12 | 0.0 | 15.8 | 75.9 | 8.3 | |

| LL | PI | D ₈₅ | D ₆₀ | D ₅₀ | D ₃₀ | D ₁₅ | D ₁₀ | C _c | C _u |
|----|----|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|
| | | 5.07 | 1.24 | 0.89 | 0.456 | 0.2106 | 0.1171 | 1.42 | 10.6 |

| MATERIAL DESCRIPTION | USCS | AASHTO |
|--|-------|--------|
| SAND W/SILT AND W/GRAVEL, MEDIUM GRAINED | SP-SM | |

Project No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT
 Location: PRAIRIE ISLAND NUCLEAR PLANT
 Date: 06/21/91

Remarks:
 BORING NO.: 15
 SAMPLE NO.: 9
 DEPTH (ft): 49.5 - 51

GRAIN SIZE DISTRIBUTION TEST REPORT
 TWIN CITY TESTING CORPORATION

Figure No.

GRAIN SIZE DISTRIBUTION TEST DATA

Test No.: 12

Date: 06/21/91
 Project No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT

Sample Data

Location of Sample: PRAIRIE ISLAND NUCLEAR PLANT
 Sample Description: SAND W/SILT AND W/GRAVEL, MEDIUM GRAINED
 SCS Class: SP-SM Liquid limit:
 ASHTO Class: Plasticity index:

Notes

Remarks: BORING NO.: 15 SAMPLE NO.: 9
 DEPTH (ft): 49.5 - 51
 Log. No.:

Mechanical Analysis Data


| Sieve | Size, mm | Percent finer |
|--------------|----------|---------------|
| + 75 inches | 19.05 | 100.0 |
| + 375 inches | 9.53 | 92.8 |
| 4 | 4.760 | 84.2 |
| 10 | 2.000 | 71.8 |
| 40 | 0.420 | 27.9 |
| | 0.149 | 11.3 |
| 200 | 0.074 | 8.3 |

Fractional Components

+ 3 in. = 0.0 % GRAVEL = 15.8 % SAND = 75.9
 FINES = 8.3

W5= 5.07 D60= 1.245 D50= 0.891
 W30= 0.4555 D15= 0.21062 D10= 0.11708
 W1 = 1.4240 Cu = 10.6292

GRAIN SIZE DISTRIBUTION TEST REPORT

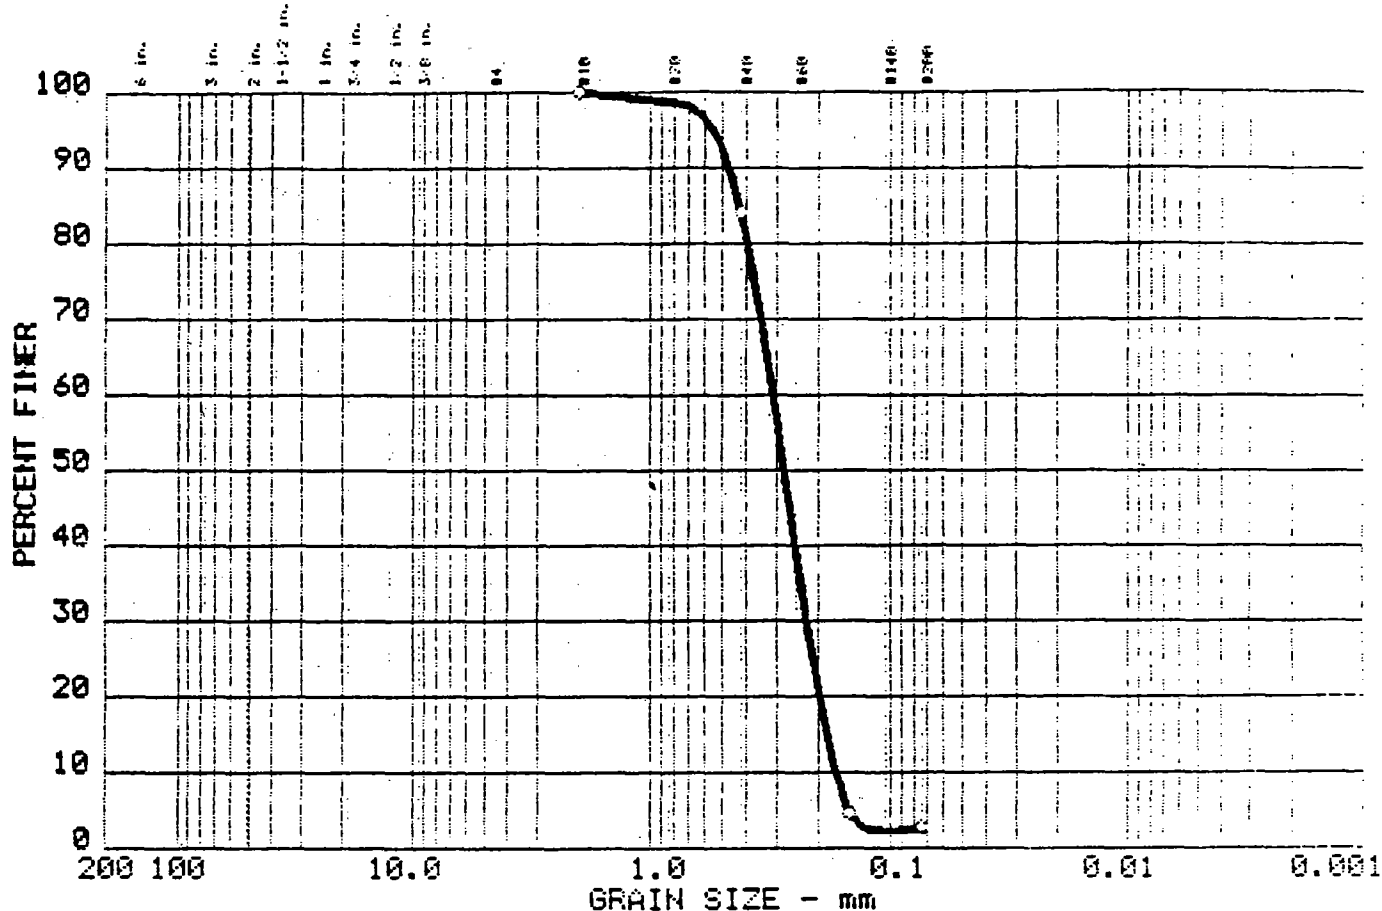

| Test | %+75 _μ | % GRAVEL | % SAND | % SILT | % CLAY |
|------|-------------------|----------|--------|--------|--------|
| 13 | 0.0 | 0.0 | 97.3 | 2.7 | |

| LL | PI | D ₈₅ | D ₆₀ | D ₅₀ | D ₃₀ | D ₁₅ | D ₁₀ | C _c | C _u |
|----|----|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|
| | | 0.43 | 0.31 | 0.28 | 0.224 | 0.1851 | 0.1704 | 0.95 | 1.8 |

| MATERIAL DESCRIPTION | USCS | AASHTO |
|----------------------|------|--------|
| SAND, FINE GRAINED | SP | |

Project No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT
 Location: PRAIRIE ISLAND NUCLEAR PLANT

Date: 06/21/91

Remarks:
 BORING NO.: 16
 SAMPLE NO.: 9
 DEPTH (ft): 34.5 - 36

GRAIN SIZE DISTRIBUTION TEST REPORT
 TWIN CITY TESTING CORPORATION

Figure No.

GRAIN SIZE DISTRIBUTION TEST DATA

Test No.: 13

Date: 06/21/91
 Project No.: 4220 91-1181
 Project: SPENT FUEL ROD VAULT

Sample Data

Location of Sample: PRAIRIE ISLAND NUCLEAR PLANT
 Sample Description: SAND, FINE GRAINED
 SCS Class: SP Liquid limit:
 AASHTO Class: Plasticity index:

Notes

Remarks: BORING NO.: 16 SAMPLE NO.: 4
 DEPTH (ft): 34.5 - 36
 Fig. No.:

Mechanical Analysis Data


| Sieve | Size, mm | Percent finer |
|-------|----------|---------------|
| 10 | 2.000 | 100.0 |
| 40 | 0.420 | 84.1 |
| 100 | 0.149 | 4.6 |
| 200 | 0.074 | 2.7 |

Fractional Components

+ 3 in. = 0.0 % GRAVEL = 0.0 % SAND = 97.3
 FINES = 2.7

D5= 0.43 D60= 0.309 D50= 0.278
 D30= 0.2241 D15= 0.18514 D10= 0.17041
 Cu = 0.9550 Cu = 1.8113

GRAIN SIZE DISTRIBUTION TEST REPORT

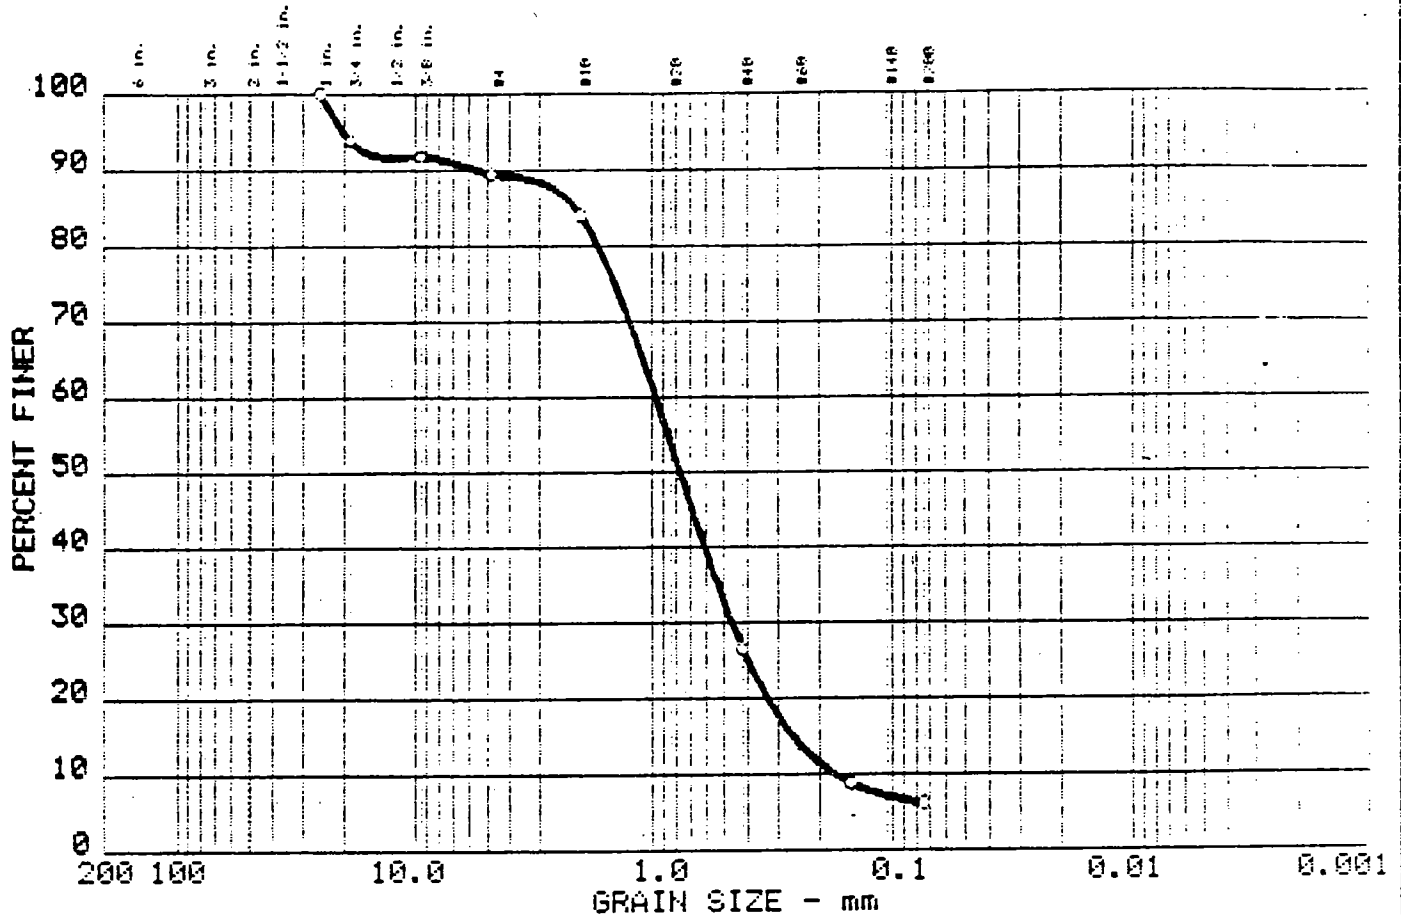

| Test | %+75 _{max} | % GRAVEL | % SAND | % SILT | % CLAY |
|------|---------------------|----------|--------|--------|--------|
| 14 | 0.0 | 10.5 | 83.3 | 6.2 | |

| | LL | PI | D ₈₅ | D ₆₀ | D ₅₀ | D ₃₀ | D ₁₅ | D ₁₀ | C _c | C _u |
|---|----|----|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|
| 0 | | | 2.11 | 0.97 | 0.77 | 0.466 | 0.2591 | 0.1732 | 1.30 | 5.6 |

| MATERIAL DESCRIPTION | USCS | AASHTO |
|---|-------|--------|
| ○ SAND W/SILT & W/A LITTLE GRAVEL, MEDIUM GRAINED | SP-SM | |

Project No.: 4220 91-1181
Project: SPENT FUEL ROD VAULT
Location: PRAIRIE ISLAND NUCLEAR PLANT

Date: 06/21/91

Remarks:

BORING NO.: 16

SAMPLE NO.: 14

DEPTH (ft): 59.5 - 61

GRAIN SIZE DISTRIBUTION TEST REPORT
TWIN CITY TESTING CORPORATION

Figure No.

=====

GRAIN SIZE DISTRIBUTION TEST DATA

Test No.: 14

06/21/91

Test No.: 4220 91-1181

Project: SPENT FUEL ROD VAULT

=====

Sample Data

Location of Sample: PRAIRIE ISLAND NUCLEAR PLANT

Sample Description: SAND W/SILT & W/A LITTLE GRAVEL, MEDIUM GRAINED

CS Class: SP-SM Liquid limit:

ASHTO Class: Plasticity index:

Notes

Remarks: BORING NO.: 16 SAMPLE NO.: 14

DEPTH (ft): 59.5 - 61

g. No.:

Mechanical Analysis Data

| Size, mm | Percent finer |
|----------|---------------|
| + 3 in. | 100.0 |
| 75 in. | 93.9 |
| 375 in. | 91.8 |
| 4 | 89.5 |
| 7.5 | 84.0 |
| 15 | 26.5 |
| 30 | 8.8 |
| 60 | 6.2 |

Fractional Components

+ 3 in. = 0.0 % GRAVEL = 10.5 % SAND = 83.3

FINES = 6.2

D5= 2.11 D60= 0.966 D50= 0.766

D0= 0.4661 D15= 0.25912 D10= 0.17318

D30= 1.238 D40= 0.5733

SECTION 3

PRINCIPAL CASK DESIGN CRITERIA

3.1 PURPOSES OF CASK

3.1.1 SPENT FUEL TO BE STORED

The ISFSI is designed to accommodate a total of 48 storage casks. Each of the casks is capable of accommodating 40 spent fuel assemblies. The total capacity of the fuel to be stored at the facility is 715.29 metric tons of uranium (MTU). This is based on storage of 482 Westinghouse standard assemblies (400 kgU/each), 481 Exxon's standard and TOPROD assemblies (370 kgU/each) and 957 Westinghouse optimized design assemblies (360 kgU/each).

Physical characteristics of the fuel to be stored in the ISFSI are described in detail in Chapter 3 of the Prairie Island USAR (Reference 1) and are summarized in Table 3.1-1.

The following fuel assembly characteristics constitute limiting parameters for storage of specific assemblies at the ISFSI:

- Initial Fuel Enrichment: shall be limited to a maximum of 3.85 weight percent U-235
- Fuel Burnup: shall be limited to a maximum burnup of 45,000 MWD/MTU
- Decay Time: shall be limited to a minimum of 10 years
- Physical Configuration/Condition: fuel assembly shall be intact, shall have no known cladding defects and shall not have physical damage which would inhibit insertion or removal from the cask fuel basket.

Only spent fuel which meets the requirements specified in Chapter 10 and the ISFSI Technical Specifications will be stored in the ISFSI.

The thermal and radiological characteristics for the spent fuel were generated using the ORIGEN2 computer code (Reference 2). These characteristics for the Westinghouse OFA 14x14 assembly are shown in Table 3.1-2. For the thermal and radiological characteristics, the Westinghouse 14x14 OFA assembly with an enrichment of 3.85 w/o U-235 was chosen. The OFA assembly contains the largest "structural" mass of all the assembly types. It was assumed to contain 380 kgU, which is the average of all assemblies. Analyses are included in Section 3.3.4.

SAFETY ANALYSIS REPORT

Revision: 16

Page 3.1-2

Fuel with various combinations of burnup, specific power, enrichment and cooling time can be stored in the TN-40 cask as long as values for decay heat and gamma and neutron sources, including spectra, fall within the design limits specified in Table 3.1-2. For reference, Figure 3.1-1 shows the relationship between cooling time and decay heat for the design basis fuel assembly. The decay heat values were calculated by multiplying the ORIGEN2 values by 1.08 (Reference 3). Figures 3.1-2 and 3.1-3 show the total photon and neutron sources, respectively, as a function of cooling time for the design basis 14x14 PWR assembly. Figure 3.1-4 shows the dimensional data for the fuel assembly.

Within the population of assemblies that meet the criteria for storage in a TN-40 as described above, there are three regions of fuel, Regions 4, 5 and 6 (assemblies identified as D, E and F) that were found to have compromised top nozzle to fuel skeleton connections due to stress corrosion cracking at the thimble tube joints (bulge joints). A fourth region of fuel, Region 14 (assemblies identified as N), was identified as potentially being subject to the condition. This condition could lead to top nozzle separation during assembly movement. The condition is addressed in one of three ways: visual inspection of the joints just prior to each movement of the assembly to insure integrity followed by movement with the standard spent fuel handling tool; the use of a thimble grip handling tool; permanent modification of the suspect assembly with anchors in the thimble tubes (Reference 34). The first two approaches do not modify the assembly. In the permanent modification approach anchors are mounted in at least six of the thimble tubes which secures the top nozzle of the assembly by bypassing the potentially compromised bulge joints. The anchors consist of two parts; a tapered pin and barbed sleeve which are stainless steel and do not extend into the active fuel (Reference 35). A thimble plug insert or BPRA insert cannot be placed in the assembly once anchors are mounted. The anchors are designed and tested for structural integrity relative to assembly movement. Each anchor is load tested upon installation.

The presence of the anchors in the cask does not invalidate any safety analyses (Reference 36). The anchors are not irradiated and do not produce any internal heat and do not add to the source term for the cask dose analysis. They do not extend into the active fuel of the assembly and do not impact the criticality analysis. The anchors weigh less than the limiting insert (16-pin BPRA) and are not a source of gas that would affect cask internal pressure. After the installation of the anchors the assembly is moved with the standard spent fuel handling tool assuring retrievability of the assemblies from the cask.

3.1.2 GENERAL OPERATING FUNCTIONS

The fuel assemblies will be stored unconsolidated and dry in sealed storage casks. The casks will rest on a reinforced concrete pad, and provide safe storage by ensuring a reliable decay heat path from the spent fuel to the environment and by providing appropriate shielding and containment of the fission product inventory. Storage of spent fuel in storage casks is a totally passive function, with no active systems required to function. Cooling of the casks is accomplished by radiant and convective cooling.

Each cask will be handled with a lifting yoke, the 125 ton capacity auxiliary building crane, a transport vehicle, or other appropriate equipment. The crane will lift the cask from the spent fuel pool, in the spent fuel pool enclosure, move the cask laterally through an access door, and lower the cask to ground level in the rail bay of the Auxiliary Building. The cask will then be picked up by the transport vehicle which will be pulled to the ISFSI by a tow vehicle. After the transport vehicle has been maneuvered to locate the cask in its storage position, the cask will be set down.

All the handling equipment to be used outside the Auxiliary Building will be designed according to appropriate commercial codes and standards, and will be operated, maintained, and inspected in accordance with the supplier's recommendations. Documentation will be maintained to substantiate conformance with all applicable standards.

THIS PAGE IS LEFT INTENTIONALLY BLANK

3.2 DESIGN CRITERIA FOR ENVIRONMENTAL CONDITIONS AND NATURAL PHENOMENA

The storage casks are designed with the objectives of ensuring that fuel criticality is prevented, cask integrity is maintained, and fuel is not damaged so as to preclude its ultimate removal from the cask. The conditions under which these objectives must be met are described below.

The safe storage of the spent fuel assemblies must depend only on the capability of the storage casks to fulfill their design functions. The casks are self-contained, independent, passive systems, which do not rely on any other systems or components for their operation. Therefore, the casks are safety-related. The criteria used in the design of the casks ensure that their exposure to credible site hazards will not impair their safety functions. Because the ISFSI is located on the plant site, all ISFSI design criteria for environmental conditions and natural phenomena are the same as the plant design basis, as found in the USAR.

The design criteria satisfy the requirements of 10CFR72. They consider the effects of normal operation, natural phenomena and postulated man-made accidents. The criteria are defined in terms of loading conditions imposed on the storage cask. The loading conditions are evaluated to determine the type and magnitude of loads induced on the storage cask. The combinations of these loads are then established based on the number of conditions that can superimpose. The load combinations are then classified as Design and/or Service Conditions consistent with Section III of the ASME Boiler and Pressure Vessel Code (Reference 4). The stresses resulting from the application of these loads are then typically evaluated based on the rules for a Class 1 nuclear component in Subsection NB of the Code.

3.2.1 TORNADO AND WIND LOADINGS

Tornado loadings specified in Section 12.2.1.3.2 of the Prairie Island USAR were used in the design of the TN-40 cask. These loads consist of the following:

- A differential pressure equal to 3 psi. This pressure is assumed to build up from normal atmospheric pressure in 3 seconds.
- A lateral force caused by a funnel of wind having a peripheral tangential velocity of 300 mph and a forward progression of 60 mph.
- The design tornado driven missile was assumed equivalent to an airborne 4" x 12" x 12'0" plank travelling end-on 300 mph, or a 4000 lb. automobile flying through the air at 50 mph and at not more than 25 ft. above ground level.

An analysis of impact on the cask of tornado missiles in accordance with Table 12.2-9 of the Prairie Island USAR is presented below. Wind loading is not significant in comparison to that due to tornados; therefore, the wind loading is conservatively taken to be the same as the tornado loading.

3.2.1.1 APPLICABLE DESIGN PARAMETERS

The external pressure drop of 3 psi associated with passing of the tornado is small and, when combined with the other internal pressure loads, is far exceeded by the design internal pressure (20 psig normal design rating, 100 psig analyzed) for the cask. Its effect is included in the effects of the other internal pressure loadings listed in Table 3.2-3.

3.2.1.2 DETERMINATION OF FORCES ON STRUCTURES

The 360 mph tornado wind was assumed based upon a summation of the assumed peripheral tangential velocity and forward progression of the design basis tornado. The wind loading was converted to a dynamic pressure (psf) acting on the cask by multiplying the square of the wind velocity (in mph) by a coefficient (0.002558 at ambient sea level condition) dependent on the air density. The result is a pressure of 332 psf. This is based on data presented in a paper by T.W. Singell (Reference 5). The net force acting on the cask is obtained by multiplying this pressure by the product of the area of the cask projected onto a plane normal to the direction of wind times a drag coefficient. A drag coefficient of 1 is used based on the geometric proportions of the cask (i.e. length to diameter ratio of approximately 2) and the conservative assumption that the cask surface is rough.

This results in a distributed load, w lb/in, acting on the cask in a vertical orientation over the length of 201.0 in. as shown in Figure 3.2-1. The load is calculated as follows:

$$\begin{aligned} w &= \frac{332}{144} \times \text{Outer Shell Diameter} \\ &= \frac{332}{144} \times 101.0 \\ &= 232.9 \text{ lb/in} \end{aligned}$$

An additional type of load on the structure is that created by the impact of tornado missiles on the cask. These impacts are analyzed for two types of missiles specified in the Prairie Island USAR. Missile A is a 4000 lb. automobile striking the cask horizontally at normal incidence at 50 mph. Missile B is a 4 in. x 12 in. x 144 in. plank weighing 200 lb. striking the cask:

- Horizontally at normal incidence at 300 mph
- Vertically at normal incidence at 80% of the horizontal velocity.

3.2.1.2.1 STABILITY OF THE CASK IN THE VERTICAL POSITION UNDER WIND LOADING

The cask stands in an upright position on a concrete pad. The coefficient of friction between the steel cask and the concrete is taken as 0.25 for dry concrete. This coefficient is conservatively low based on data in Marks Handbook (Reference 6) which gives a value of 0.29 for steel on sandstone. Steel on concrete would be similar. A wind velocity of 407 mph would then be required to cause the cask to slide.

This value is calculated below:

$$q = 0.002558 V^2$$

$$q = \frac{F}{A}$$

$$F = \text{force to overcome friction force, } F_f$$

$$A = \text{projected area of cask length, } ft^2$$

$$F = F_f = \text{cask weight} \times 0.25$$

$$= 240,000 \times 0.25 \quad (\text{The weight used in this evaluation is slightly low. This is conservative for stability evaluation under wind loading.})$$

$$= 60,000 \text{ lb.}$$

$$A = 201.0 \times 101.0/144$$

$$= 141 \text{ } ft^2$$

$$\text{Therefore: } 0.002558 V^2 = \frac{60,000}{141}; V = 407 \text{ mph}$$

If the cask does not slide, a constant wind velocity of 549 mph would be required to tip the TN-40 cask, with an outer diameter of 91.0 in. This is calculated as follows:

$$M_c = \text{The tipping moment about the bottom edge of the cask}$$

$$M_c = \frac{91.0}{2} W - w \times \frac{(201.0)^2}{2}$$

$$W = \text{cask weight} = 240,000 \text{ lb}$$

$$w = \text{distributed load to tip cask, lb/in}$$

Therefore

$$w = 91.0W/2 \times 2/(201.0)^2 = 541 \text{ lb/in.}$$

The corresponding pressure load, q , is:

$$q = \frac{541}{101.0} \times 144 = 771 \text{ psf}$$

The corresponding wind speed (v) is:

$$\begin{aligned} v &= \sqrt{\frac{771}{0.002558}} \\ &= 549 \text{ mph} \end{aligned}$$

3.2.1.2.2 STABILITY OF THE CASK IN THE VERTICAL POSITION UNDER MISSILE IMPACT

It is assumed that both Missile A and Missile B impact inelastically on the cask as shown in Figure 3.2-2. Both missile A (the automobile) and missile B (the wood plank) are assumed to crush. The cask will tend to slide if the missile strikes it below the center of gravity (unless it is blocked in position) or tilt if the missile strikes it above the center of gravity. Conservation of momentum is assumed for both sliding and tipping with a coefficient of restitution of zero. The energy transferred to the cask is dissipated by friction in the sliding case or transformed into potential energy as the cask center of gravity lifts in the tipping case. When a missile strikes the side of the cask at an elevation near the center of gravity, the following velocities are calculated:

In the sliding case:

$$V = \frac{mv_0}{M + m}$$

In the tipping case:

$$\omega_p = \frac{md_{CG}v_0}{m(d_{CG})^2 + I_p}$$

Where:

- V = cask translational velocity after impact
- V_o = missile initial velocity
- ω_p = cask angular velocity about P after impact
- m = mass of Missile A
- M = cask mass
- d_{CG} = distance from center of gravity to pivot point P
- I_p = moment of inertia of cask about pivot point P

SAFETY ANALYSIS REPORT

Revision: 17

Page 3.2-5

When the appropriate substitutions are performed for Missile A (automobile) impact, the cask velocity after impact, V , in the sliding case is found to be 1.20 ft/sec. The rotational velocity about P, ω_p , is found to be 0.21 rad/sec for impact at the top. Missile B impact produces lower cask translational and rotational velocities because of its lower initial momentum. Vertical impact of Missile B has no effect on cask stability.

If the cask slides on the concrete pad, the cask kinetic energy after impact is absorbed by friction. The friction work can be equated to the kinetic energy. Assuming a coefficient of friction of 0.25:

$$\begin{aligned} E_{friction} &= \mu g(M + m) l \\ &= 1/2 (M + m) v^2 \end{aligned}$$

Where

$E_{friction}$ = energy absorbed in friction

μ = coefficient of friction

g = acceleration of gravity

l = distance cask slides on concrete pad

When a solution is performed to determine l , the sliding distance is determined to be 1.1 in. When the cask tips or pivots about point P after impact, the kinetic energy is transformed into potential energy as the center of gravity rises:

$E_{tipping}$ = Increase in Potential Energy = Kinetic Energy

$$E_{tipping} = Mg d_{CG} [\cos(\beta + \alpha - \pi/2) - \cos\beta] = 1/2 I_p \omega_p^2$$

Where:

$E_{tipping}$ = The increase in potential energy of the cask since the center of gravity rises as the cask pivots about the corner.

β, α are indicated in Figure 3.2-2.

The angle α is determined to be 89° for impact at the top of the cask (the cask tilts 1° and the center of gravity lifts about 0.8 in.). The cask is stable and will not tip over since it will return to the vertical position as long as α is greater than about 63.7°.

Even at this 89° angle, wind will not tip over the cask (if the wind force occurs simultaneously with Missile A impact). At an 89° angle the tipping moment about Point P due to the 360 mph wind is less than 45% of the restoring moment due to the weight. Therefore the cask is stable in the vertical orientation under simultaneous tornado wind and tornado missile loadings.

SAFETY ANALYSIS REPORT

Revision: 17

Page 3.2-6

The impact forces applied to the cask as it is struck by the missiles are determined as follows:

- Missile A (automobile) is assumed to crush 1.5 ft. (18 in.) under a constant force during the impact. The loss of kinetic energy is assumed to be dissipated by crushing of the missile.

$$F_a \times 1.5 \text{ ft.} = \frac{1}{2} [m_a v_0^2 - (M + m_a) V^2]$$

The frontal area of the automobile is assumed to be

$$3 \text{ ft.} \times 6 \text{ ft.} = 18 \text{ ft.}^2$$

$$p_a = F_a / 18 \text{ ft.}^2$$

where:

$$F_a = \text{Impact force on cask by Missile A}$$

$$p_a = \text{Impact pressure on cask by Missile A}$$

The impact force, F_a , is determined to be 222,682 lb., and the crush pressure on the frontal area of the automobile, p_a , is 85.9 psi.

Missile B (Wood Plank) will crush under impact. The highest crush strength S_{crush} of any wood listed in Reference 6 is 9210 psi (hickory). The contact force required for the plank to start crushing is:

$$F_c = S_{\text{crush}} \times A = 9210 \times 48 = 442,080 \text{ lb.}$$

The kinetic energy of the plank is dissipated as the plank crushes against the cask wall. The kinetic energy (KE) of the plank is:

$$KE = \frac{1}{2} M v_0^2 = \frac{12}{2} \times \frac{200}{32.2} \times \left(\frac{300 \times 5280}{3600} \right)^2 = 7.215 \times 10^6 \text{ in. lb.}$$

The crush length (L) of the plank, for a constant force, is evaluated as:

$$L = \frac{KE}{F_c} = \frac{7.215 \times 10^6}{442,080} = 16.3 \text{ in.}$$

For the case of the plank striking the top of the cask, the velocity is 80% of the horizontal case. Hence, the kinetic energy would be 4.618×10^6 in.lb. and the crush length of the plank 10.4 in.

3.2.1.3 LOCAL EFFECT ON CONTAINMENT OF MISSILE IMPACT

Both Missiles A and B deform and are crushed during the impact. The local pressure on the cask structure is a small fraction of the body yield strength. Therefore, no local penetration occurs.

3.2.2 WATER LEVEL (FLOOD) DESIGN

The design basis flood used for the ISFSI is the same as that used for Class 1 (safe shutdown) structures of the Prairie Island Nuclear Generating Plant, and is described in Section 2.4.1. The probable maximum flood level calculated to occur at the ISFSI is 706.7 ft. above msl with a water velocity of 6.2 ft/sec. This includes wave run-up. The ISFSI is sited and designed such that the lowest point of potential leakage into the cask is above the level of the probable maximum flood.

The casks are designed to withstand loads from forces developed by the probable maximum flood including hydrostatic effects and dynamic phenomena such as momentum and drag.

The storage cask is designed for an external pressure of 25 psi which would be equivalent to a static head of water of approximately 56 ft. This is greater than would be anticipated due to the probable maximum flood.

The drag force (F) exerted on the cask by the flowing water is:

$$F = C_D A \rho \frac{V^2}{2g}$$

where: F = Drag force

C_D = Drag coefficient = 1.0

A = Projected area = 141 ft²

ρ = density of water = 62.4 lb/ft³

V = water velocity = 6.2 ft/sec

Therefore $F = 5,250$ lb.

The drag force is applied to the cask in the same manner as the wind force discussed in Section 3.2.1. Since the wind force did not move the cask, and the drag force is less than 20% of the wind force, the postulated flood will not cause the cask to slide or tip.

As mentioned previously, the maximum flood height including wave run-up does not exceed the height of the cask seals. Therefore no inleakage of water can occur. Also, the interspace between the containment seals and the containment vessel cavity are pressurized to approximately 6 atm and 2 atm, respectively, to further preclude any possibility of water inleakage.

3.2.3 SEISMIC DESIGN

Seismic design criteria requirements are set forth in 10CFR72.102. The design earthquake for use in the design of the casks and ISFSI structures must be equivalent to the safe shutdown earthquake (SSE) for a collocated nuclear power plant, the site of which has been evaluated under the criteria of 10CFR100, Appendix A.

Section 2.6 of the Prairie Island USAR discusses site seismology and development of the SSE. An SSE of 0.12g horizontal and 0.08g vertical has been established as the design criteria for the Prairie Island Nuclear Generating Plant. The recommended response spectra developed for the SSE as set forth in the Prairie Island USAR, Appendix E and Figure 2.5-8 of this SAR, was used in cask design.

3.2.3.1 SEISMIC ACCELERATION LEVEL

The TN-40 storage cask is a stiff structure having high natural frequencies of vibration. The cask standing vertically on its pad has a frequency above the minimum required (33 cps) to treat a structure as a rigid body and to ignore amplification of free field seismic motion. Therefore the cask is evaluated using an equivalent static seismic loading method, and there is no need to specify a design response spectrum or its associated time history. The equivalent static load used is 1.5 times (per NUREG-0800, Reference 27) the basic g level specified earlier. These loads are assumed to be distributed over the cask length and cask bottom areas as shown in Figure 3.2-1.

3.2.3.2 SEISMIC-SYSTEM ANALYSIS

The only significant effects of seismic loading that might occur would be sliding and/or tipping (overturning) of the cask.

For a circular cask the horizontal g value necessary to tip the cask is calculated below:

$$M_{tip} = g \times W \times l_v + \frac{2}{3} g \times W \times l_r$$

Where:

M_{tip} = Moment necessary to tip the cask, in lb.

g = Acceleration value necessary to tip the cask

W = Weight of cask on pad = 240,000 lb.

SAFETY ANALYSIS REPORT

Revision: 17

Page 3.2-9

l_v = vertical distance to center of gravity = 92 in.

l_r = radial distance to center of gravity from pivot point = 45.5 in.

$$M_{stab} = W \times l_r$$

Where:

M_{stab} = stabilizing moment on cask, in lb.

W = 240,000 lb.

l_r = 45.5 in.

Therefore the g value necessary to tip the cask is found by equating M_{tip} to M_{stab} :

$$(g \times W \times l_r) + \left(\frac{2}{3} g \times W \times l_r \right) = W l_r$$

$$g = \frac{45.5}{92 + 0.66 \times 45.5} = 0.37$$

The two horizontal components of seismic load are combined as indicated in Section 2.1 of Reference 7. At 45° to either horizontal component the response due to a N-S earthquake is $\sin 45^\circ \times$ N-S response and likewise for an E-W earthquake is $\sin 45^\circ \times$ E-W response. If both components are equal, the combined response is:

$$(\sin^2 45^\circ + \sin^2 45^\circ)^{1/2} \times \text{response} = \text{response in either axis.}$$

For this evaluation, the horizontal response is $0.12g \times 1.5 = 0.18g$ and the vertical is $0.08 \times 1.5 = 0.12g$.

Since the applied horizontal acceleration of 0.18g (0.12×1.5) is less than the 0.37 g required to tip the cask, the cask will not tip over. A dynamic analysis of the potential for a cask tip has also been performed, taking into account the design of the pad. This analysis is described in Section 4.2.1.

If the cask were to slide due to seismic loading, the horizontal component of the seismic load must overcome the normal force acting at the cask/ground interface multiplied by the coefficient of friction. The vertical seismic force is applied upward ($0.08W \times 1.5 = 0.12W$) so as to decrease the normal forces and hence the sliding resistance force. When this is done the downward load is 0.88W and the friction force that must be overcome to slide the cask is 0.22W ($0.25 \times 0.88W$). The maximum side load is $0.12W \times 1.5 = 0.18W$; therefore, the cask will not slide.

3.2.4 SNOW AND ICE LOADINGS

The TN-40 is a vertical storage cask system and thus snow and ice loadings need not be considered for the storage cask.

The temperature of the protective cover attached to the top of the cask above the lid could fall below 32°F under certain conditions and a layer of snow or ice might build up. A 50 psf (0.35 psi) snow or ice load as specified in the Prairie Island USAR corresponds to approximately 6 ft of snow or 1 ft of ice. However, this load is insignificant to the TN-40 since the cover is a 0.38 in. thick toruspherical steel head which can withstand an external pressure over 20 psi. Therefore, the cover will maintain its intended protective function under these snow or ice loading conditions.

Another possible influence on the TN-40 is a thermal shock when the warm cask is suddenly cooled by cold rain (conservatively assumed at 32°F). A number of such cycles is considered in the thermal fatigue analysis in Section 4.

3.2.5 COMBINED LOAD CRITERIA

3.2.5.1 INTRODUCTION

Sections 3.2.1 through 3.2.4, above, describe the most severe natural phenomena considered in the design of the TN-40. These natural phenomena have been analyzed in those SAR sections where it has been shown that the cask is stable. It will not tip over under any condition or slide on its pad more than about an inch. In addition, the forces and pressures applied to the cask due to these phenomena have been determined.

It should be noted that all of the above phenomena are upper bound, low probability events. In most cases, however, there is a more regular and frequent similar phenomena of lower magnitude. For instance, some small wind load occurs often, but a tornado is unlikely. The forces and pressures determined for the severe phenomena can therefore be conservatively used as upper bound values for all of the similar events.

It has been conservatively assumed that these bounding forces and pressures, with a single exception, can occur at any time and their effects are combined with those due to normal operation. The sole exception is the loading(s) due to the tornado missiles as described in Section 3.2.1.2.2. The missile case is evaluated in combination with others as a low probability event which is postulated only because the consequences of cask penetration might result in severe impact on the immediate environs.

3.2.5.2 TN-40 CASK LOADING

A brief explanation of the cask loads due to events that will occur or can be expected to occur in the course of normal operation of the ISFSI follows in the next paragraph. Next, the cask loads due to the severe natural phenomena and accidents will be compared with those for similar but less severe normal events. Then loads equal to or higher than the upper bound values selected for design and analysis of the TN-40, defined as Service Loads, will be described. Finally the Service Loads will be separated into two levels and superposition of simultaneous loadings (combined loads) will be discussed

3.2.5.2.1 NORMAL OPERATION

During normal storage on the ISFSI pad the cask is subjected to loading due to its own dead weight and that of its contents (fuel and basket), assembly stresses due to the bolt preload required to seat the double metallic seals and react to the internal pressure, and internal pressure due to initial pressurization and any fuel clad failure resulting in fission gas release. Additional normal loads include wind loading which produces a distributed lateral load on one side of the cask and can also result in slight external pressure drop on other portions of the cask. Also lifting loads are applied to the cask through the trunnions and the cask dead weight is reacted through the trunnions during lifting operations. Finally, an increased external pressure will be applied to all surfaces of the cask during fuel loading when the cask is at the bottom of the spent fuel pool. Snow and ice loads apply local external pressure loading to the top of the cask. The cask will, of course, be subjected to the full range of thermal conditions produced by ambient variations (including insolation) and decay heat.

3.2.5.2.2 LOADINGS DUE TO SEVERE NATURAL PHENOMENA AND ACCIDENTS

The cask is subjected to dead weight loading and assembly stresses due to bolt preload and seal compression under all conditions. If it becomes necessary to unload a recently loaded hot cask, cold water would be pumped into the cask to reduce the temperature before returning the cask to the pool. If proper controls are not maintained an internal pressure corresponding to saturated steam pressure at the cavity wall temperature could occur which would be higher than the normal internal pressure. The tornado wind loading described in Section 3.2.1 could produce higher lateral loading than any normal wind loading or flood water drag force. The external pressure drop due to the tornado wind is also more severe than due to any normal condition. Tornado missile impact described in Section 3.2.1.2.2 could apply a high local loading to the cask unlike any normal condition. External pressure loading of the cask could occur due to flooding (see Section 3.2.2), burial or nearby explosion. The full range of thermal conditions due to ambient variations, decay heat and minor fire in the vicinity of the cask apply.

3.2.5.2.3 THERMAL CONDITIONS

The TN-40 component temperatures and thermal gradients are affected by the following thermal conditions:

- Fuel loading
- Decay heat
- Insolation
- Beginning of life unloading
- Ambient variations
- Lightning
- Minor fire

The thermal conditions which are of concern structurally are the temperature distributions in the cask and the differential thermal expansions of interfacing cask components.

3.2.5.2.4 FUEL LOADING

The cask is loaded in a spent fuel pool under water. The cask is cooled by pool water; therefore, the thermal gradients established during fuel loading will be negligible.

3.2.5.2.5 DECAY HEAT/SOLAR LOAD

After the cask is loaded and removed from the pool, the body temperature will gradually reach steady state conditions. Since the mass of the cask is large, the time to reach equilibrium will be approximately 1 to 2 days. The temperature gradients in the cask body have an insignificant effect on the structural integrity of the body.

Several thermal analysis calculations were made for different ambient conditions. The methods used to obtain these results are discussed in Section 3.3.2.2. The temperature distribution in the cask resulting from the thermal analysis for the off-normal condition was used for the structural analysis.

3.2.5.2.6 BEGINNING OF LIFE UNLOADING

This condition would occur if it were necessary to place the cask back in the pool at the beginning of life after it had been loaded and reached thermal equilibrium. Prior to placing the cask in the pool, the cask and fuel would have to be cooled by circulating water through the cask. Therefore, cold water would contact the hotter cask inside surfaces. This condition has been evaluated and it has been shown that the thermal gradients in the cask body are small and would have an insignificant effect on the cask body and the fuel cladding.

3.2.5.2.7 AMBIENT VARIATIONS

Because the cask thermal inertia is large, the cask temperature response to changes in atmospheric conditions will be relatively slow. Ambient temperature variations due to changes in atmospheric conditions i.e., sun, ice, snow, rain and wind will not affect the performance of the cask. Snow or ice will melt as it contacts the cask because the outer surface will be above 32°F for ambient temperatures above -40°F. The cyclical variation of insolation during a day will also create insignificant thermal gradients. One condition which is evaluated structurally is cold rain on a hot cask. The conservative assumption is made that the thin outer skin on the outer surface of the cask is restrained from contracting by the mass of the cask.

The thermal effects due to ambient variations and conditions are discussed in further detail in Section 3.3.2.2.

3.2.5.2.8 LIGHTNING

Lightning will not cause a significant thermal effect. If struck by lightning on the lid, the electrical charge will be conducted by paths provided by the lid bolts to the body.

The lid metallic O-ring seals can withstand temperatures of up to 600°F without loss of sealing capability. It is not anticipated that lightning could result in the seals reaching temperatures above these values.

3.2.5.2.9 FIRE

The only real source of fuel which could cause a fire in the vicinity of the cask is the fuel tank of the tow vehicle which transports the cask to the storage pad. An evaluation was made to determine the thermal response of the cask assuming this minor fire is an engulfing fire. The details of this analysis are given in Section 3.3.2.2.2. It was concluded that the cask will maintain its containment integrity during and after this bounding hypothetical fire accident.

3.2.5.2.10 BURIED CASK

An evaluation was made to determine the increase in cask temperature with time assuming the cask was completely buried by dirt and debris with very low thermal conductivity. The details of this analysis are given in Section 3.3.2.2. The analysis shows that the cask will maintain its containment integrity up to a maximum burial period of 55 hours.

3.2.5.3 BOUNDING LOADS FOR DESIGN AND SERVICE CONDITIONS

3.2.5.3.1 DEAD (WEIGHT) LOADS

The only dead loads (hereafter referred to as weight loads) on the cask are the cask weight including the contents. The calculated weights of the individual components of the cask and the total weights are given in Table 3.2-1. The weight of the cask assembly is reacted as a contact force between cask and storage pad except when the cask is supported (lifted) by the pair of trunnions at the top of the cask during handling prior to fuel loading.

3.2.5.3.2 LIFTING LOADS

The cask is provided with two trunnions at the top spaced 180 degrees apart for non-redundant lifting. The smaller trunnions at the bottom of the cask are for rotation of the cask.

The upper trunnions themselves are considered to be lifting devices and are evaluated for lifting for g levels equivalent to 6 times and 10 times the upper bound weight of the cask. These values are based on ANSI N14.6 (Reference 8), which requires that lifting devices be capable of lifting 6 times and 10 times the cask weight without exceeding the yield and ultimate strengths of the material. The trunnion loads for the ANSI N14.6 analysis are shown in Figure 3.2-3 and listed in Table 3.2-2.

The cask body is conservatively evaluated for a vertical load of 3 g (i.e., 3 times the weight of the cask) which is reacted at the trunnions involved in the handling operation. The factor of 3 provides ample allowance for sudden load application during lifting. The loads used in the cask body analysis during lifting operations are shown in Figure 3.2-4. The weight of the cask used for these analyses is a conservatively assumed maximum loaded weight of 250,000 lb. The attachment loads are calculated in terms of forces and moments acting locally on the cask body.

3.2.5.3.3 INTERNAL PRESSURE

The pressure inside the cavity of the storage cask results from several sources. Initially the cavity is pressurized with helium such that the cavity pressure is 2.2 atm at thermal equilibrium. The basis for the initial pressure is to establish, and maintain, a cask environment with no more than 0.25% oxidizing gases by volume. Pressure variations due to daily and seasonal changes in ambient temperature conditions will be small due to the large thermal capacity of the cask.

Fuel clad failure results in the release of fission gas which increases cavity pressure. Under normal storage conditions a 10% fission gas release is assumed due to fuel clad failure. This results in an increase in cavity pressure of 3.6 psi.

Another condition when internal pressure could increase is the cooldown prior to unloading. This could occur at the beginning or end of life. Unloading of fuel at the beginning of life would only be necessary due to excessive leakage past the lid seals or a severe accident, e.g. cask drop. The cask cavity wall temperature at the beginning of life is just below 303°F. Therefore, before returning the cask into a pool, cold water would be pumped into the cavity to reduce the temperature. When the water hits the cavity surface, steam might be produced and the resulting pressure inside the cavity could reach the saturated steam pressure of 71 psia (4.82 atm) corresponding to the cavity wall temperature of 303°F.

Table 3.2-3 presents a summary of internal pressures for the conditions identified. A pressure of 100 psig was chosen as the design internal pressure, since this value exceeds that of all conditions producing an internal pressure. In a response to questions from the NRC Staff, NSP provided justification in Reference 33 for the adequacy of the hydrostatic testing performed on the TN-40 casks during fabrication. In a Safety Assessment dated May 11, 1995 (Reference 31), the NRC concluded that the hydrostatic testing performed on the TN-40 casks was adequate and that TN-40 casks need to be tested with a 25 psig hydrostatic pressure on the inner containment vessel only.

3.2.5.3.4 EXTERNAL PRESSURE

There are several conditions which can result in external pressure on the cask. The external pressure due to flood level is less than 7 psi at the bottom of the cask which corresponds to the 14.7 ft. head of water as discussed in Section 3.2.2.

During fuel loading or unloading the cask is at the bottom of the spent fuel pool, nominally 40 ft. deep. This results in an external hydrostatic pressure of approximately 20 psi.

An explosion on a barge in the vicinity of the Prairie Island plant has been shown to produce an overpressure of less than 2.25 psi at the ISFSI location.

SAFETY ANALYSIS REPORT

Revision: 17

Page 3.2-16

An earth pressure loading would occur if the cask were to be buried under dirt. This is similar to a hydrostatic pressure head of water. The density of loose dirt or earth is approximately 100 lb/ft³ compared to 62.4 lb/ft³ for that of water. Therefore 36 ft. of earth is equivalent to a 56 ft. head of water and an external pressure of 25 psi.

The various external pressures are also summarized in Table 3.2-3. The cask is designed and evaluated for an external pressure of 25 psi. This value was selected because it exceeds the maximum external pressure which would be anticipated for any of the loading conditions considered above including floodwater discussed in Section 3.2.2 and snow and ice in Section 3.2.4.

3.2.5.3.5 CASK BODY LOADS

Global distributed loads may be applied to the cask by wind (tornado is upper bound case), flood water and seismic excitation. These loads are explained in detail and calculated in Sections 3.2.1 through 3.2.3. Table 3.2-4 lists the numerical values of these forces as calculated in the various sections. Note that bounding loads equal to the weight of the cask (1g load) in each direction (lateral and vertical) applied as inertial loads for stress analysis purposes envelop all of these distributed loads with a great deal of margin. The local loads due to the tornado missile impact loading are unique. The calculated values from Section 3.2.1 are directly used in the cask analysis since there are no other cases to bound.

3.2.5.4 DESIGN AND SERVICE LOADS

The various cask loading conditions are listed in Table 3.2-5. These loading conditions include those described in 10CFR72, which are categorized as normal, man-made and natural phenomena. The applied loads acting on the different cask components due to these loading conditions have been determined and are discussed in the preceding sections and are listed in Tables 3.2-1 through 3.2-4. This section describes the bases which are used to combine the loads for each cask component. The specific stress criteria against which each load combination will be compared are described in Section 4.2.3.

The bounding pressures and loads described above are used in the load combinations. Certain combinations therefore are conservative evaluations of several events (e.g. one load combination conservatively represents stresses due to tornado wind, hurricane wind, normal wind, flood water, etc.). Several loads are always present and are included in all evaluations. These are the assembly stresses due to bolt preload and metallic seal compression. Lifting loads are always reacted by the cask weight (supported on trunnions - not the storage pad). Lifting loads are not combined with those due to extreme natural phenomena since ISFSI operations would be halted during a flood, hurricane, etc. Dead weight loads are reacted at the bottom of the cask by the storage pad for all cases except the lifting cases.

3.2.5.4.1 CASK BODY

The loading conditions for the cask body including the containment vessel are categorized based on the rules of the ASME Boiler and Pressure Vessel Code Section III, Subsection NB, for a Class 1 nuclear component. The ASME code categorizes component loadings into five service loading conditions. They include Design Conditions (same as the Primary Service) and Levels A, B, C and D Service Loadings. The code also provides different stress limits for each of these service loadings.

For each of these service loading conditions there are several applied loads which are acting on the cask. The Design Loads are listed in Table 3.2-6. They include internal and external pressure; lid bolt preload including the effect of the gasket reactions; distributed loads due to weight, wind, and handling; and attachment loads applied by the trunnion to the cask body.

The inertia g loads are quasistatically applied loads which are multiples of the weight of the cask and/or contents. The magnitude of the Design Loads envelop the maximum Level A Service Loads. Thermal effects are excluded, except for their influence on the preload of the lid bolts (if any) because the ASME Code does not consider these as Design (i.e. primary) Loads.

The Level A Service loads are listed in Table 3.2-7 and are basically the same as the Design Loadings except that the thermal effects on the containment vessel are included. The thermal effects consist of secondary (thermal) stresses caused by differential thermal expansion due to temperature differences caused by decay heat, solar insolation, ambient temperature variations and ambient conditions, e.g. ice, snow, wind, sun.

There are no Level B or C Service Loading Conditions. All loads are categorized as Design, Level A, or Level D loads. See the discussion below describing the bounding analysis where most of the Level D cases are evaluated using Design or Level A limits.

The loads due to Level D Service Loading Conditions, which are extremely unlikely conditions, are listed in Table 3.2-8.

Loading combinations for Design Conditions and Levels A and D Service Loadings which are evaluated are given in Table 3.2-9. The loads are listed across the top of the table and the Load Combinations are designated in the first column of the table. There are three Design Condition Load combinations listed, three Level A combinations and two Level D combinations. The loads which are acting simultaneously for each of these combinations are denoted by an "X" under the load column heading. For example, for Design Condition Load Combination Des (1), internal pressure due to cavity pressurization, fission gas release, distributed weight, wind, water or seismic load, and lid bolt preload are acting simultaneously.

Note that the bounding loads from Table 3.2-4 that envelop several other loads are used in the load combinations. When the superimposed bounding loads represent a Level D case as well as a Level A case (1g lateral load on cask conservatively bounds tornado wind load, flood water load and seismic load), the Level D case is effectively evaluated as a Design Case and the stress results will be later evaluated to Design Condition limits. Therefore, all of the combinations that would be Level D cases, except those including tornado missile loads, have been elevated to Design Conditions. These have also been combined with thermal effects as Level A combinations.

3.2.5.4.2 BASKET

Cask body internal and external pressures have no effect on the basket. External loads applied to the TN-40 cask do not result in basket loads unless the cask actually moves. Therefore, tornado wind and flood water produce no basket loads. Seismic loading, however, is an inertial loading since the cask and ISFSI pad experience both horizontal and vertical accelerations during an earthquake as discussed in Section 3.2.3 above. The seismic acceleration loading (much less than 1g acceleration) does combine with dead weight loading since these two effects occur simultaneously.

Temperature effects due to snow, cold rain, minor fire and even day/night cycles that can cause thermal transients on the outside of the cask body will not cause similar transients in the basket. The high heat capacity of the body slows the temperature response and effectively eliminates transients at the wall of the cask cavity. The steady state temperature and temperature differences throughout the basket are, however, affected by decay heat, solar insolation and ambient temperature variations.

The basket is important to control of criticality of the fuel assemblies stored in the cask. Therefore, since the basket loads described above are low, a conservatively high load level is assumed for the basket evaluation. Note that bounding lateral and vertical inertial loadings of the cask body equal to 1g (in each direction) have been shown to envelop the cask body loadings. For basket evaluation an even more conservative 3g loading is specified in both lateral and vertical directions.

The stresses in the 304 stainless steel portions of the basket due to the primary loading, 3g in any lateral direction combined with 3g vertical (including dead weight), are determined conservatively neglecting the tensile and bending strength of the aluminum thermal conductor plates between fuel compartment boxes. However, the through thickness strength of the aluminum plates which separate the boxes is considered. Thus the aluminum is conservatively neglected in the primary load analysis where it can react some of the load. These primary stresses in the steel are evaluated at the maximum metal temperature occurring under extreme ambient conditions.

The secondary (thermal) stresses in the stainless steel are calculated assuming elastic behavior of the steel but considering the actual strength of the aluminum. The local bearing stresses in the aluminum plates adjacent to the plugs are approximately five times the yield value when calculated elastically. The aluminum would therefore yield and creep resulting in lower thermal stresses in the stainless steel. The primary steel stresses calculated ignoring the aluminum (when it actually can react some of the load) are super-imposed on the secondary stresses calculated assuming the full strength of the aluminum is available to induce thermal stresses in the stainless steel. Therefore the primary plus secondary stresses determined for the 304 stainless steel fuel compartment boxes and their attachments in the basket are conservative. The basket design criteria described in Section 4.2.3.3 is based on Section III of the ASME Code for stress limits and buckling. The basket evaluation is also summarized in that section. The complete basket analysis is provided in Appendix 4B.

3.2.5.4.3 UPPER TRUNNIONS

The upper trunnions are considered to be lifting devices and they are evaluated to the ANSI N14.6 requirements during lifting operations. During lifting, the trunnions are evaluated for vertical lifting reactions applied on the centers of the lifting shoulders required to support 6 times or 10 times the maximum weight of a fully loaded cask. When the load is equal to 6 times the weight, the maximum tensile stresses shall not exceed the minimum yield strength of the trunnion material. For the load equal to 10 times the weight, the maximum tensile stresses shall not exceed the minimum ultimate tensile strength of the trunnion material.

In addition to the trunnions themselves, the welds that attach the trunnions to the cask body gamma shielding and the local region of the gamma shielding are analyzed under the same 6W and 10W reactions. The stresses in the welds and shielding shall not exceed the minimum yield strength of these components under the 6W loading nor the minimum ultimate strength under the 10W loading.

The loads acting on the trunnions are given in Table 3.2-2. The structural analysis of the trunnions is presented in Appendix 4A. A summary of the results and comparison with the design criteria are given in Section 4.2.3.

In a response to questions from the NRC Staff, NSP provided justification in Reference 30 for the adequacy of the load testing performed on the TN-40 cask trunnions during fabrication. In a Safety Evaluation dated May 11, 1995 (Reference 31) the NRC concluded that NSP had demonstrated that the trunnion-to-cask attachment welds have an acceptable level of quality and that load testing of the trunnions as described in Reference 30 provides an acceptable demonstration of the adequacy of the TN-40 cask trunnions.

3.2.5.4.4 OUTER SHELL

The outer shell is evaluated for the combined effects of inertia g loads due to lifting and internal pressure.

Outgassing from the resin between the cask body and outer shell may cause a slight pressure on the inside of the outer shell. A pressure relief valve is provided in the outer shell to assure any pressure build-up is small. The design is based on several years of neutron shield operating experience with this type of resin. The outer shell is completely supported by the resin when subjected to an external pressure. An internal pressure of 3 psi will occur due to the reduced external pressure during a tornado. However, since the cask body is designed for an external pressure of 25 psi, an internal pressure of 25 psi is conservatively used to evaluate the outer shell.

The structural analysis of the outer shell is presented in Appendix 4A. A summary of results and comparison with design criteria are given in Section 4.2.3.

The combined stress due to the inertia g loads and pressure is less than the minimum yield strength of the outer shell material.

3.3 SAFETY PROTECTION SYSTEMS

3.3.1 GENERAL

The TN-40 dry storage cask is designed to provide storage of spent fuel. The cask cavity pressure is always above ambient during the storage period as a precaution against the in-leakage of air which might be harmful to the fuel. Since the containment vessel consists of a steel cylinder with an integrally-welded bottom closure, the cavity gas can escape only through the lid closure system. In order to ensure cask leak tightness, two systems are employed. A double barrier system for all potential lid leakage paths consisting of covers with multiple seals is utilized. Additionally, pressurization of monitored seal interspaces provides a continuous positive inward and outward pressure gradient which guards against a release of the cavity gas to the environment and the admission of air to the cavity.

01505901

3.3.2 PROTECTION BY MULTIPLE CONFINEMENT BARRIERS AND SYSTEMS

3.3.2.1 CONFINEMENT BARRIERS AND SYSTEMS

A combined cover-seal pressure monitoring system (Figure 3.3-1) always meets or exceeds the requirement of a double barrier closure which guarantees tight, permanent containment. There are two lid penetrations, one for a drain pipe and one for venting and pressurization. When the cask is placed in storage, a pressure greater than that of the cavity is set up in the gaps (interspaces) between the double metallic seals of the lid and the lid penetrations. A decrease in the pressure of the monitoring system would be signalled by a pressure transmitter mounted at the side of the cask (Figure 3.3-1). The system is pressurized through a fill valve mounted near the overpressure tank. Lead shielding will be provided to reduce radiation exposure to the transmitter to acceptable levels.

Connections to the overpressure tank are welded fittings. A quick connect coupling with a diaphragm valve is used to fill the tank.

The Helicoflex metallic face seals of the lid and lid penetrations possess long-term stability and have high corrosion resistance over the entire storage period. These high performance seals are comprised of two metal linings formed around a helically-wound spring. The sealing principle is based on plastically deforming the seal's outer lining. Permanent contact of the lining against the sealing surface is ensured by the outward force exerted by the helically-wound spring. Additionally, all metallic seal seating areas are stainless steel overlay for improved surface control. The overlay technique has been used for Transnuclear's transport casks.

SAFETY ANALYSIS REPORT

Revision: 17

Page 3.3-2

For protection against the environment, a toruspherical protective cover equipped with an elastomer seal is provided above the lid. The lid and cover seals described above are contained in grooves. A high level of sealing over the storage period is assured by utilizing seals in a deformation-controlled design. The deformation of the seals is constant since bolt loads assure that the mating surfaces remain in contact. The seal deformation is set by its original diameter and the depth of the groove.

Metal gasket face seal fittings, diaphragm valves and Helicoflex metallic seals are all capable of limiting leak rates to less than 1×10^{-7} atm-cc/sec of helium.

The cask cavity's maximum operating pressure is 2.2 atm. This pressure assures a storage pressure of 1 atm with a minimum ambient temperature of -40°F . The maximum operating pressure of 2.2 atm corresponds to the maximum decay heat load of 0.675 kw per assembly, insolation, a 100°F ambient temperature and the storage of the casks in a 2 x 12 array.

During normal storage, cavity pressure variations due to changing ambient conditions will be small. However, fuel clad failure could result in an increase in cavity pressure due to free gas release of the fuel rods. Based on data from Reference 9, the Exxon assembly contains the most free gas, with 9.04 m^3 at standard temperature and pressure (40 assemblies). The TN-40 cask has a cavity free volume of 6.35 m^3 . A 10% release of fission gas would cause an increase in cavity pressure of about 3.8 psi at an average cavity gas temperature of 439°F (Table 3.3-1).

The pressure assuming a 100% fuel failure and the off-normal cavity gas temperature is calculated to be 4.76 atm (70.0 psia).

The initial operating pressure of the monitoring system's overpressure tank is set at 5.5 atm minimum. Over the storage period, the pressure decreases as a result of leakage from the system and as a result of temperature reduction of the gas in the system. Since the level of permeation through the containment vessel is negligible and leakage past the higher pressure of the monitoring system is physically impossible, a decrease in cavity pressure during the storage period occurs only as a result of a reduction in the cavity gas temperature with time. As long as the pressure in the monitoring system is greater than that of the cavity and ambient pressure, no in-leakage of air nor out-leakage of cavity gas is possible.

The calculations which follow define the monitoring system helium test leakage rate which ensures that no cavity gas can be released to the environment nor air admitted to the casks for a 25 year period. If needed during or after the 25 years period, the monitoring system is capable of being repressurized. All seals are considered collectively in the analysis as the monitoring system pressure boundary.

SAFETY ANALYSIS REPORT

Revision: 17

Page 3.3-3

The instantaneous leakage (L) from the monitoring system is equal to the leakage rate L_x during an infinitely small time period dt and L is also equal to the system volume V times the change in system pressure dp .

$$L = Vdp/dt$$

$$dt = \frac{-Vdp}{L} \quad (1)$$

The leakage can either be choked or unchoked flow. From ANSI N14.5 (Reference 10), choked flow can be assumed if the ratio $P_d/P_u \leq r_c$.

where:

P_d = downstream pressure

P_u = upstream pressure

r_c = maximum ratio of P_d/P_u to permit choked gas flow

For helium, $r_c = 0.485$. It is conservatively assumed for this evaluation that P_d is always 1.0 atm; therefore, choked flow will occur if the pressure in the monitoring system is greater than 2.05 atm.

From Reference 10, for choked flow:

$$L_r = L \sqrt{\frac{0.583}{k+1} \frac{M}{29} \frac{298}{T} \frac{1}{P_u} \left(\frac{2}{k+1} \right)^{\frac{k}{k+1}} \left(\frac{1}{k-1} \right)}$$

For He, $k=1.66$ and $M=4$. Substituting and rearranging equation (1) becomes:

$$dt = \frac{-0.977V \sqrt{38.399/T}}{L_r} \frac{dP_u}{P_u}$$

After integration:

$$P = P_0 \exp \left\{ - \frac{t L_r}{0.977V \sqrt{38.399/T}} \right\} \quad (2)$$

where:

P_0 = pressure at time t_0

L_r = test leak rate (atm-cc/sec)

V = monitoring system volume (14,750 cc)

T = monitoring system gas temperature ($^{\circ}\text{K}$)

t = time (sec)

For unchoked flow, the simplified equation in Reference 10, example 21 can be used:

$$L_r = L \frac{\mu}{0.185} \frac{0.99}{P_u - P_d}$$

Substituting into equation (1) and integrating:

$$P = (P_0 - 1) \exp - \{ t L_r / (53.51 V \mu) \} + 1 \quad (3)$$

where: μ = viscosity (cp)

The integration of these equations accounts for the change in the monitoring system leakage rate which occurs during the storage period because of the change in the monitoring system pressure. Although the cask cavity pressure is initially 2.2 atm and remains above ambient during the storage period, it is conservatively assumed in this analysis that both the inner and outer seals of the monitoring system are subject to a constant 1.0 atm downstream pressure.

Since these equations only account for the monitoring system pressure loss due to leakage, a correction of pressure based on a decrease in system gas temperature was employed at the end of each three month time step at which the relation was evaluated.

In order to ensure that the monitoring system pressure is simultaneously greater than the ambient and the cavity gas pressures, both the monitoring system gas and the cavity gas temperatures were established as a function of time. The cavity gas and the monitoring system gas temperatures were calculated for both the beginning and end of storage conditions and they were assumed to decrease linearly during the storage period. The end of storage condition for this calculation was conservatively assumed to be 0.43 kw/assembly and an ambient temperature of 100°F. It was determined that the cavity pressure would decrease from an initial value of 2.2 atm to 1.93 atm during the first 20 years of storage due to an average gas temperature reduction. The viscosity of the monitoring system gas was also corrected for temperature change for each successive time increment evaluated.

Equations 2 and 3 were used to calculate the monitoring system pressure as a function of time. A time step of three months was utilized. Choked flow conditions (Equation 2) was used until the calculated pressure decreased below 2.05 atm. Equation 3 was then used to calculate the pressure.

The determination of the maximum allowable test leakage rate is graphically depicted in Figure 3.3-2. According to this figure, the cavity pressure of 1.93 atm after twenty years is equivalent to the monitoring system pressure after twenty years when the helium test leakage rate is 1.0×10^{-5} atm-cc/sec. In Figure 3.3-3, the change in both the monitoring system gas and the cavity gas pressures are shown as a function of time for various test leak rates.

3.3.2.2 HEAT TRANSFER DESIGN

The TN-40 packaging is designed to passively reject decay heat under normal conditions of storage and hypothetical accident conditions while maintaining appropriate packaging temperatures and pressures within specified limits. An evaluation of the TN-40 thermal performance is presented in this section. Objectives of the thermal analyses performed for this evaluation include:

- Determination of maximum and minimum temperatures with respect to material limits.
- Determination of temperature distributions for analysis of thermal stresses.
- Determination of temperatures for containment pressurization.

Section 3.4 and Table 3.4-1 present the principal design bases for the TN-40 packaging.

A significant thermal design feature of the TN-40 is the basket described in Section 1.3. The basket consists of an assembly of 40 stainless steel fuel compartments with aluminum and boral plates sandwiched between them. The compartments are plug-welded together to form the basket. Aluminum plates are strategically welded to the basket periphery to enhance conduction heat transfer to the cavity wall. The design of the basket allows the heat from the fuel assemblies to be conducted along the plates to the periphery of the basket and dissipated to the cavity wall.

Another design feature is the conduction path created by the aluminum boxes in the neutron shielding layer described in Section 1.3. The neutron shielding is provided by a resin compound cast into long slender aluminum containers placed around the cask shell and enclosed within a smooth outer shell. By butting against the adjacent shell surfaces, the aluminum containers allow decay heat to be conducted across the neutron shield.

The TN-40 dry storage cask falls under the jurisdiction of 10CFR72 when used as a component of an ISFSI. To establish the heat removal capability, several thermal design criteria are established for the TN-40 cask. These are:

- Containment of radioactive material and gases is a major design requirement. Seal temperatures must be maintained within specified limits to satisfy the leak tight containment function during normal and accident conditions. A maximum temperature limit of 570°F (299°C) is set for the Helicoflex seals (double metallic O-rings) in the containment vessel closure lid.
- To maintain the stability of the neutron shield resin during normal storage conditions, a maximum temperature limit of 300°F (149°C) is set for the neutron shield.
- Maximum temperatures of the containment structural components must not adversely affect the containment function.
- Maintaining fuel cladding integrity during storage is another design consideration. To minimize creep deformation that can occur over the storage duration, the maximum initial storage fuel cladding temperature is determined as a function of the initial fuel age using the guidelines provided by the Commercial Spent Fuel Management Program (CSFM) (Reference 11). These temperature limits are reported in Section 3.3.7.1.

In general, all the thermal criteria are associated with maximum temperature limits and not minimum temperatures. All materials can be subjected to the minimum environment temperature of -40°F (-40°C) without adverse effects.

The TN-40 cask is analyzed based on a maximum heat load of 27 kw from 40 fuel assemblies. The thermal evaluation concludes that with this heat load all design criteria are satisfied for normal conditions. A summary of the results from the analyses performed for normal conditions is provided in Table 3.3-1.

Table 3.3-2 lists the thermal properties of materials used in the thermal analyses. The values are listed as given in the corresponding references. The analyses use interpolated values when appropriate for intermediate temperatures where the temperature dependency of a specific parameter is deemed significant. The interpolation assumes a linear relationship between the reported values.

Thermal radiation effects at the external surface of the packaging are considered. The external surfaces of the TN-40 cask are painted white (emissivity = 0.95, solar absorptivity = 0.18) (Reference 12). To account for dust and dirt, an emissivity of 0.9 and a solar absorptivity of 0.3 are used for exterior surfaces in the thermal models.

Normal ambient conditions of storage are site specific and are discussed in Section 2.3. The short term (OFF-NORMAL) environmental conditions are used for the calculation of maximum TN-40 component temperatures, containment pressure and thermal stresses. These steady state conditions correspond to the maximum daily averaged conditions, and are an ambient temperature of 100°F and a solar heat load of 135 Btu/hr-ft². The cladding temperatures, for the fuel cladding integrity evaluation, are based on long term (NORMAL) environmental conditions. These are a yearly averaged maximum ambient temperature of 50°F and a solar heat load of 108 Btu/hr-ft². The analyses include the effect of storing the TN-40 in an array that is 2 wide and infinitely long.

3.3.2.2.1 THERMAL MODEL

A three-dimensional finite element computer model of the TN-40 cask is used to simulate heat transfer in the packaging. The ANSYS computer program (Reference 13) is utilized for the analyses. This program is a large scale, general purpose finite element computer code which can perform steady state and transient three-dimensional thermal analyses.

The thermal model represents the TN-40 cask standing vertically on the concrete pad. The model includes the geometry and material properties (Table 3.3-2) of the basket, the cask shells, the neutron shield (resin in aluminum containers), the outer shell and the concrete pad. A quarter slice of the TN-40 cask is modeled with the appropriate symmetry boundary conditions. Figures 3.3-4 and 3.3-5 show sketches of radial and axial cross sections through the model.

The basket is composed of 40 stainless steel boxes (8.05 x 8.05 x 160 in.) with two 0.25 in. thick aluminum and one 0.075 in. thick boral plates placed between adjacent boxes. The boxes are held together by welded plugs which pass through the aluminum and boral plates. The plug welding design causes the aluminum and boral plates to be tightly sandwiched between adjacent box sides. The basket portion of the thermal model simulates the conduction paths provided by the aluminum plates. No credit is taken for the heat transfer paths provided by the stainless steel boxes and the boral plates. The heat flux from the fuel assemblies is applied directly to the aluminum plates. As shown in Figure 3.3-4, some aluminum plates are interrupted to allow other plates a direct conduction path to the basket periphery. As a conservative modeling approach, a 0.02 in. gap is used between the interrupted and continuous plates. This causes heat to be transferred across a gaseous medium (helium) between the two plates rather than along the more conductive stainless steel boxes sandwiching the gap, and provides conservative basket and cladding temperature results for all as-built gap sizes in the TN-40 casks.

SAFETY ANALYSIS REPORT

Revision: 17

Page 3.3-8

Aluminum plates (0.38 in. thick)⁽¹⁾ are welded to the basket periphery to increase the surface area for heat dissipating while providing structural support for the basket. These peripheral plates are sized and formed to contact the cavity surface at thermal equilibrium. However, the thermal model assumes a nominal gap of 0.06 in. between these plates and the cavity surface. The aluminum rails bolted to the cavity wall are sized so that heat is conducted from the basket periphery across a 0.06 in. gap. These gaps are shown in Figure 3.3-4. The peripheral aluminum plates may be interrupted axially to allow for dimensional adjustment at fabrication or assembly. To factor in the loss of axial conduction along these plates, the thermal conductivity in the axial direction is assigned a value of zero. No heat can be dissipated from the basket to the cavity without passing across a gaseous gap (helium) by conduction. Other modes of heat transfer are conservatively neglected.

The plug holes in the aluminum basket plates reduce their thermal conductivity. To evaluate the effect of the holes, simple two-dimensional finite element models of the plates with and without holes were developed. It was concluded that for the same temperature difference across symmetry boundaries, the conductivity for the basket plates are effectively reduced 9.3% with plug holes. Accordingly, the thermal conductivity for the basket plates are reduced 10% in the thermal model.

The ANSYS three-dimensional isoparametric thermal shell element, STIF 57, is used to simulate heat transfer along the aluminum plates and across helium gaps. At the periphery, the three-dimensional isoparametric solid element, STIF 70, is used for gaseous conduction across gaps between the basket and the cavity wall

The cask body portion of the model consists of the cask bottom, the inner containment and outer gamma shield cask body shells, the neutron shield (resin in aluminum containers) and the outer shell. The model of the cask body extends 173.25 in. from the bottom. The cask components above and including the lid are not modeled and assumed to provide an adiabatic boundary. Figures 3.3-4 and 3.3-5 show the cask components in the thermal model.

The inner and outer cask body shells will be assembled with an interference fit. This will assure thermal contact at the shell interface. A contact conductance of 350 Btu/hr-ft² is used based on the data provided in Reference 14 for interface resistance between steel surfaces in contact (air gaps). In the bottom region of the cask, the two cask bottom plates are assumed to be separated by a 0.125 in. air gap. The cask bottom is also modeled with no thermal contact with the basket bottom.

The neutron shield consists of 60 long slender resin-filled aluminum containers placed between the cask body and outer steel shell. The aluminum containers butt against the shells. However, an air gap of 0.01 in. is used in the model.

⁽¹⁾ May be ground to less than 0.38 inch locally to fit-up in cask body. See Note 4 on Figure 1.3-7.

The concrete pad in the thermal model is 36 in. thick and extends 36 in. around the bottom of the cask. The bottom of the cask is assumed to be in perfect thermal contact with the concrete pad. The bottom of the pad, which is in contact with soil, is treated as a constant temperature boundary. For the off-normal ambient conditions, a soil temperature of 70°F is used. A soil temperature of 50°F is used for the yearly averaged normal ambient conditions.

The finite element model for the stainless steel shells, the resin, the air gaps and the concrete pad, are developed using STIF 70 elements. The aluminum containers for the resin are generated using STIF 57 elements.

Figure 3.3-6 shows the three-dimensional ANSYS finite element model developed.

Solar Heat Load

The maximum solar heat load is applied as a constant value to all external surfaces of the thermal model, without taking any credit for the night period when there is no insolation. A solar absorptivity of 0.3 is used for the painted surfaces of the cask and 0.9 for the concrete pad.

Decay Heat Load

The fuel assemblies are not included in the thermal model. Instead, an axially varying heat flux corresponding to decay heat load of 0.675 kw per assembly is applied to the basket surfaces forming the fuel compartments. The heat flux profile for a typical PWR fuel assembly with a peak power factor of 1.2 and an active length of 144 in. is used. Figure 3.3-7 shows the axial power profile assumed for the analyses.

Heat Dissipation to the Environment

Most of the heat from the TN-40 packaging is dissipated to the environment by radiation and natural convection. If the packaging is stored in an array, partial radiation "blockage" occurs which reduces the overall view factor from the packaging to the environment. The analyses assume that the packaging's will be stored in an array that is two wide and infinitely long and placed at least 18 ft. (center to center) apart (Figure 3.3-8). Convection heat transfer is assumed to be unaffected. Heat transfer between packaging's is neglected. An emissivity of 0.9 is used for all external surfaces.

SAFETY ANALYSIS REPORT

Revision: 17

Page 3.3-10

To simplify the packaging environment view factor calculation, the TN-40 cask is assumed to be a cylinder of 8.4 ft. diameter and 12.7 ft. length. This represents the surface dimensions for the neutron shell. Based on its location in a two wide and infinitely long array, it is possible for 42.9% of the neutron shell surface area to be surrounded by other packaging's. Radiation heat transfer for this "blocked" region can be approximated as that between two concentric cylinders with the inner radius corresponding to the cask diameter and the outer radius corresponding to the array spacing of 18 feet. The equation for the view factor F_{2-1} is obtained from Reference 15 for two concentric cylinders of finite length and is:

$$\begin{aligned} F_{2-1} = & (1/R) - [1/(\pi R)] \cos^{-1} (B/A) \\ & + [1/(2 \pi RL)] ([(A+2)^2 - (2R)^2]^{1/2} \cos^{-1} (B/RA)) \\ & - [B/(2 \pi RL)] [\sin^{-1} (1/R)] + [A/(4RL)] \end{aligned}$$

where,

$$A = L^2 + R^2 - 1$$

$$B = L^2 - R^2 + 1$$

$$L = h/r_1$$

$$R = r_2/r_1$$

$$r_1 = \text{radius of inner cylinder}$$

$$r_2 = \text{radius of outer cylinder}$$

$$h = \text{height of cylinders}$$

From the reciprocity theorem,

$$F_{1-2} = F_{2-1}(r_2/r_1)$$

The view factor from the outer surface to the environment,

$$F_{1-amb} = 1 - F_{1-2}$$

Based on an array spacing of 18 ft. and a packaging diameter of 8.4 ft., an overall view factor of 0.8138 is calculated between the packaging and the ambient.

The heat transfer coefficient, H_r , for heat dissipation by radiation, is given by the equation

$$H_r = (0.1714E-8)(G_{12})(T_s+460)^4 - (T_a+460)^4 / (T_s - T_a) \\ (Btu/hr-ft^2 - ^\circ F)$$

where,

G_{12} = the gray body exchange coefficient

= (surface emissivity) (view factor)

For the horizontal surfaces,

$$G_{12} = (0.9)(1) = 0.9$$

For the vertical blocked surfaces,

$$G_{12} = (0.9) (0.8138) = 0.7324$$

T_a = ambient temperature, $^\circ F$

T_s = surface temperature, $^\circ F$

Heat dissipation by natural convection from vertical surfaces is described by the following equation (Reference 12).

$$Nu_L = 0.13(GR_L Pr)^{1/3} \text{ for } GR_L > 10^9$$

where,

Nu_L = Average Nusselt number

Gr_L = Grashof number

Pr = Prandtl number

Simplifying in terms of H_c , the natural convection coefficient,

$$H_c = 0.13(k) [(T_s - T_a)(Pr)(\rho^2 g \beta / \mu^2)]^{1/3} \\ (Btu/hr-ft^2 - ^\circ F)$$

where,

ρ = density, lb/ft³

g = acceleration due to gravity, ft/sec²

β = temperature coefficient of volume expansion, 1/R

μ = absolute viscosity, lb/ft-sec

k = conductivity, btu/hr/ft.

For horizontal surfaces,

$$Nu_L = 0.16 (GR_L Pr)^{1/3} \quad \text{(Reference 12)}$$

and

$$H_c = 0.16(k) [(T_s - T_a)(Pr)(\rho^2 g \beta / \mu^2)]^{1/3}$$

The total heat transfer coefficient $H_t = H_r + H_c$, is applied as a boundary condition on the outer surfaces of the finite element model.

Maximum Fuel Cladding Temperature

The finite element model does not include the fuel assemblies. Instead, the maximum fuel cladding temperature is evaluated after obtaining a steady state temperature distribution using the finite element model. For conservatism, the average temperature of the hottest fuel compartment is assumed to be the maximum basket temperature.

The Wooton-Epstein equation (Reference 16) is used to calculate the maximum fuel cladding temperature. This is a semi-empirical, semi-theoretical correlation which accounts for natural convection (in air) and radiation cooling of a spent fuel assembly in a horizontal cask. The TN-40 cask is stored vertically and is back-filled with helium. Based on experimental studies performed on the TN-24P (Reference 17), lower fuel cladding temperatures were reported for a helium (vertical cask) instead of a nitrogen (horizontal cask) back-fill gas medium. Hence it is conservative to use the Wooton-Epstein correlation for the fuel cladding temperature calculation. The correlation is:

$$q = 4WL_a \left[sC_1(I/E_r + I/E_w - I)(T_r^4 - T_w^4) + C_2(T_r - T_w)^{4/3} \right]$$

Note: A modified Wooton-Epstein correlation was used to evaluate the reduced thickness of the aluminum periphery plates. (See footnote on page 3.3-8 and Note 4 on Figure 1.3-7.)

where,

q = heat dissipation from the fuel assembly, Btu/hr

W = width of the fuel assembly, ft

L_a = active length of fuel assembly, ft

s = Stefan-Boltzmann constant ($0.171E-8$ Btu/hr-ft² - °R⁴)

C_1 = $4/(N+2)$ (geometric constant)

E_r = emissivity of fuel cladding

E_w = emissivity of compartment walls

N = number of fuel rods per side

C_2 = 0.118 (an experimentally determined constant)

T_r = maximum fuel cladding temperature, °R

T_w = maximum basket temperature, °R

A Westinghouse 14x14 OFA, 3.85 w/o fuel assembly is selected as the basis assembly. An axial power peak factor of 1.2 was assumed in the heat load calculation. For a Westinghouse 14x14 assembly,

$$W = 0.647 \text{ ft}$$

$$L_a = 12 \text{ ft}$$

$$C_1 = 0.25$$

$$E_r = 0.8 \text{ (from Reference 17)}$$

$$E_w = 0.15 \text{ (fuel compartment emissivity)}$$

$$q = (0.675 \text{ kw}) \times 1.2 \times (3413 \text{ Btu/hr-kw}) = 2764.5 \text{ Btu/hr}$$

Average Cavity Gas Temperature

The cavity gas temperature is maximum at the hottest fuel cladding and minimum at the cooler surfaces in the lid region. For simplicity and conservatism, it is assumed that the average cavity gas temperature is the average value of the maximum fuel cladding and the lid region temperatures.

3.3.2.2.2 RESULTS OF THE THERMAL ANALYSES**Short-Term OFF-NORMAL Storage Conditions**

A steady state thermal analysis is performed using the maximum decay heat load of 0.675 kw per assembly (27 kw total), 100°F ambient temperature and an insolation of 135 Btu/hr-ft². Figure 3.3-9 shows the temperature distribution predicted by the finite element model. The specific temperature distributions in the hottest cross section of the model, the hottest cross section of the basket, the top 5 in. of the basket, and the cask body are shown in Figures 3.3-10, -11, -12 and -13 respectively. The maximum fuel cladding and average cavity gas temperatures are calculated using the appropriate steady state component temperatures. A summary of the calculated packaging temperatures are listed in Table 3.3-1.

Long-Term NORMAL Storage Conditions

The NORMAL thermal analysis assumes a maximum decay heat of 0.675 kw per assembly, 50°F ambient temperature and a solar heat load of 108 Btu/hr-ft².

The steady state temperature distribution in the finite element model is shown in Figure 3.3-14. This is used to calculate the maximum fuel cladding and the average cavity gas temperature. Table 3.3-1 contains a summary of the calculated packaging temperatures.

Evaluation of Packaging Performance

The thermal analysis for normal storage concludes that the TN-40 cask design meets all applicable requirements. The maximum temperatures calculated using conservative assumptions are low. The maximum temperature of any containment structural component is less than 303°F (151°C) which has an insignificant effect on the mechanical properties of the containment materials used. The maximum seal temperature (242°F, 117°C) during normal storage is well below the 570°F long term limit specified for continued seal function. The maximum neutron shield temperature is below 300°F (149°C) and no degradation of the neutron shielding is expected through the period of extended operations. The long-term maximum fuel cladding temperature is 602°F (317°C) and within allowable fuel temperature limits (Section 3.3.7.1). The minimum temperature of -40°F (-40°C) is also inconsequential to the packaging function.

Buried Cask Thermal Evaluation

The TN-40 cask dissipates heat to the environment by radiation and natural convection. If the packaging is accidentally buried in medium that will not provide the equivalent cooling of natural convection and unrestricted radiation to the environment, component temperatures will increase to a higher steady state condition after long-term burial. Of interest is the containment integrity which is assured as long as the metallic seals remain below 570° and the cavity pressure is less than 100 psig.

The temperature response of the TN-40 cask is evaluated using a cross-sectional slice of the finite element model developed for the normal storage analysis. For this analysis, the packaging is assumed to be completely buried in dry soil with such poor heat transfer characteristics that it effectively insulates the packaging. This conservative assumption eliminates any communication between the cask and a final heat sink. The resulting analysis therefore determines the time required to reach limiting temperatures for the containment integrity.

Initial conditions before burial are established by using steady state temperatures in the hottest cross section (Figure 3.3-10). The transient analysis is performed with a packaging heat load of 27 kw.

The results of the analysis show that if the packaging is not uncovered within 5 hours, the resin will start outgassing as its temperature exceeds 300°F (149°C). Thereafter, packaging component temperatures will increase by about 5°F (2.7°C) per hour. The cask body temperatures will reach 570°F about 60 hours after burial. At this time all temperatures in the packaging will be about 260°F (144°C) higher than those for initial conditions. The cavity pressure, if all fuel fails, will not exceed 100 psig. Thermal gradients in the packaging are small and less than those during normal storage. Figure 3.3-15 shows the maximum temperature/time history for the outer surface, neutron shielding, cavity wall and basket.

The ISFSI operating and emergency procedures will consider these time frames in planning for recovery from an accidental cask burial.

Hypothetical Fire Accident Thermal Evaluation

The hypothetical fire accident for the TN-40 cask is based on a fuel fire, the source of fuel being that from a ruptured fuel tank of the cask transporter tow vehicle. The bounding capacity of the fuel tank is 200 gallons and the bounding hypothetical fire is an engulfing fire around the cask.

SAFETY ANALYSIS REPORT

Revision: 17

Page 3.3-16

From IAEA requirements (Reference 28), the "pool" of fuel is assumed to extend 1 meter beyond the cask surface. Based on an outer shell diameter of 101 inches, this gives a "pool" diameter of approximately 180 inches and a pool surface of 25,400 in². A fuel consumption rate of 0.15 in/min. was selected from a Sandia Report (Reference 29) concerning gasoline/tractor kerosene experimental burning rates. This translates into a fuel consumption rate of approximately 16.5 gal./min. Therefore, the 200 gallons of fuel will sustain a fire for about 12 minutes and hence a 15 minute fire is evaluated. The Sandia Report also reports an average flame temperature of 1550°F and an average convective heat transfer coefficient of 4.5 Btu/hr-ft²-°F for a railroad tank car fire test. The same parameters are utilized for the fire accident evaluation.

The fire thermal evaluation is performed primarily to demonstrate the containment integrity of the TN-40. This is assured as long as the metallic lid seals remain below 570°F and the cavity pressure is less than 100 psig. Two models, a cross section model and a lid seal model, are used for the evaluation.

A. Cross Section Model

The cross section finite element model utilized for the buried cask thermal evaluation is reused here. The cask components and their geometry are shown in Figure 3.3-4. Initial temperatures before the fire condition are established by using steady state temperatures in the hottest cross-section (Figure 3.3-10) for short term OFF-NORMAL storage conditions. The analysis uses a cask heat load of 27 kw. The effects of insulation are neglected during the transient fire evaluation.

During the fire condition period (15 min.), heat absorption at the outer surface is by radiation and convection, and is given by the following equation:

$$q_{fire} = (H_c + H_r)(T_f - T_s)$$

where:

$$q_{fire} = \text{heat flux into packaging from fire, Btu/hr-ft}^2$$

$$T_f = \text{flame temperature} = 1550 \text{ } ^\circ\text{F}$$

$$T_s = \text{surface temperature of the packaging, } ^\circ\text{F}$$

$$H_c = \text{convection heat transfer coefficient} = 4.5 \text{ Btu/hr-ft}^2 \text{ } ^\circ\text{F}$$

$$H_r = \text{radiation heat transfer coefficient, Btu/hr-ft}^2 \text{ } ^\circ\text{F}$$

$$H_r = (0.1714\text{E-}8)(F_s)[(E)(T_f + 460)^4 - (T_s + 460)^4]/(T_f - T_s)$$

where:

$$F_s = \text{outer surface absorptivity} = 0.8 \text{ (Ref. 28)}$$

$$E = \text{flame emissivity} = 0.9 \text{ (Ref. 28)}$$

During the cooldown period after the fire condition, heat dissipation from the outer surface is by radiation and natural convection to an ambient temperature of 100°F (as in the short-term OFF-NORMAL conditions).

The results of the analysis show that no melting of the metallic cask components occurs. The peak transient temperatures in selected locations in the cask are listed in Table 3.3-8. The transient temperatures in the cask cavity increase by no more than 52°F (29°C) and the corresponding peak cavity pressure assuming 100% fuel failure is 74 psia.

B. Lid-Seal Region Model

To demonstrate the integrity of the seals in the lid during the fire accident, a finite element model of the top portion of the TN-40 is developed. The model is an axisymmetric two-dimensional model and includes the geometry and material properties of the lid, resin disk, protective cover and upper region of the cask body shells. Figure 3.3-20 shows the geometry of the model. Figure 3.3-21 is an element plot of the 2-D axisymmetric ANSYS model. Elements representing the same material have the same color.

The outer surfaces of the protective cover and the cask body are subjected to the heat flux from the 15 minute fire, and during the cooldown period, heat is dissipated from these surfaces to an ambient temperature of 100°F. Most of the heat transfer in the enclosure under the protective cover is by radiation in the fire condition. Hence, heat transfer in this enclosure is modeled by radiation with all surfaces being assigned an emissivity of 0.9. Near the seal region where the air gap between the lid and protective cover is small, heat conduction through air is assumed. The region where heat conduction through air is assumed is indicated in Figure 3.3-21. No other heat conduction through air is assumed under the protective cover. The initial temperature before the fire condition is 242°F, the short term OFF-NORMAL storage temperature for the lid region. The effects of insolation are neglected during the transient fire evaluation.

The results of the computer analysis show that no melting of the metallic components in the lid region occur. The maximum lid seal temperature peaks at 340°F (171°C).

C. Conclusion

Based on the thermal analyses for the fire accident conditions, the TN-40 packaging will withstand the hypothetical fire accident event without compromising the containment integrity of the TN-40. Peak seal temperature remains well below 570°F and the cavity pressure below 100 psig.

The maximum basket temperature peaks at 568°F (a 38°F increase). The transient maximum fuel temperature will increase no more than 38°F from 642°F (assumed initial short term OFF-NORMAL storage temperature) to 680°F (360°C). This transient temperature is well below the maximum operating fuel temperature in the reactor of 700°F (371°C).

The neutron shield will off-gas during the hypothetical accident. A pressure relief valve is provided on the outer shell to prevent the pressurization of the outer shell. Shielding analyses have been performed showing acceptable consequences even if all the resin disappears.

3.3.3 PROTECTION BY EQUIPMENT AND INSTRUMENTATION SELECTION

3.3.3.1 EQUIPMENT

Design criteria for the casks are described in Section 3.4 and summarized in Table 3.4-1.

3.3.3.2 INSTRUMENTATION

Due to the totally passive and inherently safe nature of the storage, safety-related instrumentation is not necessary. Instrumentation to monitor cask pressure is furnished. Appropriate capabilities to check and recalibrate these monitors is also provided. The pressure monitoring system is further described in Section 3.3.2.1.

3.3.4 NUCLEAR CRITICALITY SAFETY

3.3.4.1 CONTROL METHODS FOR PREVENTION OF CRITICALITY

The design criterion for criticality is that the effective neutron multiplication factor, k_{eff} , including statistical uncertainties, shall be less than 0.95 for all postulated arrangements of fuel within the cask.

The control methods used to prevent criticality are:

1. Incorporation of neutron absorbing material (boron) in the basket material.
2. Loading of the irradiated fuel assemblies in the fuel pool containing at least 1800 ppm boron.
3. prevention of fresh water entering the loaded cask.

The basket has been designed to assure an ample margin of safety against criticality under the conditions of fresh fuel in a cask flooded with borated water. The methods of criticality control are in keeping with the requirements of 10CFR72.124.

Criticality analysis is performed using the KENO-V.A Monte Carlo code (Reference 18) along with data prepared using the NITAWL code (Reference 19) and the SCALE 27-group cross section library. These codes and cross-section library are part of the SCALE system prepared by Oak Ridge National Laboratory for the U.S. Nuclear Regulatory Commission Office of Nuclear Regulatory Research (Reference 20). They are widely used for criticality analysis of shipping casks, fuel storage pools and storage casks. Benchmark problems are run to verify the codes, methodology and cross section library. Examples of computer input used for criticality evaluation are included in Appendix 3A (Proprietary).

In the criticality calculation, fuel assembly, basket, and cask wall geometries are modeled explicitly. Within each assembly, each fuel pin and each guide tube is represented. Materials are not homogenized.

Reactivity analyses (K-Infinite) were performed for the following Prairie Island fuel assemblies: Westinghouse Standard 3.41 w/o U235; Exxon Standard 3.47 w/o U235; Exxon TOPROD 3.82 w/o U235; and Westinghouse OFA 3.80 w/o U235. The calculated K-infinite were 1.3490, 1.3547, 1.3830, and 1.3930, respectively. These results indicate that the Westinghouse OFA type assembly is the most reactive. This assembly therefore was utilized for the criticality calculation at 3.85 w/o U235. The analysis assumes fresh fuel composition with 1,800 ppm borated water in the cavity, and the cask surrounded by a water reflector.

A three-dimensional criticality model is utilized. The plenum and end fitting areas are modeled as fresh water. The poison plates cover only the active fuel length. The 0.38 in. aluminum supports at the basket periphery are modeled as a 0.12 in. shell at the cavity wall. The geometric model for the fuel assembly is shown in Figure 3.3-16 and the cask model in Figure 3.3-17. The material compositions are given in Table 3.3-3.

The result of the calculation with 1800 ppm borated water and 3.85 w/o U235 is $k_{eff}=0.8988+0.0033$. Including the bias determined from benchmark calculations and 2 sigma yields $k_{eff}=0.9162$.

Criticality calculations were made to investigate the reactivity of the cask as the borated water is drained from the cavity. No significant reactivity peaks were found. Table 3.3-4 lists the results (not corrected for bias) of the calculations. A calculation was also performed with each of the assemblies moved to the inside corner of its fuel compartment, toward the cask centerline. The calculated k_{eff} for this configuration was $0.9032+0.0033$ (no bias correction).

To approximate irradiated fuel placed into the cask, a calculation was performed using 1.9 w/o U235 and unborated water in the cask. The result of this calculation is $k_{eff}=0.9306+0.0036$, (uncorrected for bias). Calculations were also performed to evaluate the reactivity effect of low density water in the cask with this model. The results, Table 3.3-5, show that optimum moderation occurs with full density water.

Since the TN-40 cask will only contain water with at least 1,800 ppm boron, (seals are above the maximum hypothetical flood height), and irradiated fuel, criticality safety of the cask is assured.

3.3.4.2 ERROR CONTINGENCY CRITERIA

Provision for error contingency is built into the criterion used in Section 3.3.4.1 above. The criterion, used in conjunction with the KENO-V.A and NITAWL codes, is common practice for licensing submittals. Because conservative assumptions are made in modeling, it is not necessary to introduce additional contingency for error.

3.3.4.3 VERIFICATION ANALYSIS – BENCHMARKING

Five critical experiments by Pacific Northwest Laboratory (PNL) are used to validate the criticality analysis (References 21 and 22). The PNL experiments were designed to simulate conditions associated with both fuel element shipping packages and with fuel storage pools. The experiments selected are associated with critical separation between water flooded subcritical clusters of fuel rods with and without poison plates between clusters. Run A contained boral plates, Run B borated stainless steel plates, Run C SS304L plates, and Run D no poison plates. All four experiments have steel reflecting walls. The fifth experiment (E) contains no poison plates and no reflecting walls.

The NITAWL code is used to perform resonance calculations and to prepare the working library from the SCALIAS 27 group cross section library for input to KENO-V.a.

Fuel rods and dimensions are illustrated in Figure 3.3-18. The experimental geometry is shown in Figure 3.3-19. The poison plates, when present, are positioned at the outer cell boundary of the center fuel cluster. Dimensions are shown in Table 3.3-6. The KENO-V.a geometric representation includes the explicit model of each fuel rod and poison plate.

The results of the calculation are shown in Table 3.3-7. The results show a non-conservative average bias of 1.2%. Thus, the criticality results for the TN-40 are increased by a factor of 1.012.

3.3.5 RADIOLOGICAL PROTECTION

Provisions for radiological protection by confinement barriers and systems are described in Section 3.3.2.1.

3.3.5.1 ACCESS CONTROL

The ISFSI does not require the continuous presence of operators or maintenance personnel. In addition, it is located within a fenced-in area shared only with the Equipment Storage Building and Security Building which will be used for storage of cask handling and security related equipment and will not be continuously manned. Access to the fenced-in area is limited to personnel needed during operations at the ISFSI. Activities will include periodic inspections of these facilities, emplacement of storage casks, and security checks. These activities will be defined and controlled by the Radiation Protection and Security procedures manuals covering the ISFSI.

3.3.5.2 SHIELDING

The storage casks provide sufficient radiation shielding to allow handling of the loaded casks with as low as reasonably achievable (ALARA) doses to the operators and to comply with the radiation limits in 10CFR72. For specific dose estimates, see Section 7.

3.3.5.3 RADIOLOGICAL ALARM SYSTEMS

There are no credible events which could result in releases of radioactive products or unacceptable increases in direct radiation. In addition, the releases postulated as the result of the hypothetical accidents described in Section 8 are of a very small magnitude. Therefore, radiological alarm systems are not necessary. However, as described in Section 3.3.3.1, nonsafety-grade pressure monitors are provided. Procedures to be followed when these alarms are activated will be specified in the ISFSI operating procedures.

3.3.6 FIRE AND EXPLOSION PROTECTION

No hydrocarbon fuel of any sort will be stored in the ISFSI. The quantity of fuel carried in the tow vehicle will be limited so that only a small fire of short duration would be possible. There are no other significant combustible sources within the ISFSI security fence. Due to the large thermal mass of the casks any minor fires in the vicinity of the ISFSI would raise the cask temperature by only a few degrees and are not expected to affect cask integrity.

As indicated in Section 2.2, overpressures of 2.25 psi can be conservatively postulated to occur at the ISFSI as a result of accidents involving explosive materials which are stored or transported near the site. This impact is less than that postulated to result from the tornado wind loading and missile impact analysis, as described in Section 3.2.1, and is well within the design basis of the cask.

3.3.7 MATERIAL HANDLING AND STORAGE

3.3.7.1 SPENT FUEL HANDLING AND STORAGE

The handling of spent fuel within the Prairie Island Nuclear Generating Plant will be conducted in accordance with existing fuel handling procedures. Fuel that may be damaged as defined in Section 10.1.1 will not be considered for storage at the ISFSI.

Handling of the sealed casks outside of the Auxiliary Building in the process of emplacing them at the ISFSI will be done according to procedures that ensure that their safety functions and the power station capability for safe shutdown are not impaired. These operations are described in Section 5.4.

The design criteria for the TN-40 dry storage cask require that the maximum fuel cladding temperature of the hottest fuel rod in the cask shall not exceed the temperature limit calculated according to PNL-6189 (Reference 11). This temperature limit has been calculated as a function of fuel age to account for the effect of fuel age on creep deformation and fuel cladding rupture. As the age of fuel increases, its cooling rate rapidly decreases. If the initial fuel temperature is too high at loading, significant creep deformation can occur as a result of the decreasing cooling rates with fuel age. The Commercial Spent Fuel Management Program (CSFM) used the TN-24P packaging as one of its models for developing generic fuel cladding temperature limit curves for 40 year dry storage. The CSFM generic curves are used to establish the fuel cladding temperature limit for 10-year cooled fuel. The initial temperature limits for the TN-40 design used the CSFM curves developed for 40 year storage. The temperature limits determined based on the calculation below are more restrictive than those specified in ISG-11 Rev. 3 (Reference 37) and are thus conservative for storage during the period of extended operation.

From Reference 11, the midwall hoop-stress is given by the equation,

$$S_{mhoop, T_2} = (PD_{mid}/2t)(a)(T_2/T_1)$$

where

$$S_{mhoop, T_2} = \text{the midwall hoop-stress (psi) at temperature of interest } T_2 \text{ (}^\circ\text{K)}$$

$$P = \text{the internal pressure (psi) at the hot-volume average temperature, } T_1 \text{ (}^\circ\text{K)}$$

$$D_{mid} = \text{the midwall diameter (in.) accounting for cladding corrosion}$$

$$t = \text{the cladding thickness (in.)}$$

$$a = 0.95 \text{ for PWR fuel assemblies}$$

Using fuel data for the Exxon (ANF) and Westinghouse assemblies, it was determined that the Exxon fuel was the most conservative with a fuel rod pressure of 2,110 psia at 603°F (rod diameter=0.417 in., cladding thickness = .0295 in.) with a burnup of 43,000 MWD/MTU.

Substituting values and simplifying,

$$S_{mhoop}, T_2 = 22.3 T_2 \text{ psi/K for Exxon assemblies and}$$

$$S_{mhoop}, T_2 = 14.6 T_2 \text{ psi/K for Westinghouse 14 x 14 OFA lead rod at}$$
$$50,000 \text{ MWD/MTU}$$

For conservatism, the Exxon fuel assembly equation is used to determine the fuel rod temperature limits. The temperature limits are determined graphically by plotting the midwall hoop-stress equation on the CSFM generic limit curves of Reference 11. The acceptable temperature limits obtained are 342°C and 335°C for 10 year and 15 year cooled fuel, respectively.

3.3.7.2 RADIOACTIVE WASTE TREATMENT

The ISFSI will not generate radioactive waste. However, cask loading and decontamination operations, while in the Auxiliary Building, may generate small amounts of waste. This waste is disposed of in accordance with the radioactive waste handling procedures described in Section 6, and is part of the 10CFR50 licensed activities. Waste storage facilities are neither required nor provided for the ISFSI.

3.4 SUMMARY OF STORAGE CASK DESIGN CRITERIA

3.4.1 Cask Design Criteria

The principal design bases for the TN-40 cask are presented in Table 3.4-1. The TN-40 dry storage cask is designed to store 40 intact 14x14 PWR spent fuel assemblies, with a maximum assembly average burnup of 45,000 MWD/MTU and a minimum cooling time of 10 years.

The maximum total heat generation rate of the stored fuel is limited to 27 kw in order to keep the maximum fuel cladding temperature below the limit necessary to ensure cladding integrity. The fuel cladding integrity is assured by the limited fuel cladding temperature and maintenance of a nonoxidizing environment in the cask (Reference 23).

The containment vessel (body and lid) is designed and fabricated to the maximum practicable extent as a Class I component in accordance with the rules of the ASME Boiler and Pressure Vessel Code, Section III, Subsection NB, Articles NB-3200. The cask design, fabrication and testing are covered by a Quality Assurance Program which conforms to the criteria in 10CFR72(G).

The cask is designed to maintain a subcritical configuration during loading, handling, storage and accident conditions. Poison materials in the fuel basket are employed to maintain $k_{\text{eff}} \leq 0.95$ including statistical uncertainties. The TN-40 cask is designed to withstand the effects of severe environmental conditions and natural phenomena such as earthquakes, tornados, lightning, hurricanes and floods. Section 8 describes the cask behavior under these environmental conditions.

3.4.2 Design Basis Limits for Fission Product Barriers (DBLFPBs)

The NRC has defined the design basis limit for a fission product barrier as the controlling numerical value for a parameter established during the license review as presented in the Safety Analysis Report for any parameter(s) used to determine the integrity of the barrier. The list of DBLFPBs for the TN-40 cask is listed in Table 3.4-2.

THIS PAGE IS LEFT INTENTIONALLY BLANK

3.5 REFERENCES

1. Northern States Power Company, Prairie Island Nuclear Generating Plant Updated Safety Analysis Report, Revision 10, Docket 50-282 (Unit 1) and 50-306 (Unit 2).
2. Oak Ridge National Laboratory, ORIGEN2, Isotope Generation and Depletion Code, CCC-371, January 1987.
3. U.S. Nuclear Regulatory Commission, Regulatory Guide 3.54, Spent Fuel Heat Generation in an Independent Spent Fuel Storage Installation, September 1984.
4. American Society of Mechanical Engineers, ASME Boiler And Pressure Vessel Code, Section III, Division 1 - Subsection NB, 1989.
5. T. W. Singell, Wind Forces on Structures: Forces on Enclosed Structures. ASCE Structural Journal, July 1958.
6. Baumeister and Marks, Standard Handbook for Mechanical Engineers, Sixth Edition.
7. U.S. Nuclear Regulatory Commission, Regulatory Guide 1.92, Combining Modal Responses and Spatial Components in Seismic Response Analysis, Revision 1, February 1976.
8. American National Standards Institute, "American National Standard for Special Lifting Devices for Shipping Containers Weighing 10,000 Pounds (4500 kg) or More for Nuclear Materials.", ANSI N14.6, New York.
9. Letter from Northern States Power to Transnuclear, 88Y910-0003. June 4, 1990.
10. American National Standards Institute, "National Standard for Leakage Tests on Packages for Shipment of Radioactive Materials", ANSI N14.5-1977, New York, Oct. 1987.
11. Levy, et.al., "Recommended Temperature Limits for Dry Storage of Spent Light Water Reactor Zircaloy - Clad Fuel Rods in Inert Gas," Pacific Northwest Laboratory, PNL-6189, 1987.
12. Kreith, F. and Bohn, M.S., Principles of Heat Transfer, Fourth Edition, Harper & Row, Publishers, New York, 1986.
13. DeSalvo, G.J., and Swanson J.A., ANSYS Engineering Analysis System, User's Manual for ANSYS Revision 4.3, Swanson Analysis Systems, Inc., Houston, PA, June 1987.

SAFETY ANALYSIS REPORT

Revision: 17

Page 3.5-2

14. Rohsenow, W.M., and Hartnett, J.P., Handbook of Heat Transfer, McGraw-Hill Book Co., New York, 1973.
15. Siegal et. al., Thermal Radiation Heat Transfer, Second Edition, McGraw-Hill Book Co., New York, 1981.
16. Bucholz, J.A., Scoping Design Analyses for Optimized Shipping Casks Containing 1-, 2-, 3-, 5-, 7- or 10-year-old PWR Spent Fuel, ORNL/CSD/TM-149, Oak Ridge National Laboratory, Oak Ridge, Tenn., Jan. 1983.
17. Creer et. al., The TN-24P PWR Spent Fuel Storage Cask: Testing and Analyses, EPRI NP-5128, PNL-6054, UC-85, Electric Power Research Institute, Palo Alto, Calif., April 1987.
18. Petrie, L.M. and Landers, N. F., KENO-V.a, An Improved Monte Carlo Criticality Program with Supergrouping, NUREG/CR-0200, Oak Ridge Laboratory, December 1984.
19. Green, N. M., et.al., "NITAWL-S: Scale System Module for Performing Resonance Shielding and Working Library Production," NUREG/CR-0200, Oak Ridge National Laboratory, October 1981.
20. U.S. Nuclear Regulatory Commission, SCALE: A Modular Code System for Performing Standardized Computer Analysis for Licensing Evaluation, Revision 3, ORNL/NUREG/CR-0200, December 1984.
21. Bierman, S. R. et. al., "Critical Separation Between Subcritical Clusters of 2.35 wt% U235 Enriched UO2 Rods in Water with Fixed Neutron Poisons," PNL-2438, Pacific Northwest Laboratory, October 1979.
22. Bierman, S. R. and Clayton, E. D., "Criticality Experiments with Subcritical Clusters of 2.35 wt% and 4.31 wt% U235 Enriched UO2 Rods in Water with Steel Reflecting Walls," NUREG/CR-1784, PNL-3602, Pacific Northwest Laboratory, January 1981.
23. Johnson, Jr., A. B., and Gilbert, E. R., "Technical Basis for Storage of Zircaloy-Clad Spent Fuel in Inert Gases," PNL-4835, Pacific Northwest Laboratory, Richland, Wash., Sept. 1983.
24. American Society for Metals, Metals Handbook, Ninth Edition, Metals Park, Ohio, 1982.
25. Transnuclear, Inc., TN-24 Dry Storage Cask Topical Report, Revision 2A, Hawthorne, NY, 1989.
26. Bolz, R.E. and Tuve, G.L, Handbook of Tables for Applied Engineering Science, Second Edition, CRC Press, Cleveland, Ohio, 1973.

SAFETY ANALYSIS REPORT

Revision: 17

Page 3.5-3

27. U.S. Nuclear Regulatory Commission, NUREG 0800, Standard Review Plan for the Review of Safety Analysis Reports for Nuclear Power Plants, July 1981.
28. IAEA Safety Standards, Regulations for the Safe Transport of Radioactive Material, International Atomic Energy Agency, Vienna, 1985.
29. Gregory, J.J., et. al., "Thermal Measurements in a Series of Large Pool Fires", SAND85-0196, Sandia National Laboratories, Albuquerque, NM, August 1987.
30. Letter, R.O.Anderson (NSP) to U S Nuclear Regulatory Commission, dated March 27, 1995, "Response to Request for Additional Information Regarding NUREG-0612, 'Control of Heavy Loads'".
31. Letter, B.A.Wetzel (NRC) to R.O.Anderson (NSP), transmittal date June 12, 1995, "Safety Evaluation and Safety Assessment Related to Dry Cask Storage At Prairie Island".
32. Safety Evaluation 72-448, TN-40 Cask Weight/Storage Slab Design, May 14, 1996.
33. Safety Evaluation 72-411, TN-40 Dry Cask Hydrostatic Test Compliance, May 9, 1995.
34. USNRC, Regulatory Issue Summary 2013-11, Resolution of Licensing Process Expectations for Pressurized Water Reactor Fuel Assemblies Susceptible to Top Nozzle Stress Corrosion Cracking in Dry Cask Spent Fuel Storage and Transportation; September 4, 2013
35. NSP Design Change No 99FH02, Repair Regions D, E and F Spent Fuel Assemblies, Rev 0.
36. 10CFR72.48 Safety Evaluation 573, Rev 0
37. Interim Staff Guidance – 11, Revision 3, "Cladding Considerations for the Transportation and Storage of Spent Fuel," November 17, 2003.

THIS PAGE IS LEFT INTENTIONALLY BLANK

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

**TABLE 3.1-1
FUEL ASSEMBLY PARAMETERS**

| | |
|---|----------------------|
| Maximum weight, without control component or BPRA | 1,300 lb |
| Assembly dimensions: | |
| Without control component | 7.763"x7.763"x161.3" |
| Fuel rod array | 14 x 14 |
| Number of fuel rods | 179 |
| Active fuel length | 144" |
| Initial enrichment (maximum) | 3.85 w/o U235 |
| Burnup (maximum) | 45 GWD/MTU |
| Cooling time (minimum) | 10 YEARS |
| Initial uranium content: | |
| maximum | 410 kgU |
| minimum | 350 kgU |

| | Westinghouse Standard | OFA | Exxon Standard | TOPROD |
|----------------------|--------------------------|--------|-------------------|--------|
| Fuel Pellet O.D., in | 0.3659 | 0.3444 | 0.3565 | 0.3505 |
| Fuel Rod O.D., in | 0.422 | 0.400 | 0.424/0.426 | 0.417 |
| Clad Thickness, in | 0.0243 | 0.0243 | 0.030/0.031 | 0.0295 |
| Clad Material | Zr-4 | Zr-4 | Zr-4 | Zr-4 |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

**TABLE 3.1-2
THERMAL, GAMMA AND NEUTRON SOURCES FOR
THE DESIGN BASIS 14 X 14 WESTINGHOUSE OFA FUEL ASSEMBLY**

| | |
|----------------------------|----------|
| U235 Enrichment (w/o) | 3.85 |
| Burnup (MWD/MTU) | 45,000 |
| Specific Power (MW/MTU) | 37.5 |
| Cooling Time (yr) | 10 |
| Decay Heat (kw) | 0.675 |
| Gamma Source (photons/sec) | 2.44E+15 |
| Neutron Source (n/sec) | 2.19E+8 |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

**TABLE 3.2-1
SUMMARY OF TN-40 WEIGHTS**

| COMPONENT | WEIGHT, LB. |
|--|-------------|
| Body | 116,334 |
| Bottom | 18,866 |
| Lid | 13,907 |
| Aluminum Boxes | 1,991 |
| Resin | 10,578 |
| Outer Shell | 7,453 |
| Polypropylene Top Neutron Shield ⁽¹⁾ | 1,692 |
| Trunnions | 563 |
| Protective Cover ⁽²⁾ | 1,465 |
| Basket and Rails | 15,841 |
| Fuel Assemblies | 52,000 |
| Weight on Storage Pad ⁽³⁾ | 240,690 |

Notes:

- (1) Installed after cask moved to Auxiliary Building rail bay.
- (2) Installed after cask moved to Auxiliary Building rail bay or ISFSI.
- (3) Actual weight(s) will vary. Fully loaded cask weight is 244,000 lbs. max (Reference 32).

TABLE 3.2-2
SUMMARY OF LIFTING LOADS USED IN UPPER TRUNNION
ANSI N14.6 ANALYSIS OF TN-40 CASK

| <u>Handling Condition</u> | <u>Load in g's at cask CG ⁽¹⁾</u> <u>vertical</u> |
|---------------------------|---|
| Lifting-Cask Vertical | |
| Yield Evaluation | 1.5×10^6 lb. |
| Ultimate Evaluation | 2.5×10^6 lb. |
| | <u>Load at each trunnion ⁽²⁾</u> |
| Yield Evaluation | 0.75×10^6 lb. |
| Ultimate Evaluation | 1.25×10^6 lb. |
| | <u>Moment at trunnion/body interface ⁽²⁾</u> |
| Yield Evaluation | 3.90×10^6 in-lb. |
| Ultimate Evaluation | 6.50×10^6 in-lb. |

Notes:

- (1) Based on a cask weight of 250,000 lb.
(2) Load evenly divided between one pair of upper trunnions.

**TABLE 3.2-3
SUMMARY OF INTERNAL AND EXTERNAL PRESSURES
ACTING ON TN-40 CASK**

| Loading Condition | Maximum Pressure, psig |
|-------------------|---------------------------|
|-------------------|---------------------------|

Internal Pressure:

| | |
|-------------------------------------|-----|
| (a) Initial cavity pressurization | 12 |
| (b) With 10% fuel failure | 15 |
| (c) In minor fire | 12 |
| (d) Beginning of life unloading | 56 |
| (e) Tornado | 3* |
| (f) Selected bounding pressure | 100 |

External Pressure:

| | |
|----------------------------------|------|
| (a) Flood | 7 |
| (b) Snow and ice loading | 0.35 |
| (c) Fuel loading & unloading | 20 |
| (d) Earth burial | 25 |
| (e) Selected bounding pressure | 25 |

*This is due to a reduced external pressure

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

**TABLE 3.2-4
SUMMARY OF LOADS ACTING ON TN-40 CASK DUE
TO ENVIRONMENTAL AND NATURAL PHENOMENA**

Distributed Loads

Lateral Loading:

| | | |
|--|--------|-------------|
| (a) Maximum Wind or Water (external force on cask body) | | 46,750 lb. |
| (b) Seismic (inertial force throughout system) | 0.18W= | 45,000 lb. |
| Selected Bounding Load $W_{\max} \times 1G=$ | | 250,000 lb. |

Vertical Loading ⁽¹⁾

| | | |
|--|--------|-------------|
| (a) Seismic (inertial force throughout system) | 0.12W= | 30,000 lb. |
| Selected Bounding Load $W_{\max} \times 1G=$ | | 250,000 lb. |

Local Loads

Tornado Missile Loading (external force on
local area of
body):

| | |
|-------------------|-------------|
| (a) Lateral Load | 442,080 lb. |
| (b) Vertical Load | 442,080 lb. |

Note:

(1) Does not include dead weight or lifting loads.

**TABLE 3.2-5
TN-40 CASK LOADING CONDITIONS**

Normal

Assembly Loads (bolt preload and seal compression)

Pressure (internal and external)

Weight

Lifting Loads

Handling

Wind

Thermal variations (e.g. insolation, decay heat, rain, snow, ice, ambient)

Man-Made

Fuel cladding failure

Minor fire

Explosion

Cask Burial

Natural Phenomena

Earthquakes

Tornados

Hurricane

Flood

Tsunami

Seiches

Lightning

**TABLE 3.2-6
TN-40 CASK DESIGN LOADS**

| <u>Applied Load</u> | <u>Loading Condition</u> |
|---------------------|---|
| Internal Pressure | (1) and (2) |
| External Pressure | (3) |
| Distributed Loads | Weight Cask Body Contents Snow Ice Wind (Tornado) Lifting |
| Attachment Loads | Lifting |
| Bolt Loads | Preload for 100 psi metallic seal compression |

NOTES:

- (1) Cask designed for 100 psi internal pressure which envelops all internal pressure effects.
- (2) For normal conditions, the fission gas release should be less than 10%. However, for analysis purposes, 100% release is assumed.
- (3) Cask designed for 25 psi external pressure which envelops all external pressure effects.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

**TABLE 3.2-7
LEVEL A SERVICE LOADS (TN-40 CASK)**

| <u>Applied Load</u> | <u>Loading Condition (Cause)</u> | |
|-----------------------|---|----------------------------|
| Internal Pressure (1) | Rated Design | 20 psig |
| Operating (2) | Gas Release | 15psig |
| External Pressure (3) | Flood/burial | 25psig |
| Distributed Loads | Weight | Table 3.2-1 |
| | Cask body | Table 3.2-1 |
| | Contents | Table 3.2-1 |
| | Snow | Nil |
| | Ice | Nil |
| | Wind (Tornado) | Nil |
| | Lifting | Table 3.2-1 |
| Attachment Loads | Lifting | Table 4.2-3 |
| Bolt Loads | Preload for 100 psi and metallic seal compression | 25 ksi |
| Thermal Effects | Decay Heat/liner materials | 300 Deg F |
| | Solar Insolation | 108 Btu/hr-ft ² |
| | Cold Rain on Hot Cask | Nil |

NOTES:

- (1) Cask rated at 20 psig normal operating pressure and designed for 100 psig internal pressure which envelops all internal pressure effects.
- (2) For normal conditions, the fission gas release should be less than 10%.
- (3) Cask designed for 25 psig external pressure which envelops all external pressure effects.

**TABLE 3.2-8
LEVEL D SERVICE LOADS (TN-40 CASK)**

| <u>Load</u> | <u>Cause</u> |
|-------------------|---|
| Internal Pressure | (1) and (2) |
| External Pressure | (3) |
| Distributed Loads | Weight Cask body Contents Tornado Wind Flood Water Seismic |
| Local Loads | Tornado Wind Driven Missiles |
| Bolt Loads | Preload for 100 psig and metallic seal compression |

NOTES:

- (1) Cask design rating is 20 psig normal operating pressure and the cask is analyzed for 100 psig internal pressure which envelops all internal pressure effects.
- (2) The fission gas release should be less than 10%. However, for analysis purposes, 100% release is assumed.
- (3) Cask designed for 25 psig external pressure which envelops all external pressure effects including flood water level, cask burial and explosion. Explosions close to the cask are unexpected. Explosions at a significant distance from the cask would have a negligible effect.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

**TABLE 3.2-9
LOAD COMBINATIONS FOR TN-40 CASK BODY**

| | Bolt Preload | 1 g Down | Internal Pressure | Ext. Pressure | Temp. | 3 G On Trunnions | Trunnion Local | Seismic, Tornado or Flood | Tornado Missiles |
|-------------------|-------------------------|---------------------|------------------------------|--------------------------|--------------|-----------------------------|---------------------------|--|-----------------------------|
| Design Des (1) | X | X | X | | | | | X | |
| Des (2) | X | | X | | | X | X | | |
| Des (3) | X | X | | X | | | | X | |
| Level A A (1) | X | X | X | | X | | | X | |
| A (2) | X | | X | | X | X | X | | |
| A (3) | X | X | | X | X | | | X | |
| Level D D (1) | X | X | X | | | | | X | X |
| D (2) | X | X | | X | | | | X | X |

**TABLE 3.3-1
SUMMARY OF THERMAL ANALYSES (TN-40 CASK)**

Short Term (OFF-NORMAL) Storage Conditions*

Maximum Temperatures

| | | |
|---------------------------------|-------|---------|
| Outer Surface | 223°F | (112°C) |
| Neutron Shield (resin/aluminum) | 274°F | (134°C) |
| Seal/Lid | 242°F | (117°C) |
| Cavity Wall | 303°F | (151°C) |
| Basket Plate | 537°F | (281°C) |
| Fuel Cladding | 642°F | (339°C) |
| Average Cavity Gas Temperature | 442°F | (228°C) |

Long Term (NORMAL) Conditions **

Maximum Temperatures

| | | |
|---------------------------------|-------|---------|
| Outer Surface | 191°F | (88°C) |
| Neutron Shield (resin/aluminum) | 233°F | (111°C) |
| Seal/Lid | 200°F | (93°C) |
| Cavity Wall | 261°F | (127°C) |
| Basket Plate | 496°F | (258°C) |
| Fuel Cladding | 602°F | (317°C) |
| Average Cavity Gas Temperature | 401°F | (205°C) |

*100°F (38°C) ambient temperature, solar heat load of 135 btu/hr-ft².

**50°F (10°C) ambient temperature, solar heat load of 108 Btu/hr-ft².

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

**TABLE 3.3-2
PROPERTIES OF MATERIALS USED IN THERMAL ANALYSES (TN-40 CASK)**

| Material | Stainless Steel 18Cr-8Ni | Carbon Steel C-Mn-Si | Aluminum 6061 Alloy | Resin | Helium | Air | Concrete |
|---|---|---|---|----------------|---|---|-------------|
| Used for | Basket | Cask body shells and outer shells | Basket and neutron shield | Neutron shield | Fill gas | air gaps | storage pad |
| Density (lb/in. ³) | 0.29 (24)* | 0.284 (24) | 0.98 (24) | 0.057 (25) | 0 | 0 | |
| Emissivity | 0.15 (12) | | | | | | 0.94 (15) |
| Specific Heat (Btu/lb-°F) | 0.119@200°F (4) 0.123@400°F 0.130@600°F 0.132@700°F 0.136@1,000°F | 0.110@100°F (4) 0.123@300°F 0.133@500°F 0.143@700°F 0.155@900°F 0.164@1000°F | 0.215@100°F (4) 0.221@200°F 0.226@300°F 0.230@400°F | 0.3107 (25) | 0 | 0 | |
| Thermal Conductivity (Btu/hr-ft-°F) | 8.6@70°F (4) 8.7@100°F 9.3@200°F 9.8@300°F 10.4@400°F 10.9@500°F | 23.6@70°F (4) 23.9@100°F 24.2@150°F 24.4@200°F 24.4@300°F 24.2@400°F 23.7@500°F 23.1@600°F 21.7@800°F 20.0@1,000°F | 96.1@70°F (4) 96.9@100°F 98.0@150°F 99.0@200°F 100.6@300°F 101.9@400°F | 0.1(17) | 0.078@0°F(12) 0.098@200°F 0.114@400°F 0.130@600°F 0.145@800°F 0.159@981°F 0.172@116°F | 0.0137@32°F (12) 0.0145@68°F 0.0153@104°F 0.0161@140°F 0.0169@176°F 0.0177@212°F 0.0214@392°F 0.0248@572°F 0.0280@752°F | 1.0 (26) |

*Numbers in parentheses are the reference numbers.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION**SAFETY ANALYSIS REPORT**Revision: 9

TABLE 3.3-3
MATERIAL COMPOSITION FOR KENO MODEL (TN-40 CASK)

| MIXTURE | DENSITY (g/cm ³) | NUCLIDE/ ELEMENT | LIBRARY NUMBER | DENSITY (Atoms/b.cm) |
|----------------------|---------------------------------|------------------|----------------|-------------------------|
| UO ₂ Fuel | 10.39 | U235 | 92235 | 9.0350E-4 |
| 3.85 wt% U235 | | U238 | 92238 | 2.2279E-2 |
| | | O | 8016 | 4.6365E-2 |
| UO ₂ Fuel | 10.39 | U235 | 92235 | 4.4590E-4 |
| 1.9 wt% U235 | | U238 | 92238 | 2.2731E-2 |
| | | O | 8016 | 4.6355E-2 |
| Zircaloy | 6.44 | * | 40302 | 4.2518E-2 |
| Water | 0.998 | H | 1001 | 6.6759E-2 |
| | | O | 8016 | 3.3380E-2 |
| Stainless Steel | 7.92 | Cr | 24304 | 1.7430E-2 |
| | | Mn | 25055 | 1.7364E-3 |
| | | Fe | 26304 | 5.9359E-2 |
| | | Ni | 28304 | 7.7182E-3 |
| Aluminum | 2.699 | Al | 13027 | 6.0242E-2 |
| Carbon Steel | 7.82 | C | 6012 | 3.9217E-3 |
| | | Fe | 26000 | 8.3500E-2 |
| Boral Core | 2.63 | B10 | 5010 | 9.4855E-3 |
| | | B11 | 5011 | 3.8518E-2 |
| | | C | 6012 | 1.2001E-2 |
| | | Al | 13027 | 3.4804E-2 |
| Borated Water | 1 | B10 | 5010 | 1.9815E-5 |
| | | B11 | 5011 | 8.0445E-5 |
| | | H | 1001 | 6.6732E-2 |
| | | O | 8016 | 3.3366E-2 |

*40302 is a composite cross section for 97.91 wt% Zr,
1.59 Sn, 0.5%Fe

TABLE 3.3-4
TN-40 REACTIVITY DURING DRAINING

| Borated Water Level below top of active fuel (ft) | $k_{eff} \pm \sigma^*$ |
|---|------------------------|
| 0 | 0.8966 ± 0.0031 |
| 1 | 0.8899 ± 0.0035 |
| 2 | 0.9011 ± 0.0036 |
| 3 | 0.8936 ± 0.0031 |
| 4 | 0.8956 ± 0.0031 |
| 5 | 0.8879 ± 0.0033 |
| 6 | 0.8816 ± 0.0034 |

*Uncorrected for bias

TABLE 3.3-5
TN-40 REACTIVITY VERSUS WATER DENSITY

| Fresh water density (g/cc) | $K_{eff} \pm \sigma^*$ |
|-------------------------------|------------------------|
| 1.0 | 0.9306 ± 0.0036 |
| 0.8 | 0.8902 ± 0.0044 |
| 0.5 | 0.7709 ± 0.0036 |
| 0.1 | 0.4253 ± 0.0028 |
| 0.01 | 0.3137 ± 0.0032 |
| 0.0001 | 0.3137 ± 0.0022 |

*Uncorrected for bias – 1.9 w/o U235

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION**SAFETY ANALYSIS REPORT**Revision: 9

**TABLE 3.3-6
PNL BENCHMARK EXPERIMENTS**

| Case No. | Length x Width (Fuel rods) | Poison Plates (mm) | Fuel Cluster Separation (mm) |
|----------|-------------------------------|-----------------------|------------------------------------|
| A* | (1) 25 x 18 (2) 20 x 18 | Borated SS (2.98) | 48.0 |
| B* | (2) 20 x 18 | Boral (2.92) | 26.9 |
| C* | (2) 20 x 18 | SS304L (3.02) | 82.8 |
| D* | (1) 25 x 18 (2) 20 x 18 | None | 95.1 |
| E* | 20 x 15 | None | 63.9 |

*17.85 cm thick steel walls placed at 1.32 cm from fuel clusters.

TABLE 3.3-7
KENO-V.A BENCHMARK RESULTS

| Experiment No. | Keff | Sigma |
|-------------------|--------|-------|
| A | 0.9900 | 0.004 |
| B | 0.9909 | 0.004 |
| C | 0.9865 | 0.005 |
| D | 0.9885 | 0.004 |
| E | 0.9856 | 0.004 |
| Avg=0.9883 | | |

TABLE 3.3-8
MAXIMUM TRANSIENT TEMPERATURES – FIRE ACCIDENT

| Location | Initial Temperature | Peak Transient Temperature |
|----------------|---------------------|----------------------------|
| Outer Shell | 233°F | 1080°F @ 15 min.* |
| Neutron Shield | 273°F | 820°F @ 17 min. |
| Cavity Wall | 302°F | 354°F @ 201 min. |
| Basket | 530°F | 568°F @ 495 min. |

*Time from start of fire accident

**TABLE 3.4-1
DESIGN CRITERIA FOR TN-40 CASKS**

| | |
|--|--|
| Maximum gross weight on crane (with lift beams, without water) | 125 tons |
| Maximum cask height with lid removed | 16 ft. 1 in. |
| Maximum keff. including bias and uncertainties | ≤ 0.95 Normal <0.98 Accident |
| Payload capacity fuel assemblies | 40 intact PWR 14x14 |
| Maximum external dose rate (on storage pad) | 200 mrem/hr contact |
| Spent fuel characteristics | |
| a) Initial enrichment | 3.85% |
| b) Burnup (max) | 45,000 MWD/MTU |
| c) Cooling time (min) | 10 years |
| d) Decay heat | 27 kw (total) |
| Max clad temperature | 340°C |
| Cask cavity atmosphere | Helium gas |
| Maximum internal pressure | 100psig |
| Ambient temperature (Min-Max) | -40° to 120°F |
| Maximum solar heat load | 135 BTU/hr-ft ² |
| Tornado wind | 300mph rotational 60 mph translational |
| Tornado missiles | 4"x12"x144" plank @300 mph; 4,000lb. auto @50 mph |
| Seismic design earthquake | 0.12 g horizontal 0.08 g vertical |
| Snow and ice | 50 psf load |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION**SAFETY ANALYSIS REPORT**Revision: 13

**TABLE 3.4-2
DESIGN BASIS LIMITS FOR FISSION PRODUCT BARRIERS FOR 72.48
REVIEWS**


| Fission Product Barrier | Design Basis Parameter | Transnuclear TN-40 Design Basis Limit |
|------------------------------------|-----------------------------------|---|
| Fuel Cladding | Clad Temperature | Less than 340° |
| Fuel Cladding | Decay Heat Per Assembly | 27 kW (total) |
| Fuel Cladding | Sub-criticality | K _{eff} less than 0.95 |
| Confinement Boundary | MSB/DSC Pressure | 100 psig |
| Confinement Boundary | MSB/DSC Vessel Stresses | Code allowable stresses for ASME Boiler and Pressure Vessel Code, Section III, Division 1, Subsection NB, Article NB-3200 |
| Confinement Boundary | MSB/DSC Leak Rate | 1 x 10 ⁻⁵ atm cm ³ /sec |

01204149

Rev. 0 8/90


Figure 3.1-1
DECAY HEAT
DESIGN BASIS FUEL ASSEMBLY

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

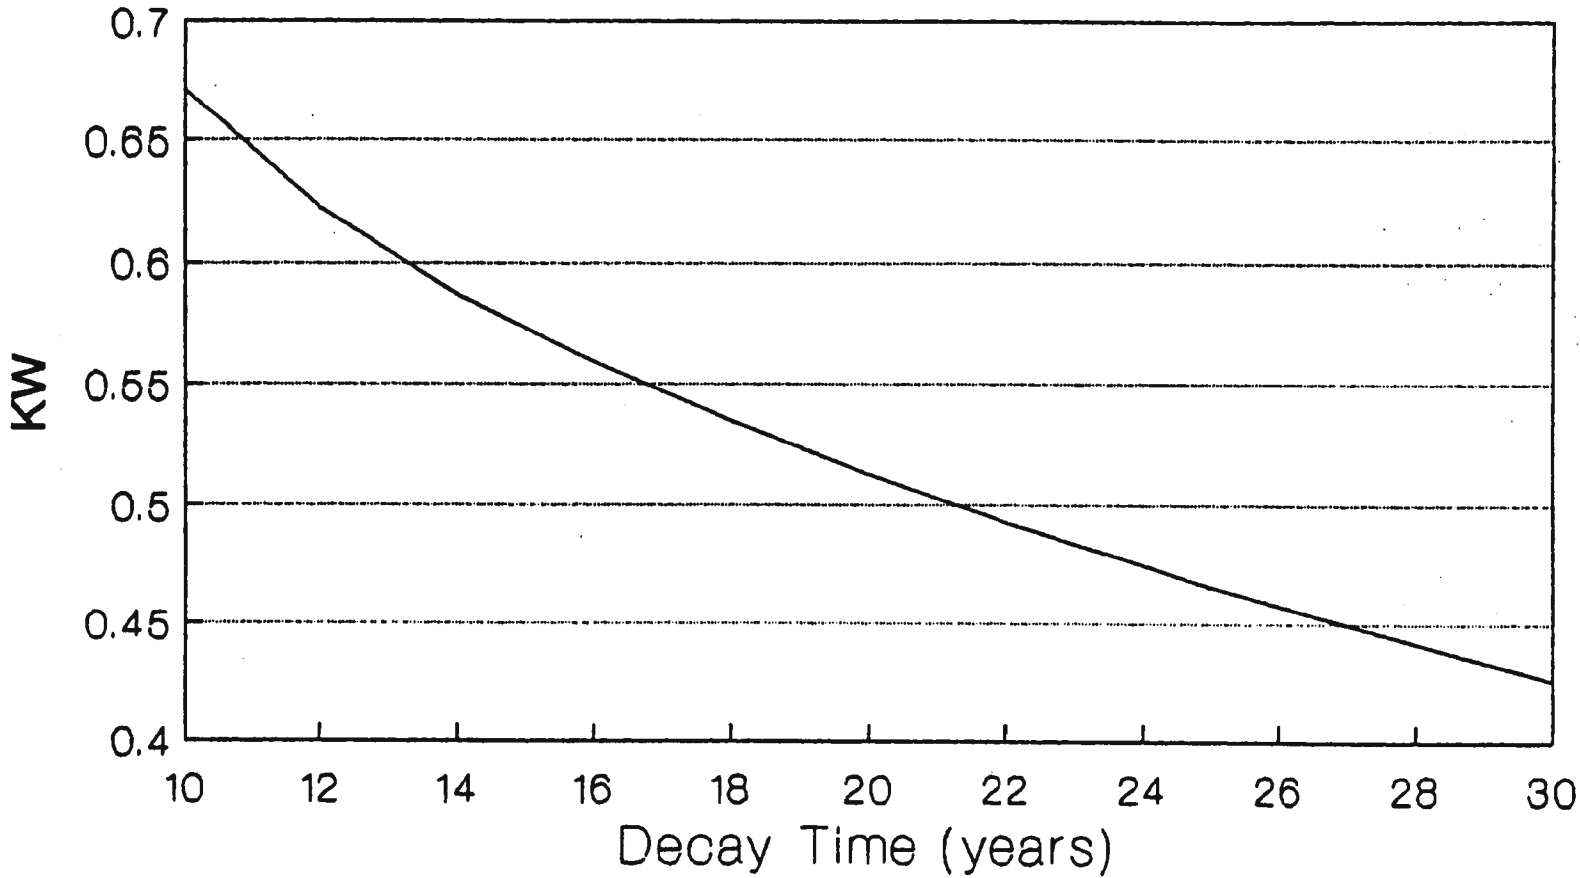

DECAY HEAT DESIGN BASIS FUEL ASSEMBLY

NORTHERN STATES POWER COMPANY



PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY:

VLS

REVISION:


0

PAGE NO.

DATE: 03-30-06

FIG3.1-1_REV_0

GAMMA SOURCE DESIGN BASIS FUEL ASSEMBLY

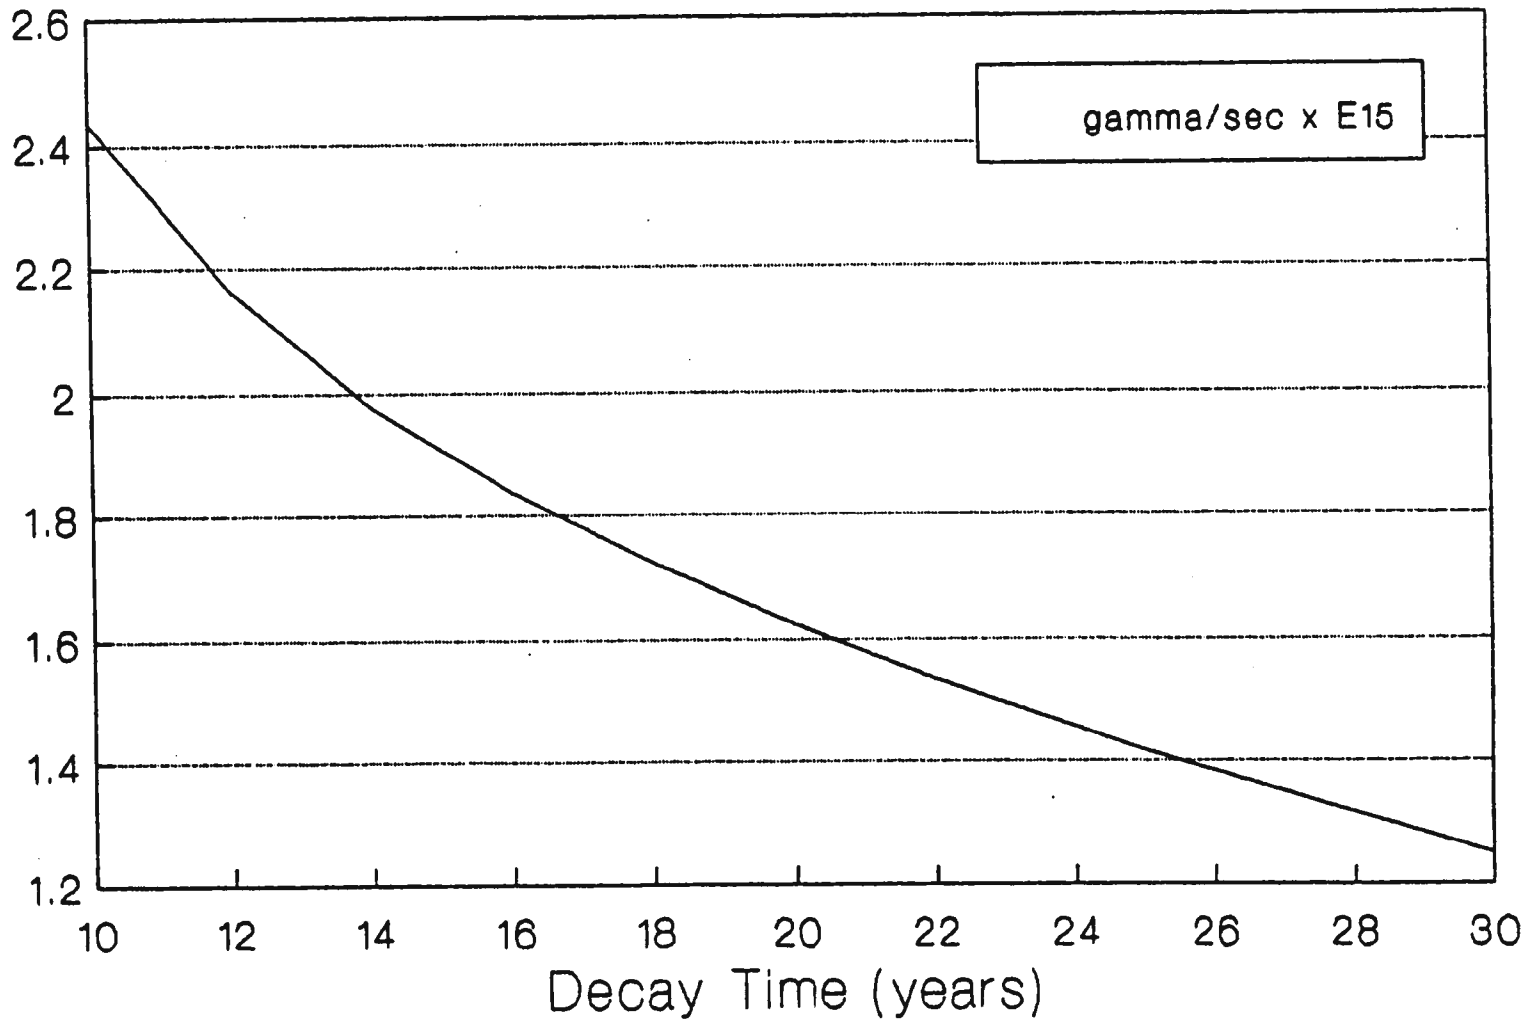


Rev. 0 8/90

Figure 3.1-2
GAMMA SOURCE
DESIGN BASIS FUEL ASSEMBLY

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

NEUTRON SOURCE DESIGN BASIS FUEL ASSEMBLY

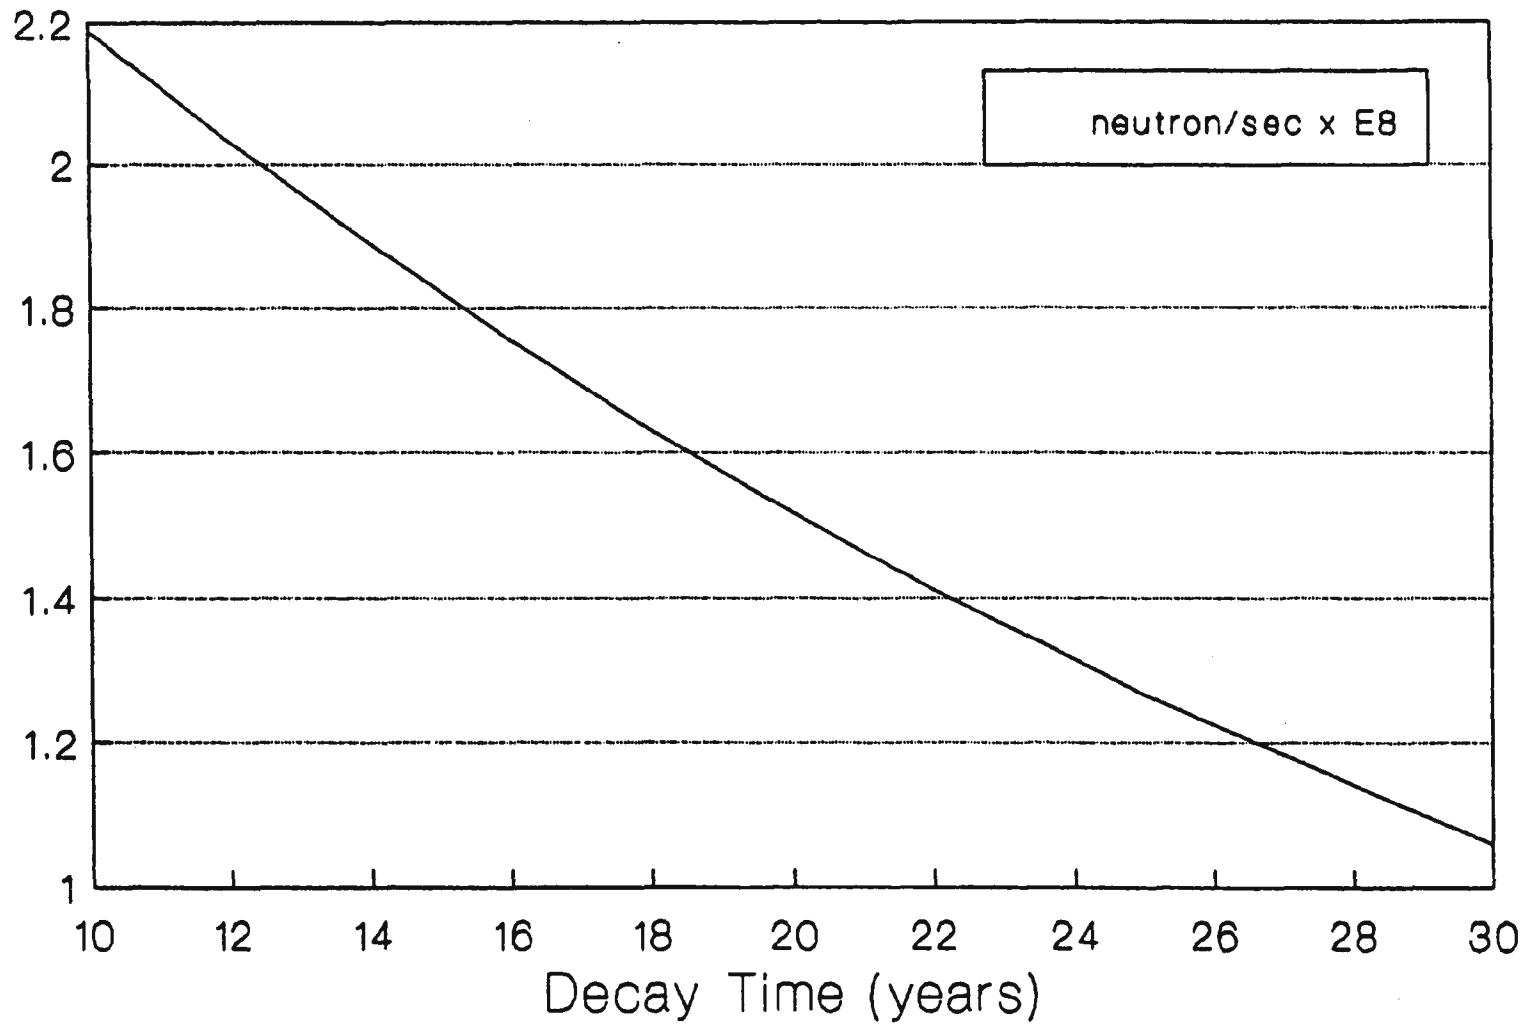

Rev. 0 8/90

Figure 3.1-3
NEUTRON SOURCE
DESIGN BASIS FUEL ASSEMBLY
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

Security-Related Information Figure Withheld Under 10 CFR 2.390.

REV 2 9/91

Figure 3.1-4 OFA FUEL ASSEMBLY DIMENSIONAL DATA

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT


OFA FUEL ASSEMBLY DIMENSIONAL DATA

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

| | |
|-----------|----------|
| DRAWN BY: | VLS |
| PAGE NO. | |
| REVISION: | 2 |
| DATE: | 03-31-06 |

FIG3.1-4_REV_2



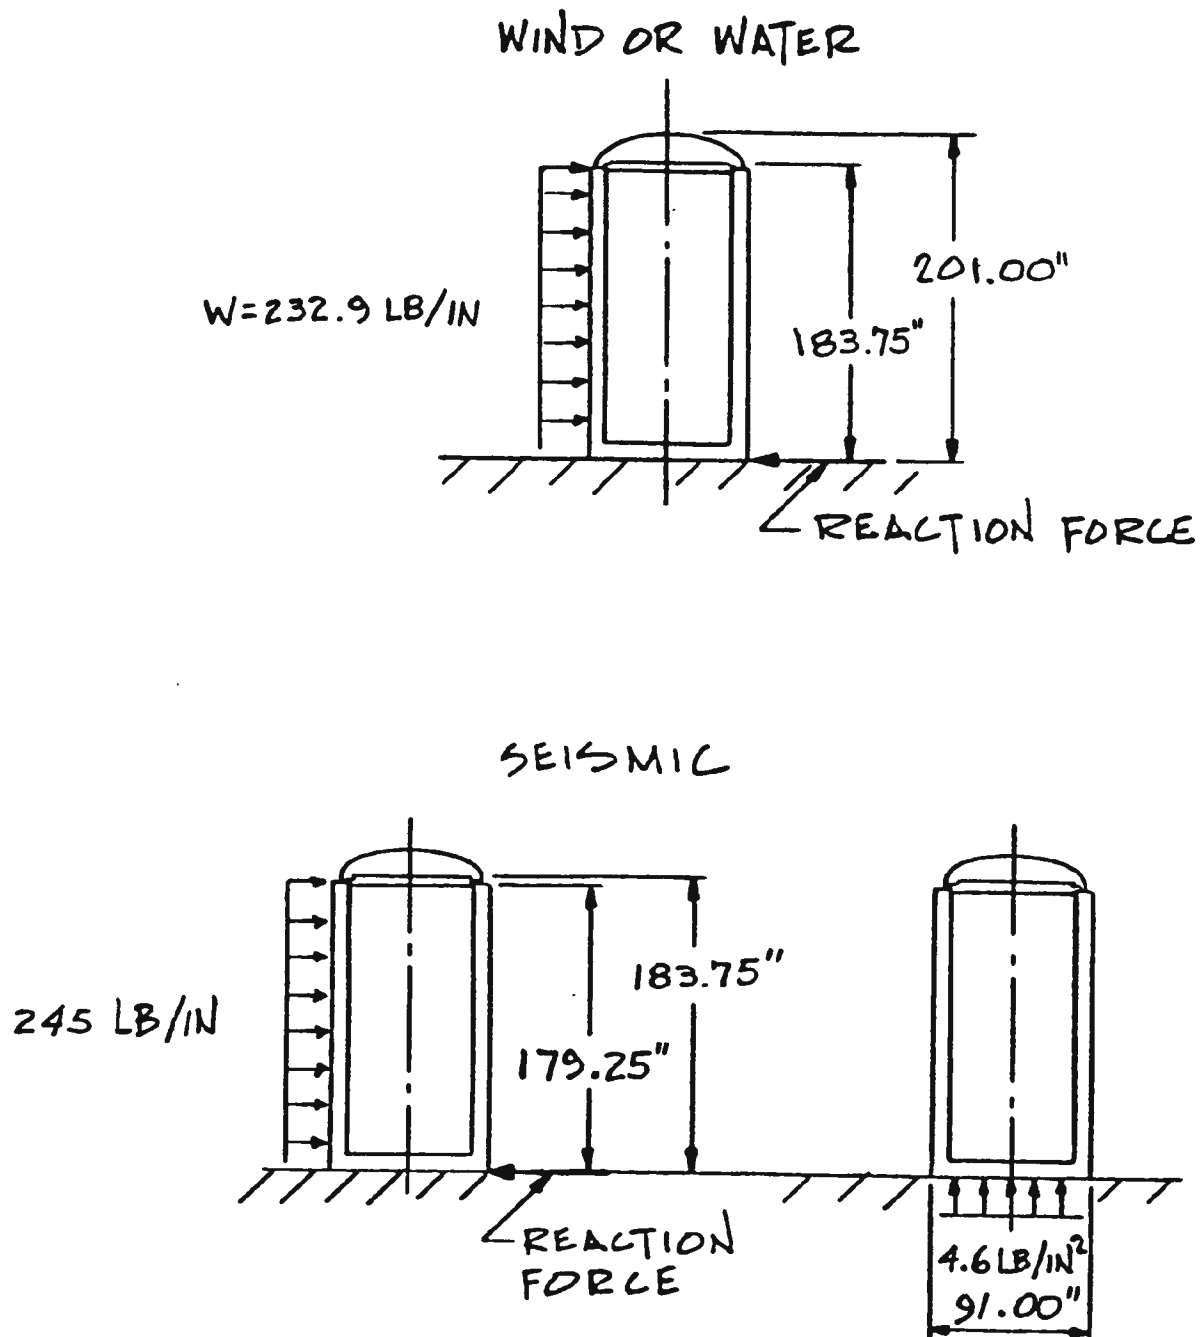


Rev. 0 8/90

Figure 3.2-1
EARTHQUAKE, WIND AND
WATER LOADS (TN-40 CASK)

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

EARTHQUAKE, WIND AND WATER LOADS (TN-40 CASK)

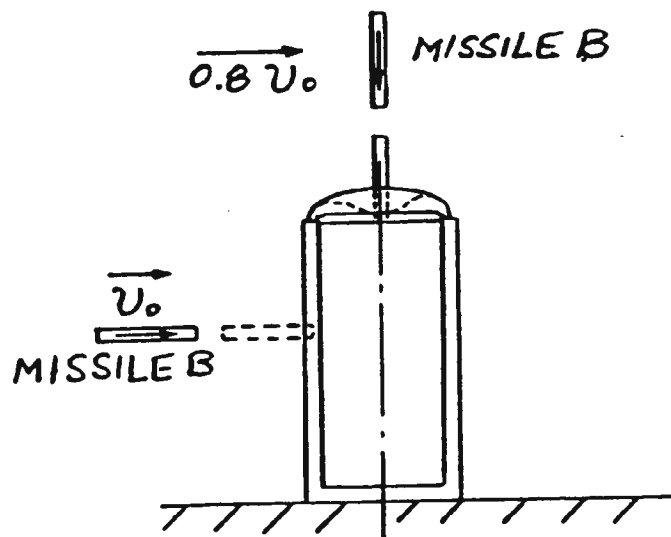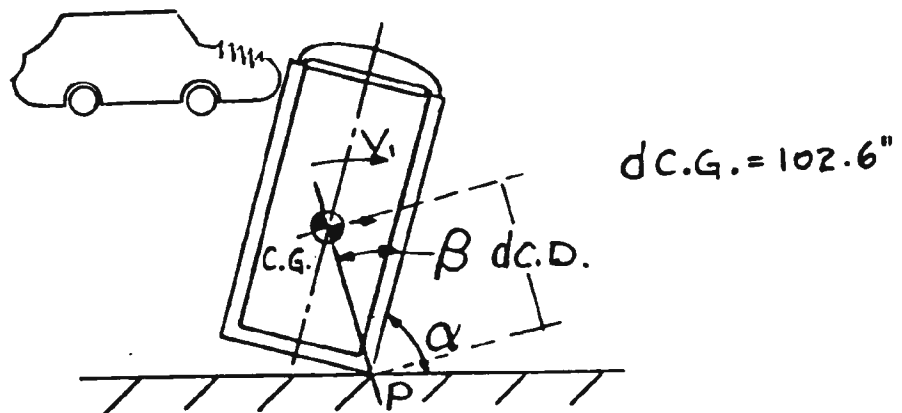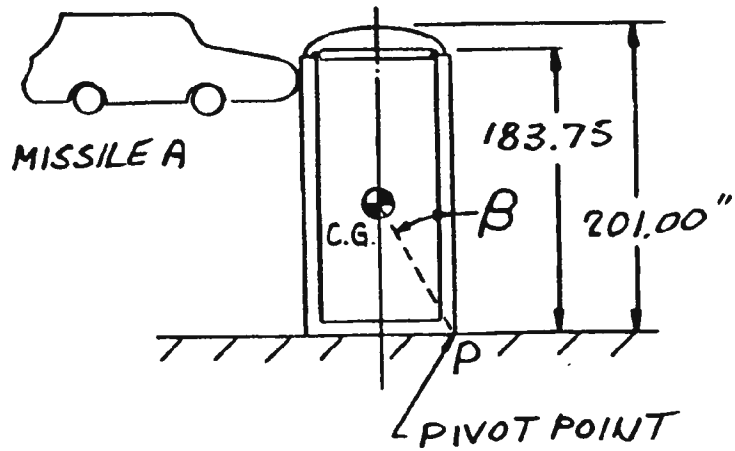


Rev. 0 8/90

Figure 3.2-2
TORNADO MISSILE IMPACT
LOADS (TN-40 CASK)

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

TORNADO MISSILE IMPACT LOADS (TN-40 CASK)

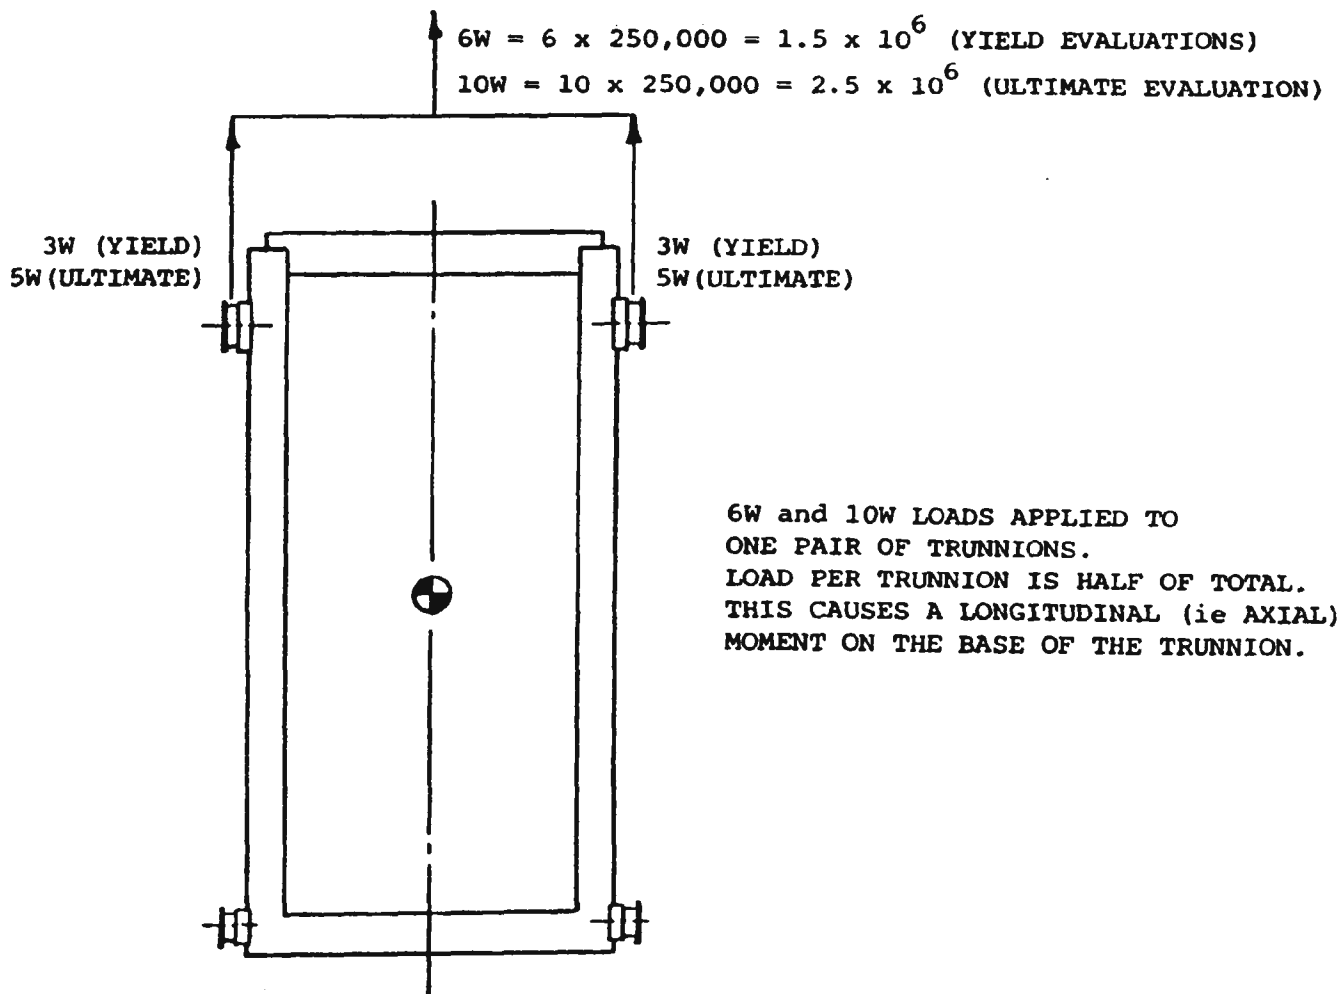


6W and 10W LOADS APPLIED TO
 ONE PAIR OF TRUNNIONS.
 LOAD PER TRUNNION IS HALF OF TOTAL.
 THIS CAUSES A LONGITUDINAL (ie AXIAL)
 MOMENT ON THE BASE OF THE TRUNNION.

Rev. 0 8/90

Figure 3.2-3
LIFTING LOADS
(TN-40 CASK)
 PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

LIFTING LOADS (TN-40 CASK)

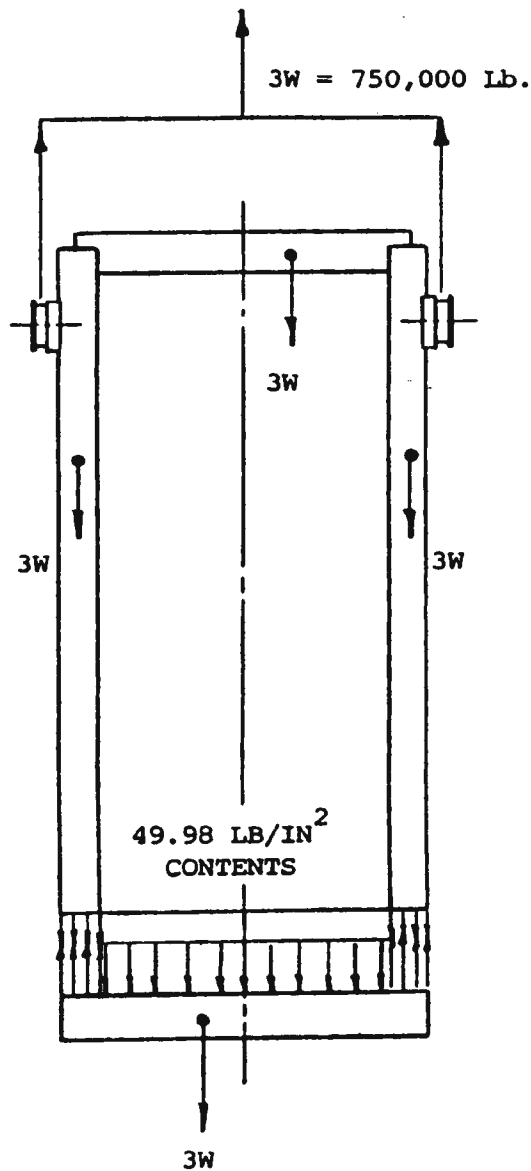

Rev. 0 8/90

Figure 3.2-4
DESIGN LOADS ON TN-40
CASK DUE TO LIFTING

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

DESIGN LOADS ON TN-40 CASK DUE TO LIFTING


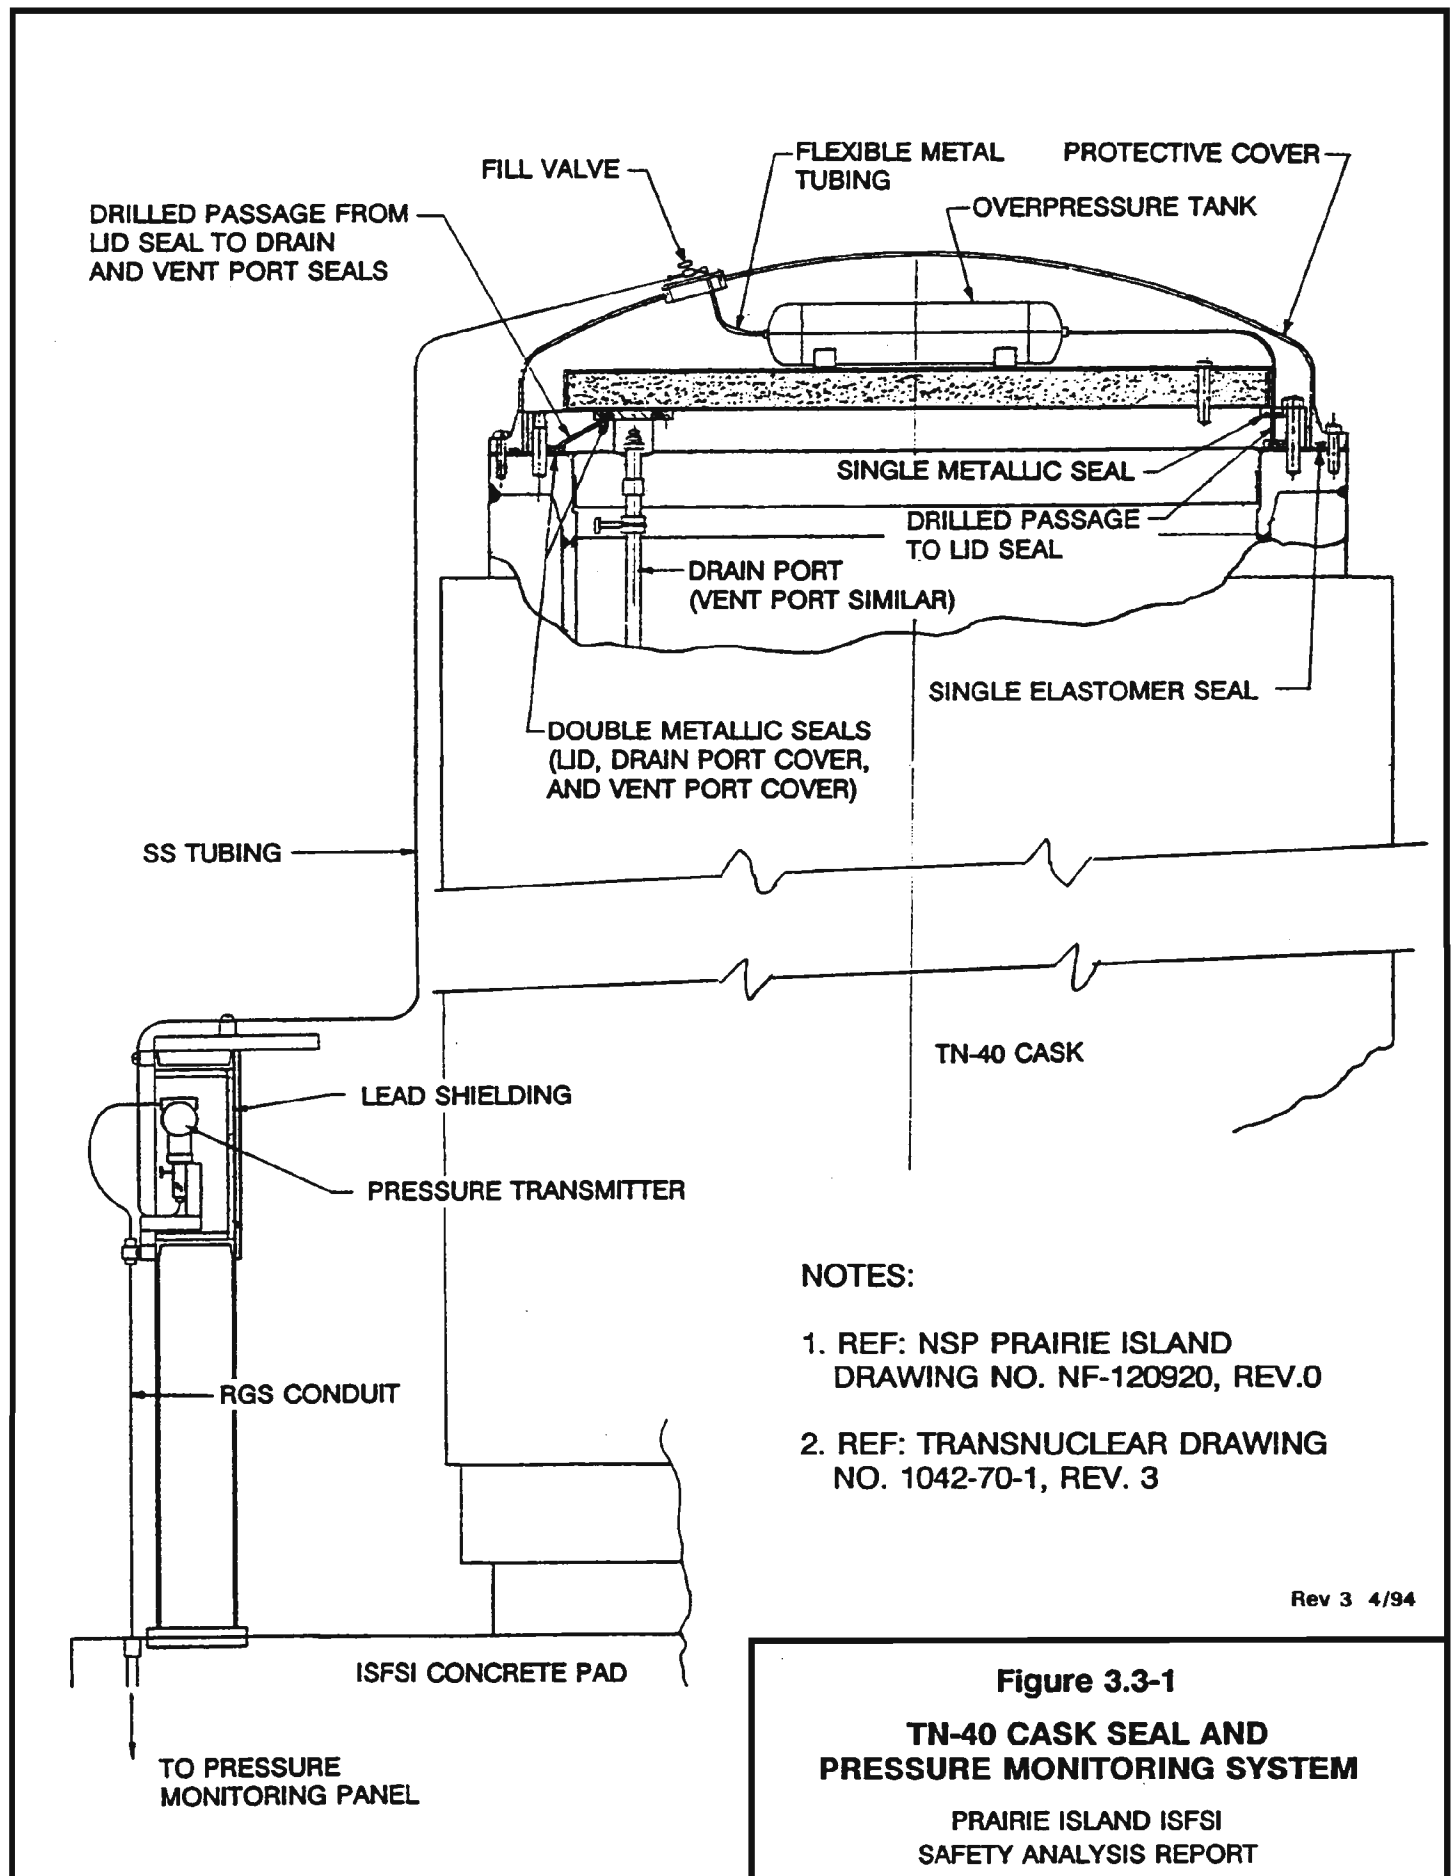


Figure 3.3-1
TN-40 CASK SEAL AND
PRESSURE MONITORING SYSTEM
 PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

TN-40 CASK SEAL AND PRESSURE MONITORING SYSTEM

Rev. 2 9/91

Figure 3.3-2
TN-40 CASK PRESSURE MONITORING
SYSTEM TEST LEAKAGE RATE
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

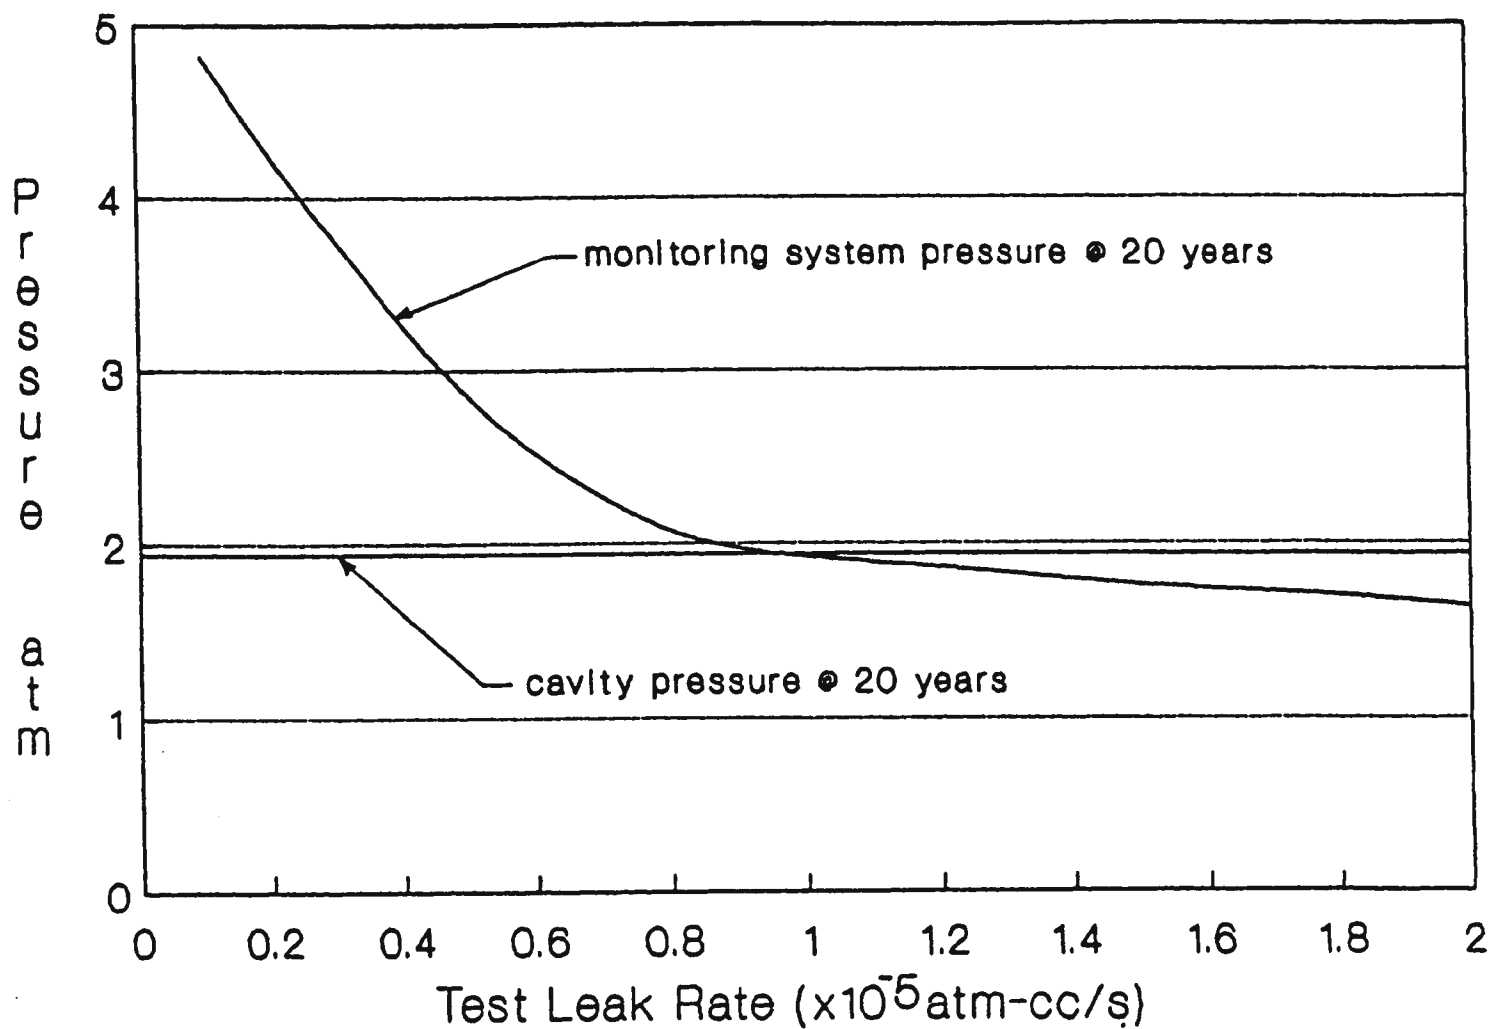

TN-40 CASK PRESSURE MONITORING SYSTEM TEST LEAKAGE RATE

NORTHERN STATES POWER COMPANY



PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY:

VLS

REVISION:


2

PAGE NO.

DATE: 04-3-06


FIG3.3-2_REV_2

TN-40 CASK PRESSURE MONITORING SYSTEM - SYSTEM PRESSURE

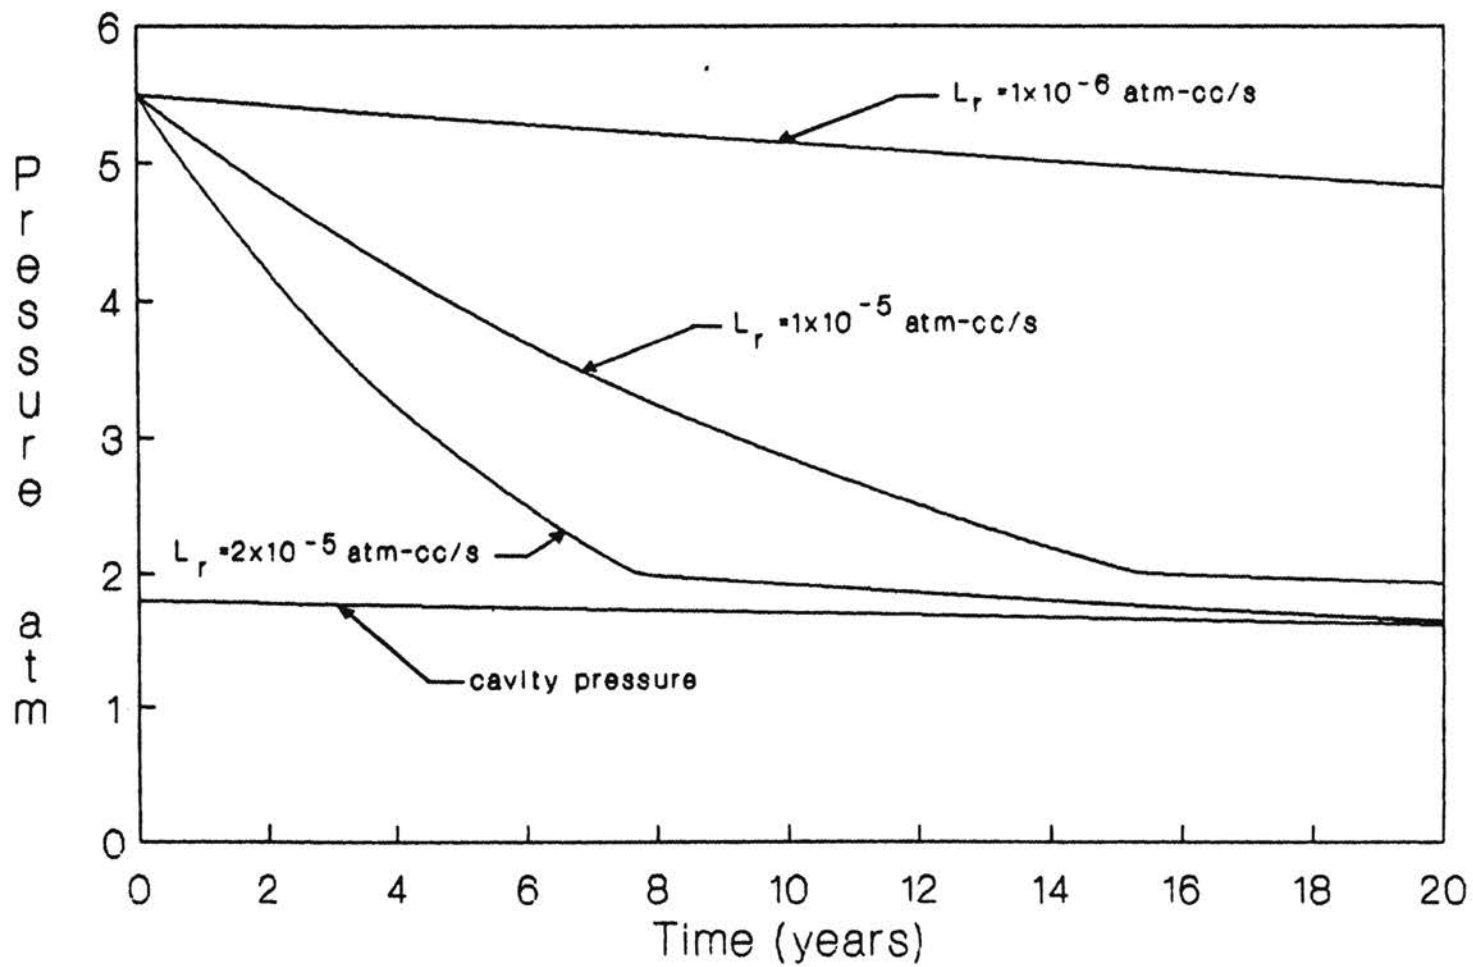

Rev. 0 8/90

Figure 3.3-3
TN-40 CASK PRESSURE MONITORING
SYSTEM - SYSTEM PRESSURE
 PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

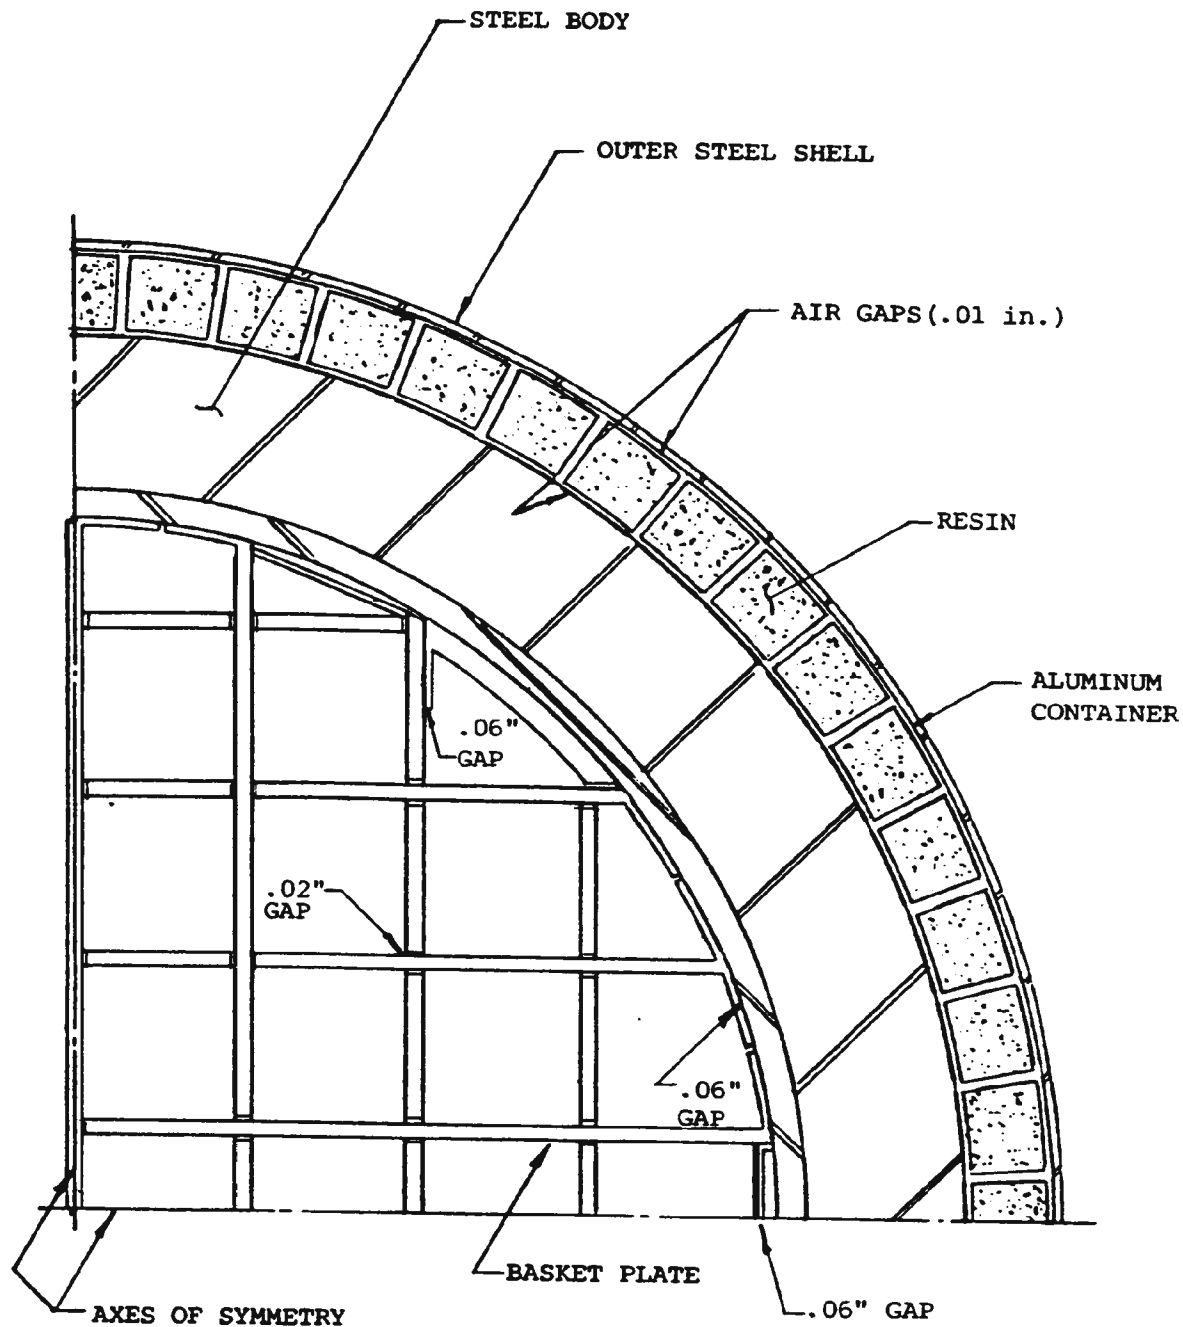

Rev. 0 8/90

Figure 3.3-4
TN-40 CASK THERMAL MODEL
RADIAL CROSS SECTION
 PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

TN-40 CASK THERMAL MODEL RADIAL CROSS SECTION

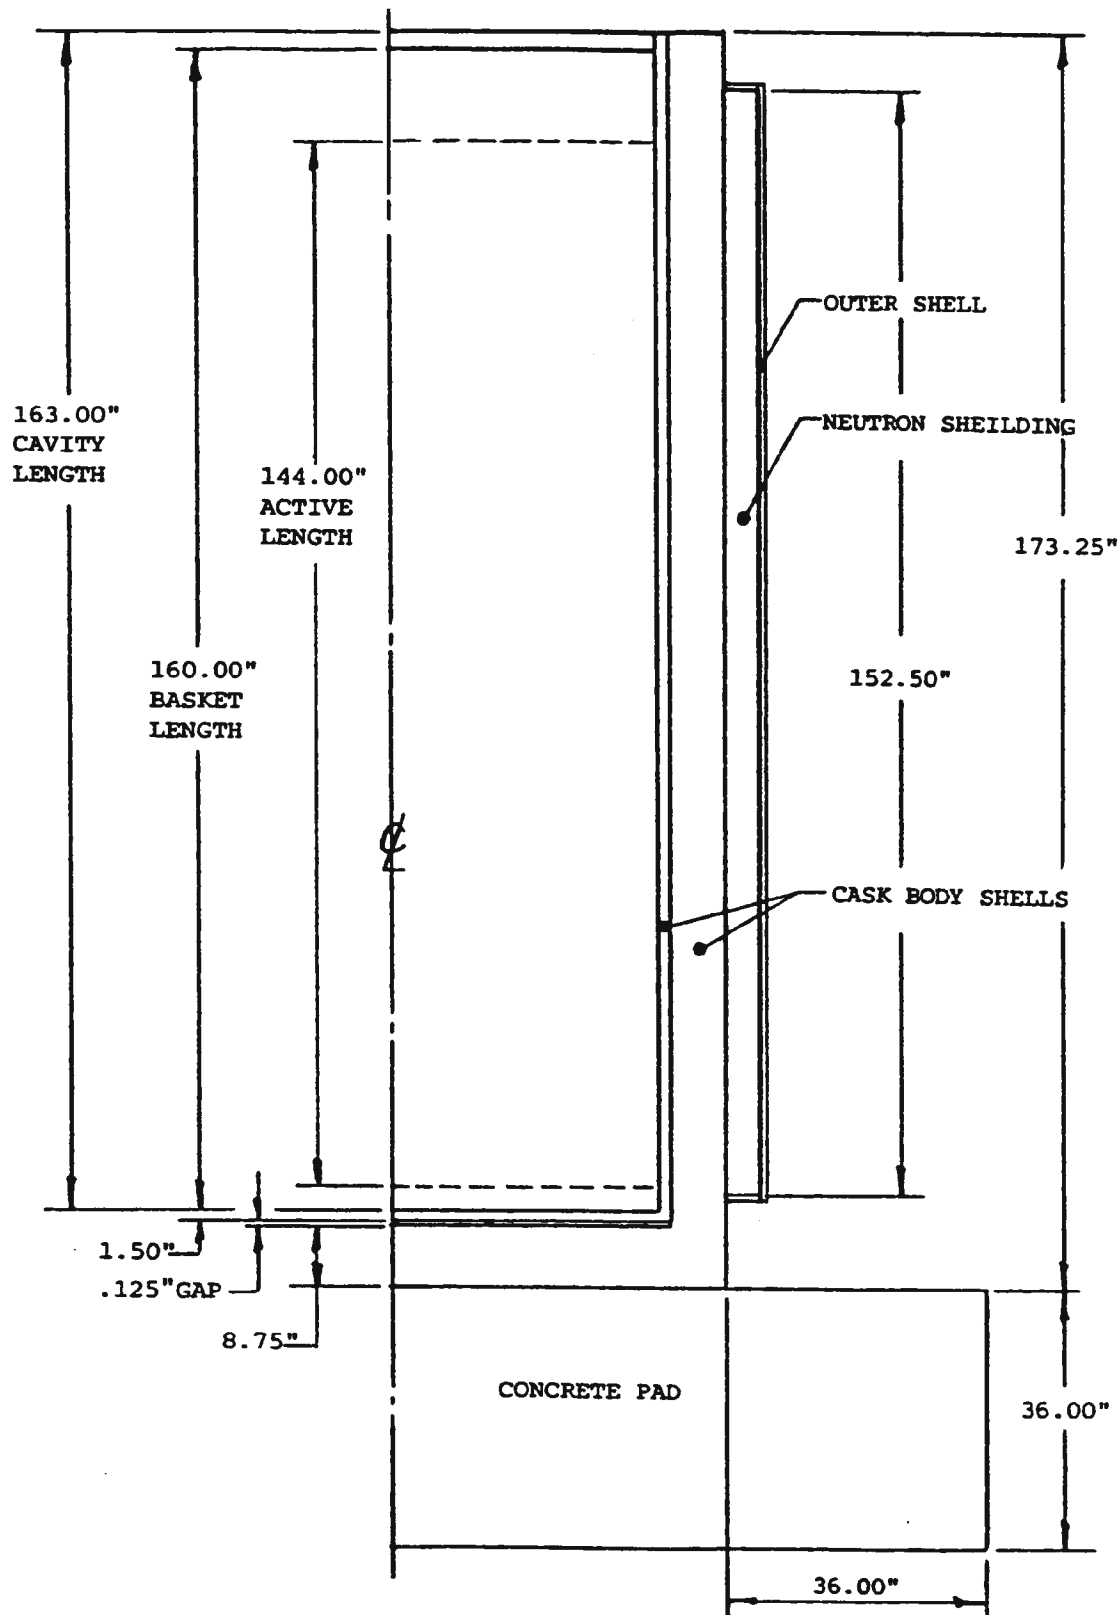


Figure 3.3-5
TN-40 CASK THERMAL MODEL
AXIAL CROSS SECTION


PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

Rev. 0 8/90

TN-40 CASK THERMAL MODEL AXIAL CROSS SECTION

ANSYS 4.3
MAY 4 1990
13:55:33
PREP7 ELEMENTS

XU=1
YU=-1
ZU=1
DIST=122
XF=25.8
YF=31.8
ZF=56.6
ANGL=-60
HIDDEN

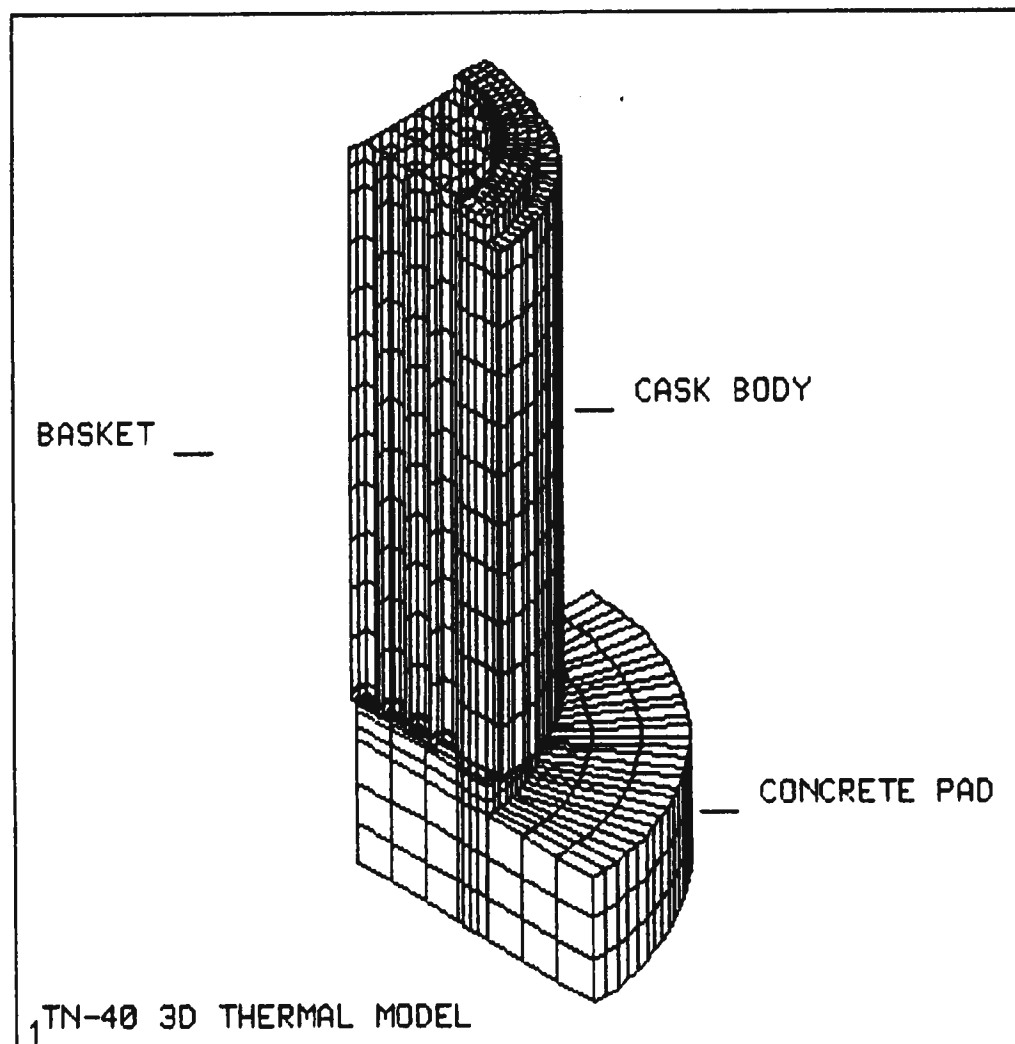

Rev. 0 8/90

Figure 3.3-6
TN-40 CASK FINITE ELEMENT
THERMAL MODEL

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

TN-40 CASK FINITE ELEMENT THERMAL MODEL

NORTHERN STATES POWER COMPANY
Xcel Energy
PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY:

VLS


REVISION:

0

PAGE. NO.

DATE: 04-3-06

FIG3.3-6_REV_0

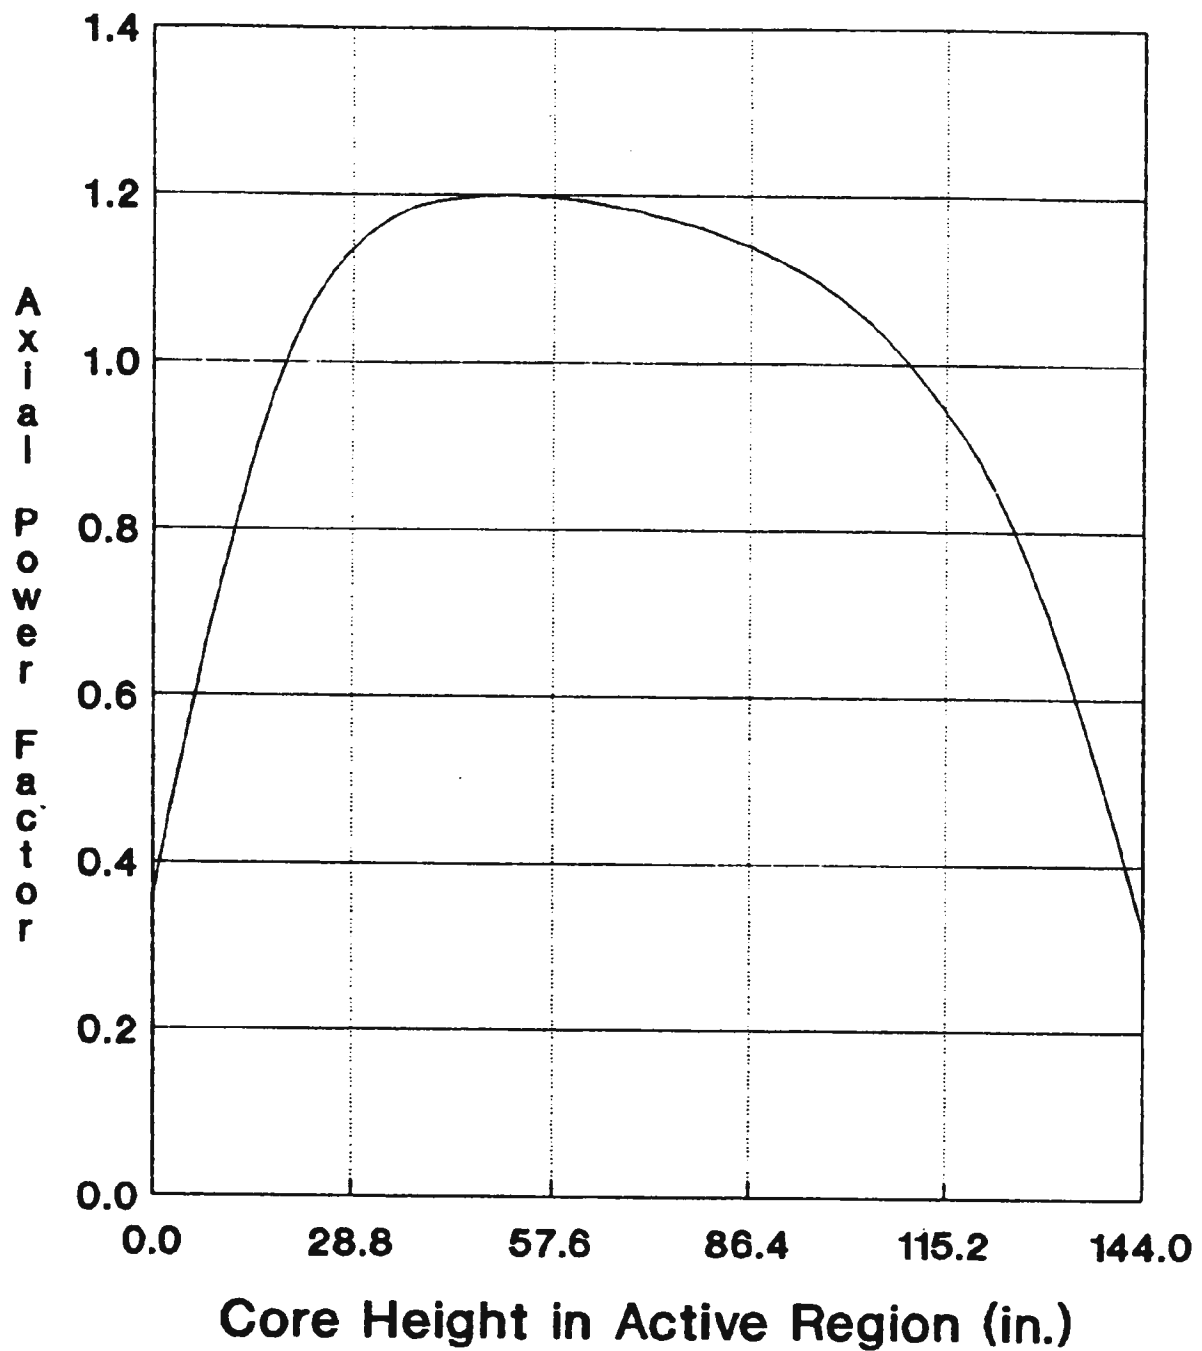


Rev. 0 8/90

Figure 3.3-7
AXIAL POWER DISTRIBUTION
(TN-40 CASK)

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT


AXIAL POWER DISTRIBUTION (TN-40 CASK)

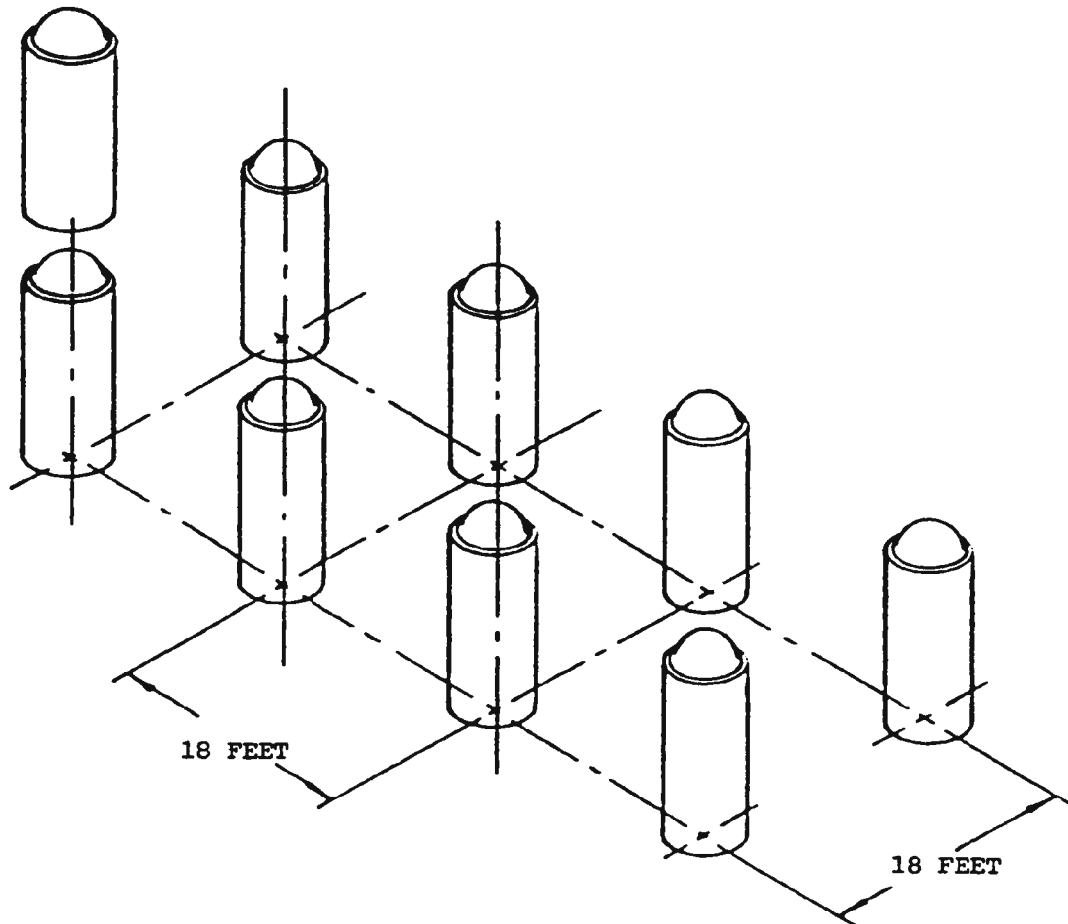

Rev. 0 8/90

Figure 3.3-8
TN-40 CASK STORAGE
CONFIGURATION
 PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

TN-40 CASK STORAGE CONFIGURATION

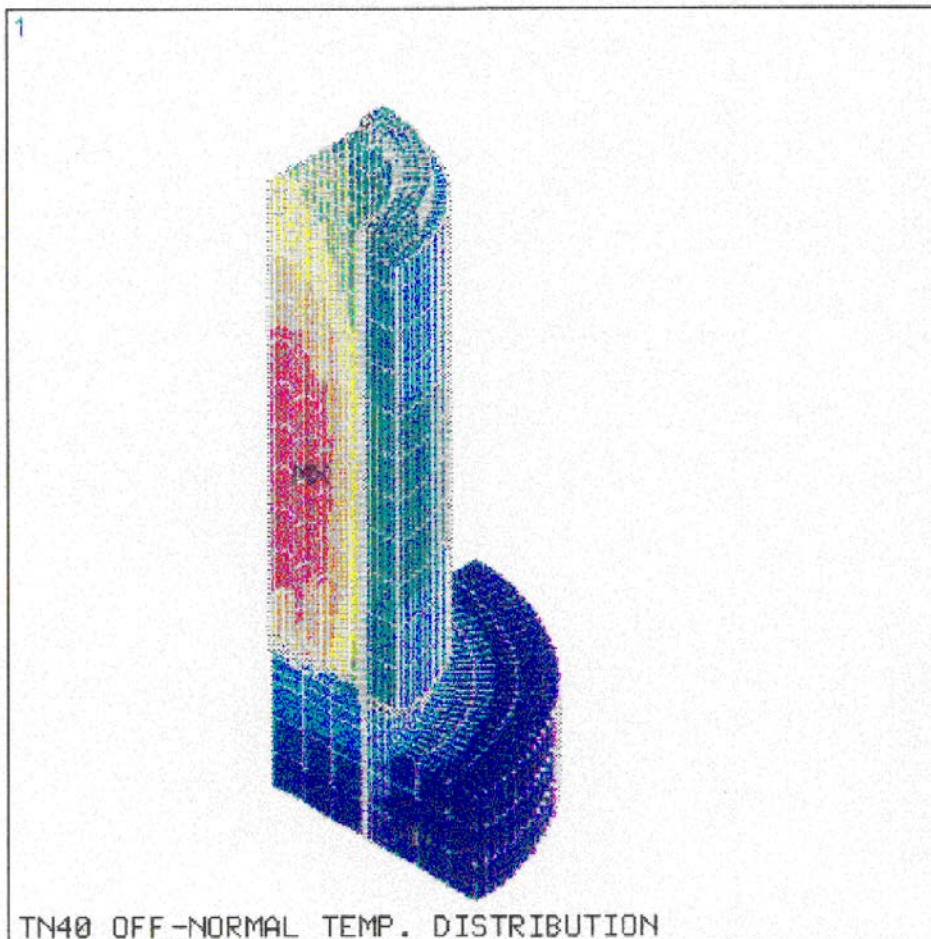

ANSYS 4.4A
MAR 19 1992
33:53:43
PLOT NO. 1
POST1 STRESS
STEP=1
ITER=5
TEMP
SMN =70
SMX =536.746

XU =1
YU =-1
ZU =1
DIST=130.568
XF =40.75
YF =40.75
ZF =68.625
ANGZ=-60
CENTROID HIDDEN
70
121.861
173.721
225.582
277.443
329.304
381.164
433.025
484.886
536.746

Figure 3.3-9
TN-40 CASK TEMPERATURE
DISTRIBUTION OFF NORMAL
CONDITIONS

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

TN-40 CASK TEMPERATURE DISTRIBUTION OFF NORMAL CONDITIONS


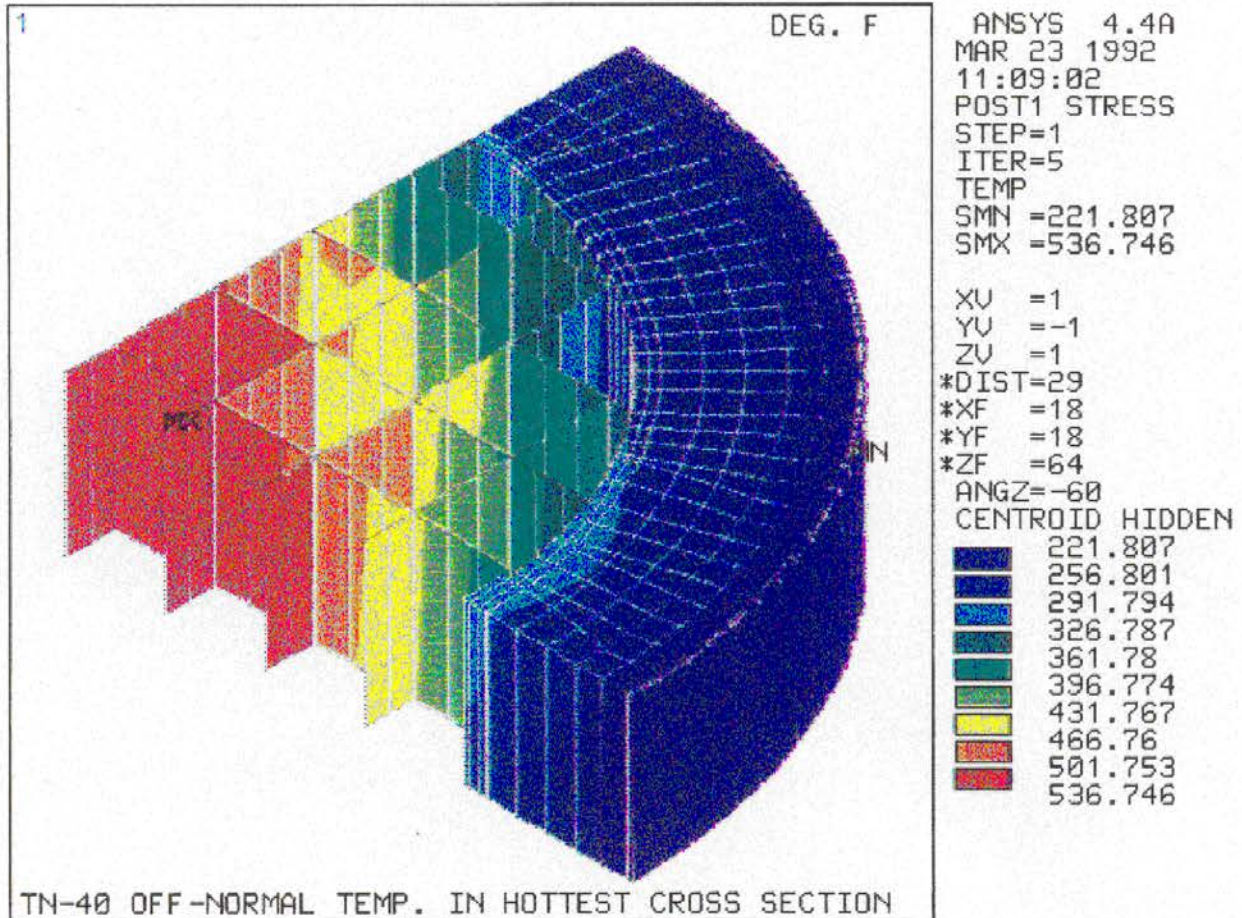


Figure 3.3-10
TN-40 CASK TEMPERATURE
DISTRIBUTION - HOTTEST
CROSS-SECTION

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

Rev 3 4/94

TN-40 CASK TEMPERATURE DISTRIBUTION - HOTTEST CROSS - SECTION

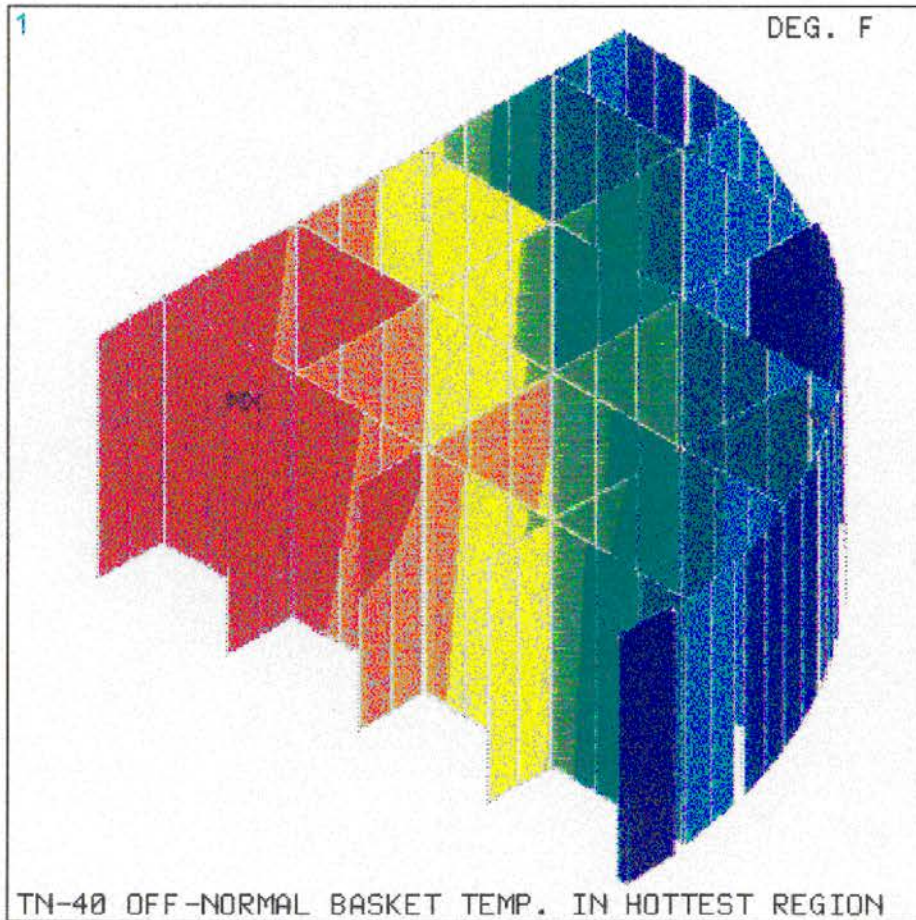

ANSYS 4.4A
 MAR 23 1992
 11:41:44
 POST1 STRESS
 STEP=1
 ITER=5
 TEMP
 SMN =275.218
 SMX =536.746

 XU =1
 YU =-1
 ZU =1
 *DIST=22
 *XF =13
 *YF =12
 *ZF =64
 ANGZ=-60
 CENTROID HIDDEN
 275.218
 304.277
 333.335
 362.394
 391.453
 420.512
 449.57
 478.629
 507.688
 536.746

Figure 3.3-11
TN-40 BASKET SECTION
TEMPERATURE DISTRIBUTION -
HOTTEST REGION

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

TN-40 BASKET SECTION TEMPERATURE DISTRIBUTION - HOTTEST REGION

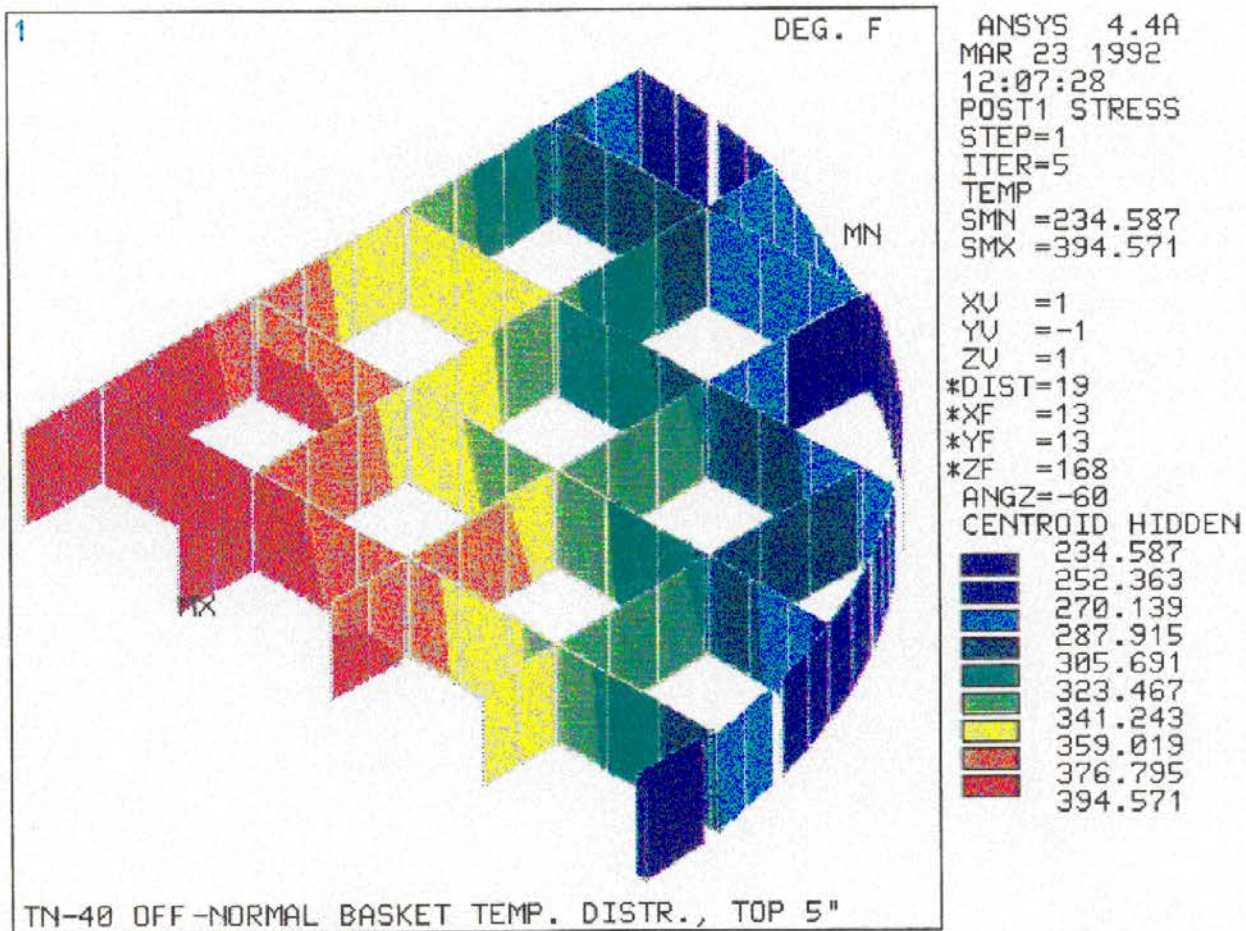


Figure 3.3-12
TN-40 BASKET TEMPERATURE
DISTRIBUTION-TOP 5 INCHES

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

TN-40 BASKET SECTION TEMPERATURE DISTRIBUTION - TOP 5 INCHES


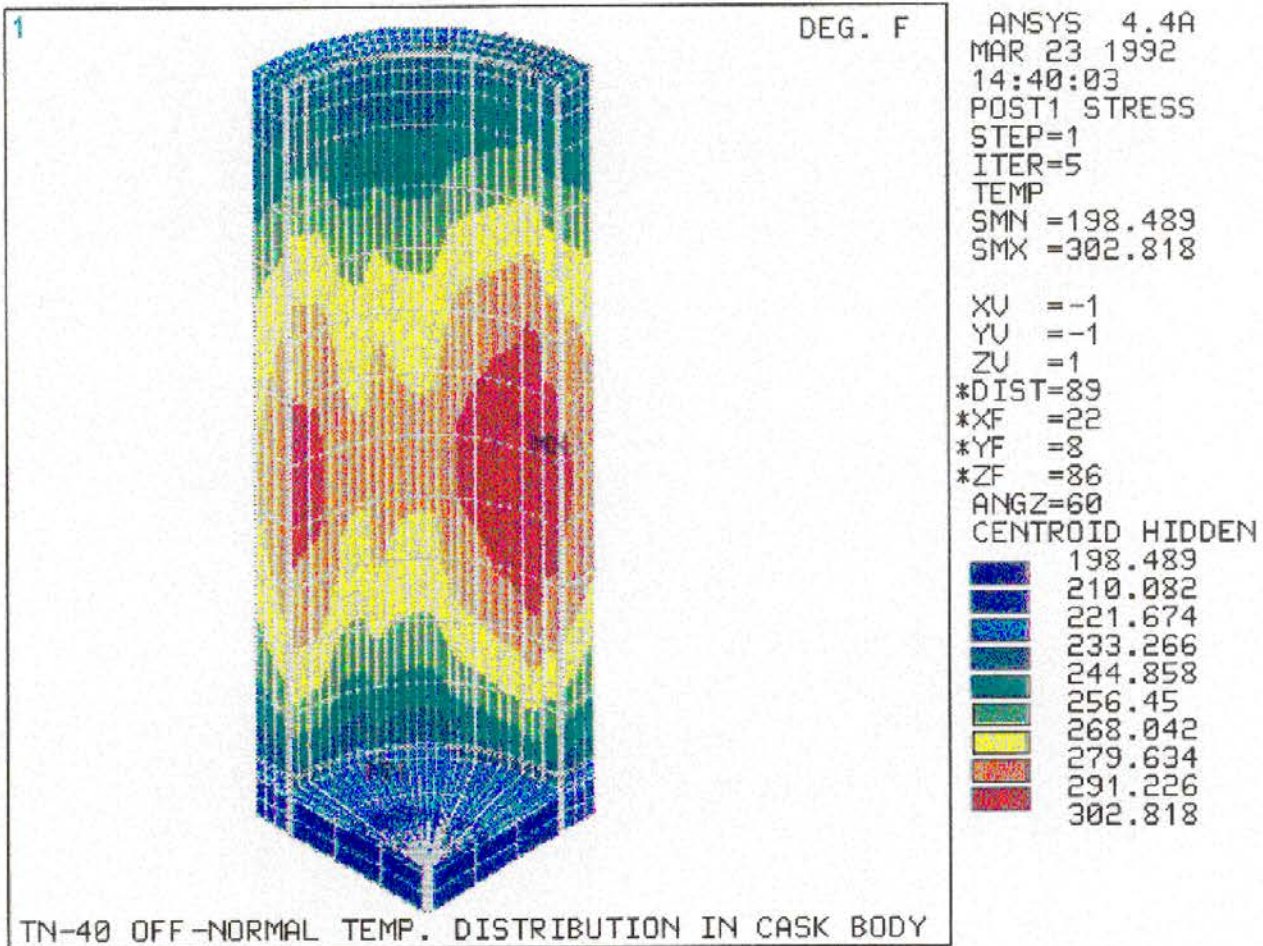


Figure 3.3-13
TN-40 CASK BODY
TEMPERATURE DISTRIBUTION

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

TN-40 CASK BODY TEMPERATURE DISTRIBUTION

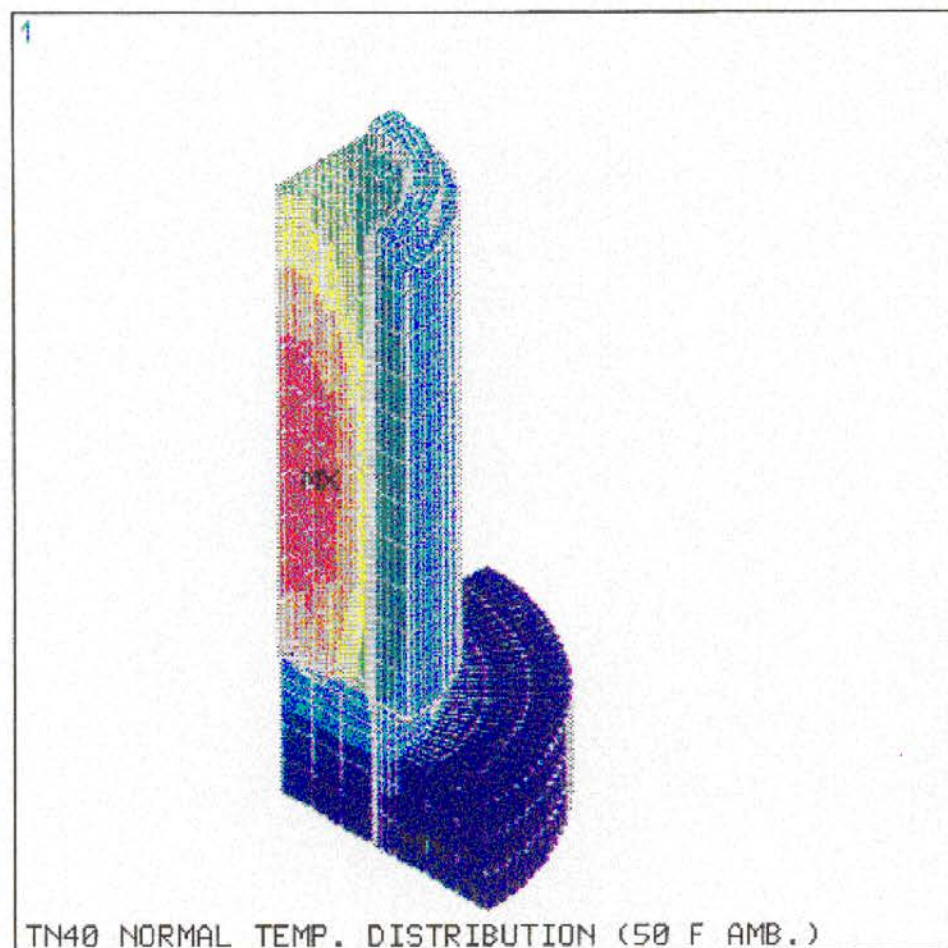


ANSYS 4.4A
MAR 28 1992
35:25:31
PLOT NO. 1
POST1 STRESS
STEP=1
ITER=5
TEMP
SMN =50
SMX =495.769

XU =1
YU =-1
ZU =1
DIST=130.568
XF =40.75
YF =40.75
ZF =68.625
ANGZ=-60
CENTROID HIDDEN
50
99.53
149.06
198.59
248.119
297.649
347.179
396.709
446.239
495.769

Figure 3.3-14
TN-40 CASK TEMPERATURE
DISTRIBUTION NORMAL CONDITIONS
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

TN-40 CASK BODY TEMPERATURE DISTRIBUTION NORMAL CONDITIONS

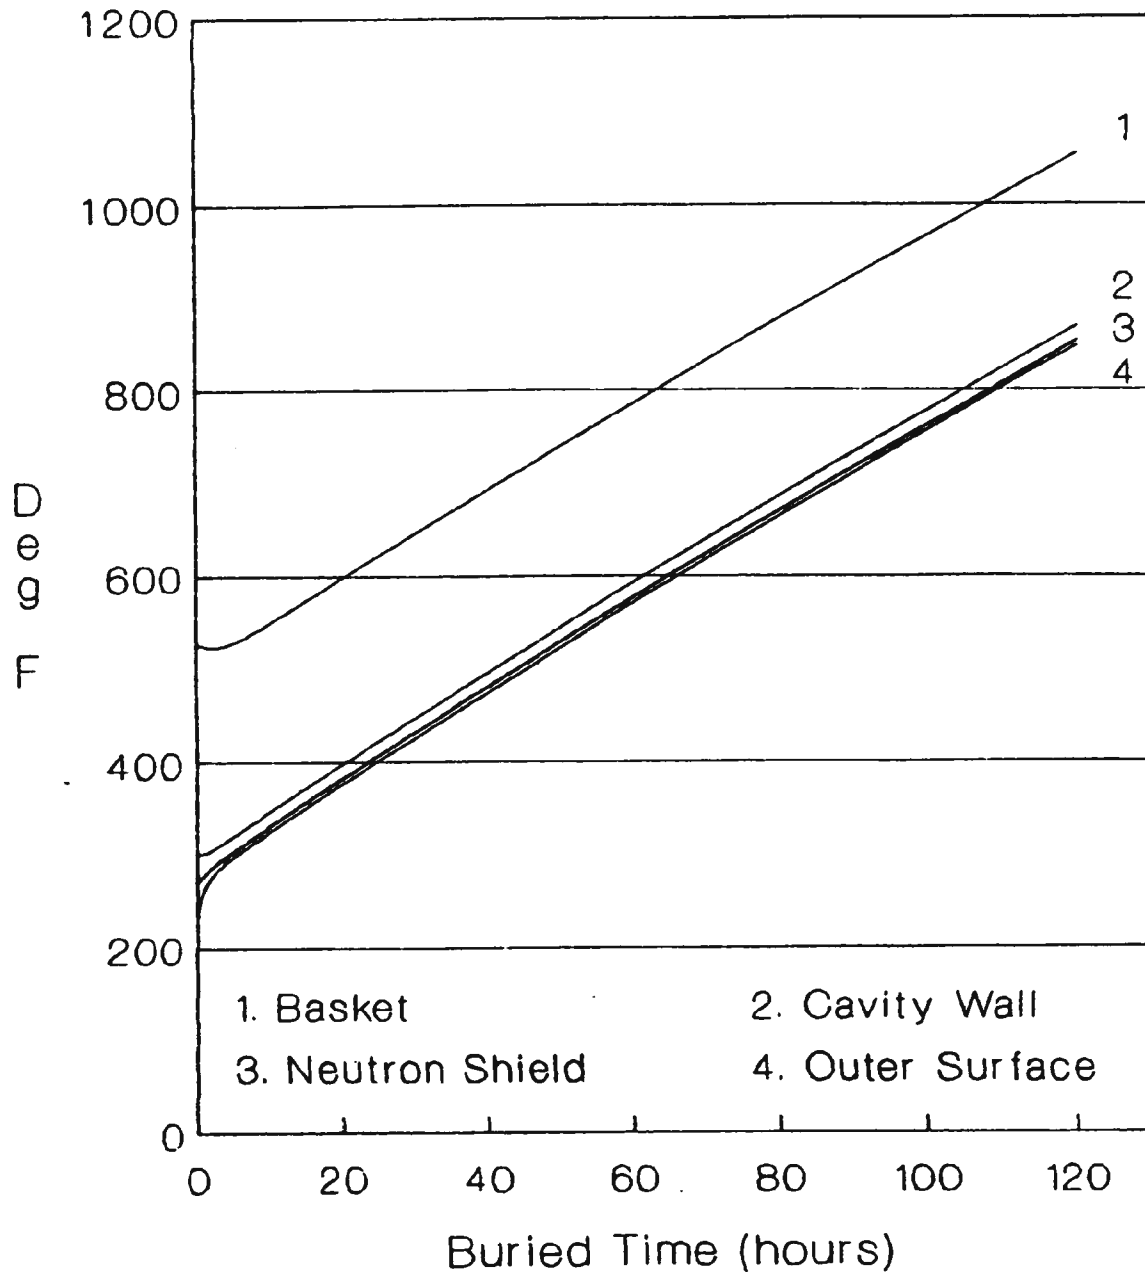


Rev. 0 8/90

Figure 3.3-15
BURIED CASK TEMPERATURE
RESPONSE (TN-40 CASK)

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

BURIED CASK TEMPERATURE RESPONSE (TN-40 CASK)

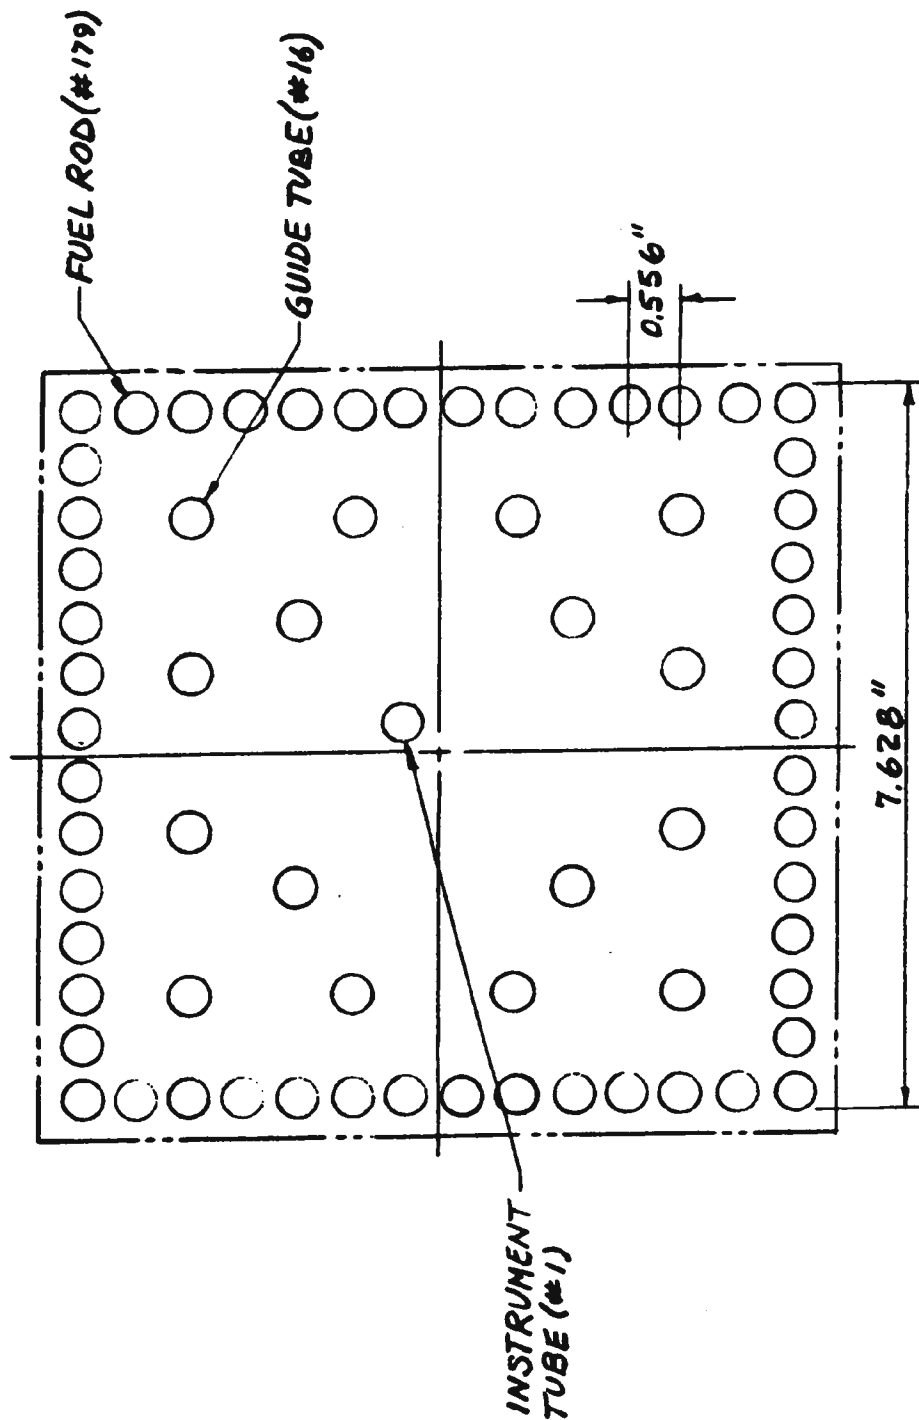

Rev. 0 8/90

Figure 3.3-16
KENO V.A. FUEL
ASSEMBLY MODEL
 PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

KENO V.A. FUEL ASSEMBLY MODEL

NORTHERN STATES POWER COMPANY

 PRAIRIE ISLAND NUCLEAR GENERATING PLANT
 RED WING, MINNESOTA

DRAWN BY: **VLS**

REVISION: **0**

PAGE. NO.

DATE: **04-3-06**

FIG3.3-16_REV_0

Security-Related Information Figure Withheld Under 10 CFR 2.390.

Rev 3 4/94

Figure 3.3-17
KENO V.A. CASK MODEL
(TN-40 CASK)
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

KENO V.A. CASK MODEL (TN-40 CASK)

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY: VLS

REVISION: 3

PAGE. NO.

DATE: 04-4-06

FIG3.3-17_REV_3

Security-Related Information Figure Withheld Under 10 CFR 2.390.

Rev. 0 8/90

Figure 3.3-18 **BENCHMARK FUEL RODS**

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

BENCHMARK FUEL RODS

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY: **VLS**

REVISION: **0**

PAGE. NO.

DATE: 04-4-06

FIG3.3-18_REV_0

Security-Related Information Figure Withheld Under 10 CFR 2.390.

Rev. 0 8/90

Figure 3.3-19
BENCHMARK EXPERIMENT

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

BENCHMARK EXPERIMENT

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
FED. WIND, MINNESOTA

| | | | |
|-----------|-----|-----------|---------|
| DRAWN BY: | VLS | REVISION: | 0 |
| PAGE NO. | | DATE: | 04-4-06 |

FIG3.3-19_REV_0

Security-Related Information Figure
Withheld Under 10 CFR 2.390.


Rev 3 4/94

Figure 3.3-20

TN-40 LID SEAL THERMAL MODEL

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

TN-40 LID SEAL THERMAL MODEL

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA


DRAWN BY: **VLS**

REVISION: **3**

PAGE. NO.

DATE: 04-4-06

FIG3.3-20_REV_3

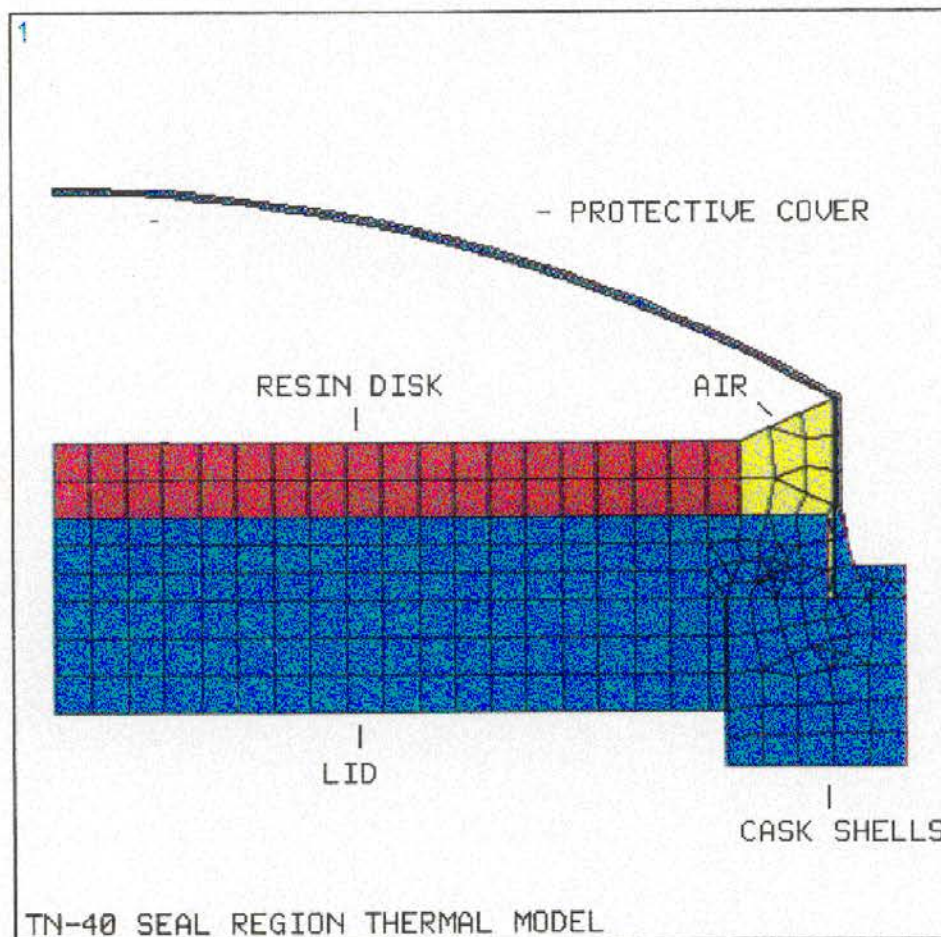

ANSYS 4.4A
NOV 8 1991
15:13:13
PREP7 ELEMENTS
MAT NUM

ZU =1
DIST=25.025
XF =22.75
YF =15.69

Figure 3.3-21
**TN-40 LID SEAL REGION FINITE
ELEMENT THERMAL MODEL**

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

TN-40 LID SEAL REGION FINITE ELEMENT THERMAL MODEL

ISFSI SAR

APPENDIX 3A

TN-40 CASK
CRITICALITY EVALUATION
COMPUTER INPUT

PROPRIETARY

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

81110610

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

SECTION 4

STORAGE SYSTEM

4.1 LOCATION AND LAYOUT

The location of the ISFSI site and the transport route of the casks from the Auxiliary Building to the site are shown in Figure 1.2-1. In addition, the map shows other facilities on the power plant site in the vicinity of the ISFSI site, such as roadways and railroad lines. The ISFSI and the entire transport route are within the Prairie Island Nuclear Generating Plant exclusion area.

The ISFSI, along with appurtenant facilities and equipment, is designed to interface with existing equipment and systems at the Prairie Island Nuclear Generating Plant. The Prairie Island USAR (Reference 1) provides a description of existing systems and equipment.

Roadways, buried pipes, and trenches have been designed or determined to be acceptable for the wheel loadings of the cask transport vehicle.

THIS PAGE IS LEFT INTENTIONALLY BLANK

SAFETY ANALYSIS REPORT

Revision: 12

Page 4.2-1

4.2 STORAGE SITE

The ISFSI is designed in accordance with the General Design Criteria set forth in 10CFR72(F). Table 4.2-1 summarizes compliance with these criteria. Additional details are provided below.

4.2.1 STRUCTURES

The operational area of the ISFSI consists of two concrete pads and the surrounding compacted gravel area. Figure 4.2-1 shows the concrete storage pad plan, cross section, and details.

The primary function of the concrete pads is to provide a uniform level surface for storing the casks. The "minimum" pad elevation criterion has been set at 693 ft.-0 in. msl to preclude immersion of the cask seals during the probable maximum flood. Actual pad elevation is 694 ft.-6 in. The gravel areas around the pads are compacted to allow for movement and positioning of the transport vehicle and tow vehicle.

Cask drop and tip accidents are analyzed in Section 8.2.8. This analysis establishes that the TN-40 casks can maintain their integrity in the event of impact onto the concrete pad. The cask analysis was performed using the following nominal soil and concrete parameters generated by Transnuclear Incorporated utilizing Reference 15:

| | |
|-------------------------------|--|
| Overall Pad thickness | 36 inches |
| Reinforcement | No. 14 bars top and bottom, two way with 1 bar each 12 in., with a 2 in. cover with $E = 30 \times 10^6$ psi and yield stress = 60,000 psi |
| Concrete Elastic Modulus | 3.6×10^6 psi |
| Concrete Compressive Strength | 4,000 psi |
| Concrete Cracking Strength | 400 psi |
| Concrete Poisson's Ratio | 0.17 |
| Soil Elastic Modulus | 30,000 psi |
| Soil Strength | 300 psi |

SAFETY ANALYSIS REPORT

Revision: 12

Page 4.2-2

The concrete is designed for a nominal compressive strength of 3,000 psi at 28 days. Testing was performed in accordance with requirements specified in ASTM C31 (Reference 2) and ASTM C39 (Reference 3). The design of the concrete pads includes the following loads identified in Section 6.17.1 of ANSI/ANS-57.9 (Reference 5):

| | |
|------------------------------|--|
| Dead Load (<i>D</i>): | Dead load of the structure and attachments. |
| Live Load (<i>L</i>) | Live loads including snow and operational loads. |
| Earthquake Load (<i>E</i>) | Loads generated by the ISFSI design earthquake. |
| Wind Load (<i>W</i>) | Loads generated by the design wind. |
| Flood Loads (<i>F</i>) | Loads resulting from maximum hypothetical flood including buoyancy and dynamic pressure. |

The design of the concrete pads includes the following load combinations identified in Section 6.17.2.1 of ANSI/ANS-57.9:

$$U_c > 1.4D + 1.7L$$

$$U_c > 0.75 (1.4D + 1.7L + 1.7W)$$

$$U_c > D + L + E$$

$$U_c > D + L + F$$

where U_c = available concrete strength

The factor of safety against overturning and sliding is based on Section 6.17.4.1 of ANSI/ANS-57.9 as modified below:

| | <u>Minimum Safety Factors</u> | |
|--------------------------|-------------------------------|----------------|
| <u>Load Combinations</u> | <u>Overturning</u> | <u>Sliding</u> |
| $D+L+E$ | 1.1 | 1.1 |
| $D+L+W$ | 1.1 | 1.1 |
| $D+L+F$ | 1.5 | 1.5 |

SAFETY ANALYSIS REPORT

Revision: 12

Page 4.2-3

The concrete pad was analyzed using Images-3D (Reference 6) which is a finite element computer program. The analysis was performed to verify that the strength of the pad was adequate to prevent unacceptable cracking or differential settlement and that the casks would not tip under design loads. A 9x49 array, or a total of 441 nodes was used. The lines connecting the nodes define 384 elements of the model. Three construction joints were modeled by designating separate but coincident nodes. Node numbers 109-117 are coincident with nodes 442-450, nodes 217-225 are coincident with nodes 451-459, and nodes 325-333 are coincident with nodes 460-468 and correspond to the locations of the construction joints (See Figure 4.2-1a).

Translational springs with an arbitrary stiffness of 50,000 kips/ft. in the three orthogonal directions were used to connect these coincident nodes. This allows the model to rotate at this interface, but not translate.

Vertical translation springs were placed to model the soil stiffness. Horizontal translation springs were modeled in each direction at the corners. These horizontal springs see no forces but were included to provide numerical stability. Rotational springs were also modeled at the center of each of the four segments of the model. These springs were also included to provide numerical stability and see no forces.

4.2.1.1 STATIC ANALYSIS

Soil springs for the static model were calculated assuming a settlement of 1.5 inches over an area of 18 ft. x 18 ft. due to a 240.7 kip cask load (Reference 17). This unit area spring was then scaled on a node by node basis as a function of its tributary area.

The worst case loading pattern that produces maximum stress in the concrete pad was determined. The maximum stress occurs with the casks at positions 3-20.

In addition to cask loads, loads representing the transport vehicle were placed on nodes 46, 50, 64, and 68. At positions where casks are located, the 240.7 kip cask weight was split between the node directly beneath the cask and the four adjacent nodes. A live load factor of 1.7 was applied, giving a resulting load of 81.8 kips per node. The transport vehicle weight was assumed to total 150 kips. A live load factor of 1.7 was applied, giving a resultant load of 63.8 kips per node.

The maximum tensile or compressive stress in the mat was calculated using the above loads to be 86.1 kips/ft². Since all of the stress is induced by bending (no in-plane forces), these values may be used to calculate the maximum moment in the mat. Since ultimate load factors were used in the loading, these represent ultimate moments.

The ultimate moment capacity of the slab was calculated to be 276 ft.-kips. The actual moment calculated from the maximum stress was determined to be 129 ft.-kips, which therefore is within the capacity of the pad.

4.2.1.2 DYNAMIC ANALYSIS

A dynamic analysis was performed to determine stresses and to consider cask overturning due to seismic response to the ISFSI design earthquake. The model used the same geometry and connectivity as used in the static analysis. A set of soil springs calculated to model the dynamic soil-structure interaction was substituted for the static springs.

Lumped dynamic soil springs for a rigid rectangular footing were calculated in accordance with Reference 7. Values for the following were determined for both the normal condition (pad above water table) and the flood condition (pad below water table):

Vertical spring constant (K_z)

Sliding spring constant (K_x)

Rocking spring constant (K_ψ)

Torsional spring constant (K_Θ)

Results are shown on Table 4.2-2. These lumped spring constants were then apportioned to the various nodes as a function of tributary area. The soil springs for the dry condition controlled the design, since they provided the least stiffness.

Members representing the casks were modeled from the center of gravity of the cask to a point directly below on the mat. Accelerations and forces were calculated based upon the response spectra for the ISFSI design earthquake.

The analysis utilized the seismic response spectra specified in Figure 2.5-8 considering a 5% damping ratio for the soil.

Three modal spectral analyses were performed, using three, five, and eight modes, to determine the sensitivity of acceleration response to the number of modes. Analyses showed that the use of five modes would give a good approximation. Five modes were therefore used for dynamic analyses.

The maximum stresses on the pad due to dynamic loading were calculated for three cases to observe the relationship between stress and cask positioning. The results of these analyses demonstrate that the worst case is when there is a single cask. The maximum stress was calculated to be 24.1 kips/ft².

The total stress resulting from the addition of dynamic seismic plus maximum unfactored static ($86.1 \text{ kips/ft}^2 \div 1.7 \text{ load factor} = 50.6 \text{ kips/ft}^2$) stress equaled 74.7 kips/ft². Since the total combined stress (D + L + E) was less than the ultimate static stress ($1.4D + 1.7L$) of 86.1 kips/ft², it was concluded that ultimate static stresses governed the design, and dynamic seismic load combinations need not be considered further.

The springs 450 to 530 in the model represent the joints between the segments of the slab. To design the shear dowels between these segments, the maximum force in the springs for various loading conditions was determined. The maximum shear force was 88.6 kips at spring 452.

The tributary width of spring 452 is 2.604 ft., so maximum shear force at spring 452 is 34.0 kips/ft. The shear stress is resisted by reinforcing steel dowels across the joint.

The dynamic stability of the cask was determined from the results of the dynamic analysis. The cask overturning moment resulting from accelerations calculated using five modes was determined and compared to the restoring moment resulting from cask weight. The factor of safety is the ratio of the restoring moment to the overturning moment. Various cask storage configurations were analyzed. The minimum factor of safety for overturning, which resulted from the storage of a single cask on a pad, was determined to be 1.35. The minimum factor of safety for sliding was calculated to be 1.14.

01145327

4.2.2 STORAGE SITE LAYOUT

The overall layout of the ISFSI is shown on Figure 1.3-1. Engineering drawings showing sections and details of the concrete pads are presented on Figure 4.2-1.

Confinement of radioactivity is accomplished solely by the storage casks and is not dependent upon the particular layout of the installation. Therefore, other than the casks themselves, no confinement features are provided at the ISFSI.

4.2.3 STORAGE CASK DESCRIPTION

This section summarizes the structural analysis of the TN-40 storage cask. For purposes of structural analysis the cask has been divided into four components: the cask body (consisting of containment vessel and gamma shielding), the basket, the trunnions and the neutron shield outer shell. The following information is provided: a brief description of the components, the design bases and criteria, the method of analysis, a summary of stresses for the highest stressed locations, and a comparison with the allowable stress criteria.

4.2.3.1 DESIGN BASIS**4.2.3.1.1 CASK BODY**

The cask body is described in detail in Section 1.3. Figures 1.3-2, 1.3-3, and 1.3-4 show the cask body. The containment shell and lid materials are SA-203 Grade D, or SA-203 Grade E and SA-350 Grade LF3, respectively. The gamma shielding is SA-105 (Table 1.3-2 for alternates). The TN-40 cask body is designed, fabricated, examined and tested in accordance with the requirements of Subsection NB of the ASME Code (Reference 8) to the maximum practical extent. The containment boundary, which consists of the inner shell and bottom plate, shell flange, lid outer plate, lid bolts, penetration cover plates and bolts, is of particular interest. The containment boundary welds are full penetration welds examined volumetrically by radiograph. These welds are also magnetic particle or liquid penetrant examined. The acceptance standards are in accordance with Article NB-5000.

The welds between the gamma shield forgings are volumetrically examined by ultrasonic or gamma x-ray techniques to verify shielding continuity. Other structural and structural attachment welds are examined by the magnetic particle or liquid penetrant method in accordance with Section V, Article 6 or 7 of the ASME Code.

Acceptance standards are in accordance with Section III, Subsection NB, Paragraph NB-5340 or NB-5350. Seal welds are examined visually and by liquid penetrant or magnetic particle methods in accordance with Section V of the ASME Code. Stainless steel overlay welds are examined by the liquid penetrant method in accordance with Section V of the ASME Code.

Electrodes, wire, and fluxes used for fabrication must comply with the applicable requirements of the ASME Code, Section II, Part C. The welding procedures, welders and weld operators must be qualified in accordance with Paragraph NB-4300 of Subsection NB.

4.2.3.1.2 BASKET

The basket structure consists of an assembly of square 304 stainless steel fuel compartment boxes or cells attached together using cylindrical plugs welded to the walls of adjacent boxes. Trapped between the adjacent boxes are two layers of 6061-T6 aluminum which surround a layer of boral. The stainless steel boxes and plugs effectively clamp and pin the aluminum thermal conductor plates and boral poison plates in place. The plugs are assembled through clearance holes in the aluminum and boral plates and are only welded to the stainless steel boxes. Additional curved aluminum plates formed to the cask cavity curvature are welded to the tips of the thermal conductor plates at the periphery of the basket. Figures 1.3-6 and 1.3-7 show details of the basket.

The basket is supported tangentially by 6061-T6 aluminum rails (shown in Figure 1.3-3) bolted to SA-203 inserts welded to the containment shell

4.2.3.1.3 TRUNNIONS

The trunnions are cylindrical SA-105 or SA-266 forgings that are groove welded to the cask body gamma shielding. The two upper trunnions are designed to lift the loaded TN-40 cask vertically. The lower trunnions provide capability to rotate the cask prior to loading of spent fuel. The trunnions are designed to meet the requirements of ANSI N14.6 (Reference 9). The trunnions are shown in Figure 1.3-3.

4.2.3.1.4 OUTER SHELL

The outer shell of the neutron shield consists of a cylindrical shell section with segmented closure plates at each end. Each segmented closure plate is welded together. The top and bottom closure plates are welded to the outer surface of the cask body gamma shielding. The outer shell provides an enclosure for the resin-filled aluminum containers and maintains the resin in the proper location with respect to the active length of the fuel assemblies in the cask cavity. The outer shell has no other structural function. The shell is carbon steel protected by a metallic coating and paint.

01136263

4.2.3.1.5 TOP NEUTRON SHIELD

The top neutron shield consists of a disc of commercial grade polypropylene surrounded by a steel enclosure. The top neutron shield is attached to and rests on the cask lid. It is protected from the environment by the protective cover.

4.2.3.2 INDIVIDUAL LOAD CASES

This section outlines the TN-40 analyses performed under the various loading conditions identified in Section 3.2. These loadings include all of the normal events that are expected to occur regularly. In addition, they include severe natural phenomena and man-induced low probability events postulated because of their potential impact on the immediate environs.

Section 3.2.5 lists all of the TN-40 loadings in Table 3.2-5. These loads are described in detail in Section 3.2.5.2. The loads selected for analysis of the cask are discussed in Section 3.2.5.3. Numerical values of these loads are listed in Tables 3.2-1 through 3.2-4.

The TN-40 components have been evaluated under these loads through numerical analysis. Finite element models of the cask body and basket have been developed, and detailed computer analyses have been performed using the ANSYS computer program (Reference 10). Other components such as the lid bolts and trunnions have been analyzed using conventional textbook methods. Table 4.2-3 lists the specific individual load cases analyzed for each major TN-40 component. The SAR sections where these analyses are described and the tables listing the stress results, where applicable, are also indicated. Note that the combined results of these analyses and their evaluation to the structural criteria of Section 4.2.3.3 below are summarized in Section 4.2.3.4.

4.2.3.3 STRUCTURAL DESIGN CRITERIA

This section describes the structural design criteria for the major components of the TN-40 storage cask. The cask consists of four major types of components:

- Containment Boundary
- Non-containment Structure
- Basket
- Trunnions

The structural design criteria for these components are described below:

4.2.3.3.1 CONTAINMENT BOUNDARY

The containment vessel consists of the cask body assembly inner shell (both cylinder and bottom) and closure flange out to the seal seating surface and the lid assembly outer plate. The lid bolts and seals are also part of the containment boundary. The containment boundary is designed to the maximum practical extent as an ASME Class I component in accordance with the rules of the ASME Code, Section III, Subsection NB. The Subsection NB rules for materials, design, fabrication and examination are applied to all of the above components to the maximum practical extent.

The stresses due to each load are categorized as to the type of stress induced, e.g. membrane, bending, etc., and the classification of stress, e.g. primary, secondary, etc., determined. Stress limits for containment vessel components, other than bolts, for Design (same as Primary Service) and Level A and D Service Loading Conditions are given in Table 4.2-4. The stress limits used for Level D conditions, determined on an elastic basis, are based on the entire structure (containment shell and gamma shielding material) resisting the accident load. Local yielding is permitted at the point of contact where the load is applied. If elastic stress limits cannot be met, the plastic system analysis approach and acceptance criteria of Appendix F of Section III may be used. The limits for the containment bolts are listed in Table 4.2-5.

The allowable stress intensity value, S_m , as defined by the Code are taken at the temperature calculated for each service load condition.

4.2.3.3.2 NON-CONTAINMENT STRUCTURES

Certain components such as the gamma shielding, the neutron shield outer shell and the trunnions are not part of the cask containment boundary but do have structural functions. These components, referred to as non-containment structures, do not have containment functions but are required to react the containment loads and in some cases share loadings with the containment structure. The design criteria for the trunnions are both unique and specific. They are specified in Section 3.2.5.4. The stress limits for the remaining non-containment structures are given in Table 4.2-6. These limits are somewhat less restrictive than those specified in Table 4.2-4 for the containment vessel.

4.2.3.3.3 BASKET

The stress limits for the basket are summarized in Table 4.2-6a.

The basket structural design criteria for a hypothetical impact accident are developed in Section 4B.5 of the Basket Analysis Appendix 4B. They are summarized here.

The basket fuel compartment wall thickness is established to meet heat transfer, nuclear criticality, and structural requirements. The basket structure must provide sufficient rigidity to maintain a subcritical configuration under the applied loads. The primary stress analysis of the basket for sustained Design and Level A Service Conditions does not take credit for the aluminum conductor plates except for through thickness compression. The aluminum is, however, considered when determining secondary stresses in the stainless steel.

The basis for the 304 stainless steel fuel compartment box stress allowables is Section III of the ASME Code. The primary membrane stress and primary membrane plus bending stress are limited to S_m (S_m is the code allowable stress intensity) and $1.5 S_m$, respectively, at any location in the basket for Design and Level A load combinations. The range of primary plus secondary stress is limited to $3 S_m$ for Level A combinations. This allows some local yielding of the basket structure. However, the thermal stresses are self-relieving and the deformation is insignificant. In addition, the thermal stress will decrease with time as the decay heat load decreases. The average primary shear stress across a section is limited to $0.6 S_m$.

The sustained Level D Service Conditions are actually elevated to Design Conditions and evaluated against Design Limits since the 3 g bounding loads are greater than any Level D loads.

See Appendix 4B for complete details of the criteria for the hypothetical drop impact accident.

SAFETY ANALYSIS REPORT

Revision: 12

Page 4.2-10

The hypothetical impact accident is evaluated as a short duration Level D condition. Since elastic quasistatic analyses are performed, the primary membrane stress is limited to $2.4 S_m$ and the membrane plus bending stress limited to $3.6 S_m$. The average primary shear stress across a section is limited to $0.42 S_u$ (S_u is the minimum ultimate strength).

Individual fuel compartment wall panels, when subjected to compressive loadings, are also evaluated against ASME Code rules for component supports and B96.1 (Reference 11) to ensure that buckling will not occur. The interaction between compression and bending was evaluated using the equations of paragraph NF-3322. These equations reduce to that below for members subjected to both axial compression and bending:

$$\frac{\text{Applied Comprehensive Load}}{\text{Allowable Comprehensive Load}} + \frac{\text{Applied Bending Moment}}{\text{Allowable Bending Moment}} \leq 1.0$$

See Appendix 4B for the development of the stability and interaction criteria.

4.2.3.4 EVALUATION

Section 4.2.3.2, above, lists the various individual load cases analyzed to evaluate the TN-40 storage cask in Table 4.2-3. The loads are described in detail in Section 3.2 and listed in Table 3.2-5. Section 3.2 also categorizes these loads for the cask body as indicated in Tables 3.2-6 through 3.2-8 into Design, Level A and Level D Service Loadings and lists the load combinations to be evaluated. Table 4.2-7 (identical to the load combination table in Section 3.2) repeats these load combinations. Each combination is a set of loads that is assumed to occur simultaneously. Note again, that all of the combinations that would be Level D cases, except those including tornado missile loads, have been elevated to Design Conditions. Note also that the hypothetical drop accident is analyzed and evaluated in Section 8.2.8.

4.2.3.4.1 CONTAINMENT VESSEL

All of the eight combinations listed in Table 4.2-7 have been performed in Appendix 4A for each of 20 cask body locations indicated in Figure 4.2-6 (8 of these are containment locations). Tables 4.2-8 and 4.2-9 list the highest containment shell, flange, and lid stress intensities for each service condition and identify the load combination and location where those maxima occur. Also listed in the tables are the stress limits for that service condition based on the Section 4.2.3.3 structural design criteria.

Note that the highest Design stress intensity is 13,865 psi ($P_I + P_b$), the highest Level A value is 22,132 psi ($P_I + P_b + Q$), and the highest Level D value is 47,425 psi ($P_I + P_b$). These values are well below the limits indicated. Therefore the stresses in the containment vessel are acceptable.

4.2.3.4.2 GAMMA SHIELDING

The eight load combinations for the 12 gamma shielding and weld locations indicated in Figure 4.2-6 have also been performed in Appendix 4A. Table 4.2-10 lists the highest cylinder, bottom and weld stress intensities for each service condition and identifies the load combination and location where those maxima occur.

The highest design stress intensity is 14,574 psi (P_m), the highest Level A value is 15,953 psi ($P_I + P_b + Q$) and the highest Level D value is 55,519 psi. These values are again below the limits indicated.

One case not included in these combinations is the stress caused by cold rain on a hot cask. A conservative analysis was performed as indicated in Appendix 4A to determine the resulting stresses. It was concluded that a stress range of 80,534 psi (Alternating stress of +28,432 psi) could occur each time the outer skin of the top of the gamma shielding is cooled. The ASME Code fatigue curves permit 22,000 cycles for this stress. Therefore this condition is acceptable. Note that the temperature and stress level in the containment vessel does not cycle.

4.2.3.4.3 LID BOLTS

The stress intensities in the lid bolts as calculated in Appendix 4A are summarized in Table 4.2-11. The highest Design value is 25,000 psi tension, and the combined Level A and Level D stress is 80,534 psi. These values are well below the allowables.

4.2.3.4.4 BASKET

Table 4.2-12 summarizes the stresses in the basket. The values listed are for the 304 stainless steel boxes and plug welds. The aluminum conductor plates and boron poison plates are assumed to have no load carrying capability, except through thickness compression between boxes, to react long duration primary loads.

It should be noted that Design and Level D stresses are identical since the basket is arbitrarily analyzed for a conservatively high 3 g bounding lateral load. No Level A or Level D TN-40 load produces such a high lateral acceleration. The highest primary stress is 6,056 psi ($P_I + P_b$) for that load and the lowest limit for Design Conditions is 25,700 psi. This limit is for the basket location at the highest temperature (530°F). The highest stress actually occurs at a lower temperature where the allowable is higher. See Section 4B.6.

SAFETY ANALYSIS REPORT

Revision: 12

Page 4.2-12

The aluminum conductor plates are assumed to have strength to apply differential expansion induced (thermal) secondary stresses to the stainless steel plates and plug welds. The highest Level A stress in the stainless boxes is 49,036 psi ($P_1 + P_b + Q$) and the indicated $3S_m$ limit is 51,000 psi. The highest weld primary plus secondary stress intensity is 50,902 psi, which meets the $3S_m$ indicated limit. Note that the ASME Code permits $3S_m$ to be exceeded in this case since thermal ratcheting and fatigue cannot occur. See Section 4B.6.

4.2.3.4.5 TRUNNIONS

The trunnion stresses are summarized in Tables 4.2-13 and 4.2-14. As required by ANSI N14.6, the trunnions are analyzed under a cask loading of 6 g and the stresses are shown to be below the trunnion yield strength of the material. Under a 10 g load the stresses are less than the ultimate strength

4.2.3.4.6 OUTER SHELL

The neutron shield outer shell stresses are summarized in Table 4.2-15. The shell stresses are highest when the cask is vertical and subjected to internal and handling loads. The shell is not analyzed under tornado missile loading, but it would undoubtedly be damaged by either Missile A or Missile B, as defined in Section 3.2.1.2. Radiological effects have been shown to be acceptable, as shown in Table 7A-4.

01136263

4.2.4 INSTRUMENTATION SYSTEM DESCRIPTION

No safety related instrumentation is required due to the passive nature of the ISFSI design.

4.3 TRANSPORT SYSTEM

4.3.1 FUNCTION

The function of the transport system is to move the loaded storage casks from the Auxiliary Building rail bay to the concrete pads in the ISFSI. The transport vehicle is capable of being towed over several different types of ground surfaces, including compacted gravel, concrete paving, and asphalt paving. The performance objectives of the transport system are to move the loaded cask in a vertical position in a manner which will preclude damage to the cask body and its internals and to any other safety or security related system or component which could be affected by cask transport. The transport vehicle shall be designed for a minimum of 100 fully-loaded one-way trips.

4.3.2 COMPONENTS

The transport vehicle is designed and fabricated by Ederer, Inc., of Seattle, Washington, based on the general design criteria discussed below. Figures 4.3-1 and 4.3-2 show side and plan views of the transport vehicle.

The Transport vehicle structural frame is fabricated of welded steel plates and shapes sized and connected as required by design stress analysis.

All transport vehicle powered functions are hydraulic. An electro-hydraulic power unit is located on the frame of the transport vehicle. When in operation, the power unit is connected with an outside electrical source at the Auxiliary Building or ISFSI. The power unit consists of a 480V, 3 phase motor coupled to a heavy duty pump. The pump supplies hydraulic fluid to operate the vehicle and cask hoist hydraulic functions. In the event of an electrical power failure, a means is provided at the power unit for lowering the cask. Between power supply locations, the hydraulic operating functions of the hoist are not required and the system is valved closed to prevent hoist movement.

The hoisting mechanism consists of a 'U' shaped steel lift beam with pivot pins at one end connected to the steel structural frame. The other end is raised and lowered by a 12 inch hydraulic cylinder. Lifting links for engagement of the upper cask trunnions are located near the mid-point of each side of the lift beam. The lift links move inward and outward on pins by means of hydraulic cylinders, and can be positioned independently to accommodate off-center positioning of the transport vehicle relative to the cask.

SAFETY ANALYSIS REPORT

Revision: 17

Page 4.3-2

The hydraulic cylinder used for cask lifting is a heavy duty design made of steel. Flow control valves are located on the outlet of the cylinders in order to restrict the flow of oil from the cylinders and control the rate of descent. The operating pressure of the cylinders is designed not to exceed 3,000 psi. The cylinders are equipped with lift cylinder locking valves which assure that the cask will not be accidentally lowered.

The transport vehicle and its cask load are carried on eight wheels. The wheels are arranged in four pairs. The two front pairs of wheels which are on the normal towing end of the vehicle are steerable and have a 30 ft. minimum turning radius. The front wheel pairs are steered by a tow bar and steering linkage from a separate tow vehicle.

A detachable dolly with two wheels can be coupled to the transport vehicle to allow towing in the reverse direction. The vehicle is towed into the Auxiliary Building in the reverse direction to avoid having to back up the vehicle. When in place, the dolly lifts the rear transport vehicle wheels off the ground to enable the dolly to steer the vehicle. The dolly cannot be used when the transport vehicle is loaded with a cask. A locking pin is used to lock the front wheel steering when towing the vehicle in reverse.

The rear wheels of the transport vehicle are designed to move inward and outward. The wheels must be moved inward (traveling position) to pass through the Auxiliary Building access door and moved outward (load/unload position) to provide clearance to load and unload the casks. Hydraulic jacking pads extend to the ground to raise the rear wheels and carry the vehicle weight when the wheels are moved to the required position. Overall transporter width is 13'-0" in the travel position and 19'-4" in the load/unload position.

The hydraulic cylinders for the jacking pads are fitted with restraint links which are used to engage the lower trunnions of the cask. The cask restraints ensure the cask remains secure while en route to the storage area.

Each of the four pairs of wheels have a parking and emergency brake disc assembly. The parking brakes are designed with springs which set the brakes when hydraulic pressure is released. The brakes must be pressurized by an operator to release and allow the vehicle to move. The parking brakes are also interlocked and must be set to enable lifting and lowering operations. The emergency brakes are dynamic brakes for use in the event the tow vehicle brakes fail. The emergency brakes are designed to gradually engage to minimize shock loads, and are manually engaged by emergency stop levers located on either side of the transport vehicle. The brake system is equipped with an accumulator which supplies hydraulic fluid pressure to operate the brakes when the vehicle is not connected to the outside power source. A manual hydraulic pump is provided to repressurize the accumulator if the pressure has dropped too low to release the parking brakes.

SAFETY ANALYSIS REPORT

Revision: 17

Page 4.3-3

A pendant control station is suspended from a swing arm at the rear of the transport vehicle allowing it to be positioned to either side of the vehicle. Controls include pump on-off, cask raise-lower, rear wheel jacking raise-lower, rear wheel travel-load/unload, cask lift links in-out, and front steering lock-unlock. The control station functions can only be operated when outside power is supplied to the vehicle.

The transport vehicle tires are designed to distribute the load and provide adequate mobility. Pneumatic rubber earthmover type tires are used. Tire pressure is maintained at a maximum of 100 psi to assure smooth travel on haul roads. The tires are filled with polyurethane foam to prevent tire deflation.

The transport vehicle travels over a cask transport route designed with a maximum ground slope of 2%. A maximum ground slope of 5% is considered in the design of the transporter structure, the cask restraints, and the disc brakes. New transport roads are designed for a CBR (California Bearing Ratio) of 80. Existing roads are paved with asphalt and have been tested for transport vehicle load acceptability.

The transport vehicle, loaded with cask, is designed for a maximum towing speed of 3 miles per hour and to remain dynamically stable at this speed.

The transport vehicle is equipped with eight perimeter marker lights and four overhead adjustable headlights for safety and/or night travel. The lights are powered from the tow vehicle electrical system.

4.3.3 DESIGN BASIS AND SAFETY ASSURANCE

The transport vehicle is designed to limit cask lift height to a maximum of 10 in. Hydraulic lock valves and rigid attachment of lugs to the trunnions maintain the lifting system integrity during transport of casks. Positive restraints prevent excessive cask motion during transport.

The transport vehicle design considers static, dynamic, and fatigue loads associated with the transport process. Load cases include:

Normal Loads: Loads on the vehicle with a maximum weight payload through all ranges of motion for each mechanism while the vehicle is stopped or braking on a 5% road grade, 2% road crown side slope, resultant tire deflection slope and 3.5" maximum cask shift from vehicle centerline.

Cyclic Loads: Loads produced by normal operation or by towing the vehicle over the roadway ridge where either an inside or outside front wheel and the diagonally opposite rear wheel are on the ridge (Figure 4.3-3 and 4.3-4). These loads are the bases for the fatigue load analysis.

Worst Case Loads: Loads produced by road conditions beyond those allowed by specification, but which must not produce vehicle failure. The worst case loading is assumed to occur when the vehicle is towed diagonally over the road ridge, as in the cyclic load case, where the ridge is elevated an additional 4" due to a bump (i.e. rock, wood, etc.) (Figure 4.3-5 and 4.3-6). The allowable stresses for the worst case loading is 90% of yield stress.

All hydraulic lifting and restraining cylinders are designed such that they will not fail when supporting a load equal to five times the cask weight. Structural design is in accordance with allowable stresses as set forth in AISC Manual of Steel Construction (Reference 12) or one-third of ultimate, whichever is more stringent.

4.3.4 DETERMINATION OF NATURAL FORCES ON A LOADED TRANSPORT VEHICLE

The time requirement necessary to move the casks from the plant to the storage facility is less than one day. This time space is so short that the probability a natural force caused by a tornado, flood or seismic event could occur while transferring a cask is extremely unlikely. However, the following sections are provided to quantify the effect of natural phenomena on the transporter loaded with a cask full of spent fuel assemblies, to show that a loaded transport vehicle tip over is not a credible event.

4.3.4.1 STABILITY OF A LOADED TRANSPORT VEHICLE UNDER TORNADO LOADING

Tornado loadings specified in Table 12.2-9 of the Prairie Island USAR (Reference 1) that were used are as follows:

- A lateral force caused by a funnel of wind having a peripheral tangential velocity of 300 mph and a forward progression of 60 mph.
- The design tornado driven missile assumed equivalent to an airborne 4" x 12" x 12'0" plank traveling end-on 300 mph, or a 4000 lb automobile flying through the air at 50 mph and not more than 25 ft above ground level.

4.3.4.1.1 WIND LOADING

The maximum wind loads are assumed to be the same as tornado loads. The maximum tornado wind is assumed to be 360 mph based on a summation of the peripheral tangential velocity and forward progression of a design basis tornado.

SAFETY ANALYSIS REPORT

Revision: 17

Page 4.3-5

Tornado winds may contact the transport vehicle from any direction. Since the vehicle is equipped with parking brakes which must be released by the operator to begin movement, it is assumed the vehicle will not roll due to the wind pressure. The maximum surface area is a loaded transport vehicle's side profile. In the case of tipping, wind pressure normal to the side profile also occurs in the same plane as the transport vehicle's minimum wheel base. Therefore, the side profile is used to analyze a tipping accident.

The transport vehicle is designed with a clearance of 3.5" between either side of the cask and the vehicle side members. In the tipping analysis, the cask is assumed to be located 3.5" off the transport vehicle centerline against the vehicle's side member. This "cask shift" is unlikely but is considered in order to be conservative.

The roadway used for transport is designed with only a 2% side slope (road crown) and the drainage embankments along the road maintain a slight 3 to 1 slope. Assuming the transport vehicle is traveling entirely to the side of the roadway centerline, additional loads due to the 2% side slope plus transport vehicle tilt caused by tire deflection from the cask shift and tornado wind loads are also considered. The transport vehicle loading conditions are shown on Figure 4.3-7.

A tornado wind velocity of 408 mph is required to cause the loaded transport vehicle to begin to tip. This velocity is calculated as follows:

The tipping moment about the bottom outside tire of the transport vehicle (pivot point P) is:

$$M_p = \left[\frac{b}{2} - x \right] W \cos \Theta - \frac{h}{2} A q - h_{cg} W \sin \Theta$$

where:

b = outside wheel base width = 130"

x = CG shift + road side slope offset + tire deflection offset

W = loaded transport vehicle weight

= 240,000 (cask) + 150,000 (transport vehicle) = 390,000 lbs.

Θ = vertical angle vehicle tilts due to tire deflection

h = overall vehicle height = 238"

A = projected area of loaded transport vehicle conservatively calculated as approximately 50,000 in²

q = wind pressure, psi

h_{cg} = height of loaded vehicle center of gravity = 104"

As the wind pressure increases, the transport vehicle will tend to tilt due to tire deflection. The vehicle has four front and rear sets of tires as shown on Figure 4.3-7. If the point of vehicle tip occurs when the windward side tire load becomes zero, indicating the tire is about to raise, then the relationship between the deflection of the four tire sets, which is linear, is expressed as:

$$d_2 = \frac{94.5}{130} d_1 \quad d_3 = \frac{35.5}{130} d_1 \quad d_4 = 0$$

SAFETY ANALYSIS REPORT

Revision: 17

Page 4.3-7

where d is tire deflection from the pivot point tire d_1 , to the tire without a load, d_4 .

The deflection spring constant for a single tire is 14,000 lbs/in (Reference 16) such that:

$$\text{tire load } (R) = 14,000d \times 2 \text{ (front + rear tires)}$$

Since $R_1 + R_2 + R_3 + R_4 = W = 390,000$ lbs and $R_4 = 0$ then deflections for the second and third set of tires can be substituted into the above equations to yield:

$$28,000d_1 + 28,000\frac{94.5}{130}d_1 + 28,000\frac{35.5}{130}d_1 = 390,000$$

or

$$d_1 = 7''$$

Considering the 3.5" cask shift, the mean center of gravity between the cask and the transport vehicle is shifted horizontally toward the pivot point (P) a distance:

$$h_{cg} = \frac{240,000(65 - 3.5) + 150,000(65)}{390,000} = 62.8''$$

Solving for the total offset (x) at the center of gravity:

$$x = (65 - 62.8) + .02(104) + 7(104/130) = 9.88''$$

The vehicle tilt angle is then, $\Theta = \text{Arctan } 9.88/104 = 5.43^\circ$

Therefore, solving for wind pressure (q):

$$\left[\frac{130}{2} - 9.88 \right] 390,000 \cos 5.43^\circ = \frac{238}{2} 50,000q + (104) 390,000 \sin 5.43^\circ$$

$$q = 2.95 \text{ psi} = 425 \text{ psf}$$

And the corresponding wind speed (v) required to tip the loaded transport vehicle is:

$$v = \sqrt{\frac{425}{0.002558}} = 408 \text{ mph}$$

Since $408 > 360$, the loaded transport vehicle will not tip as a result of the design tornado wind loads.

4.3.4.1.2 TORNADO MISSILE IMPACT

The 4,000 lb automobile traveling at 50 mph is more likely to tip the loaded transport vehicle than the airborne plank due to its higher initial momentum. The automobile impact with the transport vehicle is shown in Figure 4.3-7 and is placed at the top of the transport vehicle for maximum tipping potential.

The impact is assumed to be totally inelastic such that all kinetic energy from the airborne missile is transferred to the loaded transport vehicle into potential energy as the transport vehicle tips and the center of gravity lifts. It is also assumed that the transport vehicle components will retain structural integrity during missile impact. In the event a component, such as the hoist beam, fails, the cask will simply drop 10" to the ground. The cask is determined to be structurally sound in Section 8.2.8.2.2 for drops up to 18 inches.

Using the conservation of momentum, the transport vehicle angular velocity about point P (ω_p) is:

$$\omega_p = \frac{md_{cg}V_0}{m(d_{cg})^2} + I_p$$

where:

$$m = \text{mass of missile} = 4000/386 \text{ lbs} \cdot \text{sec}^2/\text{in}$$

$$d_{cg} = \text{distance between center of gravity and pivot point P (bottom outside tire centerline)}$$

$$V_0 = \text{initial velocity of missile} = 73 \text{ fps} = 876 \text{ in/sec}$$

$$I_p = \text{moment of inertia of loaded transport vehicle about pivot point P}$$

The distance d_{cg} from the loaded transporter center of gravity and pivot point P, is calculated from the CG height of 104" and horizontal mean distance of 62.8" as 121.5".

The moment of inertia of the cask about pivot point P is:

$$I_{p \text{ cask}} = m/12(3r^2 + l^2) + md_{cg}^2 \text{ cask}$$

SAFETY ANALYSIS REPORT

Revision: 17

Page 4.3-9

where:

$$m = \text{mass of cask} = 240,000/386 \text{ lb}\cdot\text{sec}^2/\text{in}$$

$$r = \text{radius of cask} = 45.5''$$

$$l = \text{length of cylinder} = 183.75''$$

$$d_{cg \text{ cask}} = \text{distance from cask center of gravity to pivot point P}$$

$$\begin{aligned} I_{p \text{ cask}} &= \frac{240,000}{386 \times 12} [3(45.5)^2 + (183.75)^2] + \frac{240,000}{386} [(92 + 10)^2 + (65 - 3.5)^2] \\ &= 10.89 \times 10^6 \text{ in}\cdot\text{lb}\cdot\text{sec}^2 \end{aligned}$$

The moment of inertia of the transport vehicle about pivot point P is:

$$I_{p \text{ transport vehicle}} = m/12 (h^2 + w^2) + m d_{cg \text{ transport vehicle}}^2$$

where:

$$m = \text{mass of transport vehicle} = 150,000/386 \text{ lb}\cdot\text{sec}^2/\text{in}$$

$$h = \text{height of transport vehicle (calculated as a rectangular}$$

$$\text{parallelepiped) is taken as twice the center of gravity height of } 107'' = 214''$$

$$w = \text{overall width of transport vehicle} = 156''$$

$$d_{cg \text{ transport vehicle}} = \text{distance from transport vehicle center of gravity to pivot point P}$$

$$\begin{aligned} I_{p \text{ transport vehicle}} &= \frac{150,000}{386 \times 12} [(214)^2 + (156)^2] + \frac{150,000}{386} [(107)^2 + (65)^2] \\ &= 8.36 \times 10^6 \text{ in}\cdot\text{lb}\cdot\text{sec}^2 \end{aligned}$$

$$\text{Total } I_p = 10.89 \times 10^6 + 8.36 \times 10^6 = 19.25 \times 10^6 \text{ in}\cdot\text{lb}\cdot\text{sec}^2$$

Therefore, the angular velocity (ω_p) about P is:

$$\omega_p = \frac{\frac{4,000}{386} (121.5)(876)}{\frac{4,000}{386} (121.5)^2 + 19.25 \times 10^6} = 0.06 \text{ rad / sec}$$

As the loaded transport vehicle tips about point P at impact, the kinetic energy is transferred to potential energy as the center of gravity rises a distance y :

$$E_{\text{tipping}} = \text{Kinetic Energy} = \text{Increase in Potential Energy}$$

$$= \frac{1}{2} I_p \omega_p^2 = Wy$$

$$= \frac{1}{2} (19.25 \times 10^6) (.06)^2 = 390,000y$$

$$y = 0.09''$$

Clearly, the effect of the airborne automobile impact on the loaded transport vehicle is negligible and will not tip over the transport vehicle.

4.3.4.2 FLOOD LEVEL

It is reasonable to assume that cask transportation will not be allowed during a potential flood occurrence. However, the transport vehicle will withstand loads from forces developed by the probable maximum flood including hydrostatic effects and dynamic phenomena. As determined in Section 3.2.2, the hydrostatic forces developed by a maximum flood on the cask were 20% less than the wind forces. It is therefore concluded that the hydrostatic forces against the transport vehicle are only a fraction of the wind forces and that the probable maximum flood will not cause the loaded transport vehicle to tip.

4.3.4.3 EARTHQUAKE

The transport vehicle is not designated a safety related component and therefore is not subject to specific seismic design requirements. However, this section provides the necessary evaluation based on the ISFSI design earthquake response spectra at the Prairie Island Nuclear Generating Plant ensuring that the loaded transport vehicle will not tip due to seismic loading.

The loaded transport vehicle is generally a flexible system with low frequencies which would probably not be excited due to the short duration of a seismic event. The rubber foam filled vehicle tires will tend to dampen any ground motions and minimize seismic loads such that the normal dynamic loads, due to vehicle travel, are assumed to be greater than potential seismic loads. The seismic loads would not be sufficient to result in a tip over of the transport vehicle containing a loaded cask. In the event a seismic load could cause vehicle failure, the cask would drop or lower to the ground as vehicle members fail or yield. The cask is determined to be structurally sound for drops up to 18 inches in Section 8.2.8.2.2.

SAFETY ANALYSIS REPORT

Revision: 17

Page 4.3-11

The loaded transport vehicle with its eight tires can be represented as a large mass supported by eight springs. Using the simple harmonic equation, the frequency of the loaded transport vehicle is:

$$f = \frac{\pi}{2} \sqrt{\frac{k}{m}}$$

where:

f = frequency of the loaded transport vehicle

k = spring constant of the tires = 14,000 lbs/inch/tire (Reference 16)

m = mass of loaded transport vehicle = 390,000/386 lb·sec²/in

so:

$$f = \frac{\pi}{2} \sqrt{\frac{14,000(8)396}{390,000}} = 1.7 \text{ cycles per second}$$

From the ground response spectra for the ISFSI design earthquake in Figure 2.5-8, the seismic acceleration can be determined. As mentioned above, the damping effects of the transport vehicle tires should be relatively high; however, 5% damping, which is the highest damping plotted on the spectra, is used to be conservative. For a frequency of 1.7 cycles per second at 5% damping, the response spectra yields a seismic acceleration of 0.14g.

Since the transport vehicle is rectangular, consider an earthquake in the worst case direction which is perpendicular to the minimum wheel base dimension. Calculating the tipping or overturning moment about pivot point P with the upward vertical acceleration as 2/3 horizontal, then:

$$M_p = 0 = gWv_{cg} + 2/3gWh_{cg} - Wh_{cg}$$

where:

g = acceleration value necessary to tip the transport vehicle

W = weight of loaded transport vehicle = 390,000 lbs

v_{cg} = vertical distance to center of gravity = 104"

h_{cg} = horizontal distance to center of gravity from pivot point P (from Section 4.3.4.1.1)
= 62.8"

SAFETY ANALYSIS REPORT

Revision: 17

Page 4.3-12

The overturning moment must also consider the 2% road side slope and the tire deflection caused by that slope which is 0.9% (Reference 16).

$$2\% + 0.9\% = 0.029 \quad \text{Arctan } 0.029 = 1.66^\circ$$

Therefore, the g value necessary to tip the loaded transport vehicle is:

$$g = \frac{62.8 \cos 1.66^\circ - 104 \sin 1.66^\circ}{104 + 2/3(62.8)} = 0.41$$

Since the acceleration necessary to tip the transport vehicle, 0.41g, is greater than the actual seismic acceleration of 0.14g, the loaded transport vehicle will not tip over.

4.4 OPERATING SYSTEMS

4.4.1 LOADING AND UNLOADING SYSTEMS

4.4.1.1 FUNCTION

The functions of the loading and unloading systems are to transfer the spent fuel from the spent fuel pool to the storage cask and move the storage cask from the spent fuel pool to the transport vehicle in the Auxiliary Building rail bay.

The performance objectives are to load the fuel into the casks in such a manner as to preclude damage to the fuel or criticality and to move the loaded cask in a manner which will preclude damage to the cask body and its internals and to any other safety related system or component in the load path.

4.4.1.2 MAJOR COMPONENTS AND OPERATING CHARACTERISTICS

The fuel storage area at Prairie Island Nuclear Generating Plant is located between the two reactor buildings, and consists of a new fuel pit, two pools for storing spent fuel, and a canal for transfer of fuel elements between the reactors and the pool. The two spent fuel storage pools are designated as Pool No. 1 and Pool No. 2. Pool No. 1, the smaller of the two pools, has inside plan dimensions of 18 ft.-11 in. x 18 ft.-3 in. Pool No. 2 has inside plan dimensions of 18 ft.-11 in. x 43 ft.-5 in. Normal water depth for both pools is about 40 ft. The southeast corner of Pool No. 1 is designated as the cask loading and unloading area. Five racks in Pool No. 1 could be used for fuel storage during loading of the spent fuel cask.

The spent fuel pool area is surrounded by a reinforced concrete enclosure. Access into the enclosure for the spent fuel cask is provided by a door and a narrow slot in the ceiling for attaching the spent fuel cask to the overhead Auxiliary Building crane which physically restricts cask movement to the north-south path over the cask set down area of Pool No. 1. Figure 4.4-1 is a layout drawing showing the cask load path between the spent fuel pool enclosure and the Auxiliary Building rail bay. Figure 4.4-2 and 4.4-3 are section views showing the cask load path.

4.4.1.3 SAFETY CONSIDERATION AND CONTROLS

Fuel handling activities in the spent fuel pool are subject to limiting conditions for operation as set forth in Section 3.7 of the Prairie Island Technical Specifications. A single-failure-proof crane was installed for cask handling in the spent fuel pool enclosure and Auxiliary Building rail bay. This crane and the fuel loading and cask handling is subject to conditions as set forth in the Prairie Island Technical Specifications and Operating License.

4.4.2 DECONTAMINATION SYSTEM

Standard decontamination methods will be used to remove surface contamination from the casks resulting from their submersion in the spent fuel pool during fuel loading. Decontamination of the casks will be performed in the cask decontamination area, located in the rail bay of the Auxiliary Building. Decontamination will be done manually, using water detergents and wiping cloths.

4.4.3 STORAGE CASK REPAIR AND MAINTENANCE

Maintenance on the casks can be performed as described in Section 5.1.3.3.

4.4.4 UTILITY SUPPLIES AND SYSTEMS

The storage casks are passive devices. No utility services are needed for operation of the casks.

4.4.5 OTHER SYSTEMS**4.4.5.1 ELECTRICAL SYSTEMS**

Non-safety related electrical power is provided to the ISFSI for lighting, general utility, and pressure monitoring instrumentation purposes. Electrical power is provided from a new pole mounted transformer and an existing overhead distribution line.

4.4.5.2 ALARM SYSTEM

Cask interseal pressure will be monitored. The pressure monitoring devices will provide an analog input signal to actuate alarm indication at a monitoring panel outside the ISFSI gate.

4.4.5.3 FIRE PROTECTION SYSTEM

No fires other than small electrical or tow vehicle fuel fires are considered credible at the ISFSI. Accordingly, only portable fire extinguishers are provided. Smoke detectors are installed in the ISFSI buildings to alert operators if a fire is started. The fire fighting equipment at the Prairie Island Nuclear Generating Plant is available, if needed.

4.4.5.4 VACUUM SYSTEMS

A Vacuum Drying System will be used to remove residual water left in the cask after it has been removed from the fuel pool and drained. The system applies vacuum at the vent port vaporizing any water present and sweeping the water out of the cask. The drying time is approximately 12 to 16 hours.

A Vacuum Backfill System will be used to replace air in the cask with helium. The system applies vacuum at the vent port and evacuates the cask cavity to 10 millibar. Once evacuated, the system backfills the cavity with dry helium gas.

THIS PAGE IS LEFT INTENTIONALLY BLANK

4.5 CLASSIFICATION OF STRUCTURES, SYSTEMS AND COMPONENTS

The structures, components and systems of the TN-40 Dry Storage Cask and storage facility are classified as Safety Related, Augmented Quality, or Non QA Related. A tabulation of the structures, components, and systems by their classification is shown in Table 4.5-1. The criteria for selecting the classification for particular structures, components, or systems, are based on the definitions given in QF-0202 (Reference 18)

Safety Related Item

Any structure, system or component that prevents or mitigates the consequences of postulated nuclear accidents that could cause undue risk to the health and safety of the public. Any component whose failure would produce radiation levels at the site boundary in excess of 10CFR100 limits is classified as safety related.

Augmented Quality

Augmented quality is a procurement classification for items or services which do not perform a safety related function, but are subject to special utility requirements or NRC imposed regulatory requirements. This includes items and services classified as non-safety QA related, fire protection related, 10CFR71 related, security related and other applicable site specific items and services. The difference between safety related and augmented quality items and services is that 10CFR50 Appendix B and 10CFR21 requirements do not apply to items and services purchased as augmented quality.

Commercial Material (CM) Standard Quality

This is a procurement quality classification for items or services which do not have a safety related function and are not subject to special utility requirements or NRC imposed regulatory requirements.

When purchasing safety related or augmented quality items and services, the procurement documents must contain the technical requirements, as well as the source of those requirements. These requirements must be verified by means such as vendor supplied documentation, receipt inspection, or testing. This process is similar for both safety and augmented quality items.

01213464

01213464

All items related to the storage cask, regardless of their classification, are designed in accordance with the requirements of the TN-40 Design Criteria which ensure that the General Design Criteria of 10CFR72(F), are satisfied. Those items related to the storage cask which are classified as safety related are designed, fabricated, inspected and tested, to the maximum practicable extent, in accordance with the ASME Boiler and Pressure Vessel Code, Section III, Subsection NB. The lifting trunnions are designed to ANSI N14.6 as described in Appendix 4A. Those items related to the concrete storage pads which are classified as safety related are designed, installed, inspected and tested in accordance with the specific requirements of the American Concrete Institute (ACI) and American Society for Testing and Materials (ASTM).

The quality assurance requirements of 10CFR50 Appendix B to are applied.

Those items which are classified as augmented quality or commercial material (standard quality) are designed in accordance with design rules which are indicated in the structural analysis of those items in Section 4.2.

01213464

4.5.1 CONTAINMENT VESSEL

The containment vessel and trunnions are classified as safety related since they serve as the primary confinement structure for the fuel assemblies and are designed to remain intact under all accident conditions analyzed in Chapter 8. The basket is classified as safety related because it provides criticality control, as well as serving as the structural support for the fuel and is designed to remain intact during all of the accidents described in Chapter 8.

4.5.2 PENETRATION GASKETS

Cask interseal pressure will be monitored. The pressure monitoring devices will provide an analog input signal to actuate alarm indication at a monitoring panel outside the ISFSI gate.

4.5.3 SHIELDING

The neutron shield body shield and lid shield are classified as augmented quality items. The basis for this classification is that they perform no function required by the accident analysis in Chapter 8 but they do provide radiation protection for personnel and are related to ISFSI Technical Specification requirements.

4.5.4 PROTECTIVE COVER AND OVERPRESSURE SYSTEM

The protective cover and overpressure system serve no safety function and are therefore classified as commercial material (standard quality) items.

01213464

4.5.5 CONCRETE STORAGE PADS

The concrete and reinforcing steel in the concrete storage pads are classified as safety related and are Seismic Category 1. The concrete storage pads provide structural support for the storage casks and are designed to prevent the failure of the casks due to an accident described in Chapter 8 while being moved or stored at the ISFSI.

THIS PAGE IS LEFT INTENTIONALLY BLANK

4.6 DECOMMISSIONING PLAN

The dry cask design concept to be utilized at the ISFSI features inherent ease and simplicity of decommissioning. At the end of its service lifetime, cask decommissioning could be accomplished by one of several options described below.

The casks, including the spent fuel stored inside, could be shipped to a suitable fuel repository for permanent storage. Depending on licensing requirements existing at the time of shipment off site, placement of the entire cask inside a supplemental shipping container or overpack would be considered.

The spent fuel could be removed from the ISFSI cask and shipped in a licensed shipping container to a suitable fuel repository. If desirable, cask decontamination could be accomplished through the use of conventional high pressure water sprays to further reduce contamination on the cask interior. The sources of contamination on the interior of the cask would be crud from the outside of the fuel pins and the crud left by the spent fuel pool water. The expected low levels of contamination from these sources could be easily removed with a high pressure water spray. After decontamination, the ISFSI cask could either be cut up for scrap or partially scrapped and any remaining contaminated portions shipped as low level radioactive waste to a disposal facility.

For surface decontamination of the ISFSI cask, chemical etching using hydrochloric acid or nitric acid can be applied to remove the contaminated surface of the cask. Alternatively, electropolishing can also be used to achieve the same result.

Cask activation analyses have been performed to quantify specific activity levels of cask materials after years of storage. The following assumptions were made:

1. The cask contains 40 reference PWR assemblies.
2. The neutron flux is assumed constant for 60 years.
3. The neutron spectrum is the same as in a PWR reactor.

SAFETY ANALYSIS REPORT

Revision: 17

Page 4.6-2

The activation calculation for the first 20 years of storage was performed using the computer codes ORIGEN2 (Reference 14) with the total neutron fluxes taken from the radial shielding calculation performed with the XSDRN-PM code (see Section 7). The fluxes at the cask centerline, the cavity wall, the neutron shield, and the outer shell are used to irradiate the basket, the body and lid, the neutron shield, and the outer shell and protective cover, respectively. The fluxes, material compositions, and masses of irradiated material are listed in Table 4.6-1. The ORIGEN2 cross section library for PWR's at a burnup of 33,000 MWD/MTU is used. The results listed in Table 4.6-2 indicate that after 20 years irradiation and 30 days decay (to eliminate very short lived radionuclides), the total activity is less than 0.13 Ci.

01505901

To evaluate the TN-40 cask and basket for disposal, the specific activity of the isotopes listed in Tables 1 and 2 of 10CFR 61.55 is determined and compared with the limits for Class A wastes in those tables. The actual material volumes of the cask components are used to evaluate their specific activity, rather than diluting the activity over the envelope of the entire cask. The specific activity after 60 years of storage was determined by increasing the specific activities calculated for 20 years of storage by a factor of 3.

01505901

The results of the calculation, shown in Table 4.6-3, show that the TN-40 cask will be far below the specific activity limits for both long and short lived nuclides for Class A waste. Consequently, it is expected that after application of the surface decontamination process as described above, the radiation level due to activation products will be negligible and the cask could be scrapped. A detailed evaluation will be performed at the time of decommissioning to determine the appropriate mode of disposal.

Due to the leak tight design of the storage casks, no residual contamination is expected to be left behind on the concrete base pad. The base pad, fence, and peripheral utility structures will require no decontamination or special handling after the last cask is removed.

The spent fuel pool at Prairie Island Nuclear Generating Plant will remain functional until the ISFSI is decommissioned. This will allow the pool to be utilized to transfer fuel from storage casks to licensed shipping containers for shipment off site if this decommissioning option is chosen.

The volume of waste material produced incidental to ISFSI decommissioning will be limited to that necessary to accomplish surface decontamination of the casks once the spent fuel elements are removed. Furthermore, it is estimated that the cask materials will be only very slightly activated as a result of their long-term exposure to the relatively small neutron flux emanating from the spent fuel, and that the resultant activation level will be well below allowable limits for general release of the casks as noncontrolled material. Hence, it is anticipated that the casks may be decommissioned from nuclear service by surface decontamination alone, which could be performed in the cask decontamination area in the Auxiliary Building.

The costs of decommissioning the ISFSI are expected to represent a small and negligible fraction of the cost of decommissioning the Prairie Island Nuclear Generating Plant.

4.7 REFERENCES

1. Northern States Power Company, Prairie Island Nuclear Generating Plant Updated Safety Analysis Report, Revision 10, Docket 50-282 (Unit 1) and 50-306 (Unit 2).
2. American Society for Testing and Materials, ASTM C31, Standard Practice for Making and Curing Concrete Test Specimens in the Field, 1988.
3. American Society for Testing and Materials, ASTM C39, Standard Test Method for Compressive Strength of Cylindrical Concrete Specimens, 1986.
4. Deleted
5. American Nuclear Society, ANSI/ANS-57.9, Design Criteria for an Independent Spent Fuel Storage Installation (Dry Storage Type), 1984.
6. Celestial Software, Images 3-D, Version 1.6, 1984.
7. Winterkorn, H.F. and Fang, H-Y, Foundation Engineering Handbook, Van Nostrand Reinhold Company, 1975.
8. American Society of Mechanical Engineers, ASME Boiler and Pressure Vessel Code, Section III, 1989.
9. American National Standards Institute, ANSI N14.6, American National Standard for Special Lifting Devices for Shipping Containers Weighing 11,000 Pounds or More for Nuclear Materials, 1986.
10. De Salvo, G. J. and Swanson, J.A., ANSYS Engineering Analysis System, Users Manual for ANSYS, Revision 4.3, Swanson Analysis Systems, Inc., Houston, PA, June 1987.
11. American Society of Mechanical Engineers, ASME B96.1, Welded Aluminum Alloy Storage Tanks, 1989.
12. American Institute of Steel Construction, Manual of Steel Construction, 1980.
13. Deleted
14. Oak Ridge National Laboratory, ORIGEN2, Isotope Generation and Depletion Code, CCC-371, January 1987.

SAFETY ANALYSIS REPORT

Revision: 13

Page 4.7-2

15. Electric Power Research Institute, Report No. NP-4830, The Effects of Target Hardness on the Structural Design of Concrete Storage Pads for Spent-Fuel Casks, October 1986.
16. Ederer Calculation No. D-15372, Spent Fuel Storage Cask Transport Vehicle, Rev. B, December 17, 1992.
17. Safety Evaluation 72-448, TN-40 Cask Weight/Storage Slab Design, May 14, 1996.
- 18 QF-0202, NSPM – Glossary of Procurement Terms

01213464

**TABLE 4.2-1
PAGE 1 OF 4**

COMPLIANCE WITH GENERAL DESIGN CRITERIA

| | | |
|----------------|---|---|
| 10CFR72.122(a) | Quality Standards | The design criteria require that the structures, systems and components which are safety related be designed, fabricated and delivered to the site, according to recognized commercial codes and standards and in accordance with the NSPM QA program for equipment. |
| 10CFR72.122(b) | Protection against environmental conditions and natural phenomena | Design basis environmental conditions and natural phenomena are defined in Chapter 2. The design criteria for the storage casks provide for prevention of criticality, maintenance of cask integrity and limitation of damage to fuel assemblies under these design bases conditions. |
| 10CFR72.122(c) | Protection against fires and explosions | No large fire within the ISFSI is considered credible. The design criteria require that storage casks be designed to withstand extreme ambient temperatures and peak overpressure resulting from postulated nearby explosions. |
| 10CFR72.122(d) | Sharing of structures, systems and components | The ISFSI activities will be done without jeopardizing the safe shutdown capability of the Prairie Island Nuclear Generating Plant, Units 1 and 2. |
| 10CFR72.122(e) | Proximity of sites | The design and operation of the ISFSI result in minimal additions of risk to the health and safety of the public. |
| 10CFR72.122(f) | Testing and maintenance of systems and components | The storage casks require minimum maintenance. The design criteria require that the storage casks be capable of being inspected and monitored. |
| 10CFR72.122(g) | Emergency capability | Scenarios requiring emergency actions are neither considered credible, nor postulated to occur. Nevertheless, all emergency facilities at the Prairie Island Nuclear Generating Plant would be available if needed. |

01153239

**TABLE 4.2-1
PAGE 2 OF 4**

COMPLIANCE WITH GENERAL DESIGN CRITERIA

| | | |
|----------------|-------------------------------------|--|
| 10CFR72.122(h) | Confinement barriers and systems. | The design of the storage casks will ensure that the stored fuel is maintained in a safe condition. No paths for radioactive releases are considered credible. Therefore, no ventilation or off gas systems are needed. |
| 10CFR72.122(i) | Instrumentation and control systems | No instrumentation or control systems are needed for the storage casks to perform their safety functions. Nevertheless, some monitors and alarms will be provided. |
| 10CFR72.122(j) | Control room and control area | The ISFSI is a passive installation, with no need for operator actions. Thus no control room is needed. |
| 10CFR72.122(k) | Utility or other services | The storage casks and the concrete storage pads are the only safety-related components at the ISFSI. There are no utility or emergency systems required to perform any safety functions at the ISFSI. |
| 10CFR72.122(l) | Retrievability | The design of the storage casks will enable subsequent removal of the stored fuel in the Prairie Island Nuclear Generating Plant spent fuel pool and repackaging of the fuel into transportation casks. The spent fuel pool will remain operational for the life of the ISFSI. |
| 10CFR72.124(a) | Design for criticality safety | The design criteria require that the storage casks be designed to maintain subcriticality at all times, assuming a single active or credible passive failure. |
| 10CFR72.124(b) | Methods of criticality control | Criticality control will be provided by use of favorable geometry combined with control neutron absorbing materials. Boration of spent fuel pool water is taken into account. |

**TABLE 4.2-1
PAGE 3 OF 4**

COMPLIANCE WITH GENERAL DESIGN CRITERIA

| | | |
|----------------|--|---|
| 10CFR72.124(c) | Criticality monitoring | Not required. |
| 10CFR72.126(a) | Exposure control | Operations at the ISFSI will be done according to ALARA procedures. Minimal maintenance operations are needed following storage cask emplacement at the ISFSI. Cask loading, sealing, decontamination, and preparation are done at the Auxiliary Building according to health physics procedures in effect for the Prairie Island Nuclear Generating Plant. |
| 10CFR72.126(b) | Radiological alarm systems | No radioactive releases are considered credible at the ISFSI. No safety-related systems are therefore considered appropriate. |
| 10CFR72.126(c) | Effluent and direct radiation monitoring | Operation of the ISFSI does not result in radioactive contamination of any effluents. No safety-related monitors are needed. Direct radiation monitors will be installed around the ISFSI. |
| 10CFR72.126(d) | Effluent control | No radioactive releases are considered credible at the ISFSI. |
| 10CFR72.128(a) | Spent fuel and high-level radioactive waste storage and handling systems | The design criteria require the storage casks to have adequate provisions to monitor the cask performance, provide sufficient shielding to lower surface doses to below prescribed levels, maintain leak tightness under all operating and credible conditions, provide for heat removal based upon inherent design without use of active components, and maintain fuel in a safe condition. Only minimal amounts of radioactive waste are generated in the decontamination of the casks. |

**TABLE 4.2-1
PAGE 4 OF 4**

COMPLIANCE WITH GENERAL DESIGN CRITERIA

| | | |
|----------------|-----------------|--|
| 10CFR72.128(b) | Waste treatment | Radioactive wastes generated in the decontamination of the storage casks are processed by the Prairie Island Nuclear Generating Plant waste processing systems. |
| 10CFR72.130 | Decommissioning | Operation of the ISFSI does not result in contamination of the outside surface of the storage casks or any other ISFSI components. Therefore, there is no need for provisions to facilitate decommissioning. |

TABLE 4.2-2
DYNAMIC SPRING CONSTANTS

| <u>Spring Constant</u> | <u>Above Water Table</u> | <u>Below Water Table</u> |
|-------------------------------|---------------------------------|---------------------------------|
| K_z | 3.98×10^5 kips/ft. | 5.07×10^5 kips/ft. |
| $K_x = K_y$ | 3.20×10^5 kips /ft. | 3.43×10^5 kips/ft. |
| K_ψ (x axis) | 1.77×10^8 ft.-kips/rad | 2.66×10^8 ft.-kips/rad |
| K_ψ (y axis) | 2.61×10^9 ft.-kips/rad | 3.32×10^9 ft.-kips/rad |
| K_Θ | 2.06×10^9 ft.-kips/rad | 2.06×10^9 ft.-kips/rad |

K_z = Vertical Spring Constant

$K_x = K_y$ = Sliding Spring Constant

K_ψ = Rocking Spring Constant

K_Θ = Torsional Spring Constant

TABLE 4.2-3**INDIVIDUAL LOAD CASES ANALYZED**

| <u>Component/ Analysis</u> | <u>Loading</u> | <u>SAR Section</u> | <u>Individual Stress Results Table</u> |
|---------------------------------------|---------------------------|-------------------------------|---|
| <u>CASK BODY</u> | | | |
| Bolt Preload | Preload | 4A.3 | 4A.3.3-1 |
| Internal Pressure (1) | 100 psig | 4A.3 | 4A.3.3-2 |
| External Pressure | 25 psig | 4A.3 | 4A.3.3-3 |
| Gravity | 1g | 4A.3 | 4a.3.3-4 |
| Lifting | 3g | 4A.3 | 4A.3.3-5 |
| Thermal Stress | Off-Normal Temps | 4A.3 | 4A.3.3-6 |
| Bounding Loads(1) | 2g down, 1g lateral | 4A.3 | 4A.3.3-7 |
| Trunnion Attachment | Attachment | 4A.3.4.1 | 4A.3.4.1-3 |
| Tornado Missile | Impact | 4A.3.4.2 | --- |
| Hypothetical Accident | Impact | 8.2.8.2.2 | Figure 8.2-1A |
| <u>LID BOLTS</u> | | | |
| Preload | Preload Tension | 4A.4.1 | --- |
| Thermal Effects | Differential Expansion | 4A.4.2 | --- |
| Torquing | Preload Torsion | 4A.4.3 | --- |
| Bending | Bending | 4A.4.4 | --- |
| Hypothetical Accident | Impact | 8.2.8.2.3 | --- |
| <u>BASKET</u> | | | |
| Bounding Side Load (2) | 3g lateral | 4B.6 | 4B.6-3 & 4 |
| Bounding Down Load (2) | 3g down | 4B.7 | 4B.7-1 |
| Thermal Stress | Off-Normal Temps | 4B.6 | 4B.6-6 |
| Hypothetical Accident | Impact | 8.2.8.2.4 | |
| <u>TRUNNIONS</u> | | | |
| Lifting | 6g & 10g | 4A.6 | 4A.6-2 |

NOTES

1. The above pressures and bounding loads conservatively envelop all possible pressure effects as well as tornado wind load, flood water load and seismic load.
2. The bounding loads selected for basket evaluation are extremely conservative. These loads are more severe than any loads that will actually be applied to the basket.

TABLE 4.2-4
CONTAINMENT VESSEL STRESS LIMITS (1)

| <u>DESIGN</u> | |
|-------------------------------|--|
| <u>Classification</u> | <u>Stress Intensity Limit (4)</u> |
| P_m | S_m |
| P_l | $1.5 S_m$ |
| $(P_m \text{ or } P_l) + P_b$ | $1.5 S_m$ |
| Shear Stress | $0.6 S_m$ |

| <u>LEVEL A</u> | |
|---------------------------------------|--|
| <u>Classification</u> | <u>Stress Intensity Limit (4)</u> |
| $(P_m \text{ or } P_l) + P_b + Q$ | $3 S_m$ |
| $(P_m \text{ or } P_l) + P_b + Q + F$ | S_a |

| <u>LEVEL D (2)</u> | |
|-------------------------------|--|
| <u>Classification</u> | <u>Stress Intensity Limit (3) (4)</u> |
| P_m | $2.4 S_m \text{ or } 0.7 S_u$ |
| P_l | $3.6 S_m \text{ or } S_u$ |
| $(P_m \text{ or } P_l) + P_b$ | $3.6 S_m \text{ or } S_u$ |
| Shear Stress | $0.42 S_u$ |

NOTES

1. Quantities are as defined in ASME Code, Section III, Subsection NB.
2. Limits are in accordance with ASME Code, Section III, Appendix F.
3. Whichever is lower.
4. When using materials data from Section III Appendix Tables other than I-1.0, S values may be substituted for S_m values in these expressions

TABLE 4.2-5
CONTAINMENT BOLT STRESS LIMITS (1)

DESIGN CONDITIONS

| <u>Classification</u> | <u>Stress Intensity Limit</u> | <u>ASME Section (1)</u> |
|------------------------------|--------------------------------------|--------------------------------|
| P _m (Tensile) | S _m | NB-3231 |

LEVEL A

| <u>Classification</u> | <u>Stress Intensity Limit</u> | <u>ASME Section (1)</u> |
|---|--------------------------------------|--------------------------------|
| P _m (Tensile) | 2S _m | NB-3232.1 |
| P _l + P _b (Tensile and Bending) | 3S _m | NB-3232.2 |
| Combined | 3S _m | NB-3232.2 |

LEVEL D (2)

| <u>Classification</u> | <u>Stress Intensity Limit</u> |
|---|--|
| P _m (Tensile) | Smaller of S _y or 0.7 S _u |
| P _l + P _b (Tensile and Bending) | S _u |
| Shear | Smaller of 0.42 S _u or 0.6 S _y |
| Combined Shear & Tension | $\frac{(f_t)^2}{(F_{tb})^2} + \frac{(f_v)^2}{(F_{vb})^2} \leq 1$ |

NOTES

1. Terms are as defined in ASME Code, Section III, Subsection NB, Paragraph 3230.
2. Limits are in accordance with ASME Code, Section III, Appendix F.

TABLE 4.2-6**NON CONTAINMENT STRUCTURE STRESS LIMITS (1)****DESIGN**

| <u>Classification</u> | <u>Stress Intensity Limit</u> (2) (4) |
|-------------------------------|--|
| P_m | S_m or $0.67 S_y$ |
| P_I | $1.5 S_m$ or S_y |
| $(P_m \text{ or } P_I) + P_b$ | $1.5 S_m$ or S_y (3) |
| Shear Stress | $0.65 S_m$ or $0.5 S_y$ |

LEVEL A

| <u>Classification</u> | <u>Stress Intensity Limit</u> (2, 3 & 4) |
|-----------------------------------|---|
| $(P_m \text{ or } P_I) + P_b + Q$ | $3 S_m$ or $2 S_y$ |

LEVEL D

| <u>Classification</u> | <u>Stress Intensity Limit</u> |
|-------------------------------|--------------------------------------|
| P_m | $0.7 S_u$ |
| P_I | S_u |
| $(P_m \text{ or } P_I) + P_b$ | S_u |
| Shear Stress | $0.6 S_u$ |

NOTES

1. Quantities are as defined in ASME Code, Section III, Subsection NB.
2. Whichever is higher.
3. These limits may be exceeded for non containment structure if the resulting deflection can be accommodated.
4. When using materials data from Section III Appendix Table other than I-1.0, S values may be substituted for S_m values in these expressions.

TABLE 4.2-6a**BASKET STRESS LIMITS (1)****DESIGN (4)**

| <u>Classification</u> | <u>Stress Intensity Limit</u> (4) |
|------------------------------|--|
| P_m | S_m |
| P_I | $1.5 S_m$ |
| $(P_m + P_I) + P_b$ | $1.5 S_m$ |
| Shear Stress | $0.6 S_m$ |

LEVEL A

| <u>Classification</u> | <u>Stress Intensity Limit</u> (4) |
|---------------------------------------|--|
| $(P_m \text{ or } P_I) + P_b + Q$ | $3 S_m$ |
| $(P_m \text{ or } P_I) + P_b + Q + F$ | S_a |

LEVEL D (2) (4) (5)

| <u>Classification</u> | <u>Stress Intensity Limit</u> (3) (4) |
|-------------------------------|--|
| P_m | $2.4 S_m \text{ or } 0.7 S_u$ |
| P_I | $3.6 S_m \text{ or } S_u$ |
| $(P_m \text{ or } P_I) + P_b$ | $3.6 S_m \text{ or } S_u$ |
| Shear Stress | $0.42 S_u$ |

NOTES

1. Quantities are as defined in ASME Code, Section III, Subsection NB.
2. Limits are in accordance with ASME Code, Section III, Appendix F.
3. Whichever is lower.
4. Under sustained primary loads the strength of the 6061-T6 basket plates shall not be considered.
5. For short duration impact loading the strength of the 6061-T6 basket plates may be considered. For these conditions (Level D Impact) the value of $2/3 S_y$ may be substituted for S_m .

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION**SAFETY ANALYSIS REPORT**Revision: 9

TABLE 4.2-7**LOAD COMBINATIONS FOR CASK BODY**

| | Bolt Preload | 1 G Down | Internal Pressure | Ext. Pressure | Temp | 3 G On Trunnions | Trunnion Local | Seismic Tornado of Flood | Tornado Missiles |
|---------|-----------------|-------------|----------------------|------------------|------|---------------------|-------------------|--------------------------------|---------------------|
| Design | | | | | | | | | |
| Des (1) | X | X | X | | | | | X | |
| Des (2) | X | | X | | | X | X | | |
| Des (3) | X | X | | X | | | | X | |
| Level A | | | | | | | | | |
| A (1) | X | X | X | | X | | | X | |
| A (2) | X | | X | | X | X | X | | |
| A (3) | X | X | | X | X | | | X | |
| Level D | | | | | | | | | |
| D (1) | X | X | X | | | | | X | X |
| D (2) | X | X | | X | | | | X | X |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION**SAFETY ANALYSIS REPORT**Revision: 9

TABLE 4.2-8**COMPARISON OF ACTUAL WITH ALLOWABLE STRESS INTENSITY
CONTAINMENT VESSEL**

| Service Condition | Component | Location (Figure 4.2-6) | Load Combination (Table 4.2-6) | Stress Category | Maximum* Stress Intensity (psi) | Allowable Stress Intensity (psi) |
|-------------------|-----------|-------------------------|--------------------------------|-----------------|---------------------------------|----------------------------------|
| DESIGN | Shell | - | - | P_m | - | 16,200 (S_m) |
| | | 3 | Design (1) | $P_1 + P_b$ | 13,865 | 24,300 (1.5 S_m) |
| | Flange | - | - | P_m | - | 17,500 (S_m) |
| | | 10 | Design (2) | $P_1 + P_b$ | 6,049 | 26,250 (1.5 S_m) |
| | Lid | - | - | P_m | - | 17,500 (S_m) |
| | | 12 | Design (2) | $P_1 + P_b$ | 6,535 | 26,250 (1.5 S_m) |
| LEVEL A | Shell | 3 | A (1) | $P_1 + P_b + Q$ | 22,132 | 48,600 (3 S_m) |
| | Flange | 10 | A (2) | $P_1 + P_b + Q$ | 8,184 | 52,500 (3 S_m) |
| | Lid | 12 | A (2) | $P_1 + P_b + Q$ | 8,060 | 52,500 (3 S_m) |
| LEVEL D | Shell | - | - | P_m | Same as | 38,880 (2.4 S_m) |
| | | - | - | $P_1 + P_b$ | Level A | 58,320 (3.6 S_m) |
| | Flange | - | - | P_m | Same as | 42,000 (2.4 S_m) |
| | | - | - | $P_1 + P_b$ | Level A | 63,000 (3.6 S_m) |
| | Lid | 12 | D(1) | $P_1 + P_b + Q$ | 6,140 | 42,000 (2.4 S_m) |
| | | 12 | D(1) | $P_1 + P_b + Q$ | 47,425 | 63,000 (3.6 S_m) |

*Maximum values from Tables 4A.3.5-1 through 8

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION**SAFETY ANALYSIS REPORT**Revision: 9

TABLE 4.2-9**SUMMARY OF MAXIMUM STRESS INTENSITIES AND
ALLOWABLE STRESS LIMITS FOR THE CONTAINMENT VESSEL**

| Service Condition | Location | Maximum Stress Intensity (psi) | Allowable (psi) | Margin of Safety |
|------------------------------|----------------------------------|---|------------------------|-----------------------------|
| Design | Containment Shell Near Bottom | $P_I + P_b = 13,865$ | $1.5S_m = 24,300$ | 0.75 |
| Level A | Containment Shell Near Bottom | $P_I + P_b + Q = 22,132$ | $3S_m = 48,600$ | 1.20 |
| Level D | In the Lid Near the Center | $P_I + P_b = 47,425$ | $3.6S_m = 63,000$ | 0.33 |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION**SAFETY ANALYSIS REPORT**Revision: 9

TABLE 4.2-10**COMPARISON OF ACTUAL WITH ALLOWABLE STRESS INTENSITY GAMMA SHIELDING.**

| SERVICE CONDITION | COMPONENT | LOCATION (Figure 4.2-6) | LOAD COMBINATION (Table 4.2-6) | STRESS CATEGORY | MAXIMUM* STRESS INTENSITY (psi) | ALLOWABLE STRESS INTENSITY (psi) |
|----------------------|-----------|----------------------------|--------------------------------------|--------------------|---------------------------------------|--|
| Design | Cylinder | -- | - | P_m | - | 21,866 (2/3 S_y) |
| | | 15 | Design 2 | $P_1 + P_b$ | 830 | 32,800 (S_y) |
| | Bottom | - | - | P_m | - | 21,866 (2/3 S_y) |
| | | 14 | Design 2 | $P_1 + P_b$ | 3,670 | 32,800 (S_y) |
| | Welds | 20 | Design 1 | P_m | 14,574 | 21,866 (2/3 S_y) |
| Level A | Cylinder | 16 | A (2) | $P_1 + P_b + Q$ | 1,854 | 65,600 (2 S_y) |
| | Bottom | 13 | A (2) | $P_1 + P_b + Q$ | 5,779 | 65,600 (2 S_y) |
| | Welds | 18 | A (1) | $P_1 + P_b + Q$ | 15,953 | 65,600 (2 S_y) |
| Level D | Cylinder | - | - | P_m | - | 49,000 (0.7 S_u) |
| | | 15 | D (1) | $P_1 + P_b$ | 12,638 | 70,000 (S_u) |
| | Bottom | - | - | P_m | Same as | 49,000 (0.7 S_u) |
| | | - | - | $P_1 + P_b$ | Level A | 70,000 (S_u) |
| | Welds | 20 | D (1) | P_m | 6,140 | 49,000 (0.7 S_u) |
| | | 20 | D (1) | $P_1 + P_b$ | 55,519 | 70,000 (S_u) |

*Maximum values from Tables 4A3.5-1 through 8.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4.2-11

SUMMARY OF MAXIMUM INTENSITY AND ALLOWABLE STRESS LIMITS FOR LID BOLTS

| Service Condition | STRESS CATEGORY | | | | ALLOWABLE STRESS INTENSITY (PSI) | | | | |
|-------------------|-----------------|-------------------|--------|-----------------|----------------------------------|-------------------|------------------|----------|------------------|
| | Tensile | Tensile + Bending | Shear | Combined | Tensile | Tensile + Bending | Stress Shear | Combined | Margin of Safety |
| Design (2) | 25,000 | | | | $S_m = 31,900$ | | | | 0.28 |
| Level A | 51,000 | | | | $2 S_m = 63,800$ | | | | 0.25 |
| | | 75,457 | | | | $3 S_m = 95,700$ | | | 0.27 |
| | | | 14,071 | 80,534(1) | | | $3 S_m = 95,700$ | | 0.19 |
| Level D | ----- | ----- | ----- | Same as Level A | ----- | ----- | ----- | ----- | ----- |

(1) Combined Stress = $\sqrt{\sigma^2 + 4\tau^2}$

(2) "DESIGN" condition remains unchanged.
Applied preload need not be included.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION**SAFETY ANALYSIS REPORT**REVISION: 9

TABLE 4.2-12**COMPARISON OF ACTUAL WITH
ALLOWABLE STRESS INTENSITY IN BASKET**

| SERVICE CONDITION | COMPONENT /STRESS CATEGORY | STRESS INTENSITY (PSI) | ALLOWABLE STRESS INTENSITY (PSI) ⁽³⁾ |
|---|---------------------------------------|---------------------------------------|--|
| DESIGN, LEVEL D (Bounding 3 g Lateral Load) | <u>304 SS Fuel Boxes</u> | | 17,000 (S_m) |
| | P_m | 1,571 ⁽¹⁾ | 25,700 ($1.5 S_m$) |
| | $P_l + P_b$ | 6,056 ⁽¹⁾ | |
| | <u>Plug Weld Stress</u> | | |
| | $P_m + Q (2\tau)$ | 172 ⁽¹⁾ | 17,000(S_m) |
| LEVEL A (3 g Lateral Load plus Thermal) | <u>304 SS Fuel Boxes</u> | | 51,000 ($3 S_m$) |
| | $P_l + P_b + Q$ | 49,036 ⁽²⁾ | |
| | <u>Plug Weld Stress</u> | | |
| | $P_m + Q(2\tau)$ | 50,902 ⁽²⁾ | 51,000 ($3 S_m$) |

NOTE

1. These primary stresses have been calculated on an elastic basis neglecting the structural contribution from the aluminum.
2. These primary plus secondary stresses have been determined as permitted by the ASME Code where the structural action is calculated on a plastic basis. The $3S_m$ limit has been met. ASME permits $3S_m$ to be exceeded in this case since thermal ratcheting and fatigue cannot occur. See Section 4B.6.
3. These allowable stresses are based on the maximum metal temperature of 530°F. Some of the maximum stresses occur in cooler portions of the basket where allowables are higher.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION**SAFETY ANALYSIS REPORT**REVISION: 9

TABLE 4.2-13**COMPARISON OF MAXIMUM LIFTING TRUNNION STRESS INTENSITIES
WITH ALLOWABLES**

| LOAD | MAXIMUM STRESS INTENSITY(PSI) | | ALLOWABLE STRESS (psi) |
|------------------------------|-------------------------------|--------------------|---------------------------|
| | LIFTING SHOULDER | ATTACHMENT WELD | |
| LIFTING INERTIA LOAD 6 g | 20,320 | 28,630 | S _y =31,900 |
| LIFTING INERTIA LOAD 10 g | 33,866 | 47,718 | S _u =70,000 |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION**SAFETY ANALYSIS REPORT**REVISION: 9

TABLE 4.2-14**COMPARISON OF MAXIMUM TURNING TRUNNION STRESS INTENSITIES
WITH ALLOWABLES**

| LOAD | MAXIMUM STRESS INTENSITY(PSI) | | ALLOWABLE STRESS (psi) |
|--|-------------------------------|--------------------|---------------------------|
| | LIFTING SHOULDER | ATTACHMENT WELD | |
| LIFTING INERTIA LOAD 6 g on 4 Trunnions | 18,174 | 27,953 | 31,900 |
| LIFTING INERTIA LOAD 10 g on 4 Trunnions | 30,294 | 46,589 | 70,000 |

TABLE 4.2-15**COMPARISON OF MAXIMUM STRESS INTENSITY
WITH ALLOWABLES IN OUTER SHELL**

| LOAD | MAXIMUM STRESS INTENSITY (PSI) | ALLOWABLE STRESS (psi) |
|--|--------------------------------|---------------------------|
| | TOP CLOSURE PLATE | |
| 25 psi + 3 g HANDLING VERTICAL INERTIA LOAD | 21,117 | S _y =26,600 |

01136263

TABLE 4.5-1

CLASSIFICATION OF STRUCTURES, COMPONENTS AND SYSTEMS

| <u>SAFETY RELATED</u> | <u>AUGMENTED QUALITY</u> | <u>COMMERCIAL MATERIAL (STANDARD QUALITY)</u> |
|---|--|--|
| Containment Vessel Cask Body Shell Cask Body Bottom Lid Lid Bolts | Lid Gaskets Lid Penetration covers, Bolts Gaskets | Protective Cover Overpressure System Transport Vehicle |
| Basket Assembly | Port Covers, Bolts, Gaskets | ISFSI Buildings |
| Trunnions | Neutron Shield | Electrical Power Lighting Receptacles |
| Concrete Pads Concrete Reinforcing Steel | Body Shielding Lid Shielding Security System | |

01213464

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION**SAFETY ANALYSIS REPORT**REVISION: 9

TABLE 4.6-1**DATA FOR TN-40 ACTIVATION ANALYSIS**

| ZONE | FLUX N/CM³/S | MATERIAL | MASS kg (approx) | COMPOSITION WT % |
|----------------------------------|------------------------------------|-----------------------------------|---------------------------------|---|
| Basket | 7.55E5 | Stainless Steel (SA-240 TP304) | 2,770 | Mn 2.0 Cr 19.0 Ni 9.5 Si 0.75 Fe 68.75 |
| | | Aluminum (6061-T6) | 2,906 | Si 0.6 Mg 1.0 Cr 0.2 Cu 0.3 Al 97.9 |
| Body, Lid, Basket Supports | 3.87E5 | Carbon Steel (SA-105) | 56,070 | Fe 98.5 Mn 1.0 C 0.2 Si 0.3 |
| | | Aluminum | 1,135 | See Above |
| | | "Containment" Steel (SA-203) | 12,260 | Si 0.35 Mn 0.9 Ni 3.75 C 0.2 Fe 94.8 |
| | | Stainless Steel | 681 | See Above |
| Neutron Shield | 1.07E4 | Resin | 4,858 | H 5.05 B 1.05 C 35.13 O 41.73 Al 14.93 Zn 2.11 |
| | | Aluminum | 908 | See Above |
| Shell, cover | 1.11E3 | Carbon Steel (SA-516 Gr 55) | 4,131 | Mn 0.7 Fe 99.3 |
| | | | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION**SAFETY ANALYSIS REPORT**REVISION: 17

TABLE 4.6-2**RESULTS OF ORIGEN2 20 YEAR ACTIVATION CALCULATION**

| NUCLIDE | ACTIVITY (Ci) | | | | |
|---------|------------------|----------|----------|----------|----------|
| | Basket | Body | N-Shield | Shell | TOTAL |
| H3 | ----- | ----- | 2.12E-10 | ----- | 2.12E-10 |
| C14 | ----- | 2.02E-10 | 5.12E-10 | 3.49E-14 | 5.12E-10 |
| Cr51 | 3.81E-3 | 6.35E-4 | ----- | ----- | 4.44E-3 |
| Mn54 | 4.61E-4 | 8.36E-3 | ----- | ----- | 8.82E-3 |
| Fe55 | 5.06E-3 | 9.08E-2 | ----- | 1.57E-5 | 9.59E-2 |
| Fe59 | 9.36E-5 | 1.69E-3 | ----- | ----- | 1.78E-3 |
| Co58 | 5.88E-4 | 6.00E-4 | ----- | ----- | 1.19E-3 |
| Co60 | 8.32E-6 | 8.31E-6 | ----- | ----- | 1.66E-5 |
| Ni63 | 3.64E-4 | 3.72E-4 | ----- | ----- | 7.36E-4 |
| Ni59 | 3.17E-6 | 3.24E-6 | ----- | ----- | 6.41E-6 |
| Zn65 | ----- | ----- | 1.12E-05 | ----- | 1.12E-5 |
| TOTAL | | | | | 1.13E-1 |

NOTE

1. Only nuclides with activity greater than 10^{-5} curie and those nuclides listed in 10CFR61.55 are reported here.

01505901

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

REVISION: 17

TABLE 4.6-3

COMPARISON OF TN-40 ACTIVITY WITH CLASS A WASTE LIMITS

Long lived Isotopes, 10CFR61.55, Table 1

| <u>Zone</u> | <u>Volume m³</u> | <u>Nuclide</u> | <u>Specific Activity after 20 yrs of storage Ci/m³</u> | <u>Specific Activity after 60 yrs of storage Ci/m³</u> | <u>Limit Ci/m³</u> |
|-------------|---------------------------------|----------------|---|---|-----------------------------------|
| Basket | 1.43 | C14 | ----- | ----- | 80 |
| | | Ni59 | 2.22E-06 | 6.66E-06 | 220 |
| Body | 9.27 | C14 | 2.17E-11 | 6.51E-11 | 80 |
| | | Ni59 | 3.49E-07 | 1.05E-06 | |
| N-Shield | 3.37 | C14 | 1.52E-10 | 4.56E-10 | 80 |
| Shell | 0.53 | C14 | 6.59E-14 | 1.98E-13 | 80 |

Short Lived Isotopes, 10CFR61.55, Table 2, Column 1

| <u>Zone</u> | <u>Nuclide</u> | <u>Specific Activity after 20 yrs of storage Ci/m³</u> | <u>Specific Activity after 60 yrs of storage Ci/m³</u> | <u>Limit Ci/m³</u> |
|-------------|----------------|---|---|-----------------------------------|
| Basket | Co60 | 5.82E-06 | 1.75E-05 | 700 |
| | Ni63 | 2.55E-04 | 7.65E-04 | 35 |
| | T5* | 7.00E-03 | 2.10E-02 | 700 |
| Body | Co60 | 8.96E-07 | 2.69E-06 | 700 |
| | Ni63 | 4.01E-05 | 1.20E-04 | 35 |
| | T5* | 1.10E-02 | 3.30E-02 | 700 |
| N-Shield | H3 | 6.28E-11 | 1.88E-10 | 40 |
| | T5* | 3.56E-06 | 1.07E-05 | 700 |
| Shell | T5* | 2.96E-05 | 8.88E-05 | 700 |

*Nuclides with half lives less than 5 years:
Cr52, Mn54, Fe55, Fe59, Co58, Zn65.

01505901

FIGURE 4.1-1, REV. 2

DELETED

Security-Related Information Figure Withheld Under 10 CFR 2.390.

REV. 3 4/84

Figure 4.2-1
CONCRETE PAD
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

CONCRETE PAD





NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

| | | | |
|-----------|-----|-----------|----------|
| DRAWN BY: | VLS | REVISION: | 3 |
| PAGE NO. | | DATE: | 04-05-06 |

FIG4.2-1_REV_3

IMAGES-3D COMPUTER MODEL

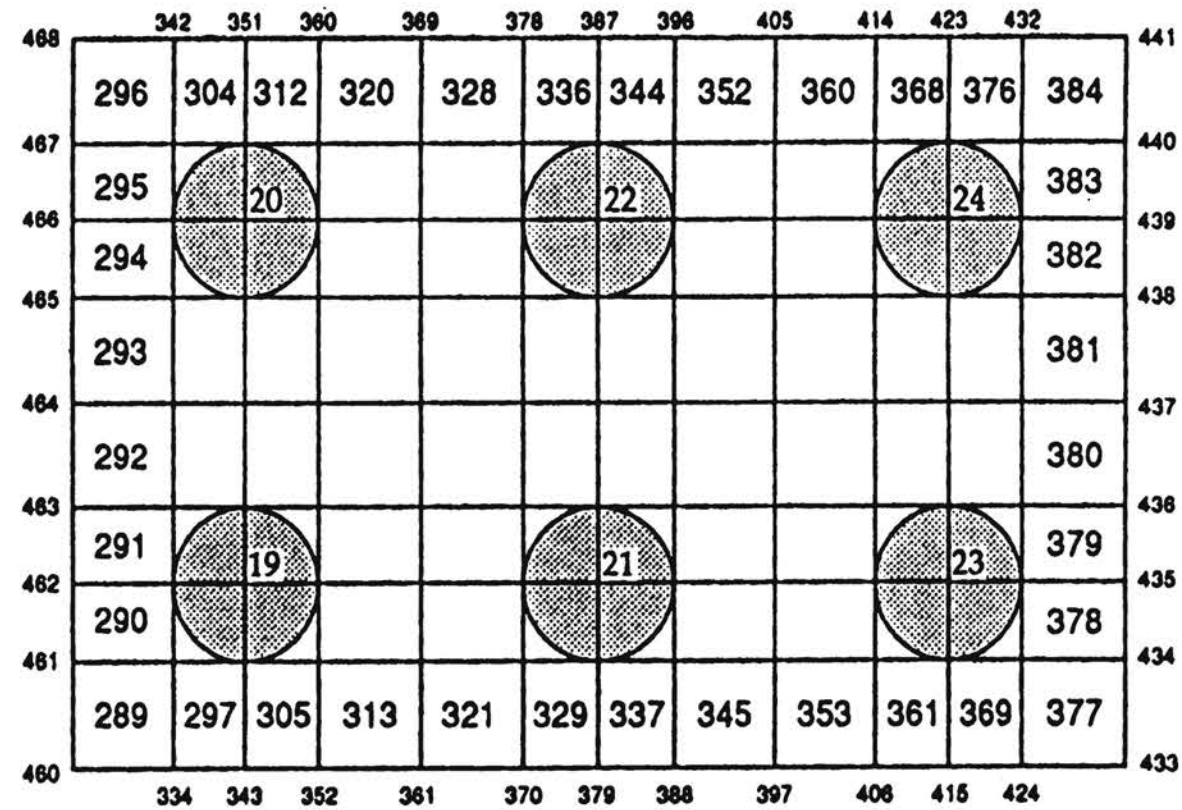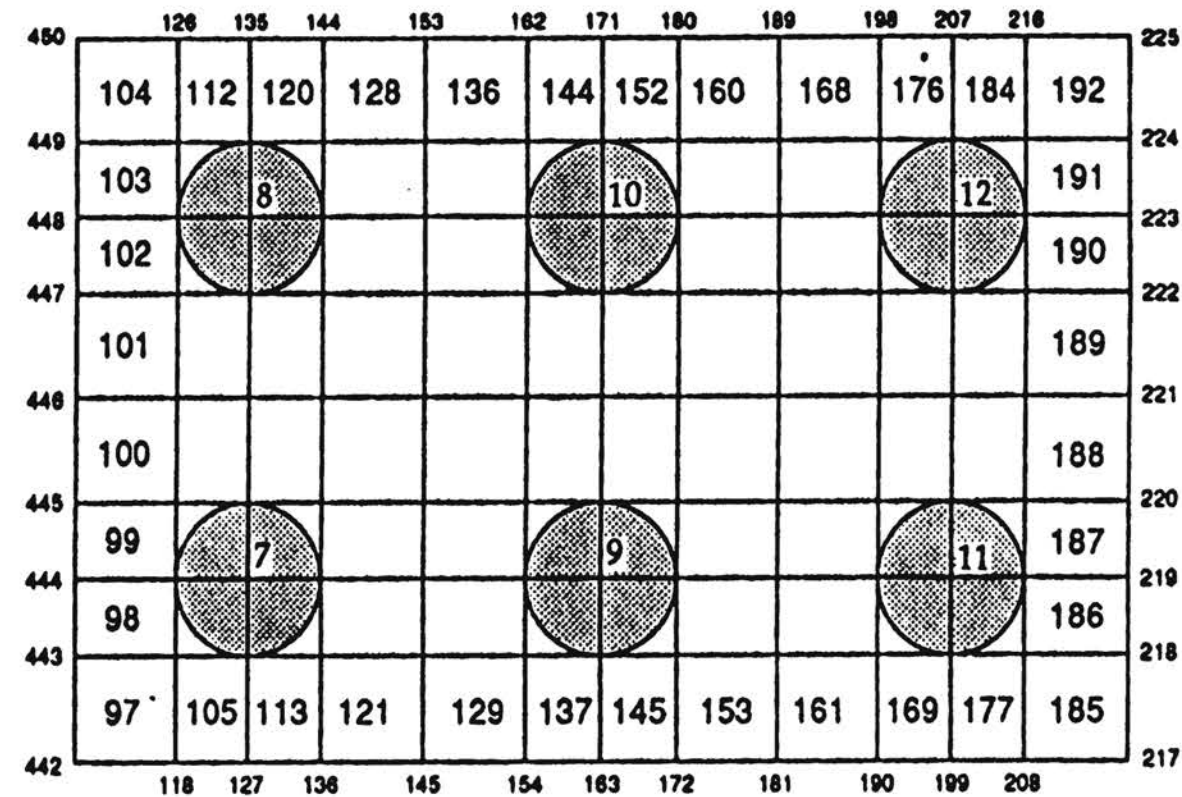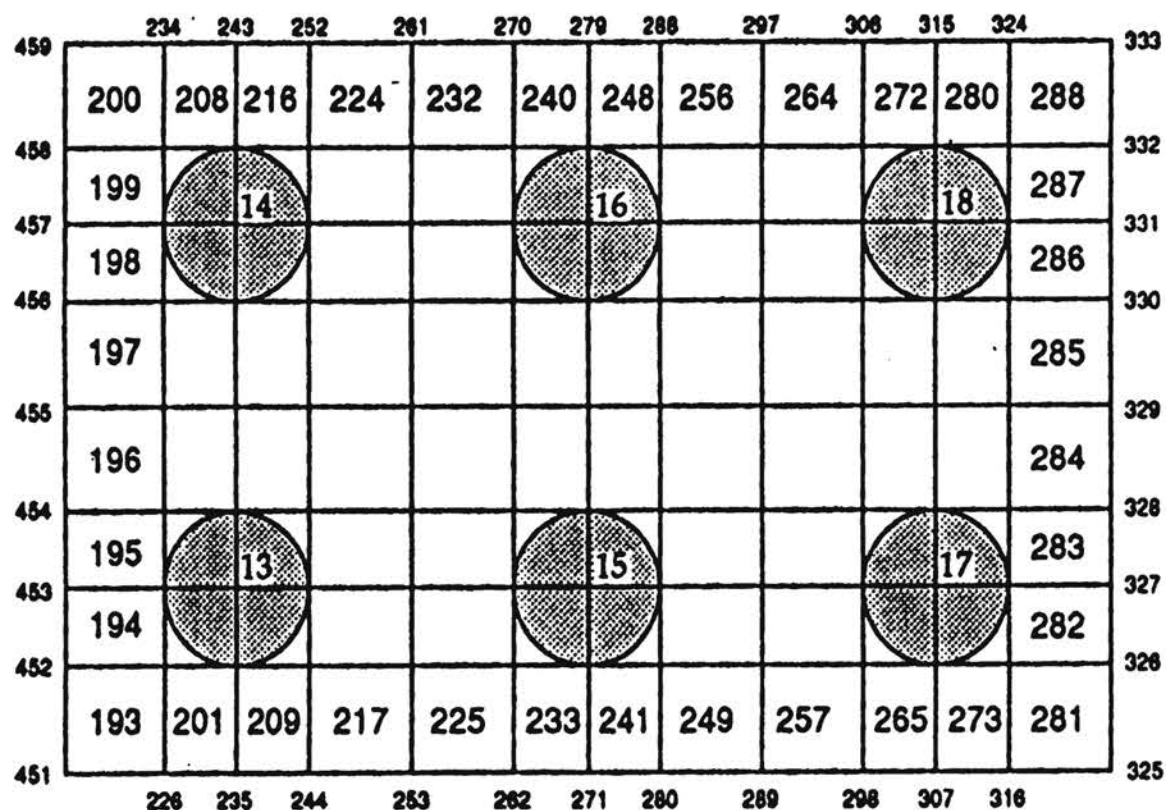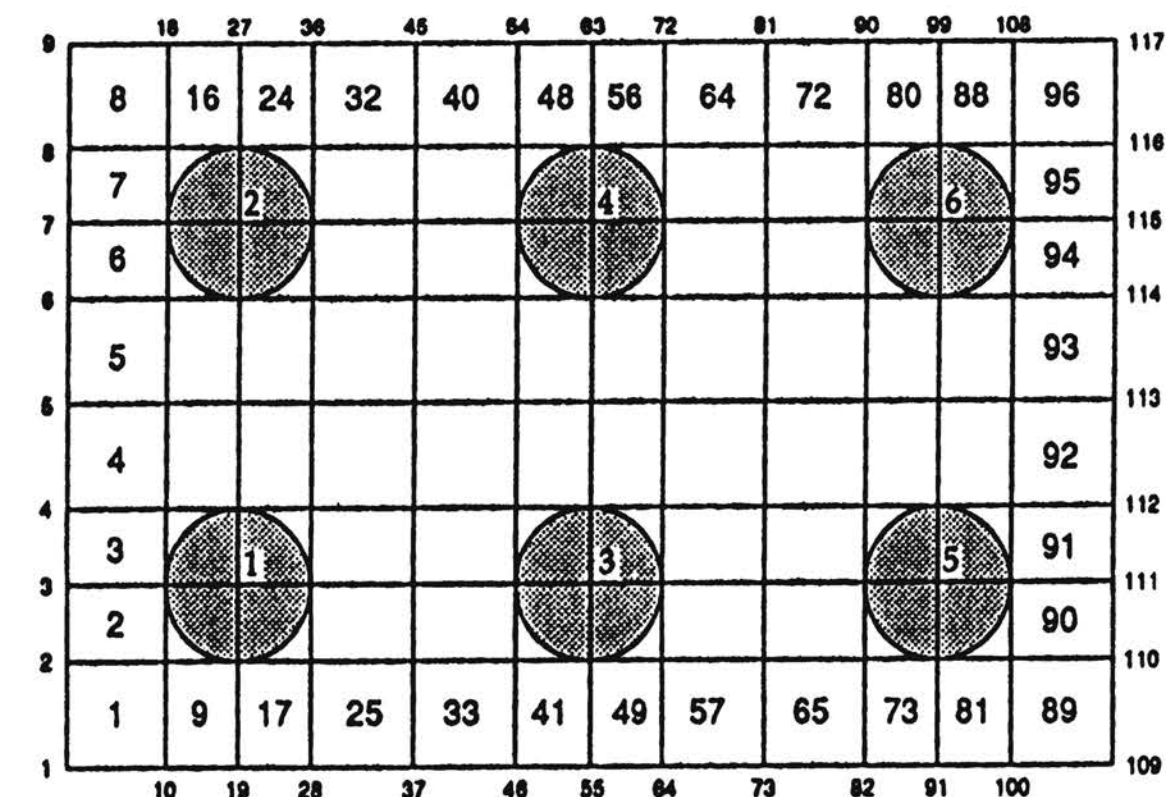

Note: Nodes 442 to 450 are coincident with nodes 109 to 117, nodes 451 to 459 are coincident with nodes 217 to 225 and nodes 460 to 468 are coincident with nodes 325 to 333.

Rev 3 4/94

Figure 4.2-1a
IMAGES - 3D COMPUTER MODEL
 PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

FIGURE 4.2-2, REV. 1

DELETED

FIGURE 4.2-3, REV. 1


DELETED

FIGURE 4.2-4, REV. 1

DELETED

FIGURE 4.2-5, REV. 1

DELETED

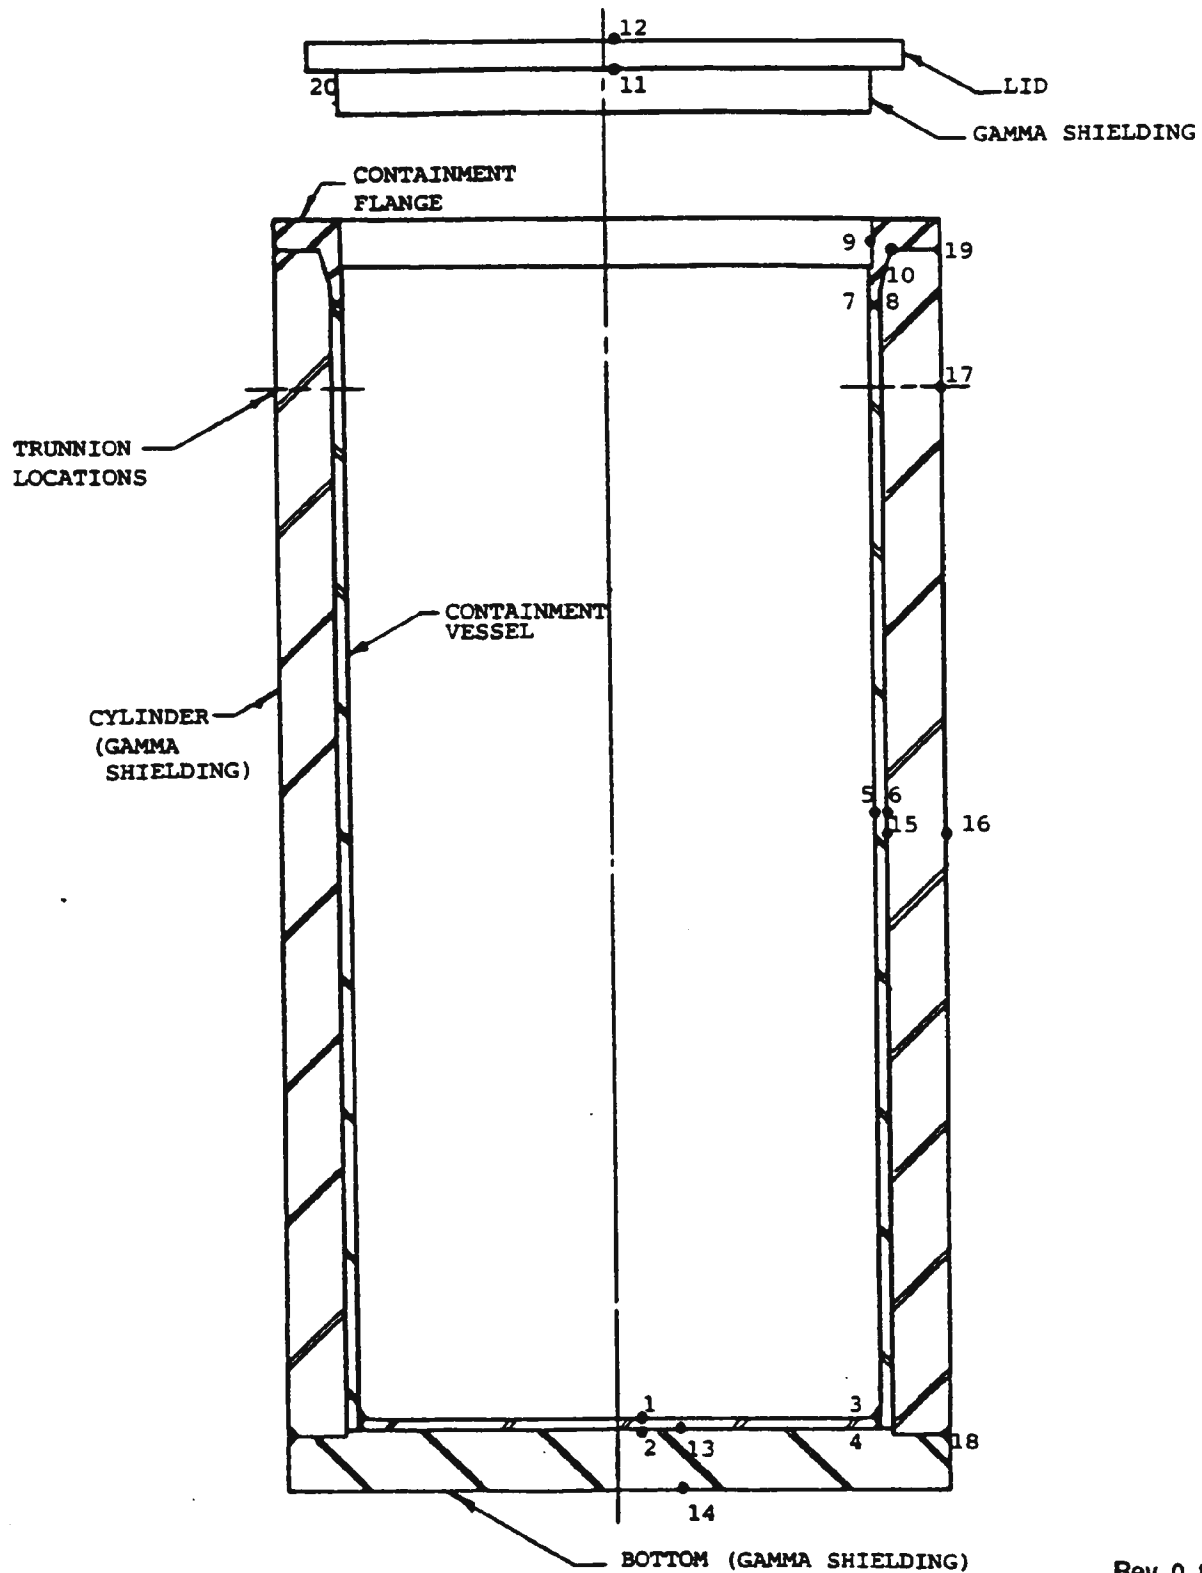


Rev. 0 8/90

Figure 4.2-6
STANDARD REPORTING LOCATIONS
FOR CASK BODY (TN-40 CASK)

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

STANDARD REPORTING LOCATIONS FOR CASK BODY (TN-40 CASK)

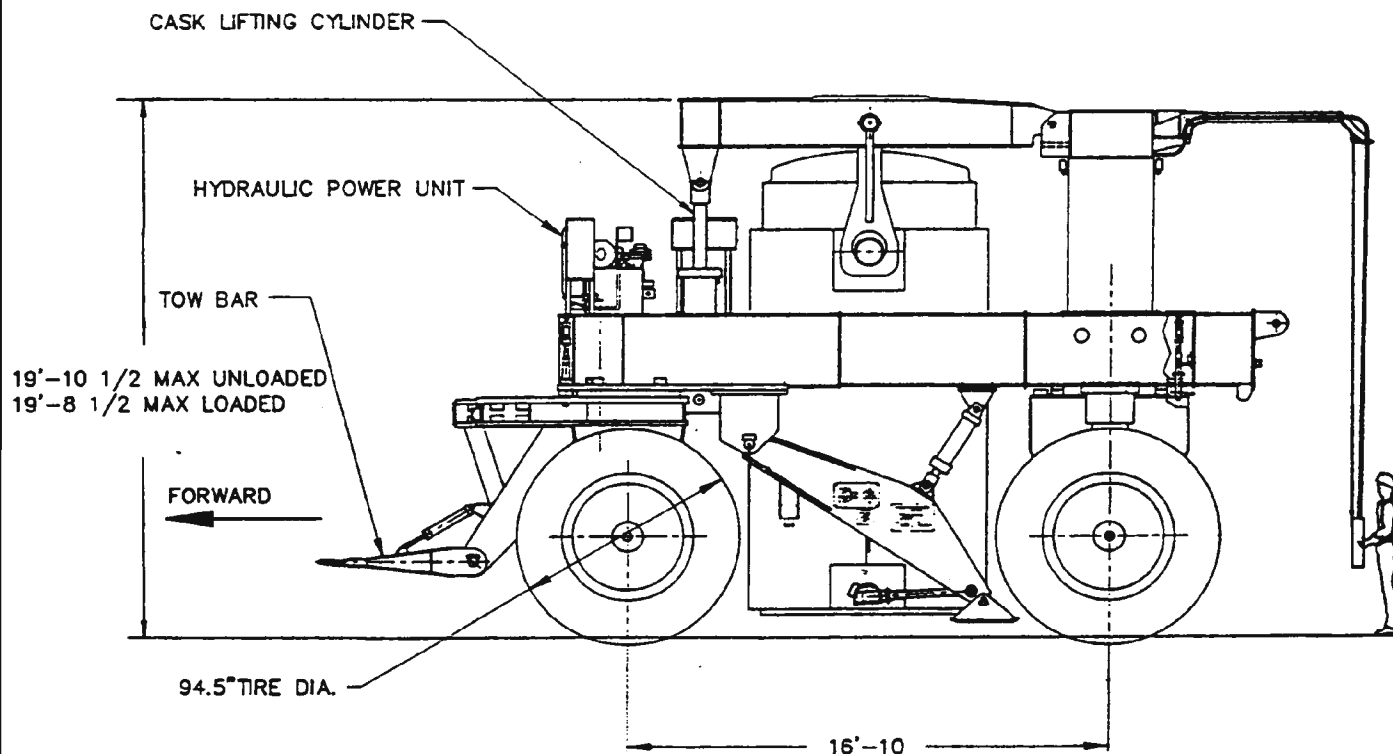

Rev 3 4/94

Figure 4.3-1
TRANSPORT VEHICLE - SIDE VIEW

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

TRANSPORT VEHICLE - SIDE VIEW

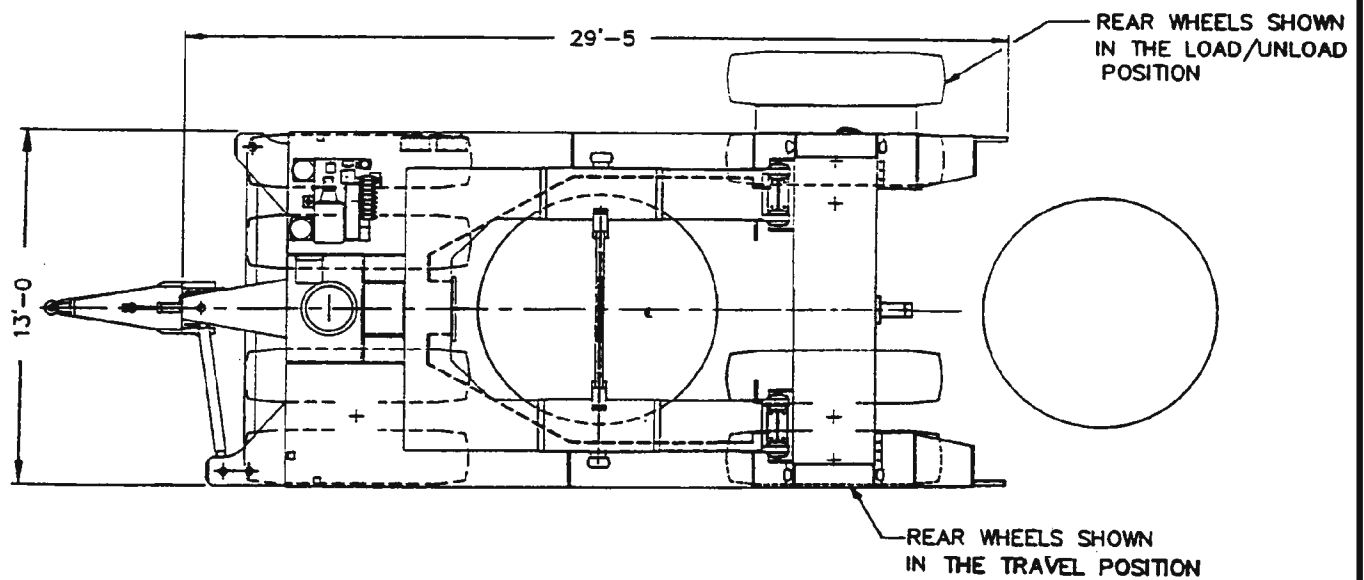



Figure 4.3-2

TRANSPORT VEHICLE - PLAN VIEW

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

Rev 3 4/94

TRANSPORT VEHICLE - PLAN VIEW

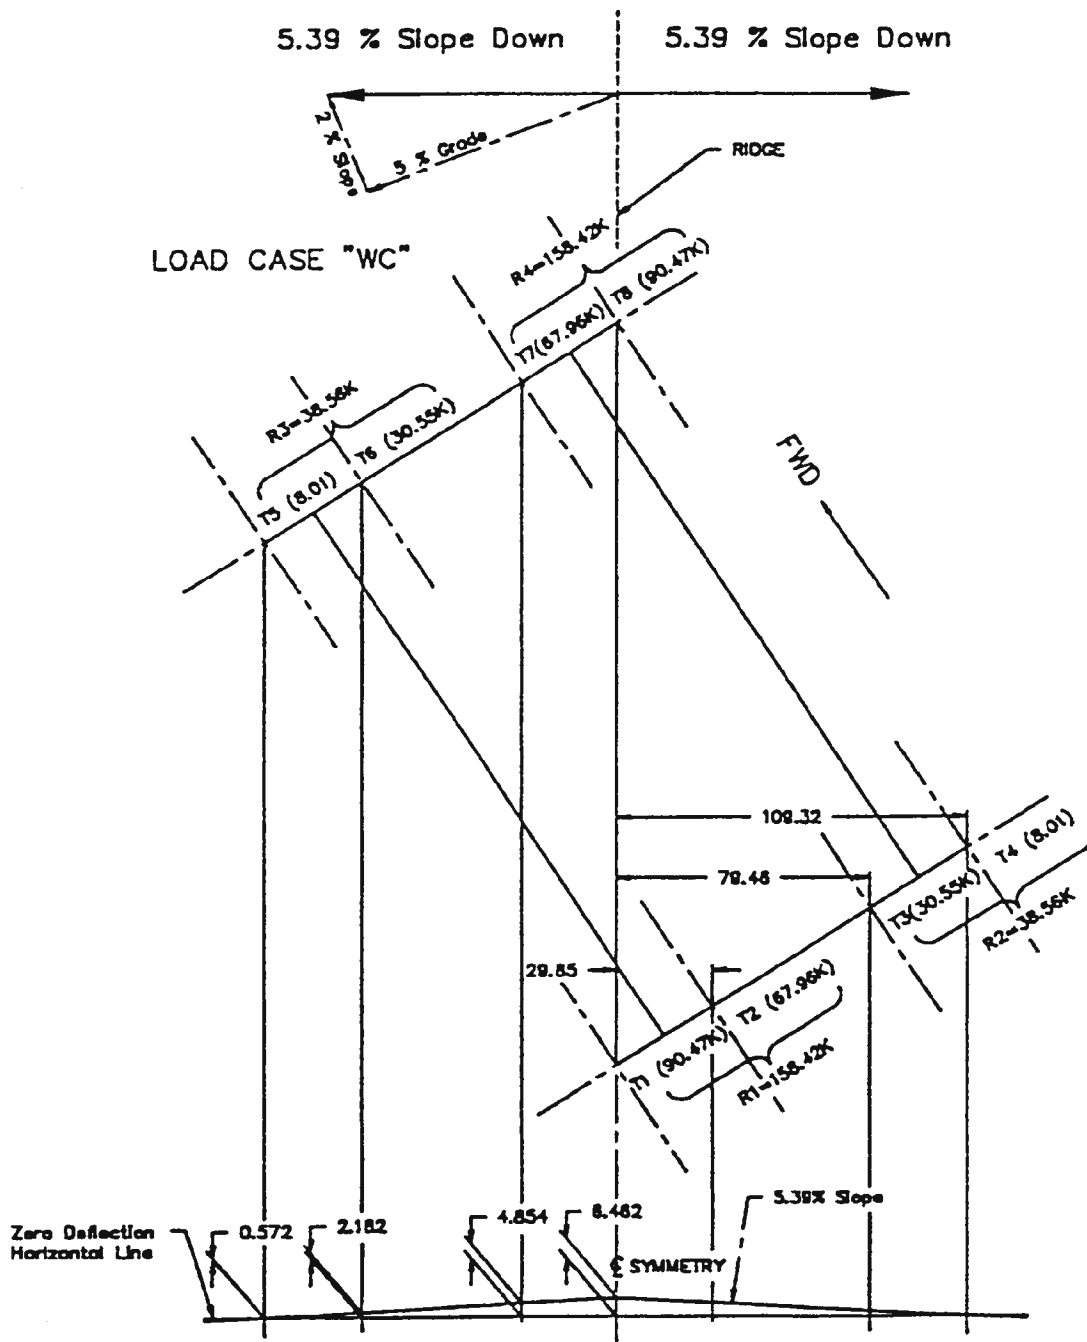

NOTE:


1. REF: EDERER CALCULATION
NO. D-15372, REV. B, p. 1-24

Rev 3 4/94

Figure 4.3-3
CYCLIC LOAD, TIRE VERTICAL REACTIONS (RIDGE UNDER T1 AND T8)

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

CYCLIC LOAD, TIRE VERTICAL REACTIONS (RIDGE UNDER T1 AND T8)

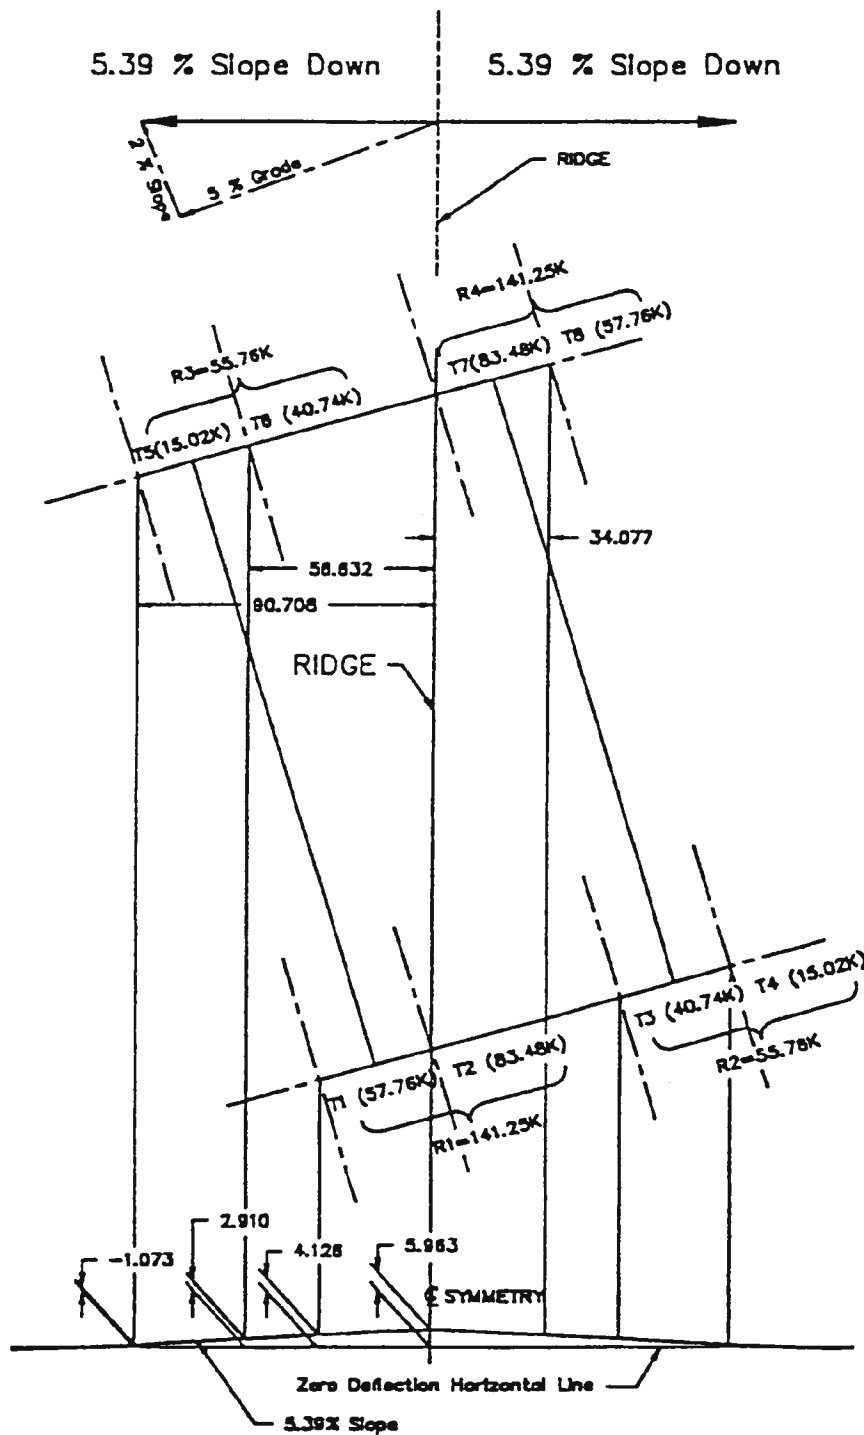

Rev 3 4/94


NOTE:

1. REF: EDERER CALCULATION
NO. D-15372, REV. B, p. 1-27

Figure 4.3-4
CYCLIC LOAD, TIRE VERTICAL REACTIONS (RIDGE UNDER T2 AND T7)

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

CYCLIC LOAD, TIRE VERTICAL REACTIONS (RIDGE UNDER T2 AND T7)

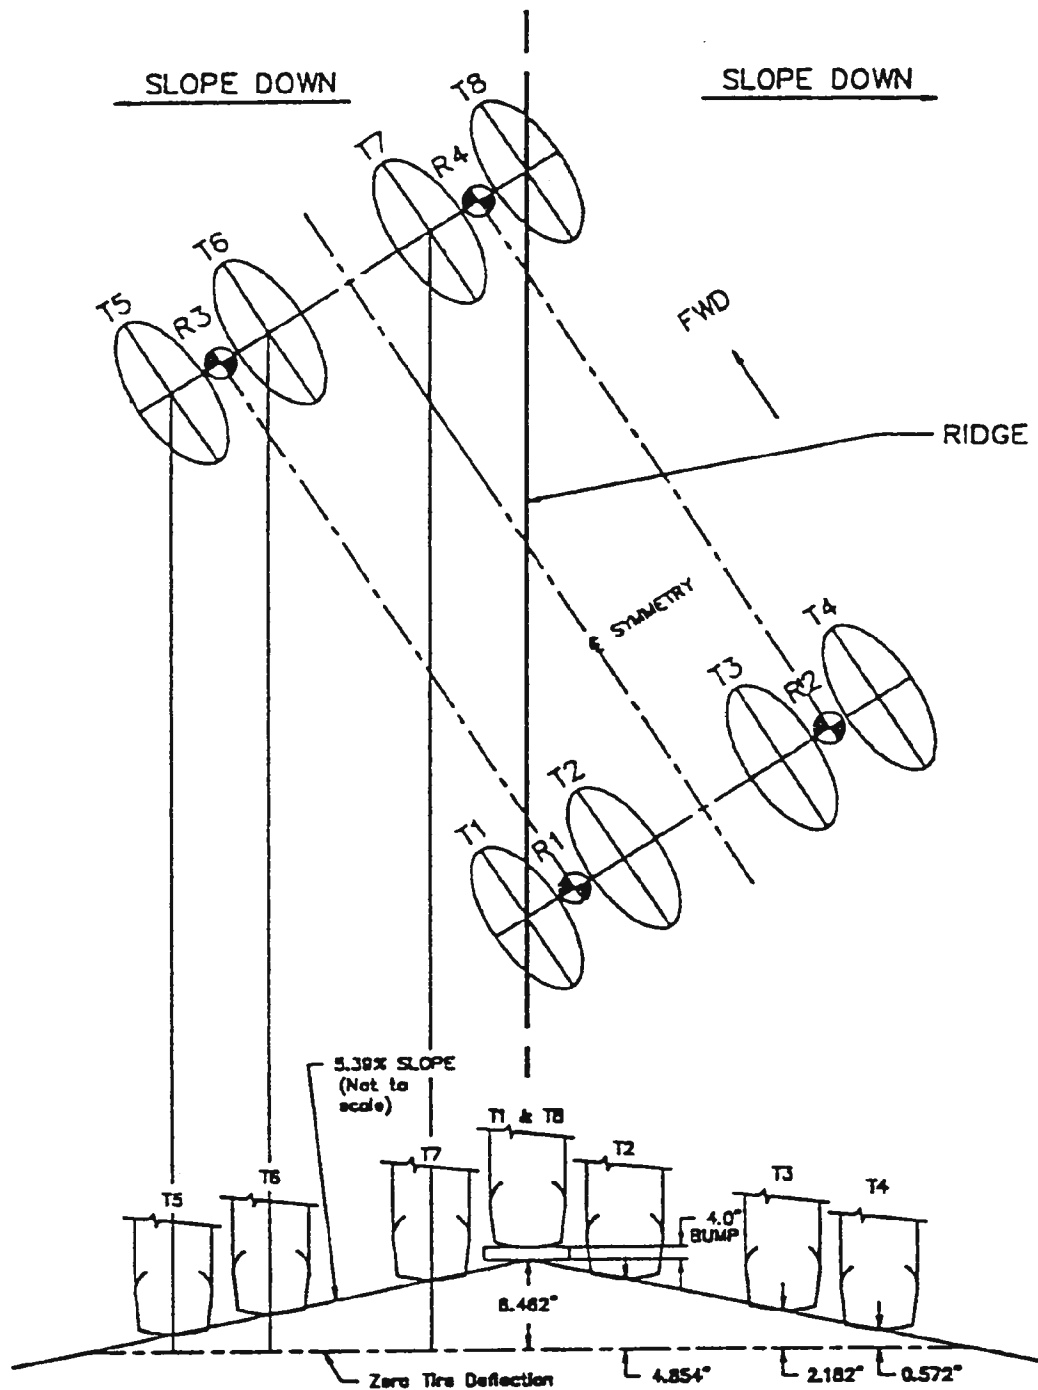

Rev 3 4/94


NOTE:

1. REF: EDERER CALCULATION
NO. D-15372, REV. B, p.1-29

Figure 4.3-5
WORST CASE LOAD, TIRE VERTICAL
REACTIONS (4" BUMP UNDER T1 AND T8)

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

WORST CASE LOAD, TIRE VERTICAL REACTION (4" BUMP UNDER T1 AND T8)

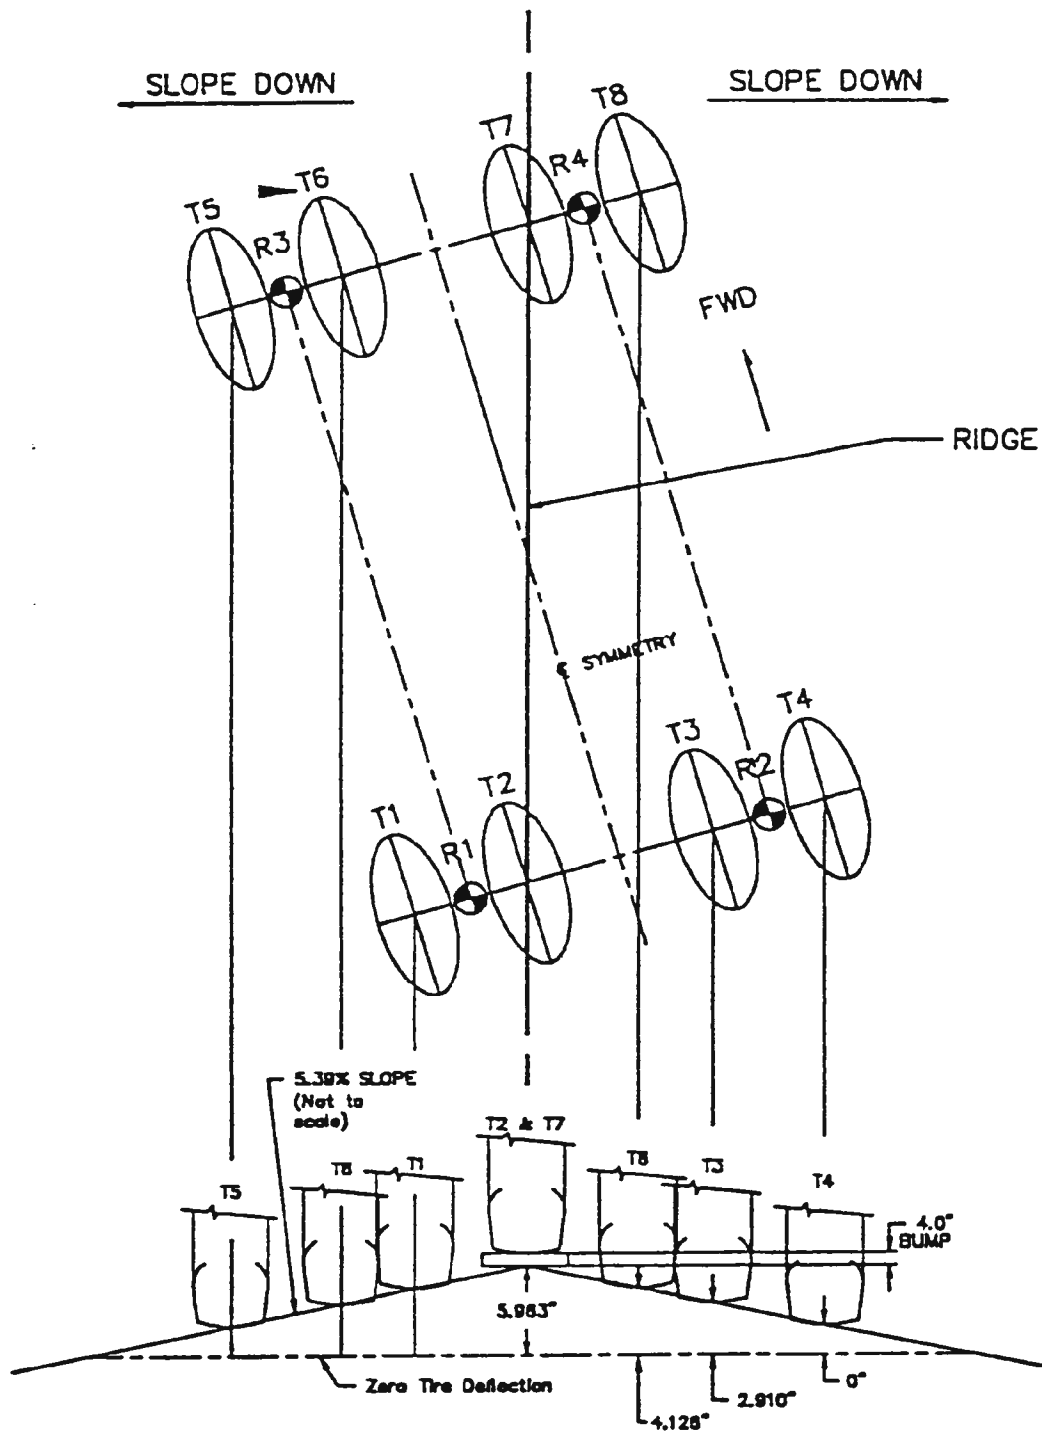

Rev 3 4/94

NOTE:


1. REF: EDERER CALCULATION
NO. D-15372, REV. B, p.1-33

Figure 4.3-6

**WORST CASE LOAD, TIRE VERTICAL
REACTIONS (4" BUMP UNDER T2 AND T7)**

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

WORST CASE LOAD, TIRE VERTICAL REACTION (4" BUMP UNDER T2 AND T7)

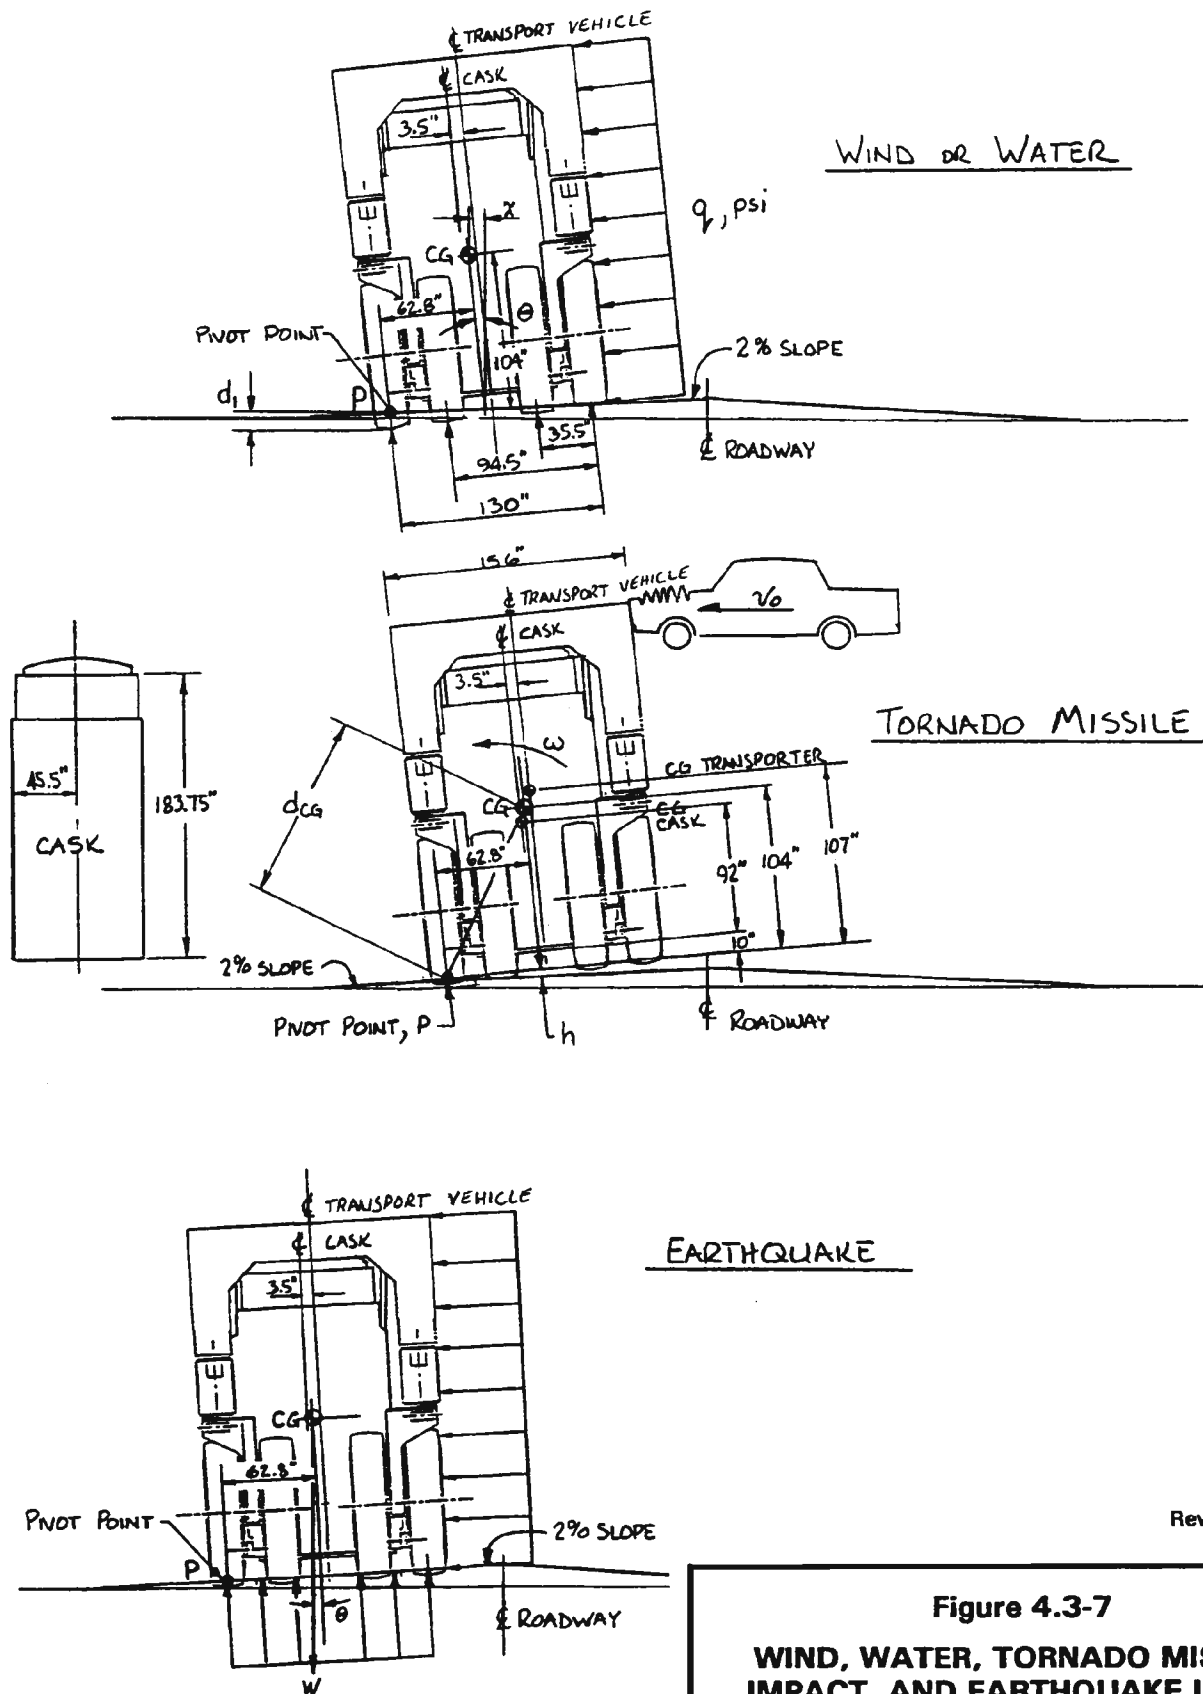

Rev 3 4/94

Figure 4.3-7
WIND, WATER, TORNADO MISSILE
IMPACT, AND EARTHQUAKE LOADS

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT


WIND, WATER, TORNADO MISSILE IMPACT, AND EARTHQUAKE LOADS

Security-Related Information Figure Withheld Under 10 CFR 2.390.

Rev. 0 8/90

Figure 4.4-1
LOAD PATH FOR SPENT
FUEL CASK - PLAN VIEW
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

LOAD PATH FOR SPENT FUEL CASK - PLAN VIEW

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY: **VLS**

REVISION: **0**

PAGE. NO.

DATE: 04-19-06

FIG4.4-1_REV_0


Security-Related Information Figure Withheld Under 10 CFR 2.390.

Rev. 0 8/90

Figure 4.4-2
LOAD PATH FOR SPENT FUEL CASK-
ELEVATION A (LOOKING EAST)

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

LOAD PATH FOR SPENT FUEL CASK - ELEVATION A (LOOKING EAST)

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY: VLS

REVISION: 0

PAGE. NO.

DATE: 04-19-06

FIG4.4-2_REV_0

Security-Related Information Figure Withheld Under 10 CFR 2.390.

Rev. 0 8/90

Figure 4.4-3
LOAD PATH FOR SPENT FUEL CASK -
ELEVATION B (LOOKING SOUTH)
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

LOAD PATH FOR SPENT FUEL CASK - ELEVATION B (LOOKING SOUTH)

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY: VLS

REVISION: 0

PAGE. NO.

DATE: 04-19-06

FIG4.4-3_REV_0

APPENDIX 4A

STRUCTURAL ANALYSIS OF THE TN-40 CASK BODY

4A.1 INTRODUCTION

This appendix presents the structural analysis of the TN-40 storage cask body which consists of the cask body, the trunnions and the outer shell. Analyses are performed to evaluate the various cask components under the loadings described in **Section 3.2**. Additional analyses are provided in Chapter 8 to evaluate the cask body under hypothetical accident loadings.

The detailed calculations for the cask body are presented in Section 4A.3 and the lid bolt analysis is reported in a separate Section 4A.4. The calculations for the trunnions and outer shell are reported in Sections 4A.6 and 4A.7, respectively.

The design criteria used in the analyses of the cask components are in accordance with the ASME Code, Section III, Subsection NB, (Reference 1). The material properties used are those obtained from the Code appendices (Reference 2). Key dimensions of the storage cask are shown in Figure 4A.1-1.

4A.2 MATERIALS PROPERTIES DATA

This section provides the mechanical properties of materials used in the structural evaluation of the TN-40 storage cask. Table 4A.2-1 lists the materials selected, the applicable components, and the minimum yield, ultimate, and design stress values specified by the ASME Code. All values reported in Table 4A.2-1 are for metal temperature up to 100°F. For higher temperatures, the temperature dependency of the material properties is reported in Table 4A.2-2.

Table 4A.2-3 is provided to summarize thermal analysis results from Chapter 3 which support the selection of cask body component design temperatures for structural analysis purposes.

4A.3 CASK BODY STRUCTURAL ANALYSIS

4A.3.1 DESCRIPTION

The cask body as shown in Figure 4A.1-1 consists of:

1. A 1 1/2-in. thick inner vessel with a welded flat bottom, a flange at the top, and a lid bolted to the flange by 48, 1 1/2" diameter high strength bolts and sealed with two metallic o-rings. This is the containment vessel, i.e. the primary containment boundary of the cask.
2. A thick cylindrical vessel with a welded flat bottom surrounding the containment. This vessel and a lid disc welded to the lid inner surface provide the gamma shielding.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-2

The lid and the flange are carbon steel forgings as are the gamma shielding components. The cask body is designed as a Class 1 component in accordance with the rules of the ASME Code. A static, linear elastic analysis is performed on the cask body so that combinations of loads can be obtained by superposition of individual loads. The stresses and deformations due to the applied loads are generally determined using the ANSYS computer program (Reference 4). A 2D ANSYS Model was specifically developed for this purpose. Exceptions include the analyses of the local effects at the trunnions and of the lid bolts.

4A.3.2 ANSYS CASK MODEL

A two-dimensional ANSYS model is used to evaluate the stresses in the cask body due to the individual load cases. The finite elements used in the model are the axisymmetric shell element, STIF 61, and the axisymmetric harmonic element, STIF 25. Both of these elements consider axisymmetric and non-axisymmetric loadings.

The cylindrical containment shell and bottom are modeled using STIF 61 elements. The remainder of the cask body is modeled with STIF 25 elements except the lid bolts for which the two dimensional elastic beam, STIF 3 is used. The finite element model of the cask body is shown in Figure 4A.3-1.

Figure 4A.3-2 shows an enlarged view of the bottom corner with the weld joining the gamma shielding flat bottom to cylinder simulated by coupling nodes 67-203 and 63-202.

The weld connecting the gamma shielding cylinder to the containment flange is simulated by coupling nodes 348-178 and 349-182 as shown in Figure 4A.3-3. Also shown in this figure are the lid bolts connecting the lid to the containment flange. The connection is simulated by coupling nodes 800, 801 and 802 of the bolts to the corresponding nodes 159, 160, and 161 of the flange; and nodes 804, 805, and 806 of the bolts to the corresponding nodes 571, 567 and 575 of the lid. In this manner the threaded portion of the bolt is fixed to the flange while the bolt head is fixed to the top surface of the lid. In order to prevent the lid from moving into the flange, nodes 157 and 564 are also coupled in the axial or Y direction. The enlarged view in Figure 4A.3-4 shows the coupling of nodes 458-552 and 463-556 which simulates the weld connecting the containment lid to the gamma shielding disc.

The pairs of nodes listed above, with the exception of nodes 157-564, are coupled in the X, Y and Z directions. The coupling of nodes 157-564 is in the Y direction only and is accomplished using a constraint equation. The reaction at the nodes is monitored during the analysis to insure that tensile forces between the cylinder and the lid are not developed.

Appropriate boundary conditions are applied to prevent rigid body motion and to show that the system of forces applied to the cask in each of the individual load cases is in equilibrium. Generally a node at the center of the vessel bottom is held in all directions and one at the center of the lid is held in the X and Z directions.

4A.3.3 INDIVIDUAL LOAD CASES

Individual load cases are evaluated to determine the stress contribution due to specific individual loads. Stress results are reported in this Appendix for each individual load. Since the individual load cases are linearly elastic, their results can be ratioed and/or superimposed as required in order to obtain the load combinations characteristic of the particular loading condition.

The following individual loads are analyzed using the ANSYS model described in the previous section:

1. Bolt preload and seal seating pressure.
2. Internal Pressure loading.
3. External Pressure loading.
4. 1 g down with cask standing in a vertical position on the concrete storage pad.
5. Lifting (Cask Vertical)
6. Worst thermal condition.
7. 1 g lateral and 1 g down bounding loads on the cask standing in a vertical position on the concrete pad.

Loadings for Cases 1 through 6 are axisymmetric. In Case 7 Fourier series representation of the nonaxisymmetric loads are required. Each discrete load acting on the cask body is expanded into a Fourier series and is input into ANSYS as a series of load steps. Each load step contains all of the terms from the applied loads having the same mode number. The number of terms in the Fourier series required to adequately represent a load varies with the type of load (concentrated or distributed) and the degree of accuracy required. In this case, the load applied by the internals to the inside wall of the containment is assumed to be a distributed load varying sinusoidally in the arc 90° to 270° and acting on the total length of the cavity. Figure 4A.3-5 shows that only a few terms of the series are required to get a satisfactory representation of the load.

Since Case 7 is asymmetric, the resulting stresses are also asymmetric. Therefore in order to properly characterize the stress condition in the cask body, results are obtained at the two worst diametrically opposite locations and reported for the location where they are maximum.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-4

The individual loads are described in the following paragraphs:

1. Bolt Preload and Seal Seating Pressure

A lid bolt preload corresponding to 25,000 psi direct stress in the bolt shank is simulated by specifying an initial strain in the elements representing the bolts. A portion of this strain becomes elastic preload strain in the bolts, and a portion becomes strain in the clamped parts. The required initial strain value of 0.00134 in/in (in the bolts) was determined by trial and error.

The selected bolt preload is sufficient to insure a full seating of the metallic seals under a maximum design internal pressure of 100 psig. The metallic seal seating load is 2198 lb./in./seal (Reference 5) or 4396 lb./in. for 2 seals. This load is simulated by applying a pressure of 1946.48 psi on an annular ring on both the containment lid and flange surfaces as shown in Figure 4A.3-6.

2. Internal Pressure Loading

A conservative design pressure of 100 psig is used as the maximum pressure acting in the containment vessel cavity as shown in Figure 4A.3-7

3. External Pressure Loading

A pressure of 25 psig is used as the maximum external pressure acting on the outer surface of the cask body as shown in Figure 4A.3-8.

4. 1 g Down

The cask is stored vertically on the concrete storage pad as shown in Figure 4A.3-9, with the following loads acting on it:

- a. A distributed vertical down inertia force of 1 g acting at each finite element in the model. For practical purposes, the resultant of all these forces is shown acting at the C.G. of the cask. Note that the resin, the outer shell and the trunnions are not included in the model. They are accounted for by increasing the density of the gamma shielding.
- b. Since the internals are not included in the model, their loading effects are simulated by a distributed pressure acting on the inside bottom surface of the cask cavity.
- c. A vertical up reaction from the concrete pad is simulated as a uniformly distributed pressure acting on the outside bottom surface of the cask body. All of these forces acting on the cask form a system of forces in equilibrium

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-5

5. Lifting Cask Vertical

The cask is oriented vertically in space held by the 2 top trunnions and subjected to a vertical down load of 3 g, as shown in Figure 4A.3-10.

The inertia force acting on the cask elements and the pressure from the internals on the containment bottom inner surface are as described in Case 4 multiplied by a factor of 3. The pressure p at the bottom outer surface is eliminated and replaced by forces applied to the top 2 trunnions so that the system of forces acting on the cask is again in equilibrium. The cask weight of 250,000 lb. is used in calculations. The two trunnion forces $F_{TR} = 1.5W$ are replaced by a uniform line force

$$q_y = \frac{3W}{2\pi R} - \frac{3 \times 250,000}{2 \times 3.14 \times 45.5} = 2,623.43 \text{ lb./in.}$$

acting in the Y direction on the outer surface of the gamma shielding at the trunnion location. Superimposed on this solution are the local trunnion effects at two locations around the circumference which are determined by using the Bijlaard method. 1 g Down

6. Worst Temperature Distribution in the Cask Body (Off-Normal Condition)

A thermal analysis of the cask body using a 3D ANSYS thermal model is described in Chapter 3. The thermal model is used to obtain the steady state metal temperatures in the cask body for the off-normal condition which includes 100°F ambient air temperature, maximum decay heat and maximum solar heat loading. These temperatures are then used as ANSYS input for the thermal stress analysis.

7. 1 g Lateral and 1 g down Bounding Loads - Cask Standing in a Vertical Orientation on the Pad

The $\sin\theta$ and $\cos\theta$ terms of the Fourier series are used to represent the 1 g lateral load acting at the CG of each finite element of the model. The load applied by the internals to the inside surface of the containment is assumed to vary sinusoidally on a 180° arc as shown in Figure 4A.3-5, and the same Fourier representation applies. The 1 g down load is applied simultaneously (as described in 4, above) with the 1 g lateral load. The cask is held at the bottom and no tilting or sliding is allowed (See Figure 4A.3-11). This load combination is an upper bound loading for tornado wind, flood water, seismic loads, etc. (See Table 3.2-4).

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-6

Stress results for these individual loads are reported in Tables 4A.3.3-1 through 4A.3.3-07. Figure 4A.3-12 shows the locations on the cask body, where stress results are reported. These locations are divided into two groups, containment and non containment. Stress components and stress intensities at nodal locations on the inner and outer surfaces of each cask body component are reported in these tables.

These results are provided in this report to indicate the relative significance of the individual loads. These point-wise results are combined below in Section 4A.3.5 with each other and with the results of several hand computations to provide results for the various load combinations which are compared to the design criteria in Section 4.

4A.3.4 ADDITIONAL CASK BODY ANALYSES

Two additional analyses of the cask body were performed using classical methods rather than the ANSYS finite element method. These analyses determined the maximum stresses at local points on the body: (a) due to the trunnion reactions (while lifting the cask) and (b) in the locations where tornado missile impact might occur. The stress intensities from these loadings are combined with those from the other FEA loadings in Section 4A.3.5, below.

4A.3.4.1 TRUNNION LOCAL STRESSES

This section discusses the analysis performed to calculate the local stresses in the cask body outer gamma shielding at the trunnion locations due to the loadings applied through the trunnions. These local effects are not included in the ANSYS stress result tables reported above in Section 4A.3.3. The local stresses must be superimposed on the above stress results for the cases where the inertial lifting loads are reacted at the trunnions. The local stresses are calculated in accordance with the methodology of WRC Bulletin 107 (Reference 6) which is based on the Bijlaard analysis for local stresses in cylindrical shells due to external loadings.

Loading

The Bijlaard analysis was performed to support various structural evaluation cases. A summary of the trunnion loads is provided in Table 4A.3.4.1-1.

Section 4A.6 provides the analyses of the trunnions themselves under the limiting 6/10g lifting (cask vertical) loading. Those analyses were performed to demonstrate that the trunnions satisfy the ANSI N14.6 (Reference 11) design requirements for special lifting devices. The Bijlaard analysis described in this section was performed to verify that the trunnion induced stresses in the cask body are also acceptable.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-7

Method of Analysis

The local stresses induced in the cask body by the trunnions are calculated using Bijlaard's method. The neutron shield and thin outer shell are not considered to strengthen either the trunnions or the gamma shielding cylinder. The trunnion is approximated by an equivalent attachment so that the curves of Reference 6 can be used to obtain the necessary coefficients. These resulting coefficients are inserted into blanks in the column entitled "Read Curves For " in a standard computation form, a sample of which is attached as Table 4A.3.4.1-2.

The stresses are calculated by performing the indicated multiplication in the column entitled "Compute Absolute Values of Stress and Enter Result." The resulting stress is inserted into the stress table at the eight stress locations, i.e., AU, AL, BU, BL, etc. Note that the sign convention for this table is defined on the figure for the load directions as shown. The membrane plus bending stresses are calculated by completing Table 4A.3.4.1-2.

Model, Boundary Conditions and Assumptions

The cylindrical body is assumed to be a hollow cylinder of infinite length. This is conservative since end restraints reduce the local cylinder bending effects.

Input Data

The only required input data for this analysis, are the dimensions of the trunnion and the cylinder. These are obtained from Section 1.3 drawings. The dimensions and Bijlaard parameters are listed as follows:

LIST OF BIJLAARD PARAMETERS

| <u>Parameter</u> | <u>Parameter Description</u> | <u>Parameter Value</u> |
|---------------------------|-------------------------------------|-------------------------------|
| R_m | Mean radius of shell | 41.1475 in. |
| T | Wall thickness of shell | 7.295 in. |
| $\gamma = \frac{R_m}{T}$ | Shell Parameter | 5.64 |
| r_o | Outside radius of attachment | 6.0 in. |
| $B = \frac{.875r_o}{R_m}$ | Attachment parameter | 0.1275 in. |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-8

Results

Table 4A.3.4.1-3 summarizes the resulting local membrane stresses and bending (surface) stresses for the above loading conditions. These local stresses are combined with the finite element results at the same locations from Section 4A.3.3 above and compared with allowables in Section 4A.3.5 below.

4A.3.4.2 TORNADO MISSILE IMPACT

It is assumed that Missile A or Missile B, studied in Section 3.2.1.2.2 for cask stability, may impact against the cask during a tornado. That section concludes that Missile A, the automobile, could produce an impact force of 222,682 lb. over a 3 ft. x 6 ft. area of the cask producing an average contact pressure of 85.9 psi. Missile B, the wood plank, could deliver 442,080 lb. over 48 in.² producing a 9210 psi local contact pressure. Section 3.2.1.2.2 shows that Missile A has a greater effect on cask stability than does Missile B because of its greater momentum (mv_0 is greater for the 4000 lb. automobile at 50 mph than for the 200 lb. plank at 300 mph). However, in this section a quasi-static analysis is performed for the conditions of peak impact where Missile B delivers greater force and applies it to a smaller area than does Missile A.

Missile B is assumed to have the highest crush strength of any wood in Table 2, page 6-147 of Marks Handbook (Reference 7). That table lists a crush strength of 9210 psi for hickory. Therefore the impact force could reach the crush strength x end area for end impact of the plank (9210 psi x 4 in. x 12 in. = 442080 lb.). The minimum yield stress of the SA-105 gamma shielding forging material is 36,000 psi at room temperature and 31,900 psi at 300°F. Therefore the wood plank will crush before it penetrates the forged steel cask. Local damage of the neutron shielding might occur since the outer shell is relatively thin, but neither the massive gamma shielding forging nor the containment vessel (inside of the gamma shielding) will be punctured.

If Missile B were to strike the gamma shielding, the shear stress around the plug of material loaded by the blank would be:

$$\begin{aligned}\tau_{shielding} &= \frac{Force}{shield\ thickness \times plank\ perimeter} = \frac{442,080 lb.}{8 in. \times 32 in.} \\ &= 1,727\ psi\end{aligned}$$

If it is assumed that the Missile B impact on the side of the cask is reacted by a 36 in. high cylindrical section of the gamma shielding as shown in Figure 4A.3-13, the bending stresses in the cylinder can be determined. If we consider the formula for Case 18 from Table VIII of Roark (Reference 8), the circumferential bending moment in the shielding ring is:

$$M_{max} = \frac{3}{2}WR^2 \text{ (maximum at section where } F \text{ is applied)}$$

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-9

where $2\pi RW = \text{Impact Force, } F$

$R = \text{mean radius of gamma shield, } 41.5 \text{ in.}$

$F = \text{Impact Force, } 442,080 \text{ lb.}$

$$\text{then, } W = \frac{F}{2\pi R} = \frac{442,080}{2\pi \times 41.5} = 1,695 \text{ lb./in.}$$

$$M_{\max} = \frac{3}{2} \times 1,695 \times 41.5^2 = 4.38 \times 10^6 \text{ in.lb.}$$

The bending stress in the ring is:

$$P_{\text{shielding}} = \frac{M_{\max} C}{I \text{ of } 36 \text{ in. ring}} = \frac{4.38 \times 10^6 \times \frac{8}{2}}{1/12 \times 36 \times 8^3} = 11,405 \text{ psi}$$

The membrane stress is quite small.

If the plug shear stress of 1,727 psi is combined with this bending stress, the resulting stress intensity is:

$$SI_{\text{shielding}} = (11405^2 + 4 \times 1727^2)^{1/2} = 11,916 \text{ psi}$$

This stress intensity is far below the Level D allowable for SA-105 shielding material. This stress intensity will be combined with those for other loads and evaluated in Section 4A.3.5 below. The shield cylinder surrounds and protects the containment vessel so that containment stresses are negligible if the missile strikes the side of the cask.

If missile B were to strike the top of the cask, it could puncture the weather cover and neutron shield. The shear stress in the lid would be:

$$\tau_{\text{lid}} = \frac{\text{Force}}{\text{lid thickness} \times \text{plank perimeter}} = \frac{442,080 \text{ lb.}}{4.5 \text{ in.} \times 32 \text{ in.}} = 3,070 \text{ psi}$$

If we idealize the lid loaded by the impact force as indicated in Figure 4A.3-14, we can determine the lid bending stresses. Roark, in Case 2 from Table X, indicates that the bending stress in the center of the lid in both radial and tangential directions is:

$$P_{\text{bid}} = \frac{3F}{2\pi m t^2} \left[m + (m+1) \ln \frac{a}{r_o} - (m-1) \frac{r_o^2}{4a^2} \right]$$

r_o is the radius of the area where the load is applied

$$\pi r_o^2 = 4 \times 12 = 48 \text{ in.}^2 \text{ (end area of plank)}$$

$$r_o = (48/\pi)^{1/2} = 3.91 \text{ in.}$$

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-10

$$m = 1/\text{Poisson's ratio} = 3.33$$

$$t = \text{lid thickness} = 4.5 \text{ in.}$$

$$a = \text{lid radius @ flange inside} = 36 \text{ in.}$$

$$P_{b_{lid}} = \frac{3 \times 442,080}{2\pi \times 3.33 \times 4.5^2} \left[3.33 + 4.33 \ln \frac{36}{3.91} - (2.33) \frac{3.91^2}{4 \times 36^2} \right] = 40,483 \text{ psi}$$

Combining the bending stress with the plug shear stress:

$$SI_{lid} = (40483^2 + 4 \times 3070^2)^{1/2} = 40,945 \text{ psi}$$

This stress intensity is below the Level D allowable for the SA 350 LF3 lid material. This value will be combined with other cases and evaluated in Section 4A.3.5 below.

4A.3.5 EVALUATION (LOAD COMBINATIONS VS. ALLOWABLES)

The TN-40 cask loading conditions are listed in Section 3.2, Table 3.2-5. The individual loads acting on the various cask components due to these loading conditions have been applied to the cask and the resulting stresses are reported above in Tables 4A.3.3-1 through Table 4A.3.3-7.

The loading conditions listed in Table 3.2-5 are categorized according to the rules of the ASME Code, Section III, Subsection NB for Class 1 nuclear components. These categories include Design (same as Primary Service), Level A and Level D loading conditions. See Tables 3.2-6 through 3.2-8 for these categories. Next, the load combinations are determined based on those loads that can occur simultaneously. The individual loads making up each combination are indicated in Table 3.2-9.

The stress intensities for the combined load cases are evaluated at the locations indicated in Figure 4A.3-12 and compared to the stress limits associated with each service loading. To simplify the analysis only the containment shell stress limits were used in Tables 4A.3.5-1 through 4A.3.5-8. SA-203 Grade D containment shell stress limits are lower than the lid on the non containment stress limits (See Section 4.2.3.4, Tables 4.2-8 and -9 for containment and Table 4.2-10 for non containment).

The following conservative approach is used to arrive at the load combination stress intensities. At each location, instead of algebraically adding the corresponding stress components for the various load cases and determining the resulting stress intensity, the stress intensities for the various individual load cases are simply added together. The net stress intensity thus obtained is an upper bound value since it represents the absolute sum of the stresses rather than the algebraic sum (stress intensities have no signs). Also the membrane and bending stresses are not separated so the combined stress intensity is compared to the lower membrane allowable. In nearly all of the locations selected the stress intensities thus calculated are less than the membrane allowable. At those two locations where this simple conservative approach does not show margin, the membrane and bending stresses are separated.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-11

The stress intensities at the selected locations for the Design, Level A and Level D combinations listed in Table 3.2-9 are reported in Tables 4A.3.5-1 through 4A.3.5-8. The containment stress limits for each case are also listed at the bottom of each table. See Chapter 8 for additional analyses of the cask body under hypothetical accident conditions. An additional condition not listed in Tables 3.2-5 or 3.2-9 that was evaluated is cold rain on a hot cask. Only the top of the cask body between the weather cover and neutron shield is directly exposed to rain. The major portion of the cylindrical length is protected by the neutron shield and outer shell. The analysis was based on the conservative assumption that the temperature of the outer skin of the cask body not covered by the outer shell is suddenly chilled to 32°F. The rest of the cask body is at the Off-Normal temperature distribution previously used.

This temperature distribution produces a peak stress of 52,474 psi in the containment flange at location 19. This stress is added to the maximum design stress of 4,389 psi, resulting in a total stress of 56,863. The stress is assumed to vary from 0 to the maximum value shown above; hence the maximum alternating stress is $S_a = 1/2 \times 56,863 = 28,432 \text{ psi}$. The allowable number of cycles, N_A , for this value of S_a is obtained from Figure I-9.1 of the ASME Code Section III Appendices and is 22,000 cycles. Note that the assumptions used to arrive at this value are very conservative.

4A.4 LID BOLT ANALYSES

4A.4.1 BOLT PRELOAD

The lid is secured to the cask body by forty eight 1.5 in. diameter UN-8 bolts. The selected bolt preload is such that the metallic containment seals are properly compressed and the lid seated against the flange with sufficient force to resist the maximum cavity internal pressure and any dead weight loads acting to unseat the lid. The corresponding tensile preload stress in the bolts at temperature is 25,000 psi (for dry bolt) which is less than the stress allowable for the bolt material for Design Conditions. The load per bolt is:

$$\begin{aligned} F_B &= A_B \times 25,000 \\ &= 1.492 \times 25,000 = 37,300 \text{ lb./bolt} \end{aligned}$$

The lubricated bolt preload stress of 51,000 psi need not be included in the "Design" condition. Since we have 48 bolts, the total seating force of all 48 bolts is:

$$48 F_B = 1,790,400 \text{ lb.}$$

The force required to seat the seals is a line load of 2,198 pounds per inch of seal circumference. The diameter of the outer seal is 75.9 in. and the diameter of the inner seal 74.3 in. The seal seating force is then:

$$F_{\text{seating}} = 2,198 \pi(75.9 + 74.3) = 1,037,164 \text{ lb.}$$

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-12

The maximum cask cavity internal pressure is the Design Pressure of 100 psi. The force required to react the pressure load, conservatively assuming the pressure is applied over the outer seal diameter, is:

$$F_{pressure} = 100 \frac{\pi}{4} (75.9)^2 = 452,453 \text{ lb.}$$

The TN-40 cask is always oriented vertically during loading, during transfer to the ISFSI and during storage on the pad. Dead weight of the lid and cask contents does not actually load the lid bolts. In fact the lid weight (and external pressure) help seat the lid. However, it is conservative to require that the bolt preload maintain lid seating in any cask orientation.

The weights of the lid, fuel and basket are:

| | |
|--------------------|---------------------|
| Lid Weight | = 15,599 lb. |
| Fuel Weight | = 52,000 lb. |
| Basket Weight | = <u>15,841</u> lb. |
| W _{Total} | 83,440 lb. |

The total of the seal seating force, pressure load and dead weight loads is:

| | |
|-----------------------|-----------------|
| F _{seating} | = 1,037,164 |
| F _{pressure} | = 452,453 |
| W _{tota} | = <u>83,440</u> |
| | 1,573,057 lb. |

Therefore the selected bolt preload stress of 25,000 psi provides ample lid seating force. The average bolt tensile stress required to react the lid loadings under Design Conditions is the preload stress of 25,000 psi which is well below the limiting value of S_m (31,900 psi) for the bolt material at 300°F.

4A.4.2 DIFFERENTIAL THERMAL EXPANSION

The 48 lid bolts preload the outer rim of the closure lid against the cask body flange. The 1.5 in. diameter bolts are installed through 1.56 in. diameter clearance holes in the 4.50 in. thick lid periphery. Preloading of the bolts against the lid is accomplished by tightening the bolts so that the shank portions of the bolts within the clearance holes are stretched elastically. The bolt loads will therefore change from the initial installed values if any thermal expansion differences should occur between the lid (through thickness direction) and the bolts.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-13

The bolt material is SA 320 Grade L43 (1 3/4 Ni 3/4 Cr 1/4 Mo). The lid and body flange are both SA 350 Grade LF3 (3 1/2 Ni). The Section III Code Appendices specify the same coefficient of thermal expansion for these materials. The bolts are in intimate contact with the lid and flange and will therefore operate at the same temperature as these components. Therefore there will be no thermal expansion differences between the lid and bolts, and the assembly preload will be maintained under all temperatures.

4A.4.3 BOLT TORSION

The torque required to preload the dry bolt is:

$$T = 0.2 D_N F_B$$

Where

$$A_B = \text{Bolt stress area} = 1.492 \text{ in.}^2$$

$$D_N = \text{Bolt nominal dia} = 1.5 \text{ in.}$$

$$F_B = 25,000 \text{ psi preload stress} \times A_B$$

The residual torque in the bolt is:

$$\begin{aligned} T_R &= 0.5625T = 0.5625 \times 0.2 \times 1.5 \times 1.492 \times 25,000 \\ &= 6,294 \text{ in.lb.} \end{aligned}$$

The shear stress in the bolt due to the residual torque from preload given by Reference 9:

$$\tau_{\text{torsion}} = \frac{T_R \times r}{J}$$

Where r and J are based on the bolt effective radius for the above stress area.

$$r = 0.689 \text{ in. effective bolt radius}$$

$$J = \frac{\pi^4}{2} = 0.354^4 \text{ in torsional moment of inertia of threaded bolt}$$

$$\tau_{\text{torsion}} = \frac{6,294 \times 0.689}{0.354} = 12,250 \text{ psi torsional shear}$$

4A.4.4 BOLT BENDING

It is assumed that bolt bending does not occur during seating of the lid against the cask body during assembly. The bolts are rotated as they are torqued so any slight relative movement between lid and body flange during preloading will not result in a net offset between the bolt head and tapped flange holes. In addition, since the lid, flange and bolt materials have the same coefficient of thermal expansion and will operate at essentially the same temperature, differential expansion between components will not produce bolt bending.

As internal pressure is applied to the cask cavity, the lid will bulge slightly and its edge will rotate. In addition the body cylinder radius will increase slightly due to the internal pressure resulting in outward radial movement of the tapped bolt holes in the body flange. Since no net membrane stress is developed in the lid, the lid bolt holes (at the mid surface) will remain at the original location. Rotation of the edge of the lid will, however, produce radial movement of the outer surface of the lid at the bolt head location.

The hoop stress in the cask body cylinder is:

$$S_{hoop} = \frac{PR_i}{t}$$

where $P = 100$ psi Design Pressure

$R_i = 36$ in. inside radius

$t = 9.5$ in. thickness

$$S_{hoop} = \frac{100 \times 36}{9.5} = 378.9 \text{ psi}$$

The radial deflection at the bolt circle is:

$$\delta_{boltcircle} = R_{bc} \times \frac{S_{hoop}}{E}$$

$R_{bc} = 39.65$ in. bolt circle radius

$$\delta_{boltcircle} = \frac{39.65 \times 378.9}{28 \times 10^6} = 0.000537 \text{ in (outward motion)}$$

When pressure is applied to the lid, the edge rotation can be calculated assuming the lid is simply supported:

$$\theta = \frac{3W(m-1)R}{2\pi Emt^3} \text{ from Reference 8, Table X, Case 1}$$

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-15

where:

θ = edge rotation, radians

W = total applied load

m = 1/Poisson's ratio = 3.33

R = 37.95 in. outer seal radius

t = 4.5 in. lid thickness

$$\theta = \frac{3 \times 100 \times \pi \times 37.95^3 \times 2.33}{2\pi \times 28 \times 10^6 \times 3.33 \times 4.5^3} = 0.002248 \text{ radians}$$

Figure 4A.4-1 shows the net movement of the threaded hole and the point on the lid under the bolt head. If it is assumed that the bolt head doesn't slide on the lid surface, the head will be forced from position a to a' as the lid deflects. Point a' under the bolt head moves outward 0.005058 in. while the threaded hole moves only 0.000537 in. outward. The bolt head will be bent laterally by 0.005058 - 0.000537 in. or 0.00452 in. from the threaded end.

The bending model of the bolt is shown in Figure 4A.4-2. The moment on the bolt is calculated assuming the bolt is subjected to affect bending with the head and threaded end prevented from rotating. The model in Figure 4A.4-2 is half of a fixed-fixed beam with length $2l$ and center load $2P$ deflected δ at the center. If any end rotation occurred the moment would be reduced for a given deflection. For a cantilevered bolt free to rotate at the head, the bending moment would be reduced by one half. Therefore the assumption of fixed ends is the most conservative and results in the highest stress.

The shear force, P , and bending moment, M , are:

$$P = \frac{12EI\delta}{l^3} \text{ for a beam subjected to offset bending with ends prevented from rotating}$$

$$M = \frac{6EI\delta}{l^2}$$

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-16

Where

P = lateral load to deflect the bolt distance δ , lb.

δ = lateral displacement

= 0.00452 in.

E = Young's modulus, 28×10^6 psi @300 °F

I = bolt length in bending

= 4.625 in. (including tapped hole chamfer)

$I = \pi^4/4$

= 0.177 in.⁴ (r based on stress area of 1.492 in.²)

Therefore

$$M = \frac{6 \times 28 \times 10^6 \times 0.177 \times 0.00452}{4.625^2} = 6,283 \text{ in.-lb.}$$

$$P = \frac{12 \times 28 \times 10^6 \times 0.177 \times 0.00452}{4.625^3} = 2,712 \text{ lb.}$$

The bending stress in the bolt is

$$\sigma_b = \frac{Mr}{I} = \frac{6,283 \times 0.689}{0.177} = 24,457 \text{ psi}$$

The shear stress due to the lateral force is

$$\tau_p = P/A = 2712/1.492 = 1821 \text{ psi}$$

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-17

4A.4.5 COMBINED STRESSES

The total shear stress is then equal to the residual torsional shear stress plus that due to force P.

$$\tau_{total} = \tau_{torsion} + \tau_p = 12,250 + 1,821 = 14,071 \text{ psi}$$

The maximum tensile stress at two locations in the lubricated bolt is the preload stress plus the bending stress.

$$\sigma_{max} = 51,000 + 24,457 = 75,457 \text{ psi}$$

The combined stress intensity is:

$$\begin{aligned} SI &= \left(\sigma_{max}^2 + 4(\tau_{total})^2 \right)^{\frac{1}{2}} \\ &= \left(75,457^2 + 4 \times 14,074^2 \right)^{\frac{1}{2}} \\ &= 80,534 \text{ psi} \end{aligned}$$

For Level A conditions, the average bolt stress is limited to 2 S_m or 2 x 31,900 = 63,800 psi. The maximum bolt stress is limited to 3 S_m or 95,700 psi. We are well within these limits as well as the yield strength of the bolt material (also 95,700 psi). The lid bolt stresses are no different under Level D conditions than Level A conditions.

4A.5 BASKET ANALYSIS

This section has been deleted from Appendix 4A. See Appendix 4B for the complete Basket Analysis.

4A.6 TRUNNION ANALYSIS

This section provides the structural analysis of the TN-40 storage cask trunnions. The trunnions shown in Figure 4A.6-1 are SA-105 carbon steel forgings. They are attached to the cask body with groove welds. A flat surface is machined on the cask body outer surface at each trunnion location for this purpose.

The two top trunnions are used for lifting the cask and are designed to the requirements of ANSI N14.6 (Reference 11) for lifting devices for use with a single failure proof crane. They can support a loading equal to 6 times the weight of the cask without generating stresses in excess of the minimum yield strength of the material. They can also lift 10 times the weight of the cask without exceeding the ultimate tensile strength of the material.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-18

The lower trunnions are used to rotate the cask from a horizontal orientation to the vertical orientation. The lower trunnions will not be used to lift a loaded cask at Prairie Island. The lower trunnions are conservatively designed to half the load carried by the top trunnions and therefore can satisfy ANSI N14.6 if used with the top trunnions to lift a horizontal cask.

Figure 4A.6-1 shows the basic dimensions of the top and bottom trunnions. The cask total weight used in this calculation is $W = 250,000$ pounds. Table 4A.6-1 shows the cross sectional areas and moments of inertia at cross sections A-A and B-B of both upper and lower trunnions. In addition the loads applied to these sections (for 6 W and 10 W loading) to evaluate the yield and ultimate limits are listed.

Table 4A.6-2 presents a summary of the stresses at the same locations to compare against the yield and ultimate trunnion strengths. Also listed at the bottom of the table are the allowable stresses (yield and ultimate strengths).

The reported data shows that all of the calculated stresses in both the upper and lower trunnions are acceptable, and that the minimum margin of safety is 0.061 for the yield condition and 0.396 for the ultimate condition. Both minimums occur in the upper trunnion.

4A.7 OUTER SHELL

This section presents the structural analysis of the outer shell of the TN-40 storage cask. The outer shell consists of a cylindrical shell section and closure plates (segmented-welded together) at each end which connect the cylinder to the cask body. The normal loads acting on the outer shell are due to internal and external pressure and the normal handling operations. Membrane stresses due to the pressure difference and bending and shear stresses due to the handling loads are determined. These stresses are compared to the allowable stress limits in Section 4.2 to assure that the design criteria are met.

Description

The outer shell is constructed from low-alloy carbon steel and is welded to the outer surface of the cask body gamma shielding. The cylindrical shell section is constructed of 0.50 in. thick partial cylinders joined together with partial penetration welds and welded to the closure plates via partial penetration welds. The closure plates are 0.75 in. thick segments that may be joined together via partial penetration welds. Pertinent dimensions are shown in Fig. 4A.7-1 and Figure 1.3-2.

Materials Input Data

The outer shell cylindrical section and closure plates are SA 516-GR 55. The material properties are taken from the Reference 2, ASME Code, Section III, Appendices. The yield strength of the material is also obtained from the Appendices at a temperature of 300°F.

01136263

01136263

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-19

Applied Loads

It is assumed that a pressure of 25 psi may be applied to either the inside or outside of the outer shell. This bounding assumption envelops the actual expected pressures described in Section 3.2.5.

The handling loads acting on the outer shell are a result of lifting. The loads applied to the shell as a result of these operations consist of the values given in Section 3.2-5. The weight or inertia g load can include all of the weights of the outer shell, neutron resin shield, and aluminum containers. The most severe Design and Level A Condition load is the 3 g inertia load in the vertical lifting orientation. The shell is also analyzed for 3 g loading when the cask is oriented horizontally to ensure it is not damaged during delivery to Prairie Island.

Method of Analysis

The structural analysis of the neutron shield outer shell, closure rings, and attachment welds utilized a finite element model and the ANSYS code to determine the stresses. The ANSYS results were manually adjusted to conservatively account for the partial penetration welds of the closure plates. The ANSYS finite element model modeled the 0.5 inch outer shell, the 0.75 inch closure plates (modeled as solid plates) the welds attaching the outer shell to the closure plates, the weld attaching the top closure plate to the cask body and included two different weld configurations for attaching the bottom closure plate to the cask body. The weight of the resin and aluminum boxes used as inputs to the calculation agree with those listed in Table 3.2-1. Note that the model did not include the weld that joins the outer shell half cylinders together, see discussion below.

The outer shell is constructed of cylinders joined together via partial penetration welds. The stresses at these weld locations were previously analyzed for internal pressure and horizontal handling loads via conservative hand calculations. Since the welds run axially along the outer shell, there are no loads due to vertical handling of the cask. Since the previously analyzed stresses were calculated via a conservative hand calculation and since they were less than the limiting stresses, a finite element analysis of these welds would calculate stresses less than those reported herein.

As discussed above, the ANSYS finite element model modeled the top and bottom closure plates as solid 0.75 inch plates. To ease assembly during fabrication, these plates may be made of segments welded together with partial penetration welds. The stresses were determined by conservatively assuming that the entire thickness of the plate corresponded to the thickness of the weld material. Since stresses are inversely proportional to the square of the thickness of the plate, the limiting ANSYS results (25 psi + 3g handling in vertical position) were adjusted by the appropriate ratio at the junction between the top plate and the cask body (necessary since the plate was now assumed to be thinner than the original attachment weld), the remainder of the top plate, and the bottom plate.

01136263

4A.8 TOP NEUTRON SHIELD BOLTS

The top neutron shield (or resin disc) is bolted to the outside of the TN-40 lid using four SA-193, Gr B-8 bolts as indicated in Table 1.3-2 and Figure 1.3-2. The overpressure tank is attached to the upper surface of the shield. The weight of the overpressure tank is about 110 lbs and the weight of the top neutron shield is 1,692 lbs (Table 3.2-1) for a total component weight of 1,802 lbs attached through the four bolts.

The top neutron shield is necessary for the TN-40 cask to meet dose rate limits for Design and Level A conditions. Shielding analyses (Table 7A-4) show that the dose rate at the top of the lid without the neutron shield is well below the acceptable accident dose limit. Therefore the analysis below is limited to Design primary loadings. No analysis is needed for accident conditions in Chapter 8.

The neutron shield bolts have 1.25-7 UNC threads with a minor diameter of 1.0725 in. The stress area is at least $(\pi/4)(1.0725^2)$ or 0.9034 in². Under Design conditions the assembled and loaded (with fuel) TN-40 never experiences a net upward acceleration or a side load exceeding the 1.0g bounding load listed in Table 3.2-4. The tornado missile load is a Level D load. Nevertheless, a 3.0g upward or lateral load (not simultaneous) is assumed to conservatively evaluate these shield attachment bolts. The bolt stress under the 3.0g loading is equal to 3.0g x attached weight divided by the total bolt area. The stress is $3 \times 1,802 \text{ lbs} / (4 \times 0.9034 \text{ in}^2) = 1,496 \text{ psi}$. This is a tensile stress in the upward load case and a shear stress in the side load case.

These neutron shield attachment bolts are non-containment bolts. Therefore, the non-containment structure stress limits of Table 4.2-6 apply. The yield stress of SA-193, Gr B8 is 22,500 psi at 300°F. The allowable membrane stress is then $0.67(22,500)$ or 15,075 psi, and the allowable shear stress is $0.5(22,500) = 11,250 \text{ psi}$. The 1,496 psi applied stress (tension or shear) calculated above is well below the allowable and is therefore acceptable.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 12

Page 4A-21

4A.9 REFERENCES

1. American Society of Mechanical Engineers, ASME Boiler and Pressure Vessel Code, Section III, 1989.
2. American Society of Mechanical Engineers, ASME Boiler and Pressure Vessel Code, Appendices, 1989.
3. American Society of Mechanical Engineers, ASME Boiler and Pressure Vessel Code Section II, 1989.
4. De Salvo, G. J. and Swanson, J. A., ANSYS Engineering Analysis System, Users Manual for ANSYS Revision 4.3, Swanson Analysis Systems, Inc., Houston, PA, June 1987.
5. Resilient Metal Seals and Gaskets, Helicoflex Catalog H.001.002, Helicoflex Co., Boonton, N.J., 1983 pp.5-7.
6. WRC Bulletin 107, March 1979 Rev: "Local Stresses in Spherical and Cylindrical Shells Due to External Loadings."
7. Baumeister and Marks Standard Handbook for Mechanical Engineers, Sixth Edition.
8. Roark, R.J.: "Formulas for Stress & Strain", 4th Edition, McGraw-Hill Book Co.
9. Hopper, A.G. and Thompson, G.V. "Stress in Preloaded Bolts," Product Engineering, 1964.
10. Deleted
11. ANSI N14.6, "American National Standard for Special Lifting Devices for Shipping Containers Weighing 10,000 Pounds or More for Nuclear Materials," New York.
12. Timoshenko and Woinowsky-Krieger, Theory of Plates and Shells, Second Edition.
13. Safety Evaluation 72-425, TN-40 Cask Construction Issues During Cask 3 Fabrication, October 31, 1995.

THIS PAGE IS LEFT INTENTIONALLY BLANK

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 10

TABLE 4A.2-1

MECHANICAL PROPERTIES OF BODY MATERIALS (NOTE 1)

| MATERIAL SPECIFICATION (NOMINAL COMPOSITION) | APPLICATION | MINIMUM YIELD STRENGTH S_y psi | MINIMUM ULTIMATE STRENGTH S_u psi | DESIGN STRESS VALUE, PSI (NOTE 2) | DATA SOURCE (NOTE 3) |
|---|--------------------|---|--|--|------------------------------|
| ASME SA-350, Grade LF3 (3 ½ Ni) | Flange | 37,500 | 70,000 | S=17,500 | Table I-7.1 |
| ASME SA-203, Grade A & D | Containment Lid | | | | P. 140 (Note 4) |
| ASME SA-203, Grade E | Containment Vessel | 37,500 | 65,000 | S=16,200 | Table I-7.1 |
| ASME SA-320, Grade L43 | Containment Vessel | 40,000 | 70,000 | S=17,500 | P. 140 |
| (1 ¾ Ni ¾ Cr- ¼ Mo) | Closure Lid Bolts | 105,000 | 125,000 | S_m =35,000 | Table I-1.3, P. 42 |
| ASME SA-105 (C-Si) | Gamma Shielding | 36,000 | 70,000 | S_m =23,300 | Table I-1.1 P. 9 |
| ASME SA-516, Grade 55 (C-Si) | Trunnions | | | | |
| ASME SA-516, Grade 70 (C-Mn-Si) (Note 5) | Weather Cover | 30,000 | 55,000 | S=13,700 | Table I-7.1 P. 132 |
| | Outer Shell | | | | |
| | Gamma Shielding | 38,000 | 70,000 | S_m =23,300 | Table 2A, P. 298 (Note 6) |

NOTES

- Mechanical properties listed are for metal temperatures up to 100°F to provide a baseline comparison of all structural materials. Temperature dependent properties required for structural analysis are provided in Table 4A.2-2.
- Values listed are the stress parameters which form the basis for structural analysis acceptance criteria.
S refers to the ASME allowable stress for Class 2 or Class 3 components,
 S_m refers to the ASME design stress intensity for Class 1 components, and S_y refers to minimum yield strength.
- Data are taken from tables in ASME Section III, Appendix I, 1989 unless otherwise noted.
- Table I - 7.1 actually lists 40,000 psi for S_y . However, the ASME material specification data sheet (Reference 3) (ASME Section II, Part A, p. 409) lists 37,500. Since the stress allowable for this material is based on ultimate strength ($1/4 S_u$), this variation in quoted yield strength does not affect selection of an analysis acceptance criteria.
- Optional plate material used as a substitute for cask shell, bottom and shield plate SA-105 forged material.
- Data is taken from table in ASME Section II, Part D, Subpart 1, 1992.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 11

TABLE 4A.2-2
SHEET 1 OF 3

TEMPERATURE DEPENDENT MATERIAL PROPERTIES
COEFFICIENTS OF THERMAL EXPANSION (NOTE 1)

| MATERIAL | TEMPERATURE, °F | | | | | | | | | | |
|------------------------------------|------------------------|------------|------------|------------|------------|------------|------------|------------|------------|------------|------------|
| | 100 | 150 | 200 | 250 | 300 | 350 | 400 | 450 | 500 | 550 | 600 |
| SA-350,SA-320,SA-203 (Note 2) | 6.27 | 6.41 | 6.54 | 6.65 | 6.78 | 6.88 | 6.98 | 7.07 | 7.16 | 7.24 | 7.32 |
| SA-105 & SA-516, Gr 55 (Note 2) | 5.73 | 5.91 | 6.09 | 6.27 | 6.43 | 6.57 | 6.74 | 6.89 | 7.06 | 7.18 | 7.28 |
| SA-516, Gr 70 (Note 3) (Note 4) | 5.53 | 5.71 | 5.89 | 6.09 | 6.26 | 6.43 | 6.61 | 6.77 | 6.91 | 7.06 | 7.17 |

NOTES

1. Values listed are the mean coefficients of thermal expansion x 10⁻⁶ (in./in. °F) from 70° F to the indicated temperature.
2. Source of data is ASME Section III, Appendix I, Table I-5.0, p. 123-128.
3. Optional plate material used as a substitute for cask shell, bottom and shield plate SA-105 forged material.
4. Source of data is ASME Section II, Part D, Subpart 2, Table TE-1, p. 638, 1992.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 11

TABLE 4A.2-2
SHEET 2 OF 3

TEMPERATURE DEPENDENT MATERIAL PROPERTIES
MODULI OF ELASTICITY, E (NOTE 1)

| MATERIAL | TEMPERATURE, °F | | | | | |
|------------------------------------|------------------------|------------|------------|------------|------------|------------|
| | 70 | 200 | 300 | 400 | 500 | 600 |
| SA-203, SA-320, SA-350 (Note 2) | 27.8 | 27.1 | 26.7 | 26.1 | 25.7 | 25.2 |
| SA-516 Grade 55, SA-105 (Note2) | 29.5 | 28.8 | 28.3 | 27.7 | 27.3 | 26.7 |
| SA-516 Grade 70 (Note 3) (Note 4) | 29.3 | 28.6 | 28.1 | 27.5 | 27.1 | 26.5 |

NOTES

1. Values listed are the moduli of elasticity x 10⁶ psi for the indicated temperature.
2. Source of data is ASME Section III, Appendix I, Table I- 6.0, p. 129-138.
3. Optional plate material used as a substitute for cask shell, bottom and shield plate SA-105 forged material.
4. Source of data is ASME Section II, Part D, Subpart 2, Table TM-1, p.664, 1992

01029652

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 11

TABLE 4A.2-2
SHEET 3 OF 3

TEMPERATURE DEPENDENT MATERIAL PROPERTIES DESIGN STRESS PARAMETER

| MATERIAL | STRESS | TEMPERATURE, °F | | | | | | DATA SOURCE |
|------------------------------------|-----------------------|-----------------|-------|-------|--------------|-------|-------|---------------------------------|
| | PARAMETER (NOTE 1) | 100 | 200 | 300 | 400 | 500 | 600 | |
| SA-350, Grade LF3, SA-203, Grade E | S | 17.5 | 17.5 | 17.5 | 17.5 | 17.5 | 17.5 | Table I-7.1 p. 140 |
| SA-203, Grade A and D | S | 16.2 | 16.2 | 16.2 | 16.2 | 16.2 | 16.2 | Table I-7.1 p. 140 |
| SA-320, Grade L43 | S _y | 105.0 | 99.0* | 95.7* | 91.8* | 88.5* | 84.3* | Table I-1.3 p. 42. *(Note 3) |
| SA-105 | S _m | 23.3 | 21.9 | 21.3 | Not Required | | | Table I-1.1 p. 9 |
| | S _y | 36.0 | 32.8 | 31.9 | | | | Table I-2.1 p. 52 |
| | S _u | 70.0 | 70.0 | 70.0 | | | | Table I-3.1 p.85 |
| SA-516, Grade 55 | S _y | 30.0 | 27.3 | 26.6 | 25.7 | | | Table I-2.1 p. 50 |
| | S _m | 13.7 | 13.7 | 13.7 | 13.7 | | | Table I-7.1 p, 132 |
| SA-516, Grade 70 (Note 4) | S _m | 23.3 | 23.1 | 22.5 | Not Required | | | Table 2A p. 300 |
| | S _y | 38.0 | 34.6 | 33.7 | | | | Table y-1 p. 516 |
| | S _u | 70.0 | 70.0 | 70.0 | | | | Table U p. 481 (Note 5) |

NOTES

- Values listed are the stress parameters which form the basis for structural analysis acceptance criteria.
S refers to the ASME allowable stress for Class 2 or Class 3 components,
S_m refers to the ASME design stress intensity for Class 1 components, and
S_y refers to minimum yield strength.
- Data are taken from ASME Section III, Appendix I as noted.
- For bolting materials, S_y ≥ 3 S_m. Optional plate material used as a substitute for cask shell, bottom and shield plate SA-105 forged material.
- Optional plate material used as a substitute for cask shell, bottom and shield plate SA-105 forged material.
- Data is taken from ASME Section II, Part D, Subpart 1, 1992 as noted.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4A.2-3

**REFERENCE TEMPERATURES FOR
STRESS ANALYSIS ACCEPTANCE CRITERIA (TN-40 CASK)**

| COMPONENT | MAX. CALCULATED TEMPERATURE °F | SELECTED DESIGN TEMPERATURE °F |
|------------------|---|---|
| Cask Body | 303 | 300 |
| Cask Lid | 242 | 300 |
| Lid Bolts | 242 | 300 |
| Trunnions | 242 | 300 |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4A.3.3-1
BOLT PRELOAD
AND SEAL REACTION (TN-40 CASK)

| LOCATION | | MERIDIONAL STRESS (psi) | | HOOP STRESS (psi) | | STRESS INTENSITY SI (psi) | |
|--------------------------|-----------------|-------------------------|--------------|-------------------|---------------|---------------------------|------|
| | | OUTER SIGB S | INNER SIGT S | OUTER SIGB TH | INNER SIGT TH | | |
| CONTAINMENT VESSEL | | 1 | | -136 | | -137 | 137 |
| | | 2 | -52 | | -51 | | 52 |
| | | 3 | | -2148 | | -710 | 2148 |
| | | 4 | 1428 | | 363 | | 1428 |
| | | 5 | | -343 | | -102 | 343 |
| | | 6 | -342 | | -101 | | 342 |
| | | 7 | | -2444 | | -54 | 2444 |
| | | 8 | 1857 | | 1209 | | 1857 |
| | | STRESS COMPONENTS (psi) | | | | STRESS INTENSITY SI (psi) | |
| | | Sx | Sy | Sz | Sxy | | |
| CONTAINMENT FLANGE & LID | | 9 | -17 | -2359 | -1483 | -69 | 2347 |
| | | 10 | 495 | 2214 | 1159 | 815 | 2369 |
| | | 11 | -1314 | -36 | -1317 | 61 | 1284 |
| | | 12 | 2118 | 43 | 2061 | 128 | 2091 |
| Table A NON | GAMMA SHIELDING | 13 | -245 | 0 | -245 | 0 | 246 |
| | | 14 | 264 | -1 | 263 | 0 | 265 |
| | | 15 | -4 | 55 | 16 | 0 | 59 |
| | | 16 | 0 | 59 | 14 | 0 | 59 |
| | TRUNNION | 17 | 1 | -20 | 26 | -2 | 45 |
| | WELDS | 18 | 150 | -384 | -146 | -97 | 568 |
| | | 19 | -395 | 2432 | 807 | -484 | 2987 |
| | | 20 | -1458 | -5454 | -2982 | -2070 | 5754 |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4A.3.3-2

INTERNAL PRESSURE (100 PSIG) (TN-40 CASK)

| LOCATION | | MERIDIONAL STRESS (psi) | | HOOP STRESS (psi) | | STRESS INTENSITY SI (psi) | |
|--------------------------|-----------------|-------------------------|--------------|-------------------|---------------|---------------------------|------|
| | | OUTER SIGB S | INNER SIGT S | OUTER SIGB TH | INNER SIGT TH | | |
| CONTAINMENT VESSEL | | 1 | | -533 | | -223 | 433 |
| | | 2 | 297 | | -14 | | 311 |
| | | 3 | | 4148 | | 1058 | 4248 |
| | | 4 | -4385 | | -1295 | | 4385 |
| | | 5 | | 636 | | 584 | 736 |
| | | 6 | 590 | | 540 | | 590 |
| | | 7 | | 305 | | 151 | 405 |
| | | 8 | 915 | | 305 | | 915 |
| | | STRESS COMPONENTS (psi) | | | | STRESS INTENSITY SI (psi) | |
| | | Sx | Sy | Sz | Sxy | | |
| CONTAINMENT FLANGE & LID | | 9 | 142 | 400 | 529 | 186 | 593 |
| | | 10 | -717 | -756 | -449 | -176 | 464 |
| | | 11 | -859 | -44 | -882 | 23 | 839 |
| | | 12 | 2057 | 38 | 2010 | 122 | 2034 |
| Table B NON | GAMMA SHIELDING | 13 | -1164 | 51 | -947 | -25 | 1216 |
| | | 14 | 1300 | -112 | 1097 | -29 | 1413 |
| | | 15 | -73 | 92 | 389 | -1 | 462 |
| | | 16 | 1 | 76 | 311 | 0 | 310 |
| | TRUNNION | 17 | 0 | 224 | 370 | 13 | 370 |
| | WELDS | 18 | 444 | -1515 | -489 | -268 | 2031 |
| | | 19 | 259 | -767 | -221 | 312 | 1200 |
| | | 20 | -2402 | -399 | -756 | -789 | 2549 |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4A.3.3-3
EXTERNAL PRESSURE (25PSIG) (TN-40 CASK)

| LOCATION | | MERIDIONAL STRESS (psi) | | HOOP STRESS (psi) | | STRESS INTENSITY SI (psi) |
|--------------------------|-----------------|-------------------------|--------------|-------------------|---------------|---------------------------|
| | | OUTER SIGB S | INNER SIGT S | OUTER SIGB TH | INNER SIGT TH | |
| CONTAINMENT VESSEL | 1 | | 110 | | 113 | 113 |
| | 2 | -69 | | -71 | | 71 |
| | 3 | | -1838 | | -537 | 1838 |
| | 4 | 1366 | | 425 | | 1366 |
| | 5 | | -221 | | -174 | 221 |
| | 6 | -220 | | -174 | | 220 |
| | 7 | | -472 | | -144 | 472 |
| | 8 | 51 | | 7 | | 51 |
| | | STRESS COMPONENTS (psi) | | | | STRESS INTENSITY SI (psi) |
| | | Sx | Sy | Sz | Sxy | |
| CONTAINMENT FLANGE & LID | 9 | -49 | -126 | -265 | -60 | 249 |
| | 10 | 223 | 287 | 127 | 52 | 190 |
| | 11 | 195 | -15 | 202 | -4 | 216 |
| | 12 | -558 | -35 | -544 | -34 | 527 |
| Table C NON | GAMMA SHIELDING | 13 | 479 | -2 | 483 | 485 |
| | | 14 | -562 | -22 | -566 | 544 |
| | | 15 | -7 | -44 | 0 | 113 |
| | | 16 | -25 | -40 | 0 | 76 |
| | TRUNNION | 17 | -25 | -71 | -118 | 93 |
| | WELDS | 18 | -163 | 432 | 125 | 617 |
| | | 19 | -136 | 297 | 48 | 511 |
| | | 20 | 596 | 58 | 173 | 663 |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4A.3.3-4

**1 g DOWN – TN-40 CASK STANDING IN A
VERTICAL POSITION ON A CONCRETE PAD**

| LOCATION | | MERIDIONAL STRESS (psi) | | HOOP STRESS (psi) | | STRESS INTENSITY SI (psi) | |
|--------------------------|-----------------|-------------------------|--------------|-------------------|---------------|---------------------------|------|
| | | OUTER SIGB S | INNER SIGT S | OUTER SIGB TH | INNER SIGT TH | | |
| CONTAINMENT VESSEL | | 1 | | 198 | | 198 | |
| | | 2 | -30 | | -5 | | 30 |
| | | 3 | | -872 | | -167 | 872 |
| | | 4 | 1046 | | 342 | | 1046 |
| | | 5 | | -76 | | -14 | 76 |
| | | 6 | -76 | | -14 | | 76 |
| | | 7 | | 45 | | -3 | 48 |
| | | 8 | -163 | | -65 | | 163 |
| | | STRESS COMPONENTS (psi) | | | | STRESS INTENSITY SI (psi) | |
| | | Sx | Sy | Sz | Sxy | | |
| CONTAINMENT FLANGE & LID | | 9 | -2 | -3 | 21 | -2 | 25 |
| | | 10 | -22 | -62 | -28 | -18 | 54 |
| | | 11 | 27 | 0 | 28 | -1 | 28 |
| | | 12 | -58 | -1 | -56 | -3 | 57 |
| Table D NON | GAMMA SHIELDING | 13 | 390 | -21 | 394 | -2 | 415 |
| | | 14 | -412 | -36 | -416 | -2 | 380 |
| | | 15 | -1 | -19 | 3 | 0 | 22 |
| | | 16 | 0 | -19 | 2 | 0 | 22 |
| | TRUNNION | 17 | 0 | -4 | 2 | 0 | 21 |
| | WELDS | 18 | -129 | 325 | 133 | 82 | 483 |
| | | 19 | 13 | -48 | -14 | 15 | 68 |
| | | 20 | 73 | 10 | 23 | 25 | 78 |

**PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT**

Revision: 9

TABLE 4A.3.3-5

LIFTING – 3 G VERTICAL-UP (TN-40 CASK)

| LOCATION | | MERIDIONAL STRESS (psi) | | HOOP STRESS (psi) | | STRESS INTENSITY SI (psi) | |
|--------------------------|-----------------|-------------------------|--------------|-------------------|---------------|---------------------------|------|
| | | OUTER SIGB S | INNER SIGT S | OUTER SIGB TH | INNER SIGT TH | | |
| CONTAINMENT VESSEL | | 1 | | -644 | | -597 | 585 |
| | | 2 | 12 | | -36 | | 48 |
| | | 3 | | 1155 | | 88 | 1200 |
| | | 4 | -1788 | | -717 | | 1788 |
| | | 5 | | 225 | | -4 | 228 |
| | | 6 | 217 | | -6 | | 223 |
| | | 7 | | -1067 | | -86 | 1067 |
| | | 8 | 1572 | | 705 | | 1572 |
| | | STRESS COMPONENTS (psi) | | | | STRESS INTENSITY SI (psi) | |
| | | Sx | Sy | Sz | Sxy | | |
| CONTAINMENT FLANGE & LID | | 9 | -50 | -168 | -525 | -62 | 502 |
| | | 10 | 572 | 1084 | 561 | 275 | 752 |
| | | 11 | 55 | 0 | 58 | 0 | 58 |
| | | 12 | -238 | -5 | -232 | -15 | 235 |
| Table F NON | GAMMA SHIELDING | 13 | -1598 | -55 | -1606 | 4 | 1551 |
| | | 14 | 1698 | -9 | 1707 | 5 | 1716 |
| | | 15 | 0 | 248 | 5 | -2 | 248 |
| | | 16 | 0 | 212 | 6 | -1 | 218 |
| | TRUNNION | 17 | 9 | 664 | 212 | 81 | 675 |
| | WELDS | 18 | 471 | -1463 | -535 | -295 | 2022 |
| | | 19 | -280 | 980 | 302 | -343 | 1435 |
| | | 20 | 223 | 44 | 63 | 77 | 235 |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4A.3.3-6

**THERMAL STRESSES DUE TO OFF-NORMAL
TEMPERATURE DISTRIBUTION (TN-40 CASK)**

| LOCATION | | MERIDIONAL STRESS (psi) | | HOOP STRESS (psi) | | STRESS INTENSITY SI (psi) | |
|-------------------------------|-----------------|-------------------------|--------------|-------------------|---------------|---------------------------|-------|
| | | OUTER SIGB S | INNER SIGT S | OUTER SIGB TH | INNER SIGT TH | | |
| CONTAINMENT VESSEL | | 1 | | -2468 | | -2442 | 2468 |
| | | 2 | -2814 | | -2847 | | 2847 |
| | | 3 | | -7202 | | -8267 | 8267 |
| | | 4 | 4736 | | -4685 | | 9422 |
| | | 5 | | -1798 | | -1654 | 1798 |
| | | 6 | -566 | | -1285 | | 1285 |
| | | 7 | | 1591 | | -1935 | 3526 |
| | | 8 | -4033 | | -3529 | | 4033 |
| | | STRESS COMPONENTS (psi) | | | | STRESS INTENSITY SI (psi) | |
| | | Sx | Sy | Sz | Sxy | | |
| CONTAINMENT FLANGE & LID | | 9 | 175 | 555 | 797 | 191 | 702 |
| | | 10 | -2324 | -3489 | -1844 | -895 | 2135 |
| | | 11 | 40 | 49 | 59 | -28 | 56 |
| | | 12 | 1300 | -207 | 808 | 120 | 1525 |
| Table F NON CONTAINMENT | GAMMA SHIELDING | 13 | 2526 | 16 | 2482 | 15 | 2510 |
| | | 14 | 26 | 12 | -11 | -12 | 43 |
| | | 15 | -195 | -741 | 33 | -20 | 775 |
| | | 16 | -190 | 1009 | 469 | 64 | 1206 |
| | TRUNNION | 17 | 368 | 417 | 73 | 101 | 424 |
| | WELDS | 18 | 5918 | -4071 | 2783 | 793 | 10113 |
| | | 19 | 1418 | -2067 | -446 | 878 | 3903 |
| | | 20 | 2031 | -265 | 278 | 348 | 2398 |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4A.3.3-7

**1 g LATERAL AND 1 g DOWN
 BOUNDING LOAD FOR SEISMIC, TORNADO WIND & FLOOD (TN-40 CASK)**

| LOCATION | | MERIDIONAL STRESS (psi) | | HOOP STRESS (psi) | | STRESS INTENSITY SI (psi) | |
|-------------------------------|-----------------|-------------------------|--------------|-------------------|---------------|---------------------------|------|
| | | OUTER SIGB S | INNER SIGT S | OUTER SIGB TH | INNER SIGT TH | | |
| CONTAINMENT VESSEL | | 1* | | 38 | | 58 | 97 |
| | | 2* | 147 | | 84 | | 147 |
| | | 3 | | -4371 | | -1427 | 4363 |
| | | 4 | 3053 | | 800 | | 3053 |
| | | 5 | | -166 | | 27 | 192 |
| | | 6 | -158 | | 49 | | 207 |
| | | 7 | | -113 | | 29 | 142 |
| | | 8 | -12 | | 60 | | 72 |
| | | STRESS COMPONENTS (psi) | | | | STRESS INTENSITY SI (psi) | |
| | | Sx | Sy | Sz | Sxy | | |
| CONTAINMENT FLANGE & LID | | 9 | 16* | 4 | -89 | 0 | 105 |
| | | 10 | 30* | -19 | -47 | -17 | 82 |
| | | 11 | 56* | 1 | 49 | -2 | 55 |
| | | 12 | -125* | -4 | -127 | -7 | 123 |
| Table G NON CONTAINMENT | GAMMA SHIELDING | 13 | -14 | -53 | -23 | 7 | 42 |
| | | 14 | -14 | 7 | -7 | -1 | 22 |
| | | 15 | -8 | -127 | -15 | -2 | 118 |
| | | 16 | 0 | -73 | 91 | 3 | 164 |
| | TRUNNION | 17 | 0 | -18 | 70 | -1 | 88 |
| | WELDS | 18 | 270 | -1891 | -286 | -81 | 2167 |
| | | 19 | -23 | -81 | 53 | -1 | 134 |
| | | 20 | 179 | 10 | 47 | 61 | 209 |

NOTE

Values with * sign are at $\theta=0^\circ$

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4A.3.4.1-1

***TRUNNION LOADINGS ON TN-40
FOR USE IN CASK BODY EVALUATION**

| <u>LOADING DESCRIPTION</u> | <u>INERTIAL LOAD</u> | <u>MAX. TRUNNION LOAD (LOAD SHARED BY 2 TOP TRUNNIONS)</u> |
|---------------------------------------|-----------------------------|---|
| Lifting (Cask Vertical) | 3 G | $V_L = 375$ kips $M_L = - 2093$ in kips |

*Based on Figure 3.2-4 of Section 3.2
Note: 1G = weight of cask = 250 kips

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4A.3.4.1-2

COMPUTATION SHEET FOR LOCAL STRESSES IN CYLINDRICAL SHELLS

1. APPLIED LOADS

RADIAL LOAD P _____ LB

CIRC. MOMENT M_c _____ IN-LB

LONG. MOMENT M_L _____ IN-LB

TORSION MOMENT M_t _____ IN-LB

SHEAR LOAD V_L _____ LB

SHEAR LOAD V_t _____ LB

*NOTE: ENTER ALL FORCE VALUES IN ACCORDANCE WITH SIGN CONVENTION

2. GEOMETRY

VESSEL THICKNESS T _____ IN

ATTACHMENT RADIUS r_a _____ IN

VESSEL RADIUS R_m _____ IN

PRIME COORDINATE SYSTEM

| FROM FIG | READ CURVES FOR | COMPUTE ABSOLUTE VALUES OF STRESS AND ENTER RESULT | STRESSES - IF LOAD IS OPPOSITE THAT SHOWN, REVERSE SIGNS SHOWN | | | | | | | | | |
|---|--|--|--|-------|-------|-------|-------|-------|-------|-------|-------|--|
| | | | A_u | A_v | B_u | B_v | C_u | C_v | D_u | D_v | D_t | |
| 3C AND 4C | $\frac{M_c}{P/R_m} = \left(\frac{M_c}{P/R_m}\right) \frac{P}{R_m}$ | $\left(\frac{M_c}{P/R_m}\right) \frac{P}{R_m}$ | + | + | + | + | + | + | + | + | + | |
| 1C AND 2C-1 | $\frac{M_c}{P/R_m} = \left(\frac{M_c}{P/R_m}\right) \frac{P}{R_m}$ | $\left(\frac{M_c}{P/R_m}\right) \frac{P}{R_m}$ | + | + | + | + | + | + | + | + | + | |
| 3A | $\frac{M_c}{M_c/R_m} = \left(\frac{M_c}{M_c/R_m}\right) \frac{M_c}{R_m}$ | $\left(\frac{M_c}{M_c/R_m}\right) \frac{M_c}{R_m}$ | + | + | + | + | + | + | + | + | + | |
| 1A | $\frac{M_c}{M_c/R_m} = \left(\frac{M_c}{M_c/R_m}\right) \frac{M_c}{R_m}$ | $\left(\frac{M_c}{M_c/R_m}\right) \frac{M_c}{R_m}$ | + | + | + | + | + | + | + | + | + | |
| 3B | $\frac{M_c}{M_c/R_m} = \left(\frac{M_c}{M_c/R_m}\right) \frac{M_c}{R_m}$ | $\left(\frac{M_c}{M_c/R_m}\right) \frac{M_c}{R_m}$ | + | + | + | + | + | + | + | + | + | |
| 1B OR 1B-1 | $\frac{M_c}{M_c/R_m} = \left(\frac{M_c}{M_c/R_m}\right) \frac{M_c}{R_m}$ | $\left(\frac{M_c}{M_c/R_m}\right) \frac{M_c}{R_m}$ | + | + | + | + | + | + | + | + | + | |
| ADD ALGEBRAICALLY FOR SUMMATION OF STRESSES σ_x | | | | | | | | | | | | |
| 3C AND 4C | $\frac{M_t}{P/R_m} = \left(\frac{M_t}{P/R_m}\right) \frac{P}{R_m}$ | $\left(\frac{M_t}{P/R_m}\right) \frac{P}{R_m}$ | + | + | + | + | + | + | + | + | + | |
| 1C-1 AND 2C | $\frac{M_t}{P/R_m} = \left(\frac{M_t}{P/R_m}\right) \frac{P}{R_m}$ | $\left(\frac{M_t}{P/R_m}\right) \frac{P}{R_m}$ | + | + | + | + | + | + | + | + | + | |
| 4A | $\frac{M_t}{M_t/R_m} = \left(\frac{M_t}{M_t/R_m}\right) \frac{M_t}{R_m}$ | $\left(\frac{M_t}{M_t/R_m}\right) \frac{M_t}{R_m}$ | + | + | + | + | + | + | + | + | + | |
| 2A | $\frac{M_t}{M_t/R_m} = \left(\frac{M_t}{M_t/R_m}\right) \frac{M_t}{R_m}$ | $\left(\frac{M_t}{M_t/R_m}\right) \frac{M_t}{R_m}$ | + | + | + | + | + | + | + | + | + | |
| 4B | $\frac{M_t}{M_t/R_m} = \left(\frac{M_t}{M_t/R_m}\right) \frac{M_t}{R_m}$ | $\left(\frac{M_t}{M_t/R_m}\right) \frac{M_t}{R_m}$ | + | + | + | + | + | + | + | + | + | |
| 2B OR 2B-1 | $\frac{M_t}{M_t/R_m} = \left(\frac{M_t}{M_t/R_m}\right) \frac{M_t}{R_m}$ | $\left(\frac{M_t}{M_t/R_m}\right) \frac{M_t}{R_m}$ | + | + | + | + | + | + | + | + | + | |
| ADD ALGEBRAICALLY FOR SUMMATION OF STRESSES σ_y | | | | | | | | | | | | |
| SHEAR STRESS DUE TO TORSION M_t | | | | | | | | | | | | |
| $\tau_{xy} = \frac{M_t}{R_m} \cdot \frac{1}{2R_m} = \frac{M_t}{2R_m^2}$ | | | | | | | | | | | | |
| SHEAR STRESS DUE TO LOAD V_L | | | | | | | | | | | | |
| $\tau_{xy} = \frac{V_L}{R_m}$ | | | | | | | | | | | | |
| SHEAR STRESS DUE TO LOAD V_t | | | | | | | | | | | | |
| $\tau_{xy} = \frac{V_t}{R_m}$ | | | | | | | | | | | | |
| ADD ALGEBRAICALLY FOR SUMMATION OF SHEAR STRESSES τ_{xy} | | | | | | | | | | | | |

3. GEOMETRIC PARAMETERS

NOZZLE NO. _____

PRIME LOAD CODE _____

ANALYSIS POINT _____

CIRCUMFERENTIAL σ_θ _____

LONGITUDINAL σ_x _____

PRESSURE STRESS _____

LONGITUDINAL BENDING STRESS _____

TOTAL MEMBRANE STRESS _____

TOTAL SURFACE STRESS _____

COMPUTATION SHEET FOR LOCAL STRESSES IN CYLINDRICAL SHELLS ()

SERVICE: _____

ITEM NO. _____

S-R JOB NO. _____

DATE _____ BY _____ SHEET _____

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4A.3.4.1-3

STRESSES ON TN-40 CASK BODY DUE TO TRUNNION LOADING

| DESCRIPTION | CIRCUMFERENTIAL | | LONGITUDINAL | |
|--------------------------------|----------------------------|-------|----------------------------|-------|
| | <u>STRESS (PSI)</u> | | <u>STRESS (PSI)</u> | |
| | MEMBRANE | | MEMBRANE | |
| | SURFACE | | SURFACE | |
| 3 g – Lifting Cask Vertical | 413 | 3,208 | 102 | 4,546 |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4A.3.5-1

DESIGN (1) LOAD COMBINATION (TN-40 CASK)

| LOCATION | | STRESS INTENSITY S.I. (PSI) | | | | ΣS.I.(a) PSI | ΣS.I. (b) PSI | |
|------------------------------------|--------------------|--------------------------------|-------------|----------------------|---|-----------------|------------------|-------|
| | | BOLT PRELOAD _(a) | 1 g DOWN | INTERNAL PRESSURE | BOUNDING VERTICAL & LATERAL FORCES | | | |
| CONTAINMENT VESSEL | 1 | 137 | 198 | 433 | 97 | 865 | 1007 | |
| | 2 | 52 | 30 | 311 | 147 | 540 | 594 | |
| | 3 | 2148 | 872 | 4248 | 4363 | 11631 | 13865 | |
| | 4 | 1428 | 1046 | 4385 | 3053 | 9912 | 11397 | |
| | 5 | 343 | 76 | 736 | 192 | 1347 | 1704 | |
| | 6 | 342 | 76 | 590 | 207 | 1215 | 1571 | |
| | 7 | 2444 | 48 | 405 | 142 | 3039 | 5581 | |
| | 8 | 1857 | 163 | 915 | 72 | 3007 | 4938 | |
| CONTMNT FLANGE & LID | 9 | 2347 | 25 | 593 | 105 | 3070 | 5511 | |
| | 10 | 2369 | 54 | 464 | 82 | 2969 | 5433 | |
| | 11 | 1284 | 28 | 839 | 55 | 2206 | 3541 | |
| | 12 | 2091 | 57 | 2034 | 123 | 4305 | 6480 | |
| NON CONTAINMENT | GAMMA SHIELDING | 13 | 246 | 415 | 1216 | 42 | 1919 | 2175 |
| | | 14 | 265 | 380 | 1413 | 22 | 2080 | 2356 |
| | | 15 | 59 | 22 | 462 | 118 | 661 | 722 |
| | | 16 | 59 | 21 | 310 | 164 | 554 | 615 |
| | TRUNNION | 17 | 45 | 6 | 370 | 88 | 509 | 556 |
| | WELDS | 18 | 568 | 483 | 2031 | 2167 | 5249 | 5840 |
| | | 19 | 2987 | 68 | 1200 | 134 | 4389 | 7495 |
| | | 20 | 5754 | 78 | 2549 | 209 | 8590 | 14574 |
| CONTAINMENT ALLOWABLE STRESS | | S _m = | | | | 16,200 | | |

(a) CORRESPOND TO BOLT PRELOAD STRESS OF 25,000 psi

$$(b) \text{ TOTAL} = \Sigma \text{ S.I.}_{(a)} + \text{BOLT PRELOAD} \times \left(\frac{51}{25} \right) - 1$$

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4A.3.5-2
DESIGN (2) LOAD COMBINATION (TN-40 CASK)

| LOCATION | | STRESS INTENSITY S.I. (PSI) | | | | ΣS.I.(a) PSI | ΣS.I. (b) PSI | |
|------------------------------------|--------------------|---|----------------------|------------------|-------------------------------|-----------------|------------------|-------|
| | | BOLT PRELOAD(a) | INTERNAL PRESSURE | LIFTING 3g UP | BIJLAARD LOCAL MEMBRANE | | | |
| CONTAINMENT VESSEL | 1 | 137 | 433 | 585 | | 1155 | 1297 | |
| | 2 | 52 | 311 | 48 | | 411 | 465 | |
| | 3 | 2148 | 4248 | 1200 | | 7596 | 9830 | |
| | 4 | 1428 | 4385 | 1788 | | 7601 | 9086 | |
| | 5 | 343 | 736 | 228 | | 1307 | 1664 | |
| | 6 | 342 | 590 | 223 | | 1155 | 1511 | |
| | 7 | 2444 | 405 | 1067 | | 3916 | 6458 | |
| | 8 | 1857 | 915 | 1572 | | 4344 | 6275 | |
| CONTMNT FLANGE & LID | 9 | 2347 | 593 | 502 | | 3442 | 5883 | |
| | 10 | 2369 | 464 | 752 | | 3585 | 6049 | |
| | 11 | 1284 | 839 | 58 | | 2181 | 3516 | |
| | 12 | 2091 | 2034 | 235 | | 4360 | 6535 | |
| NON CONTAINMENT | GAMMA SHIELDING | 13 | 246 | 1216 | 1551 | | 3013 | 3269 |
| | | 14 | 265 | 1413 | 1716 | | 3394 | 3670 |
| | | 15 | 59 | 462 | 248 | | 769 | 830 |
| | | 16 | 59 | 310 | 218 | | 587 | 648 |
| | TRUNNION | 17 | 45 | 370 | 675 | 11700 | 12790 | 12837 |
| | WELDS | 18 | 568 | 2031 | 2022 | | 4621 | 5212 |
| | | 19 | 2987 | 1200 | 1435 | | 5622 | 8728 |
| | | 20 | 5754 | 2549 | 235 | | 8538 | 14522 |
| CONTAINMENT ALLOWABLE STRESS | | DESIGN (2) LOAD COMBINATION ALLOWABLE STRESS S _m = | | | | 16,200 | | |

(a) CORRESPOND TO BOLT PRELOAD STRESS OF 25,000 psi

$$(b) \text{ TOTAL} = \Sigma S.I._{(a)} + \text{BOLT PRELOAD} \times \left(\frac{51}{25} \right) - 1$$

**PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT**

Revision: 9

TABLE 4A.3.5-3

DESIGN (3) LOAD COMBINATION (TN-40 CASK)

| LOCATION | | STRESS INTENSITY S.I. (PSI) | | | | ΣS.I.(a) PSI | ΣS.I. (b) PSI | |
|------------------------------------|--------------------|--------------------------------|-------------|----------------------|--|-----------------|------------------|-------|
| | | BOLT PRELOAD _(a) | 1 g DOWN | EXTERNAL PRESSURE | BOUNDING VERTICAL & LATERAL LOADS | | | |
| CONTAINMENT VESSEL | 1 | 137 | 198 | 113 | 97 | 545 | 687 | |
| | 2 | 52 | 30 | 71 | 147 | 300 | 354 | |
| | 3 | 2148 | 872 | 1838 | 4363 | 9221 | 11455 | |
| | 4 | 1428 | 1046 | 1366 | 3053 | 6893 | 8378 | |
| | 5 | 343 | 76 | 221 | 192 | 832 | 1189 | |
| | 6 | 342 | 76 | 220 | 207 | 845 | 1201 | |
| | 7 | 2444 | 48 | 472 | 142 | 3106 | 5648 | |
| | 8 | 1856 | 163 | 51 | 72 | 2143 | 4074 | |
| CONTMNT FLANGE & LID | 9 | 2347 | 25 | 249 | 105 | 2726 | 5167 | |
| | 10 | 2369 | 54 | 190 | 82 | 2695 | 5159 | |
| | 11 | 1284 | 28 | 216 | 55 | 1583 | 2918 | |
| | 12 | 2091 | 57 | 527 | 123 | 2798 | 4973 | |
| NON CONTAINMENT | GAMMA SHIELDING | 13 | 246 | 415 | 485 | 42 | 1188 | 1444 |
| | | 14 | 265 | 380 | 544 | 22 | 1211 | 1487 |
| | | 15 | 59 | 22 | 113 | 118 | 312 | 373 |
| | | 16 | 59 | 21 | 76 | 164 | 320 | 381 |
| | TRUNNION | 17 | 45 | 6 | 93 | 88 | 232 | 279 |
| | WELDS | 18 | 568 | 483 | 617 | 2167 | 3835 | 4426 |
| | | 19 | 2987 | 68 | 511 | 134 | 3700 | 6806 |
| | | 20 | 5754 | 78 | 663 | 209 | 6704 | 12688 |
| CONTAINMENT ALLOWABLE STRESS | | S _m = | | | | 16,200 | | |

(a) CORRESPOND TO BOLT PRELOAD STRESS OF 25,000 psi

(b) TOTAL = Σ S.I._(a) + BOLT PRELOAD × (51/25 – 1)

**PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT**

Revision: 9

TABLE 4A.3.5-4

LEVEL A (1) LOAD COMBINATION (TN-40 CASK)

| LOCATION | | STRESS INTENSITY S.I. (PSI) | | | | ΣS.I.(a) PSI | ΣS.I. (b) PSI | |
|------------------------------------|--------------------|-----------------------------|--|---------------------------------------|-----------------|-----------------|------------------|-------|
| | | | | DESIGN (1) LOAD COMBINATIONS(a) | WORST THERMO | | | |
| CONTAINMENT VESSEL | 1 | | | 865 | 2468 | 3333 | 3475 | |
| | 2 | | | 540 | 2847 | 3387 | 3441 | |
| | 3 | | | 11631 | 8267 | 19898 | 22132 | |
| | 4 | | | 9912 | 9422 | 19334 | 20819 | |
| | 5 | | | 1347 | 1798 | 3145 | 3502 | |
| | 6 | | | 1215 | 1285 | 2500 | 2856 | |
| | 7 | | | 3039 | 3526 | 6565 | 9107 | |
| | 8 | | | 3007 | 4033 | 7040 | 8971 | |
| CONTMNT FLANGE & LID | 9 | | | 3070 | 702 | 3772 | 6213 | |
| | 10 | | | 2969 | 2135 | 5104 | 7568 | |
| | 11 | | | 2206 | 56 | 2262 | 3597 | |
| | 12 | | | 4305 | 1525 | 5830 | 8005 | |
| NON CONTAINMENT | GAMMA SHIELDING | 13 | | | 1919 | 2510 | 4429 | 4685 |
| | | 14 | | | 2080 | 43 | 2123 | 2399 |
| | | 15 | | | 661 | 775 | 1436 | 1497 |
| | | 16 | | | 554 | 1206 | 1760 | 1821 |
| | TRUNNION | 17 | | | 509 | 424 | 933 | 980 |
| | WELDS | 18 | | | 5249 | 10113 | 15362 | 15953 |
| | | 19 | | | 4389 | 3903 | 8292 | 11398 |
| | | 20 | | | 8590 | 2398 | 10988 | 16972 |
| CONTAINMENT ALLOWABLE STRESS | | 3.0 S _m = | | | | 48600 | | |

(a) CORRESPOND TO BOLT PRELOAD STRESS OF 25,000 psi

(b) TOTAL = WORST THERMO + ΣS.I._(b) (TABLE 4A.3.5-1)

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4A.3.5-5

LEVEL A (2) LOAD COMBINATION (TN-40 CASK)

| LOCATION | | STRESS INTENSITY S.I. (PSI) | | | | ΣS.I.(a) PSI | ΣS.I. (b) PSI | |
|------------------------------------|--------------------|-------------------------------------|----------------------|---------------|-----------------|---------------------|------------------|-------|
| | | BOLT PRELOAD(a) | INTERNAL PRESSURE | LIFTING UP | WORST THERMO | | | |
| CONTAINMENT VESSEL | 1 | 137 | 433 | 585 | 2468 | 3623 | 3765 | |
| | 2 | 52 | 311 | 48 | 2847 | 3258 | 3312 | |
| | 3 | 2148 | 4248 | 1200 | 8267 | 15863 | 18097 | |
| | 4 | 1428 | 4385 | 1788 | 9422 | 17023 | 18508 | |
| | 5 | 343 | 736 | 228 | 1798 | 3105 | 3462 | |
| | 6 | 342 | 590 | 223 | 1285 | 2440 | 2796 | |
| | 7 | 2444 | 405 | 1067 | 3526 | 7442 | 9984 | |
| | 8 | 1857 | 915 | 1572 | 4033 | 8377 | 10308 | |
| CONTMT FLANGE & LID | 9 | 2347 | 593 | 502 | 702 | 4144 | 6585 | |
| | 10 | 2369 | 464 | 752 | 2135 | 5720 | 8184 | |
| | 11 | 1284 | 839 | 58 | 56 | 2237 | 3572 | |
| | 12 | 2091 | 2034 | 235 | 1525 | 5885 | 8060 | |
| NON CONTAINMENT | GAMMA SHIELDING | 13 | 246 | 1216 | 1551 | 2510 | 5523 | 5779 |
| | | 14 | 265 | 1413 | 1716 | 43 | 3437 | 3713 |
| | | 15 | 59 | 462 | 248 | 775 | 1544 | 1605 |
| | | 16 | 59 | 310 | 218 | 1206 | 1793 | 1854 |
| | TRUNNION | 17 | 45 | 370 | 12375* | 424 | 13214 | 13261 |
| | WELDS | 18 | 568 | 2031 | 2022 | 10113 | 14734 | 15325 |
| | | 19 | 2987 | 1200 | 1435 | 3903 | 9525 | 12631 |
| | | 20 | 5754 | 2549 | 235 | 2398 | 10936 | 16920 |
| CONTAINMENT ALLOWABLE STRESS | | LEVEL A SERVICE LOAD COMBINATION | | | | 3.0S _m = | 48600 | |

* INCLUDES BIJLAARD LOCAL MEMBRANE

(a) CORRESPOND TO BOLT PRELOAD STRESS OF 25,000 psi

(b) TOTAL = Σ S.I._(a) + BOLT PRELOAD × (51/25 – 1)

**PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT**

Revision: 9

TABLE 4A.3.5-6

LEVEL A (3) LOAD COMBINATION (TN-40 CASK)

| LOCATION | | STRESS INTENSITY S.I. (PSI) | | | | ΣS.I.(a) PSI | ΣS.I. (b) PSI | |
|------------------------------------|--------------------|-----------------------------|--|---------------------------------------|-----------------|-----------------|------------------|-------|
| | | | | DESIGN (3) LOAD COMBINATIONS(a) | WORST THERMO | | | |
| CONTAINMENT VESSEL | 1 | | | 545 | 2468 | 3013 | 3155 | |
| | 2 | | | 300 | 2847 | 3147 | 3201 | |
| | 3 | | | 9221 | 8267 | 17488 | 19722 | |
| | 4 | | | 6893 | 9422 | 16315 | 17800 | |
| | 5 | | | 832 | 1798 | 2630 | 2987 | |
| | 6 | | | 845 | 1285 | 2130 | 2486 | |
| | 7 | | | 3106 | 3526 | 6632 | 9174 | |
| | 8 | | | 2143 | 4033 | 6176 | 8107 | |
| CONTMNT FLANGE & LID | 9 | | | 2726 | 702 | 3428 | 5869 | |
| | 10 | | | 2695 | 2135 | 4830 | 7294 | |
| | 11 | | | 1583 | 56 | 1639 | 2974 | |
| | 12 | | | 2798 | 1525 | 4323 | 6498 | |
| NON CONTAINMENT | GAMMA SHIELDING | 13 | | | 1188 | 2510 | 3698 | 3954 |
| | | 14 | | | 1211 | 43 | 1254 | 1530 |
| | | 15 | | | 312 | 775 | 1087 | 1148 |
| | | 16 | | | 320 | 1206 | 1526 | 1587 |
| | TRUNNION | 17 | | | 232 | 424 | 656 | 703 |
| | WELDS | 18 | | | 3835 | 10113 | 13948 | 14539 |
| | | 19 | | | 3700 | 3903 | 7603 | 10709 |
| | | 20 | | | 6704 | 2398 | 9102 | 15086 |
| CONTAINMENT ALLOWABLE STRESS | | 3.0 S _m = | | | | 48600 | | |

(a) CORRESPOND TO BOLT PRELOAD STRESS OF 25,000 psi

(b) TOTAL = WORST THERMO + Σ S.I._(b) (TABLE 4A.3.5-3)

**PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT**

Revision: 9

TABLE 4A.3.5-7

LEVEL D (1) LOAD COMBINATION (TN-40 CASK)

| LOCATION | | STRESS INTENSITY S.I. (PSI) | | | ΣS.I.(a) PSI | ΣS.I. (b) PSI | | |
|------------------------------------|--------------------|--------------------------------------|--|--|-----------------|------------------|--------------------|-------|
| | | | | DESIGN (1) LOAD COMBINATION _(a) | | | TORNADO MISSILE | |
| CONTAINMENT VESSEL | 1 | | | | | | | |
| | 2 | | | | | | | |
| | 3 | | | | | | | |
| | 4 | | | | | | | |
| | 5 | | | | | | | |
| | 6 | | | | | | | |
| | 7 | | | | | | | |
| | 8 | | | | | | | |
| CONTMNT FLANGE & LID | 9 | | | | | | | |
| | 10 | | | | | | | |
| | 11 | | | 2206 | 40945* | 43151 | 44486 | |
| | 12 | | | 4305 | 40945* | 45250 | 47425 | |
| NON CONTAINMENT | GAMMA SHIELDING | 13 | | | | | | |
| | | 14 | | | | | | |
| | | 15 | | | 661 | 11916 | 12577 | 12638 |
| | | 16 | | | 554 | 11916 | 12470 | 12531 |
| | TRUNNION | 17 | | | | | | |
| | WELDS | 18 | | | | | | |
| | | 19 | | | 4389 | 11916 | 16305 | 19411 |
| | | 20 | | | 8590 | 40945* | 49535 | 55519 |
| CONTAINMENT ALLOWABLE STRESS | | MEMBRANE 2.4S _m = | | | 38880 | | | |
| | | MEMBRANE+BENDING 3.6S _m = | | | 58320 | | | |

* THE MEMBRANE PORTION IS 6,140 psi; THE BALANCE IS BENDING

(a) CORRESPOND TO 25,000 psi BOLT PRELOAD STRESS

(b) TOTAL = TORNADO MISSILE + Σ S.I. (b) (TABLE 4A.3.5-1)

**PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT**

Revision: 9

TABLE 4A.3.5-8

LEVEL D (2) LOAD COMBINATION (TN-40 CASK)

| LOCATION | | STRESS INTENSITY S.I. (PSI) | | | | ΣS.I.(a) PSI | ΣS.I.(b) PSI | |
|------------------------------------|--------------------|---|--|--|--------------------|-----------------|-----------------|-------|
| | | | | DESIGN (2) LOAD COMBINATION _(a) | TORNADO MISSILE | | | |
| CONTAINMENT VESSEL | 1 | | | | | | | |
| | 2 | | | | | | | |
| | 3 | | | | | | | |
| | 4 | | | | | | | |
| | 5 | | | | | | | |
| | 6 | | | | | | | |
| | 7 | | | | | | | |
| | 8 | | | | | | | |
| CONTMNT FLANGE & LID | 9 | | | | | | | |
| | 10 | | | | | | | |
| | 11 | | | 1583 | 40945* | 42528 | 43863 | |
| | 12 | | | 2798 | 40945* | 43743 | 45918 | |
| NON CONTAINMENT | GAMMA SHIELDING | 13 | | | | | | |
| | | 14 | | | | | | |
| | | 15 | | | 312 | 11916 | 12228 | 12289 |
| | | 16 | | | 320 | 11916 | 12236 | 12297 |
| | TRUNNION | 17 | | | | | | |
| | WELDS | 18 | | | | | | |
| | | 19 | | | 3700 | 11916 | 15616 | 18722 |
| | | 20 | | | 6704 | 40945* | 47649 | 53633 |
| CONTAINMENT ALLOWABLE STRESS | | MEMBRANE 2.4 S _m = | | | 38880 | | | |
| | | MEMBRANE + BENDING 3.6 S _m = | | | 58320 | | | |

* THE MEMBRANE PORTION IS 6,140 psi; THE BALANCE IS BENDING

(a) CORRESPOND TO 25,000 psi BOLT PRELOAD STRESS

(b) TOTAL = TORNADO MISSILE + Σ S.I. (b) (TABLE 4A.3.5-3)

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4A.6-1

TRUNNION SECTION PROPERTIES AND LOADS (TN-40 CASK)

| ITEM | UPPER TRUNNIONS | | LOWER TRUNNIONS | |
|---|-----------------|-----------|-----------------|-----------|
| | SECT A-A | SECT B-B | SECT A-A | SECT B-B |
| CROSS SECTION AREA, IN ² | 93.415 | 79.73 | 54.95 | 46.0 |
| AREA MOMENT OF INERTIA, IN ⁴ | 987.20 | 755.60 | 379.69 | 285.10 |
| YIELD LIMIT LOAD* | | | | |
| SHEAR FORCE LB. | 750,000 | | 375,000 | |
| BENDING MOMENT, IN-LB. | 4,185,000 | 1,312,500 | 2,092,500 | 656,250 |
| ULTIMATE LIMIT LOAD ** | | | | |
| SHEAR FORCE LB. | 1,250,000 | | 625,000 | |
| BENDING MOMENT, IN-LB. | 6,975,000 | 2,187,500 | 3,487,500 | 1,093,750 |

*TRUNNION LOADS TO SUPPORT 6 TIMES CASK WEIGHT

**TRUNNION LOADS TO SUPPORT 10 TIMES CASK WEIGHT

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4A.6-2

**TRUNNION STRESSES WHEN LOADED
BY *6 AND **10 TIMES CASK WEIGHT**

| LOCATION /STRESS | *YIELD LIMIT | | ** ULTIMATE LIMIT | |
|-------------------------|----------------------------|----------|----------------------------|----------|
| | SECT A-A | SECT B-B | SECT A-A | SECT B-B |
| | (NOTE 1) | (NOTE 1) | (NOTE 1) | (NOTE 1) |
| UPPER TRUNNIONS | | | | |
| SHEAR STRESS (psi) | 8,029 | 9,407 | 13,381 | 15,678 |
| BENDING STRESS | 25,436 | 9,771 | 42,393 | 16,285 |
| STRESS INTENSITY | 30,080 | 21,200 | 50,134 | 35,333 |
| LOWER TRUNNIONS | | | | |
| SHEAR STRESS | 6,824 | 8,152 | 11,374 | 13,589 |
| BENDING STRESS | 26,178 | 10,220 | 43,629 | 17,033 |
| STRESS INTENSITY | 29,522 | 19,242 | 49,203 | 32,074 |
| ALLOWABLE STRESS | $S_y = 31,900 \text{ psi}$ | | $S_u = 70,000 \text{ psi}$ | |

NOTE

1. Sections A-A and B-B are shown on Figure 4A.6-1.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 12

TABLE 4A.7-1

STRESS IN OUTER SHELL AND CLOSURE PLATES (TN-40 CASK)

| LOCATIONS | STRESS INTENSITIES (1) (psi) |
|---------------------------------------|---------------------------------|
| AT JUNCTION TOP PLATE TO VESSEL | 12,404 |
| REMAINDER OF TOP PLATE | 21,117 |
| AT JUNCTION BOTTOM PLATE TO VESSEL | 7,112 |
| REMAINDER OF BOTTOM PLATE | 5,304 |

⁽¹⁾ 25 PSI + 3G handling in vertical position loading

01136263

Security-Related Information Figure Withheld Under 10 CFR 2.390.

Rev 3 4/94

Figure 4A.1-1 TN-40 CASK BODY KEY DIMENSIONS

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

TN-40 CASK BODY KEY DIMENSIONS

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA


DRAWN BY: VLS

REVISION: 3

PAGE. NO.

DATE: 04-19-06

FIG4A.1-1_REV_3

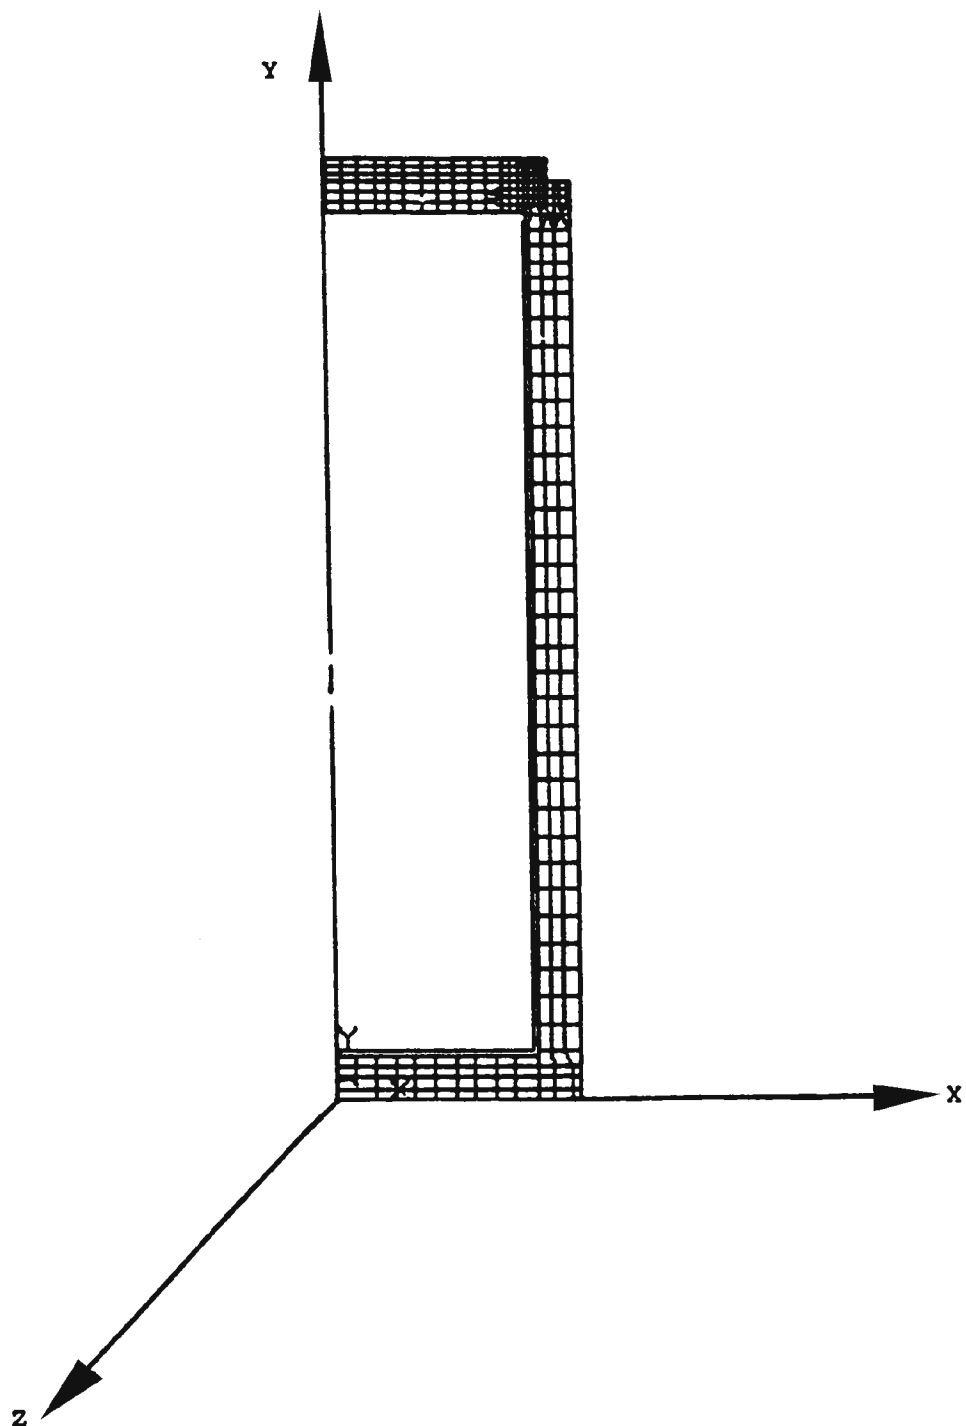

Rev. 0 8/90

Figure 4A.3-1
TN-40 CASK BODY -
ANSYS MODEL

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

TN-40 CASK BODY - ANSYS MODEL

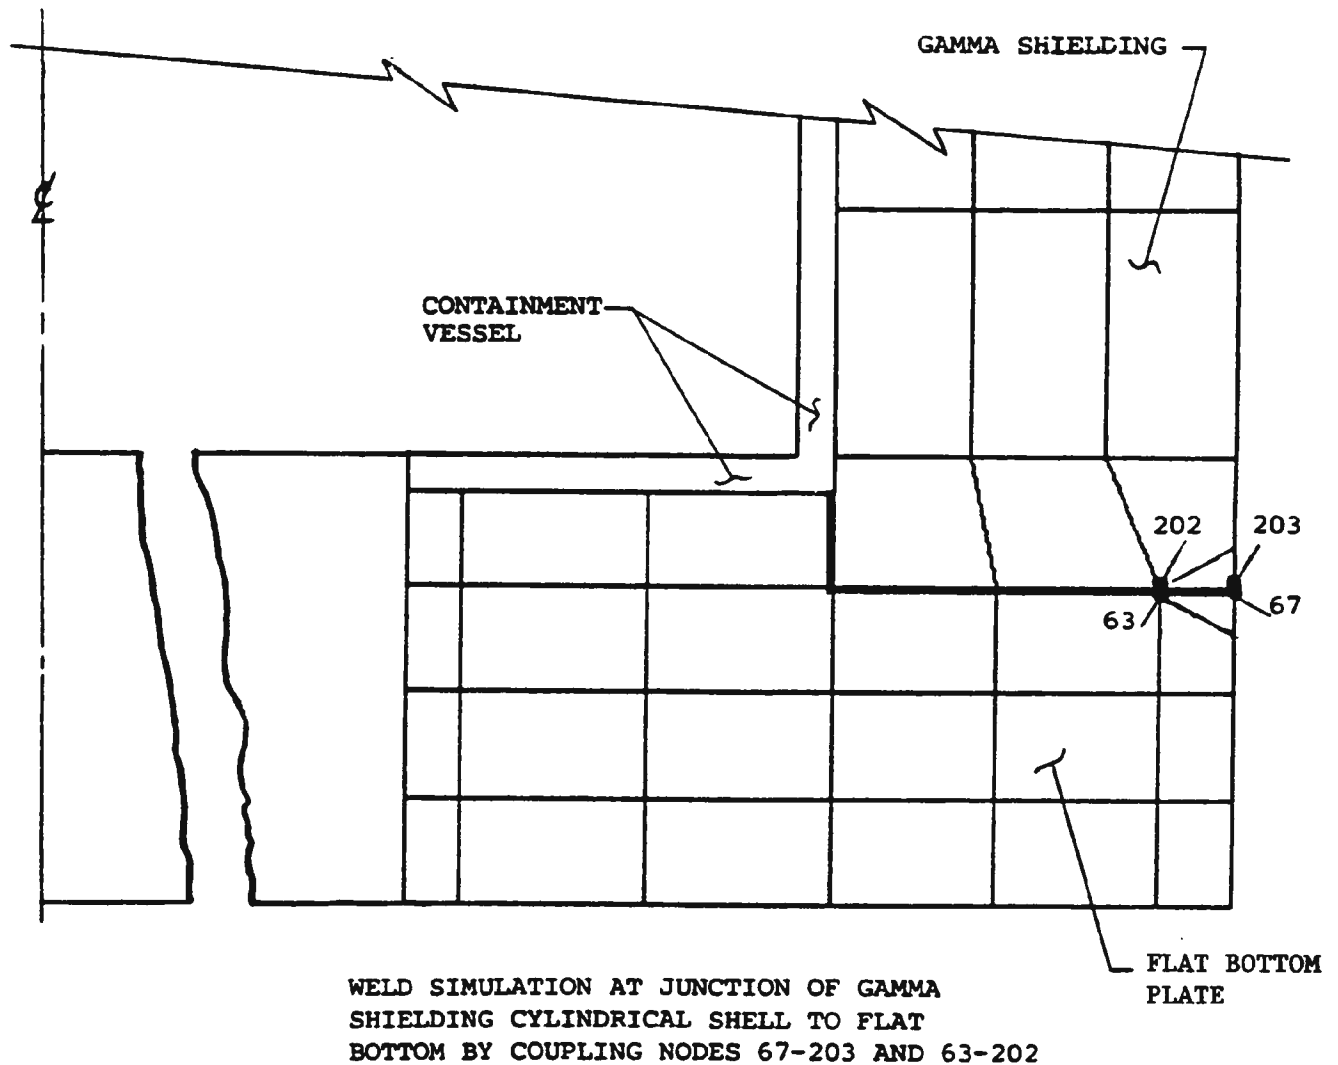


Figure 4A.3-2
TN-40 CASK BODY
BOTTOM CORNER

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

Rev. 0 8/90

TN-40 CASK BODY - BOTTOM CORNER

LID BOLTS CONNECTING PRIMARY LID TO CONTAINMENT
FLANGE AND WELD ATTACHING GAMMA SHIELDING TO FLANGE

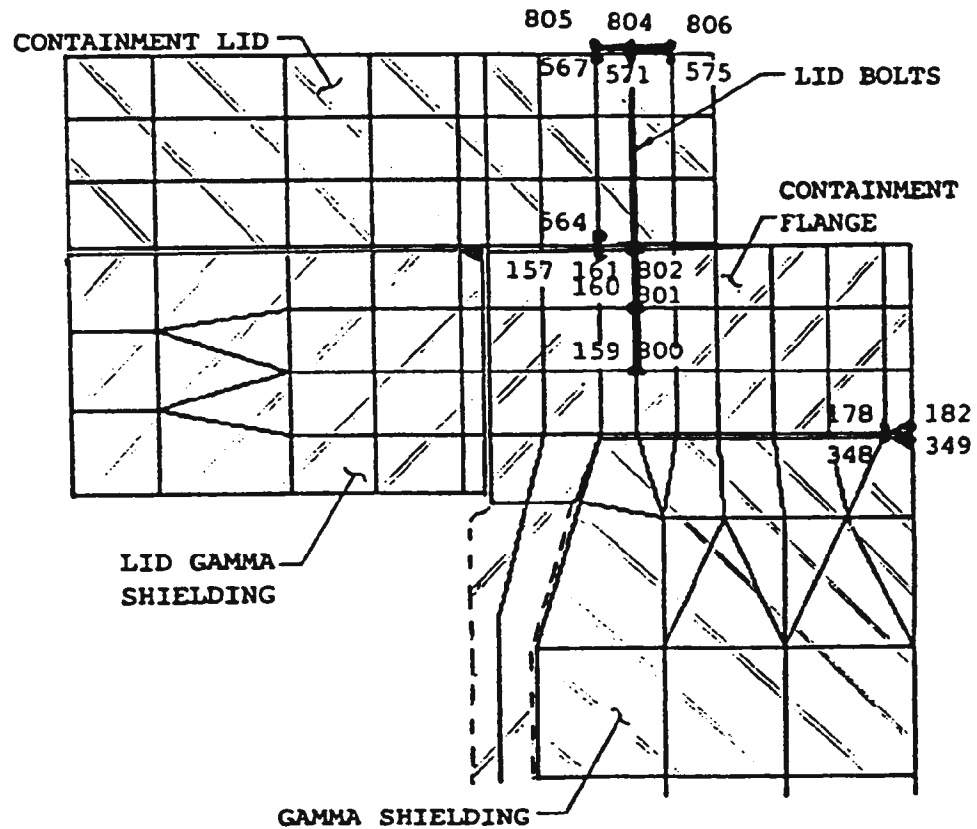


Figure 4A.3-3


TN-40 CASK BODY TOP CORNER

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

Rev. 2 9/91

TN-40 CASK BODY - TOP CORNER

SIMULATION OF WELD CONNECTING CONTAINMENT LID
TO LID DISC BY COUPLING NODES 458-552 AND
463-556.

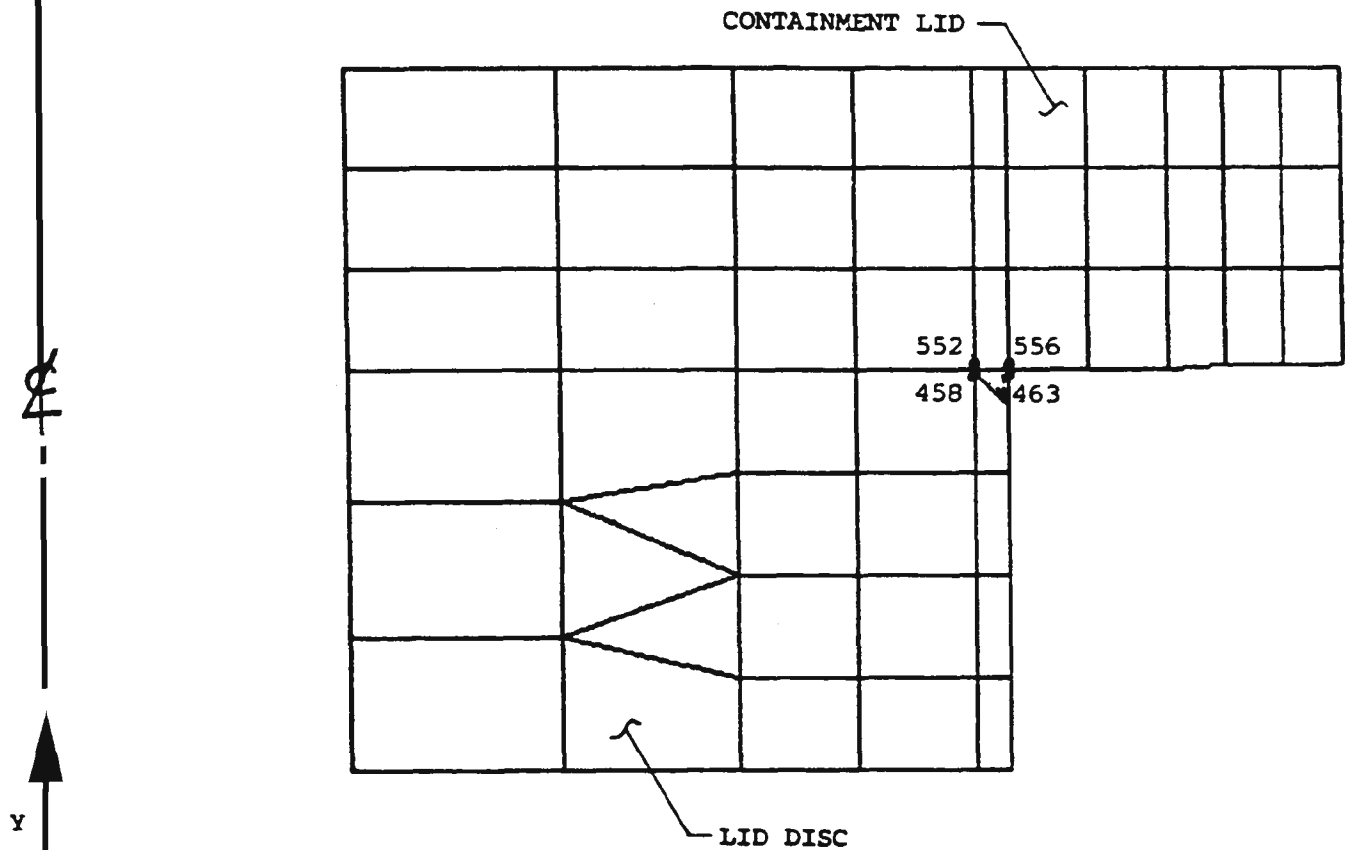

Rev. 0 8/90

Figure 4A.3-4
TN-40 CASK LID TO SHIELD
PLATE CONNECTION
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

TN-40 CASK BODY LID TO SHIELD PLATE CONNECTION

FOURIER COEFFICIENTS


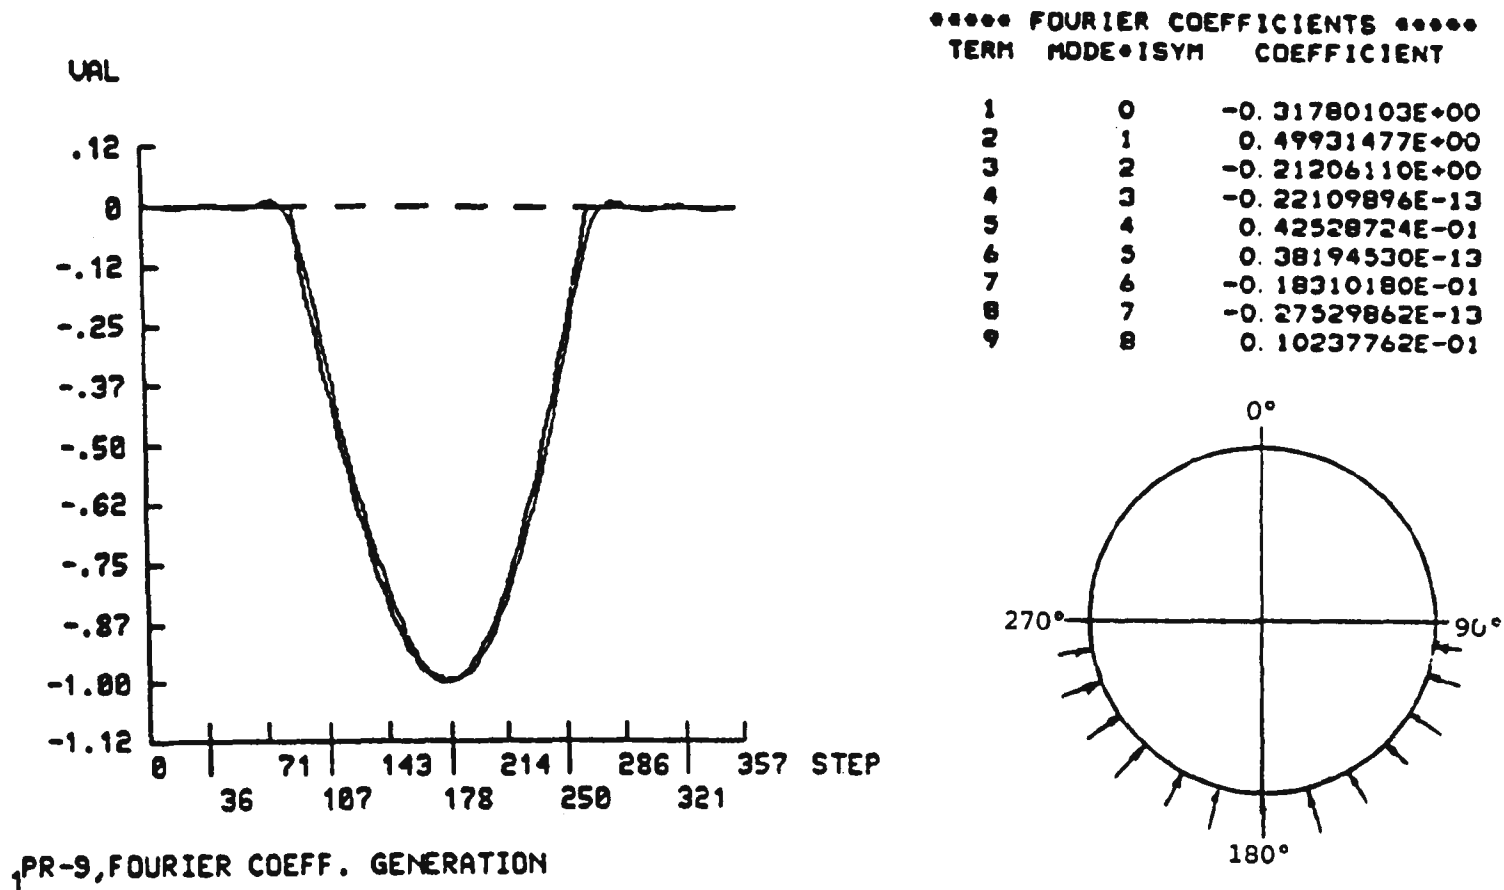


Figure 4A.3-5
FOURIER COEFFICIENTS
 PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

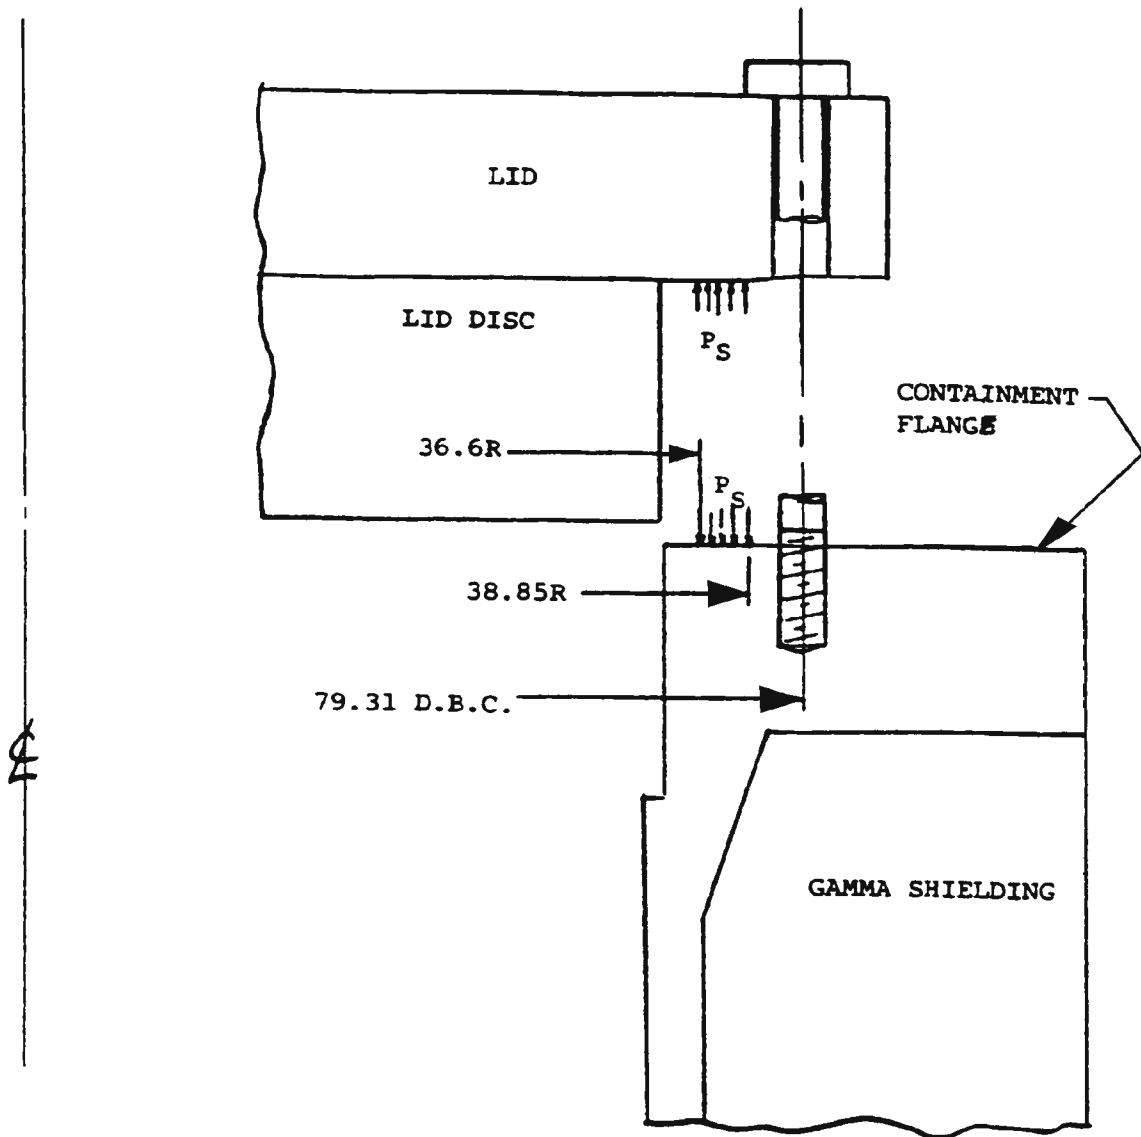

SEAL PRESSURE CALCULATION

SEAL LOAD $F_S = 2 \times 2198 \sim 4400\#/IN.$ AT $D_{AV} = 75.1"$

SEAL PRESSURE: $P_S = \frac{4400 \times 75.1 \times \pi}{\pi (38.85^2 - 36.6^2)} = 1946.48 \text{ PSI}$

BOLT PRELOAD STRESS: 25000 PSI

Rev. 0 8/90

Figure 4A.3-6
TN-40 BOLT PRELOAD AND
SEAL REACTION

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

TN-40 BOLT PRELOAD AND SEAL REACTION


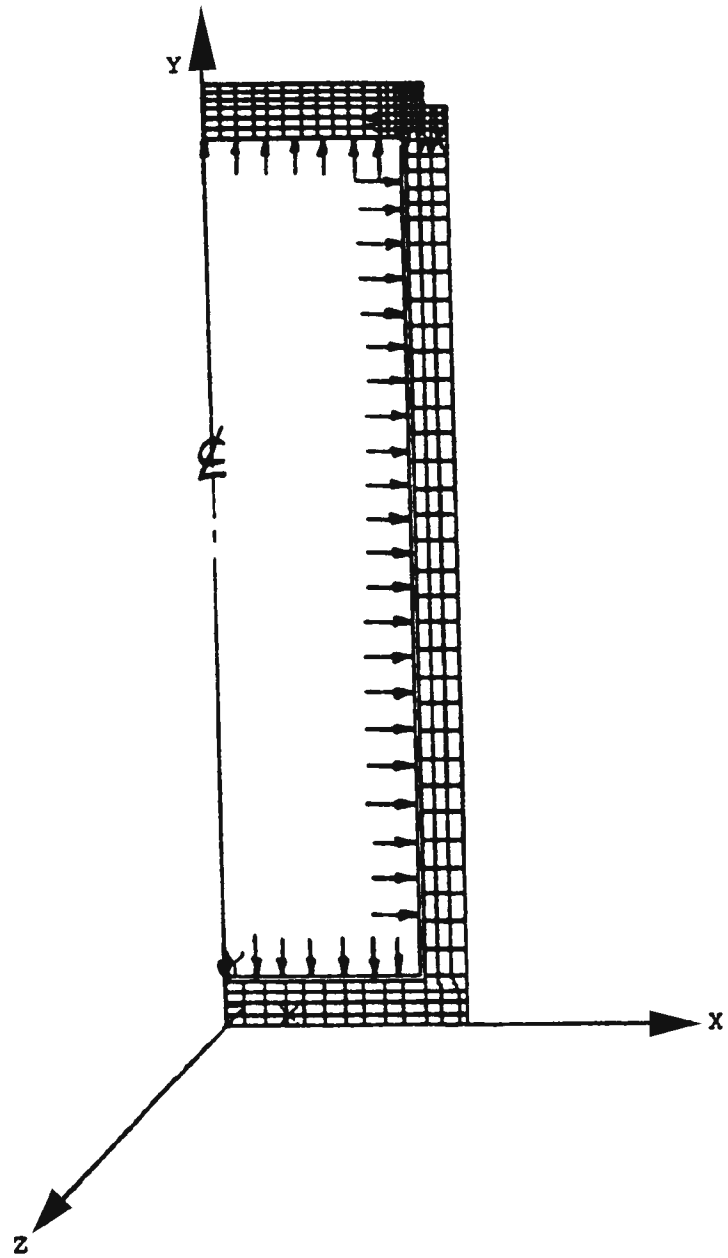


Figure 4A.3-7
TN-40 DESIGN INTERNAL
PRESSURE (100 PSIG)

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

Rev. 0 8/90

TN-40 DESIGN INTERNAL PRESSURE (100 PSIG)

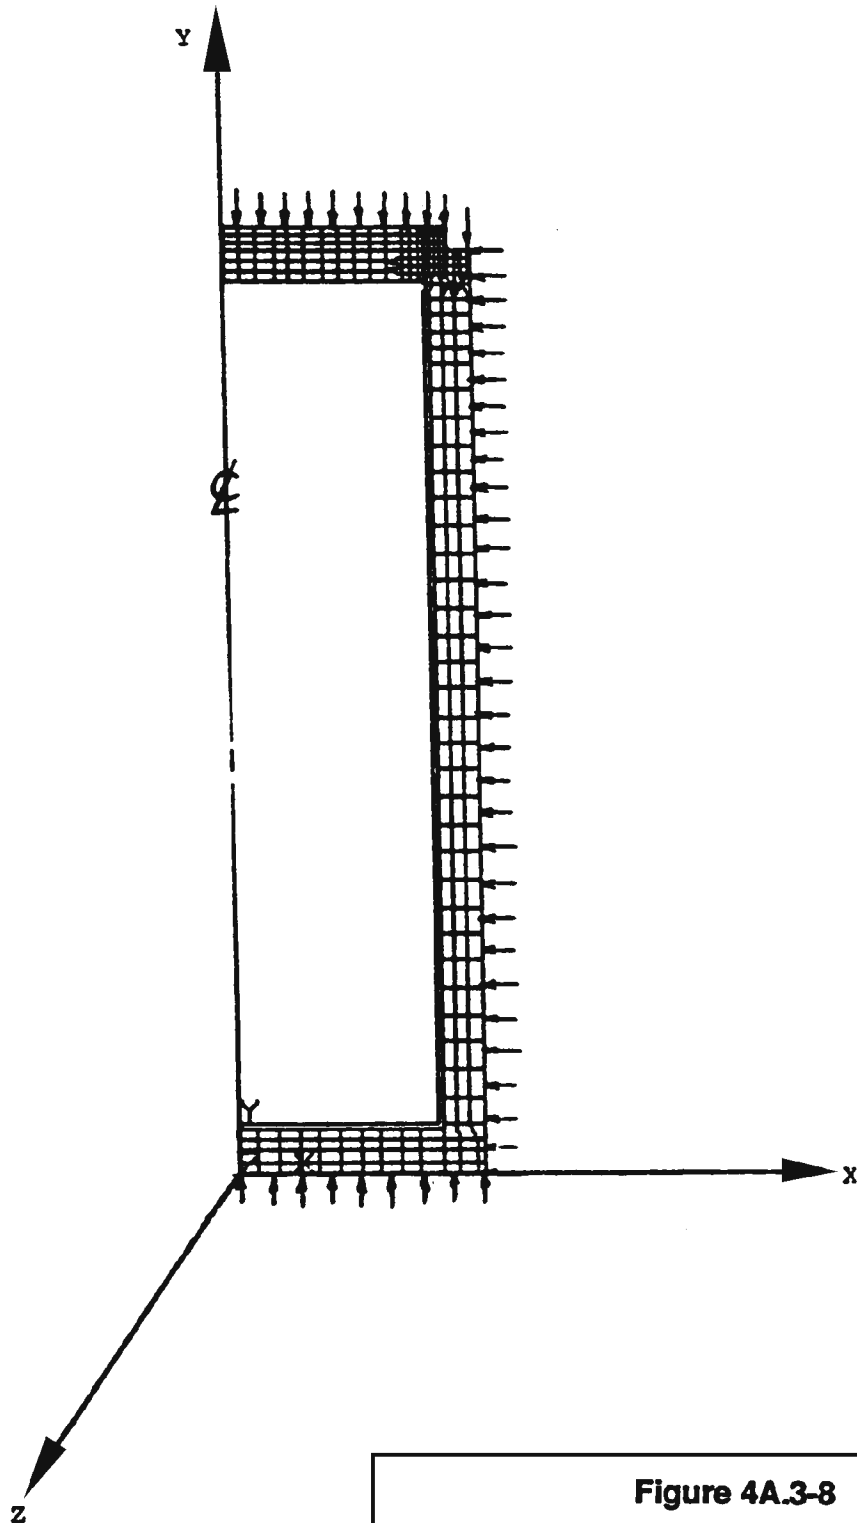

Rev. 0 8/90

Figure 4A.3-8
TN-40 EXTERNAL PRESSURE
LOADING (25 PSIG)

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

TN-40 EXTERNAL PRESSURE LOADING (25 PSIG)

CASK WEIGHT
COMPUTER CALCULATED VALUE

W = 250,000 LB.
W₁ = 149,310 LB.


TOP & LATERAL NEUTRON SHIELD:
12,569 LB.

OUTER SHELL:
7453 LB.

TOP TRUNNIONS:
354 LB.

BOTTOM TRUNNIONS:
209 LB.

WEIGHT OF INTERNALS

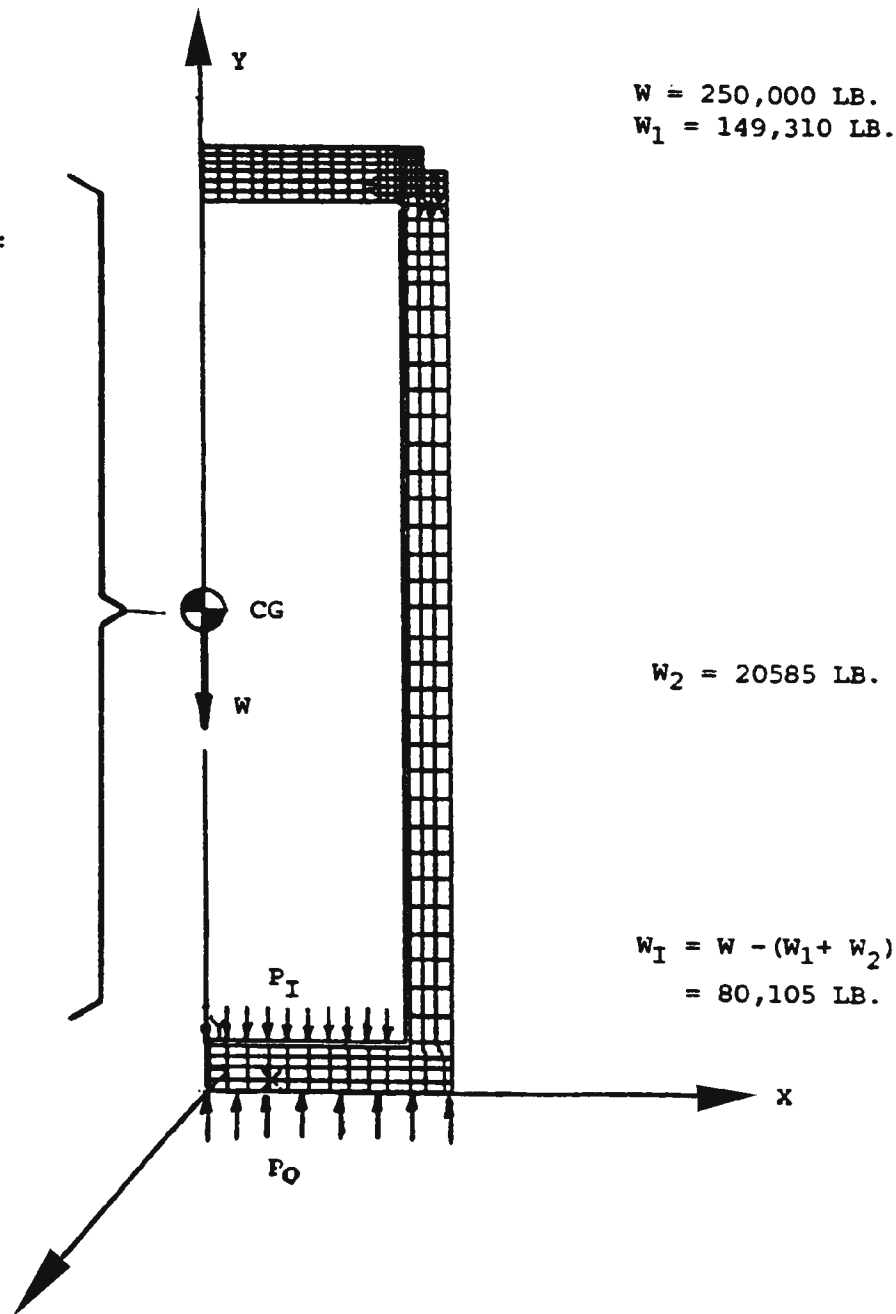

$$P_O = \frac{250,000}{\pi \times 45.5^2} = 38.44 \text{ PSI} \quad \text{PRESSURE ON BOTTOM OUTER SURFACE}$$

$$P_I = \frac{80,105}{\pi \times 36^2} = 19.67 \text{ PSI} \quad \text{PRESSURE ON CONTAINMENT BOTTOM INNER SURFACE}$$

Rev. 0 8/90

Figure 4A.3-9
TN-40 1g DOWN LOADING

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

TN-40 1g DOWN LOADING

$$F_{TR} = \frac{3 W}{2} = 3 \times \frac{250,000}{2} = 375,000 \text{ LB.}$$

$$F_B = 3(149,310 + 20,585) = 509,685 \text{ LB.}$$

$$P_I = \frac{80,105 \times 3}{\pi \times 36^2} = 59.02 \text{ PSI ; } 2F_{TR} + F_B + P_I A_I = 0$$

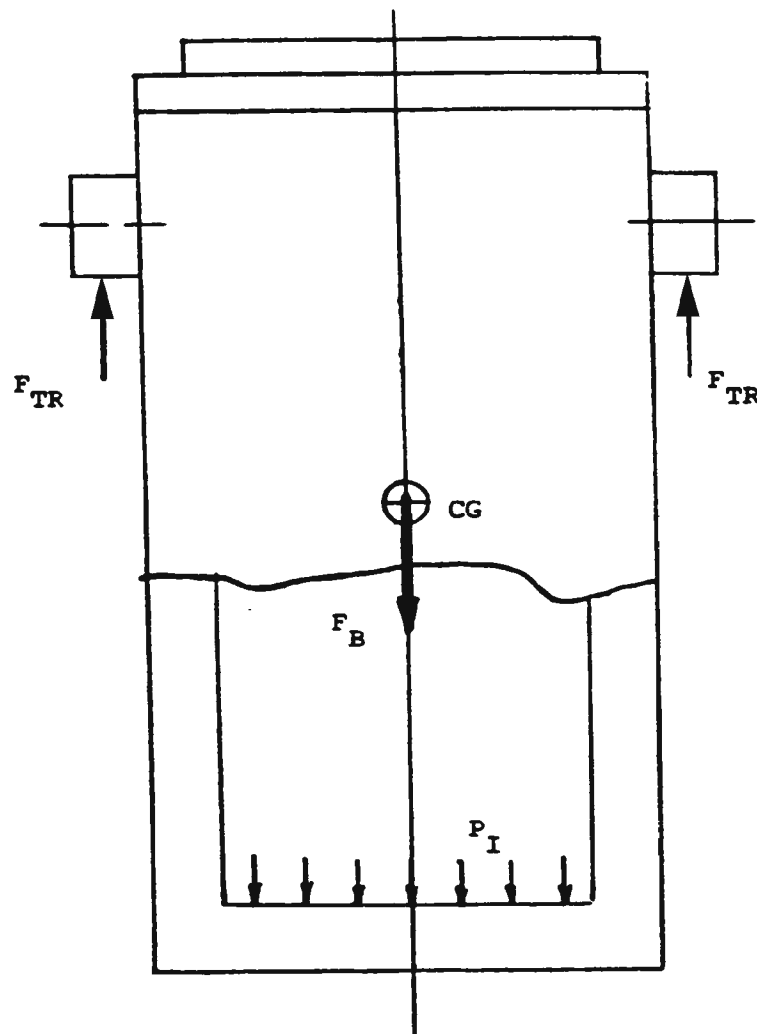


Figure 4A.3-10

TN-40 LIFTING: 3g VERTICAL UP

**PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT**

Rev. 0 8/90

TN-40 LIFTING: 3g VERTICAL UP

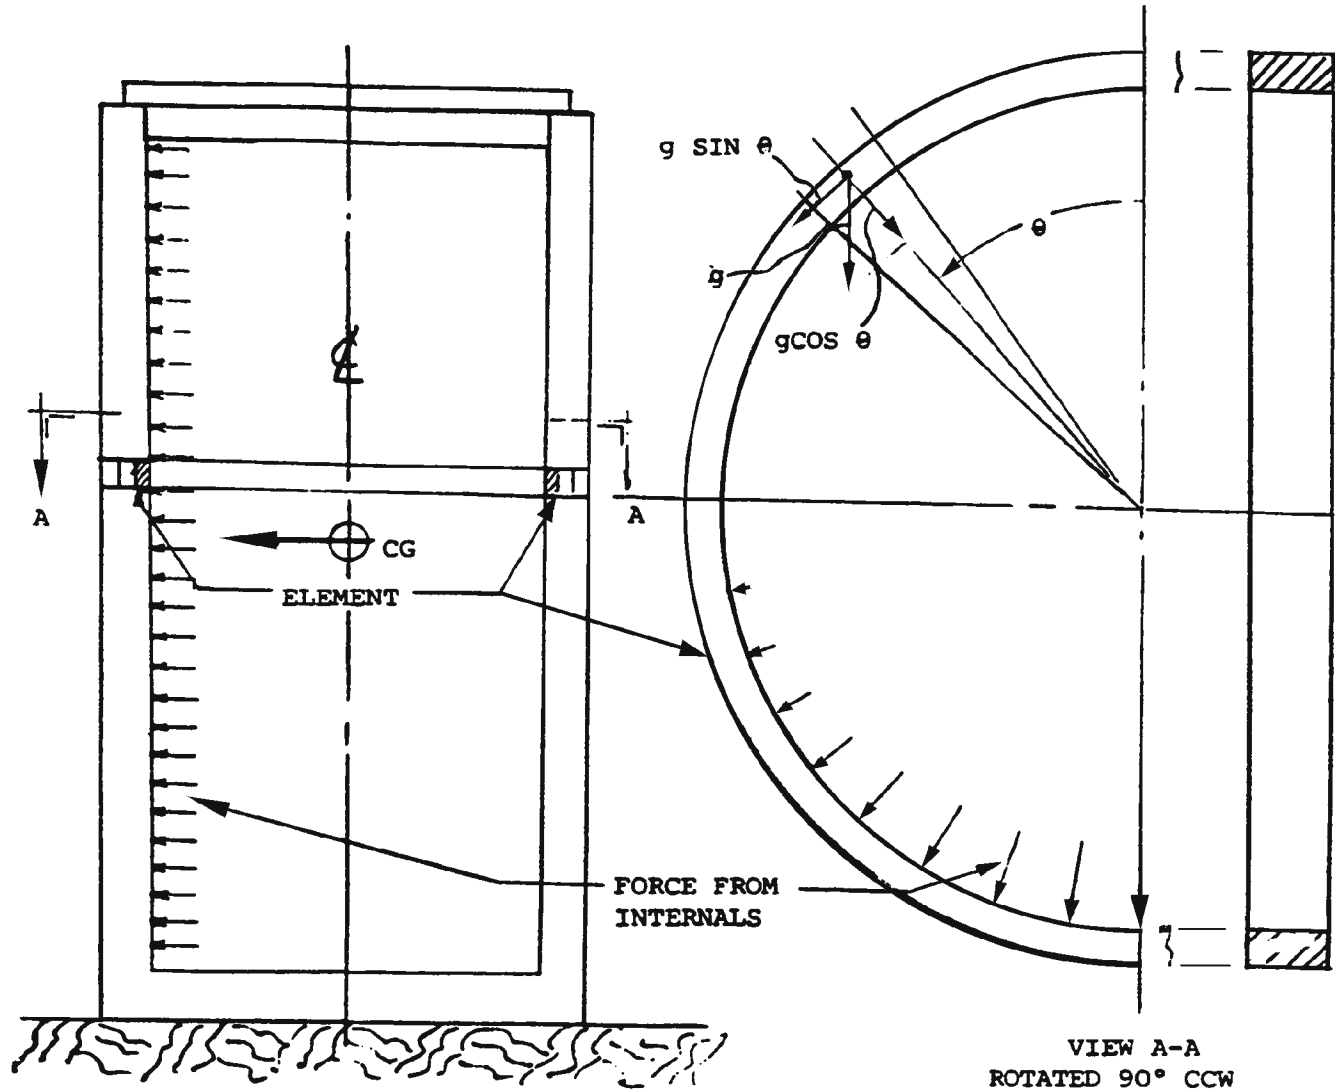



Figure 4A.3-11

TN-40 1g LATERAL

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

Rev. 0 8/90

TN-40 1g LATERAL

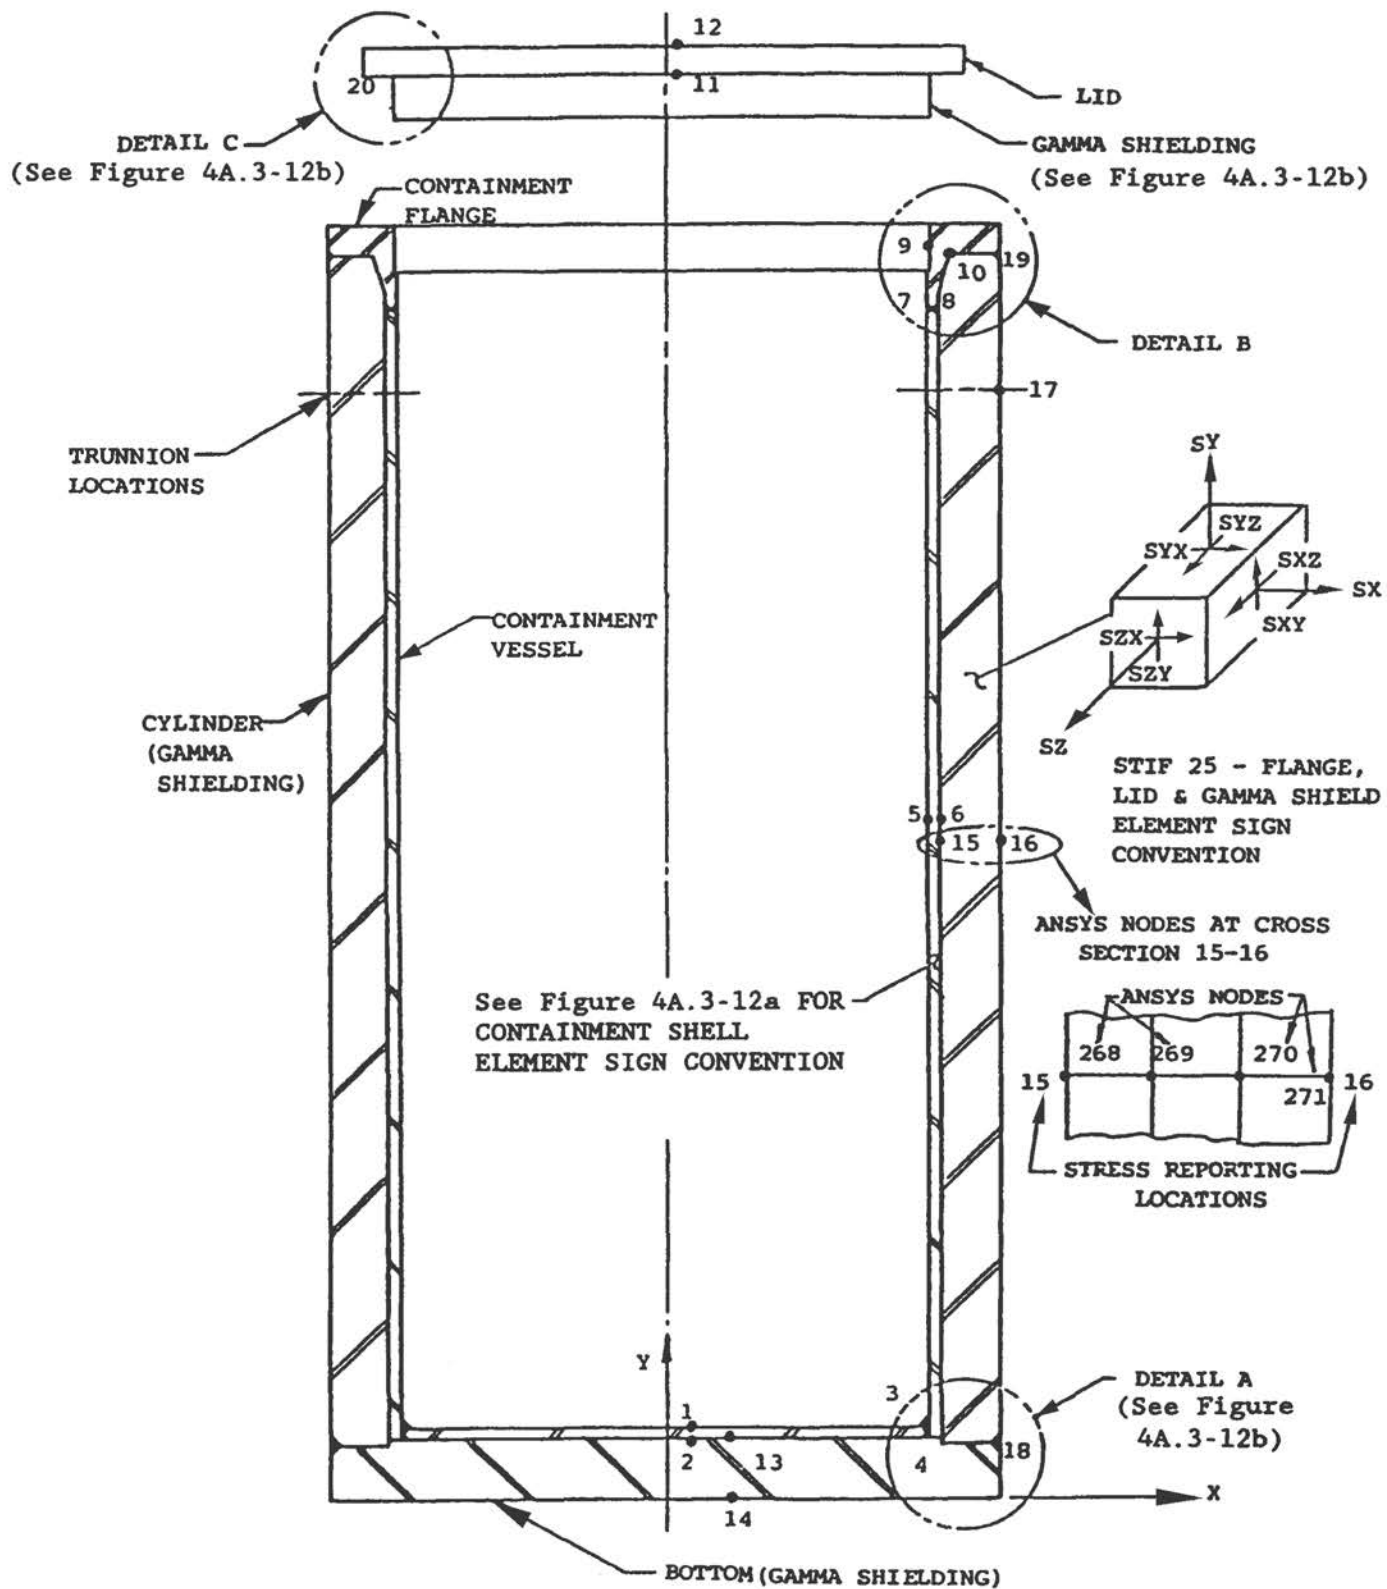

**Figure 4A.3-12
STANDARD REPORTING
LOCATIONS FOR TN-40
CASK BODY**

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

Rev 3 4/94

STANDARD REPORTING LOCATIONS FOR TN-40 CASK BODY

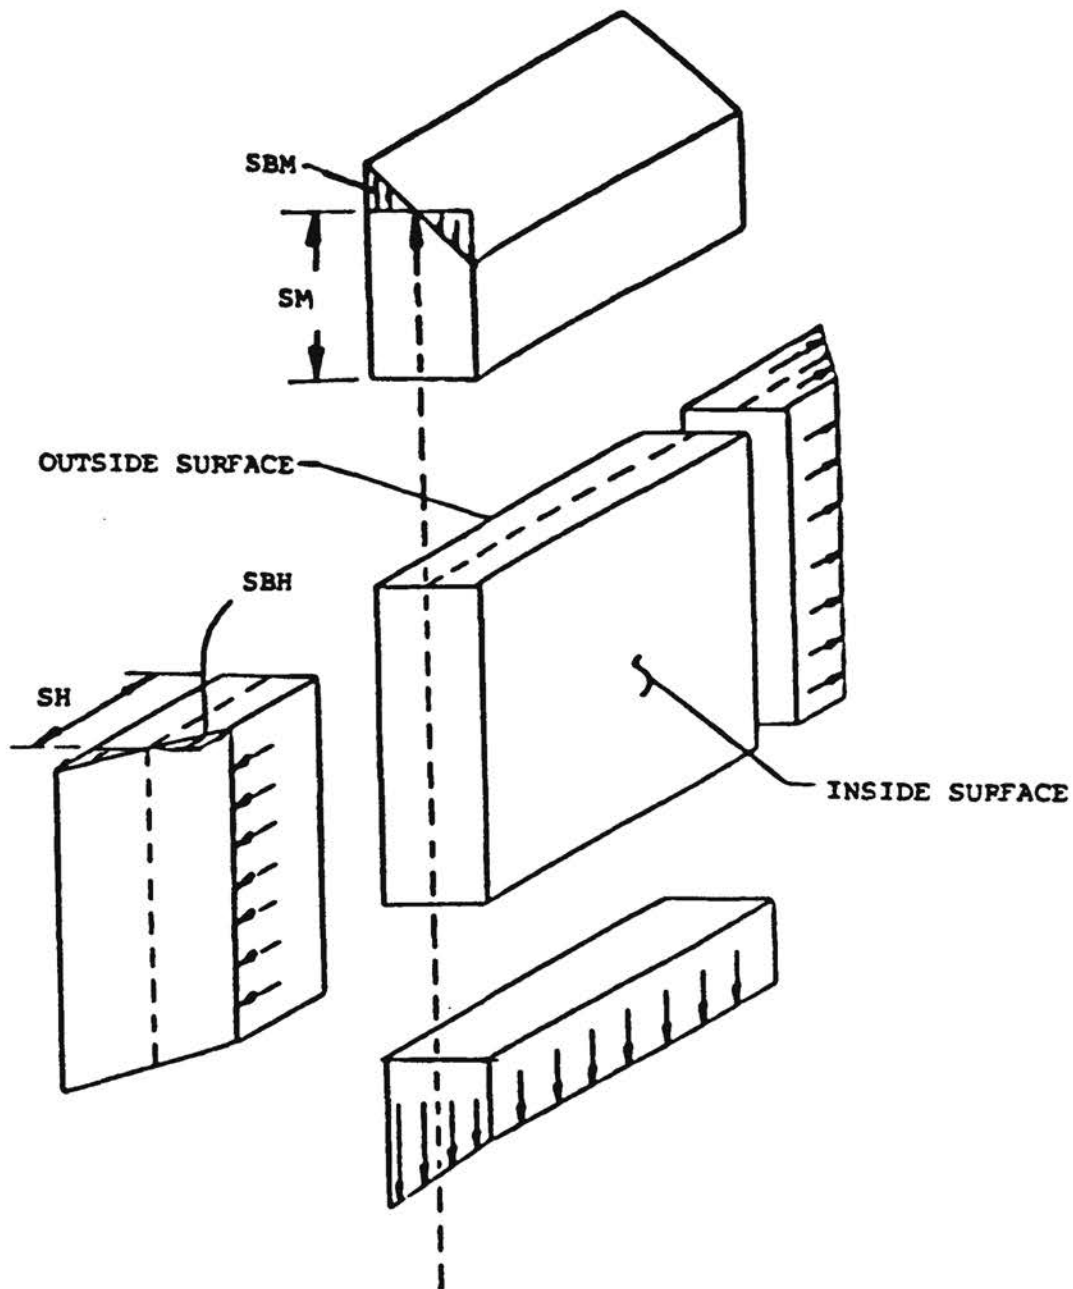


Figure 4A.3-12a
STIF 61 CONTAINMENT VESSEL
ELEMENT SIGN CONVENTION

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

Rev. 0 8/90

STIF 61 CONTAINMENT VESSEL ELEMENT SIGN CONVENTION

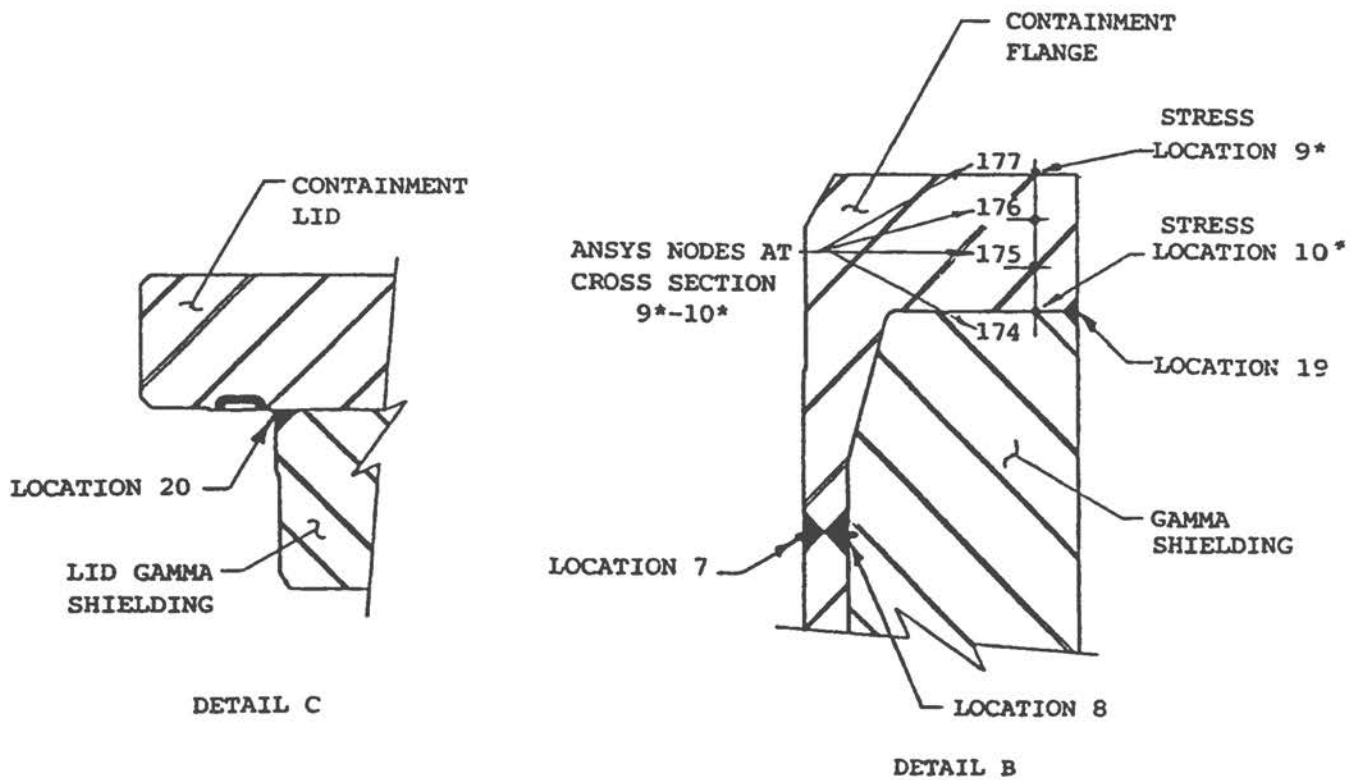
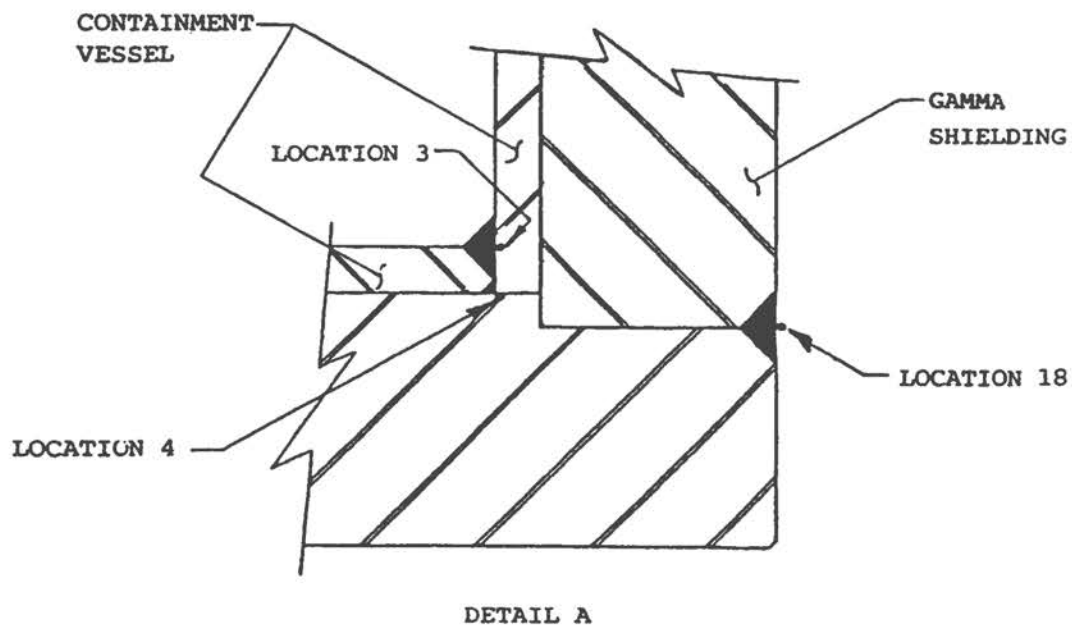



Figure 4A.3-12b
TN-40 WELD STRESS LOCATIONS

Rev. 2 9/91

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

TN-40 WELD STRESS LOCATIONS

MISSILE B IMPACTING
CASK SIDE

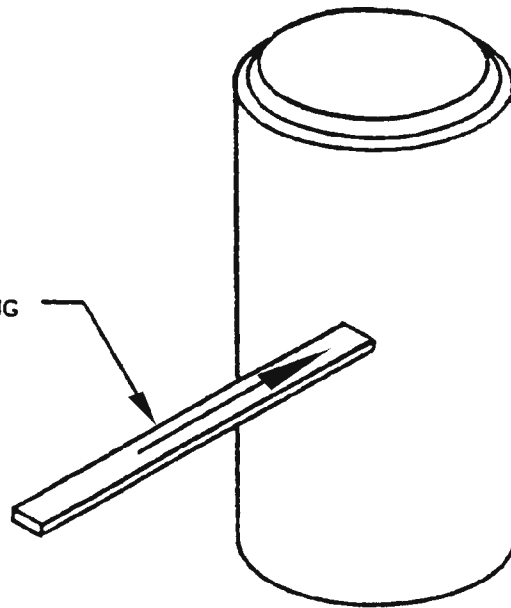

ACTUAL
IMPACT
CASE .



INERTIA REACTION

w

36 in. LENGTH OF
GAMMA SHIELDING

IDEALIZED
IMPACT
MODEL

IMPACT FORCE ,F

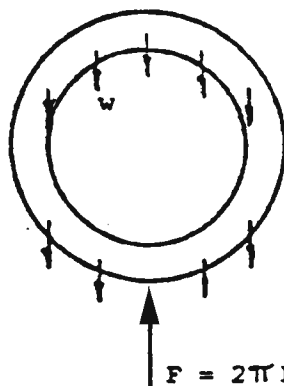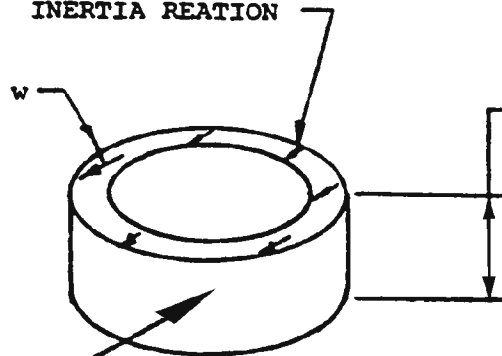




CASE 18 FROM
TABLE VIII
OF ROARK (REFERENCE 8)

Rev. 0 8/90

Figure 4A.3-13
IDEALIZED TORNADO MISSILE
IMPACT MODEL OF GAMMA SHIELD
CYLINDER

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

IDEALIZED TORNADO MISSILE IMPACT MODEL OF GAMMA SHIELD CYLINDER

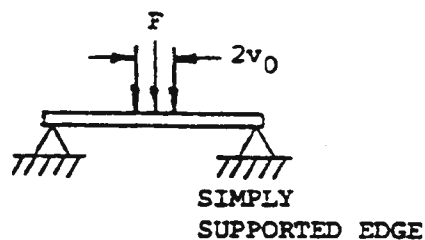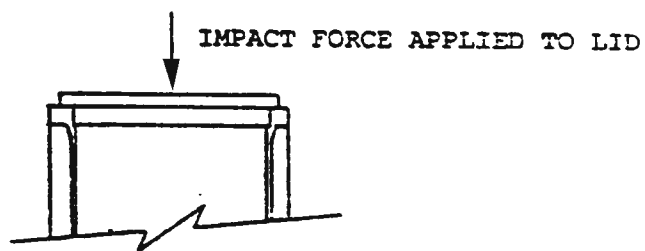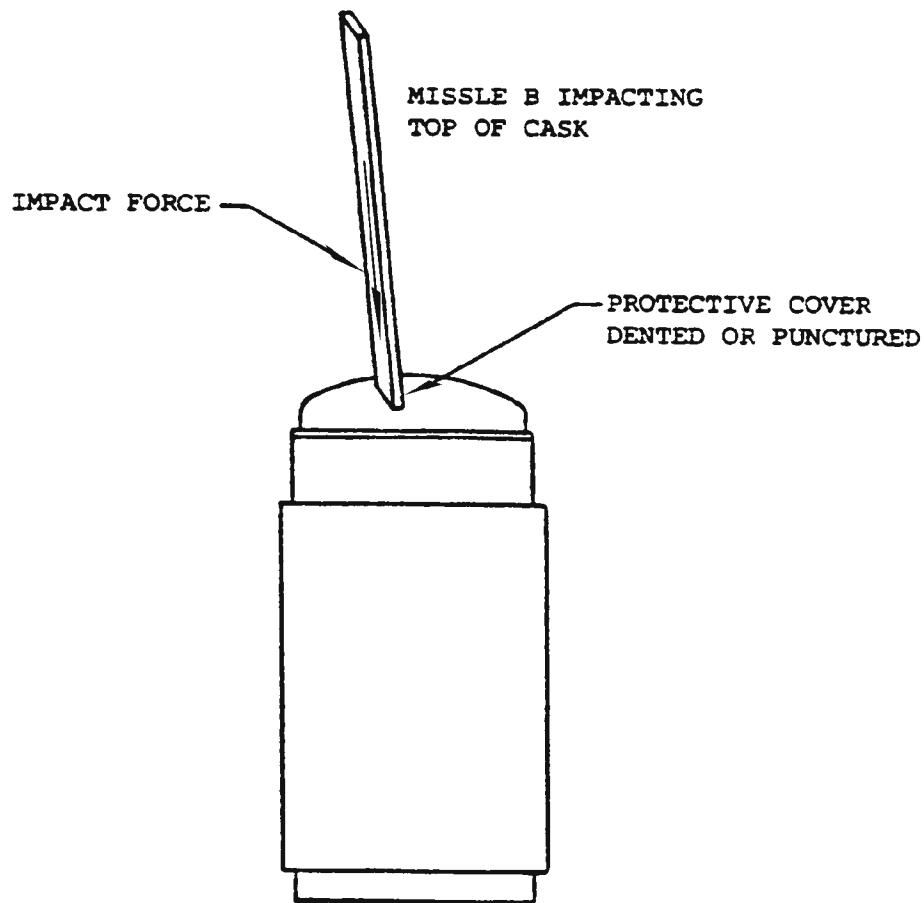

CASE 2 FROM
TABLE X OF RCARK
(REFERENCE 8)

Rev. 0 8/90

Figure 4A.3-14 IDEALIZED TORNADO MISSILE IMPACT MODEL OF LID

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

IDEALIZED TORNADO MISSILE IMPACT MODEL OF LID

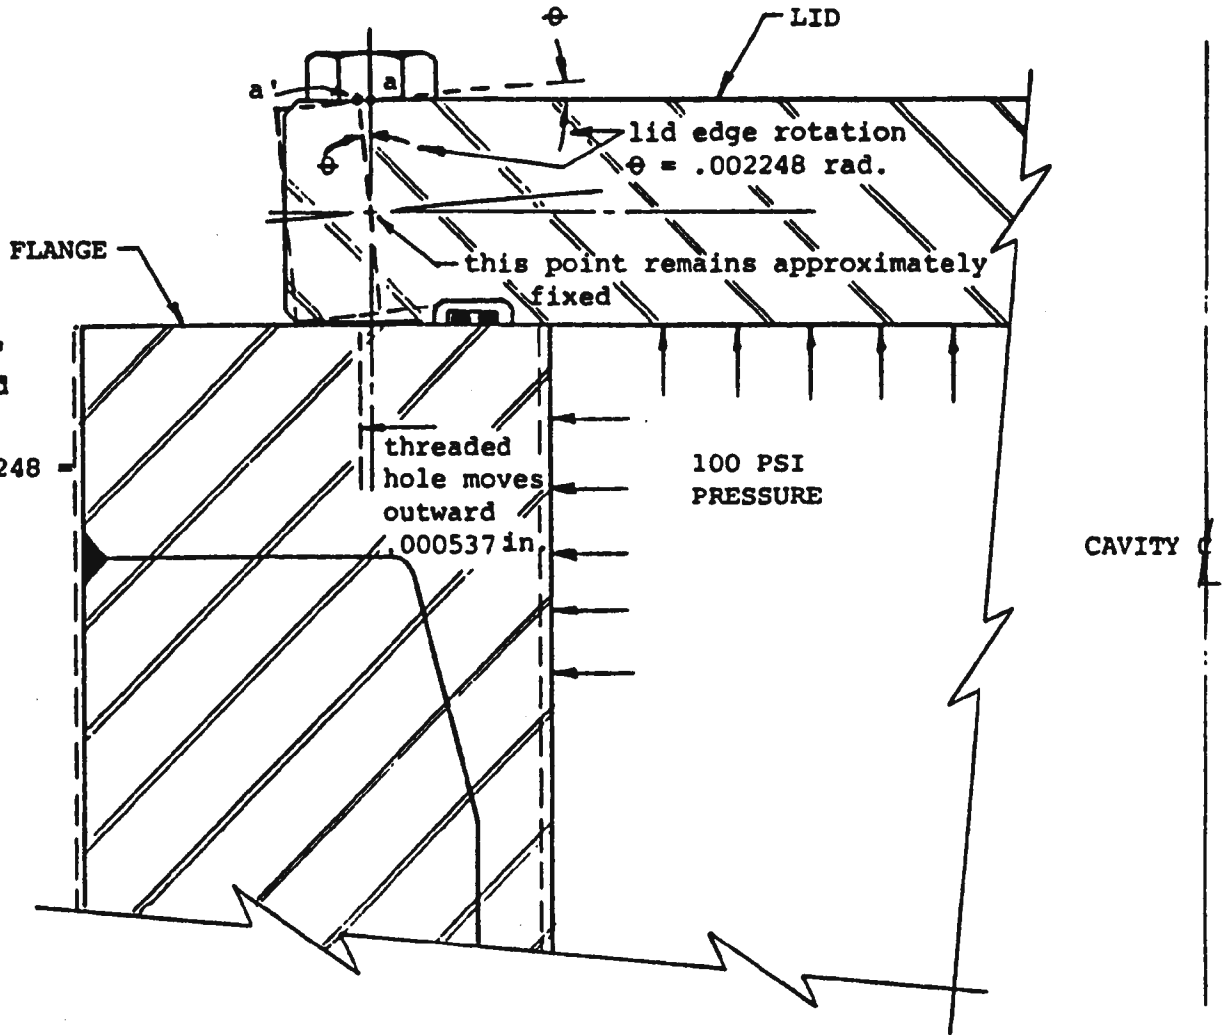


Figure 4A.4-1
SUMMARIZING THE BOLT END
MOTIONS DUE TO 100 PSIG PRESSURE
IN THE CASK CAVITY
 PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

Rev. 0 8/90

SUMMARIZING THE BOLT END MOTIONS DUE TO 100 PSIG PRESSURE IN THE CASK CAVITY

NORTHERN STATES POWER COMPANY

Xcel Energy

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
 RED WING, MINNESOTA

DRAWN BY:

VLS



REVISION:

0

FIG4A.4-1_REV_0

PAGE NO.

DATE: 04-20-06

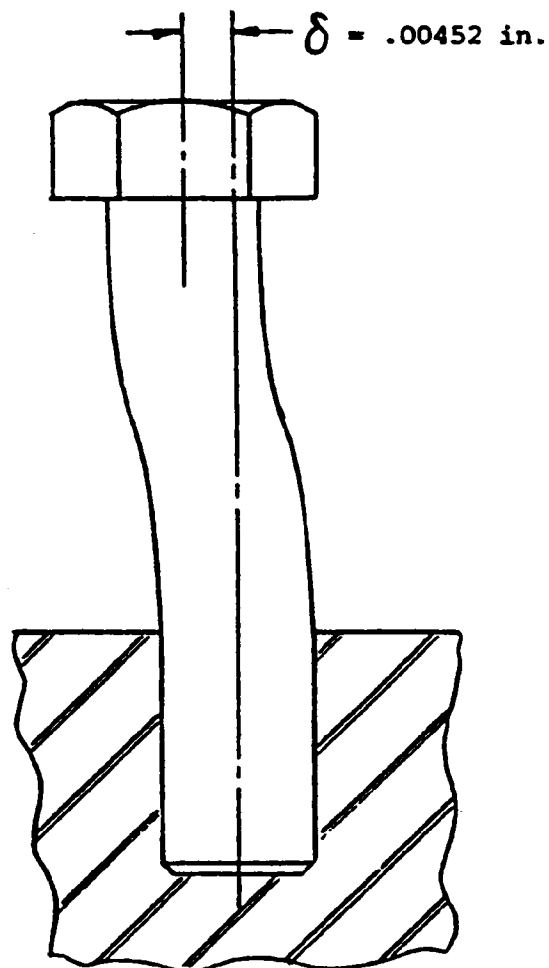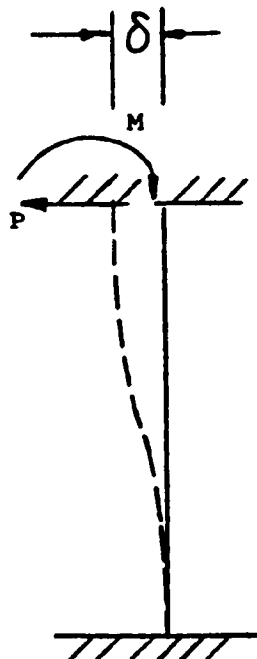

Rev. 0 8/90

Figure 4A.4-2
LID BOLT BENDING DUE TO LID EDGE
ROTATION UNDER INTERNAL
PRESSURE

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

LID BOLT BENDING DUE TO LID EDGE ROTATION UNDER INTERNAL PRESSURE

FIGURE 4A.5-1, REV. 1

DELETED

FIGURE 4A.5-2, REV. 1

DELETED

FIGURE 4A.5-3, REV. 1

DELETED

FIGURE 4A.5-4, REV. 1

DELETED

FIGURE 4A.5-5, REV. 1

DELETED

FIGURE 4A.5-6, REV. 1

DELETED

FIGURE 4A.5-7, REV. 1

DELETED

Security-Related Information Figure Withheld Under 10 CFR 2.390.

Figure 4A.6-1

TN-40 TRUNNION GEOMETRY

**PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT**

Rev. 4 10/95

TN-40 TRUNNION GEOMETRY

NORTHERN STATES POWER COMPANY



PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY: KJF

REVISION: 4

PAGE. NO.

DATE: 9-22-11

FIG4A.6-1_REV_4

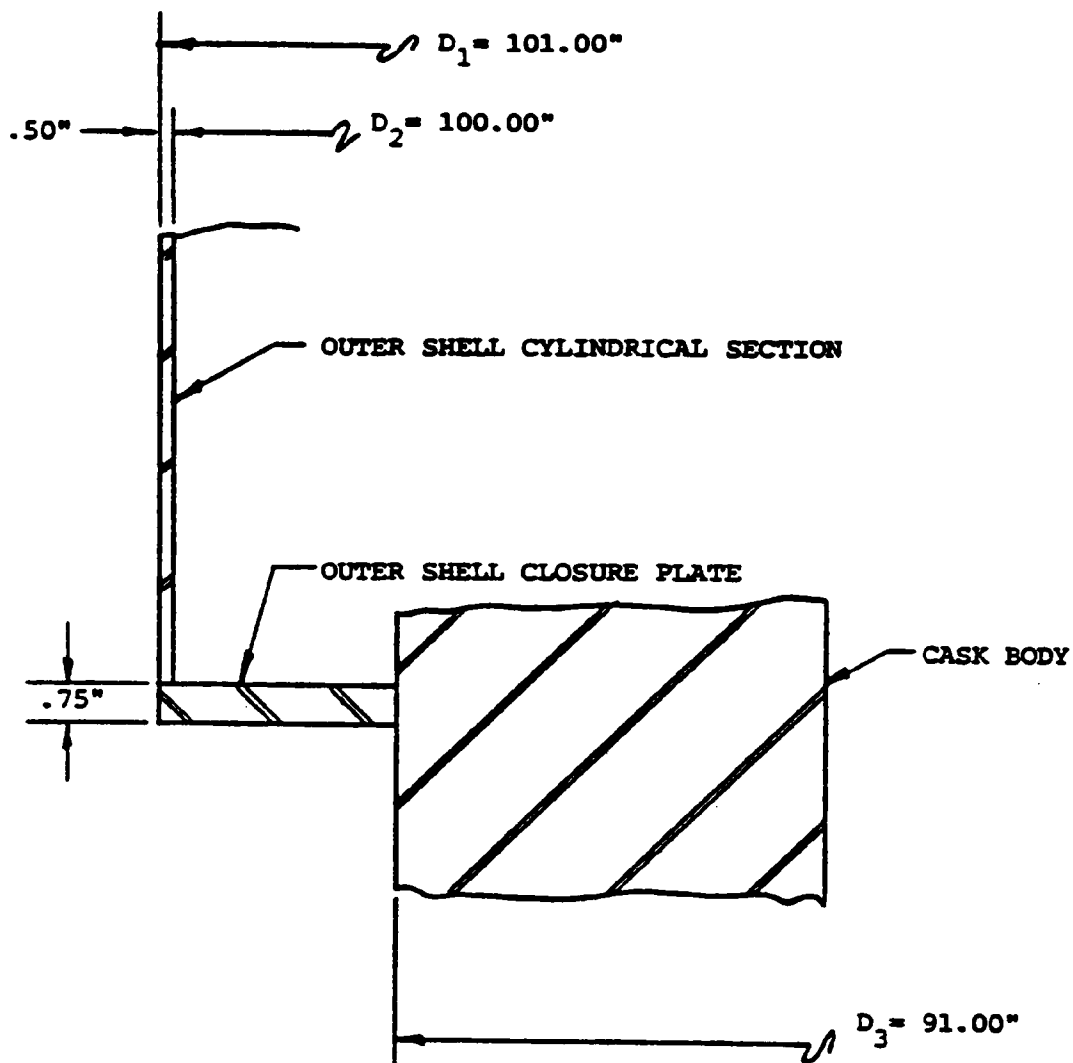


Figure 4A.7-1
TN-40 CASK OUTER SHELL AND
CONNECTION WITH CASK BODY


PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

Rev. 0 8/90

TN-40 CASK OUTER SHELL AND CONNECTION WITH CASK BODY

CASK HORIZONTAL

a) SIMPLY SUPPORTED ENDS

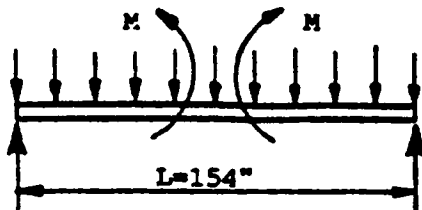


$$w = 20031 \times \frac{3}{154} = 390 \frac{\text{lbs}}{\text{in}}$$

$$M = \frac{wL^2}{8}$$


$$\sigma = \frac{Mc}{I}$$

b) FIXED ENDS

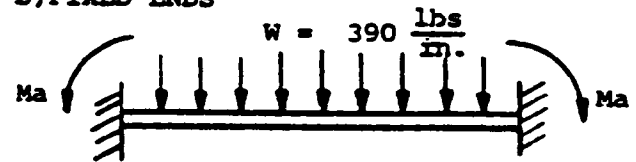

$$Ma = \frac{wL^2}{12}$$

$$\sigma_a = \frac{6Ma}{t^2}$$

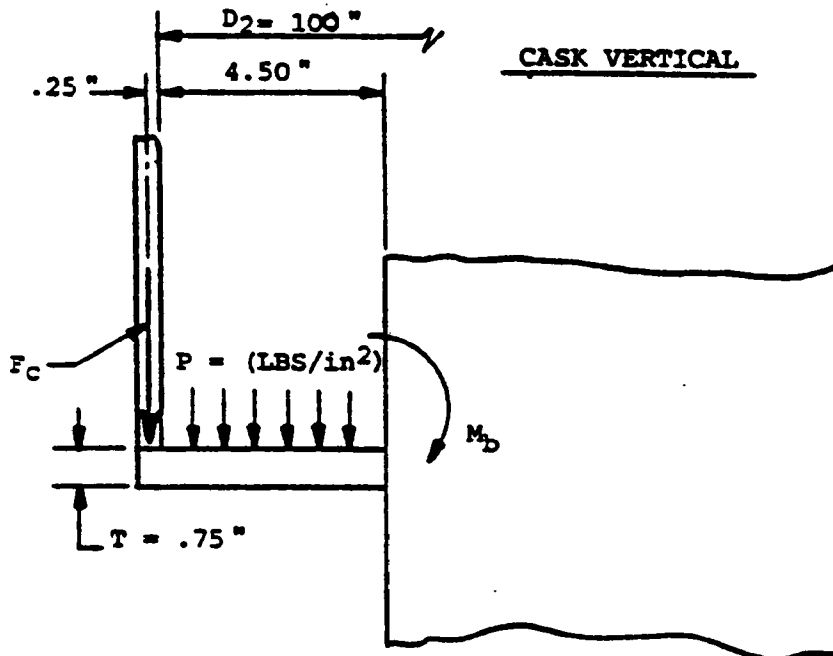

$$\sigma_b = \frac{6 M_b}{t^2} = K \frac{F_c}{t^2} + K \frac{P (D_2/2)^2}{t^2}$$

Rev. 0 8/90

Figure 4A.7-2 LOAD DISTRIBUTIONS AND MODELS USED FOR ANALYSIS FOR TN-40 OUTER SHELL

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

LOAD DISTRIBUTIONS AND MODELS USED FOR ANALYSIS FOR TN-40 OUTER SHELL

APPENDIX 4B

STRUCTURAL ANALYSIS OF THE TN-40 BASKET

4B.1 INTRODUCTION

This appendix presents the structural analysis of the TN-40 fuel support basket. The basket is a welded assembly of stainless steel boxes. The fuel compartment stainless steel box sections are attached together locally by cylindrical stainless steel plugs (that actually pass through the aluminum and boral plates) that are fusion welded to both adjacent box sections. The boral and aluminum plates are thus sandwiched between the stainless steel walls of adjacent box sections. The basket contains 40 compartments for proper spacing and support of the fuel assemblies.

The deformations and stresses induced in the basket structure due to the applied lateral loads are determined using the ANSYS computer program (Reference 1). The most severe loading for which the basket was evaluated is the 50 g vertical loading of the basket evaluated to represent a hypothetical end drop accident. Also a 3 g loading was applied to the basket in both lateral and vertical directions as a bounding load to represent both Design and Level A Conditions. In addition, primary plus secondary (thermal) stresses due to differential expansion were evaluated against Level A limits. The inertial loads of the fuel assemblies were applied to the basket structure as distributed loads applied to the plate surfaces. Quasistatic stress analyses were performed with applied loads in equilibrium with the reactions at the periphery of the basket. The calculated stresses in the basket structure were compared with the stress limits to demonstrate that the established design criteria are met.

Geometry

The details of the TN-40 basket are shown on Figures 1.3-6 and 1.3-7. As described above, the basket structure consists of an assembly of stainless steel boxes or cells joined by fusion welded steel plugs and separated by aluminum and boral poison plates. The stainless, aluminum and boral wall between fuel compartments is effectively a sandwich panel. The panel consists of two 13 gauge (0.088 in.) thick 304 stainless plates and two 0.25 in. thick 6061-T6 aluminum plates surrounding the 0.075 in. thick boral poison plate. The aluminum provides the heat conduction path from the fuel assemblies to the cask cavity wall, and the poison material provides the necessary criticality control.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

Page 4B-2

A representative basket wall panel between fuel compartments is shown in Figure 4B.2-1. The panel plates are fastened together at discrete locations (2 attachments every 8 inches) along their lengths. The adjacent fuel compartment stainless steel walls are fusion welded to cylindrical plugs that pass through holes in the boron and aluminum plates. This method of construction forms a very strong honeycomb-like structure of boxes. The open dimension of each fuel compartment cell or box is 8.05 in. x 8.05 in. which provides a minimum of 1/8 in. clearance around the fuel assemblies. The pitch of the cells is approximately 8.85 in. The overall basket length (160 in.) is less than the cask cavity length to allow for thermal expansion and tolerances.

Several of the aluminum conductor plates are continuous across the diameter of the basket to provide uninterrupted heat conduction paths. Other shorter plates are provided between and perpendicular to these continuous plates. Some of the aluminum plates are as short as one cell dimension in width.

Structural rails oriented parallel to the axis of the cask are attached to the inner cavity wall of the cask body to establish and maintain basket orientation, to prevent twisting of the basket assembly, and to support the edges of those plates adjacent to the rails which would otherwise be free to slide tangentially around the cask cavity wall under lateral inertial loadings.

Weight

A conservative value of 1,330 lb. is assumed for the weight of each fuel assembly. Under lateral inertial loading each assembly is assumed to be uniformly supported across the width and along the length of the basket wall. The inertia of the basket structure (weight of the basket x g load) is also included in the analysis.

Temperature

Thermal analyses were conducted to obtain the temperature distributions in the basket for various conditions. These analyses are presented in Chapter 3. Stress analysis of the basket using the thermal results are described below in Section 4B.6.

Material Properties

The material properties of the 304 stainless steel plates are taken from the ASME Code, Section III Appendices (Reference 2). The material properties of the aluminum alloy (6061-T-6) are also taken from the above reference except at elevated temperature. The elevated temperature properties not available in this reference are obtained from the Aluminum Association data (Reference 3). These properties are listed with specific references in Table 4B.1-1 and 4B.1-2. The material properties used in the finite element model analysis are listed in Table 4B.1-3. The maximum calculated basket temperatures and the temperatures selected for evaluation are listed in Table 4B.1-4. The full strength of the aluminum was considered when performing dynamic impact analyses. For long term sustained loading the aluminum strength is generally neglected under primary loading where it can share the load with the stainless steel.

4B.2 BASKET FINITE ELEMENT MODEL DEVELOPMENT (FOR SIDE IMPACT ANALYSIS)

Approach

The TN-40 basket is a large, complex redundant structure. The basket has 40 fuel compartments 8.05 in. x 8.05 in. x 160 in. long. There are 65 walls between adjacent fuel compartments, 30 exterior compartment walls and numerous radial and circumferential members. In addition, each wall between fuel compartments has 5 different layers of material which are attached to each other locally at 40 locations. Finally, the different layers (or plates) of material are free to slide relative to each other except at the attachment locations. Therefore a careful approach was needed to adequately model the basket while avoiding an excessively large computer model.

Since the major purpose of the analysis was to perform a side impact analysis, a unit slice of the basket cross section perpendicular to the cask longitudinal axis was modeled to represent the basket system. The basket has one axis of symmetry; therefore only half of the slice was modeled. Also, because the basket wall panels are quite complex (5 layers of material all connected differently at the edges and connected together only at the plugs and welds) a simplified wall panel substructure was developed for use in the half slice system model.

Panel Models

Figure 4B.2-1 shows a typical wall panel between adjacent fuel compartments. Note the 5 layers of material: 0.1 in. stainless steel (fuel compartment box side), 0.25 in. aluminum, 0.075 in. boral, 0.25 in. aluminum and another 0.1 in. stainless steel layer (adjacent fuel compartment box side). Note the plugs and welds in the lower enlarged detail. The plugs are spaced 5 in. apart in this section and 8 in. apart along the axis of the basket. Also note that, at the edges of the panel, the 0.1 in. stainless plate edges are actually the corners of the box sections. The aluminum plates sometimes end at the edges of the panel and in some cases continue beyond the panel edges into the next panel. The edge conditions at any panel depend on how these 5 layers or plates are attached to the corresponding plates in the adjacent panels.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

Page 4B-4

First, a detailed wall panel substructure finite element model was developed as illustrated schematically in Figure 4B.2-2. Figure 4B.2-3 is an ANSYS computer plot of this same model showing the elements properly scaled. This 876 element model carefully represents all of the panel components including the plugs and welds. The plates are modeled using ANSYS STIF 63 shell elements and the plugs using STIF 16 pipe elements. The edges of the detailed model terminate at the panel edges (compare Figures 4B.2-1 and 4B.2-3). The finite element model is 8 in. long along the axial direction of the basket and terminates midway between plugs and welds. Symmetry boundary conditions are applied at these front and rear planes (4 in. in each direction from the plugs and welds). The individual plates in the model are connected together in plane only at the plugs and welds (the plugs are rigidly connected to the 0.1 in. stainless steel plates and coupled to nodes in the aluminum and boral plates). The nodes of the various plates are coupled together in the out of plane direction so that they will bend in unison under surface pressure loading. This model is correct and complete and can be used to perform detailed wall panel stress analyses for various loadings simulating fuel assembly inertial reactions applied to the basket if the edge conditions of the various plates can be determined.

Next a simplified wall panel substructure with far fewer elements was developed. The simplified panel was intended for use in the system model of the basket cross section described above. The simplified model is illustrated in Figure 4B.2-4 and a computer plot of the model is provided in Figure 4B.2-5. This simplified model uses ANSYS STIF 91 laminated elements (which have shear deflection capability) to represent all of the various plates in the 5 in. wide region between weld lines and also to represent the aluminum and boral plates outboard of the weld line. The stainless steel box section corners are modeled using STIF 63 shell elements exactly as in the detailed panel model. The weld lines along the axial direction are modeled as rigid members (discrete local plugs and welds are not modeled). Based on the compression load tests described in Appendix 4C, the row of welds and plugs do in fact fix the 0.1 in. stainless steel plates to the aluminum plates along the weld lines.

The reviewer should note that the simplified panel substructure has approximately the same stiffness (stiffness matrix if you prefer) as the detailed model. This could have been accomplished by developing an array of springs or specifying a matrix of numbers to represent the panels in the ANSYS basket system model. The details of the simplified panel model (such as the continuous rigid weld line or the use of laminated elements to represent multiple plates) are not important since this simplified panel model is used only in the system model (described below) and is not used for panel stress analysis.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

Page 4B-5

The detailed and simplified panel substructure models (Figures 4B.2-3 and 4B.2-5) were both subjected to a surface pressure loading simulating a fuel assembly lateral inertial reaction on the basket plates. Cases were run for both models with the edges simply supported and fixed. As would be expected, the simplified model with laminated elements (perfect shear connection) was stiffer and deformed less than the detailed sliding plate model. The stiffness of the simplified panel was decreased until its performance agreed well with that of the detailed panel by decreasing the shear modulus of the aluminum layers in the laminated elements (inducing greater shear deflections in these elements)

Figure 4B.2-6 shows the center deflection, weld line deflection and edge rotation of the simplified panel model plotted vs. laminated element shear modulus for the simply supported case. The horizontal lines at the right edge of the figure show the detailed panel results. Figure 4B.2-7 shows the panel center moment comparison for this simply supported case. The moment is insensitive to shear modulus and there is excellent agreement between both models and classical theory. Figure 4B.2-8 shows the center and edge moments for the fixed edge case. Agreement between models and theory is excellent for a shear modulus range (laminated elements only) of 10,000 to 14,000 psi. A shear modulus of 11,000 psi was selected for subsequent analyses to be performed with the simplified panel model.

Basket System Model

A basket system model, shown in Figure 4B.2-9, was then developed by assembling an array of these simplified panels (with shear modulus of 11,000 psi). This system model is an extremely large and complex ANSYS model. The fuel compartment corners and basket periphery are carefully modeled to define each plate connection. Interface elements are provided between the corner nodes of the stainless steel shell elements to simulate the through thickness support provided by the aluminum. This system model was used to determine the response of the entire basket structure and to obtain the correct panel end conditions for the various loading cases. The panel end conditions were extracted from the system model results (for the highest loaded panels) and used as boundary conditions for the edges of the detailed panel model of Figures 4B.2-2 and 4B.2-3. This detailed panel model was then used directly to determine the stresses in the plates and welds since these components are modeled in detail in that model.

4B.3 DELETED

4B.4 DELETED

4B.5 DELETED

4B.6 BASKET ANALYSIS UNDER SUSTAINED LATERAL LOADINGS

It should be noted that the aluminum plates in the TN-40 basket are primarily heat conductors. The 304 stainless steel members are the primary structural components. The calculated stress intensities presented in this section have been corrected for the 13 gauge (0.088 in.) stainless steel boxes (ANSYS model assumes 0.1 in. SS).

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

Page 4B-6

As described in Section 4B.1, for long term sustained loading, the 6061 aluminum strength is generally neglected (except for through thickness strength) under primary loading where the aluminum can share the load with the 304 stainless steel. This analysis approach produces conservatively high calculated values of primary stresses in the stainless steel components. Since the aluminum strength is already neglected in this approach, creep, relaxation, yielding, etc. in the aluminum cannot increase the stainless steel primary stresses above these bounding results. The actual aluminum strength is considered, however, when determining the secondary (thermal) stresses that it can apply to the 304 stainless steel members. Thus the aluminum strength is neglected when it might reduce the calculated primary stresses in the stainless components but it is considered completely effective when it can induce secondary stresses in the stainless steel.

The primary stress analysis of the basket under the bounding loads for Design, Level A and Level D (not impact accidents) conditions described in Sections 3.2.5.4.2 and 4.2.3.4.4 is described below.

3 g Side Load Without Credit for Aluminum Strength

The system analysis was performed with a 3 g lateral inertial load at the 0° orientation shown in Figure 4B.6-1. The elastic modulus of the aluminum and boral were assumed to be small (10,000 psi) to simulate very weak materials. The computer results were scanned and the highest forces and bending moments and their corresponding locations are shown in Figure 4B.6-2. See Figure 4B.3-12 for system model panel locations. Based on the results from this figure, panel location 17 (highest force) and panel location 14 (highest temperature) were selected for analysis using the detailed plate panel model (Figures 4B.2-2 and 4B.2-3). These panel analyses were accomplished by extracting the edge displacements from the system model and applying them to the corresponding edges of the plate panel model. The results were postprocessed to printout the stresses at the 20 standard locations on the basket panel shown in Figure 4B.3-13. Figures 4B.6-3 and 4B.6-4 list the plate stress intensities and plug weld shear stresses for the above two panels. These stresses will be evaluated below to verify that the design criteria are met.

Thermal Stress

The thermal analysis of the basket is described in Section 3.3.2.2. That analysis was performed to determine the basket temperatures for the condition with maximum solar heating, maximum decay heat from the cask contents, and 100°F ambient air. The temperatures from that thermal analysis were used directly in the ANSYS structural models to calculate the basket panel stresses due to differential thermal expansion. Stresses occur due to the differences between the coefficients of thermal expansion of the 304 stainless, the aluminum and boral.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

Page 4B-7

When a panel consisting of aluminum (and boral) and stainless plates is heated, the aluminum expands more than the stainless steel. For example, if a 5 in. long strip (the plug to plug centerline spacing across the panel) of 304 stainless is heated from 70°F to 400°F, it expands 0.0115 in. A 5 in. strip of aluminum expands 0.0223 in., or 0.0108 in. more than the stainless. If the plates were perfectly connected, a compressive stress of 10,240 psi would develop in the aluminum. However, since the connection is only local at a 1 in. diameter plug each 8 in., a simple hand analysis (assuming tight plugs) would result in an aluminum bearing stress of $8 \times 10,240$ or 81,920 psi, far above the aluminum yield stress of 13,300 psi at 400°F. Therefore local plastic deformation of the aluminum plates in areas adjacent to the plugs will occur (if the plugs are not centered in the holes at assembly) and this effect must be properly considered to accurately determine the 304 stainless secondary stress state.

The first task in determining the thermal stresses was to run the system model. The full elastic behavior of the aluminum was considered in that model to conservatively determine panel edge loads, displacements, etc. The results from the system model were scanned. Since panel location 14 is located in the highest temperature (530°F) area of the basket, the results from this panel were used to run the detailed plate model.

The detailed panel model used for the panel thermal stress analysis is shown in Figure 4B.6-5. It is conservatively assumed that the 1 in. diameter stainless steel plugs that penetrate the 1.12 in. diameter holes in the aluminum (and boral) plates are not centered. The plugs are assumed to be in contact initially (at 70°) with the opposing sides of the two holes in the aluminum (the sides toward the center of the panel) so that the maximum interference of aluminum and steel will occur when the panel is heated. It should be noted that this is a condition that cannot reverse. If the temperature decreases after initial heatup, the plug to aluminum contact will be lost but tension cannot be developed at the plug to aluminum interface.

The holes in the aluminum and boral plates are modeled (see square holes in Figure 4B.6-5). Also the bearing interfaces between the aluminum plates and plugs are approximately modeled using rigid members connected between the edges of the holes and nodes on the axis of the pipe elements representing the plugs. Plasticity was considered in the local regions (only) of the aluminum plates at the plug/aluminum bearing interfaces. In these local areas of the aluminum the ANSYS STIF 63 elastic shell elements were replaced with STIF 48 plastic shell elements. The 304 stainless steel structural members are still modeled elastically. The stress vs. strain curve used for the aluminum was based on Table 4B.1-1 from the Aluminum Association data. The boral sheet was assumed to have the same material properties as the aluminum.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

Page 4B-8

Figure 4B.6-6 lists the thermal stresses from this detailed panel analysis. The reviewer should be reminded that these stresses in the 304 stainless steel structural plates are elastic stresses. The stainless steel is modeled as an elastic material even though local plasticity is considered in the aluminum (which applies differential expansion loading to the stainless steel). These stresses are conservatively combined with the stresses from the 3 g side load by adding stress intensities at the stress reporting locations. The combined primary plus secondary (thermal) stresses are listed in Figure 4B.6-7. The stresses are compared with the specified limits below.

Design Criteria

The primary stress analysis of the basket for sustained Design, Level A and Level D Service Conditions does not take credit for the aluminum conductor plates except for through thickness compression. The aluminum strength is, however, considered when determining secondary stresses in the stainless steel.

The basis for the 304 stainless steel fuel compartment box section stress allowables is Section III of the ASME Code. The primary membrane stress intensity and primary membrane plus bending stress intensities are limited to S_m (S_m is the Code allowable stress intensity) and $1.5 S_m$, respectively, at any location in the basket for Design and Level A load combinations. The 3 g bounding load cases described above also bound all Level D loads such as seismic and tornado effects. No special Level D criteria or evaluation are needed for these sustained loadings, however, since these Level D loadings (less than the 3 g bounding loads) are evaluated as Design Conditions.

The ASME Code provides a basic $3 S_m$ limit on primary plus secondary stress intensity for Level A conditions. That limit is specified to prevent ratcheting of a structure under cyclic loading and to provide controlled linear strain cycling in the structure so that a valid fatigue analysis can be performed. The Code also provides guidance in the application of plastic analyses which can be performed to demonstrate shakedown (absence of ratcheting) and to determine stresses for fatigue evaluation. Ratcheting and fatigue cannot occur in the basket since thermal cycling will not occur and interference loading at the plug/aluminum interfaces cannot reverse.

Evaluation

Figure 4B.6-4 lists the stress intensities for the 3 g side load in the basket at panel location 14. Note that these stresses have been calculated elastically (assuming structurally ineffective aluminum). The highest membrane stress intensity is 465 psi at stress reporting location 20. The highest membrane plus bending stress intensity is 3,594 psi at stress location 5. These stresses are well below the allowable membrane stress intensity (S_m) of 17,000 psi and the allowable membrane plus bending stress intensity ($1.5 S_m$) of 25,700 psi based on the temperature of 530°F at this panel location.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

Page 4B-9

Figure 4B.6-3 lists the stress intensities for the 3 g side load in the basket at panel location 17. The highest membrane stress intensity is 1,378 psi at stress reporting location 1. The highest membrane plus bending stress intensity is 6,056 psi, also at stress location 1. These stresses are well below the allowable 304 stainless steel membrane stress intensity of 19,000 psi and membrane plus bending stress intensity of 29,000 psi based on the temperature of 330°F at this panel location.

Figure 4B.6-6 lists the thermal stresses due to differential thermal expansion in the basket at panel location 14, and Figure 4B.6-7 lists the combined stress intensities for the thermal stress and 3 g side load. The basic primary plus secondary stress limit at any location on the 304 stainless steel panel is $3 S_m$ or 51,000 psi at the maximum temperature of 530°F. The maximum primary plus secondary stress intensity of 49,036 psi occurs at stress location 4 and is well below the basic allowable stress. The maximum weld stress intensity is 50,902 psi which is also below the basic limit.

Based on the results of these analyses, it is concluded that:

1. The maximum 304 stainless steel (fuel compartment box) stresses, both in the center and peripheral regions of the basket, are well below the specified allowable stresses under the Design (3 g side load) and Level A (3 g load plus thermal stress) conditions.
2. The maximum shear stresses in the plug welds are low under the 3 g loading above. The stainless and aluminum plates may push against the plugs due to differential thermal expansion if the plugs are not centered in the holes in the aluminum at assembly. In the worst plug misalignment case the weld shear stress could reach a maximum of 25,451 psi. The corresponding stress intensity is $2 \times \tau$ or 50,902 psi. This stress intensity is below the basic $3 S_m$ limit of 51,000 psi. This basic limit ensures that thermal ratcheting of a structure does not occur. This primary plus secondary limit could be exceeded in the TN-40 basket since the stress does not cycle and since the loading cannot reverse.
3. The aluminum plates are generally not considered to have a structural function under Design or Level A conditions. Nevertheless, the primary plus secondary (thermal) stress in the aluminum plates midway between the stainless plugs (stress reporting locations 10 and 12) is no greater than 1,617 psi since this upper bound stress was calculated assuming the stainless plugs were misaligned in the aluminum holes in the worst possible way. This stress is much less than the 10,240 psi discussed above that might develop in a perfectly connected aluminum plate. The 1,617 psi stress is also far below the 8,535 psi allowable compressive stress (based on stability or buckling) in the aluminum from Figure 4B.5-5. Therefore compressive stresses developed in the aluminum cannot cause these plates to buckle.
4. The basket is structurally adequate and it will properly support and position the fuel assemblies.

4B.7 BASKET ANALYSIS UNDER VERTICAL LOADINGS

Under vertical loads, the fuel assemblies and basket are forced against the bottom of the cask. It is important to note that, for any vertical or near vertical loading, the fuel assemblies react directly against the bottom of the cask cavity and not through the basket structure as in lateral loading. The fuel assemblies weigh 52,000 lb and the basket weighs 15,841 lb. Therefore the basket weight is only about 25% of the total cask internals weight (of fuel and basket). Therefore the vertical basket inertial loading is only about 25% of the lateral loading for a given g level.

3 g Vertical Load Without Credit for Aluminum Strength

The analysis of the basket subjected to the 3 g bounding vertical load (bounds all Design, Level A and Level D sustained loads) is presented in Figure 4B.7-1. A full length of compartment wall (160 in. long) with a span length of 8.05 in. is evaluated for compressive load. A maximum compressive force of 431 lb occurs at the bottom of the wall. Stresses are conservatively calculated by assuming all of the load is taken by the 304 stainless steel. Therefore

$$\sigma = \frac{\text{Total Compressive Load}}{\text{Cross Section Area of 304SS}} = \frac{431 \text{ lb.}}{1.42 \text{ in.}^2} = 304 \text{ (psi)}$$

Based on the above results it is concluded that the stress on the stainless steel panel due to the 3 g vertical load is insignificant and additional analysis is not necessary.

Vertical Load Due to Hypothetical End Drop Accident

Section 8.2.8.2.1 presents the dynamic impact analysis of the TN-40 cask during a hypothetical end drop accident. That section of the SAR recommends that the cask be analyzed for 50 g vertical loading to conservatively evaluate this accident.

Figure 4B.7-1 presents the analysis of the basket due to a 3 g vertical load neglecting the strength contribution from the aluminum. Using the same weight and dimensions, the compressive stress on the 304 stainless steel plates for a 50 g load is 50/3 x 304 or 5,067 psi. This stress level is acceptable for any criteria (Design, Level D or Level D impact). In addition, test data presented in Appendix 4C show that the compressive stress can reach 23,000 psi before buckling failure even without the stiffening effects of the aluminum plates. Therefore the 5,067 psi stress is acceptable based on both stress and buckling criteria.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 9

Page 4B-11

4B.8 REFERENCES

1. De Salvo, G.J. and Swanson, J.A., ANSYS Engineering Analysis System Users Manual for ANSYS Revision 4.3, Swanson Analysis Systems, Inc., Houston, PA, June 1987.
2. American Society of Mechanical Engineers, ASME Boiler and Pressure Vessel Code, Section III Appendices, 1989.
3. Aluminum Standards and Data, Volume 1, The Aluminum Association, 1976.

THIS PAGE IS LEFT INTENTIONALLY BLANK

**PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT**

Revision: 9

TABLE 4B.1-1

MECHANICAL PROPERTIES OF BASKET MATERIALS (NOTE 1)

| MATERIAL SPECIFICATION (NOMINAL COMPOSITION) | APPLICATION | MINIMUM YIELD STRENGTH S_y, psi | MINIMUM ULTIMATE STRENGTH S_u, psi | DESIGN STRESS VALUE, (NOTE 2) | DATA SOURCE (NOTE 3) |
|---|--------------------|---|--|--|-------------------------------------|
| ASME SA-240, Type 304 (Stainless Steel) | Basket | 30,000 | 75,000 | $S_m=20,000$ | Table I-1.2 p. 25 |
| ASME SB-209, Alloy 6061-T6 (Aluminum) | Basket | 35,000 | 42,000 | $S=10,500$ | Table I-8.4 p. 189 |

NOTES

1. Mechanical properties listed are for metal temperatures up to 100° to provide a baseline comparison of all structural materials.

Temperature dependent properties required for structural analysis are provided in Table 4A.2-2.

2. Values listed are the stress parameters which form the basis for structural analysis acceptance criteria.

S refers to the ASME allowable stress for Class 2 or Class 3 components,
 S_m refers to the ASME design stress intensity for Class 1 components, and S_y refers to minimum yield strength.

3. Data are taken from tables in ASME Section III, Appendix I, 1989 unless otherwise noted

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4B.1-2

SHEET 1 OF 3

TEMPERATURE DEPENDENT MATERIAL PROPERTIES
COEFFICIENTS OF THERMAL EXPANSION

| MATERIAL | TEMPERATURE, °F | | | | | | | | | | |
|-----------------------------|------------------------|------------|------------|------------|------------|------------|------------|------------|------------|------------|------------|
| | 100 | 150 | 200 | 250 | 300 | 350 | 400 | 450 | 500 | 550 | 600 |
| SA-240, Type 304 | 8.55 | 8.67 | 8.79 | 8.90 | 9.00 | 9.10 | 9.19 | 9.28 | 9.37 | 9.45 | 9.53 |
| SB-209, Aluminum 6061-T6 | 12.60 | 12.76 | 12.91 | 13.07 | 13.22 | 13.37 | 13.52 | | | | |

Values listed are the mean coefficients of thermal expansion $\times 10^{-6}$ (in./in.°F) from 70°F to the indicated temperature. Source of data is ASME Section III, Appendix I, Table I-5.0, pp. 123-128.

**PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT**

Revision: 9

TABLE 4B.1-2

SHEET 2 OF 3

**TEMPERATURE DEPENDENT MATERIAL PROPERTIES
MODULI OF ELASTICITY, E**

| MATERIAL | TEMPERATURE °F | | | | | |
|---|-----------------------|------------|------------|------------|------------|------------|
| | 70 | 200 | 300 | 400 | 500 | 600 |
| SA-240, Type 304 Stainless Steel | 28.3 | 27.6 | 27.0 | 26.5 | 25.8 | 25.3 |
| SB-209, 6061-T6 Aluminum | 10.0 | 9.6 | 9.2 | 8.7 | 8.1 | |
| Boral (Based on Brooks Perkins Data Sheet) | 5.8 | | | | | |

Values listed are the moduli of elasticity $\times 10^6$ psi for the indicated temperature.

Source of data is ASME Section III, Appendix I, Table I-6.0, pp. 129 –130.

**PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT**

Revision: 9

TABLE 4B.1-2

SHEET 3 OF 3

**TEMPERATURE DEPENDENT MATERIAL PROPERTIES
DESIGN STRESS PARAMETER**

| MATERIAL | STRESS PARAMETER (NOTE 1) | TEMPERATURE °F | | | | | | DATA SOURCE |
|------------------------------|--|-----------------------|------------|------------|------------|------------|------------|---|
| | | 100 | 200 | 300 | 400 | 500 | 600 | |
| ASME SA-240, Type 304 | S _y | 30.0 | 25.0 | 22.5 | 20.7 | 19.4 | 18.2 | Table I-2.2, p. 67 (NOTE 2) Table I-2.2, p. 25 |
| | S _m psi | 20.0 | 20.0 | 20.0 | 18.7 | 17.5 | 16.4 | |
| ASME SB-209 Alloy 6061-T6 | S _y | 35.0 | 33.2 | 27.4 | 13.3 | 4.375 | --- | NOTE 3 |
| | S _u ksi | 42.0 | 36.7 | 31.7 | 12.7 | 7.0 | --- | |

NOTES

- Values listed are the stress parameters which form the basis for structural analysis acceptance criteria.
S_m refers to the ASME design stress intensity for Class 1 components, and
S_y refers to minimum yield strength.
S_u refers to minimum ultimate strength.
- Data are taken from ASME Section III, Appendix I as noted.
- 87.5% of Reference 3 data as recommended by ASME Subgroup on Non Ferrous Alloys.

**PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT**

Revision: 9

TABLE 4B.1-3

MATERIALS PROPERTIES USED FOR TN-40 BASKET FINITE ELEMENT MODEL

| MATERIAL | TEMPERATURE (°F) | ULTIMATE STRENGTH (psi) | YIELD STRENGTH (psi) | MODULUS OF ELASTICITY (psi × 10⁶) | THERMAL EXPANSION (in./in./°F) |
|------------------------------|-----------------------------|--|-------------------------------------|---|---|
| 304 S.S. | 70 | 75,000 | 30,000 | 28.3 | ---- |
| | 300 | 66,000 | 22,500 | 27.0 | 9.0×10^{-6} |
| | 400 | 64,400 | 20,700 | 26.5 | 9.19×10^{-6} |
| | 500 | 63,500 | 19,400 | 25.8 | 9.37×10^{-6} |
| *ALUMINUM 6061-T6 | 70 | 42,000 | 35,000 | 10.0 | ---- |
| | 300 | 31,700 | 27,400 | 9.2 | 13.22×10^{-6} |
| | 400 | 17,700 | 13,300 | 8.7 | 13.52×10^{-6} |
| | 500 | 7,000 | 4,375 | 8.1 | 13.82×10^{-6} |

* Boral is assumed to have the same properties as 6061-T6 aluminum except for modulus of elasticity listed in Table 4B.1-2.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 4B.1-4

**REFERENCE TEMPERATURE FOR
STRESS ANALYSIS ACCEPTANCE CRITERIA (TN-40 BASKET)**

| LOCATION | MAX. CALCULATED TEMPERATURE, °F | SELECTED DESIGN TEMPERATURE, °F |
|-----------------------------------|--|--|
| Centerline at Mid Height (max) | 530 | 530 |
| Centerline at Top | 392 | 400 |
| Periphery at Top | 305 | 330 |

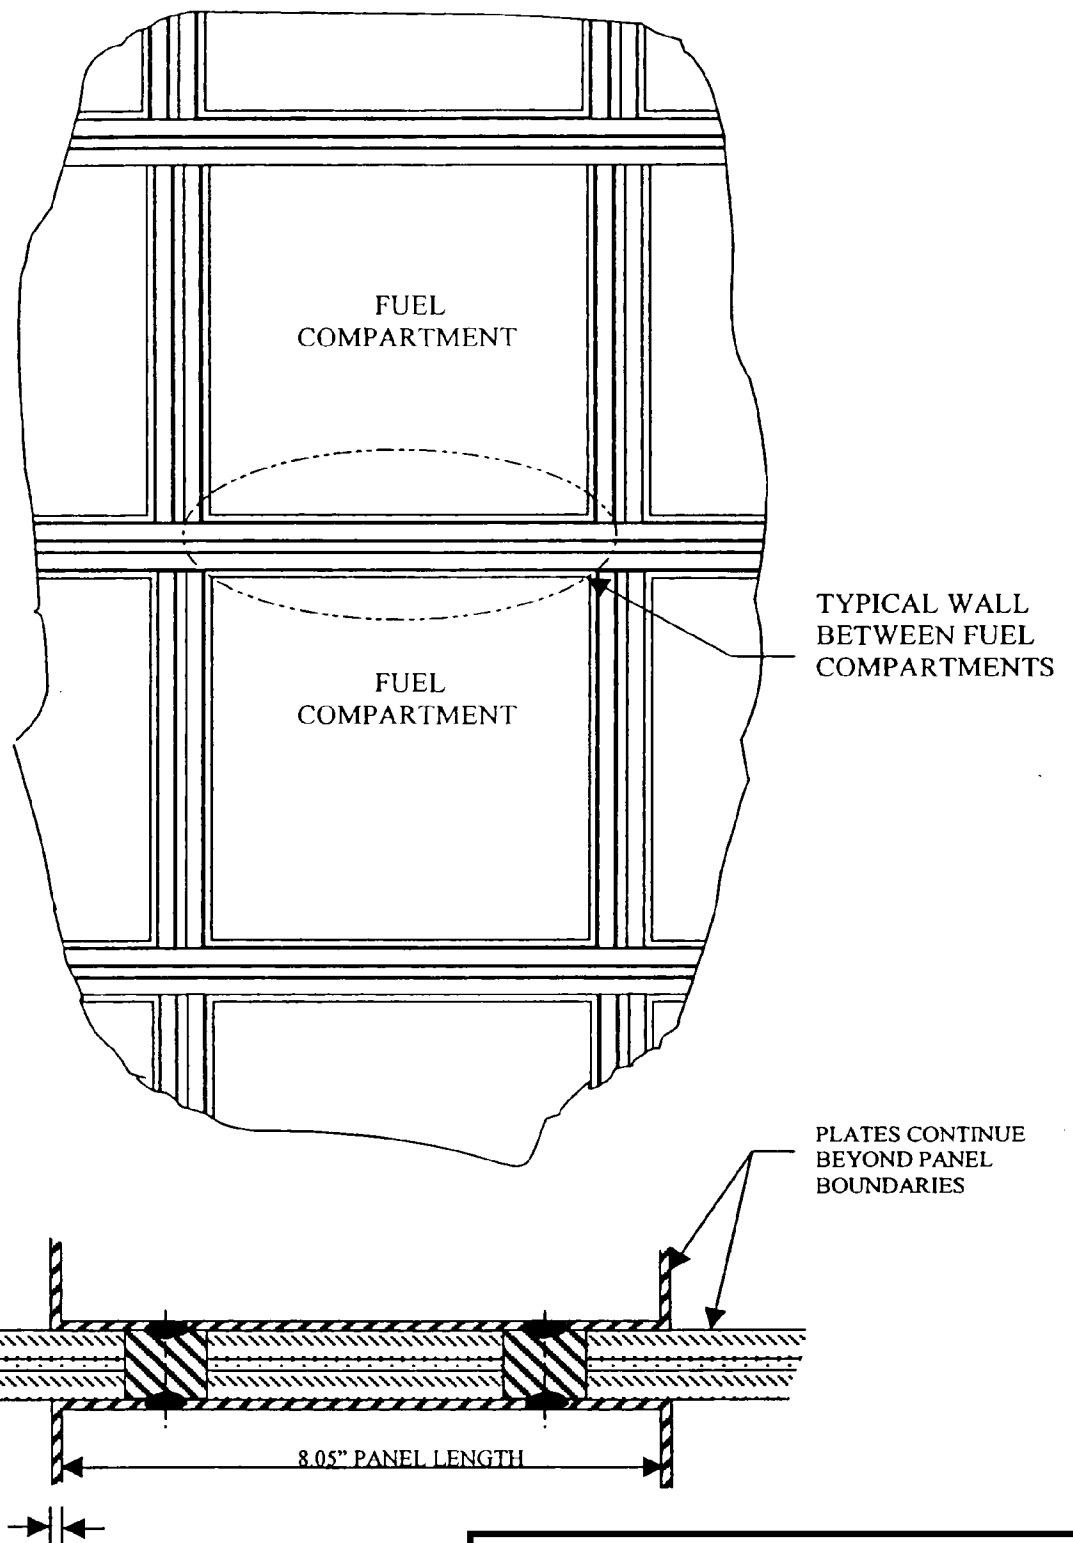


Figure 4B.2-1

**REPRESENTATIVE BASKET
WALL PANEL**

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

REV. 8 10/99

REPRESENTATIVE BASKET WALL PANEL

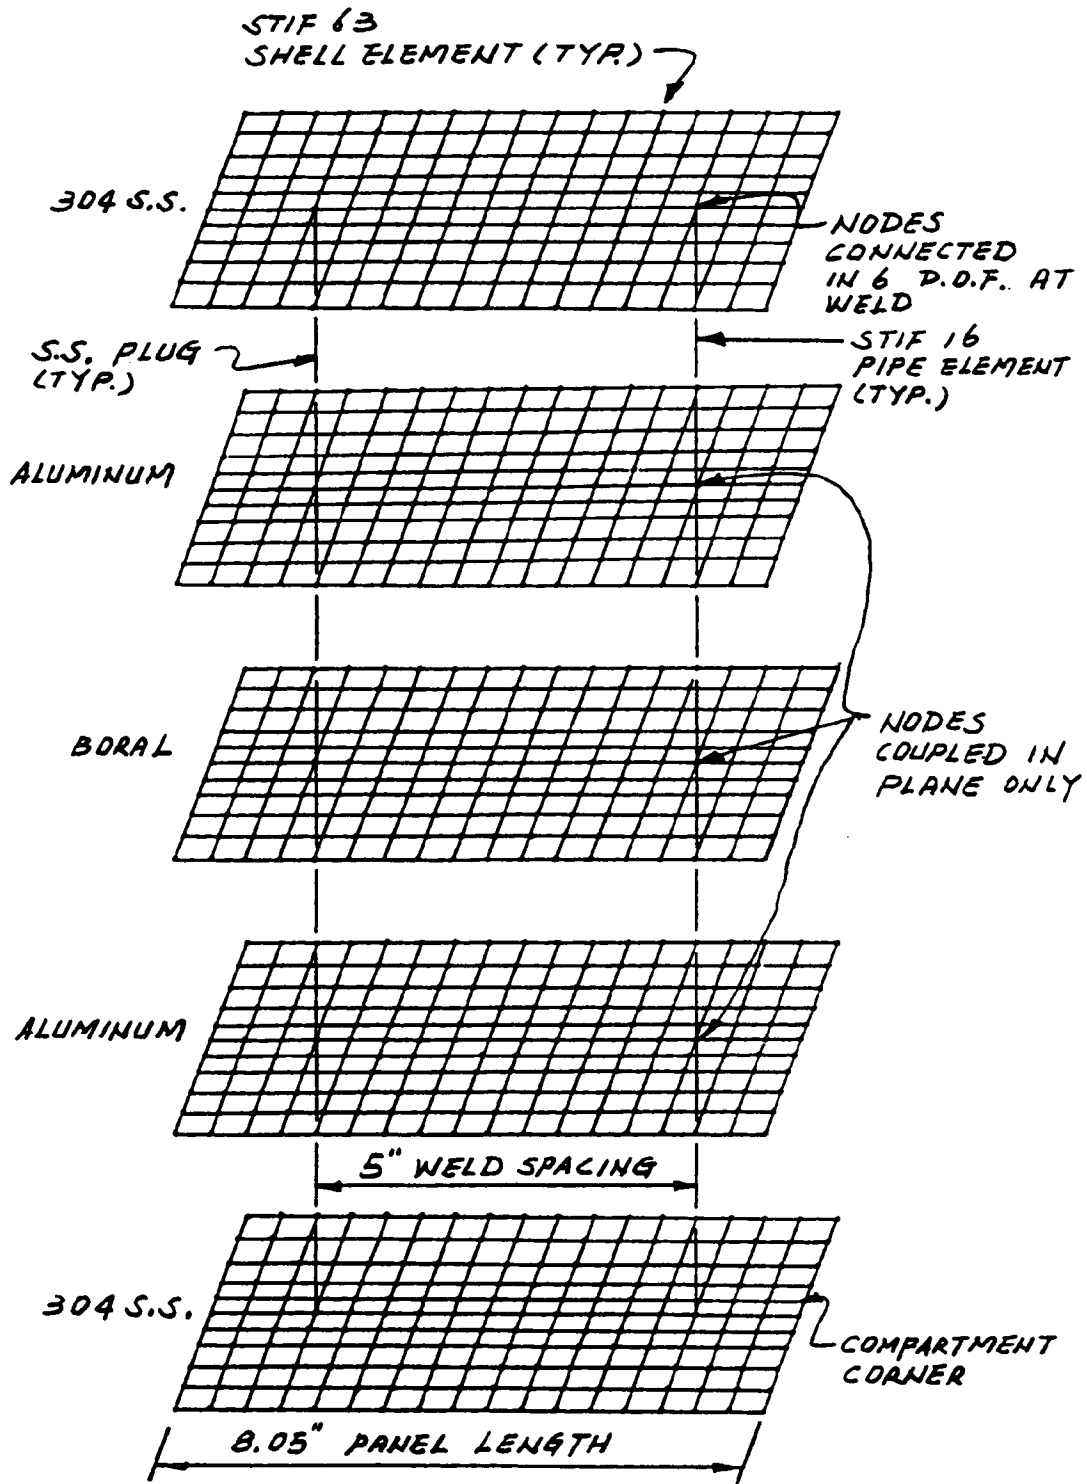


Figure 4B.2-2


**DETAILED WALL PANEL
SUBSTRUCTURE MODEL**

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

Rev. 1 4/91

DETAILED WALL PANEL SUBSTRUCTURE MODEL

1

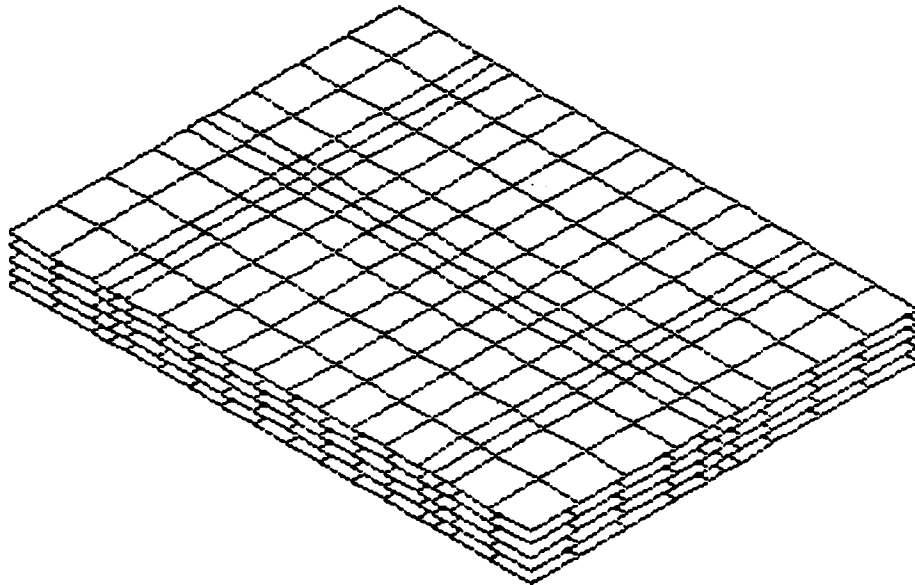

TN40 BASKET ANALYSIS

ANSYS 4.4A
FEB 28 1991
10:29:56
PREP7 ELEMENTS
TYPE NUM

XU =1
YU =1
ZU =1
DIST=5.464
XF =4.025
YF =-0.35
ZF =-3
PRECISE HIDDEN


Rev. 1 4/91

Figure 4B.2-3


**ANSYS COMPUTER PLOT OF DETAILED
WALL PANEL SUBSTRUCTURE MODEL**

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

ANSYS COMPUTER PLOT OF DETAILED WALL PANEL SUBSTRUCTURE MODEL

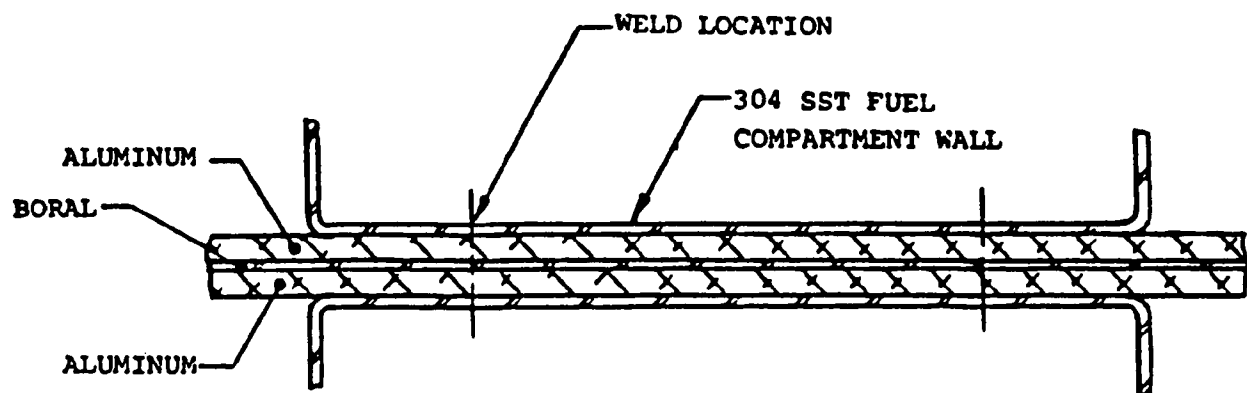

a. ACTUAL WALL CONFIGURATION

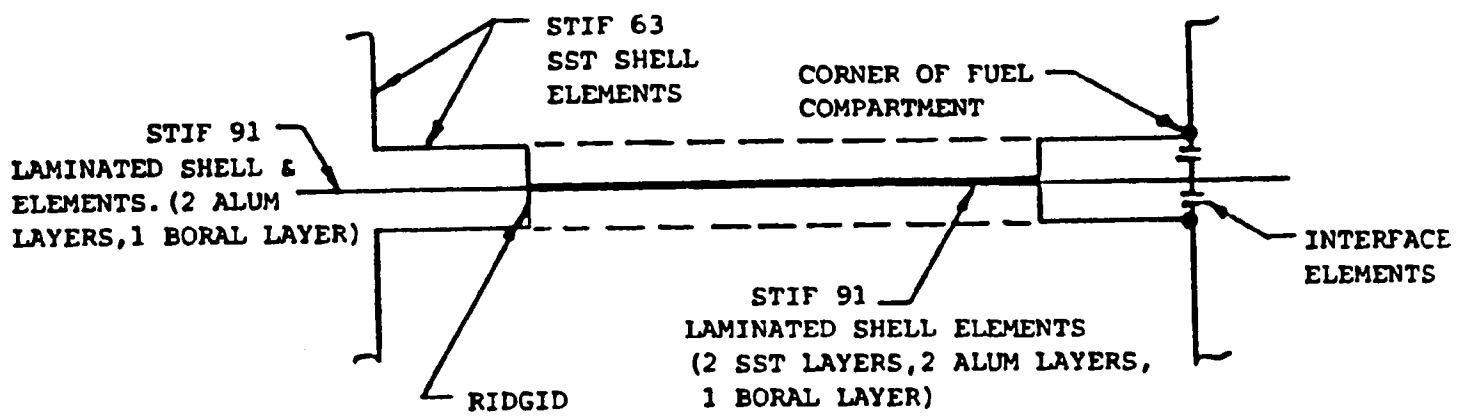


b. PANEL SIMULATION

REVISION: 1

Figure 4B.2-4
DEVELOPMENT OF SIMPLIFIED PANEL
SIMULATION FOR SYSTEM MODEL
 PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

DEVELOPMENT OF SIMPLIFIED PANEL SIMULATION FOR SYSTEM MODEL

1

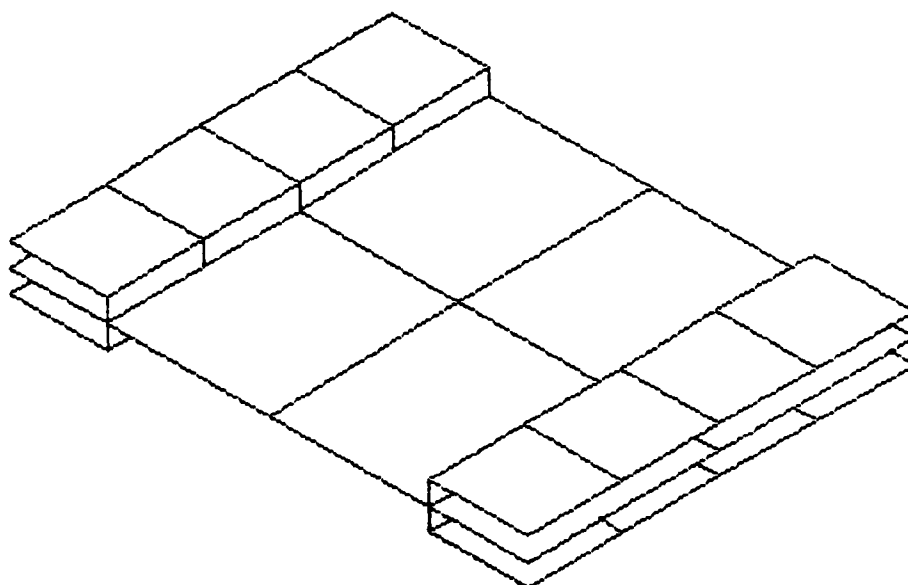

TITLE

ANSYS 4.4A
FEB 28 1991
10:46:31
PREP7 ELEMENTS
TYPE NUM

XU =1
YU =1
ZU =1
DIST=5.464
XF =4.025
YF =0.35
ZF =-3
PRECISE HIDDEN

Rev. 1 4/91

Figure 4B.2-5

**ANSYS COMPUTER PLOT OF SIMPLIFIED
WALL PANEL SUBSTRUCTURE MODEL**

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

ANSYS COMPUTER PLOT OF SIMPLIFIED WALL PANEL SUBSTRUCTURE MODEL

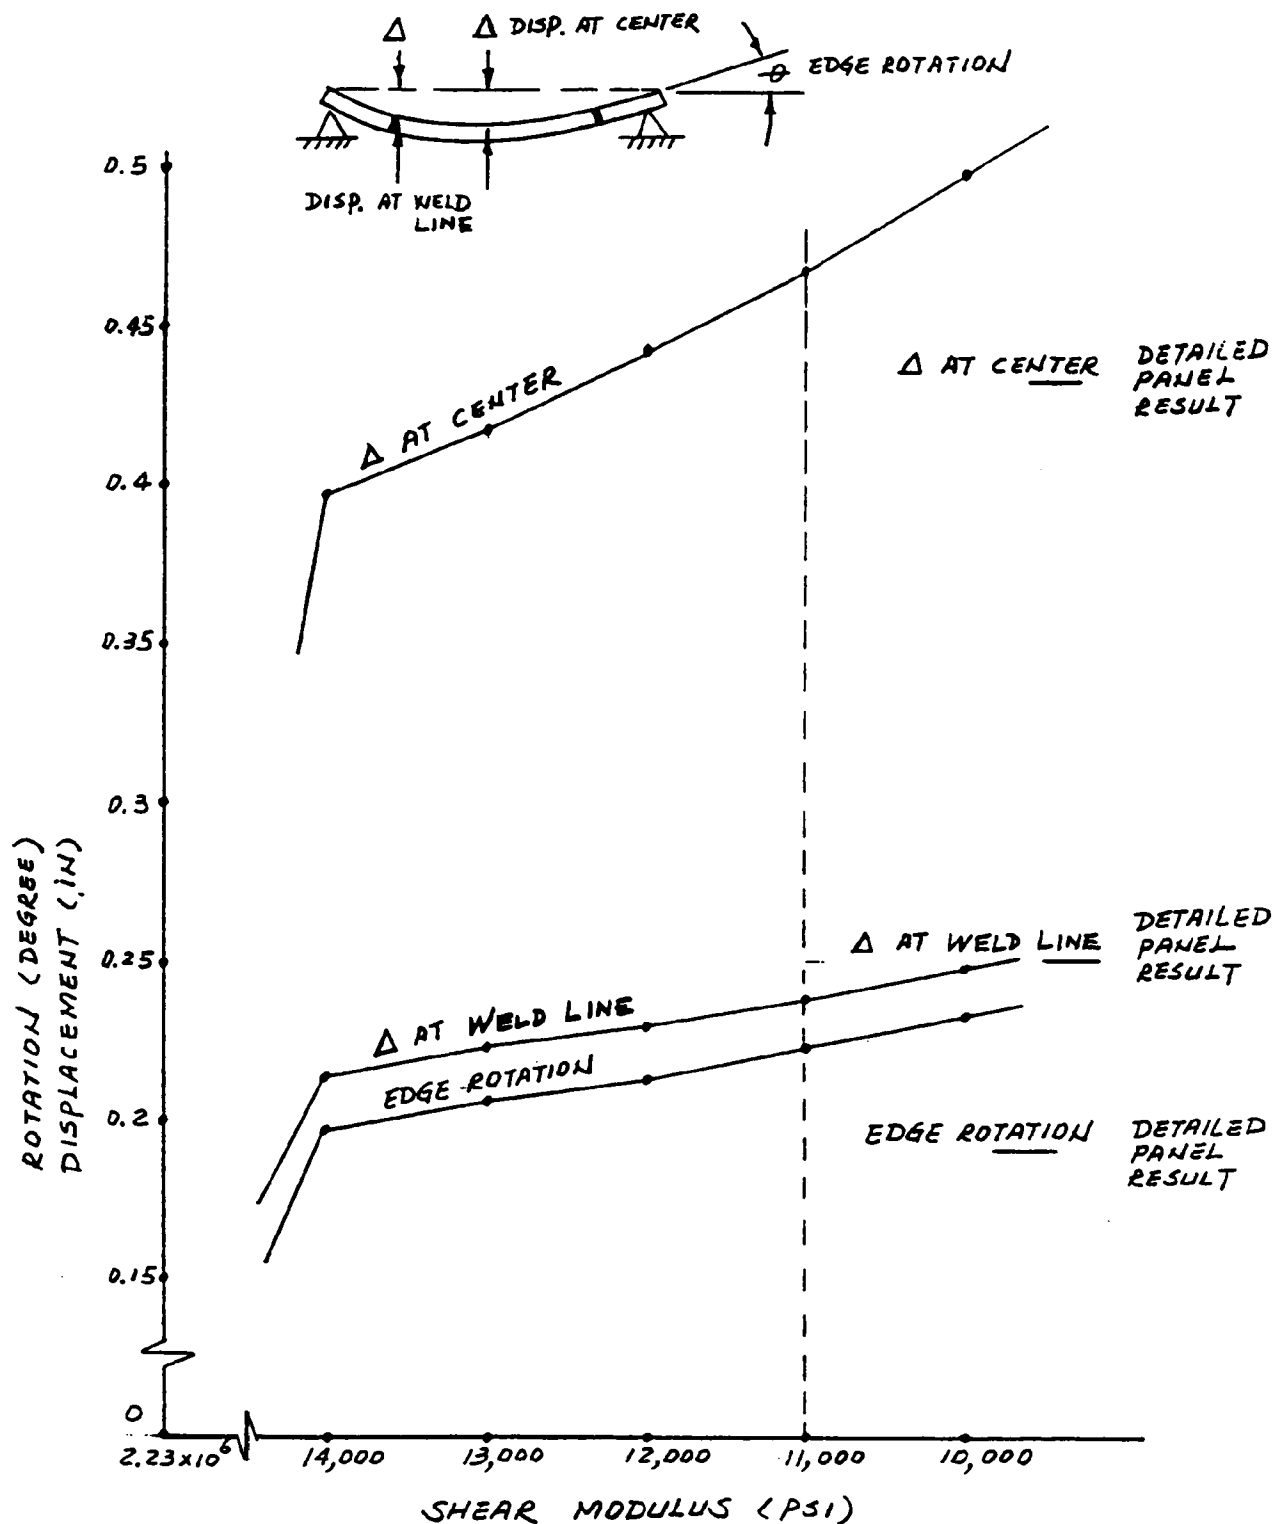


Figure 4B.2-6
SIMPLY SUPPORTED EDGES-DISP.
& ROTATION COMPARISON

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

Rev. 1 4/91

SIMPLY SUPPORTED EDGES - DISP. & ROTATION COMPARISON

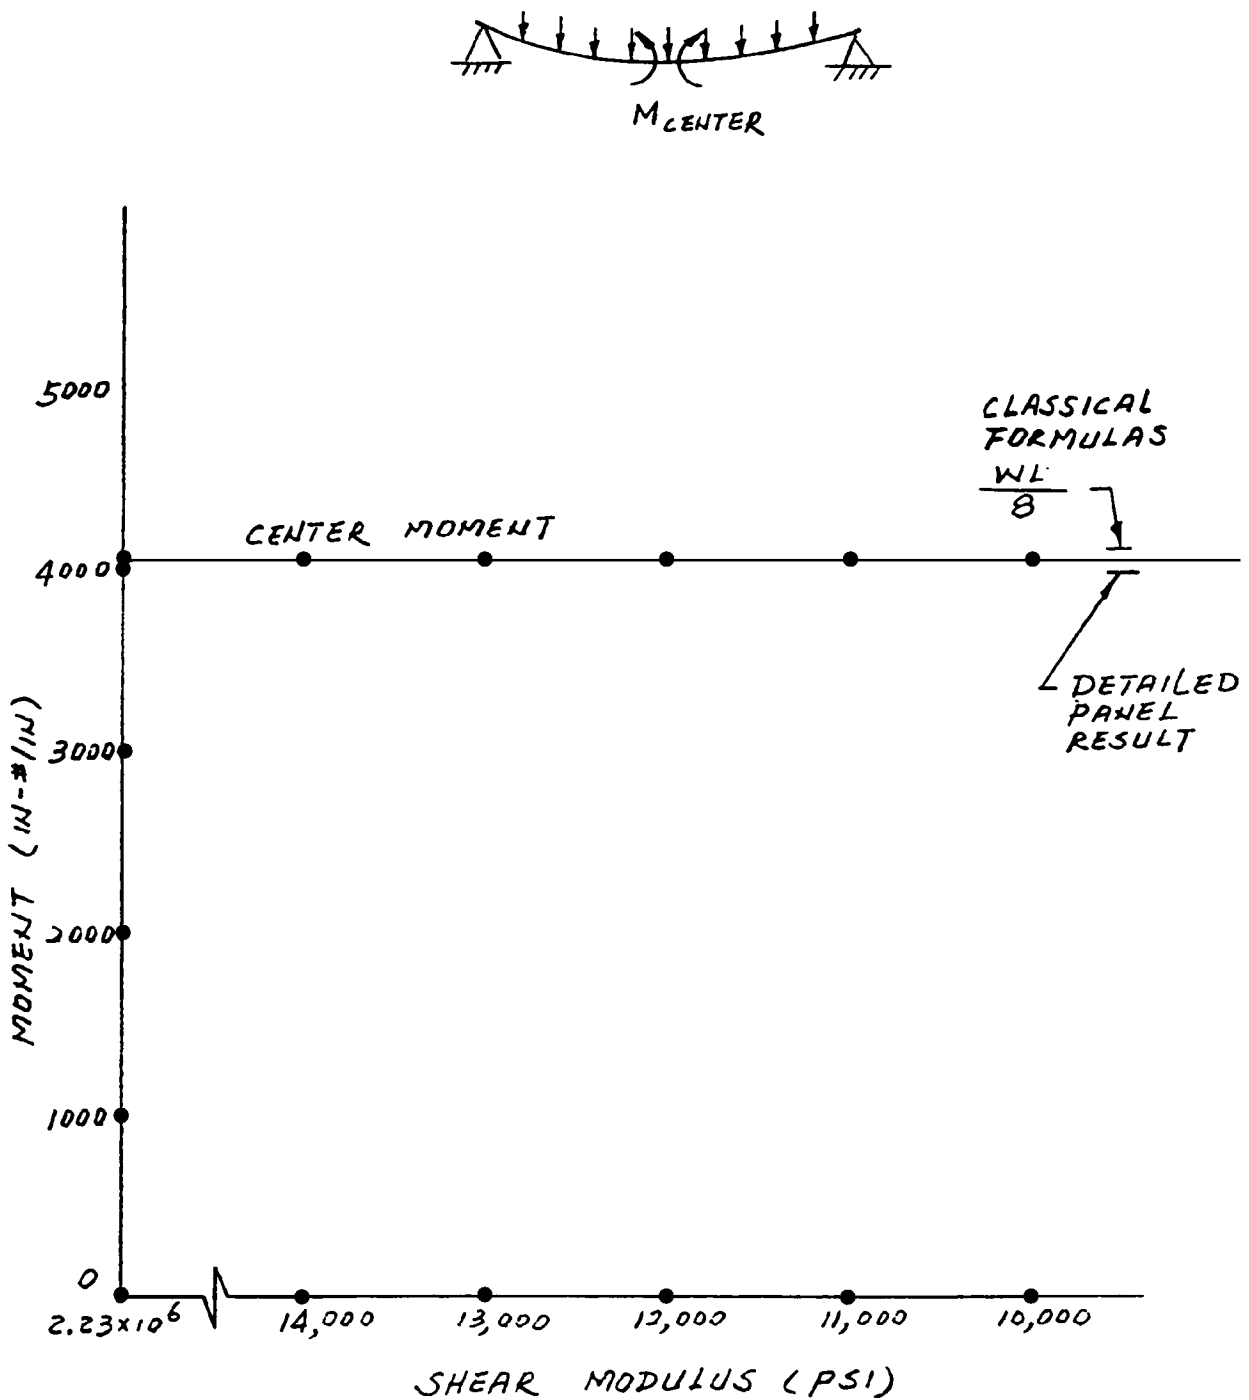


Figure 4B.2-7
SIMPLY SUPPORTED EDGES-CENTER
MOMENT COMPARISON

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

Rev. 1 4/91

SIMPLY SUPPORTED EDGES - CENTER MOMENT COMPARISON

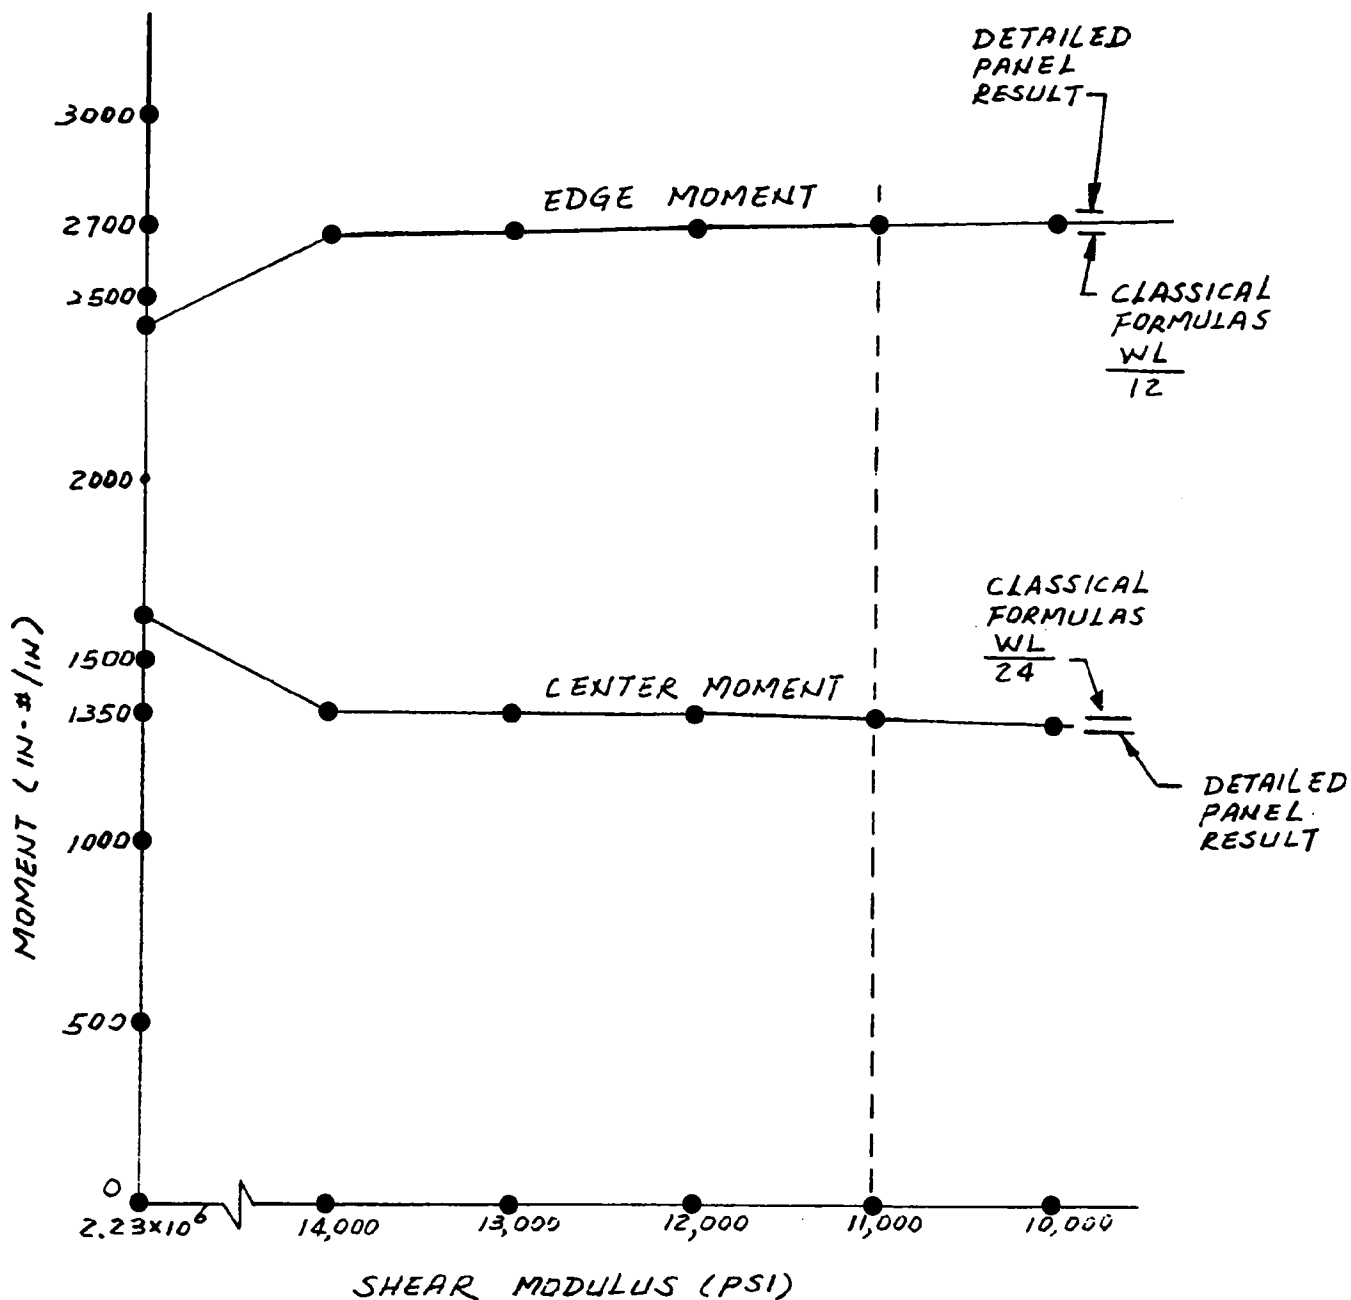


Figure 4B.2-8

FIXED EDGES-MOMENT COMPARISON

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

Rev. 1 4/91

FIXED EDGES - MOMENT COMPARISON

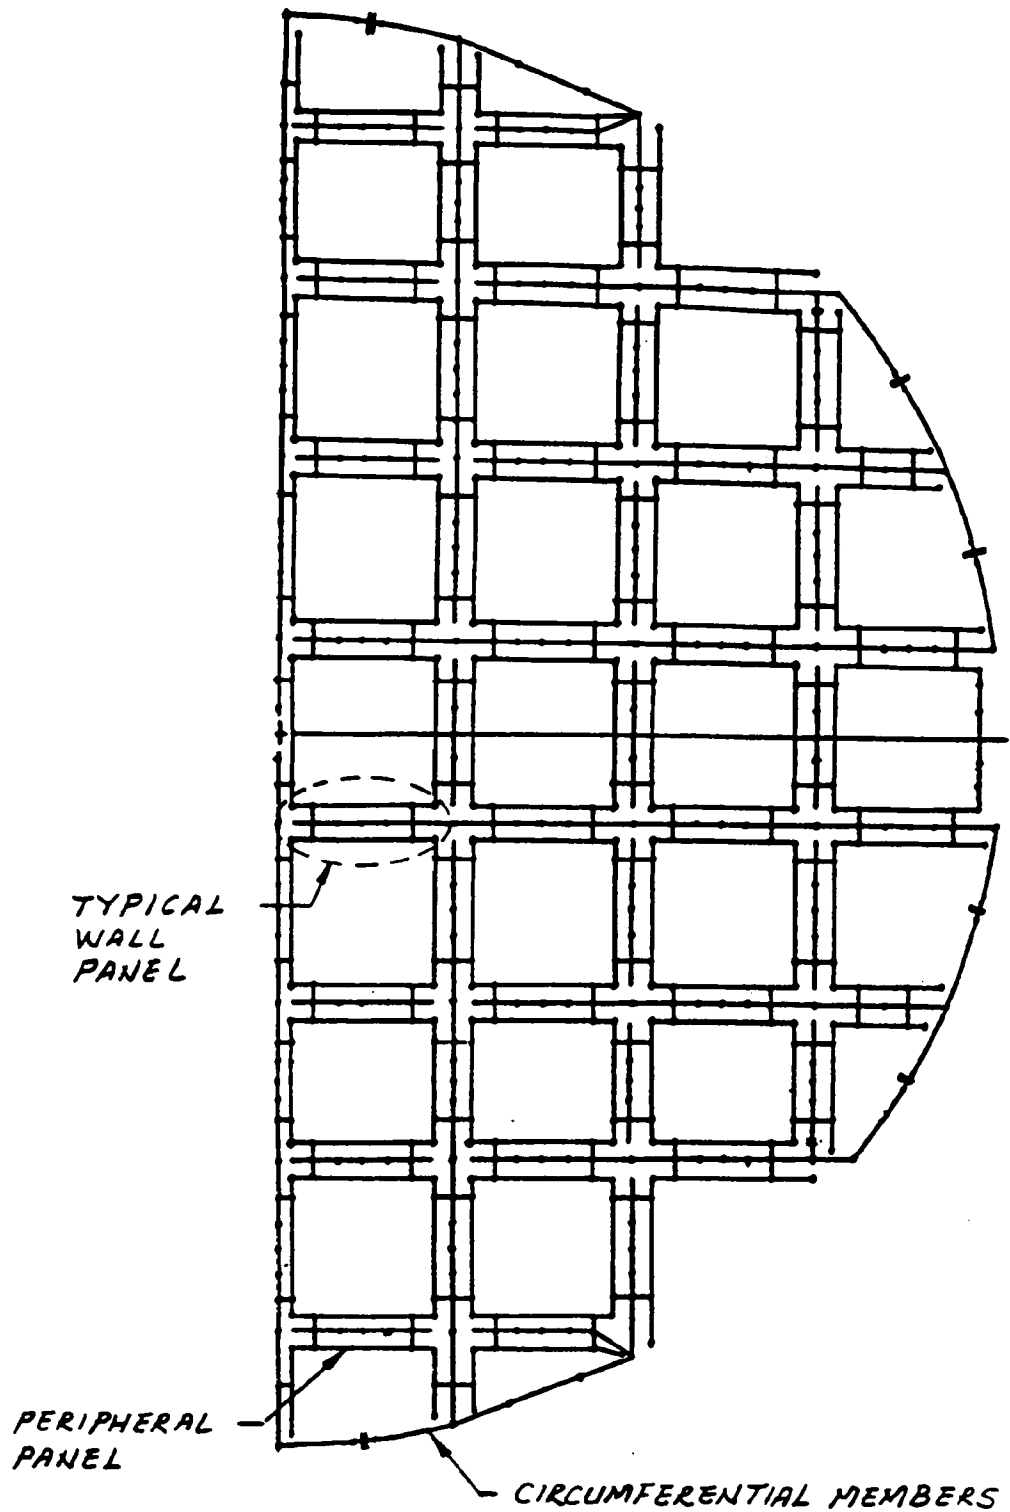


Figure 4B.2-9

TN-40 BASKET SYSTEM MODEL

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

Rev. 1 4/91

TN-40 BASKET SYSTEM MODEL

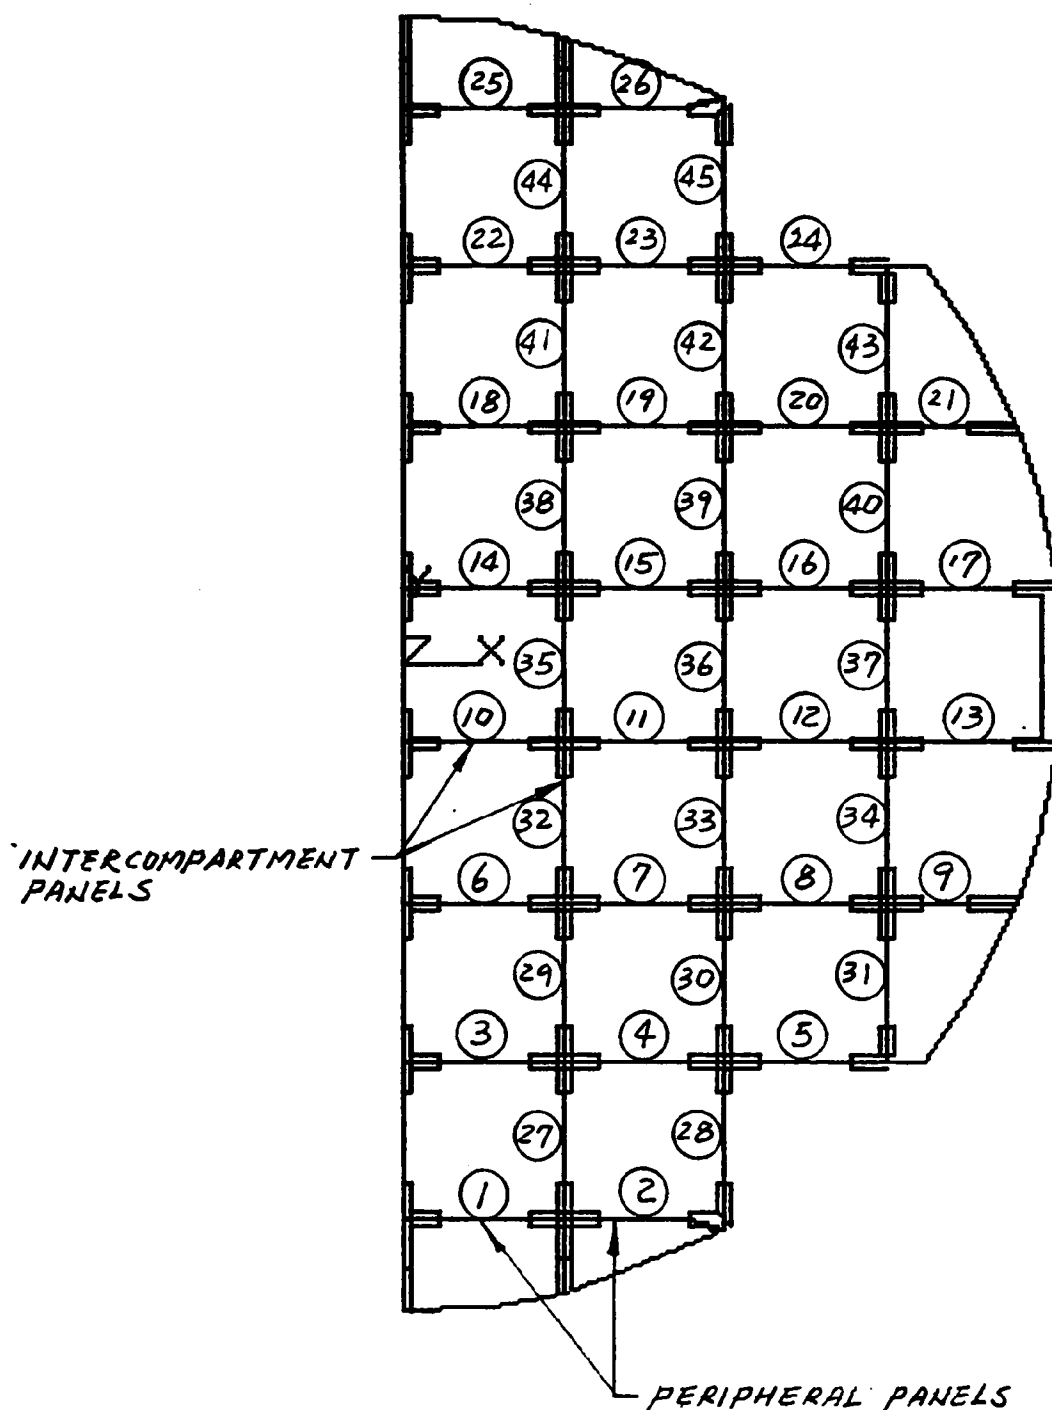



Figure 4B.3-12

**SYSTEM MODEL
PANEL LOCATIONS**

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

Rev. 1 4/91

SYSTEM MODEL PANEL LOCATIONS

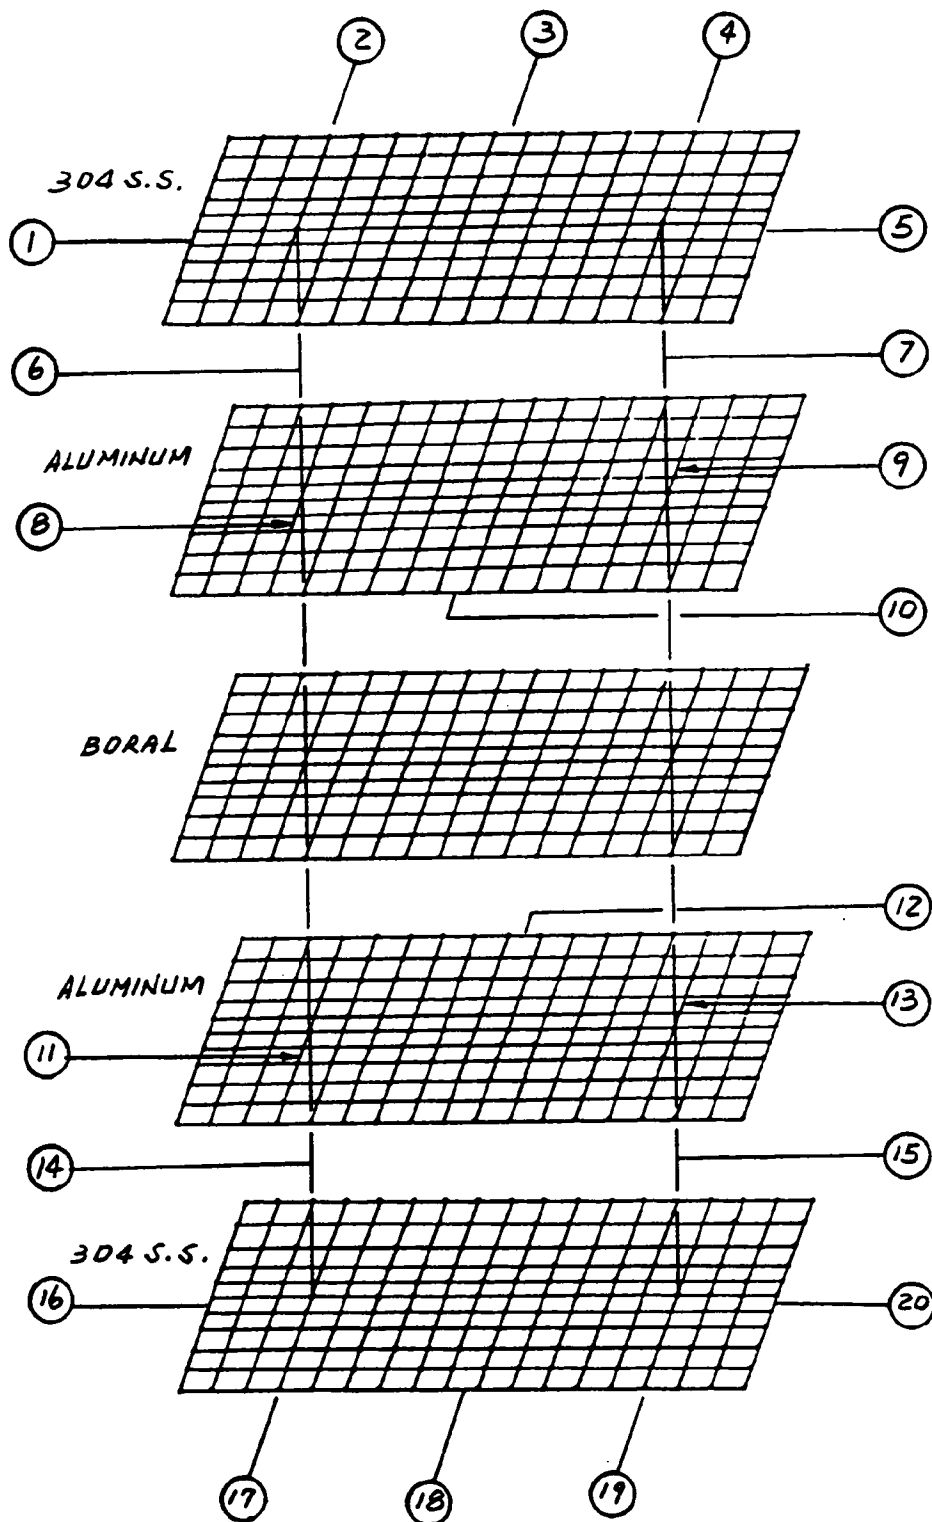


Rev. 1 4/91

Figure 4B.3-13
DETAILED WALL PANEL SUBSTRUCTURE
STRESS REPORTING LOCATIONS FOR
INTERCOMPARTMENT BASKET WALL PANEL

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

DETAILED WALL PANEL SUBSTRUCTURE STRESS REPORTING LOCATIONS FOR INTERCOMPARTMENT BASKET WALL PANEL

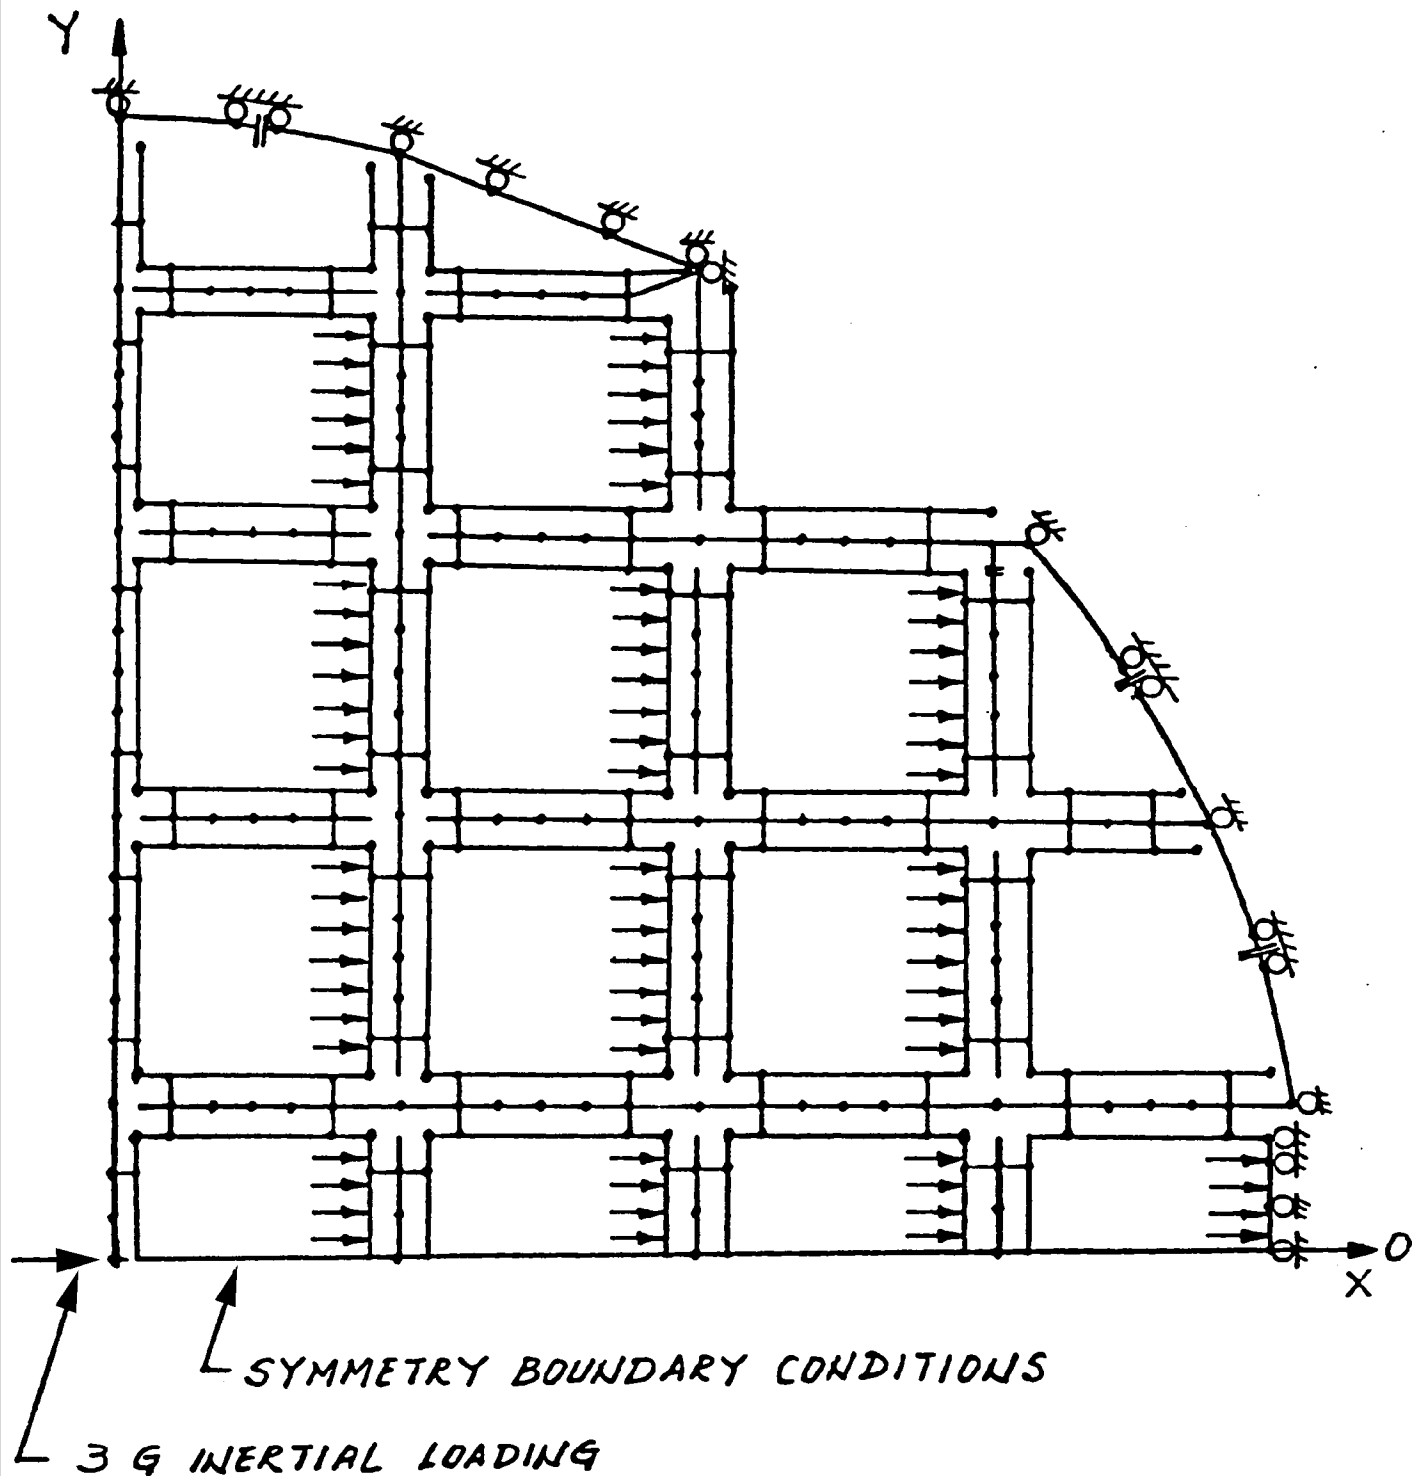

Rev. 1 4/91

Figure 4B.6-1
LOAD DISTRIBUTION AND
BOUNDARY CONDITIONS - 3G LOAD
 PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

LOAD DISTRIBUTION AND BOUNDARY CONDITIONS - 3G LOAD

| PANEL LOCATION (FM. 4A.5-5) | | F_x (#/IN) | F_y (#/IN) | M_z (IN-#/IN) | | | |
|--------------------------------|----|-----------------|-----------------|--------------------|--|--|--|
| HORIZONTAL PANEL | 14 | 70 | | ≈ 0 | | | |
| | 16 | 135 | | ≈ 0 | | | |
| | 17 | 173 | | ≈ 0 | | | |
| | 20 | 20 | | 6 | | | |
| | 24 | 79 | | 15 | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| VERTICAL PANEL | 35 | | 4 | 16 | | | |
| | 36 | | 1 | 15 | | | |
| | 37 | | 86 | 8 | | | |
| | 39 | | 3 | 19 | | | |
| | 40 | | 87 | 15 | | | |
| | 42 | | 3 | 17 | | | |
| | 43 | | 72 | 22 | | | |
| | | | | | | | |
| | | | | | | | |

Figure 4B.6-2

**FORCES AND MOMENTS DUE TO 3G
SIDE LOAD (TN-40 CASK)**

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

Rev. 1 4/91

FORCES AND MOMENTS DUE TO 3G SIDE LOAD (TN-40 CASK)

0 Degree Drop (3G) – Location 17

| Location (Fig 4B.3-13) | STRESS INTENSITIES (PSI) | | | Shear Stress at Weld |
|---------------------------|--------------------------|----------------|-------------------|-------------------------|
| | Average | Top Surface | Bottom Surface | |
| 1 | 1571 | 6056 | 2694 | 27 85 |
| 2 | 1365 | 2096 | 1760 | |
| 3 | 1451 | 1736 | 1634 | |
| 4 | 1360 | 1382 | 1722 | |
| 5 | 1470 | 1318 | 2010 | |
| 6 | | | | |
| 7 | | | | |
| 8 | | | | |
| 9 | | | | |
| 10 | | | | |
| 11 | | | | 20 86 |
| 12 | | | | |
| 13 | | | | |
| 14 | | | | |
| 15 | | | | |
| 16 | 1324 | 2113 | 4578 | |
| 17 | 1296 | 2112 | 1609 | |
| 18 | 1451 | 1792 | 1544 | |
| 19 | 1322 | 1446 | 1565 | |
| 20 | 1477 | 1742 | 1602 | |

Note: stress intensities shown are for 13 gauge (0.088") stainless steel plate.


Figure 4B.6-3

**BASKET PANEL STRESSES UNDER
3G SIDE LOAD (TN-40 CASK)
(PANEL LOCATION 17)**

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

REV. 8 10/99

BASKET PANEL STRESSES UNDER 3G SIDE LOAD (TN-40 CASK) (PANEL LOCATION 17)

| | | | |
|--|---------------|----------------|-----------------|
| NORTHERN STATES POWER COMPANY  PRAIRIE ISLAND NUCLEAR GENERATING PLANT RED WING, MINNESOTA | DRAWN BY: VLS | REVISION: 8 | FIG4B.6-3_REV_8 |
| | PAGE. NO. NA | DATE: 04-21-06 | |

0 Degree Drop (3G) – Location 14

| Location (Fig 4B.3-13) | STRESS INTENSITIES (PSI) | | | Shear Stress at Weld |
|---------------------------|--------------------------|----------------|-------------------|-------------------------|
| | Average | Top Surface | Bottom Surface | |
| 1 | 424 | 2254 | 1316 | 17 70 |
| 2 | 392 | 428 | 1171 | |
| 3 | 426 | 466 | 502 | |
| 4 | 393 | 1373 | 553 | |
| 5 | 448 | 2599 | 3594 | |
| 6 | | | | |
| 7 | | | | |
| 8 | | | | |
| 9 | | | | |
| 10 | | | | |
| 11 | | | | 44 6 |
| 12 | | | | |
| 13 | | | | |
| 14 | | | | |
| 15 | | | | |
| 16 | 449 | 1020 | 2012 | |
| 17 | 421 | 1331 | 495 | |
| 18 | 458 | 501 | 538 | |
| 19 | 424 | 855 | 1680 | |
| 20 | 465 | 2910 | 1880 | |

Note: stress intensities shown are for 13 gauge (0.088") stainless steel plate.


Figure 4B.6-4


**BASKET PANEL STRESSES UNDER
3G SIDE LOAD (TN-40 CASK)
(PANEL LOCATION 14)**

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

REV. 8 10/99

BASKET PANEL STRESSES UNDER 3G SIDE LOAD (TN-40 CASK) (PANEL LOCATION 14)

| | | | |
|---|----------------------|-----------------------|------------------------|
| <small>NORTHERN STATES POWER COMPANY</small>  PRAIRIE ISLAND NUCLEAR GENERATING PLANT <small>RED WING, MINNESOTA</small> | DRAWN BY: VLS | REVISION: 8 | FIG4B.6-4_REV_8 |
| | PAGE. NO. NA | DATE: 04-21-06 | |

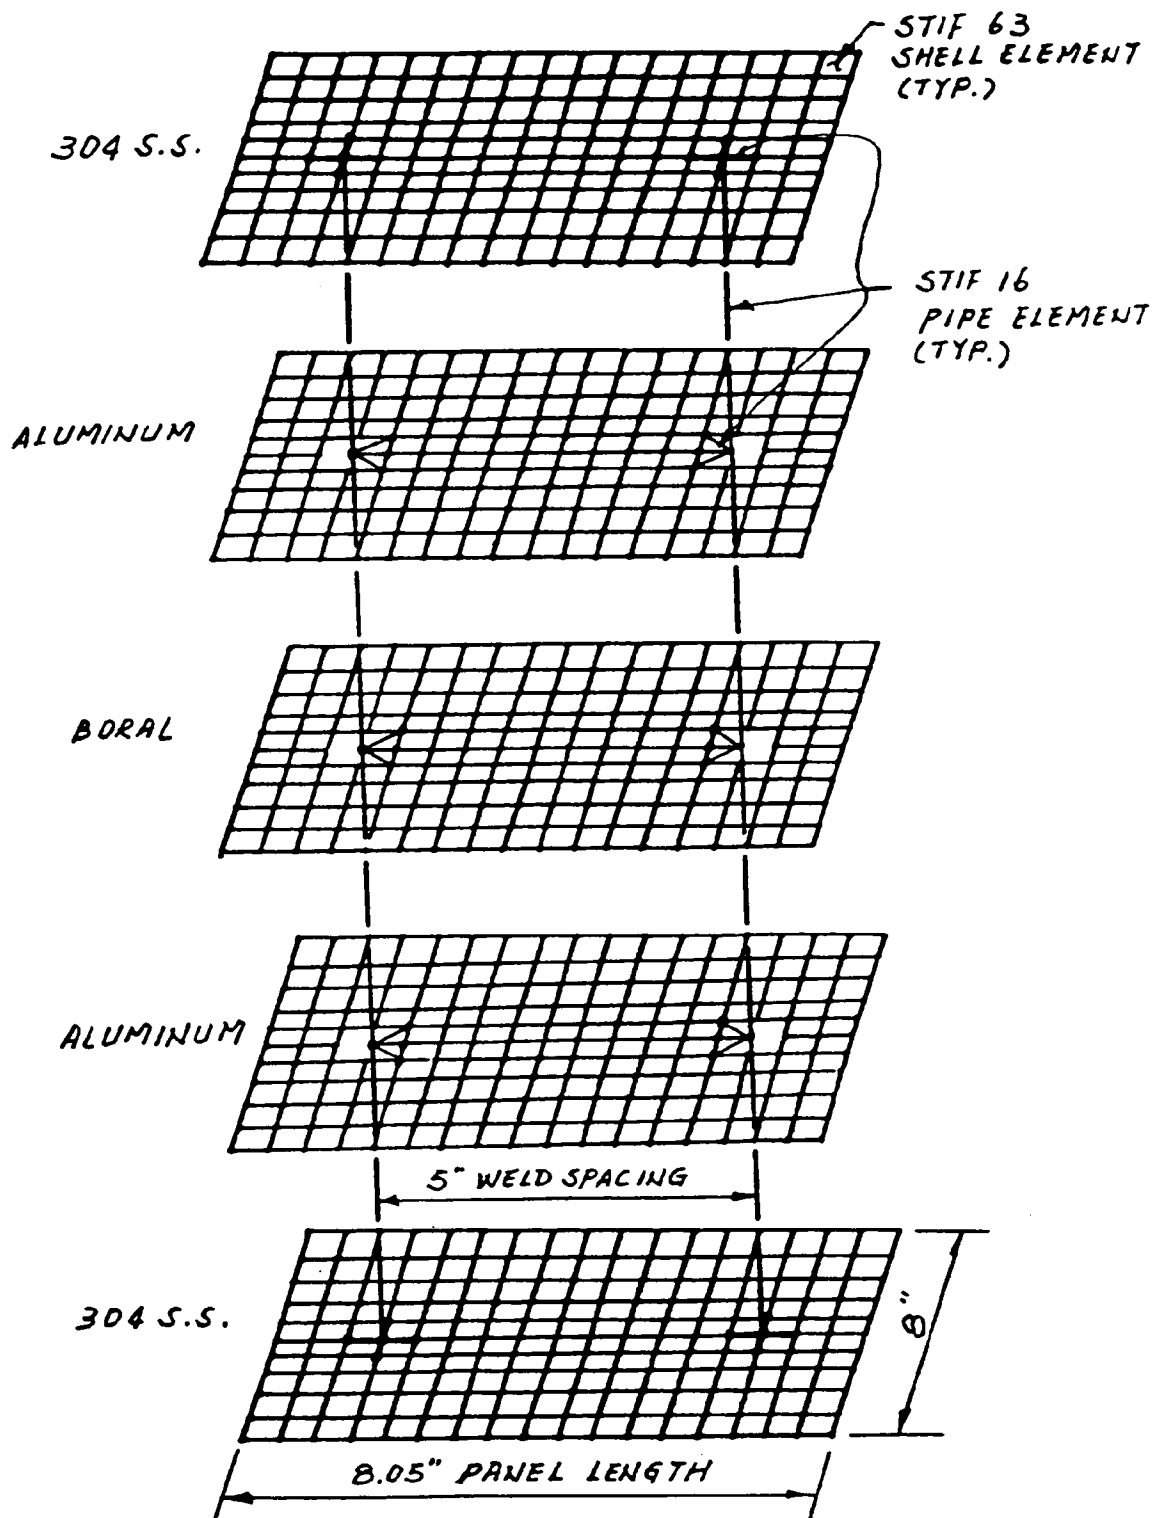

Rev. 1 4/91

Figure 4B.6-5
DETAILED PANEL MODEL
(THERMAL RUN)

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

DETAILED PANEL MODEL (THERMAL RUN)

Thermal Stress Run – Location 14

| Location | STRESS INTENSITIES (PSI) | | | Shear Stress at Weld |
|----------|--------------------------------|----------------|-------------------|-------------------------|
| | THERMAL (SECONDARY) STRESS - Q | | | |
| | Average | Top Surface | Bottom Surface | |
| 1 | 14267 | 32609 | 8149 | 25434 25378 |
| 2 | 17579 | 26495 | 35272 | |
| 3 | 19469 | 21930 | 22145 | |
| 4 | 17573 | 29375 | 48483 | |
| 5 | 9193 | 30864 | 7277 | |
| 6 | | | | |
| 7 | | | | |
| 8 | 2815 | 3185 | 3185 | 25364 25421 |
| 9 | 2815 | 3185 | 3185 | |
| 10 | 1844 | 2086 | 2086 | |
| 11 | 2817 | 3188 | 3188 | |
| 12 | 1844 | 2086 | 2086 | |
| 13 | 2817 | 3188 | 3188 | |
| 14 | | | | |
| 15 | | | | |
| 16 | 14242 | 7891 | 31786 | |
| 17 | 19027 | 29830 | 19640 | |
| 18 | 19432 | 22118 | 21868 | |
| 19 | 20211 | 30932 | 28741 | |
| 20 | 14231 | 7327 | 31308 | |

Note: stress intensities shown are 13 gauge (0.088”) stainless steel plate.

REV. 8 10/99

Figure 4B.6-6

**BASKET PANEL STRESSES DUE TO
DIFFERENTIAL THERMAL EXPANSION
(TN-40 CASK) (PANEL LOCATION 14)**

**PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT**

BASKET PANEL STRESSES DUE TO DIFFERENTIAL THERMAL EXPANSION (TN-40 CASK) (PANEL LOCATION 14)

| Location | STRESS INTENSITIES (PSI) | | | Shear Stress at Weld |
|----------|---|----------------|-------------------|-------------------------|
| | PRIMARY + SECONDARY STRESS (Pm + Pb + Q) | | | |
| | Average | Top Surface | Bottom Surface | |
| 1 | 13331 | 34863 | 9465 | 25451 25448 |
| 2 | 17971 | 26923 | 36443 | |
| 3 | 19895 | 22396 | 22647 | |
| 4 | 17966 | 30748 | 49036 | |
| 5 | 9641 | 33463 | 10871 | |
| 6 | | | | |
| 7 | | | | |
| 8 | 2815 | 3185 | 3185 | 25408 25427 |
| 9 | 2815 | 3185 | 3185 | |
| 10 | 1844 | 2086 | 2086 | |
| 11 | 2817 | 3188 | 3188 | |
| 12 | 1844 | 2086 | 2086 | |
| 13 | 2817 | 3188 | 3188 | |
| 14 | | | | |
| 15 | | | | |
| 16 | 14691 | 8911 | 33798 | |
| 17 | 19448 | 31161 | 20135 | |
| 18 | 19890 | 22619 | 22406 | |
| 19 | 20635 | 31787 | 30421 | |
| 20 | 14696 | 10237 | 33188 | |

Note: stress intensities shown are for 13 gauge (0.088") stainless steel plate.

REV. 8 10/99


Figure 4B.6-7

**BASKET PANEL STRESSES -
THERMAL + 3G SIDE LOAD
(TN-40 CASK) (PANEL LOCATION 14)**

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

BASKET PANEL STRESSES - THERMAL + 3G SIDE LOAD (TN-40 CASK) (PANEL LOCATION 14)

BASKET STRESSES DUE TO 3G VERTICAL LOAD (TN-40 CASK) (PANEL LOCATION 14)

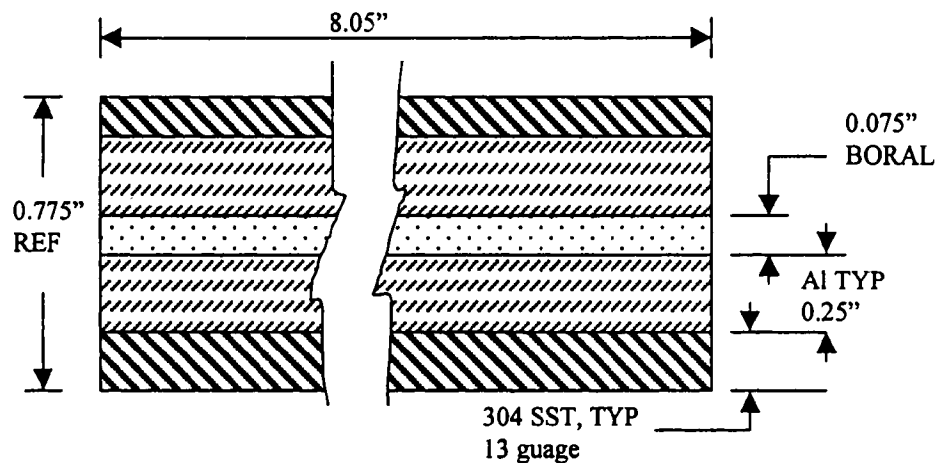

SECTION A-A

WEIGHT OF 304SST:
 $2 \times 8.05 \times 0.088 \times 160.00 \times 0.2975 = 67.44 \text{ LBS}$

WEIGHT OF ALUMINUM:
 $2 \times 8.05 \times 0.25 \times 160.0 \times 0.105 = 67.62 \text{ LBS}$


WEIGHT OF BORAL:
 $1 \times 8.05 \times 0.075 \times 160.0 \times 0.0903 = 8.72 \text{ LBS}$

TOTAL WEIGHT (1G) = $67.44 + 67.62 + 8.72 = 143.78 \text{ LBS}$

AREA OF 304 SST = $2 \times 8.05 \times 0.088 = 1.42 \text{ IN}^2$

COMPRESSIVE STRESS AT BOTTOM OF THE PANEL (3G):

$$\sigma = 3 \times 143.78 / 1.42 = 304 \text{ PSI}$$

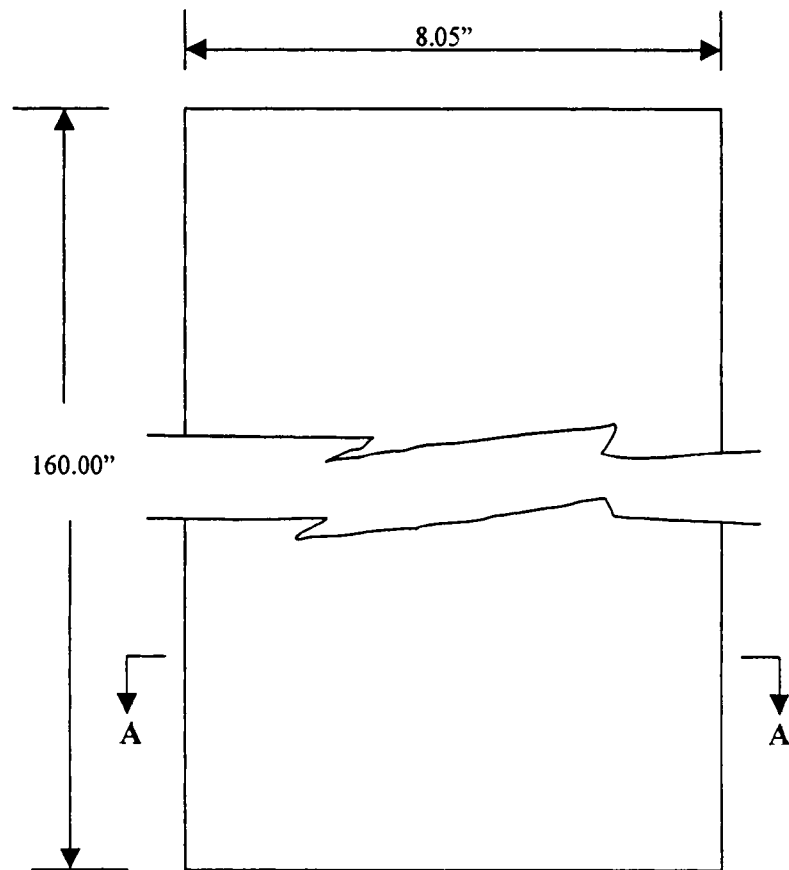

BASKET PANEL

Figure 4B.7-1

BASKET STRESSES DUE TO
 3G VERTICAL LOAD
 (TN-40 CASK) (PANEL LOCATION 14)

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

REV. 8 10/99

APPENDIX 4C

TESTS PERFORMED TO SUPPORT DESIGN OF THE TN-40 BASKET

4C.1 COMPRESSION TESTS OF THE TN-40 BASKET PANELS

The structural design criteria for the basket under impact accident loading are presented in Section 4B.5 of Appendix 4B, the basket analysis appendix. That section presents both stress and basket wall panel stability criteria. Determination of the panel compressive load limit (analytically) required the analyst to make several key assumptions. The tests described in this section were performed to verify the validity of these assumptions and to demonstrate the safety margin associated with the Section 4B.5 compressive load limit.

Figure 4C.1-1 shows a representative TN-40 basket wall section between fuel compartments. The compression tests were conducted on test specimens or panels designed to simulate this wall section. These test panels were fabricated from the TN-40 basket materials, 6061-T6 aluminum and 304 stainless steel. The panels were made without the 0.075 in. center boral plate. This is conservative since the boral plate slightly increases the compressive load capability of the basket wall section. The various plates in the panels were attached to each other using prototypic stainless steel plugs and fusion welds as shown in the figure (two welds 5 in. apart at various spacings along the basket axial direction).

The compression tests were performed to determine the panel strength when loaded in the 8.05 in. direction (to simulate loading of a bottom outer radial panel of a basket during side impact). Each test panel was 8.05 in. long and 24 in. wide (the basket axial direction). Panels were tested with a weld spacing of 6 in., 8 in. and 12 in. in the 24 in. direction. Panels were also tested at room temperature and at elevated temperature.

The test setup for the panel compression test is shown schematically in Figure 4C.1-2. The loaded edges of the panel were hinged so that no panel edge rotational restraint would be provided. This results in conservatively low panel failure loads since, in the actual basket arrangement, there is some edge rotational restraint at the corner of the stainless steel box sections and at the aluminum plate continuation into adjacent panels. The edges were loaded through a lubricated brass insert free to rotate in the test fixture as shown schematically in Figure 4C.1-2.

Tests were run initially with 3 panels at room temperature. Then three additional elevated temperature tests were run. Thermocouples and strip heaters were mounted on both sides of the panels for the hot test. Soft insulation was wrapped around the panel (and heaters, etc.). The heaters were turned on and the temperature was allowed to stabilize while the panel and fixture were mounted in the test machine. See the top sketch in Figure 4C.1-3.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

Page 4C-2

The tests were performed at a rapid loading rate; the test machine was operated at a head travel speed of 0.2 in./minute. The observed deformation modes are illustrated in the lower three sketches of Figure 4C.1-3.

Initially, the load increased (well beyond 100,000 lbs) with the panel apparently undeformed as in the first sketch. The 0.10 inch steel plates began to separate from each side of the aluminum plates (buckling elastically between welds but not failing) as shown in the second sketch. In the first room temperature test, a load of 290,000 lbs was applied and then released prior to reaching the panel failure load. The steel plates, which had separated, "snapped back" nearly flush with the aluminum plates. Therefore this initial steel separation is almost completely elastic. Also, this demonstrated that there is negligible permanent deformation of the panel at a load approaching 85% of the failure load.

This separation gradually increased as the load increased until both aluminum plates buckled in the center as shown in the third sketch. The load peaked at this time and gradually decreased after the aluminum buckled. There was no sudden load dropoff. Figure 4C.1-4 illustrates a typical load vs. deflection curve. It shows the elevated temperature curve for 8 in. weld spacing.

The panel compression test results are summarized in Figure 4C.1-5. The panel buckling load (maximum load from load vs deflection curve) in the room temperature tests ranged from 13,333 lb/in to 14,166 lb/in. The buckling load at metal temperatures from 365°F to 529°F ranged from 10,542 lb/in to 11,135 lb/in. These loads are very consistent (within 6%) for a given metal temperature. In addition, the deformation mode was uniform from test to test. The buckling load was quite insensitive to weld spacing along the axial direction of the basket. Also, the stainless plates and aluminum plates behaved as though they were fixed along the weld line, as assumed in the criteria section 4B.5. See the lower sketches in Figure 4C.1-3.

The test panels were made from 304 stainless and 6061-T6 aluminum plates procured in accordance with ASME/ASTM material standards. They were slightly thicker than specified for the TN-40 basket. Therefore, it was necessary to determine an allowable compressive load for the thicknesses using the technique described in Section 4B.5. If we repeat the calculations performed in Figures 4B.5-5 and 4B.5-6 for a stainless plate 0.110 in. thick and an aluminum plate 0.256 in. thick (actual thicknesses of plates in test panels), we obtain the results listed in Figure 4C.1-6. The allowable compressive load for this geometry using the TN-40 criteria is 4951 lb/in (vs 4512 lb/in for TN-40). If we compare the minimum measured elevated temperature panel buckling load from Figure 4C.1-5 (10,542 lb/in) with the allowable (4951 lb/in) we can see that the panel buckling load was at least 2.13 times the allowable. This demonstrates that the TN-40 basket panel compressive load criteria has an inherent safety factor greater than 2.

4C.2 AXIAL CRUSH TEST OF STAINLESS STEEL BOX SECTION

Section 4B.7 provides the analysis of the basket under vertical loading due to a hypothetical end drop accident. Under vertical loading the basket inertial loading is reacted by a uniform contact force developed between the basket and the bottom of the cask cavity. The compressive stress developed at the ends of the 304 stainless steel plates is 4750 psi, neglecting any strength contribution from the aluminum plates.

The load vs deflection curve from an axial crush test (performed previously for a different program) on a length of bare, unstiffened 304 stainless steel box section is shown in Figure 4C.2-1. That box section withstood an axial force of 102,000 lbs. before it began to crush. The load peaked at this value and then slowly decreased. Sudden failure did not occur.

The 102,000 lbs corresponds to an axial stress of 23,000 psi in the test specimen (a 9×9×0.122 in box section). This test demonstrated that a bare 304 stainless steel box section can withstand almost five times the stress applied in the end drop accident. This was a severe test since the aluminum plate would react a portion of the load and adjacent box sections would tend to provide additional support.

THIS PAGE IS LEFT INTENTIONALLY BLANK

Security-Related Information Figure Withheld Under 10 CFR 2.390.

Rev. 1 4/91

**Figure 4C.1-1
REPRESENTATIVE BASKET
WALL PANEL**

**PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT**

REPRESENTATIVE BASKET WALL PANEL

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY: VLS

REVISION: 1

PAGE. NO. NA

DATE: 04-24-06


FIG4C.1-1_REV_1

Security-Related Information Figure Withheld Under 10 CFR 2.390.

Rev. 1 4/91

Figure 4C.1-2
TN-40 BASKET PANEL
COMPRESSION TEST SETUP
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT


TN-40 BASKET PANEL COMPRESSION TEST SETUP

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY: VLS
PAGE. NO. NA

REVISION: 1
DATE: 04-24-06

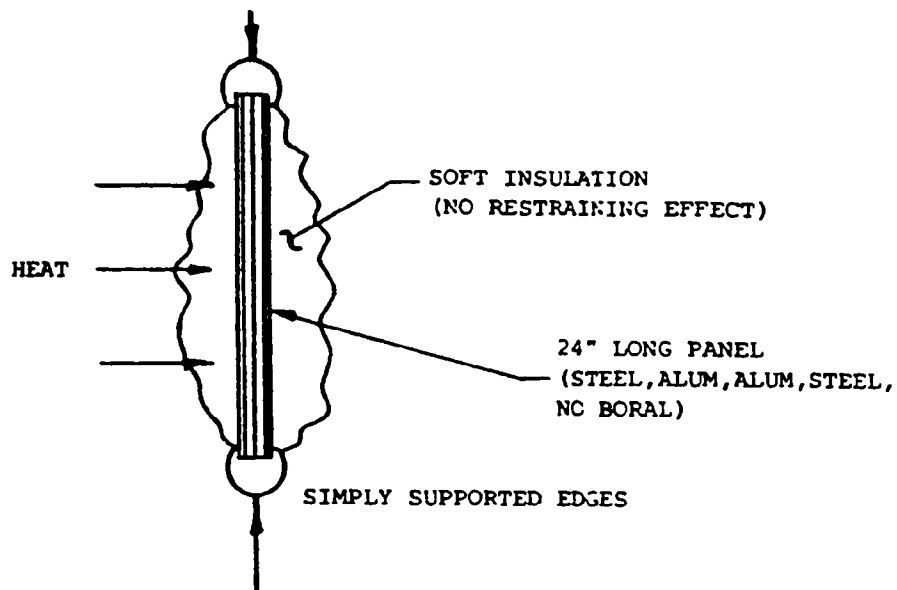FIG4C.1-2_REV_1



TEST SETUP

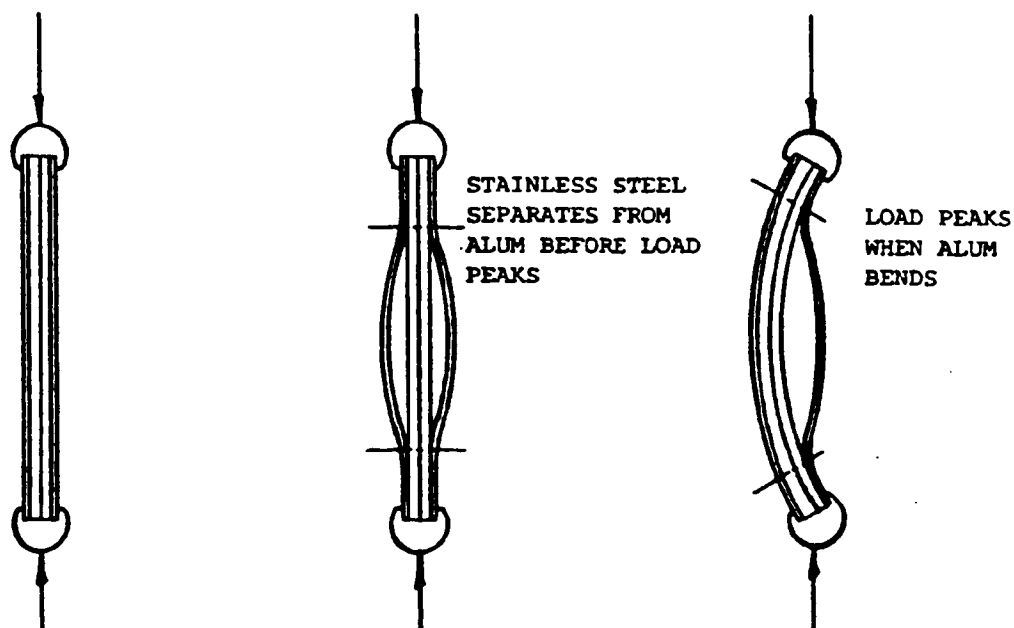




Figure 4C.1-3

OBSERVED DEFORMATION MODES

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

Rev. 1 4/91

OBSERVED DEFORMATION MODES

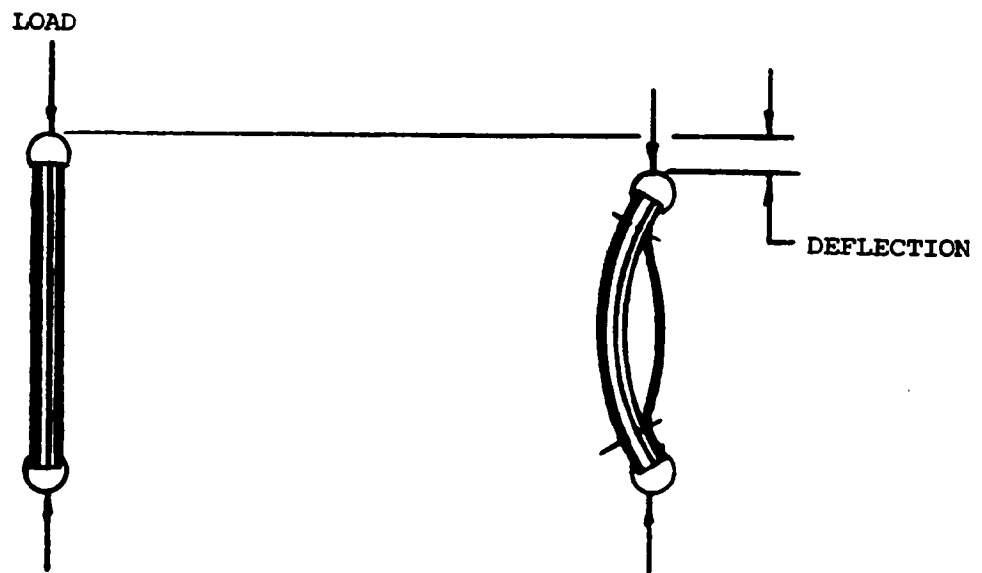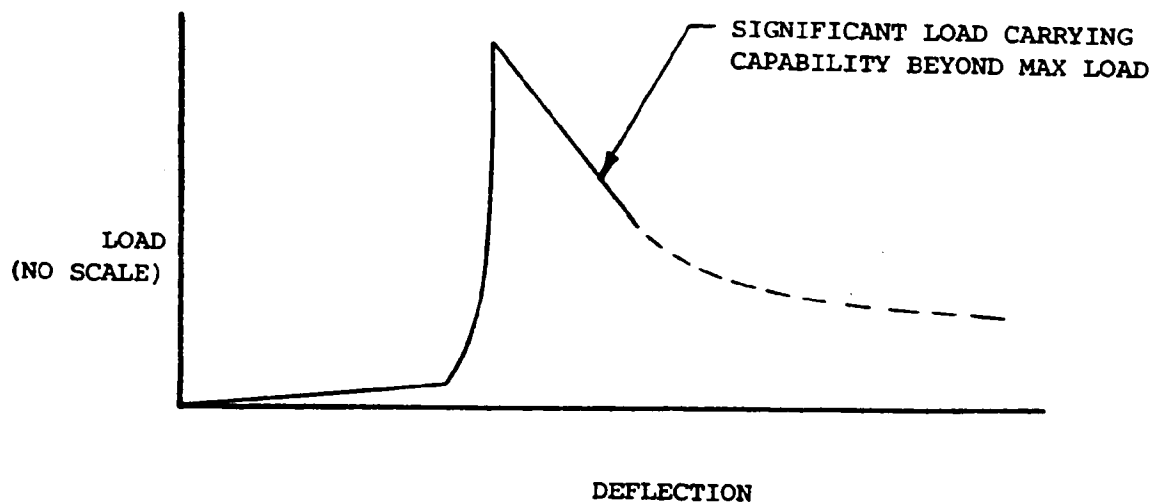

Rev. 1 4/91

Figure 4C.1-4
PANEL LOAD VS
DEFLECTION CURVE
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

PANEL LOAD VS DEFLECTION CURVE

| <u>Panel No.</u> | <u>*Weld Spacing (in.)</u> | <u>Temperature, °F (at Max. Load)</u> | <u>Maximum Load (lb, Total)</u> | <u>Maximum Unit Load (lb/in.)</u> |
|------------------|--------------------------------|---|-------------------------------------|---|
| A1 | 5x12 | RT | 340,000 | 14,166 |
| B1 | 5x8 | RT | 332,000 | 13,833 |
| C1 | 5x6 | RT | 320,000 | 13,333 |
| A2 | 5x12 | 529° | 253,000 | 10,542 |
| B2 | 5x8 | 405° | 267,250 | 11,135 |
| C2 | 5x6 | 365° | 261,500 | 10,896 |

*Note: The weld spacing in the 8.05 in. load direction is always 5 in. The 12, 8 and 6 in. spacings are along the basket axial direction.

Rev. 1 4/91

Figure 4C.1-5
TN-40 BASKET PANEL
COMPRESSION TEST RESULTS
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

TN-40 BASKET PANEL COMPRESSION TEST RESULTS

BASED ON OVERALL PANEL GEOMETRY
(CROSS SECTION ASSUMED STABLE)

BASED ON LOCAL PLATE GEOMETRY
BETWEEN WELDS (LOCAL CROSS
SECTION MAY BE UNSTABLE
- PLATES MAY SEPARATE)

304SS 2814 LB/IN.
PLATES (2545 FOR TN-40)

2055 LB/IN.
(1707 FOR TN-40)

6061 T6 2896 LB/IN.
ALUMINUM (2805 FOR TN-40)
PLATES

3234 LB/IN.
(3145 FOR TN-40)

TOTAL TEST PANEL ALLOWABLE LOAD = 2055 + 2896 = 4951 LB/IN.
(4512 FOR TN-40)

*NOTE: PLATES USED IN TEST PANELS HAD GREATER THICKNESSES THAN
SPECIFIED FOR TN-40 (304 SS THICKNESS WAS .110" VS. 100"
AND 6061 T6 ALUMINUM THICKNESS WAS .256" VS. .250").

Rev. 1 4/91

Figure 4C.1-6
TEST PANEL ALLOWABLE COMPRESSIVE
LOAD* USING TN-40 CRITERIA AND ACTUAL
TEST PANEL DIMENSIONS (SLIGHTLY
THICKER PLATES THAN TN-40 DESIGN)
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

TEST PANEL ALLOWABLE COMPRESSIVE LOAD USING TN-40 CRITERIA AND ACTUAL TEST PANEL DIMENSIONS
(SLIGHTLY THICKER PLATES THAN TN-40 DESIGN)

AXIAL CRUSH TEST OF BARE BOX SECTION

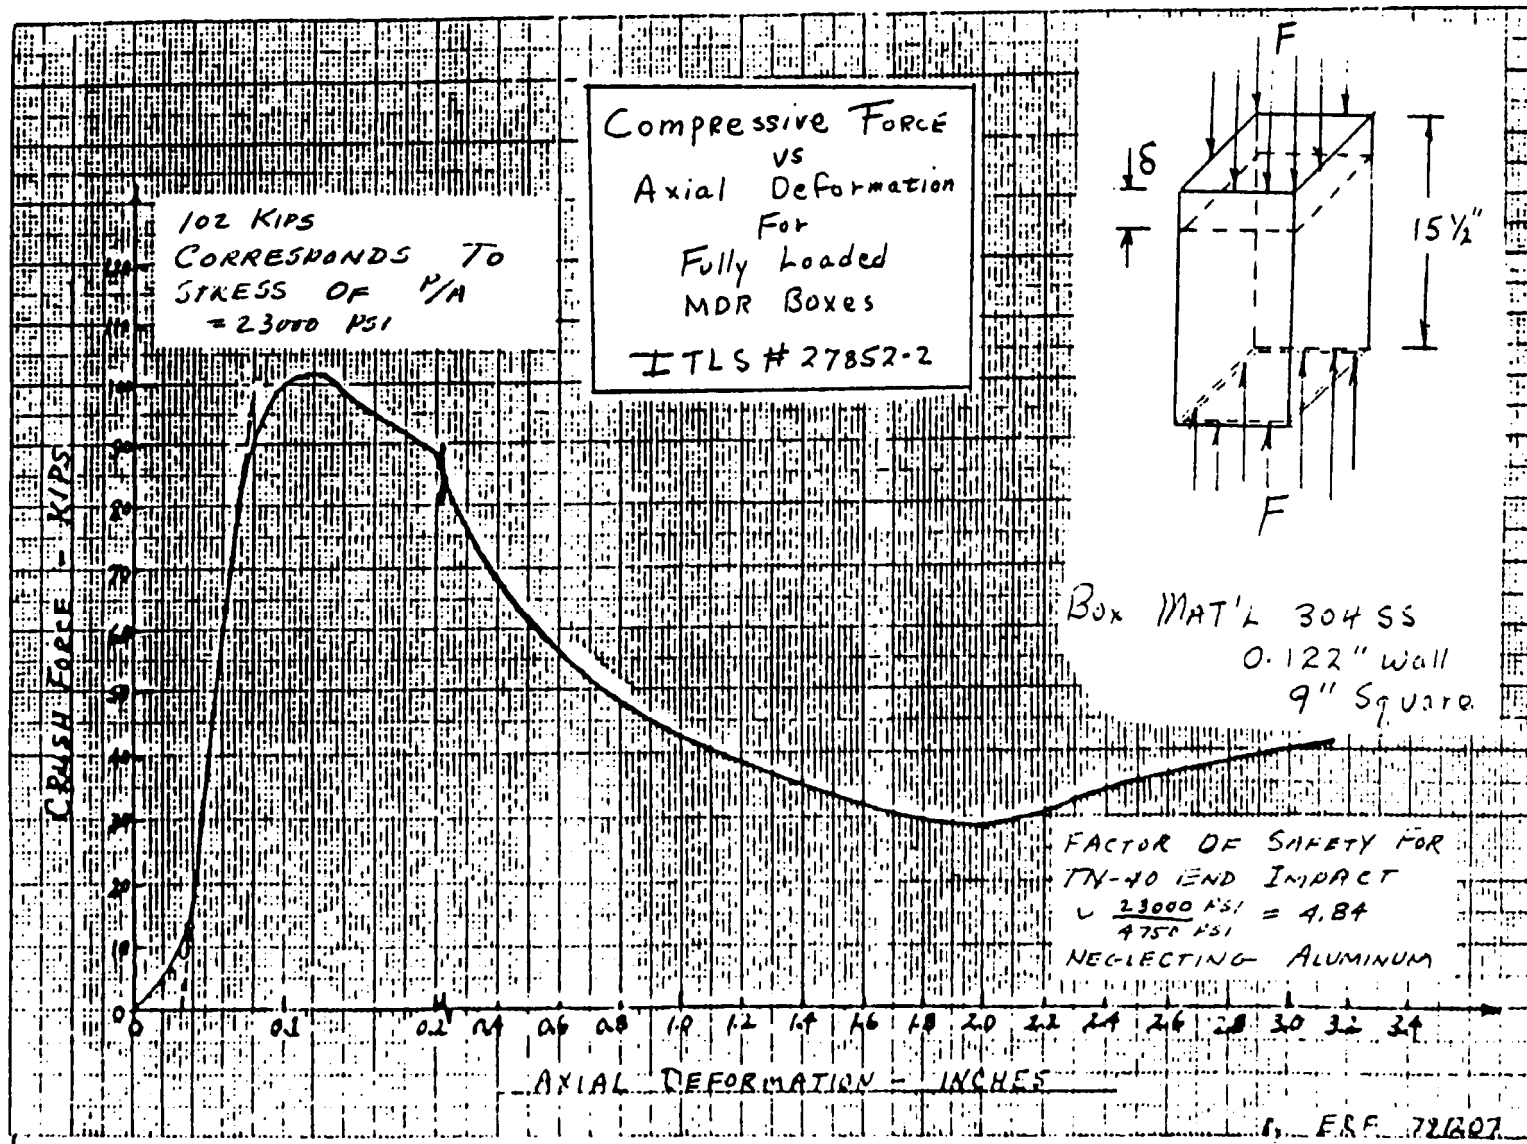


Figure 4C.2-1
AXIAL CRUSH TEST OF
"BARE" BOX SECTION
 PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

Rev. 1491

SECTION 5**STORAGE SYSTEM OPERATIONS****5.1 OPERATION DESCRIPTION****5.1.1 NARRATIVE DESCRIPTION**

Fuel handling and cask loading operations in the Auxiliary Building will be done in accordance with requirements of the Prairie Island Nuclear Generating Plant Operating License. Cask transport and storage at the ISFSI will be subject to requirements of the ISFSI Operating License. Operating activities in the Auxiliary Building and during transport and storage are described below.

The fuel storage operation will commence with the cask being brought into the Auxiliary Building rail bay through the west roll-up door. The cask weather cover and the cask lid will be removed and the cask inspected. A lifting yoke will be attached to the cask and connected to the Auxiliary Building crane hook. The cask will be laterally transferred and lifted by the crane from the basemat, elevation 695 feet, through a large opening in the floor slab at the 755 ft. elevation, laterally transferred and aligned with the access door to the fuel pool area, moved directly north to above the loading and unloading area of Pool No. 1 and lowered to the surface of the pool. The load path for the cask is illustrated in Figures 4.4-1 through 4.4-3. The narrow slot in the ceiling of the pool enclosure prohibits any movement of the cask except in the north-south direction.

The cask containment lid will be removed and the cask will be lowered into the spent fuel pool. Fuel assemblies will be loaded into the cask using a long handled tool suspended from the spent fuel pool bridge crane hoist and manipulated by an operator standing on the movable bridge over the pool.

After the cask is loaded with spent fuel and the lid is placed on the cask, the cask will be lifted to the pool surface and the lid bolts will be installed. The internal fuel cavity will be drained by displacing the water with air or with a suitable drain pump.

The cask will be returned to the Auxiliary Building rail bay by retracing the load path described above. The cask will be decontaminated in the Auxiliary Building rail bay/cask decontamination area and will be dried by using a vacuum system. The cavity will be filled with helium to design pressure and the cask lid seal will be leak tested. The top neutron shield will be installed on the lid. The overpressure monitoring system will be installed, and the interspaces between the double metallic seals pressurized to equilibrium pressure. Prior to transfer from the Auxiliary Building to the ISFSI, the cask will be monitored for contamination, temperature, radiation dose rates and the proper functioning of the seal tightness monitoring system. The protective cover will be installed and the pressure transducer connections fed through the external fitting.

The transport vehicle will be pulled to the ISFSI site by a tow vehicle as described in Section 5.4. The cask will be set in its storage position. The cask will be connected to the cask seal monitoring system and a functional check of the monitoring system will be performed.

5.1.2 FLOW SHEETS

The sequence of operations performed in loading fuel into the TN-40 storage cask and placing the cask into storage at the ISFSI is outlined in Table 5.1-1 and is shown in simplified flowsheet form in Figure 5.1-1.

Details of the number of personnel and the time required for the various operations are given in Table 5.1-2 for use in the radiation exposure determinations developed in Chapter 7. The data are based on Transnuclear's experience with transport cask operations.

5.1.3 IDENTIFICATION OF SUBJECTS FOR SAFETY AND RELIABILITY ANALYSIS

5.1.3.1 CRITICALITY PREVENTION

As discussed in Section 3.3.4, criticality is controlled by utilizing poison materials in the fuel basket and in the spent fuel pool water. These features are only necessary underwater during cask loading in the spent fuel pool. During storage, with the cavity dry and sealed from the environment, no further criticality control measures within the installation are necessary because of the low reactivity of the dry cask and the assurance that no unborated water can enter the cask during storage.

01106798

01106798

5.1.3.2 INSTRUMENTATION

Due to the totally passive and inherently safe nature of the storage casks, there is no need for any instrumentation to perform safety functions. However, transmitters are utilized to monitor the cask seals for leakage and are described in Section 3.3.3. The transmitters monitor the pressure in an interspace between the double metallic seals to provide an indication of seal failure before any release occurs.

An initial function check is performed at the manufacturer's plant and another function check of the transmitters is performed in preparation for cask storage.

5.1.3.3 MAINTENANCE TECHNIQUES

Because of their passive nature, the storage casks will require little, if any, maintenance over the lifetime of the ISFSI. Typical maintenance tasks involve occasional replacement and recalibration of monitoring instrumentation and recoating of some casks with corrosion-inhibiting coatings. No special maintenance techniques are necessary.

5.2 CONTROL ROOM AND CONTROL AREAS

This is a passive system and there is no need for control room annunciators or other systems to indicate off-normal conditions. A panel outside the ISFSI site will provide an alarm for the cask pressure monitoring equipment.

5.3 SPENT FUEL ACCOUNTABILITY PROGRAM

Accountability and control of special nuclear materials will be maintained at all times during the loading, transport, and storage of spent fuel assemblies. Accountability records for all fuel assemblies transferred to, stored in or removed from the ISFSI will be maintained for as long as the fuel is stored on the Prairie Island site.

Fuel management records shall be utilized to verify that the initial fuel enrichment and fuel burnup of the fuel assemblies to be stored in the ISFSI are within the cask design criteria limits. Fuel management records will be reviewed to ensure that the assemblies to be put in each cask have not been previously identified as being failed fuel (leakers). The fuel assemblies shall also be visually inspected for physical damage which could potentially cause problems during insertion and/or removal from the storage cask. Each fuel assembly is engraved with a unique identification number and a vendor identification, which is unique to the site for which the fuel assemblies were fabricated. This will allow visual confirmation of the identity of the fuel assemblies placed in the cask.

The visible physical identification on each fuel assembly in combination with the administrative assignment of cell storage locations within the storage cask, and a unique serial number stamped on each storage cask, will allow for the positive identification of the locations of all ISFSI spent fuel assemblies.

5.4 SPENT FUEL TRANSPORT TO ISFSI

The transport vehicle used to move the casks from the Auxiliary Building to the ISFSI is described in Section 4.3. A tow vehicle, such as a diesel tractor, will be used to pull the transport vehicle.

The casks will be loaded onto the transport vehicle in the Auxiliary Building rail bay. The rail bay is on the basemat of the Auxiliary Building.

The transport vehicle will be pulled out of the rail bay and out to the plant protected area fence along the same route as the railroad spur. The railroad spur (No. 1) is constructed on top of 6 inch by 8 inch railroad ties covered by 1 1/2 inch thick coarse bituminous binder and a 1 1/2 inch thick coarse bituminous surface. The ties are placed on 12 inch thick ballast.

The transport vehicle will be pulled over a newly designed and constructed access road. The access road is constructed of a 14 inch thick MN/DOT Class 5 compacted aggregate and is designed for transport vehicle loads with a loaded cask. The plan and profile of the access road is shown in Figure 5.4-1.

The transport vehicle will be pulled over the access road to the ISFSI site which also consists of a 14 inch thick MN/DOT Class 5 aggregate. The ISFSI site is designed with ample area to allow the transport vehicle to be maneuvered up onto the cask storage pads from any direction. A plan of the site is shown in Figure 1.3-1. The casks will then be unloaded from the transport vehicle onto the pads for storage.

5.5 SPENT FUEL TRANSFER TO TRANSPORT CASK

Assuming that the spent fuel in the TN-40 cask will be transferred to a licensed transport cask using a normal “in pool” fuel transfer, the sequence of operations described in Section 5.1 and listed in Table 5.1-1 will be essentially performed in reverse.

The cask will be moved from the ISFSI back into the Auxiliary Building rail bay using the cask transport vehicle. The weather cover will be unbolted and removed. The overpressure system will then be removed and the cavity gas sampled through the vent port.

After moving the cask into the fuel pool area, the cavity will be depressurized and the cask lowered into the spent fuel pool. With the cask lid at the pool surface, fill and drain lines will be connected to the lid drain and vent ports. Borated water will be slowly added to fill the cask and to gradually cool the fuel in the cask. When the cask is full, the fill and drain lines will be removed. The cask will then be lowered to the pool bottom where the lid would be removed making the fuel accessible for transfer.

5.6 REFERENCES

None.

TABLE 5.1-1**PAGE 1 OF 3****SEQUENCE OF OPERATIONS****A. Receiving**

1. Unload empty cask and separately packaged seals at plant site.
2. Inspect the following for shipping damage: exterior surfaces, sealing surfaces, trunnions, seals, accessible interior surfaces and basket assembly, bolts, bolt holes and threads, neutron shield vents.
3. Remove weather shield and install plug in neutron shield vent hole (threaded hole in the top of the steel shell surrounding the resin which contains a pressure relief valve during storage).
4. Remove lid bolts and lid.
5. Install protective plate over cask body sealing area.
6. Obtain lid and lid seal from storage.
7. Attach lid seal to lid by means of six retaining screws.
8. Move to spent fuel pool area.

B. Spent Fuel Pool Area

1. Lower cask into cask loading pool.
2. Load preselected spent fuel assemblies into the 40 basket compartments.
3. Verify identity of the fuel assemblies loaded into the cask.
4. Remove protective plate from cask body flange.
5. Lower lid and place on cask body flange over the two alignment pins.
6. Lift cask to surface of pool and install some lid bolts.
Note: Steps B.7 through B.11 may use a drain pump with a quick-disconnect coupling or suction lance to drain water as an alternate method.
7. Connect drain line to quick-disconnect coupling in the drain port.
8. Bolt special adapter, with quick-disconnect coupling, to vent port bolt holes.

TABLE 5.1-1**PAGE 2 OF 3****SEQUENCE OF OPERATIONS**

9. Connect plant compressed air line to special adapter quick-disconnect coupling.
10. Pressurize cavity to force water from cavity through drain port to the spent fuel pool.
11. Disconnect plant compressed air line and drain line from their quick-disconnect couplings.
12. Move cask to the decontamination area.

C. Decontamination Area (Rail Bay)

1. Decontaminate cask until acceptable surface dose levels are obtained.
2. Install remaining lid bolts and torque lid bolts using the prescribed procedure.
3. Remove plug from neutron shield vent and install pressure relief valve.
4. Connect Vacuum Drying System (VDS) to vent port.
5. Evacuate cavity to remove remaining moisture using prescribed procedure.
6. Evacuate cavity to 10 millibar and backfill with dry helium gas.
7. Pressurize cavity to about 2 atm with helium.
8. Disconnect VDS at vent port and install vent port cover with seal and bolts.
9. Perform helium leak test of lid seals.
10. Remove overpressure test connector.
11. Load cask on transport vehicle.
12. Check external surface temperatures using infrared camera or equivalent.
13. Install top neutron shield drum.
14. Torque the bolts using prescribed procedure.
15. Perform leak test on overpressure system.

01106798

01106798

TABLE 5.1-1

PAGE 3 OF 3

SEQUENCE OF OPERATIONS

16. Pressurize overpressure system (seal interspaces) with helium to a pressure of about 5.5 atm.
17. Check surface radiation levels.
18. Install protective cover with seal and bolts (could be performed at storage area).
19. Move cask to storage area.

D. Storage Area

1. Position cask in preselected location on storage pad.
2. Unload cask from transport vehicle.
3. Check for surface defects.
4. Connect pressure instrumentation to cask and to monitoring panel.
5. Check that pressure instrumentation is functioning.
6. Check surface radiation levels.

01106798

01106798

TABLE 5.1-2**PAGE 1 OF 3****ANTICIPATED TIME AND PERSONNEL REQUIREMENTS FOR
CASK HANDLING OPERATIONS**

| OPERATION | NO. OF PERSONNEL | TIME (MIN) | AVG. DISTANCE (ft) FROM CASK |
|---|-----------------------------|-----------------------|---|
| | | | |
| RECEIVING (Table 5.1-1 [A1 – A8]) | | | |
| 1. Unloading | * | * | * |
| 2. Inspection | * | * | * |
| 3. Transfer to cask | * | * | * |
| CASK LOADING POOL (Table 5.1-1 [B1 – B12]) | | | |
| 4. Lower cask into pool | * | * | * |
| 5. Load fuel | 5 | * | * |
| 6. Place lid on cask | 5 | * | * |
| 7. Lift cask to pool surface | 5 | 30 | 5 |
| 8. Install lid bolts | 5 | 120 | 3 |
| 9. Drain cavity | 5 | 90 | 6 |
| 10. Transfer to decontamination area | 3 | 60 | 10 |
| DECONTAMINATION AREA (RAIL BAY) (Table 5.1-1 [C1 – C19]) | | | |
| 11. Decontaminate cask | 3 | 120 | 3 |
| 12. Remove vent plugs | 2 | 30 | 5 |
| 13. Drying, evacuating, backfilling | 2 | 480 | 5 |

TABLE 5.1-2**PAGE 2 OF 3****ANTICIPATED TIME AND PERSONNEL REQUIREMENTS FOR
CASK HANDLING OPERATIONS**

| OPERATION | NO. OF PERSONNEL | TIME (MIN) | AVG. DISTANCE (ft) FROM CASK |
|---|-----------------------------|-----------------------|---|
| 14. Install top neutron shield | 2 | 15 | 3 |
| 15. Install pressure transducers | 2 | 30 | 5 |
| 16. Pressurize interspace | * | * | * |
| 17. Check leakage | 2 | 30 | 5 |
| 18. Check surface temperature | 2 | 30 | 5 |
| 19. Check surface dose rate | 2 | 30 | 3 |
| 20. Install protective cover | 2 | 30 | 5 |
| 21. Load transport vehicle | 3 | 60 | 5 |
| 22. Transfer to storage area | 3 | 60 | 10 |
| STORAGE AREA (Table 5.1-1 [D1 – D6]) | | | |
| 23. Unload from vehicle position in location | 5 | 60 | 5 |
| 24. Check surface dose rate | 5 | 30 | 3 |
| 25. Connect pressure instrumentation | 5 | 30 | 5 |

TABLE 5.1-2**PAGE 3 OF 3****ANTICIPATED TIME AND PERSONNEL REQUIREMENTS FOR
CASK HANDLING OPERATIONS**

| OPERATION | NO. OF PERSONNEL | TIME (MIN) | AVG. DISTANCE (ft) FROM CASK |
|--|-----------------------------|-----------------------|---|
| PERIODIC MAINTENANCE | | | |
| 1. Visual surveillance (NA) | 2 | 15 | 5 |
| 2. Repair surface defects (NA) | 2 | 60 | 3 |
| 3. Instrument testing and calibration | 2 | 180 | 5 |
| 4. Instrument repair (NA) | 2 | 60 | 3 |
| MAJOR MAINTENANCE | | | |
| 1. Replace cask lid seals | 3 | 1950** | 8 |

* No measurable dose associated with this activity. Therefore, the number of personnel, time and distance are not significant.

Parenthetical information corresponds to Table 5.1-1 activity numbers.

** Total time to transfer cask to spent fuel pool, replace lid seals, and return cask to ISFSI pad.

01505901

SECTION 6

WASTE MANAGEMENT

6.1 DESIGN

No radioactive wastes will be generated during storage of the casks at the ISFSI or during cask transport outside of the Auxiliary Building. Radioactive wastes generated during loading operations in the Auxiliary Building will be treated using existing Prairie Island Nuclear Generating Plant radioactive waste control systems as described in Section 9 of the Prairie Island USAR (Reference 1).

Contaminated pool water removed from loaded storage casks will normally be drained back into the spent fuel pool with no additional processing. A small amount of liquid waste will result from storage cask decontamination. The decontamination procedure will result in a small amount of a detergent/demineralized water mixture being collected in the cask decontamination area. Liquid wastes collected in the cask decontamination area are directed to the aerated waste sump tank, where it will be mixed with other plant liquid wastes, treated or held up for decay, and released.

Potentially contaminated air and helium purged from the storage casks following spent fuel loading will be handled by the spent fuel pool ventilation systems as described in the Prairie Island USAR, Section 10.3.7, or the gaseous radwaste system as described in the USAR, Section 9.3. Air in the spent fuel pool area is normally exhausted through roughing and HEPA filters. In the event of a high radiation signal, ventilation is performed by the spent fuel pool special ventilation system, which has roughing, HEPA and activated charcoal filters.

A small quantity of low level solid waste will be generated as a result of storage cask loading operations and transfer cask decontamination. The solid waste generated will be processed as described in the Prairie Island USAR, Section 9.4. This low level waste will consist of disposable anti-contamination garments, tape, blotter paper, rags, etc.

The ISFSI Decommissioning Plan is detailed in Section 4.6.

THIS PAGE IS LEFT INTENTIONALLY BLANK

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 9

Page 6.2- 1

6.2 REFERENCES

1. Northern States Power Company, Prairie Island Nuclear Generating Plant
Updated Safety Analysis Report, Revision 10, Docket 50-282 (Unit 1) and 50-
306 (Unit 2)

THIS PAGE IS LEFT INTENTIONALLY BLANK

SECTION 7

RADIATION PROTECTION

7.1 ENSURING THAT OCCUPATIONAL RADIATION EXPOSURES ARE AS LOW AS REASONABLY ACHIEVABLE (ALARA)

7.1.1 POLICY CONSIDERATIONS AND ORGANIZATION

A radiological protection program will be implemented at the ISFSI in accordance with requirements of 10CFR72.126. The program will be based upon policies in existence at the Prairie Island Nuclear Generating Plant, which are described below.

The Prairie Island site shielding and radiation protection policies are described in Section 12.3 of the Prairie Island USAR (Reference 1). These policies will be applied to the Independent Spent Fuel Storage Installation. NSPM is committed to a strong ALARA program in design and operation of nuclear facilities. The ALARA program which is applied to the ISFSI is the same as used at the Prairie Island Nuclear Generating Plant. Plant and design personnel are trained and updated on ALARA practices and dose reduction techniques. Design and implementation of systems and equipment are reviewed to insure ALARA criteria are met on all new and modification projects.

The ALARA program ensures that:

1. An effective ALARA program is administered at the Prairie Island Nuclear Generating Plant that appropriately integrates management philosophy and NRC regulatory requirements and guidance.
2. Facility design features, operating procedures and maintenance practices are in accordance with ALARA program guidelines; and that written reviews of the on-site radiation protection program assure that objectives of the ALARA program are attained.
3. Pertinent information concerning radiation exposure of personnel from other utilities and research work are reflected in design and operation.
4. Appropriate experience gained during the operation of nuclear power stations relative to in-plant radiation control is factored into revisions of procedures to assure that the procedures continually meet the objectives of the ALARA program.
5. Necessary assistance is provided to insure that operations, maintenance, and decommissioning activities are planned and accomplished in accordance with ALARA objectives.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 12

Page 7.1-2

6. Trends in station personnel and job exposures are analyzed in order to permit corrective actions to be taken with respect to adverse trends.

Reports of the findings of the radiation protection staff are also effectively conveyed to management.

Specific responsibilities of station personnel are to ensure that:

1. Activities are planned and accomplished in accordance with the objectives of the ALARA program.
2. Procedures and their revisions are implemented in accordance with the objectives of the ALARA program.
3. The general office radiation protection staff is consulted as necessary for assistance in meeting ALARA program objectives.

The primary goal of the radiation protection and ALARA programs is to minimize exposure to radiation such that the total individual and collective exposure to personnel in all phases of design, construction, operation and maintenance are kept As Low As Reasonably Achievable. This is achieved by integrating ALARA concepts into design, construction, and operation of facilities.

Trained personnel adequate to develop and conduct all necessary radiation protection and ALARA programs are provided. These personnel are trained to assure that all procedures are followed to meet company and regulatory requirements. Training programs in the basics of radiation protection and exposure control are provided to all facility personnel whose duties require working in radiation areas.

The administrative organization is responsible for and has appropriate authority for assuring that the three basic objectives of the radiation protection program are achieved. These objectives are to:

1. Protect personnel
2. Protect the public
3. Protect the facility

Protection of Personnel Includes surveillance and control over internal and external radiation exposure and maintaining the exposure of all personnel within permissible limits and as low as reasonably achievable (ALARA).

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 12

Page 7.1-3

Protection of the public includes surveillance and control over all conditions and operations that may affect the health and safety of the public. Included are such activities as radioactive gas, liquid, and solid waste disposal, shipment of radioactive materials, an environmental radioactivity monitoring plan and maintaining portions of the station emergency plan.

Protection of the Facility includes monitoring to warn of possible detrimental changes and exposure hazards, to determine changes or improvement needed, and to note trends for planning future work.

This administrative organization is also responsible for and has appropriate authority for maintaining occupational exposures as far below the specified limits as reasonably achievable by assuring that:

1. Station personnel are made aware of management's commitment to keep occupational exposures as low as reasonably achievable;
2. Formal reviews are performed periodically to determine how exposures might be lowered.
3. There is a well-supervised radiation protection capability with specific defined responsibilities;
4. Station workers receive sufficient training;
5. Sufficient authority to enforce safe station operation is provided;
6. Modification to operating and maintenance procedures and to station equipment and facilities are made where they should substantially reduce exposures at a reasonable cost;
7. The radiation protection staff understands the origins of radiation exposures in the station and seeks ways to reduce exposures;
8. Adequate equipment and supplies for radiation protection work are provided.

The Site Vice President is responsible for the protection of all persons against radiation and for compliance with NRC regulations and license conditions. This responsibility is in turn shared by all Managers. Furthermore, all personnel are required to work safely and to follow the regulations, rules, and procedures that have been established for their protection.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 12

Page 7.1-4

The Radiation Protection and Chemistry Manager is responsible for the Radiation Protection Program, including the program for handling and monitoring radioactive material, that is designed to assure compliance with applicable regulations, technical specifications, and regulatory guides. This person also provides technical guidance and support for conducting this program, reviews the effectiveness and the results of the program and modifies it as required based on experience and regulatory changes, to assure that occupational radiation exposure and exposure to the general public are maintained as low as reasonably achievable.

The Radiation Protection General Supervisor is responsible for radiation safety. This duty includes the authority to measure and control the radiation exposure of personnel; to continuously evaluate and review the radiological status of the station; to make recommendations for control or elimination of radiation hazards; to assure that all personnel are trained in radiation protection; to assist all personnel in carrying out their radiation protection responsibilities; and to protect the health and safety of the public both on-site and in the surrounding area. In order to achieve the goals of the Radiation Protection Program and fulfill these responsibilities for radiation protection, radiological monitoring, survey and personnel exposure control work are performed on a continuing basis for station operations and maintenance including the ISFSI.

7.1.2 DESIGN CONSIDERATIONS

The equipment design takes into account radiation protection considerations, which ensure that occupational radiation exposures are ALARA. The fuel will be stored dry, inside sealed, heavily-shielded casks. The most significant radiation protection design consideration provides for heavy shielding to minimize personnel exposures. To avoid personnel exposure, the casks will not be opened nor fuel removed from the casks while at the ISFSI. Storage of the fuel in dry sealed casks eliminates the possibility of leakage of contaminated liquids. Gaseous releases are not considered credible. The exterior of the casks will be decontaminated before leaving the Auxiliary Building, thereby minimizing exposure of personnel to surface contamination. The storage casks will contain no active components which require periodic maintenance or surveillance. This method of spent fuel storage minimizes direct radiation exposures and eliminates the potential for personnel contamination.

Both concrete storage pads and the Equipment Storage Building at the ISFSI will be constructed prior to ISFSI operation. This will be done to eliminate occupational radiation exposure which would result from additional construction following placement of storage casks in the ISFSI.

An annunciator panel monitoring cask pressure will be located outside of the ISFSI protected area. This will minimize time required for periodic cask surveillance and reduce personnel exposure.

The ISFSI site is within the exclusion area of the Prairie Island site. The location of the ISFSI is of sufficient distance from frequently occupied areas of the Prairie Island Nuclear Generating Plant such that the increased dose to personnel will not be significant.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 12

Page 7.1-5

Regulatory Position 2 of Regulatory Guide 8.8, is incorporated into design considerations, as described below:

- ALARA objective 2a on access control is met by use of a fence with a locked gate that surrounds the ISFSI and prevents unauthorized access.
- Regulatory Position 2b on radiation shielding is met by the heavy shielding of the casks which minimizes personnel exposures.
- Regulatory Position 2c on process instrumentation and controls is met by designing the instrumentation for a long service life and locating readouts in a low dose rate location.
- Regulatory Position 2d on control of airborne contaminants does not apply because no gaseous releases are expected. No significant surface contamination is expected because the exterior of the casks and racks will be decontaminated before they leave the decontamination area in the Auxiliary Building.
- Regulatory Position 2e on crud control is not applicable to the ISFSI because there are no systems at the ISFSI that could transport crud.
- Regulatory Position 2f on decontamination is met because the exteriors of the casks are designed for decontamination. The casks and racks are decontaminated before they are released from the decontamination area in the Auxiliary Building.
- Regulatory Position 2g on radiation monitoring does not apply because the casks are sealed. There is no need for airborne radioactivity monitoring since no airborne radioactivity is anticipated. Area radiation monitors will not be required because the ISFSI will not normally be occupied; however, TLDs will be installed along the controlled access fence.
- Regulatory Position 2h on resin treatment systems is not applicable to the ISFSI because there will be no radioactive systems containing resins.
- Regulatory Position 2i concerning other miscellaneous ALARA items is not applicable because these items refer to radioactive systems not present at the ISFSI.

7.1.3 OPERATIONAL CONSIDERATIONS

The ALARA procedures for the ISFSI will be the same as those used in the radiation protection program for Prairie Island Nuclear Generating Plant. Section 7.1.1 describes the policy and procedures that ensure that ALARA occupational exposures and contamination levels are achieved. Section 7.1.2 describes how the design considerations are ALARA.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 12

Page 7.1-6

Storage of spent fuel in storage casks is expected to involve lower exposures than other alternative methods or designs for onsite storage. For example, storage in a fuel pool would involve use of radioactive water cooling and cleanup systems and filtered HVAC that would result in higher operator exposures during pump, valve, and motor maintenance of these systems, and filter and resin replacement. This alternative would also lead to additional airborne and liquid releases that will not be present at the ISFSI.

Operational requirements for surveillance are incorporated into the design considerations in Section 7.1.2 in that the casks are stored with adequate spacing to allow ease of on site surveillance. In addition, annunciation will be available outside the ISFSI protected area to minimize surveillance time. The operational requirements are incorporated into the radiation protection design features described in Section 7.3 since the casks are heavily shielded to minimize occupational exposure.

The ISFSI contains no systems that process liquids or gases or contain, collect, store, or transport radioactive liquids or solids other than the stored spent fuel and contaminated spent fuel racks. Therefore, the ISFSI meets ALARA requirements since there are no such systems to be maintained, be repaired, or be a source of leaks.

7.2 RADIATION SOURCES

7.2.1 CHARACTERIZATION OF SOURCES

There are five principal sources of radiation associated with cask storage that are of concern for radiation protection. These are:

1. Primary gamma radiation from spent fuel.
2. Primary neutron radiation from spent fuel.
3. Gamma radiation from activated fuel structural materials.
4. Capture gamma radiation produced by attenuation of neutrons by shielding material of the cask.
5. Neutrons produced by sub-critical fission in fuel.

Primary gamma and neutron radiation sources for the stored spent fuel are generated by using the ORIGEN2 computer code (Reference 5). A 3.85% enrichment Westinghouse OFA 14x14 fuel assembly, as described in Section 3.1.1, is modeled in three zones for the ORIGEN2 calculation (Reference 6). The structural material masses are listed in Table 7.2-1. The structural material compositions and fuel impurities are taken from Reference 6. In particular, the cobalt impurities in Inconel, Zircaloy and stainless steel are 0.47%, 0.001% and 0.08% respectively.

The fuel zone is irradiated at a constant specific power of 37.5 MW/MTU to a total burnup of 45,000 MWD/MTU. A conservative three-cycle operating history is utilized with 30 days down time each cycle except for no down time in the last cycle. After the fuel zone irradiation, the flux generated by ORIGEN2 for the fuel zone is used to irradiate the plenum and end zones. However, the methodology of Reference 6 is used to correct the plenum and end zone irradiations. The cobalt, Zircaloy and manganese masses in the structural materials are multiplied by 0.67, 0.40 and 0.80 respectively and the irradiation flux for the plenum and end zones is multiplied by 0.042 and 0.011 respectively. Those factors are used to correct for the spatial and spectral changes of the neutron flux outside of the fuel zone.

Gamma and neutron sources are generated for cooling times from 10 years to 30 years.

Table 7.2-2 shows the total primary gamma source and neutron source. Fission product activities are listed on Table 7.2-3 and activation activities are listed on Table 7.2-3A.

The primary gamma source spectrum, group structure and ANSI/ANS-6.1.1 flux-to-dose factors are listed in Table 7.2-4. The energy groups are those output by ORIGEN2. The fuel zone gamma spectrum contains a contribution of activated materials from the materials listed in Table 7.2-1.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

Page 7.2-2

The neutron source consists of spontaneous fission and alpha-n reactions mainly from Cm-244. Spectra for both mechanisms are obtained from Reference 7. However the spectra of Reference 7 must be converted into the proper neutron energy groups of the SCALE 27n-18g library (Reference 8). This is accomplished by apportioning the Cm-244 spectra into the SCALE energy groups. For example, SCALE Group 6 contains neutrons with energies between 0.4 and 0.9 MeV. This encompasses two groups and part of a third of the Reference 7 spontaneous fission spectrum (i.e., 0.4-0.6, 0.6-0.8 and 0.8-1.0).

Therefore, the fraction in SCALE Group 6 is:

$$0.07973 + 0.08156 + 0.07056 \times \frac{0.9 - 0.8}{1.0 - 0.8} = 0.1966$$

The spectra from Reference 7 for both spontaneous fission and alpha-n reactions are converted into equivalent neutron spectra in the SCALE energy groups in this manner. A single combined neutron spectrum is then calculated using 93.7% spontaneous fission and 6.3% alpha-n. Those percentages are obtained from the ORIGEN2 output. Table 7.2-5 lists the neutron spectra.

The primary gamma spectrum is also converted into the SCALE 27n-18g energy groups. In addition to simple apportioning of overlapping groups as is done above for the neutrons, the gammas are weighted by the ratio of the ORIGEN2 and SCALE library average group energies because ORIGEN2 weights the photon yields in this fashion. Table 7.2-6 lists this spectrum and ANSI flux-to-dose factors for the SCALE energy groups.

Gamma radiation produced by capture of neutrons in cask shielding materials is computed in the shielding analysis with the coupled SCALE 27n-18g neutron-gamma library. Similarly, neutrons produced from sub-critical multiplication are accounted for in the shielding calculation.

7.2.2 AIRBORNE RADIOACTIVE SOURCES

The quantity of fission gas produced in a typical PWR assembly for the design irradiation condition is approximately 600 liters at STP (Reference 9). Of this quantity, only a small fraction is radioactive with Kr-85 being the dominant nuclide. Most of the fission products generated are retained within the fuel pellet. A small fraction, nominally 30% for Kr-85 and 10% for noble gases, is released into the fuel rod plenums. Table 7.2-7 shows the inventory of fission gases and volatile nuclides contained in 40 of the design basis fuel assemblies. There are the total curves in the fuel assemblies, not just in the plenums.

The radioactive sources resulting from cask storage are safely confined both within the fuel cladding and within the cask containment during storage. Accordingly, airborne provisions for personnel protective measures against airborne sources are not required.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 13

Page 7.3-1

7.3 RADIATION PROTECTION DESIGN FEATURES

7.3.1 STORAGE SYSTEM DESIGN DESCRIPTION

A description of the ISFSI, including layout and characteristics is provided in **Section 4.1**.

The ISFSI has a number of design features which ensure that exposures are ALARA.

- There will be no radioactive systems in the ISFSI other than the storage casks.
- The casks will be loaded, sealed, and decontaminated prior to transfer to the ISFSI.
- The fuel will not be unloaded nor will the casks be opened at the ISFSI.
- The fuel will be stored dry inside the casks, so that no radioactive liquid is available for leakage.
- The casks will be sealed airtight.
- The casks will be heavily shielded to minimize external dose rates.

Also, the ISFSI will not normally be occupied. Therefore, no personnel areas, equipment decontamination areas, contamination control areas, or health physics facilities need be located at the ISFSI. These types of facilities are available at the Prairie Island Nuclear Generating Plant.

Due to the remoteness of the ISFSI from other normally occupied areas and the anticipated occupancy times for performing surveillance activities, the anticipated total effective dose equivalent to any individual member of the public in any period of one calendar year will be well below 0.1 rem in accordance with 10CFR20.1301(a)(1). Accordingly, areas outside the owner-controlled fenced area are unrestricted and the dose to unrestricted areas from the ISFSI cannot exceed 2.00 mrem in any one hour in accordance with 10CFR20.1301(a)(2). Worst case dose rates (assuming design basis fuel in 48 casks) at the outer fence boundary (nuisance fence), which is well within the restricted area boundary, have been calculated to be 1.99 mrem/hr.

7.3.2 SHIELDING

The design of the cask shielding, material of construction, and method of calculating shielding parameters are explained in Appendix 7A. A discussion of the earth berm shielding is contained in Appendix A7A. No special features or remote handling of the casks in the ISFSI are proposed. Portable shielding may be used during cask maintenance, if appropriate.

01244873

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 13

Page 7.3-2

7.3.3 AREA RADIATION AND AIRBORNE RADIOACTIVITY MONITORING INSTRUMENTATION

As indicated in Section 3.3.5.3, there are no credible events which could result in releases of radioactive products or unacceptable increases in direct radiation. Area radiation and airborne radioactivity monitors are therefore not needed at the ISFSI; however, TLDs will be used to record dose rates along the outer (nuisance) fence boundary of the ISFSI

7.4 ESTIMATED ONSITE COLLECTIVE DOSE ASSESSMENT

Table 7.4-1 shows the estimated design basis occupational exposures to ISFSI personnel during the loading, transport, and emplacement of the storage casks. Dose rates at 1 meter were utilized for all cases except cask transfer, when individuals will typically be at least 2 meters away from the cask.

Table 7.4-2 shows the estimated design basis annual man-rem for surveillance and maintenance activities. Visual surveillance was based on a walkdown of each of the two pads at a distance no closer than 2 meters to the casks. The casks on the opposite pad contribute approximately 1 mrem/hr to the expected dose rate along with contributions from the casks on the near pad. It was assumed that the average dose rate for the surveillance was four times the dose rate calculated at 2 meters from a cask. To estimate the dose rates for operability tests and calibration, the worker was assumed to be located at the monitoring panel at the perimeter fence entrance. During instrument repairs, the worker was assumed to be positioned between two rows of casks. The six surrounding casks (all within 16 feet of the worker) were the predominant dose contributors during repair work, but dose rates from casks on the other pads were also considered.

Both Table 7.4-1 and 7.4-2 provide for each task the estimated time required for the task, number of personnel required, the design basis dose rates, and man-rem.

An evaluation of the additional dose to station personnel from ISFSI operations is contained in Section A7.

THIS PAGE IS LEFT INTENTIONALLY BLANK

7.5 OFFSITE COLLECTIVE DOSE ASSESSMENT

An evaluation of the offsite collective dose from ISFSI operations is contained in Section A7.

THIS PAGE IS LEFT INTENTIONALLY BLANK

7.6 RADIATION PROTECTION PROGRAM

The ISFSI is located on the site of the Prairie Island Nuclear Generating Plant within the Owner Controlled Area. The Radiation Protection and Chemistry Manager will have responsibility for radiation protection activities at the ISFSI.

The Radiation Protection and ALARA programs are discussed in Section 7.1.1.

Radiation protection requirements for all radiological work at the Prairie Island Nuclear Generating Plant are governed by existing station directives, and station Radiation Protection procedures. Radiation protection practices for cask loading, transfer, storage, monitoring, and retrieval will also be based on existing procedures, as well as on current and anticipated conditions when the task is to be performed. These procedures include, but are not limited to, the following:

- Procedure for personnel dosimetry issue.
- Issuance, revision, and termination of radiation work permits and standing radiation work permits.
- Procedure for roping off, barricading, and posting of radiation control zones.
- Decontamination procedure for equipment and areas.
- Smear swab sampling, counting, and calculation.
- Procedure for quantifying airborne radioactivity.

THIS PAGE IS LEFT INTENTIONALLY BLANK

7.7 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

An additional 16 TLDs will be placed around the ISFSI. These will be read as part of the existing radiological environmental monitoring program already in effect at the Prairie Island Nuclear Generating Plant. Since no effluents are expected from the ISFSI, the operation of the ISFSI will have minimal impact on the monitoring program.

THIS PAGE IS LEFT INTENTIONALLY BLANK

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 9

Page 7.8-1

7.8 REFERENCES

1. Northern States Power Company, Prairie Island Nuclear Generating Plant Updated Safety Analysis Report, Revision 10, Docket 50-282 (Unit 1) and 50-306 (Unit 2).
2. Deleted
3. Deleted
4. Deleted
5. Oak Ridge National Laboratory, ORIGEN2 Isotope Generation and Depletion Code, CCC-371, January 1987.
6. A.G. Croff, et. al., Revised Uranium - Plutonium Cycle PWR and BWR Models for the ORIGEN Computer Code. ORNL/TM-6051, Oak Ridge National Laboratory, Oak Ridge, Tennessee, September 1978.
7. Bucholz, J.A., Scoping Design Analyses for Optimized Shipping Casks Containing 1-, 2-, 3-, 5-, 7-, and 10-Year-Old PWR Spent Fuel, ORNL/CSD/TM-149, Oak Ridge National Laboratory, Oak Ridge, Tennessee, January 1983.
8. U.S. Nuclear Regulatory Commission, SCALE: A modular Code System for Performing Standardized Computer Analysis for Licensing Evaluation, ORNL/NUREG/CR-0200, Revision 3, December 1984.
9. Transnuclear, Inc., "Extended Fuel Burnup Demonstration Program Topical Report - Transport Considerations for Transnuclear Casks," DOE/ET 34014-11, White Plains, New York, December 1983.

THIS PAGE IS LEFT INTENTIONALLY BLANK

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 7.2-1

MATERIAL DISTRIBUTION IN WESTINGHOUSE 14x14 OFA FUEL ASSEMBLY

| | | MASS | | |
|------------------------------------|---|-------------|--------------|--------------|
| | | MATERIAL | kg/MTU | kg/assembly |
| <u>FUEL ZONE</u> | | | | |
| | Cladding | Zircaloy-4 | 220.6 | 83.8 |
| | Grid spacers and grid-spacer springs | Zircaloy-4 | 17.4 | 6.6 |
| | | Inconel 718 | 3.7 | 1.4 |
| | Guide Tubes | Zircaloy-4 | 19.5 | 7.4 |
| <u>FUEL-GAS PLENUM ZONE</u> | | | | |
| | Cladding | Zircaloy-4 | 10.8 | 4.1 |
| | Guide Tubes | Zircaloy-4 | 1.0 | 0.4 |
| | Spring | SS-304 | 7.3 | 2.8 |
| <u>END FITTING ZONE</u> | | | | |
| | Top End Fitting | SS-304 | 11.3 | 4.3 |
| | Hold Down Spring | Inconel 718 | 1.8 | 0.7 |
| | Bottom End Fitting | SS-304 | 11.8 | 4.5 |
| TOTAL | | | <u>305.2</u> | <u>116.0</u> |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 7.2-2

GAMMA AND NEUTRON RADIATION SOURCES
WESTINGHOUSE OFA 14x14 3.85 W/O U235
45,000 MWD/MTU, 10 YEAR COOLING TIME

| | |
|---|----------|
| Fission Product Activity (Curie/Assembly) | 1.55E5 |
| Neutron Source (n/sec/Assembly) | 2.19E8 |
| Fuel Zone Gamma Source (γ /sec/Assembly) | 2.44E15 |
| Plenum Zone Gamma Source (γ /sec/Assembly) | 1.73E11 |
| End Zone Gamma Source (γ /sec/Assembly) | 2.06E11* |

* Upper fitting (52.4%), Lower fitting (47.5%)

TABLE 7.2-3

Security-Related Information
Withheld Under 10 CFR 2.390.

TABLE 7.2-3a

Security-Related Information
Withheld Under 10 CFR 2.390.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 7.2-4

**PRIMARY GAMMA SOURCE SPECTRUM
ORIGEN2 GROUP STRUCTURE
WESTINGHOUSE OFA 14x14 3.85 W/O U235,
45,000 MWD/MTU, 10 YEAR COOLING TIME**

| AVG. ENERGY MeV | FLUX-TO-DOSE FACTOR (mrem/hr/φ) | γ/s/40 ASSEMBLIES | | | |
|--------------------|---------------------------------------|-------------------|----------------|----------------|-------------------|
| | | FUEL ZONE | PLENUM ZONE | TOP FITTING | BOTTOM FITTING |
| 0.125 | 3.26E-4 | 6.9832E15 | 1.12E9 | 1.919E9 | 1.740E9 |
| 0.225 | 5.66E-4 | 6.868E15 | 1.29E10 | 6.317E8 | 5.739E8 |
| 0.375 | 9.33E-4 | 3.191E15 | 7.65E10 | 1.769E8 | 1.607E8 |
| 0.575 | 1.31E-3 | 6.992E16 | 9.83E10 | 1.016E7 | 9.225E6 |
| 0.850 | 1.76E-3 | 6.924E15 | 2.53E7 | 3.443E9 | 3.128E9 |
| 1.25 | 2.32E-3 | 3.524E15 | 6.75E12 | 4.303E12 | 3.909E12 |
| 1.75 | 2.93E-3 | 8.204E13 | | | |
| 2.25 | 3.47E-3 | 1.394E12 | | | |
| 2.75 | 3.96E-3 | 9.940E10 | | | |
| 3.50 | 4.63E-3 | 1.322E10 | | | |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 7.2-5

**NEUTRON SOURCE DISTRIBUTION
WESTINGHOUSE OFA 14x14 3.85 W/O U235
45,000 MWD/MTU, 10 YEAR COOLING TIME**

| SCALE Group | Alpha-n Spectrum | Spontaneous Fission Spectrum | Combined Spectrum | n/sec* |
|------------------------|-----------------------------|---|------------------------------|---------------|
| 1 | 0.0 | 0.01883 | 0.01764 | 1.544E8 |
| 2 | 0.25271 | 0.20958 | 0.21231 | 1.858E9 |
| 3 | 0.52336 | 0.22657 | 0.24536 | 2.147E9 |
| 4 | 0.13084 | 0.13081 | 0.13081 | 1.145E9 |
| 5 | 0.06978 | 0.17915 | 0.17223 | 1.507E9 |
| 6 | 0.01981 | 0.19657 | 0.18538 | 1.622E9 |
| 7 | 0.00349 | 0.03849 | 0.03627 | 3.175E8 |
| | 1.0 | 1.0 | 1.00000 | 8.75E9 |

* For 40 Assemblies

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 7.2-6

PAGE 1 OF 2

PARAMETERS FOR THE SCALE 27N-18G LIBRARY
WESTINGHOUSE OFA 14x14 3.85 W/O U235
45,000 MWD/MTU, 10 YEAR COOLING TIME

| Group No. | Max Energy (eV) | Flux-Dose Factor (rem/hr/φ) | Primary Gamma* γ/sec) |
|------------------|----------------------------|--|----------------------------------|
| 1 | 2.000E+07 | 1.492E-04 | 0.000E+00 |
| 2 | 6.434E+06 | 1.446E-04 | 0.000E+00 |
| 3 | 3.000E+06 | 1.270E-04 | 0.000E+00 |
| 4 | 1.850E+06 | 1.281E-04 | 0.000E+00 |
| 5 | 1.400E+06 | 1.298E-04 | 0.000E+00 |
| 6 | 9.000E+05 | 1.028E-04 | 0.000E+00 |
| 7 | 4.000E+05 | 5.118E-05 | 0.000E+00 |
| 8 | 1.000E+05 | 1.232E-05 | 0.000E+00 |
| 9 | 1.700E+04 | 3.837E-06 | 0.000E+00 |
| 10 | 3.000E+03 | 3.725E-06 | 0.000E+00 |
| 11 | 5.500E+02 | 4.015E-06 | 0.000E+00 |
| 12 | 1.000E+02 | 4.293E-06 | 0.000E+00 |
| 13 | 3.000E+01 | 4.474E-06 | 0.000E+00 |
| 14 | 1.000E+01 | 4.568E-06 | 0.000E+00 |
| 15 | 3.050E+00 | 4.558E-06 | 0.000E+00 |
| 16 | 1.770E+00 | 4.519E-06 | 0.000E+00 |
| 17 | 1.300E+00 | 4.488E-06 | 0.000E+00 |
| 18 | 1.130E+00 | 4.466E-06 | 0.000E+00 |
| 19 | 1.000E+00 | 4.435E-06 | 0.000E+00 |
| 20 | 8.000E-01 | 4.327E-06 | 0.000E+00 |
| 21 | 4.000E-01 | 4.198E-06 | 0.000E+00 |
| 22 | 3.250E-01 | 4.098E-06 | 0.000E+00 |
| 23 | 2.250E-01 | 3.839E-06 | 0.000E+00 |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 7.2-6

PAGE 2 OF 2

PARAMETERS FOR THE SCALE 27N-18G LIBRARY
WESTINGHOUSE OFA 14x14 3.85 W/O U235
45,000 MWD/MTU, 10 YEAR COOLING TIME

| Group No. | Max Energy (eV) | Flux-Dose Factor (rem/hr/φ) | Primary Gamma: γ/sec) |
|------------------|----------------------------|--|----------------------------------|
| 24 | 1.000E-01 | 3.675E-06 | 0.000E+00 |
| 25 | 5.000E-02 | 3.675E-06 | 0.000E+00 |
| 26 | 3.000E-02 | 3.675E-06 | 0.000E+00 |
| 27 | 1.000E-02 | 3.675E-06 | 0.000E+00 |
| 28 | 1.000E+07 | 8.772E-06 | 0.000E+00 |
| 29 | 8.000E+06 | 7.478E-06 | 0.000E+00 |
| 30 | 6.500E+06 | 6.375E-06 | 0.000E+00 |
| 31 | 5.000E+06 | 5.414E-06 | 0.000E+00 |
| 32 | 4.000E+06 | 4.622E-06 | 1.322E+10 |
| 33 | 3.000E+06 | 3.960E-06 | 9.939E+10 |
| 34 | 2.500E+06 | 3.469E-06 | 1.394E+12 |
| 35 | 2.000E+06 | 3.019E-06 | 5.335E+13 |
| 36 | 1.660E+06 | 2.628E-06 | 1.035E+15 |
| 37 | 1.330E+06 | 2.205E-06 | 2.502E+15 |
| 38 | 1.000E+06 | 1.833E-06 | 4.359E+15 |
| 39 | 8.000E+05 | 1.523E-06 | 2.578E+16 |
| 40 | 6.000E+05 | 1.173E-06 | 4.904E+16 |
| 41 | 4.000E+05 | 8.759E-07 | 2.279E+15 |
| 42 | 3.000E+05 | 6.306E-07 | 4.120E+15 |
| 43 | 2.000E+05 | 3.834E-07 | 9.211E+15 |
| 44 | 1.000E+05 | 2.669E-07 | 0.000E+00 |
| 45 | 5.000E+04 | 9.347E-07 | 0.000E+00 |

*For 40 Assemblies

TABLE 7.2-7

Security-Related Information
Withheld Under 10 CFR 2.390.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 7.4-1

**DESIGN BASIS OCCUPATIONAL EXPOSURES FOR CASK LOADING,
TRANSPORT
AND EMPLACEMENT (ONE TIME EXPOSURE)**

| TASK | TIME REQUIRED (hr) | NO. OF PERSONS | DOSE RATE (rem/hr) | DOSE (man-rem) |
|---|-------------------------------|---------------------------|-------------------------------|---------------------------|
| Placement in pool (A1-A8)* | 2 | 3 | 0.005 | 0.03 |
| Loading Process (B1-B3) | 5 | 5 | 0.005 | 0.125 |
| Removal from Pool (B4-B11) | 5 | 5 | 0.030 | 0.75 |
| Transfer to Decontamination Area (B12) | 1 | 3 | 0.030 | 0.09 |
| Processing of Cask (C2-C11) | 6.5 | 2 | 0.030 | 0.39 |
| Helium Leak Test (C12) | 2 | 2 | 0.030 | 0.12 |
| Decontamination (C1) | 2 | 3 | 0.030 | 0.18 |
| Install Neutron Shield, Pressurize, Test (C13-C22) | 3 | 2 | 0.030 | 0.18 |
| Preparation for Transport (C23) | 1 | 3 | 0.030 | 0.09 |
| Transfer of Cask to ISFSI (C24) | 1 | 3 | 0.020 | 0.06 |
| Final Cask Emplacement (D1-D6) | 2 | 5 | 0.030 | 0.30 |
| TOTAL | | | | 2.315 |

* Steps from Table 5.1-1

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 7.4-2
DESIGN BASIS ISFSI MAINTENANCE OPERATIONS
ANNUAL EXPOSURES

| TASK | TIME REQUIRED (hr) | NO. OF PERSONS | DOSE RATE (mrem/hr) | PERSON-rem |
|--|-----------------------------------|---------------------------|--------------------------------|-------------------|
| Visual Surveillance of Casks ¹ | 1 | 2 | 78.8 | 0.16 |
| Instrumentation | | | | |
| a. Operability Tests ² | 1 | 2 | 1.0 | 0.002 |
| b. Calibration ³ | 2 | 2 | 1.0 | 0.002 |
| c. Repairs ⁴ | 1 | 2 | 118 | 0.24 |
| Surface Defect Repair ⁵ | 1 | 2 | 118 | 0.24 |
| Major Maintenance | 32.5 | 3 | 25.6 | 2.5 |

NOTES

1. Assumes 4 yearly surveys, 15 minutes each.
2. Based on two tests per year, 30 minutes each.
3. Based on recalibration of the instruments every 2 years (annualized).
4. Assumes repair of one instrument every year, 1 hour per repair.
5. Assumes repair of one cask every year, 1 hour per repair

TABLE 7.4-3

DELETED

TABLE 7.4-4

DELETED

TABLE 7.4-6

DELETED

FIGURE 7.4-1

DELETED

SECTION 7A

TN-40 CASK DOSE ANALYSIS

7A.1 SHIELDING DESIGN FEATURES

Shielding for the TN-40 cask is provided mainly by the thick-walled cask body. For neutron shielding, a borated polyester resin compound surrounds the cask body and a polypropylene disk covers the lid. Additional shielding is provided by the steel shell surrounding the resin layer and by the steel and aluminum structure of the basket.

Geometric attenuation, enhanced by attenuation by air and ground, and the earth filled berm provide additional shielding for distant locations at restricted area and site boundaries. Figure 7A-1 shows the configuration of shielding in the cask. Table 7A-1 lists the compositions of the shielding materials.

7A.2 SHIELDING ANALYSES

Shielding calculations for the primary gamma source are performed with the QAD-CGGP computer code (Reference 1). Neutron and capture gamma calculations are performed with the SCALE modules XSDRNPM and XSDOSE with the coupled SCALE 27n-18g cross section library (Reference 2).

A single QAD model was used for the primary gamma calculations of the top, bottom and side. This model is shown in Figure 7A-2.

Four QAD runs are performed, each utilizing one of the four source areas listed in Table 7.2-4: fuel zone, plenum, upper fitting and lower fitting. The sources are uniformly homogenized over the cavity diameter and the appropriate length, as shown in Figure 7A-2. The fuel basket is also homogenized over the cavity diameter and fuel assembly length and mixed into each source region. The basket material density is reduced by 75% in the top, bottom and plenum source zones to estimate the reduced shielding effectiveness of the basket in the axial direction. The radial resin and aluminum boxes are homogenized into a single composition based on the mass of each component. The steel encased polypropylene disk is also homogenized. The materials input for the QAD model is listed in Table 7A-2.

For the neutron and capture gamma dose on the side of the cask, a cylindrical one-dimensional model is used in XSDRNPM, as shown in Figure 7A-3. The central fuel region is considered to consist of uranium dioxide. The fuel cladding and steel basket are included in the homogenized fuel region. The fuel region is modeled as a cylinder with the actual cavity diameter. Subsequent regions are cylindrical shells corresponding to actual dimensions. The source placed uniformly in the fuel region is the source described in Table 7.2-5. The total source in the cylindrical fuel region is the same as the total source in the actual fuel region.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 13

Page 7A-2

For doses at the ends of the cask, one-dimensional plane geometry XSDRNPM models are used. The fuel region is assumed to consist of uranium dioxide, Zircaloy and steel basket, as in the cylindrical model described above. In the top end model the plenum and top end fitting are homogenized with 25% basket material density as used in the QAD model and placed above the fuel zone. A polypropylene/steel slab and a steel layer representing the protective cover are placed over the lid. The bottom end model is similar. Both configurations are shown in Figure 7A-4. Atom densities of the materials used in the XSDRNPM calculations are listed in Table 7A-3. A conservative assumption is that the axial distribution of the source is taken as uniform, while in reality, the source will be relatively low near the top and bottom of the fuel region. This is because power shape during operation is non-uniform. The angular fluxes produced by XSDRNPM are processed by XSDOSE to produce dose rates at selected points.

To evaluate doses at long distances from the cask (long by comparison to either radius or height of the cask), a spherical geometry XSDRNPM model is used. This type of model is appropriate because the source region appears to be small and central when viewed from a great distance. This reasoning is confirmed by examination of the analytical solution for dose from a shielded line source of finite height (Reference 3). At large distances, the analytical solution is equivalent to the analytical solution for a point source having the same total source as the line source (line source strength times height of line) and the same thickness of shield. The fuel region of the XSDRNPM model is taken as a sphere of radius such that the volume of the sphere is equal to the volume of the cask cavity. The total primary source contained in the sphere is that listed in Tables 7.2-4 and 7.2-5. Layers of other materials - resin, steel shells - reproduce thicknesses of materials in the actual configuration, as shown in Figure 7A-5.

The spherical geometry model does not account for the presence of the ground. At very large distances from a source, characteristic of the distance to the nominal site boundary, the dose should be reduced by a factor of two because of attenuation by the ground (References 3 and 4). The XSDRNPM model with this correction still is conservative in that attenuation in non-uniform terrain (e.g., hills), natural obstacles (e.g., trees) and manmade structures is neglected. At moderate distances characteristic of the distance to the nominal restricted area boundary, however, the spherical geometry XSDRNPM model should apply without correction because of a balance between attenuation and back-scattering by the ground. Air attenuation is ignored in using XSDOSE to determine the dose rates.

As will be seen below, this modeling, when applied, indicates satisfaction of all regulatory requirements for radiation protection by substantial margins. Side and end contact dose rates and dose rates at short distances are given in Table 7A-4.

These dose rates are modest in view of the short duration of the tasks required in handling of the storage casks. Occupational doses are well within the requirements of 10CFR20 (Reference 5) and are consistent with the 10CFR72 (Reference 6) ALARA guideline. Dose rates at long distances for a single cask are shown in Figure 7A-6.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 13

Page 7A-3

The models described above pertain to an individual storage cask. The evaluation of the ISFSI dose rates, i.e., from the array of casks, is contained in Appendix A7A

7A.3 DIRECT RADIATION N-S

The evaluation of the ISFSI dose rates, i.e., from the array of casks, is contained in Appendix A7A.

7A.4 DIRECT RADIATION E-W

The evaluation of the ISFSI dose rates, i.e., from the array of casks, is contained in Appendix A7A.

7A.5 INDIRECT RADIATION (SKYSHINE)

The evaluation of the ISFSI dose rates, i.e., from the array of casks, is contained in Appendix A7A.

7A.6 EARTH BERM

The evaluation of the ISFSI dose rates, i.e., from the array of casks, is contained in Appendix A7A.

7A.7 DOSE RATE AROUND THE ISFSI

The evaluation of the ISFSI dose rates, i.e., from the array of casks, is contained in Appendix A7A.

7A.8 EXPERIMENTAL RESULTS

The calculated dose rates for the TN-40 cask are essentially the same as for the TN-24 storage cask, which has a previously approved TSAR. A TN-24 prototype cask (TN-24P) has been fabricated and loaded with 24 Westinghouse 15x15 fuel assemblies. The assemblies had about four years cooling time with a burnup of around 30,000 MWD/MTU. Thermal and shielding tests were conducted at INEL on this loaded cask. The results are detailed in EPRI Report NP-5128 (Reference 8). The measured contact dose rates (mrem/hr) at mid height radially and at the center of the steel lid and bottom (no polypropylene disks or protective cover) were: 17g, 3n; 52g, 30n; and 145g, 90n respectively. At one meter from the surface they became, 10g, 2n; 23g, 12n; and 55g, 25n respectively. Although a direct comparison with the calculated values is difficult because of the different fuel parameters, it can be seen that the dose rates around the TN-24P cask are within expected values and therefore, the expected dose rates around the TN-40 should also compare favorably with the calculated values.

01244873

01244873

01244873

01244873

01244873

01244873

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 13

Page 7A-4

7A.9 REFERENCES

1. "QAD-CGGP - A combinatorial Geometry Version of QAD-P5A, a Point Kernel Code System for Neutron and Gamma-Ray Shielding Calculations Using the GP Buildup Factor," CCC-493, Oak Ridge National Laboratory, Oak Ridge, Tennessee, September 1986.
2. "SCALE: A Modular Code System for Performing Standardized Computer Analyses for Licensing Evaluation," ORNL/NUREG/CR-0200, U.S. Nuclear Regulatory Commission, Revision 3, December 1984.
3. Jaeger, R. G., et. al., Engineering Compendium on Radiation Shielding, Springer-Verlag, New York, 1968.
4. Schaeffer, N. M., Reactor Shielding for Nuclear Engineers, TID-25951, U.S. Atomic Energy Commission, Washington, D.C., 1983.
5. "Standards for Protection Against Radiation," 10CFR Part 20, Rules and Regulations, Title 10, Chapter 1, Code of Federal Regulations - Energy, U.S. Nuclear Regulatory Commission, Washington D.C., January 1987.
6. "Licensing Requirements for the Storage of Spent Fuel in an Independent Spent Fuel Storage Installation (ISFSI)," 10CFR Part 72, Rules and Regulations, Title 10, Chapter 1, Code of Federal Regulations - Energy, U.S. Nuclear Regulatory Commission, Washington D.C., January 1987.
7. "SKYSHINE II - Calculation of the Effects of Structure Design on Neutron Primary Gamma-Ray Dose Rates in Air," CCC-289, Oak Ridge National Laboratory, Oak Ridge, Tennessee, March 1982.
8. "The TN-24P PWR Spent-Fuel Storage Cask: Testing and Analysis," EPRI NP-5128, Electric Power Research Institute, Palo Alto, California, April 1987.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 7A-1
TN-40 CASK SHIELD MATERIALS

| COMPONENT | MATERIAL | DENSITY (g/cm³) | THICKNESS (in.) |
|--------------------------|------------------|---------------------------------------|----------------------------|
| Cask Body Wall | Carbon Steel | 7.85 | 9.50 |
| Lid | Carbon Steel | 7.85 | 10.50 |
| Bottom | Carbon Steel | 7.85 | 10.25 |
| Resin | Polyester Resin | | |
| | Styrene | | |
| | Aluminum Hydrate | | |
| | Zinc Borate | 1.58 | 4.26 |
| Aluminum Box | Aluminum | 2.7 | 0.12 |
| Outer Shell | Carbon Steel | 7.82 | 0.50 |
| Basket | Stainless Steel | 7.80 | 2 x 0.10 |
| | Aluminum | 2.7 | 2 x 0.25 |
| | Boral | 2.65 | 0.075 |
| Protective Cover | Carbon Steel | 7.85 | 0.38 |
| Polypropylene Drum | Polypropylene | 0.90 | 4.0 |
| Polypropylene Drum Shell | Carbon Steel | 7.85 | 0.25 |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 7A-2
MATERIALS INPUT FOR QAD MODEL (TN-40 CASK)

| ZONE | ELEMENT | DENSITY g/cm³ |
|-----------------------|----------------|-------------------------------------|
| Fuel Basket | Fe | 0.248 |
| | Zr | 0.349 |
| | U | 1.58 |
| | Al | 0.261 |
| Plenum/Basket | Fe | 0.062 |
| | Zr | 0.378 |
| | Al | 0.065 |
| Top Fitting/Basket | Fe | 0.802 |
| | Al | 0.065 |
| Bottom Fitting/Basket | Fe | 1.12 |
| | Al | 0.065 |
| Body, Cover, Shell | Fe | 7.85 |
| Polypropylene/Steel | C | 0.68 |
| | Fe | 0.86 |
| Resin/Aluminum | C | 0.50 |
| | O | 0.59 |
| | Al | 0.48 |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 7A-3
MATERIALS INPUT FOR XSDRNPM (TN-40 CASK)

| ZONE | ELEMENT/ NUCLIDE | LIBRARY NUMBER | DENSITY atom/b.cm |
|-----------------------|-----------------------------|---------------------------|------------------------------|
| Fuel Basket | U238 | 92238 | 3.84E-3 |
| | U235 | 92235 | 1.56E-4 |
| | O | 8016 | 8.00E-3 |
| | Zr | 40000 | 2.30E-3 |
| | Fe | 26000 | 2.67E-3 |
| | Al | 13027 | 5.83E-3 |
| Plenum/Top | Fe | 26000 | 9.32E-3 |
| Fitting Basket | Zr | 40000 | 2.50E-3 |
| | Al | 13027 | 2.90E-3 |
| Bottom Fitting/Basket | Fe | 26000 | 1.20E-2 |
| | Al | 13027 | 1.45E-3 |
| Body, Cover, Shell | Fe | 26000 | 8.46E-2 |
| Polypropylene/Steel | Fe | 26000 | 9.27E-3 |
| | C | 6012 | 3.41E-2 |
| | H | 1001 | 7.23E-2 |
| Resin/Aluminum | Al | 13027 | 1.08E-2 |
| | C | 6012 | 2.50E-2 |
| | O | 8016 | 2.23E-2 |
| | H | 1001 | 4.32E-2 |
| | BiO | 5010 | 1.64E-4 |

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 7A-4
TN-40 DOSE RATES AT SHORT DISTANCES

| LOCATION | DOSE RATE (mrem/hr) | | |
|---------------------------------|---------------------|---------|-------|
| | GAMMA | NEUTRON | TOTAL |
| <u>Radial</u> | | | |
| Contact | 45.1 | 12.4 | 57.5 |
| 1 m | 24.8 | 5.2 | 30.0 |
| 2 m | 16.8 | 2.9 | 19.7 |
| 3 m | 12.0 | 1.8 | 13.8 |
| 2 m ⁽³⁾ | 73.5 | 160.0 | 233.5 |
| <u>Top</u>⁽¹⁾ | | | |
| Contact | 23.0 | 2.6 | 25.6 |
| 2 m | 5.9 | 0.5 | 6.4 |
| <u>Top</u>⁽²⁾ | | | |
| Contact | 40.8 | 891 | 932 |
| <u>Bottom</u> | | | |
| Contact | 79.8 | 1195 | 1275 |

- (1) With polypropylene disc and protective cover in place.
- (2) Without polypropylene disc or protective cover.
- (3) Without neutron shield and outer shell.

***PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT***

Revision: 13

TABLE 7A-5

DELETED

01214873

***PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT***

Revision: 13

TABLE 7A-5a

DELETED

01214873

***PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT***

Revision: 13

TABLE 7A-5b

DELETED

01214873

***PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT***

Revision: 13

TABLE 7A-6

DELETED

01214873

***PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT***

Revision: 13

TABLE 7A-7

DELETED

01214873

TABLE 7A-8

DELETED

01214873

Security-Related Information Figure Withheld Under 10 CFR 2.390.

Rev 3 4/94

Figure 7A-1
TN-40 CASK SHIELDING
CONFIGURATION
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

TN-40 CASK SHIELDING CONFIGURATION

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY: VLS

REVISION: 3

PAGE. NO. NA

DATE: 04-25-06

FIG7A-1_REV_3

Security-Related Information Figure Withheld Under 10 CFR 2.390.


Rev 3 4/94

Figure 7A-2

QAD MODEL (TN-40 CASK)

**PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT**

QAD MODEL (TN-40 CASK)

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY: VLS
PAGE. NO. NA

REVISION: 3
DATE: 04-25-06

FIG7A-2_REV_3

Security-Related Information Figure Withheld Under 10 CFR 2.390.

Rev. 0 8/90

Figure 7A-3
XSDRN-PM RADIAL MODEL
(TN-40 CASK)
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

XSDRN-PM RADIAL MODEL (TN-40 CASK)

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY: VLS
PAGE. NO. NA

REVISION: 0
DATE: 04-25-06

FIG7A-3_REV_0

Security-Related Information Figure Withheld Under 10 CFR 2.390.

Rev. 0 8/90

Figure 7A-4
XSDRN-PM AXIAL MODELS
(TN-40 CASK)
PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

XSDRN-PM AXIAL MODEL (TN-40 CASK)

NORTHERN STATES POWER COMPANY

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY: VLS
PAGE. NO. NA

REVISION: 0
DATE: 04-25-06

FIG7A-4_REV_0

Security-Related Information Figure Withheld Under 10 CFR 2.390.


Rev. 0 8/90

Figure 7A-5 XSDRN-PM TN-40 SPHERICAL MODEL (LONG DISTANCE)

**PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT**

XSDRN-PM TN-40 SPHERICAL MODEL (LONG DISTANCE)

NORTHERN STATES POWER COMPANY



PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

DRAWN BY: VLS


REVISION: 0

PAGE. NO. NA

DATE: 04-25-06

FIG7A-5_REV_0

DOSE RATES AT LONG DISTANCES (MREM/HR)

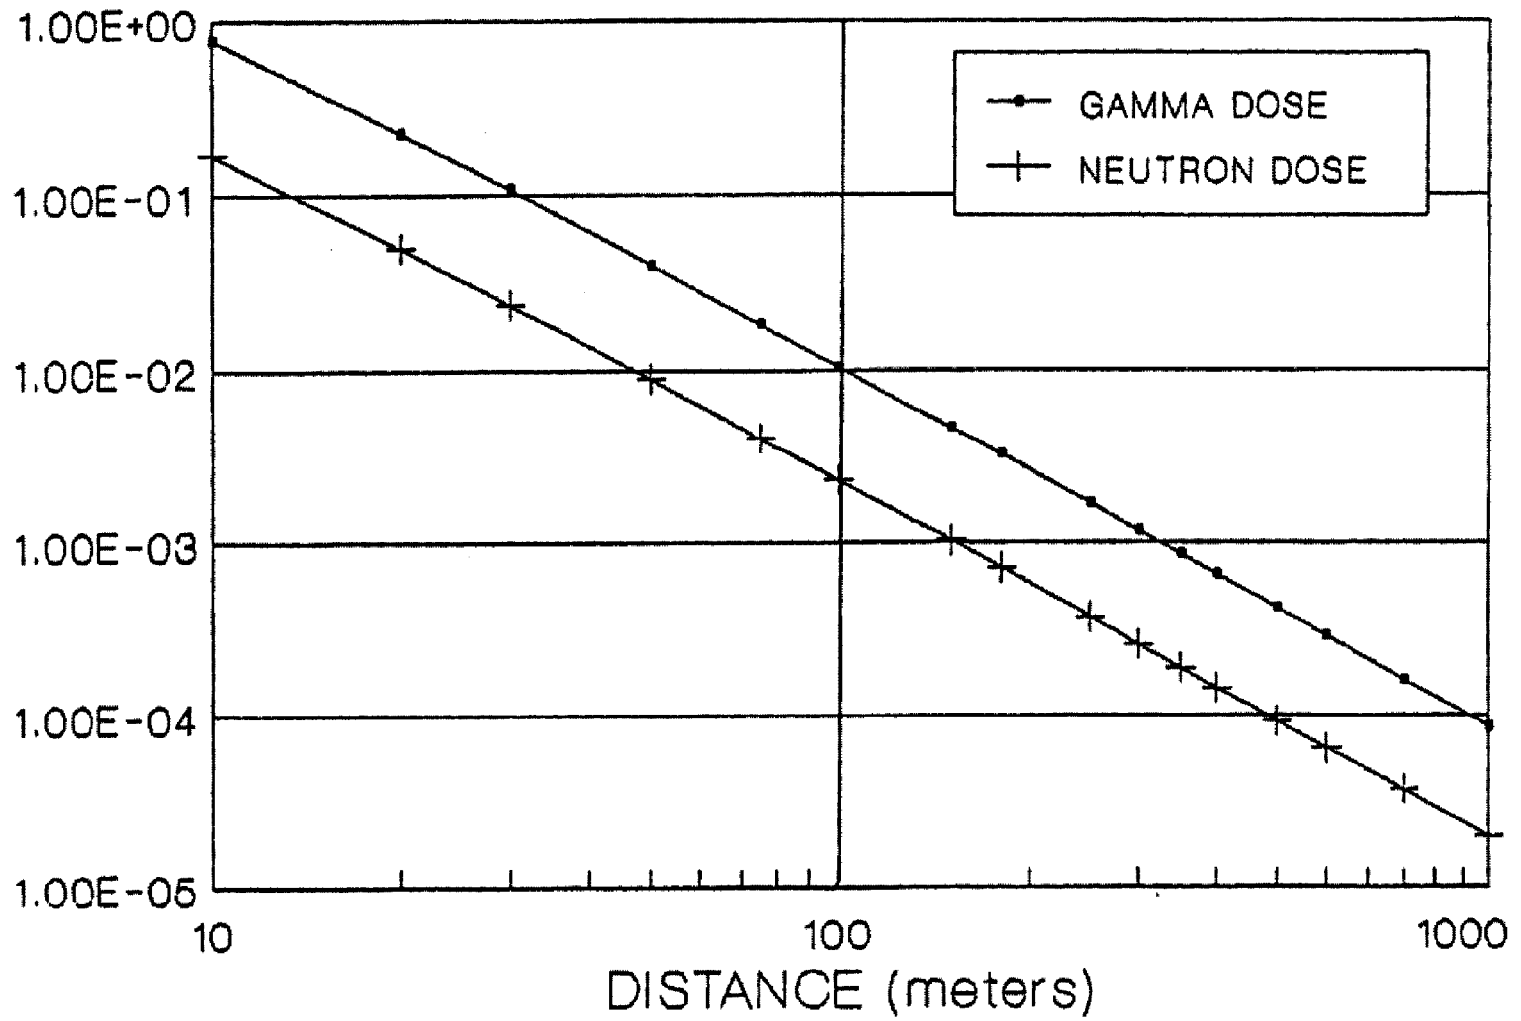

Rev. 2 9/91

Figure 7A-6
DOSE RATES AT LONG
DISTANCES (MREM/HR)
 PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

FIGURE 7A-7
DELETED

FIGURE 7A-8, REV. 2

DELETED

FIGURE 7A-9, REV. 2

DELETED

FIGURE 7A-10
DELETED

FIGURE 7A-11
DELETED

PROPRIETARY – TRADE SECRET

01301118

ISFSI SAR

APPENDIX 7B

SHIELDING EVALUATION COMPUTER INPUT

PROPRIETARY

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

PROPRIETARY – TRADE SECRET

01301118

**PROPRIETARY - TRADE SECRET INFORMATION
WITHHELD PURSUANT TO 10 CFR 2.390**

SECTION 8

ACCIDENT ANALYSIS

8.1 OFF-NORMAL OPERATIONS

Off-normal operations are design events of the second type (Design Event II) as defined in ANSI/ANS 57.9 (Reference 1). Design Event II consists of that set of events that, although not occurring regularly, can be expected to occur with moderate frequency or on the order of once during a calendar year of ISFSI operation.

Of the various types of Design Event II conditions described in Reference 1, only the loss of external power supply for a limited duration is considered to be applicable and credible to ISFSI operations. Loss of electric power as an off-normal condition is analyzed below.

8.1.1 LOSS OF ELECTRICAL POWER

A total loss of ac power is postulated to occur in the feeder cabling which supplies power to the ISFSI. The failure could be either an open or a short to ground circuit, or any other mechanism capable of producing an interruption of power.

8.1.1.1 POSTULATED CAUSE OF THE EVENT

A loss of power to the ISFSI may occur as a result of natural phenomena, such as lightning or extreme wind, or as a result of undefined disturbances in the nonsafety-related portion of the electric power system of the Prairie Island Nuclear Generating Plant.

If electric power is lost, the following systems would be de-energized and rendered nonfunctional:

- Area lighting
- Area receptacles
- Cask pressure monitoring instrumentation

8.1.1.2 DETECTION OF EVENTS

A loss of ac power at the Prairie Island Nuclear Generating Plant site would be indicated and/or alarmed in the main control room. If the loss of power were localized solely at the ISFSI, this would be detected during periodic surveillance by noting that area lighting is not operational.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 9

Page 8.1-2

8.1.1.3 ANALYSIS OF EFFECTS AND CONSEQUENCES

This event has no safety or radiological consequences because a loss of power will not affect the integrity of the storage casks, jeopardize the safe storage of the fuel, or result in radiological releases. None of the systems whose failure could be caused by this event are necessary for the accomplishment of the safety function of the ISFSI. The lighting system functions merely for convenience and visual monitoring, and the instrumentation monitors the long-term performance of the storage casks with respect to the cask seals. None of these parameters are expected to change rapidly and their status is not dependent upon electric power.

8.1.1.4 CORRECTIVE ACTION

Following a loss of electric power to the ISFSI, plant maintenance personnel will be informed and will isolate the fault and restore service by conventional means. Such an operation is straightforward and routine for the maintenance personnel of an electric utility.

8.1.2 RADIOLOGICAL IMPACT FROM OFF-NORMAL OPERATIONS

No radiological impact from off-normal operations is postulated.


8.2 ACCIDENTS

Accidents are design events of the third and fourth type (Design Events III and IV) as defined in ANSI/ANS 57.9. Design Event III consists of that set of infrequent events that could reasonably be expected to occur during the lifetime of the ISFSI.

Design Event IV consists of the events that are postulated because their consequences may result in the maximum potential impact on the immediate environs. Their consideration establishes a conservative design basis for certain systems with important confinement features.

8.2.1 EARTHQUAKE

8.2.1.1 CAUSE OF ACCIDENT

The design earthquake (DE) is postulated to occur as a design basis extreme natural phenomenon 

8.2.1.2 ACCIDENT ANALYSIS

Seismic response characteristics of the storage casks are provided in Section 3.2.3 and 4.2.3. Results of these analyses show that cask leak-tight integrity is not compromised and that no damage will be sustained.

8.2.1.3 ACCIDENT DOSE CALCULATIONS

The DE is not capable of damaging the cask. Hence, no radioactivity is released and there is no associated dose.

8.2.2 EXTREME WIND

8.2.2.1 CAUSE OF ACCIDENT

The extreme winds due to passage of the design tornado as defined in Section 3.2.1 are postulated to occur as an extreme natural phenomenon.

8.2.2.2 ACCIDENT ANALYSIS

The effects and consequences of extreme winds on the casks are presented in Section 3.2.1.

8.2.2.3 ACCIDENT DOSE CALCULATIONS

Extreme winds are not capable of overturning these casks nor of damaging their seals. Since no radioactivity is released, no resultant doses will occur.

Local damage to the neutron shield may be caused by tornado missiles. However, Table 7A-4 shows that the dose rate without any shield to be less than the allowable accident dose rate.

8.2.3 FLOOD

8.2.3.1 CAUSE OF ACCIDENT

The probable maximum flood has been calculated to reach a level of 703.6 ft., with wave action to a maximum level of 706.7 ft.

8.2.3.2 ACCIDENT ANALYSIS

The casks are designed to withstand the forces developed by the probable maximum flood without damage to cask integrity or tipping of the casks. The height of the cask seals will be above the level of the probable maximum flood and associated wave action. Accordingly no fuel damage or criticality is postulated to occur as a result of flooding. Analyses are contained in Section 3.2.2.

8.2.3.3 ACCIDENT DOSE CALCULATIONS

The probable maximum flood is not capable of overturning the casks or of damaging their seals. Therefore, no resultant doses are projected.

8.2.4 EXPLOSION

8.2.4.1 CAUSE OF ACCIDENT

A munition barge explosion has been postulated to occur at a location approximately 2600 feet from the ISFSI. This occurrence is described in detail in Section 2.2. The pressure wave of 2.25 psi is estimated to occur at the ISFSI.

8.2.4.2 ACCIDENT ANALYSIS

The cask accident analysis includes the consideration for a 2.25 psi overpressure from the postulated explosion near the ISFSI location, as described in Section 3.2.5.3.4.

8.2.4.3 ACCIDENT DOSE CALCULATIONS

The cask will not tip as a result of the postulated pressure wave. Accordingly, no cask damage or release of radioactivity is postulated. Since no radioactivity is released, no resultant doses would occur.

8.2.5 FIRE

8.2.5.1 CAUSE OF ACCIDENT

The only combustible materials in the ISFSI are in the form of insulation on instrumentation wiring, and paint on the outside surface of the storage casks. In addition, the tow vehicle will contain a small amount of gasoline or diesel fuel. No other combustible or explosive materials are allowed to be stored on the ISFSI slabs. The ISFSI area is cleared of trees. The entire area surrounding the Equipment Storage Building and concrete pad within the perimeter road is covered with crushed rock. In addition, other equipment in the area are adequately separated from the ISFSI slabs. Therefore, no fires other than small electrical fires are considered credible at the ISFSI.

8.2.5.2 ACCIDENT ANALYSIS

The ability of the cask to withstand postulated fires is addressed in Section 3.2.5.2.9 and 3.3.2.2.2.

8.2.5.3 ACCIDENT DOSE CALCULATIONS

Since no activity is released, no resultant doses would occur.

8.2.6 INADVERTENT LOADING OF A NEWLY DISCHARGED FUEL ASSEMBLY

8.2.6.1 CAUSE OF ACCIDENT

The possibility of a spent fuel assembly, with a heat generation rate greater than 0.675 kw, being erroneously selected for storage in a cask has been considered. The cause of this accident is postulated to be an error during the loading operations, e.g., wrong assembly picked by the fuel handling crane, or a failure in the administrative controls governing the fuel handling operations.

8.2.6.2 ACCIDENT ANALYSIS

The fuel assemblies require several years of storage in the spent fuel pool before the heat generation decays to a rate below 0.675 kw. This accident scenario postulates the inadvertent loading of an assembly not intended for storage in the storage canister, with a heat generation rate in excess of the design basis specified in Section 3.1.1 and 10.1.1.

In order to preclude this accident from going undetected, and to ensure that appropriate rectification actions can take place prior to the sealing of the casks, a final verification of the assemblies loaded into the casks and a comparison with fuel management records will be performed to ensure that the loaded assemblies do not exceed any of the specified limits.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 11

Page 8.2-4

These administrative controls and the records associated with them will be included in the procedures described in Chapter 9 and in the proposed license requirements described in Chapter 10, and will comply with the applicable requirements of the Quality Assurance Program described in Chapter 11.

Therefore, appropriate and sufficient actions will be taken to ensure that an erroneously loaded fuel assembly does not remain undetected. In particular, the storage of a fuel assembly with a heat generation in excess of 0.675 kw is not considered credible in view of the multiple administrative controls.

8.2.6.3 ACCIDENT DOSE CALCULATIONS

The inadvertent loading of a fuel assembly not intended for storage in a storage cask is not considered to be a credible occurrence. Therefore, no doses are postulated.

8.2.7 CASK SEAL LEAKAGE

The storage casks feature redundant seals in conjunction with an extremely rugged body design. Additional barriers to the release of radioactivity are presented by the sintered fuel pellet matrix and the Zircaloy cladding which surrounds the fuel pellets. Furthermore, the interseal gaps are pressurized in excess of the cask cavity. As a result, no credible mechanisms that could result in leakage of radioactive products have been identified. Nevertheless, a complete loss of the storage cask confinement capability is postulated in Section 8.2.9, and the results found to be negligible.

8.2.8 HYPOTHETICAL CASK DROP ACCIDENT

8.2.8.1 CAUSE OF ACCIDENT

The stability of the TN-40 storage cask in the upright position on the ISFSI concrete storage pad is demonstrated in Section 3.2 of this SAR. The effects of tornado wind and missiles, flood water and earthquakes are described in Sections 3.2.1, 3.2.2 and 3.2.3, respectively. It is shown in those sections that the cask will not tip over under the most severe natural phenomena specified in the Prairie Island Updated Safety Analysis Report. Also the cask will not slide on its pad any more than about one inch under any of these loadings.

The cask will be lifted at Prairie Island using a single failure proof crane. The trunnions are designed to the requirements of ANSI N14.6 (Reference 2) for lifting devices for critical loads with increased stress design factors. Safety factors of 6 against the trunnion yield strength and 10 against the ultimate strength are provided. In addition, the cask will be handled by the transport vehicle. The cask will always be in a vertical orientation and never lifted higher than 18 in. Therefore it is extremely unlikely that the cask could be dropped.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 11

Page 8.2-5

However, this section of the SAR considers design events of the third and fourth types (includes accidents) as defined in ANSI/ANS-57.9. The third type of events are those that could reasonably be expected to occur over the lifetime of the ISFSI (does not include dropping of the cask). The fourth type of events include severe natural phenomena (described in Section 8.2.1 through 8.2.5) and man induced low probability events postulated because their consequences could result in the maximum potential impact on the immediate environs. Therefore the cask is examined for a dropping accident, which is a hypothetical impact event that is extremely unlikely to occur.

8.2.8.2 ACCIDENT ANALYSIS

In this section the cask is evaluated under bottom end impact on the ISFSI storage pad after a drop from a height of 18 in. The storage pad is the hardest concrete surface outside of the containment building. The cask is always oriented vertically and is never lifted higher than 18 in. once it leaves the containment building. Therefore this case is an upper bound drop event since impact onto a softer surface would result in lower cask deceleration and a lower impact force.

8.2.8.2.1 DYNAMIC IMPACT LOADS

The impact analysis is based on the methodology of EPRI NP-4830 (Reference 3). This report considers the mass and geometry of the cask but assumes it to be rigid compared to the concrete storage pad. The storage pad properties and the cask geometry are used to determine the pad hardness parameter. The report provides graphs that show the force on the cask as a function of storage pad hardness.

TARGET HARDNESS

The target (or storage pad) hardness parameter, S , for the end drop case is:

$$S_{end} = \frac{2}{w^3} \frac{rAkM_u\sigma_u}{(1 - e^{-\beta r} \cos \beta r)} = 95,680 \quad (\text{formula 4, reference 3})$$

Where:

$$r = \text{cask bottom radius} = 45.5 \text{ in.}$$

$$A = \text{bottom area} = \pi r^2 = 6,504 \text{ in.}^2$$

$$k = \frac{\pi E}{1 - \nu_s^2} s = 118,200 \text{ psi/in.}$$

$$E_s = \text{Soil modulus} = 30,000 \text{ psi}$$

$$\nu_s = \text{Poisson's ratio of soil} = 0.45$$

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 11

Page 8.2-6

$M_u =$ is based on pad thickness of 36 in., #14 rebar @ 12 in. spacing (nominal), S_y rebar of 60,000 psi, 2 in. cover (nominal), σ_u of 4,000 psi max. concrete compressive strength

$$= 4.25 \times 10^6 \text{ in. lb/ft.}$$

$$\beta = 0.02686$$

$W = 240,000 \text{ lb.}$ (slightly low weight gives conservatively high hardness)

DECELERATIONS

Figure 22 for a 20 in. drop height from EPRI NP-4830 (Reference 3) can be conservatively used to determine the cask deceleration after the 18 in. end drop. The upper bound deceleration is 40 g's for a hardness parameter, S, of 95,680. The maximum impact force is then 40 times the weight of the cask. The TN-40 end impact stress analyses below are conservatively performed for a deceleration of 50 g's.

8.2.8.2.2 CASK BODY ANALYSIS

The analysis results for the hypothetical cask drop accident are reported in this section as the 18 in. bottom end drop onto the storage pad. As explained in Section 8.2.8.1, this accident has a very low probability, but in view of its potential impact on the environs, a detailed analysis was performed.

A conservative 50 g bottom drop onto the concrete pad was analyzed. The ANSYS model in Section 4A.3.2 was used to evaluate the stresses in the cask body due to the 50 g bottom drop with the following modifications:

1. Nodes 44-200 and 59-201 (See Figure 8.2-1C) are also coupled. They are coupled in the axial direction but are allowed to slide over each other in the radial and hoop directions.
2. All nodes on the outside bottom surface of the cask are fixed in the axial direction.
3. The internal loading effects are simulated by distributed pressure acting on the inside bottom surface of the cavity, as opposed to nodal forces.
4. A distributed inertial force of 50 g's was applied on each finite element in the model (See Figure 8.2-1D).

Stress results for this individual load case are reported in Figure 8.2-1A. Figure 4A.3-12 shows the locations on the cask body where stress results are reported. This case is combined with the stress results for bolt preload and internal pressure of 100 psi in Figure 8.2-1B. This case will be evaluated against the cask body criteria for a Level D event below.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 11

Page 8.2-7

8.2.8.2.3 LID BOLT ANALYSIS

The lid bolts are analyzed in this section under the loadings selected to bound those for the hypothetical bottom end drop onto the concrete storage pad.

BOTTOM END DROP

The bottom end drop from a height of 18 in. onto the concrete storage pad is analyzed above in Section 8.2.8.2.1. That section indicates that the cask deceleration may reach 40 g. This analysis conservatively examines the effects (if any) of a 50 g quasistatic loading on the lid bolts.

During a bottom end drop, the rim of the lid is forced against the flange of the cask body. The lid is initially seated against the flange by preloading (torquing) the bolts. The bolt preload will not be affected if compressive yielding of the contact bearing area does not occur.

The contact force on the bearing area, conservatively neglecting internal pressure, is the bolt preload force less the seal compression force plus the 50 g inertial force of the lid system. The preload force, from Section 4A.4.1, is 1,790,400 lb.¹ The seal seating force is 1,037,164 lb. The weight of the lid system (including shield plate and resin disk) is 15,397 lb.

Therefore, during a 50 g deceleration in the axial direction the contact force between lid and cask body is:

$$\begin{aligned} F_{\text{contact}} &= F_{\text{Bolt Preload}} - F_{\text{seal seating}} + 50 (W_{\text{lid system}}) \\ &= 1,790,400 - 1,037,164 + 50(15,397) \\ &= 1,523,086 \text{ lb.} \end{aligned}$$

Figure 8.2-7A illustrates the bearing interface between lid edge and body flange. The bearing area equals the area within the diameter of the lid raised section (77.25 in.) less that outside of the body chamber (73.29 in.) less the area of the seal groove.

$$\begin{aligned} A_{\text{bearing}} &= \frac{\pi}{4} (77.25^2 - 76.2^2 + 74.00^2 - 73.29^2) \\ &= 208.7 \text{ in.}^2 \end{aligned}$$

The bearing stress during impact is then equal to:

$$S_{\text{bearing}} = \frac{F_{\text{contact}}}{A_{\text{bearing}}} = \frac{1,523,086 \text{ lb.}}{208.7 \text{ in.}^2} = 7,229 \text{ psi}$$

¹□ Based on 25,000 psi bolt preload stress (conservative)□

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 11

Page 8.2-8

This contact stress is well below the 37,500 psi yield stress of the lid and flange material. The bolt preload will not be affected by the bottom drop. Therefore, this hypothetical accident case will not affect the bolts.

8.2.8.2.4 BASKET ANALYSIS

BOTTOM END DROP

The basket analysis is presented in detail in Appendix 4B. The analysis of the basket under vertical loading is found in Section 4B.7. The fuel assemblies react directly against the bottom of the cask in the vertical load case. They do not load the basket as in the side impact case. The fuel assemblies themselves can withstand more than 80 g as indicated in Reference 6.

The Appendix 4B analysis performed for the hypothetical 50g bottom end drop onto the concrete pad does not take credit for the aluminum strength. It is conservatively assumed that all of the load is taken by the 304 stainless steel. Therefore:

$$\sigma = \frac{\text{Total Compressive Load}}{\text{Cross Section of 304SS}}$$

On a single wall panel the stress calculated in Section 4B.7 for a 3g load would simply be $50/3 \times 304 = 5067$ psi. This 5067 psi compressive stress is acceptable since the Section 4B.5 Level D membrane stress intensity limit for 304 stainless steel is 44,900 psi at 400°F (the approximate maximum temperature at the end of the basket). In addition, axial compression tests of unsupported fuel compartment box sections described in Section 4C.2 show that the compressive stress can reach 23,000 psi before failure (even without the stiffening effects of the aluminum plates). Therefore buckling will not occur.

SHEAR STRESS IN ½ IN. FUSION PLUG WELDS

This section describes the analysis of the shear stresses at the basket plug welds due to the combination of differential thermal expansion between aluminum and stainless steel and the bottom end drop.

The thermal analysis of the basket is described in Section 3.3.2.2. The analysis determines the basket temperatures for the condition with maximum solar heating, maximum decay heat from the cask contents, and 100°F ambient air temperature. The basket temperatures were used directly in the ANSYS structural models to calculate the basket panel stresses due to differential thermal expansion. Stresses occur due to differences between the coefficients of thermal expansion of the 304 stainless, aluminum and boron (See Section 4B for detailed ANSYS model descriptions). In order

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 11

Page 8.2-9

to calculate the maximum shear stresses at the 1/2 in. plug welds, it was conservatively assumed that the 1.38 in. diameter stainless plugs that penetrate the 1.5 in. diameter hole in the aluminum (and boral) plates are not centered. The plugs were assumed to be in contact initially (at 70°F) with the opposing sides of the two holes in the aluminum (the sides toward the center of the panel) so that the maximum interference of aluminum and steel will occur when the panel is heated. In this worst plug misalignment case with the highest temperature of 530°F, seen by any portion of the basket, the weld shear stress could reach a maximum of 25,434 psi as shown on Figure 4B.6-6.

A full length compartment wall (160 in. long) with a span length of 8.05 in. is evaluated for shear stresses at the 1/2 in. plug welds due to a 50 g end drop.

Size of weld = 0.5 dia.

$$\text{Number of welds} = 2 \times 2 \times \frac{160}{8} = 80 \quad (\text{each 8'' spacing has two rows of plugs, each plug has two welds, one on each side})$$

$$\text{Shear area} = \pi/4 (0.5)^2 \times 80 = 15.71 \text{ in}^2$$

$$\text{Weight of aluminum} = 2 \times 8.05 \times 0.25 \times 160 \times 0.105 = 67.62 \text{ lbs.}$$

$$\text{Weight of boral} = 1 \times 7.50 \times 0.075 \times 160 \times 0.0903 = 8.13 \text{ lbs.}$$

$$\text{Total weight of aluminum and boral} = 75.75 \text{ lbs.}$$

Assuming the 50 g compressive load is uniformly distributed to all of the 80 welds, the shear stress is

$$\tau = \frac{75.75 \times 50}{15.71} = 241 \text{ psi}$$

Appendix F to Section III of the ASME Code (Reference 4) provides a basic $0.42 S_u$ limit on the average primary shear stress across a section loaded in pure shear for Level D conditions. The combined shear stress in the weld due to differential thermal expansion and the end drop accident is $25,434 + 241 = 25,675$ psi which is below the limit of 26,670 psi ($0.42 S_u$) based on the temperature of 530°F at the worst panel location.

Based on the results of this analysis, it is concluded that the basket is structurally adequate for withstanding the combined loads due to thermal expansion and the 18 inch end drop accident, and will properly support and position the fuel assemblies.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 11

Page 8.2-10

BASKET WELD MATERIAL TOLERANCE

The 18 inch cask end drop is the most limiting postulated event in terms of structural analysis. Achieving a tight tolerance between the aluminum plates and the stainless steel boxes at the bottom edge of the basket was considered. If the aluminum plates are recessed, the stainless steel boxes must support the load due to the end drop. In order to evaluate this possibility, an analysis was performed.

The basket was analyzed first assuming that the entire load is supported by the stainless steel, and then analyzed assuming that the entire load is supported by the aluminum.

The basket is composed of stainless steel boxes, aluminum plates and boral plates held together by plug welds every 8 inches vertically. A cross section of the basket wall is shown in Figure 4B.7-1.

The stainless steel is analyzed as a box section with a thickness of 0.10 inches and inside dimensions of 8.05 inches square. The highest loading occurs at the base of the basket, which is analyzed at a temperature of 300°F. The basket segments below the bottom welds will be stressed the most, since they are taking the entire weight of the basket. The yield stress of Type 304 stainless steel at 300°F is 22,500 psi.

The area of the box section is:

$$A = 8.25^2 - 8.05^2 = 3.26 \text{ in.}^2$$

The radius of gyration is:

$$r = 0.408d = 0.408(8.15) = 3.33 \text{ in.}$$

Assuming hinged ends, the slenderness ratio is:

$$\frac{kl}{r} = \frac{(1)(8.0)}{(3.33)} = 2.4$$

From Section NF-3322.1, equation 6a and Table NF-3523(b)1 of Reference 4, the critical stress is:

$$\begin{aligned} F_a &= 1.5S_y[0.47 - (kl/r)/444] \\ &= 1.5(22,500)\left(0.47 - \frac{2.4}{444}\right) \\ &= 15,680 \text{ psi for level C service conditions.} \end{aligned}$$

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 11

Page 8.2-11

Level C service conditions are more restrictive than level D accident conditions but are used because Appendix F for level D conditions gives no guidance for austenitic stainless steel.

The critical load applied to the box section is:

$$P_c = F_a \times A = 15,680 \times 3.26 = 51,116 \text{ lbs.}$$

The weight of the basket per box section is approximately 320 lbs. Therefore the maximum g load sustainable by the stainless steel is $51,116/320 = 160 \text{ g's}$.

This result is conservative as shown by the tests on the bare boxes presented in Section 4C. The test showed that a stress of 23,000 psi was sustainable at room temperature. This is roughly equivalent to 17,000 psi at 300°F, which results in a sustainable g load of 176 g's.

The condition where the aluminum panels are supporting the load was evaluated by assuming a stable cross section with each member bending about a common neutral axis as shown in Figure 4B.5-6. The allowable stresses were taken from Reference 7.

$$A = 0.5 \text{ in}^2/\text{in}$$

$$r = 0.1443 \text{ in.}$$

Assuming hinged ends,

$$l = 8 \text{ in.}$$

$$k = 1.0$$

$$\frac{kl}{r} = 55.44$$

If $T = 300^\circ\text{F}$, the allowable axial compression stress is:

$$F_c = 15.8 - 0.096 \text{ kl/r} = 10.48 \text{ ksi for cross sections farther than 1.0 inch from any weld, and}$$

$$F_c = 9.5 \text{ ksi for cross sections within 1.0 inch of a weld.}$$

The critical load is $9,500 \text{ psi} \times 0.5 = 4,750 \text{ lb/in.}$

The critical load per panel is $4,750 \times 8.05 = 38,237 \text{ lbs.}$

This is equivalent to a g load of $\frac{38,237}{153} = 250 \text{ g's}$

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 11

Page 8.2-12

Based on this analysis, the stainless steel members can withstand a 160 g impact load of the entire basket during the end drop. The aluminum members can withstand a 250 g impact load due to the entire weight of the basket.

Based on the analysis in Section 8.2.8.2.2 showing that the maximum g load during the end drop is less than 50 g's, the stainless steel and the aluminum panels can each withstand the end drop loading separately. Therefore the tolerance on the lengths of the steel boxes and aluminum panels is not critical.

8.2.8.3 ACCIDENT DOSE CALCULATIONS

Cask drop will not breach the cask confinement barrier. No radioactivity will be released and no resultant doses will occur. Table 7A-4 shows the calculated dose rate assuming the neutron shield and outer shell are removed.

8.2.9 LOSS OF CONFINEMENT BARRIER

8.2.9.1 CAUSE OF ACCIDENT

The following postulated accident scenario is not considered to be credible. It is hypothesized solely to demonstrate the inherent safety of the ISFSI by subjecting it to a set of simultaneous multiple failures, any one of which is far beyond the capability of natural phenomena or man-made hazards to produce. A simultaneous failure of all protective layers of confinement is postulated to occur by unspecified nonmechanistic means in the cask.

8.2.9.2 ACCIDENT ANALYSIS

In this accident, the confinement function is nonmechanistically removed. Heat removal and radiation shielding functions operate in the normal passive manner.

This is equivalent to breaking the cask seal barriers (no release), removing the closure lids (no release), failing all the cladding in all the loaded fuel assemblies (gap activity release), and finally, failing the fuel pellets themselves such that the remaining Kr-85 is released from the fuel matrix.

8.2.9.3 ACCIDENT DOSE CALCULATIONS

Table 7.2-7 lists the nuclides present in a cask containing 40 design basis fuel assemblies. The only nuclide listed in Table 7.2-7 which naturally occurs in the gaseous state, which could escape from the cask following a postulated breach of cask confinement barrier and which would be a significant dose contributor, is Kr-85.

All of the Kr-85 gas is conservatively assumed to be instantaneously released from the TN-40 cask. There is no additional decay of Kr-85 in transit from the spent fuel storage cask to the receptor and no credit is taken for personnel protection due to any structure or system.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 11

Page 8.2-13

The maximum individual is assumed to be located at the site boundary where the least amount of atmospheric dispersion takes place (largest χ/Q value). The dose results for this location are conservative for any individual (maximum) and may be reported as dose to an individual at the nearest site boundary.

The site boundary χ/Q values were calculated as described in Section 2.3.4 and shown on Table 2.3-1.

As shown on Table 7.2-7, there are 9.67E4 Curies of Kr-85 activity in the TN-40 spent fuel cask following 10 years of fuel decay. The gamma (whole body) dose conversion factor (K) for Kr-85 is 1.9 rem/hr per Ci/cu. meter. The atmospheric dispersion factors for ground level release were calculated as described in Section 2.3.4.

Dose evaluations were performed based on Regulatory Guide 1.3 (Reference 5) methodology and equations.

The offsite radiological consequences of a postulated loss of spent fuel cask confinement barrier for a cask located at the ISFSI are provided in Table 8.2-1 and plotted in Figure 8.2-33.

The nearest site boundary or maximum individual whole body dose for the loss of spent fuel cask confinement barrier is determined to be 0.15 rem. This dose is well within the 5 rem criteria given in 10CFR72.106(b)

THIS PAGE IS LEFT INTENTIONALLY BLANK

8.3 SITE CHARACTERISTICS AFFECTING SAFETY ANALYSIS

Site characteristics have been considered in the formation of the bases for these safety analyses. Conservative assumptions concerning meteorology were used in the determination of λ/Q . The characteristics of extreme winds and their contribution to maximum flood level were considered. Regional and site seismology and geology were used to help define the design earthquake acceleration value and analyze for liquefaction potential. Population distribution and other demographic data were used to determine radiation doses.

Other site characteristics affecting safety analyses include the proximity to the Mississippi River to the ISFSI assumptions concerning barge traffic was used to develop the bases for the explosion (Section 8.2.4).

THIS PAGE IS LEFT INTENTIONALLY BLANK

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 9

Page 8.4-1

8.4 REFERENCES

1. American Nuclear Society, ANSI/ANS-57.9, Design Criteria for an Independent Spent Fuel Storage Installation (Dry Storage Type), 1984.
2. American National Standards Institute, ANSI N14.6, Special Lifting Devices for Shipping Containers Weighing 10,000 pounds or More, 1986.
3. Electric Power Research Institute, Report No. NP-4830, The Effects of Target Hardness on the Structural Design of Concrete Storage Pads for Spent-Fuel Casks, October 1986.
4. American Society of Mechanical Engineers, ASME Boiler and Pressure Vessel Code, Section III, 1989.
5. U.S. Nuclear Regulatory Commission, Regulatory Guide 1.3, Assumptions Used for Evaluating the Potential Radiological Consequences of a Loss of Coolant Accident for Boiling Water Reactors, Revision 2, June 1974.
6. Chun, R., Witte, M. and Schwartz, Dynamic Impact Effects on Spent Fuel Assemblies, Lawrence Livermore National Laboratory Report UCID-21246, Oct. 20, 1987.
7. American Society of Mechanical Engineers, ASME B96.1, Welded Aluminum Alloy Storage Tanks, 1989.

THIS PAGE IS LEFT INTENTIONALLY BLANK

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT

Revision: 9

TABLE 8.2-1

RADIOLOGICAL CONSEQUENCES – LOSS OF CONFINEMENT BARRIER

| LOCATION | DISTANCE (MILES) | $\frac{x}{Q}$ (SEC/CU. METER) | DOSE FACTOR (REM-SEC PER CU. METER) | DOSE (REM) |
|-------------------|---------------------|----------------------------------|--|---------------|
| Max. Individual* | 0.068 | 6.63E-03 | 51.04 | 3.38E-01 |
| Max. Individual** | 0.11 | 2.95E-03 | 51.04 | 1.50E-01 |
| 1 | 0.5 | 2.23E-04 | 51.04 | 1.14E-02 |
| 2 | 1.5 | 7.45E-05 | 51.04 | 3.80E-03 |
| 3 | 2.5 | 4.54E-05 | 51.04 | 2.32E-03 |
| 4 | 3.5 | 3.24E-05 | 51.04 | 1.65E-03 |
| 5 | 4.5 | 2.50E-05 | 51.04 | 1.28E-03 |
| 6 | 7.5 | 1.46E-05 | 51.04 | 7.45E-04 |
| 7 | 15 | 6.84E-06 | 51.04 | 3.49E-04 |
| 8 | 25 | 4.35E-06 | 51.04 | 2.22E-04 |
| 9 | 35 | 3.94E-06 | 51.04 | 2.01E-04 |
| 10 | 45 | 3.67E-06 | 51.04 | 1.87E-04 |

*Located at nearest site boundary distance of 110 meters from the western edge of the ISFSI concrete pads.

**Located at nearest site boundary distance of 180 meters from a central point between the two ISFSI concrete pads.

***PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION
SAFETY ANALYSIS REPORT***

Revision: 9

THIS PAGE IS LEFT INTENTIONALLY BLANK

FIGURE 8.2-1, REV. 1

DELETED

| LOCATION | | MERIDIONAL STRESS (PSI) | | HOOP STRESS (PSI) | | STRESS INTENSITY SI (PSI) |
|--|----|-------------------------|-------------|-------------------|--------------|---------------------------|
| | | OUTER SIGBS | INNER SIGTS | OUTER SIGBTH | INNER SIGTTH | |
| CONTAINMENT VESSEL | 1 | | 1543 | | 1016 | 2526 |
| | 2 | -504 | | 23 | | 527 |
| | 3 | | -1910 | | -4 | 1906 |
| | 4 | 2954 | | 1110 | | 2954 |
| | 5 | | -1509 | | -42 | 1509 |
| | 6 | -1508 | | -42 | | 1508 |
| | 7 | | -442 | | -12 | 442 |
| | 8 | -983 | | -174 | | 983 |
| | | STRESS COMPONENTS (PSI) | | | | STRESS INTENSITY SI (PSI) |
| | | Sx | SY | Sz | Sxy | |
| CONTAINMENT FLANGE & LID | 9 | -105 | -96 | -181 | -99 | 198 |
| | 10 | -62 | -334 | -76 | 102 | 340 |
| | 11 | 1266 | -17 | 1264 | -34 | 1285 |
| | 12 | -3106 | -136 | -3119 | -180 | 2995 |
| NON CONTAINMENT GAMMA SHIELDING TRUN- TION WELDS | 13 | 145 | -1049 | 95 | -28 | 1197 |
| | 14 | 105 | -1069 | 98 | 3 | 1174 |
| | 15 | -1 | -1321 | 5 | -1 | 1327 |
| | 16 | 20 | -1328 | 3 | -1 | 1331 |
| | 17 | 1 | -657 | 48 | 7 | 706 |
| | 18 | -14 | -3445 | -467 | 9 | 3431 |
| | 19 | 22 | 209 | 94 | 18 | 190 |
| | 20 | 3661 | 533 | 1202 | 1185 | 3925 |

Rev 3 4/94

Figure 8.2-1A
HYPOTHETICAL ACCIDENT -
50G BOTTOM DROP ON
CONCRETE PAD (50G'S)

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

HYPOTHETICAL ACCIDENT - 50G BOTTOM DROP ON CONCRETE PAD (50G'S)

| LOCATION | | STRESS INTENSITY S.I. (PSI) | | | | ΣS.I. (a) PSI | TOTAL FOR BOLT PRELOAD = 51k ΣS.I. (b) PSI | |
|------------------------------------|--------------------|--------------------------------|----------------------|----------------|-------|------------------|---|-------|
| | | BOLT PRELOAD _(a) | INTERNAL PRESSURE | BOTTOM DROP | | | | |
| CONTAINMENT VESSEL | 1 | 137 | 433 | 10868 | | 11438 | 11580 | |
| | 2 | 52 | 311 | 1476 | | 1839 | 1893 | |
| | 3 | 2148 | 4248 | 42864 | | 49260 | 51494 | |
| | 4 | 1428 | 4385 | 52299 | | 58112 | 59597 | |
| | 5 | 343 | 736 | 3778 | | 4857 | 5214 | |
| | 6 | 342 | 590 | 3779 | | 4711 | 5067 | |
| | 7 | 2444 | 405 | 2391 | | 5240 | 7782 | |
| | 8 | 1857 | 915 | 8131 | | 10903 | 12834 | |
| CON'MNT FLANGE & LID | 9 | 2347 | 593 | 1271 | | 4211 | 6652 | |
| | 10 | 2369 | 464 | 2700 | | 5533 | 7997 | |
| | 11 | 1284 | 839 | 1375 | | 3498 | 4833 | |
| | 12 | 2091 | 2034 | 2839 | | 6964 | 9139 | |
| NON CONTAINMENT | GAMMA SHIELDING | 13 | 246 | 1216 | 20715 | | 22177 | 22433 |
| | | 14 | 265 | 1413 | 18970 | | 20648 | 20924 |
| | | 15 | 59 | 462 | 1091 | | 1612 | 1673 |
| | | 16 | 59 | 310 | 1070 | | 1439 | 1500 |
| | TRUN NION | 17 | 45 | 370 | 316 | | 731 | 778 |
| | | WELDS | 18 | 568 | 2031 | 24132 | | 26731 |
| | 19 | | 2987 | 1200 | 3402 | | 7589 | 10695 |
| | 20 | | 5754 | 2549 | 3924 | | 12227 | 18211 |
| CONTAINMENT ALLOWABLE STRESS | | HYPOTHETICAL ACCIDENT LOAD | | | | | | |
| | | COMBINATION $P_m < 2.4 S_m =$ | | | | 42.000 | | |
| $(P_l + P_b) < 3.6 S_m =$ | | | | | | 63,000 | | |

(a) CORRESPOND TO 25,000 psi BOLT PRELOAD STRESS

$$(b) \text{ TOTAL} = \Sigma \text{S.I.} + \text{BOLT PRELOAD} \times \left(\frac{51}{25} - 1 \right)$$


Rev. 5 10/96

Figure 8.2-1B

HYPOTHETICAL ACCIDENT -
LOAD COMBINATION (1)

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT

HYPOTHETICAL ACCIDENT - LOAD COMBINATION (1)

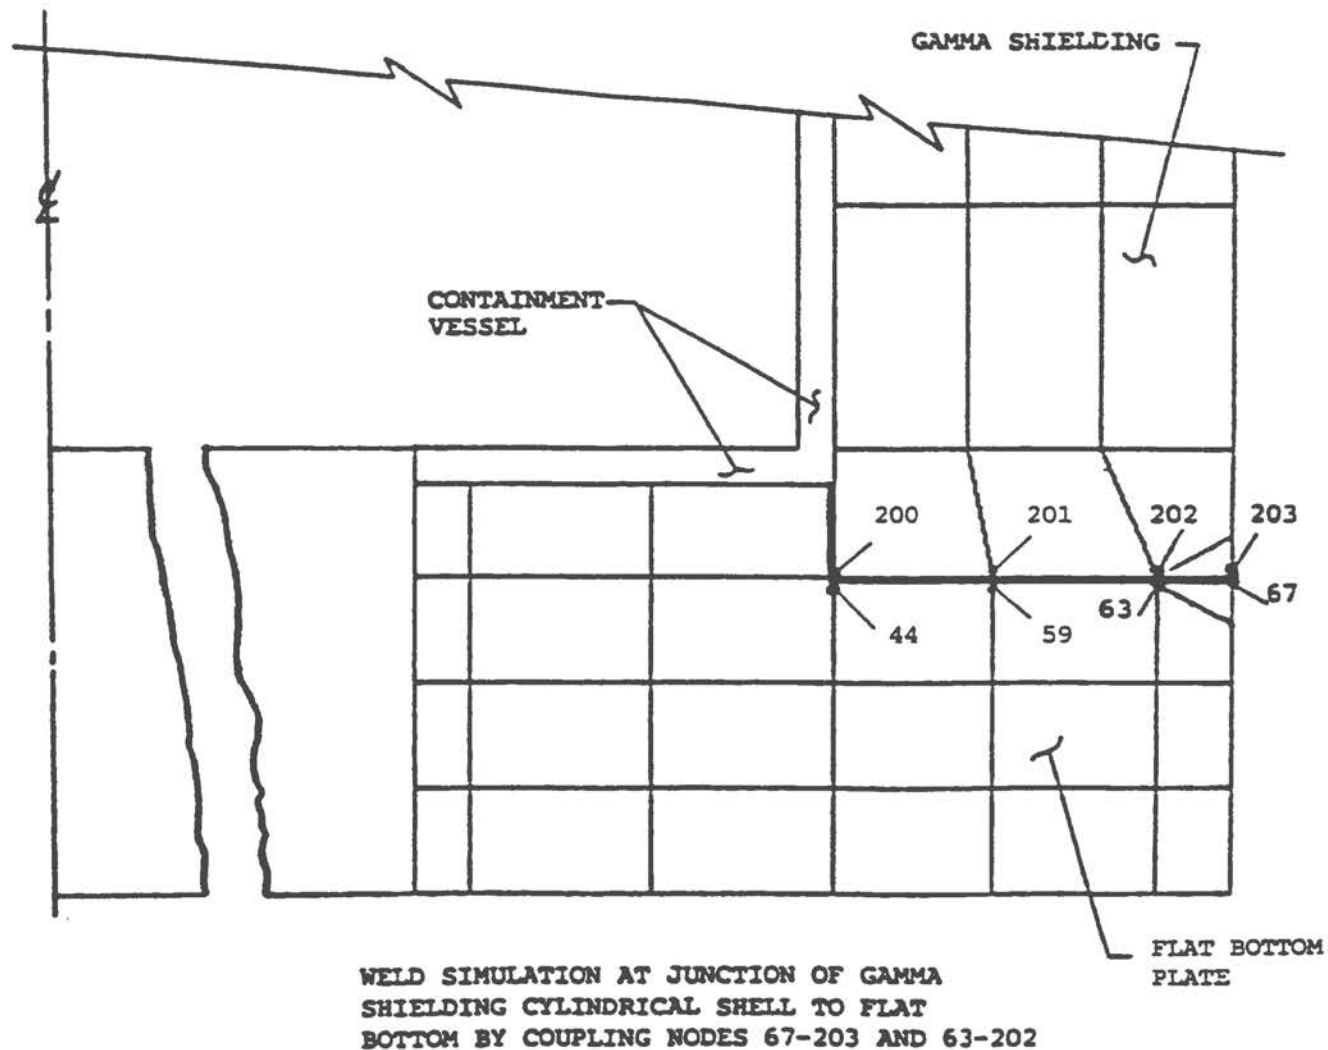

Rev 3 4/94

Figure 8.2-1C
TN-40 CASK BODY BOTTOM CORNER
50G BOTTOM DROP

PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT


TN-40 CASK BODY BOTTOM CORNER 50G BOTTOM DROP

W = Total weight of Cask
 (Based on 250,000#)
 - Total Weight of Internals
 (Based on 80,105#)
 = 169895#

P_i = Pressure on containment bottom
 inner surface due to weight of
 internals

$$= \frac{80,105}{\pi \times 36^2}$$

 = 19.67 psi

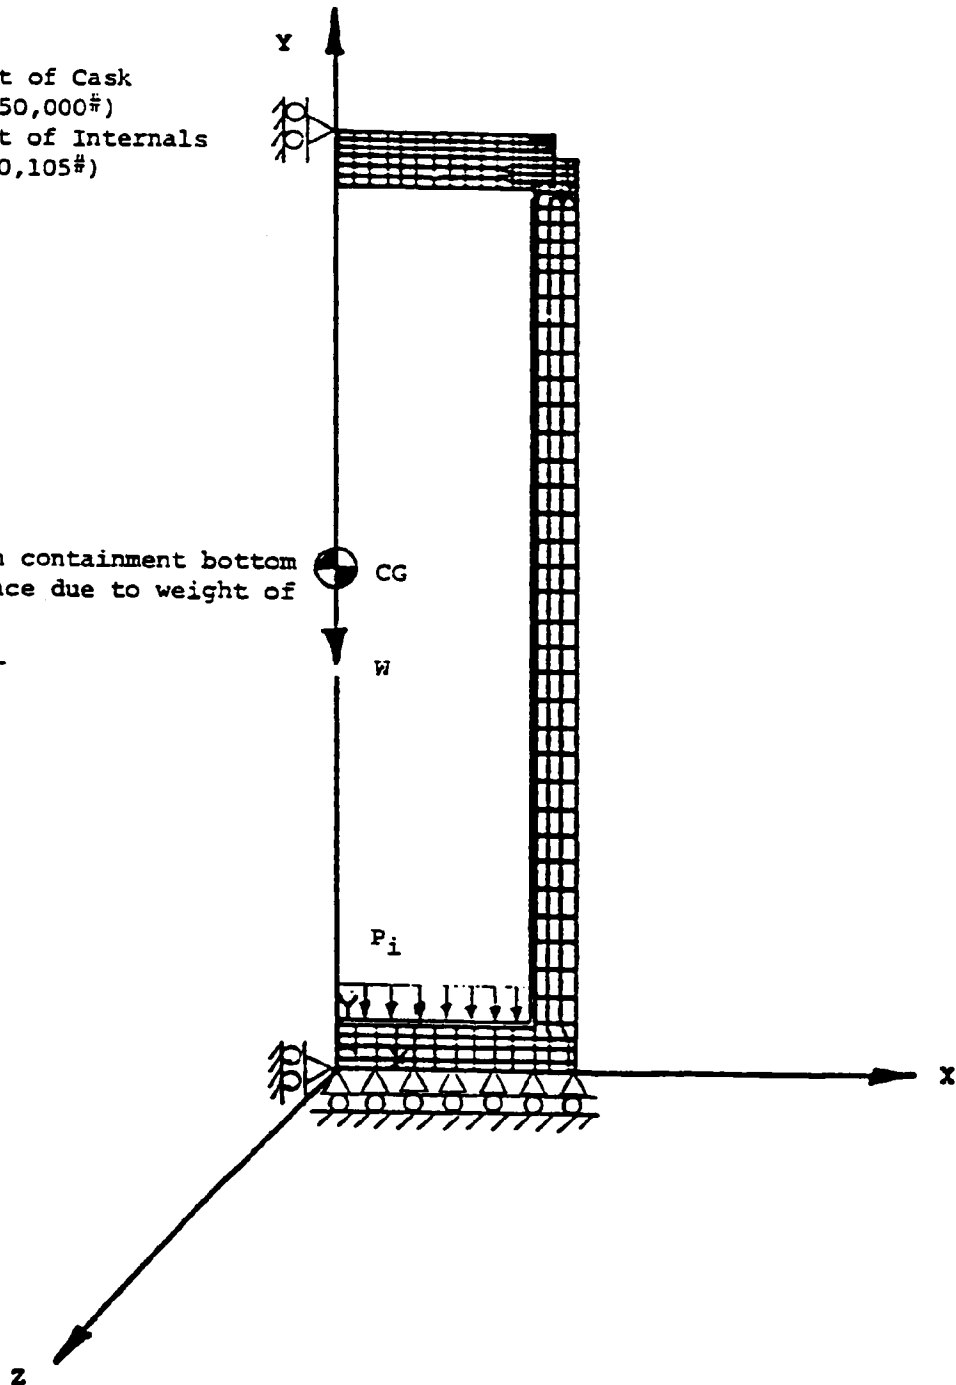

Rev 3 4/94

Figure 8.2-1D
TN-40 50G DOWN LOADING
& BOUNDARY CONDITIONS

PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

TN-40 50G DOWN LOADING & BOUNDARY CONDITIONS

FIGURE 8.2-2, REV. 1

DELETED

| CROSS SECTION | | DIRECT STRESS | BOLT PRELOAD _(a) | INTERNAL PRESSURE | HYPOTHETICAL ACCIDENT | PRINCIPAL STRESSES $\Sigma_{(a)}$ | PRINCIPAL STRESSES Σ (DUE TO BOLT PRELOAD _(b) =51k) |
|---------------|-------------------|-------------------|-----------------------------|-------------------|-----------------------|-----------------------------------|--|
| 3-4 | BOTTOM DROP COMB. | MERIDONAL S DIR S | -360 | -119 | 4349 | 3870 | 3496 |
| | | HOOP S DIR TH | -174 | -119 | 4380 | 4087 | 3906 |

$$SI = 4087 \text{ psi} < 2.4 S_m = 42,000 \text{ psi}$$

(a) CORRESPOND TO 25,000 psi PRELOAD STRESS

$$(b) \text{ TOTAL} = \text{PRINCIPAL STRESS } \Sigma + \text{BOLT PRELOAD} \times \left(\frac{51}{25} - 1 \right)$$

REV. 8 10/99

Figure 8.2-5

**MEMBRANE STRESS INTENSITY
AT SECTION 3-4 (TN-40 CASK)**

**PRAIRIE ISLAND ISFSI
SAFETY ANALYSIS REPORT**

MEMBRANE STRESS INTENSITY AT SECTION 3-4 (TN-40 CASK)

FIGURE 8.2-20, REV. 1


DELETED

FIGURE 8.2-21, REV. 1

DELETED

FIGURE 8.2-22, REV. 1

DELETED

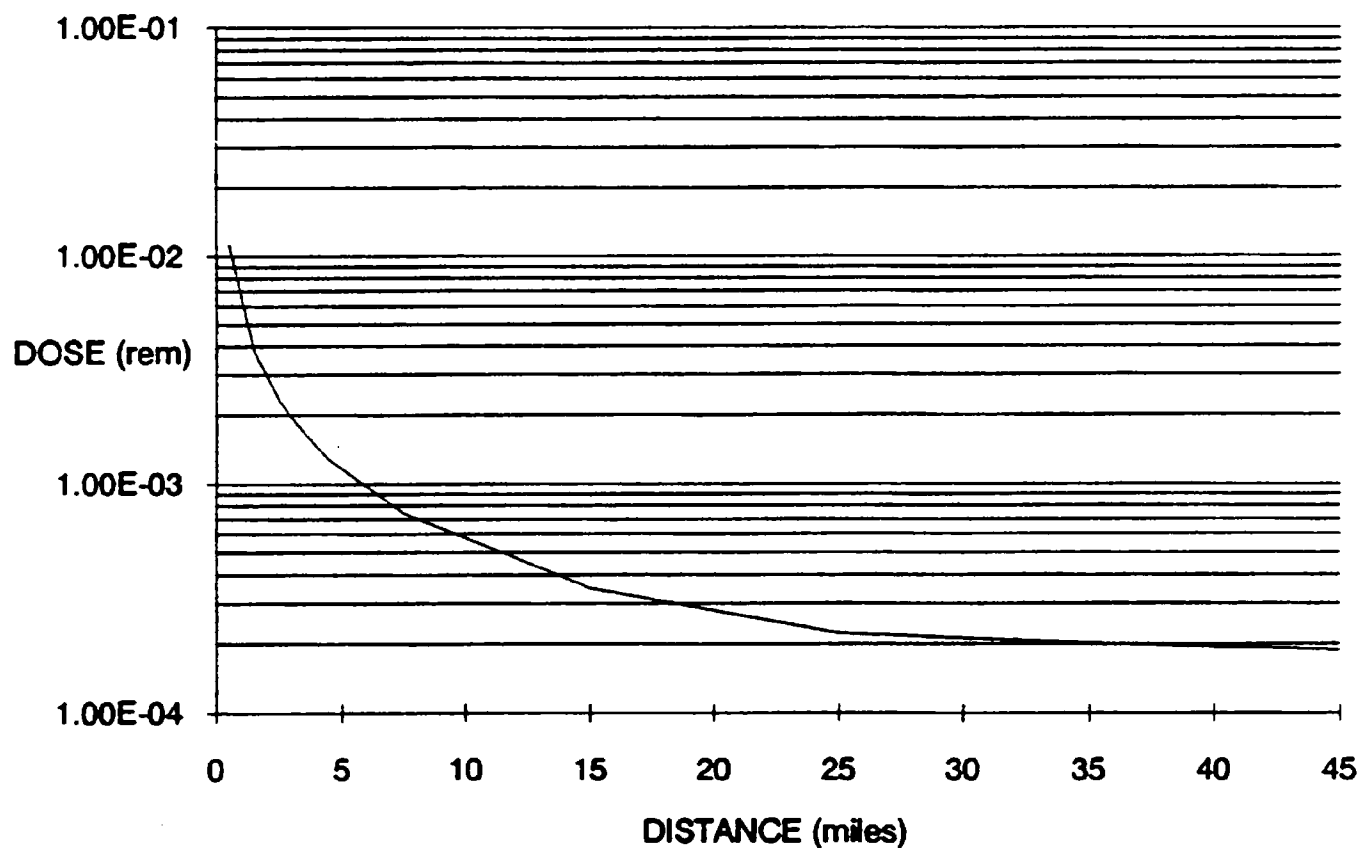

NOTE:

1. DOSES CALCULATED BASED UPON LOSS OF CONFINEMENT BARRIER OF TN-40 CASK WITH 40 FUEL ASSEMBLIES AS SPECIFIED IN SECTION 3.1.1

Rev. 0 8/90

Figure 8.2-33
DOSE VS. DISTANCE AT POPULATION
SECTOR MIDPOINT DISTANCES
BETWEEN 0 AND 50 MILES
 PRAIRIE ISLAND ISFSI
 SAFETY ANALYSIS REPORT

DOSE VS. DISTANCE AT POPULATION SECTOR MIDPOINT DISTANCES BETWEEN 0 AND 50 MILES

SECTION 9**CONDUCT OF OPERATIONS****9.1 ORGANIZATIONAL STRUCTURE****9.1.1 CORPORATE ORGANIZATION****9.1.1.1 CORPORATE FUNCTIONS, RESPONSIBILITIES AND AUTHORITIES**

Northern States Power Company was incorporated in Minnesota as a wholly owned subsidiary of Xcel Energy, Inc. Figure 9.1-1 illustrates the NSPM corporate organization. The NSPM corporate organization is fully described in Chapter 13 of the Prairie Island USAR (Reference 1). All activities at Prairie Island Nuclear Generating Plant are the responsibility of the NSPM Chief Nuclear Officer (CNO).

The Plant Manager is responsible for operational activities at the Prairie Island Nuclear Generating Plant. He is also responsible for operation of the Prairie Island ISFSI.

9.1.1.2 ISFSI PROJECT ORGANIZATION

The project team responsible for engineering and design, procurement, construction, quality assurance, and testing of the Prairie Island ISFSI is shown in Figure 9.1-3.

The Project Manager - Dry Cask Storage at Prairie Island is responsible for activities relating to engineering and design, procurement, construction, quality assurance, and testing of the Prairie Island ISFSI.

Quality Assurance is provided as described in the Northern States Power Company Operational Quality Assurance Plan. The Project Manager - Dry Cask Quality Assurance for Prairie Island is responsible for quality assurance activities during design and construction.

9.1.1.3 RELATIONSHIP WITH CONTRACTORS AND SUPPLIERS

The Project Manager is the primary interface with the cask supplier, architect-engineer, and other equipment vendors. The Construction Superintendent is the primary interface with construction subcontractors.

9.1.1.4 TECHNICAL STAFF

The engineering technical staff, under the direction of the Project Manager, is responsible for development of design criteria associated with procurement of the storage casks and engineering services. The technical staff is also responsible for review of cask, transporter, and other ISFSI design documentation provided by the cask vendor, Transnuclear, and the architect-engineer, Stone & Webster.

9.1.2 OPERATING ORGANIZATION, MANAGEMENT AND ADMINISTRATIVE CONTROL SYSTEM

9.1.2.1 ONSITE ORGANIZATION

Figure 9.1-2 illustrates the onsite organization at Prairie Island Nuclear Generating Plant. Figure 9.1-4 illustrates the organization responsible for cask operation. The Plant Manager will be responsible for operations at the ISFSI. The various superintendents and staff members will have functional responsibility for operations, maintenance, and radiation protection. In addition, an engineer in the Nuclear Engineering Group has been assigned the responsibility of interfacing with the Project Manager during design, construction, and operation of the ISFSI.

9.1.2.2 PERSONNEL FUNCTIONS, RESPONSIBILITIES AND AUTHORITIES

The Prairie Island USAR, Section 13.2 provides a general description of personnel functions, responsibilities, and authorities of the onsite organization. Due to the passive nature of the ISFSI, it is expected that the existing organization can accommodate the additional responsibilities associated with ISFSI operation without the need for additional staff.

9.1.3 PERSONNEL QUALIFICATION REQUIREMENTS

9.1.3.1 MINIMUM QUALIFICATION REQUIREMENTS

Each member of the plant staff is required to meet or exceed the minimum qualifications of ANSI 18.1-1971 as noted in the applicable section of the Technical Specifications. Training and retraining programs are conducted to maintain a qualified staff of technical and operations personnel. The training program is under the direction of the Plant Manager.

9.1.3.2 QUALIFICATIONS OF PERSONNEL

Qualifications of personnel assigned to managerial and technical positions are set forth in the Prairie Island USAR, Section 13.2.

9.1.4 LIAISON WITH OUTSIDE ORGANIZATIONS

Stone & Webster, as architect-engineer, provided engineering expertise required to design the ISFSI structures and foundations and developed specifications for use in procurement of the cask transporter and other equipment. Transnuclear is providing technical expertise required in the design, fabrication, and delivery of the casks.

The Project Manager is responsible for directing the activities of these contractors and for procuring equipment and services of other contractors.

9.2 STARTUP TESTING AND OPERATION

9.2.1 ADMINISTRATIVE PROCEDURES FOR CONDUCTING TEST PROGRAM

The administrative procedures for the ISFSI will be the same as those used for the Prairie Island Nuclear Generating Plant. Any changes to, or deviations from, these procedures and instructions will be reviewed and approved by the Station Operations Committee as appropriate.

9.2.2 TEST PROGRAM DESCRIPTION

9.2.2.1 PHYSICAL FACILITIES

Before startup and during the lifetime of the ISFSI, the cask monitoring instrumentation, the electrical system, the communications system, and the storage casks will be tested to ensure their proper functioning.

The cask monitoring instrumentation alarms will be tested to ensure that individual alarm signals annunciate at the local annunciator enclosure at the ISFSI location.

The electrical system will be tested to ensure that power is available for the cask monitoring instrumentation and the local annunciator. The lighting and service receptacles are also tested for proper operation.

The communications system will be tested to ensure that the telephone at the local annunciator is properly connected into the plant phone system.

The storage casks will be tested with a dummy fuel assembly prior to fuel loading to ensure that the assemblies will fit properly.

The seals of the casks will be inspected prior to and tested following fuel loading.

9.2.2.2 OPERATIONS

Testing and calibration of instruments and components in use at the ISFSI will be done in accordance with procedures established for similar equipment in use at the Prairie Island Nuclear Generating Plant. Acceptance criteria and corrective actions for test margins and response times will be specified by the equipment vendors.

9.2.3 TEST DISCUSSION

The preoperational test purposes, responses, acceptance criteria, margins, and corrective actions are discussed in Section 9.2.2. Instrumentation, electrical, and communications equipment will be functionally tested to confirm operability.

9.2.4 COMPLETION OF PRE-OPERATIONAL TEST PROGRAM

Preoperational testing of the Prairie Island ISFSI was completed on April 15, 1995. Pursuant to the requirements of 10CFR72.82(e), a report of the preoperational test acceptance criteria and test results was submitted to the NRC by Reference 3.

9.3 TRAINING PROGRAM

The training program has the objective of providing and maintaining a well qualified work force for safe and efficient operation of the ISFSI. The existing Prairie Island Nuclear Generating Plant training program will be used to provide this training and indoctrination. Additional sections to this program will be added as needed to include information pertinent to the ISFSI. Training courses will be prepared by training center personnel in cooperation with engineering personnel qualified in the particular topical or functional area. All personnel working in the fuel storage area will receive radiation and safety training and those actually performing cask and fuel handling functions will be given additional training in specific areas as required by the Radiation Protection program in effect at the Prairie Island Nuclear Generating Plant. The retraining schedule will be consistent with retraining requirements in effect for personnel involved in fuel handling operations.

Training records will be maintained for 5 years. Such records will include dates and hours of training and other documentation on training subjects, information on physical requirements, job performance statements, copies of written examinations, information pertaining to walk-through examinations, and retesting particulars.

9.4 NORMAL OPERATIONS

9.4.1 PROCEDURES

Detailed written procedures for all normal operating, maintenance, and testing procedures will be prepared and will be in effect prior to operation of the ISFSI. These procedures are briefly described in Section 9.4.1.1 through 9.4.1.8.

These initial procedures were reviewed and approved by the cognizant superintendent and the Plant's Operations Committee. Any later revisions necessitated by operational experience, changes to systems and components, new requirements, clerical errors, etc., will be reviewed by a Qualified Reviewer.

01372903

9.4.1.1 ADMINISTRATIVE PROCEDURES

Administrative procedures will provide rules and instructions to all ISFSI personnel to provide a clear understanding of operating philosophy and management policies. These procedures include instructions pertaining to personnel conduct and control, including consideration of job-related factors, e.g., work hours, entering and exiting the ISFSI, organization, and responsibility, etc.

9.4.1.2 ANNUNCIATOR RESPONSE GUIDES

Annunciator response guides will provide information relative to each alarm annunciator which monitors cask and fuel parameters. The procedures will provide alarm set points and appropriate corrective action.

9.4.1.3 RADIATION PROTECTION PROCEDURES

Radiation protection procedures are used to implement a radiation control program. The radiation control program will involve the acquisition of data and provision of equipment to perform necessary radiation surveys, measurements, and evaluations for the assessment and control of radiation hazards associated with the operation of the ISFSI. Procedures will be developed and implemented for: monitoring exposures of employees, utilizing accepted techniques, radiation surveys of work areas, radiation monitoring of maintenance activities, and for records maintenance demonstrating the adequacy of measures taken to control radiation exposures of employees and others within prescribed limits and as low as practicable.

Entrance to the ISFSI and all work performed inside will require a radiation work permit and will be controlled by radiation protection personnel. Existing radiation protection procedures will be revised, where applicable, prior to operation of the ISFSI. The revised procedures will ensure safety of personnel performing surveillance and maintenance at the ISFSI.

Regularly scheduled surveillance will be required, but calculations have shown that doses received by personnel from all anticipated activities are within the guidelines set forth in 10CFR20. There are no credible events during normal storage that could lead to a high radiation condition (as defined by PINGP Operations manual, F2, Reference 2) at the ISFSI. Accident analyses in Chapter 8 also show no credible event leading to the high radiation release during transport, placement, or storage. In the unlikely event that maintenance on the cask involving cask integrity is to be performed, the cask would be returned to the Prairie Island Nuclear Generating Plant and the work performed inside the Auxiliary Building.

9.4.1.4 MAINTENANCE PROCEDURES

Maintenance procedures will be established for performing preventative and corrective maintenance on ISFSI equipment. Preventative maintenance will be performed on a periodic basis to preclude the degradation of ISFSI systems, equipment, and components. Corrective maintenance is that performed to rectify any unexpected system, equipment, or component malfunction, and is initiated as the need arises.

9.4.1.5 OPERATING PROCEDURES

The operating procedures will provide instructions for handling, loading, sealing, transporting, and storing the ISFSI casks.

9.4.1.6 TEST PROCEDURES

Periodic test procedures will be formulated to ensure that ISFSI systems, equipment, and components are observed on a routine basis to verify operability.

9.4.1.7 PREOPERATIONAL TEST PROCEDURES

Preoperational test procedures will be established to ensure that ISFSI structures, systems, and components satisfactorily perform their required functions. These test procedures will further ensure that the ISFSI has been properly designed and constructed and is ready to operate in a manner that will not endanger the health and safety of the public.

9.4.1.8 QUALITY ASSURANCE PROCEDURES

Quality assurance procedures will be established to ensure that the operation and maintenance of the ISFSI is performed in accordance with the QA program described in Chapter 11.

9.4.2 RECORDS

Records will be maintained on file as described in the Prairie Island USAR, Section 13.5.

9.5 EMERGENCY PLANNING

The Prairie Island Emergency Plan describes the organization, assessment actions, conditions for activation of the emergency organization, notification procedures, emergency facilities and equipment, training, provisions for maintaining emergency preparedness, and recovery criteria used at the Prairie Island Nuclear Generating Plant. This emergency plan will also be used for any radiological emergencies that may arise at the ISFSI.

Portions of the Emergency Plan and applicable implementing procedures reflect the actions to be taken during off normal and accident conditions. Damage to a loaded cask confinement boundary will result in declaration of a Notification of Unusual Event.

01029651

9.6 PHYSICAL SECURITY PLAN

The purpose of the security program for the ISFSI is to establish and maintain a physical and cyber security program that has the capabilities for the protection of spent fuel stored in the cask system.

Additional information regarding the security program for the ISFSI is contained in a separate enclosure that is withheld from public disclosure in accordance with 10CFR2.790(d) and 10CFR73.21. This enclosure addresses the Physical Security Plan, Safeguards Contingency Plan, and Training and Qualification Plan.

01304073

9.7 ADDITIONAL FABRICATION TESTING AND INSPECTIONS

Not Used

01505901

9.8 AGING MANAGEMENT

9.8.1 Aging Management Review

An aging management review (AMR) of the ISFSI systems, structures, and components (SSC) was conducted as part of the ISFSI License Renewal process. The AMR addresses aging effects/mechanisms that could adversely affect the ability of the SSCs to perform their safety functions during the period of extended operation. The results of the AMR determined that there were aging effects that require aging management activities for the casks, concrete pads, and earthen berm. Although the AMR did not identify any aging effects for the spent fuel assemblies that could lead to a loss of intended function, a High Burnup Fuel Monitoring Program as described in Section A9.8.4 will be used to confirm that the intended function(s) of high burnup fuel stored in TN-40HT casks are maintained during the period of extended operation. The potential aging effects for the casks, concrete pads, and earthen berm are identified in the ISFSI Inspection and Monitoring Activities Program and the Time-Limited Aging Analyses.

9.8.2 ISFSI Inspection and Monitoring Activities Program

The purpose of the ISFSI Inspection and Monitoring Activities Program is to ensure that the structure's or component's intended functions(s) is not degraded for the in-service dry fuel storage casks, reinforced concrete storage pads or earthen berm.

The ISFSI Inspection and Monitoring Activities Program will perform periodic inspection activities that monitor the condition of ISFSI structures and subcomponents that are classified as Safety Related (or Important To Safety for the TN-40HT casks) or whose failure could prevent fulfillment of a function that is important to safety, or its failure as a support structure or component could prevent fulfillment of a function that is important to safety.

The aging effects managed by this program are included in Table 9.8-1. The aging effects/mechanisms applicable to each structure and component are dependent upon the associated material/environment combinations, design, and installation. Those structures and components that have been grouped together for aging management review (e.g., Carbon Steel in Atmosphere/Weather) have been evaluated and based upon the materials of construction, design, installation, and environments, will have the same aging effects.

The scope of the ISFSI Inspection and Monitoring Activities Program includes:

- 1) Visual inspection of the exterior of the in-service dry storage casks,
- 2) Monitoring of the interseal pressure of the in-service dry storage casks,
- 3) Radiation monitoring and associated surveillance activities of the inservice dry storage casks,
- 4) Visual inspection of the concrete pads,
- 5) Visual inspection of the earthen berm,
- 6) Visual inspection of an in-service dry storage cask bottom prior to the end of the current ISFSI license period,
- 7) Visual inspection under an in-service dry storage cask protective cover (surfaces normally not visible or accessible with the cover in-place) prior to the end of the current ISFSI license period,
- 8) Visual inspection of the cask bottom in the event an in-service dry storage cask is lifted in preparation for movement (inspections of opportunity),
- 9) Visual inspection under the protective cover (surfaces normally not visible or accessible with the cover in-place) of an in-service dry storage cask in the event the cover is removed for maintenance (inspections of opportunity),
- 10) Visual inspection of the bottom and under the protective cover of the lead cask at least every 20-years, and
- 11) Monitoring of ground water chemistry.

9.8.3 Time-Limited Aging Analyses

A review of time-limited aging analyses (TLAA) involving the TN-40 cask design, spent fuel assemblies stored in a TN-40 cask, concrete pads, and earthen berm was performed as a part of the ISFSI license renewal. TLAAs are defined as those licensee calculations or analyses that have all of the following attributes:

1. Involves a Structure System or Component (SSC) within the scope of license renewal,
2. Considers the effects of aging,
3. Involves time-limited assumptions defined by the current operating term,
4. Was determined to be relevant in making a safety determination,
5. Involves conclusions or provides the basis for conclusions related to the capability of the SSC to perform its intended functions, and
6. Is contained or incorporated by reference in the licensing basis.

No TLAAs were identified for the TN-40 cask design, spent fuel assemblies stored in a TN-40 cask, concrete pads, or earthen berm.

9.9 REFERENCES

1. Northern States Power Company, Prairie Island Nuclear Generating Plant Updated Safety Analysis Report, Revision 18, Docket Nos. 50-282 (Unit 1) and 50-306 (Unit 2).
2. Prairie Island Nuclear Generating Plant, Operations Manual, Section F2, Radiation Safety.
3. Letter, R.O. Anderson (NSP) to U S Nuclear Regulatory Commission, dated April 20, 1995, "Prairie Island Independent Spent Fuel Storage Installation Preoperational Test Acceptance Criteria and Test Results".

01505901

**TABLE 9.8-1
MANAGED AGING EFFECTS**

| Material | Environment | Aging Effect | Aging Mechanism |
|--------------------|--------------------|-------------------------------|---|
| Aluminum | Atmosphere/Weather | Loss of Material | Crevice Corrosion |
| Aluminum | Atmosphere/Weather | Loss of Material | Galvanic Corrosion |
| Aluminum | Atmosphere/Weather | Loss of Material | Pitting Corrosion |
| Carbon Steel | Atmosphere/Weather | Loss of Material | Crevice Corrosion |
| Carbon Steel | Atmosphere/Weather | Loss of Material | Galvanic Corrosion |
| Carbon Steel | Atmosphere/Weather | Loss of Material | General Corrosion |
| Carbon Steel | Atmosphere/Weather | Loss of Material | Pitting Corrosion |
| Polypropylene | Air/Gas | Cracking | Material property changes from radiation exposure |
| Borated Polyester | Air/Gas | Cracking | Material property changes from radiation exposure |
| Stainless steel | Atmosphere/Weather | Loss of Material | Crevice Corrosion |
| Stainless steel | Atmosphere/Weather | Loss of Material | Pitting Corrosion |
| Concrete | Atmosphere/Weather | Change in Material Properties | Leaching of Ca(OH) ₂ |
| Concrete | Atmosphere/Weather | Cracking | Freeze-Thaw |
| Concrete | Atmosphere/Weather | Cracking | Reaction with Aggregates |
| Concrete | Atmosphere/Weather | Loss of Material | Freeze-Thaw |
| Concrete | Soil | Change in Material Properties | Leaching of Ca(OH) ₂ |
| Concrete | Soil | Cracking | Reaction with Aggregates |
| Concrete | Soil | Cracking | Settlement |
| Earthen Structures | Atmosphere/Weather | Change in Material Properties | Desiccation |
| Earthen Structures | Atmosphere/Weather | Loss of Form | Settlement |
| Earthen Structures | Atmosphere/Weather | Loss of Form | Frost Action |
| Earthen Structures | Atmosphere/Weather | Loss of Material | Erosion (Wind/Rain Impact) |

01505901

Xcel Corporate Organization


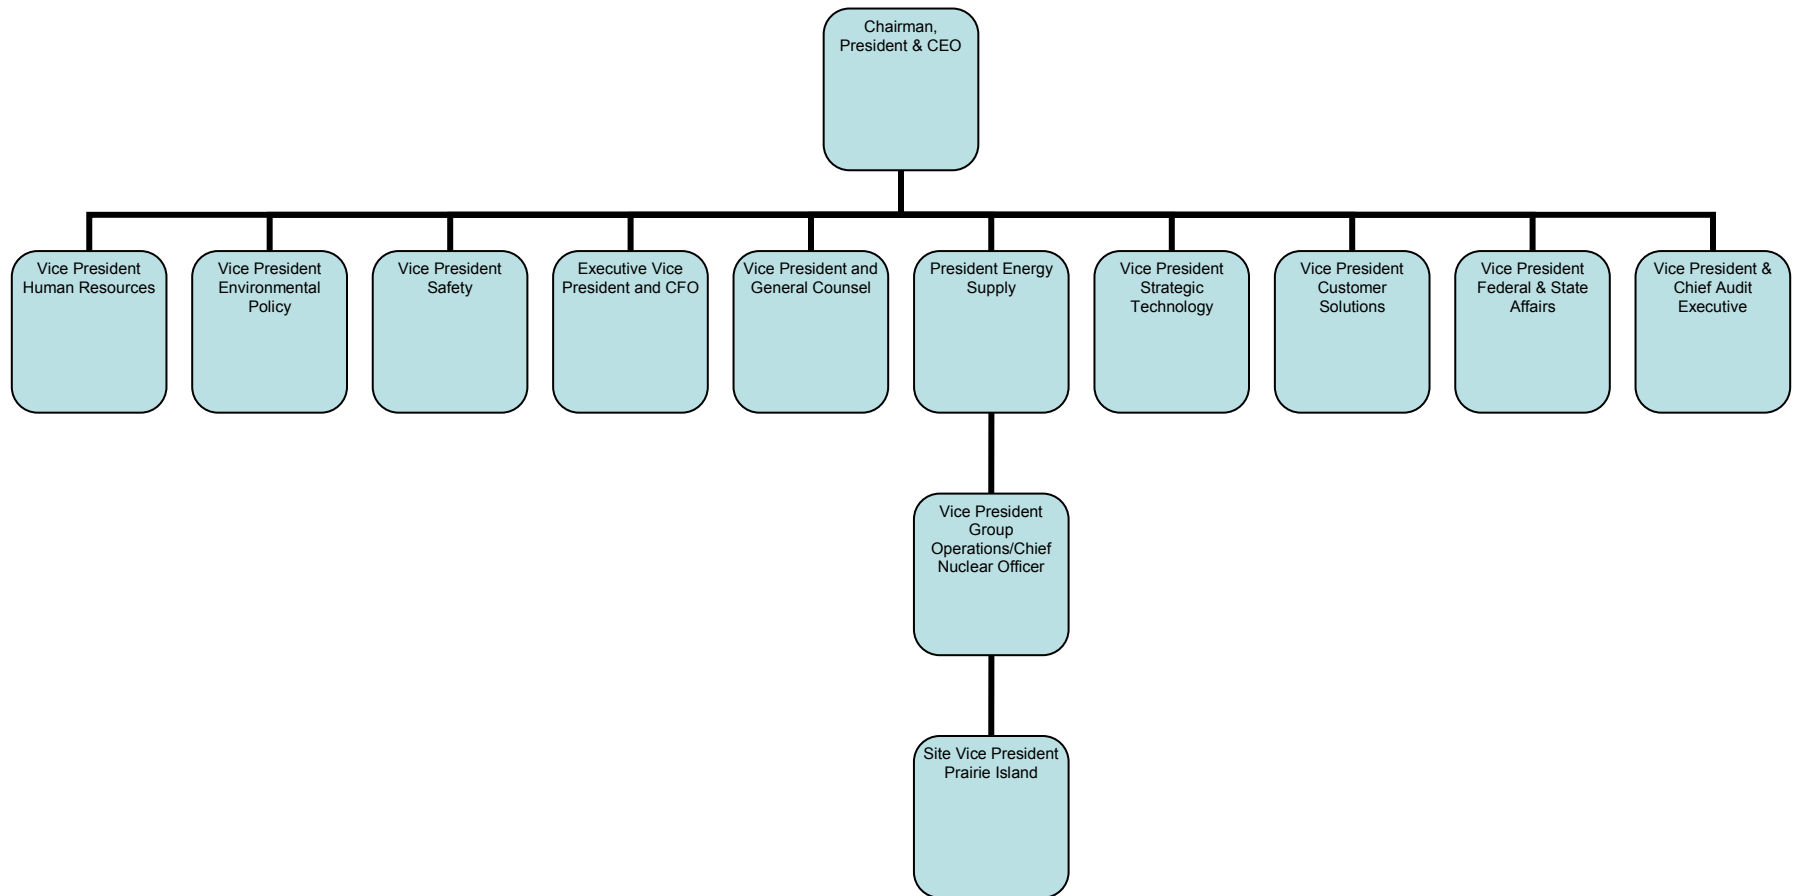


FIGURE 9.1-1, REV 12

Prairie Island Plant Organization

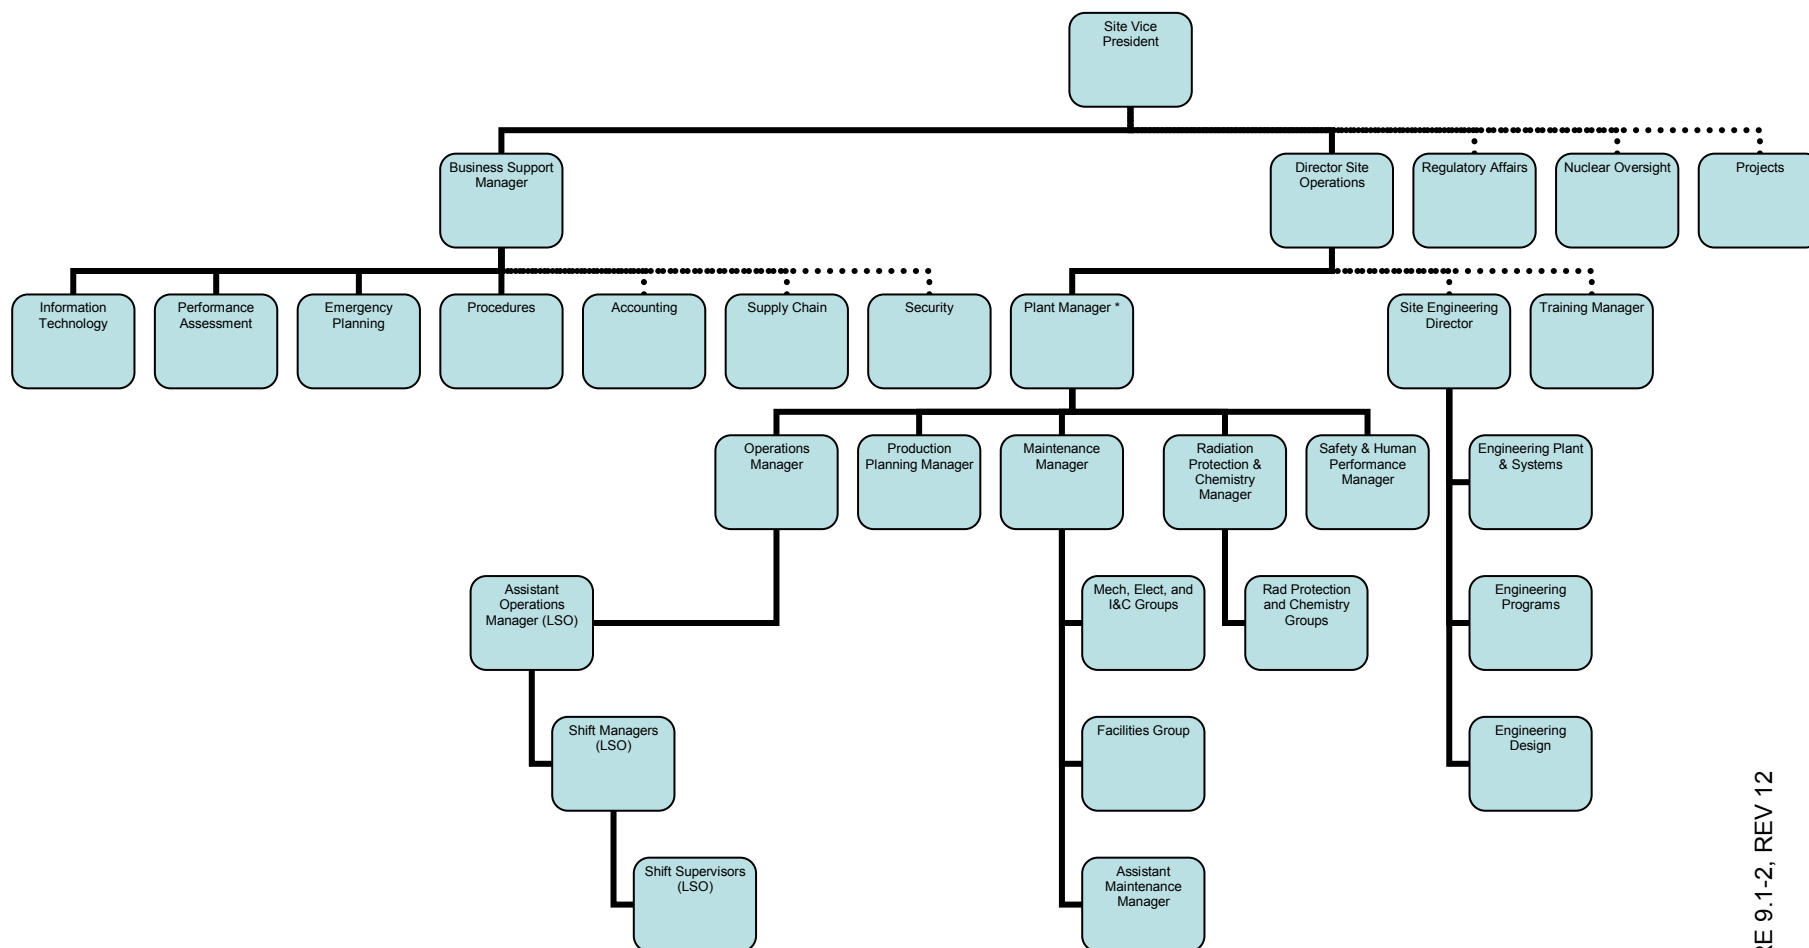

* = The Plant Manager chairs the PORC (Plant Operations Review Committee)
 LSO = Licensed Senior Operator

FIGURE 9.1-2, REV 12

ISFSI Cask Fabrication Organization

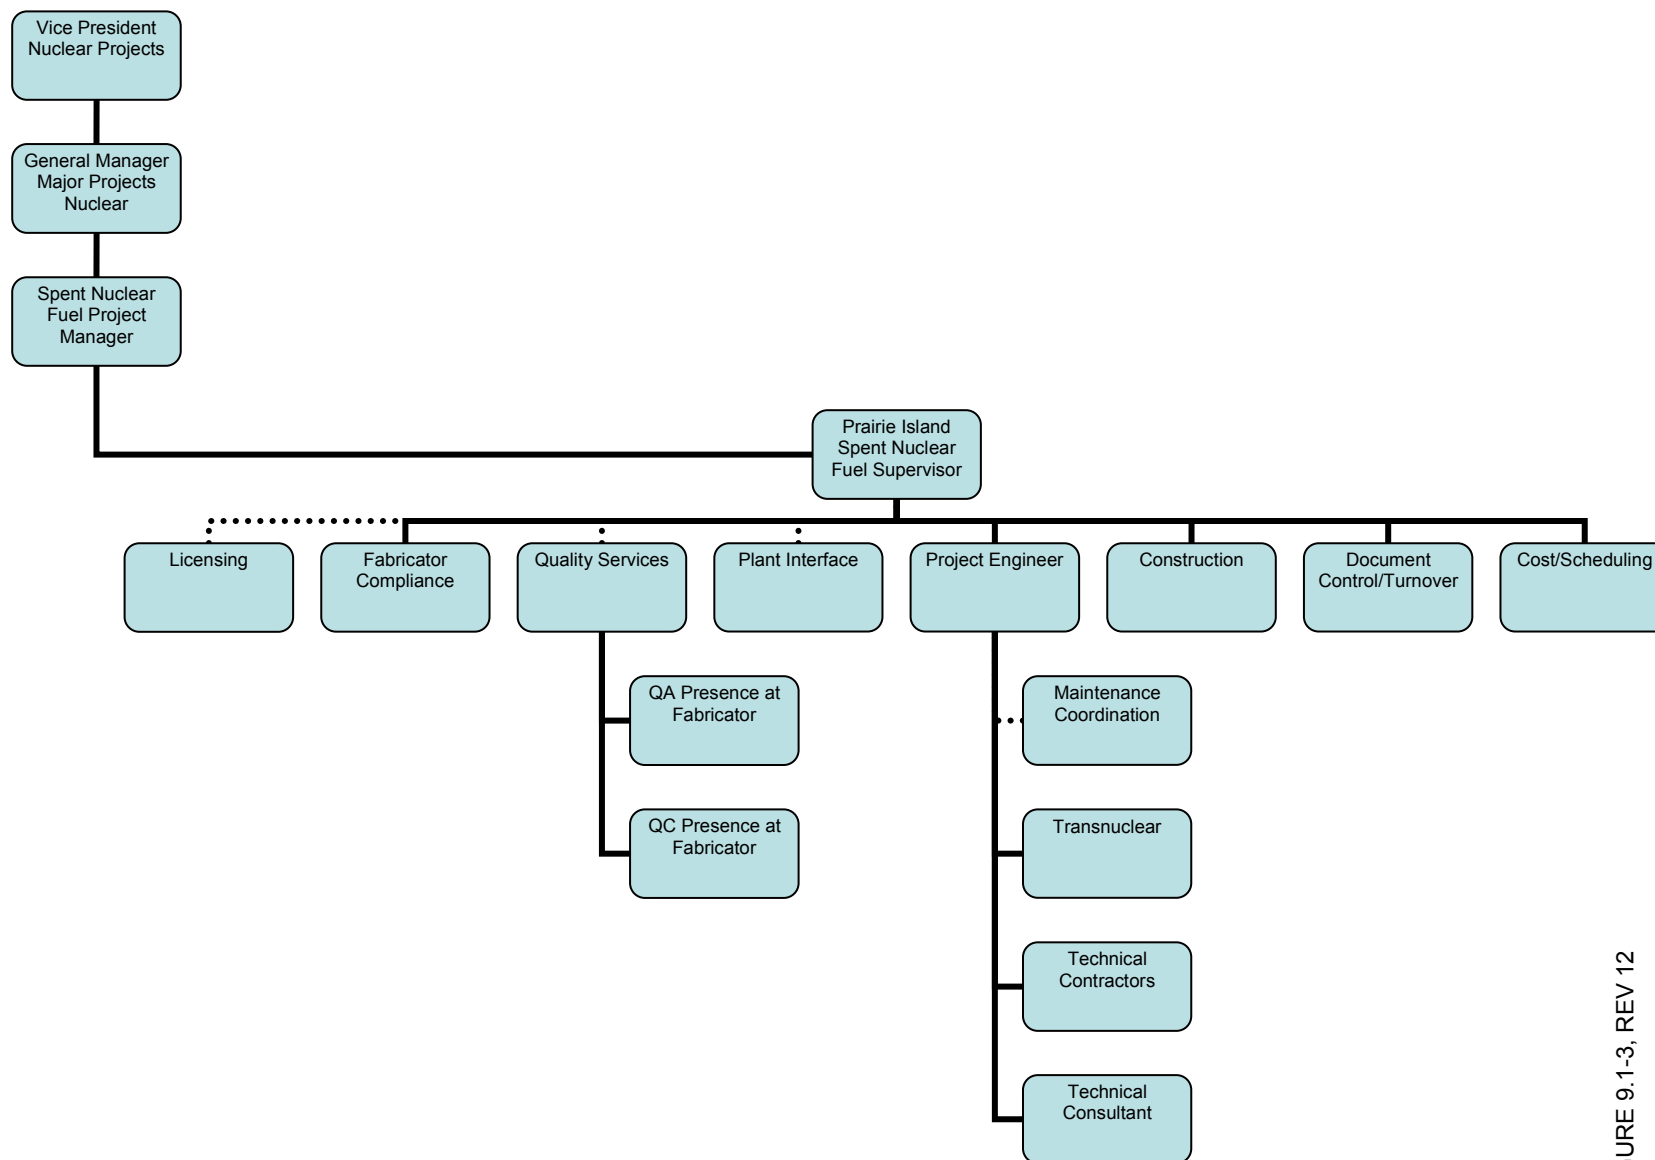


FIGURE 9.1-3, REV 12

ISFSI Operating Organization

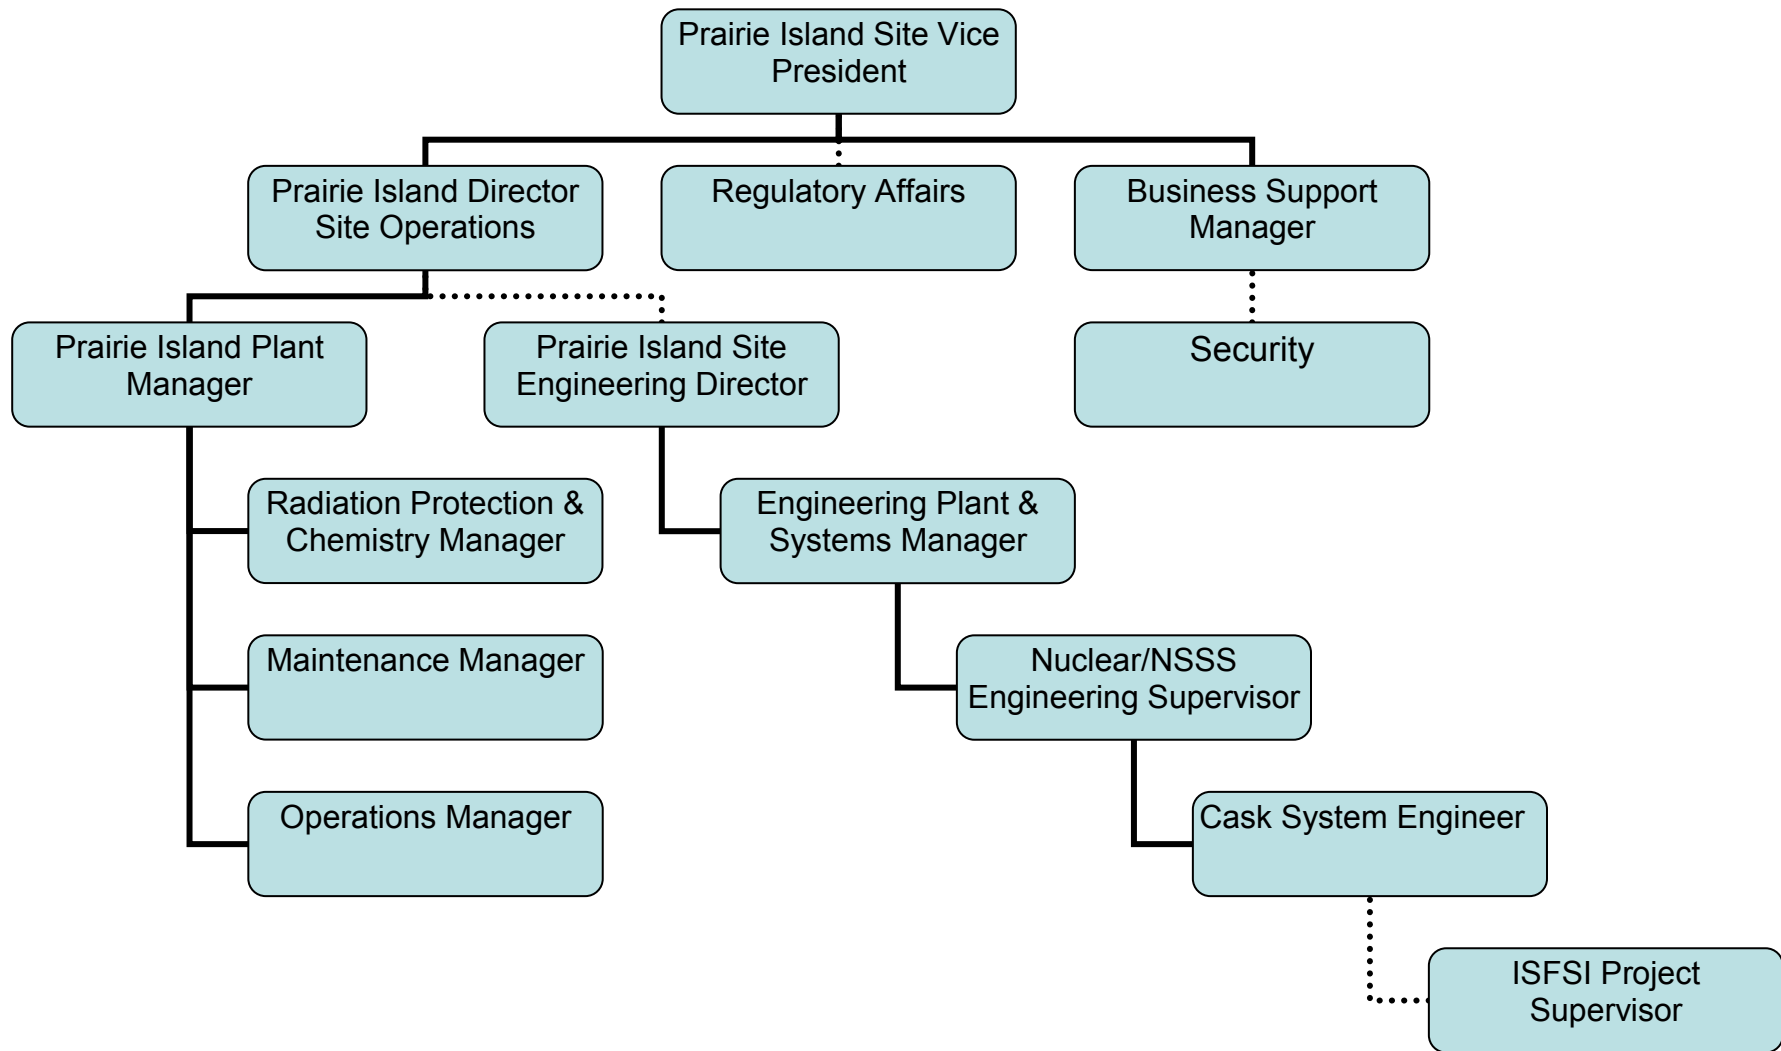


FIGURE 9.1-4, REV 12

SECTION 10

OPERATING CONTROLS AND LIMITS

10.1 FUNCTIONAL AND OPERATING LIMITS, MONITORING INSTRUMENTS AND LIMITING CONTROL SETTINGS

10.1.1 FUEL

1. Specification:

The spent nuclear fuel to be stored at the ISFSI shall meet the following requirements:

- A. Only fuel irradiated at the Prairie Island Nuclear Generating Plant may be used.
- B. Maximum initial enrichment shall not exceed 3.85 weight percent U-235.
- C. Maximum assembly average burnup shall not exceed 45,000 megawatt-days per metric ton uranium.
- D. Fuel shall have cooled a minimum of 10 years after reactor discharge and prior to storage in the ISFSI.
- E. Fuel shall be intact unconsolidated fuel. Partial fuel assemblies, that is, fuel assemblies from which fuel pins are missing, must not be stored unless dummy fuel pins are used to displace an amount of water equal to that of the displaced original pins.
- F. Fuel assemblies known or suspected to have structural defects sufficiently severe as to adversely affect fuel handling shall not be loaded into a cask for storage, unless canned.

2. Applicability: The specification is applicable to all fuel to be stored in the TN-40 casks at the Prairie Island ISFSI.

3. Objective: The specification was derived to ensure that the peak fuel rod temperature, surface doses, and nuclear subcriticality are below design values.

4. Action: If this specification is not met, additional analysis and/or data must be presented demonstrating that the nonconformance does not exceed safe operating limits before the spent fuel can be placed in the cask for storage.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION

SAFETY ANALYSIS REPORT

Revision: 9

Page 10.1-2

5. Surveillance: Surveillance shall be performed as specified in Sections 10.3.1 and 10.3.2.
6. Basis: The design criteria and subsequent safety analyses of the ISFSI and storage casks assumed certain characteristics and limitations for the fuels that are to be received and stored. This specification assures that these bases remain valid by defining the source of the spent fuel, and limits on maximum initial enrichment, irradiation history, and minimum post irradiation cooling time. The objective of these limits is to protect the integrity of the spent fuel by ensuring that the thermal and criticality analyses are valid for fuel stored at the ISFSI.

10.1.2 CASKS

1. Specification: The spent fuel storage casks used at the ISFSI shall meet the following requirements:
 - A. Cask surface temperature shall be less than 250°F.
 - B. The cask surface dose rate (on the pad) shall be less than 200 mRem/hr.
 - C. Removable surface contamination levels on the cask shall be less than 1000 dis/min/100cm² from beta and gamma emitting sources and 20 dis/min/100cm² from alpha emitting sources.
 - D. Maximum lifting height of a cask by a non-single failure proof lifting device shall be less than 18 inches.
2. Applicability: The specification is applicable to the TN-40 casks.
3. Objective: The objective is to ensure that the casks have been loaded and handled in accordance with design basis criteria.
4. Action: If temperature, surface dose rates, or contamination levels exceed limits, the cask shall not be transported to the ISFSI. If maximum lift height is exceeded, the transport activities shall be stopped and the cask lowered to within the acceptable limit.
5. Surveillance: Surveillances shall be performed as specified in Sections 10.3.3, 10.3.4, and 10.3.5.
6. Basis: The design criteria and subsequent safety analysis of the Transnuclear TN-40 cask assumed certain characteristics and operating limits for the use of the casks. This specification assures that those design criteria are not exceeded.

Confirmation that the cask surface temperature is within the prescribed limit will ensure that the cladding temperature of the fuel assemblies is less than the maximum design basis temperature of 340°C. This will protect the integrity of the spent fuel stored in the ISFSI by ensuring that the thermal analyses are valid for the fuel stored in the ISFSI.

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 9

Page 10.1-3

Confirmation that cask surface dose and surface contamination levels are below prescribed limits will protect employees against occupational exposures by ensuring compliance with occupational dose limits and ALARA principles.

Confirmation that cask lifting heights are within the prescribed limit will protect the cask integrity and guard against uncontrolled release of radioactive material by ensuring the thermal, criticality, and radiological analyses remain valid following an accidental cask drop.

THIS PAGE IS LEFT INTENTIONALLY BLANK

10.2 LIMITING CONDITIONS FOR OPERATION

Limiting conditions are the lowest functional capability or performance levels of equipment required for safe operation.

10.2.1 CASK INTERNAL HELIUM PRESSURE

1. Specification: The cask shall be backfilled with a helium cover gas to a pressure of 20 ± 1 psia (5.3 ± 1 psig).
2. Applicability: The specification is applicable to the TN-40 casks.
3. Objective: The objective is to ensure that the cask is backfilled with helium in accordance with design basis criteria.
4. Action: If internal pressure is not within specified limits, the cask shall not be transported to the ISFSI.
5. Surveillance Requirements: Surveillances shall be performed as specified in Section 10.3.6.
6. Basis: The thermal and pressure analyses performed for the cask assume the use of a cover gas. Compliance with this limiting condition will ensure long term maintenance of fuel clad integrity. Periodic testing is not required due to the reliability of the redundant monitoring system.

10.2.2 CASK LEAKAGE

1. Specification: The cask leakage shall be less than 10^{-5} atm-cc/sec.
2. Applicability: The specification is applicable to the TN-40 cask.
3. Objective: The objective is to ensure that cask leakage is within limits assumed in the radiological dose calculations.
4. Action: If leakage is above the specified limit, the cask shall not be transported to the ISFSI.
5. Surveillance Requirements: Surveillances shall be performed as specified in Section 10.3.7. Basis:
6. Basis: Compliance with this limiting condition will ensure long-term maintenance of cask integrity. Periodic testing is not required due to the reliability of the redundant monitoring system.

10.3 SURVEILLANCE REQUIREMENTS

10.3.1 FUEL PARAMETERS

Prior to cask loading, the fuel selected to be loaded shall have been reviewed to ensure that it is within the cask-specific functional and operating limits. This information shall be documented for each assembly to be loaded into the cask.

10.3.2 CASK LOADING

Prior to cask closure, the actual cask loading will be verified to be correct.

10.3.3 CASK TEMPERATURE

A minimum of 24 hours after cask loading and prior to moving the cask to the storage pad, the surface temperature of the cask shall be measured to ensure that it is within the functional and operating limit.

10.3.4 CASK SURFACE DOSE RATE

Prior to moving a loaded cask to the storage pad, gamma and neutron measurements shall be taken on the outside surface of the cask surface. These dose rates shall be less than the surface dose rate limit.

10.3.5 CASK CONTAMINATION

Prior to moving a loaded cask to the storage pad, the cask removable surface contamination levels shall be measured to ensure they are less than the contamination limit.

10.3.6 CASK INTERNAL HELIUM PRESSURE

Prior to moving a loaded cask to the storage pad, the helium pressure shall be measured to ensure it is within the pressure limit.

10.3.7 CASK LEAKAGE

Prior to moving the cask to the storage pad, the cask seal shall be tested using a helium leak detector to ensure that the seal leak tightness is within the leakage limit

10.3.8 ISFSI SAFETY STATUS

A visual surveillance of the ISFSI shall be performed on a quarterly basis to determine that no significant damage or deterioration of the exterior of the emplaced casks has occurred. Surveillance shall also include observation to determine that no significant accumulation of debris on cask surfaces has occurred.

10.3.9 ISFSI AREA DOSE RATE

TLDs located on the ISFSI site fence shall be read quarterly.

10.4 DESIGN FEATURES

The ISFSI cask storage pads are constructed of reinforced concrete, with nominal dimensions of 36 ft. x 216 ft. x 3 ft. thick. The top of the concrete pad elevation is set at a minimum elevation of 693'-0" to preclude immersion of the cask seals during the maximum probable flood. The actual pad elevation is 694'-6".

THIS PAGE IS LEFT INTENTIONALLY BLANK

10.5 ADMINISTRATIVE CONTROLS

The ISFSI is located on the Prairie Island Nuclear Generating Plant site and is managed and operated by the Station staff. The administrative controls shall be in accordance with the requirements of the Station Facility Operating License and associated Technical Specifications.

THIS PAGE IS LEFT INTENTIONALLY BLANK

10.6 REFERENCES

None.

THIS PAGE IS LEFT INTENTIONALLY BLANK

SECTION 11

QUALITY ASSURANCE

11.1 QUALITY ASSURANCE PROGRAM DESCRIPTION

10CFR72.140 requires that a quality assurance program be established and implemented. The previously approved NSPM QA Program which satisfies applicable criteria of 10CFR50, Appendix B, will be applied to activities, structures, systems, and components of the ISFSI commensurate with their importance to safety.

Since NSPM is currently licensed under 10CFR50 to operate nuclear power facilities, a quality assurance (QA) program meeting the requirements of 10CFR50, Appendix B, is already in place. The governing document for this program is "Northern States Power Company-Minnesota, Quality Assurance Topical Report," (QATR) (Reference 1) which has been reviewed and approved by the NRC. This program is implemented through directives, instructions and procedures. The objective of the company QATR is to comply with the criteria as expressed in 10CFR50, Appendix B, as amended, and with the quality assurance program requirements for nuclear power plants as referenced in the Regulatory Guides and industry standards. This program will be applied to those activities associated with the ISFSI. No changes to this program are required for the ISFSI activities.

As indicated in previous chapters, the storage casks and the concrete storage pads are the only components with safety related components. Those components of the storage casks and concrete storage pads which are safety related are listed in Table 4.5-1. As such, the QATR delineates the requirements for the engineering, procurement, fabrication, and inspection of this equipment.

The procurement documents (specifications, requisitions, etc.) of the casks will be reviewed technically prior to use to ensure that the proper criteria have been specified. During the cask design phase, vendor information (drawings, specifications, procedures, etc.) will be reviewed to ensure compliance with technical requirements. During cask fabrication, Shop Inspectors will visit the vendor's shop to ensure compliance with requirements and to witness parts of the cask fabrication and testing. Until NSPM is satisfied that the cask meets the technical requirements, the vendor may not ship the cask.

The concrete and reinforcing steel for the concrete storage pads was purchased by NSP and installed by the general contractor under NSP's direction to assure that materials conform as specified and that the concrete placement conforms to the drawings and the specification requirements.

01153239

01153239

01201386

01153239

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 12

Page 11.1-2

Reinforcing steel is required to be furnished with certified material test reports for chemical analysis and physical tests for each heat of steel to verify compliance with the applicable ASTM specification requirements. In addition, tensile properties are required for representative samples of actual reinforcing steel.

Concrete is required to be furnished with materials (cement, aggregate, water, and admixtures) having certified material test reports which verify compliance with the specified ASTM requirements. Concrete materials are required to be stored, handled, measured, mixed and transported per standard industry practice (ACI 304). Inspections to verify compliance will be performed throughout the project.

Batch plant inspections will be performed to ensure proper mixing proportions.

The fresh concrete will be sampled at the site by an independent testing agency to verify key properties (slump, air content, temperature and unit weight) meet the specification requirements. Compressive strength will be tested for compliance on the 28th day following placement.

Each of the 18 criteria of 10CFR50, Appendix B and their applicability to the storage casks, concrete storage pads and associated activities are described in Sections 11.1.1 through 11.1.18.

11.1.1 ORGANIZATION

Sections A.2, A.3 and A.4 of the QATR define and describe the organization responsible for the establishment and execution of the quality assurance program at the Prairie Island Nuclear Generating Plant. This same organization will be responsible for ensuring that the ISFSI meets the appropriate guidelines of the QATR.

11.1.2 QUALITY ASSURANCE PROGRAM

Sections A.1, A.5 and B.2 of the QATR describe the quality assurance program for the Prairie Island Nuclear Generating Plant. This program will be applied to the ISFSI in accordance with the guidelines for applicability contained in the referenced section.

11.1.3 DESIGN CONTROL

Sections B.2 and B.3 of the QATR ensure that applicable specified design requirements, quality standards, interfaces, checks, and changes are applied, coordinated, and controlled. These same design controls will be applied to the ISFSI in accordance with the applicability guidelines of the referenced section.

11.1.4 PROCUREMENT DOCUMENT CONTROL

Section B.4 of the QATR provides guidelines for ensuring that applicable regulatory requirements, design bases, and other requirements necessary to ensure adequacy are included or referenced in the documents for procurement of items or services. These same controls will be applied to the storage casks and concrete storage pads.

11.1.5 INSTRUCTIONS, PROCEDURES AND DRAWINGS

Section A.1 of the QATR establishes guidelines for preparing instructions, procedures, and drawings for activities affecting quality. These same guidelines will be applied to the procedures for the handling and maintenance of the storage casks and concrete storage pads.

11.1.6 DOCUMENT CONTROL

Section B.14 of the QATR provides general requirements and guidance for the establishment and execution of document control systems for the Prairie Island Nuclear Generating Plant. The documents associated with the storage casks and concrete storage pads and the records committed to in Chapter 10 will come under the control of this system.

11.1.7 CONTROL OF PURCHASED MATERIALS, EQUIPMENT AND SERVICES

Section B.5 of the QATR establishes procedures which ensure that purchased material, equipment, and services conform to the procurement documents. These same procedures will be applied to the storage casks and concrete storage pads.

11.1.8 IDENTIFICATION AND CONTROL OF MATERIALS, PARTS AND COMPONENTS

Section B.6 of the QATR provides methods and conditions for the identification and control of materials, parts, and components. These same methods and conditions will be applied to the storage casks and concrete storage pads.

11.1.9 CONTROL OF SPECIAL PROCESSES

Section B.11 of the QATR establishes procedures which ensure that special processes (e.g., welding, heat treatment, etc.) are controlled and accomplished by qualified personnel, using qualified procedures, in accordance with applicable requirements. The same procedures will be applied to the storage casks and concrete storage pads.

11.1.10 INSPECTION

Section B.12 of the QATR establishes a program for the inspection of activities affecting quality to verify conformance with the documented instructions, procedures, and drawings for accomplishing the activity. The same program will be applied to the storage casks and concrete storage pads.

11.1.11 TEST CONTROL

Section B.8 of the QATR establishes a program to ensure that all testing required to demonstrate that structures, systems, and components will perform satisfactorily is performed in accordance with appropriate test procedures. This same program will be applied to the storage casks and concrete storage pads.

11.1.12 CONTROL OF MEASURING AND TEST EQUIPMENT

Section B.9 of the QATR sets forth the requirements of a calibration program to control and verify the accuracy of measuring and test equipment used in activities affecting quality. This same program will be applied to the storage casks and concrete storage pads.

11.1.13 HANDLING, STORAGE AND SHIPPING

Section B.7 of the QATR establishes measures for the packaging, shipping, storage, and handling of Category I items. These same measures will be applied to the storage casks and concrete storage pads.

11.1.14 INSPECTION, TEST AND OPERATING STATUS

Section B.10 of the QATR establishes and defines the measures to indicate the status of inspections and tests performed upon individual items of the Prairie Island Nuclear Generating Plant. These same measures will be applied to the storage casks and concrete storage pads.

11.1.15 NON-CONFORMING MATERIALS, PARTS OR COMPONENTS

Section B.13 of the QATR establishes guidelines and inspections for reporting any deviation from or violation of an authorized code, standard, engineering document, or procedurally established quality requirement. These same guidelines and instructions will be applied to the activities described in Sections 11.1.1 through 11.1.14.

11.1.16 CORRECTIVE ACTION

Sections A.6 and B.13 of the QATR provide procedures for identifying, documenting, reporting, determining the cause of, and correcting defects and conditions adverse to quality. These same procedures will be applied to the activities described in Sections 11.1.1 through 11.1.14.

11.1.17 QUALITY ASSURANCE RECORDS

Section B.15 of the QATR provides general requirements and guidance for the establishment and execution of the records control system at the Prairie Island Nuclear Generating Plant. The records associated with the storage casks and concrete storage pads will be controlled by this system.

11.1.18 AUDITS

Section C.3 of the QATR establishes a comprehensive system of planned and periodic audits to be carried out in order to verify compliance with all aspects of the quality assurance program and to determine the effects of the program. This same system will be applied to the activities described in Sections 11.1.1 through 11.1.17.

THIS PAGE IS LEFT INTENTIONALLY BLANK

11.2 QUALITY ASSURANCE PROGRAM – CONTRACTORS

11.2.1 ARCHITECT-ENGINEER

As described in the QATR, NSPM has the ultimate responsibility to ensure that the design and engineering of the ISFSI is done in accordance with the plan. In accordance with the plan, the contractor NSP hired to perform the design and engineering of the ISFSI, Stone & Webster Engineering Corporation, performed its work in accordance with an approved QA program (Reference 2).

11.2.2 CASK SUPPLIER

As described in the QATR, NSPM has the ultimate responsibility for ensuring that the manufacture of safety-related components is done in accordance with the plan. In accordance with the plan, the cask manufacturer must do work under the approved NSPM QA Program.

11.2.3 CONCRETE STORAGE PAD CONTRACTOR

As described in its “Operational Quality Assurance Plan,” NSP had the ultimate responsibility for ensuring that the construction of the safety-related concrete storage pads is done in accordance with the plan. In accordance with the plan, the general contractor worked under NSP's approved QA plan.

01153239

01201386 01153239

THIS PAGE IS LEFT INTENTIONALLY BLANK

PRAIRIE ISLAND INDEPENDENT SPENT FUEL STORAGE INSTALLATION SAFETY ANALYSIS REPORT

Revision: 12

Page 11.3-1

11.3 REFERENCES

1. Northern States Power Company-Minnesota, Quality Assurance Topical Report (NSPM-1), most recent revision.
2. Stone & Webster Engineering Corporation, Standard Nuclear Quality Assurance Program, Docket No. 99900509, Revision E.

01153239

01201386

THIS PAGE IS LEFT INTENTIONALLY BLANK