


Active Earth Pressure on 1-ft Wide Vertical Strip

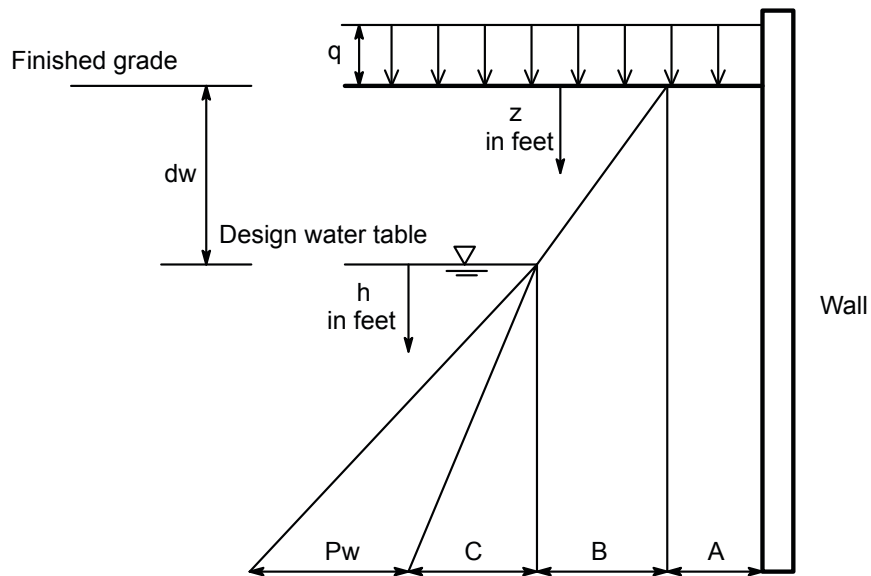

$A = K_a (q) =$ Effect of uniform full coverage surface surcharge

$B = K_a \gamma_s (z) =$ Active earth pressure above water table

$C = K_a \gamma' (h) =$ Active earth pressure increment below water table

$P_w = 62.4 (h) =$ Hydrostatic pressure increment

$H = A + B =$ Static lateral earth pressure above water table ($z < dw$)

$H = A + K_a \gamma_s (dw) + K_a \gamma' (z - dw) =$ Static lateral earth pressure below water table
($z > dw$) (P_w not included)

Conditions on information:

- Units of pressure, psf
- Backfill of granular material compacted to 96% maximum dry density by ASTM D1557
- γ_s = saturated unit weight of granular backfill above water table, pcf
- γ' = submerged unit weight of granular backfill, pcf
- $\phi = 35$ degrees = angle of internal friction of soil
- $K_a = \tan^2 (45 - \phi/2) =$ Active earth pressure coefficient of soil
- Plane strain conditions (corner adjustment factors not included)
- Dynamic soil pressure not included
- Compaction-induced residual pressure not included

USCS Type	γ_s	γ'	K_a
GW	150	87.6	0.271
GP	142	79.6	0.271
SW	136	73.6	0.271

WLS COL 2.5-13

WILLIAM STATES LEE III
NUCLEAR STATION UNITS 1 & 2

Static Lateral Active
Pressures on Nuclear Island

FIGURE 2.5.4-255a Rev 7