


WLS SUP 9.2-4

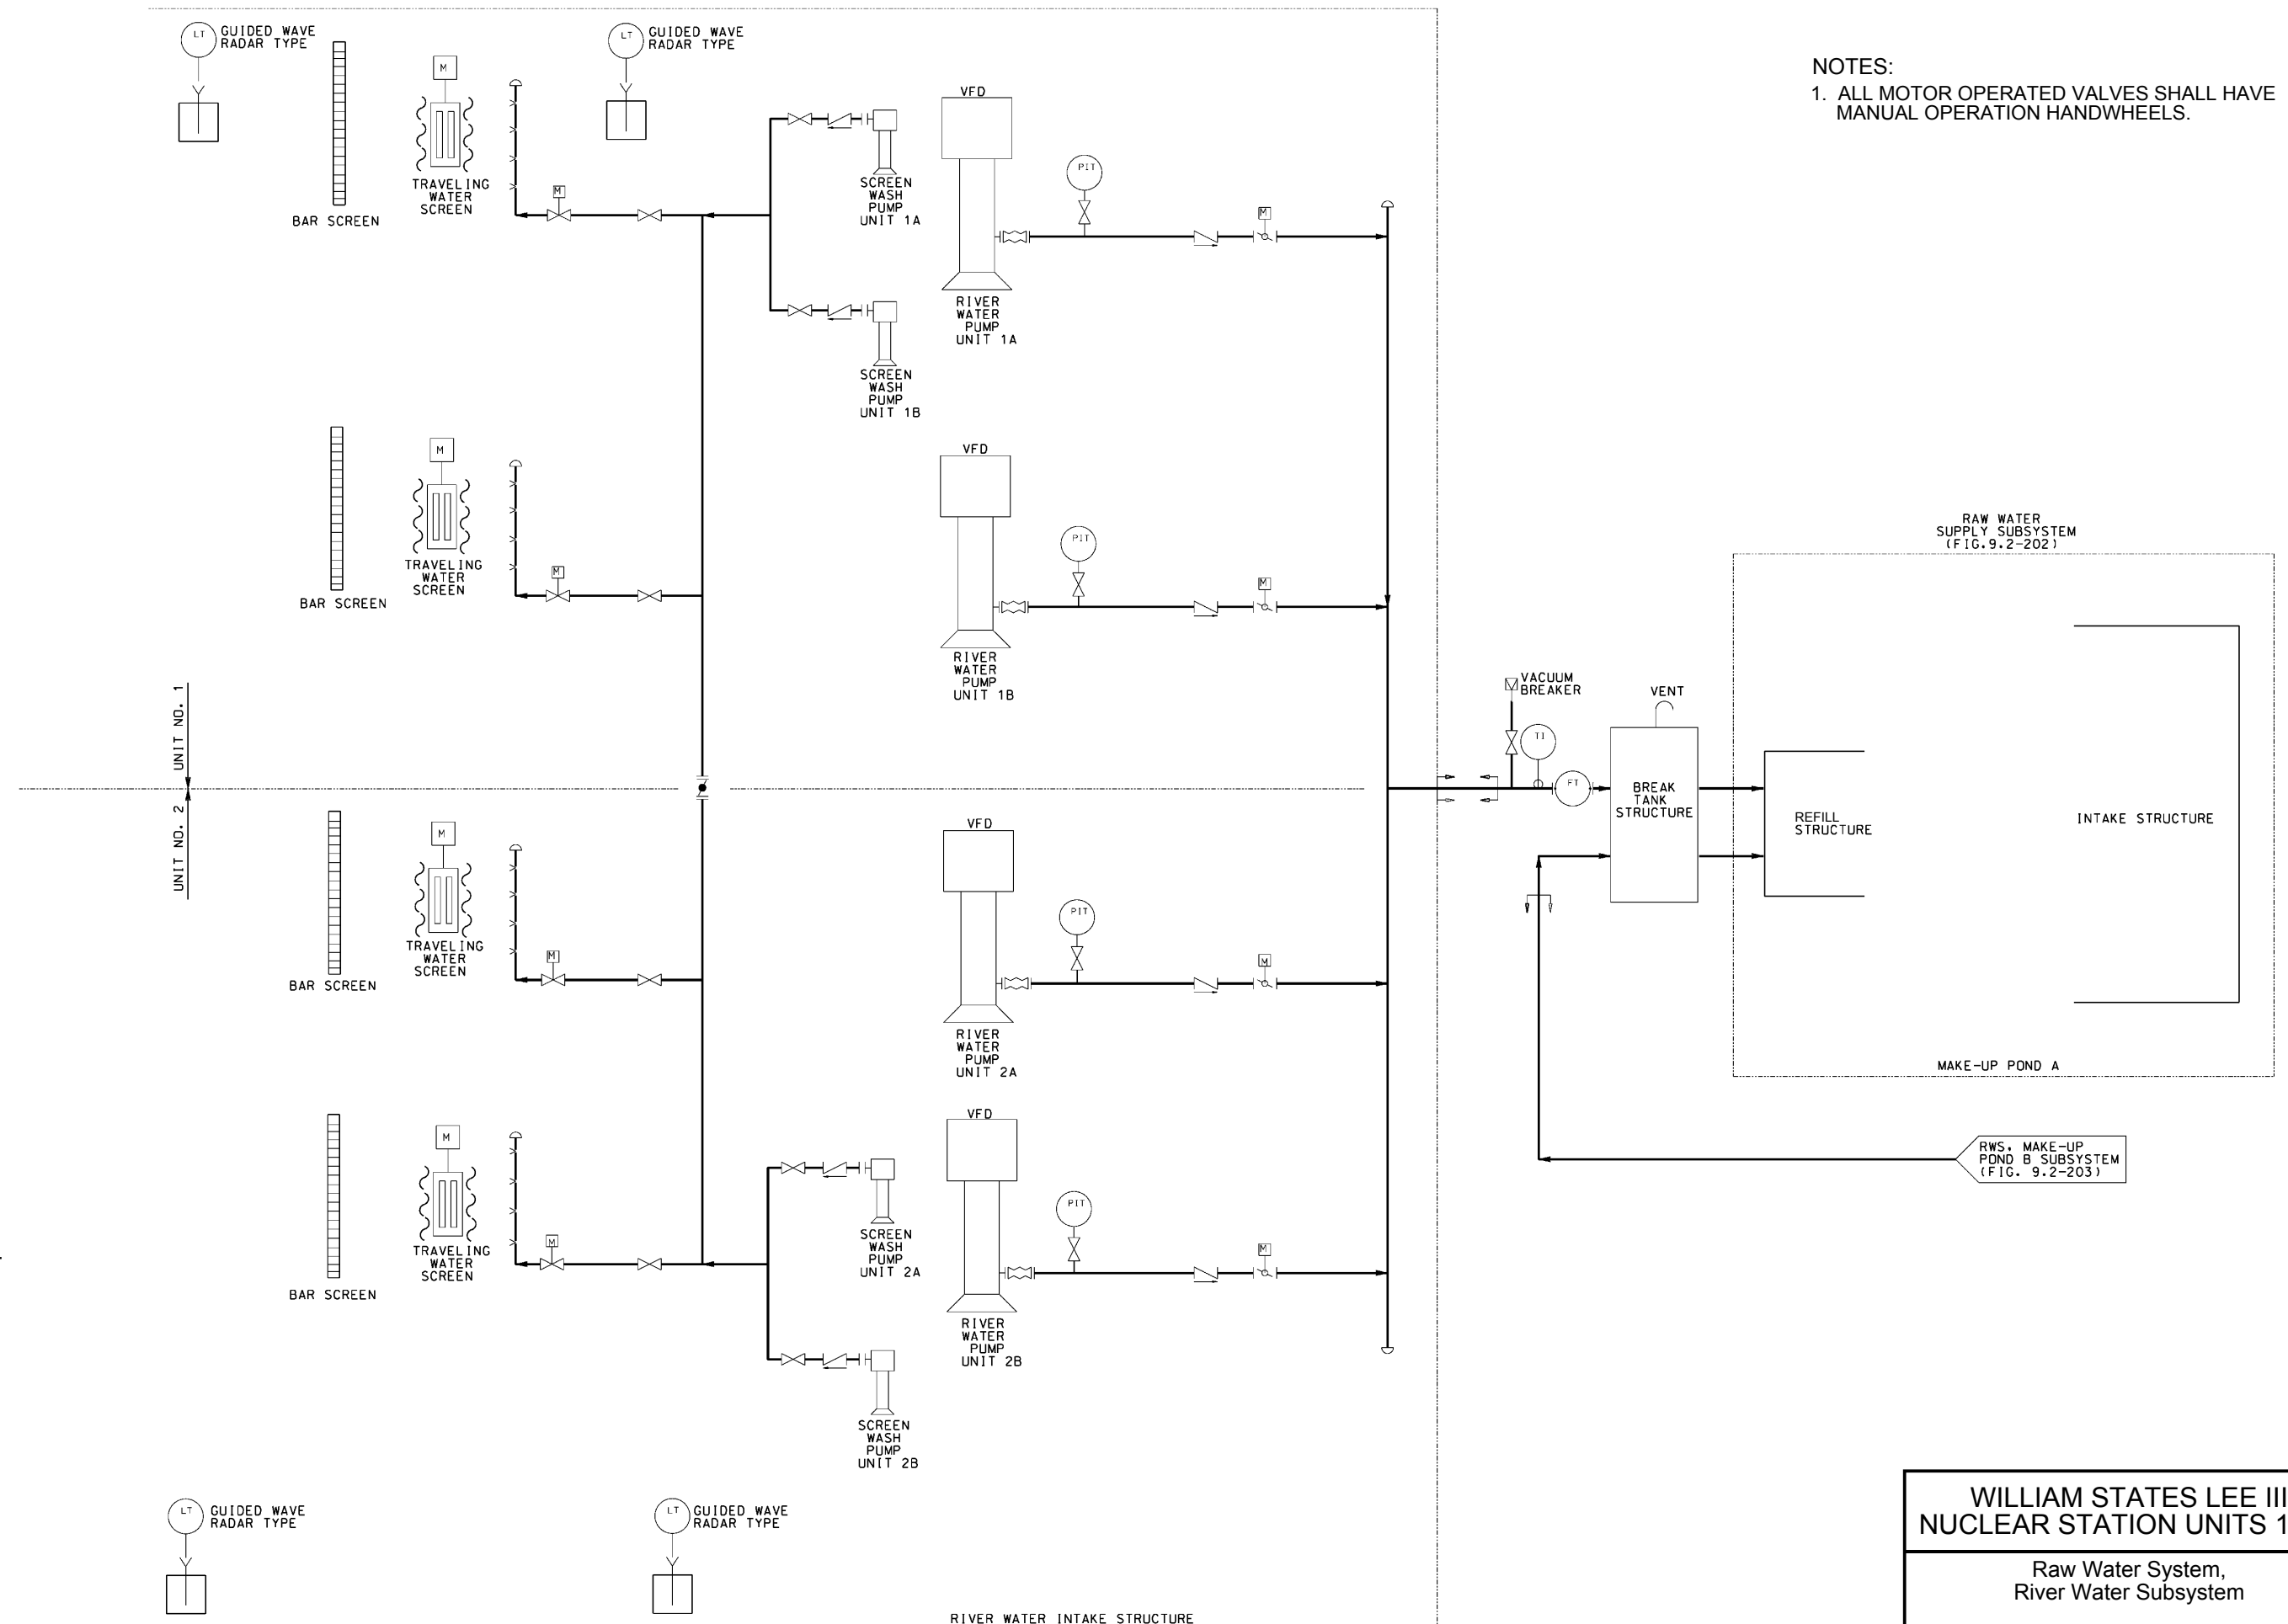

NOTES:  
1. ALL MOTOR OPERATED VALVES SHALL HAVE MANUAL OPERATION HANDWHEELS.

WILLIAM STATES LEE III  
NUCLEAR STATION UNITS 1 & 2

Raw Water System,  
River Water Subsystem

FIGURE 9.2-201

Rev 5