

REACTOR
AUXILIARY
BUILDING

TURBINE
BUILDING

SOLIDIFICATION BUILDING

40' X 55'
(LONG)

RETAINING WALL

ROADWAY

SERVICE BLDG.

CHILLER BLDG.

RADIOACTIVE
MATERIAL
STORAGE
BUILDING

WATER
TREATMENT
BLDG.

Revision 11-A (02/02)

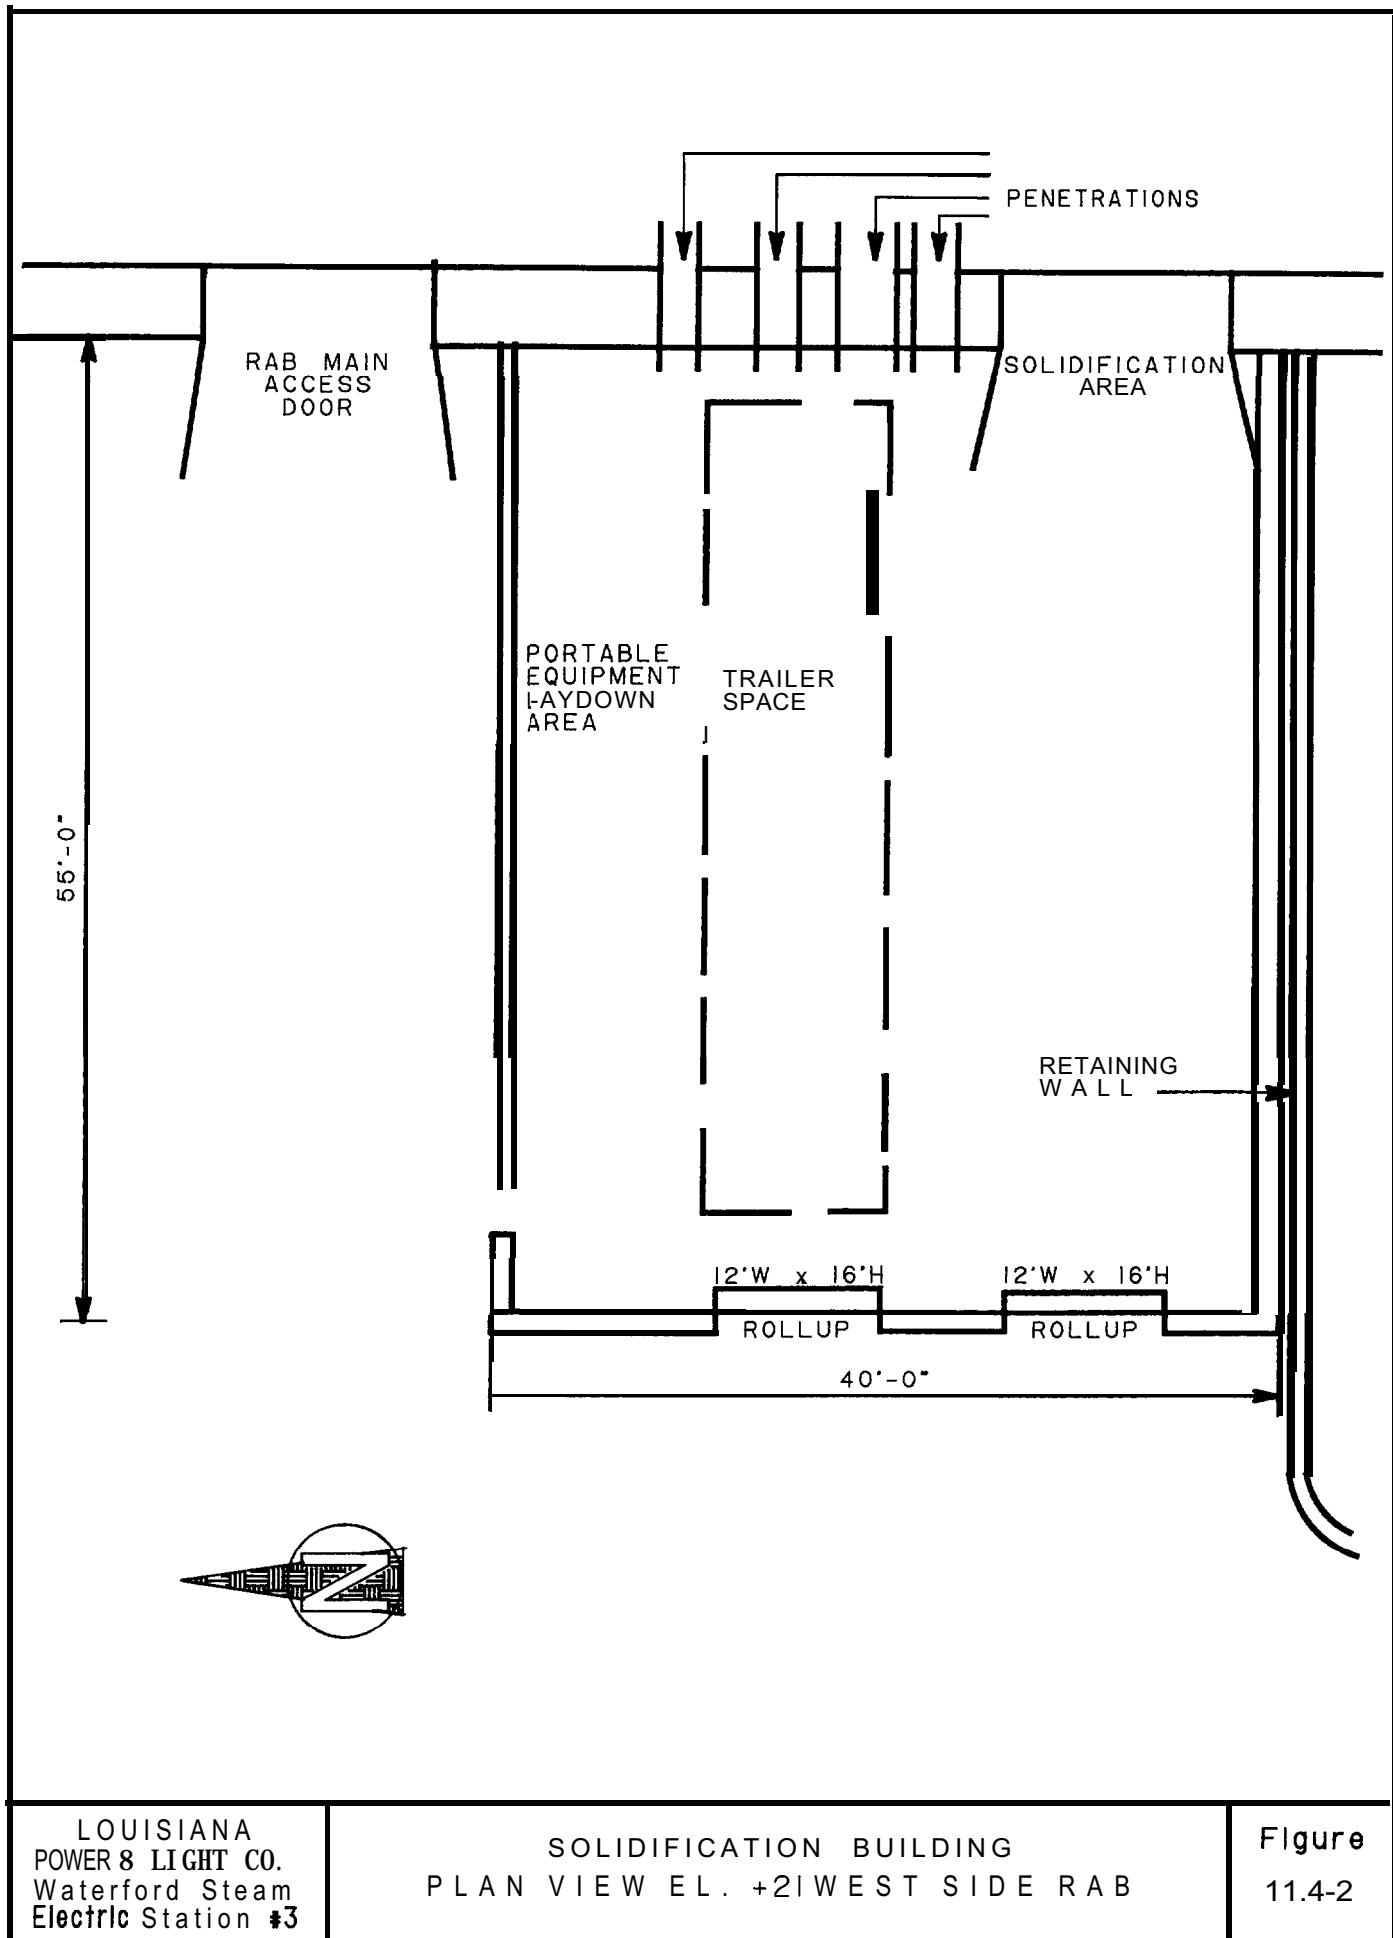


Figure 11.4-3 has been Intentionally Deleted.

Revision 11 (05/01)

Figure 11.4-4 has been Intentionally Deleted.

Revision 11 (05/01)

→ (DRN 01-421)

Figure 11.4-5 has been incorporated by reference in accordance with NEI 98-03.

Figure information can be found in Drawing G-170, Sheet 5.

← (DRN 01-421)

→ (DRN 01-223)


← (DRN 01-223)

THIS FIGURE INTENTIONALLY DELETED


Revision 11-B (06/02)

Waterford Steam
Electric Station #3

Figure
11.4-6

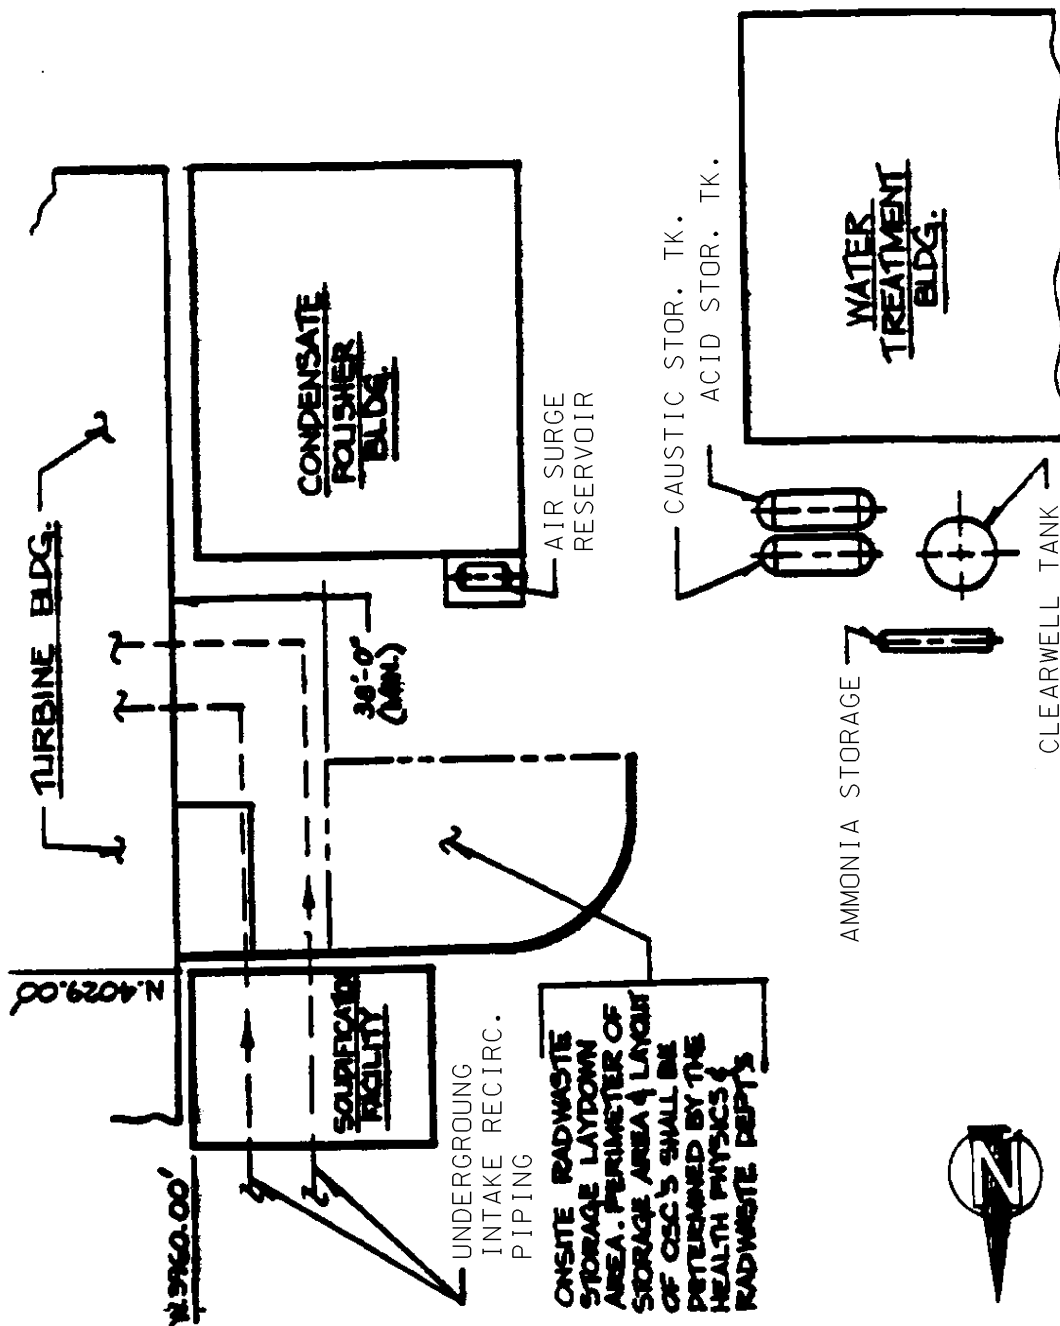

Revision 11-A (02/02)

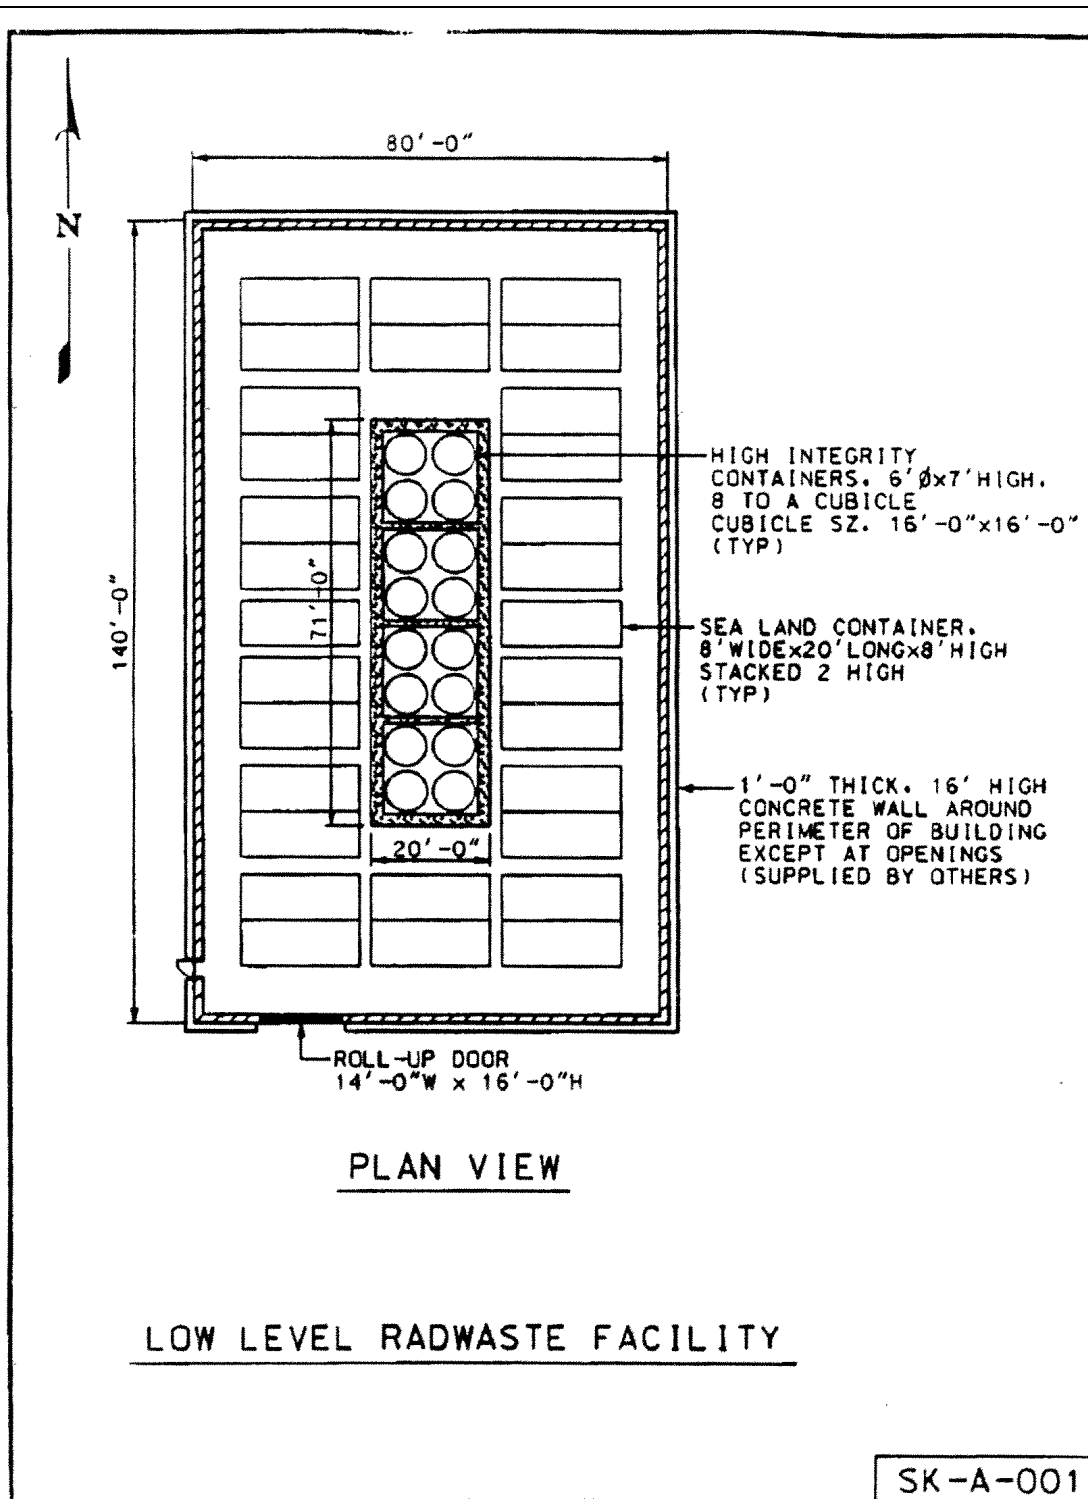

Revision 307 (07/13)