

<h1 style="margin: 0;">TVA</h1>	<h2 style="margin: 0;">WALL THICKNESS PROFILE SHEET</h2>	REPORT NO: <div style="font-size: 1.2em; margin-top: 5px;">R-P0150</div>
PROJECT: <u>WBN</u>		WELD NO: <u>RCF-63-4</u>
UNIT: <u>2</u>		SYSTEM: <u>RCS</u>

Record Thickness Measurements As Indicated, Including Weld Width, Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1	3.34	3.0	3.04	2.95
2	3.14	3.07	3.16	3.19
3	3.52	3.47	3.42	3.50
4	N/A	N/A	N/A	N/A
5	N/A	N/A	N/A	N/A

CROWN HEIGHT: <u>FLUSH</u>	DIAMETER: <u>31.0</u>
CROWN WIDTH: <u>2.75</u>	WELD LENGTH: <u>118.25</u>

ELBOW
FLOW →
PUMP

0°

90°

180°

270°

EXAMINER: <u>José Alejandro Meléndez</u>	REVIEWED BY: <u>Darlene Dialez</u>	ANII: <u>20</u>
LEVEL: <u>II</u>	LEVEL: <u>III</u>	DATE: <u>3/9/09</u>
DATE: <u>02-04-09</u>	DATE: <u>02-04-09</u>	PAGE <u>4</u> OF <u>5</u>

TVA

Office of Nuclear Power

PROJECT: WBN

SYSTEM: RCS

REPORT NO.:

UNIT: 2


WELD NO: RCF-63-4

R.P0150

ELBOW

FLOW →

PUMP

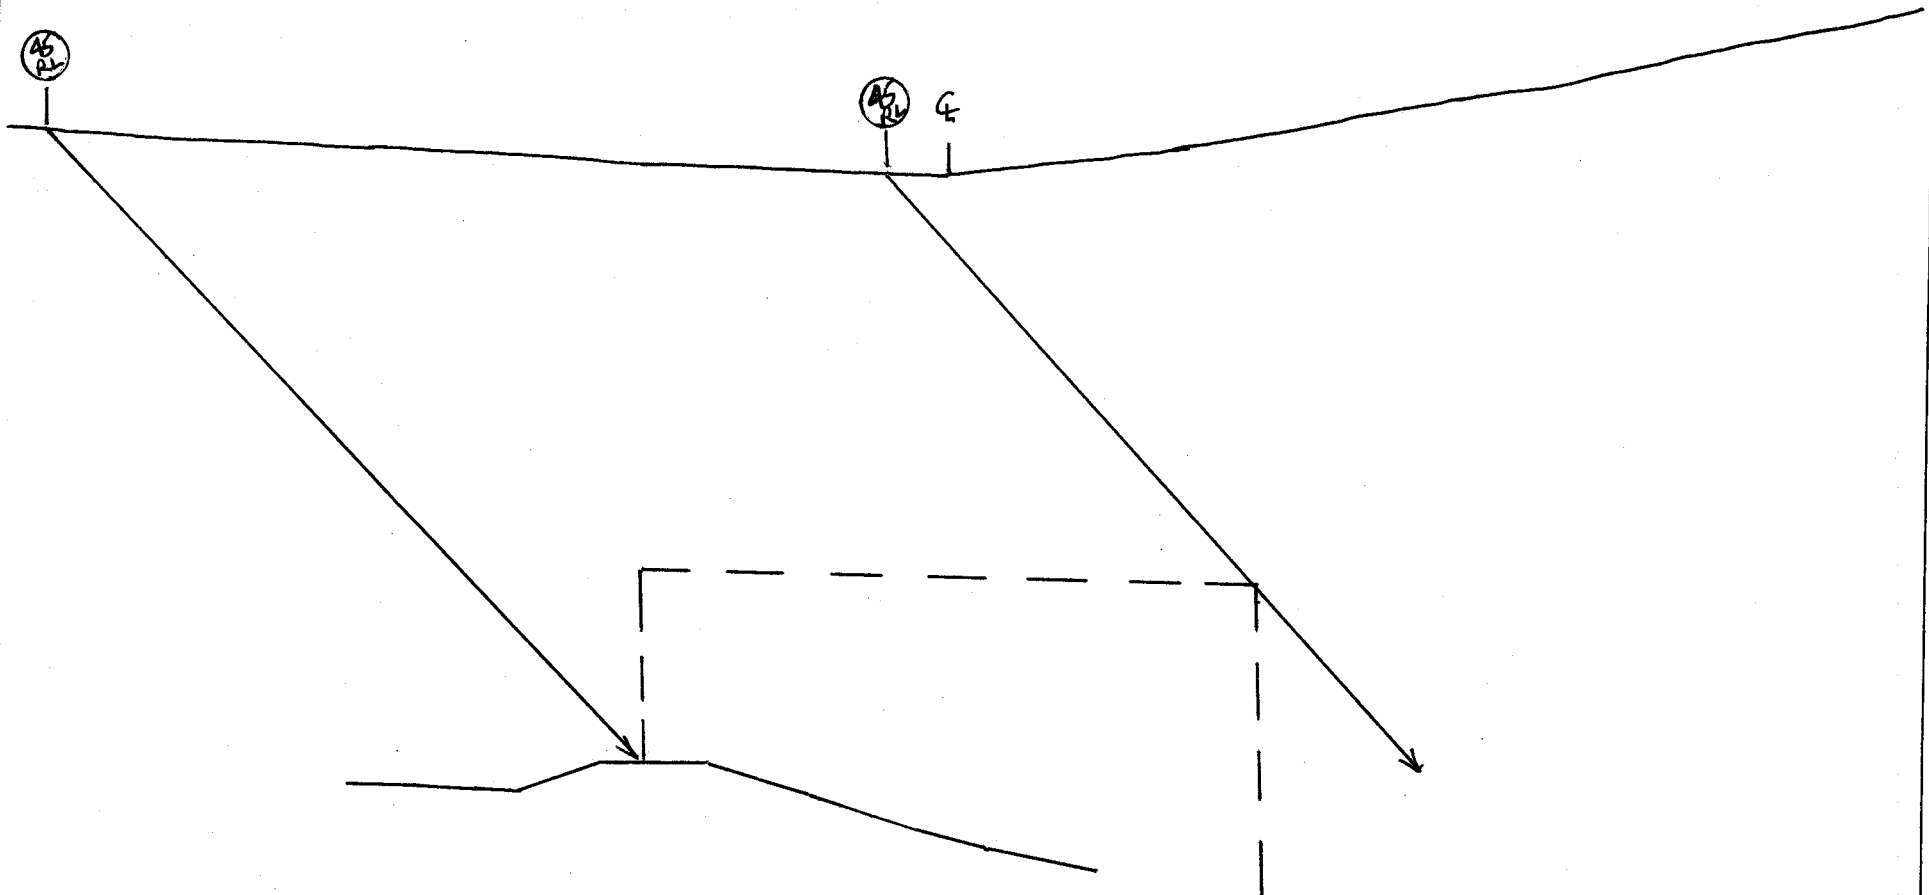

BY: José Alejandro [Signature] LEVEL: II DATE: 02-04-09 PAGE 5 OF 5