

TVA


WALL THICKNESS
PROFILE SHEET

REPORT NO:

R-POISS

PROJECT: WBN
UNIT: 2WELD NO: G4 RCF-G-4-4
SYSTEM: RCSRecord Thickness Measurements As
Indicated, Including Weld Width,
Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1	2.70	3.56	3.14	3.22
2	3.24	3.45	3.36	3.44
3	3.3	3.26	3.21	3.2
4	3.65	3.53	N/A	3.89
5	N/A	N/A	N/A	N/A

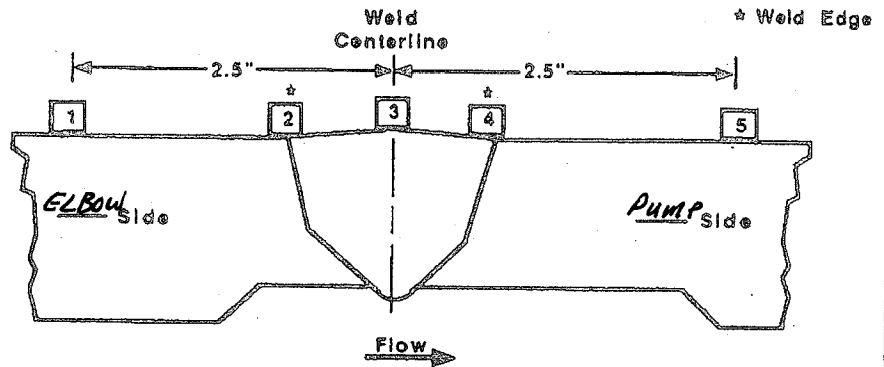CROWN HEIGHT: FLUSH DIAMETER: 31.0
CROWN WIDTH: 2.5 WELD LENGTH: 118.0

ELBOW

FLOW →

PUMP

0°

90°

180°

270°

EXAMINER: José Alejandro J. Cepeda
LEVEL: II
DATE: 02-04-09REVIEWED BY: Dr. Elena D. Lopez
LEVEL: III DATE: 02-04-09ANII: W
DATE: 3/9/09
PAGE 4 OF 5

TVA

Office of Nuclear Power

PROJECT: WBN

SYSTEM: RCS

REPORT NO.:

UNIT: 2

WELD NO: RCF-G4-4

R-P0155

ELBOW


FLOW →

PUMP

45
RL

45
RL

4

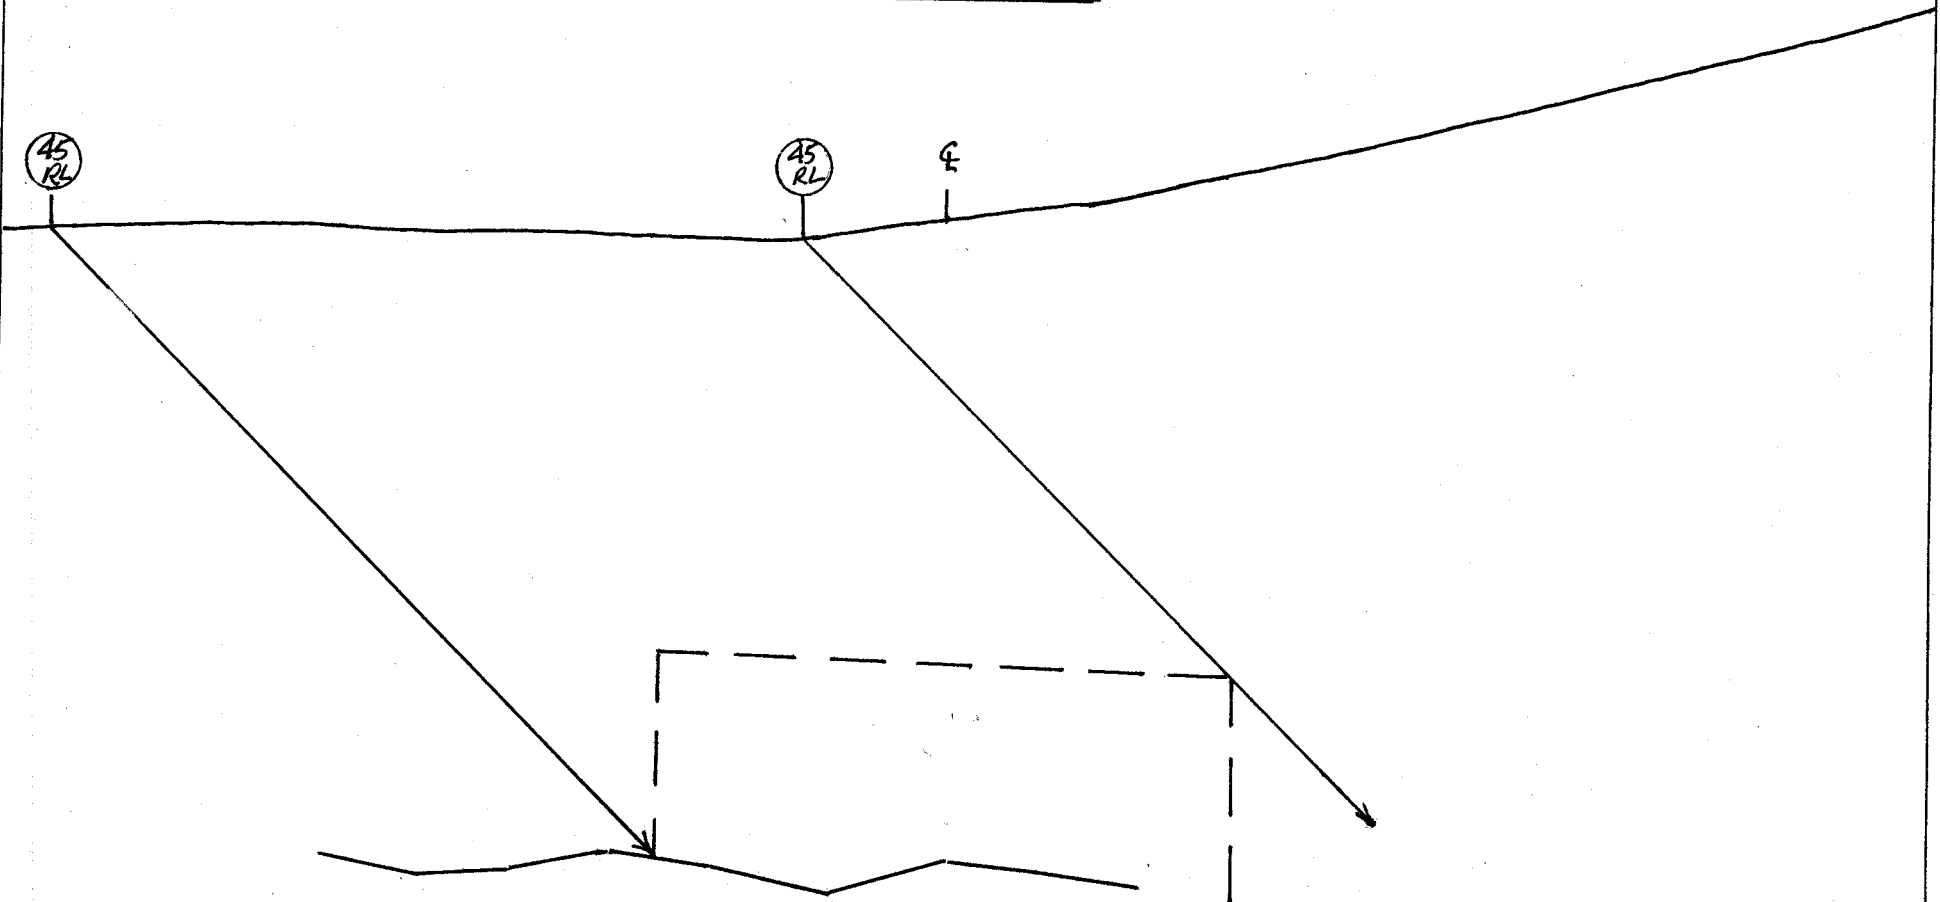

BY: Jose Alejandro

[Signature]

LEVEL: II

DATE: 02-04-09

PAGE

5

OF

5