

TVA

Office of Nuclear Power

PROJECT: WBN **SYSTEM:** RCS



UNIT: 2 **WELD NO:** RCF-G3-1-SE

REPORT NO.:

R-P2438

N02/SAFE END

FLOW →

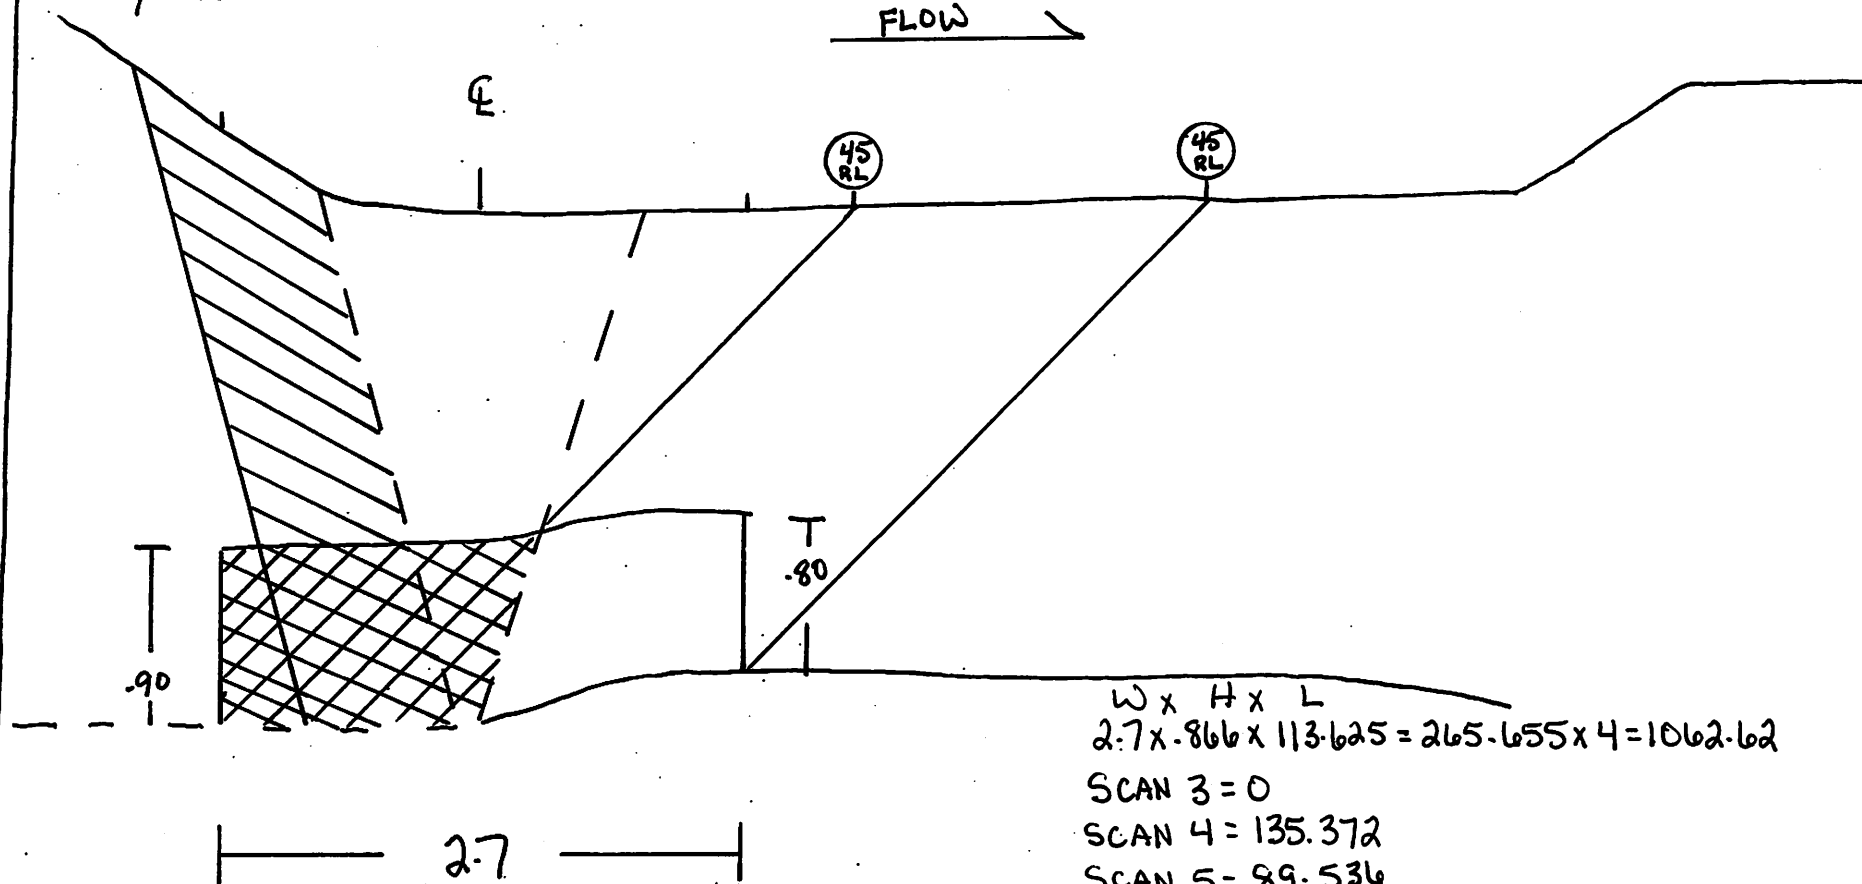

AXIAL AREA
NOT COVERED
BY AXIAL SCAN

$$W \times H \times L \\ 2.7 \times .866 \times 113.625 = 265.655 \times 4 = 1062.62$$

SCAN 3 = 0

SCAN 4 = 135.372

SCAN 5 = 89.536

SCAN 6 = 89.536

314.444

$$314.444 \div 1062.62 = .2959 = 29.59\%$$

AWT verified: Joe E. Hair for C. Hair 06/11/2015

BY:

[Signature]

LEVEL: II

DATE: 01-17-15 **PAGE** 5 **OF** 6

TVA

Office of Nuclear Power

PROJECT:

WBN

SYSTEM:

RCS

REPORT NO.:

R.P2438

UNIT:

2

WELD NO:

RCF-G3-1-SE

NO2 / SAFE END


FLOW →

¢

.90

.80

2.7



EXAM AREA
NOT COVERED
BY CTCL SLANS

AME I Verified: See C.HAM for certain calculations

BY:

[Signature]

LEVEL: II

DATE: 01-17-15 **PAGE** 6 **OF** 6