

TVA


WALL THICKNESS
PROFILE SHEET

REPORT NO:

R.D2440

PROJECT: WBNWELD NO: RCF-EI-2-SEUNIT: 2SYSTEM: RCSRecord Thickness Measurements As
Indicated, Including Weld Width,
Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1	N/A	N/A	N/A	N/A
2	N/A	N/A	N/A	N/A
3	2.37	2.46	2.41	2.43
4	2.50	2.73	2.48	2.52
5	3.14	2.87	2.81	2.93

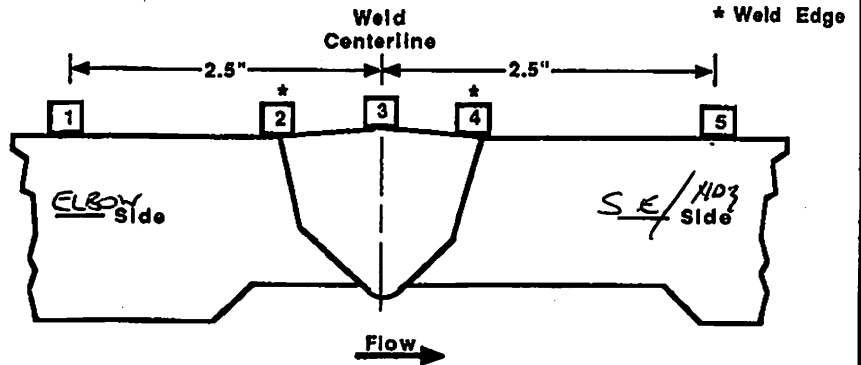CROWN HEIGHT: FLATDIAMETER: 36" ODCROWN WIDTH: 11-4-14 2.2" 1.7"WELD LENGTH: 114 3/8"

0°

90°

180°

270°

EXAMINER: D.J. MacLeanREVIEWED BY: [Signature]

ANII:

LEVEL: IIILEVEL: IIIDATE: 11-10-14DATE: 06/11/2015DATE: 11-4-2014PAGE 5 OF 67

TVA

Office of Nuclear Power

PROJECT: WBN


SYSTEM: RCS

REPORT NO.:

UNIT: 2

WELD NO: RCF-EI-2-SE

R.P2440

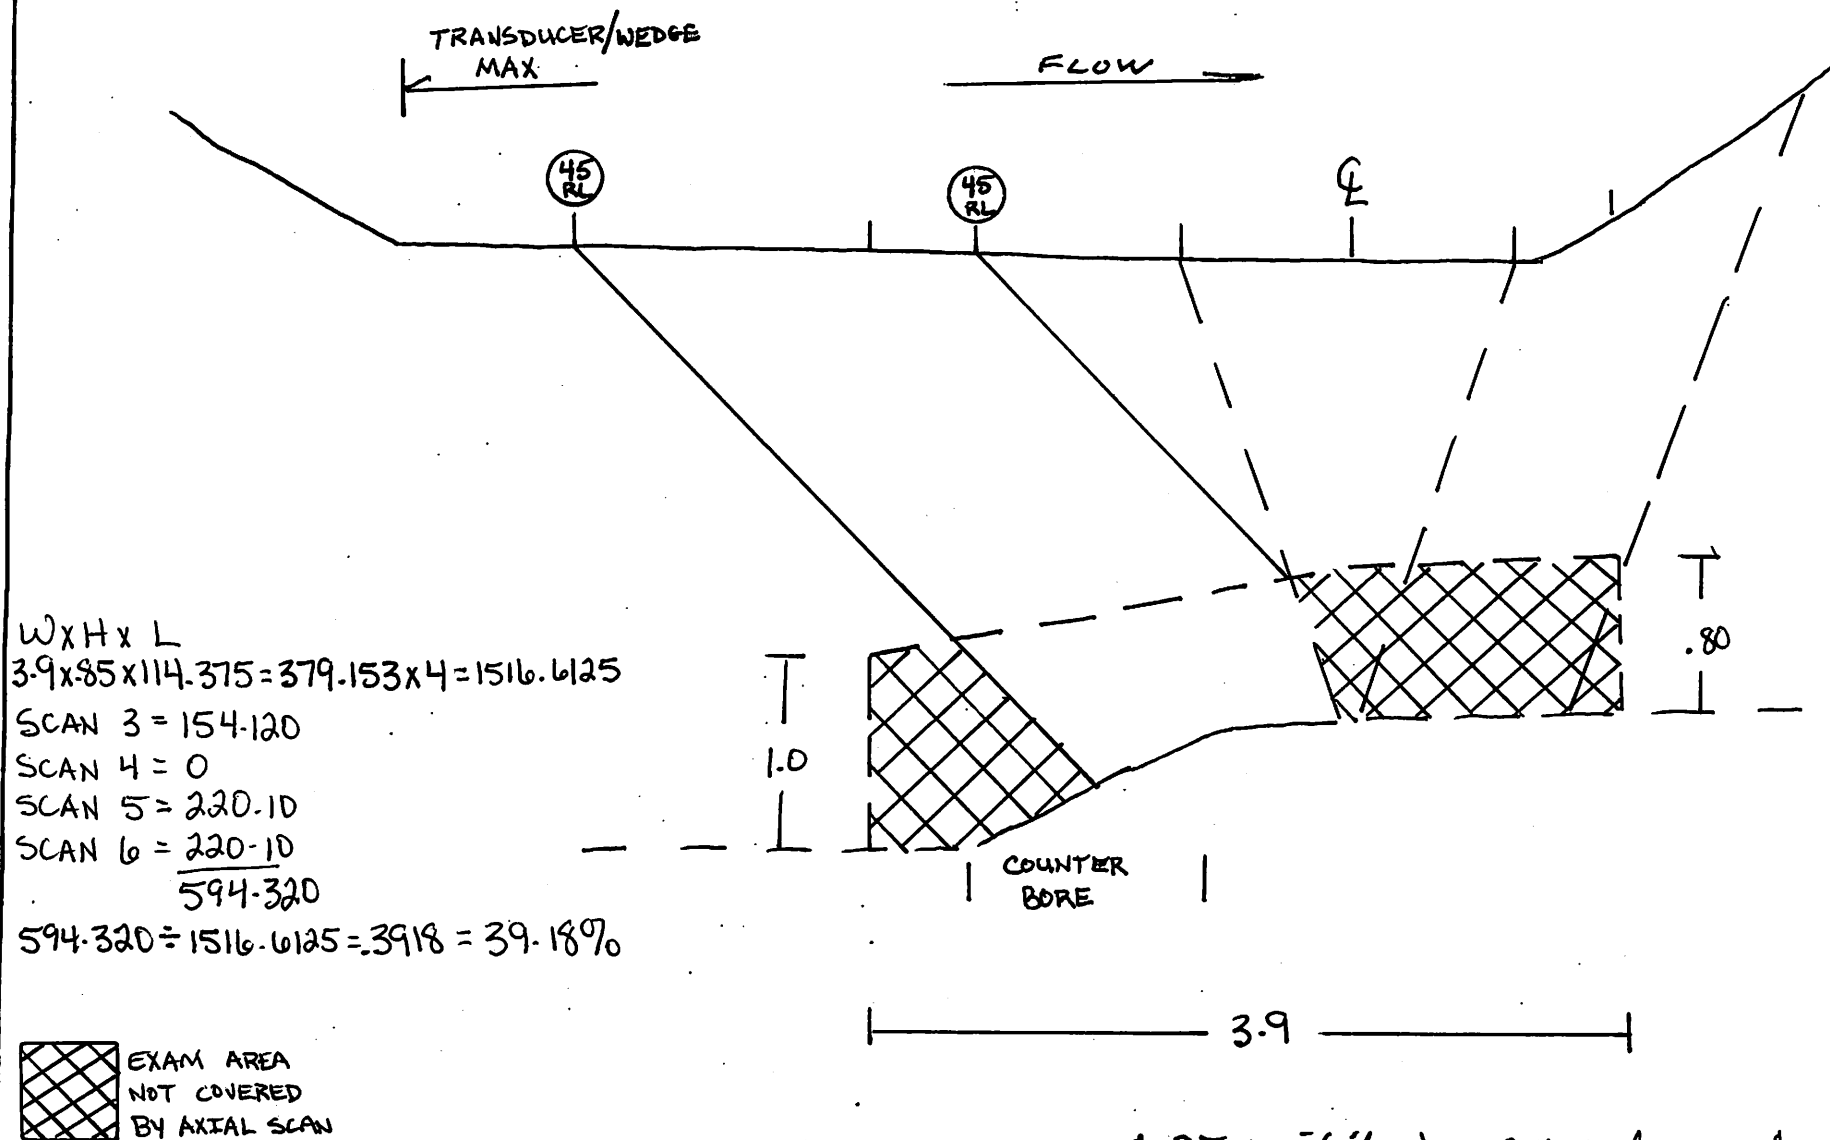

AWEI verified: See C.HAR for E.HAR 6/11/15

BY:

LEVEL: II DATE: 01-07-15 PAGE 6 OF 7

TVA

Office of Nuclear Power

PROJECT: WBN


SYSTEM: RCS

REPORT NO.:

UNIT: 2

WELD NO: RCF-E1-2-SE

R.P2440

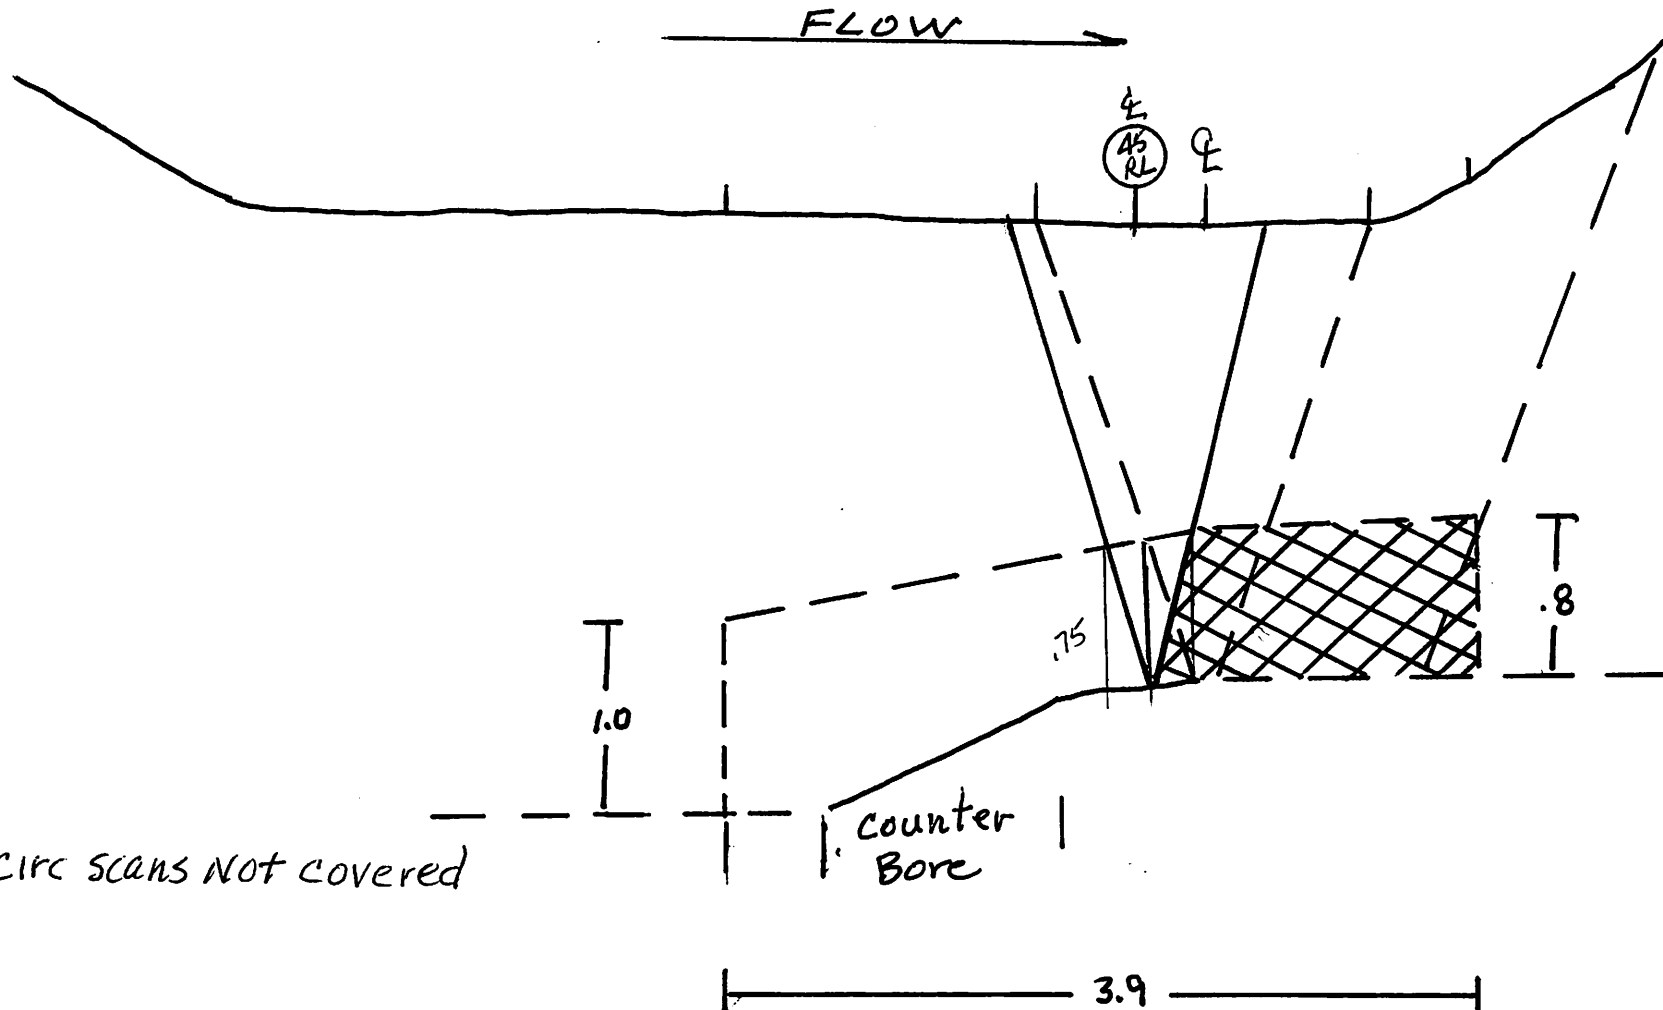

ANET verified: Joe C. HAIR Joe C. Hair obliques

BY:

[Signature]

LEVEL: II

DATE: 01-07-15 PAGE 7 OF 7