


TVA	WALL THICKNESS PROFILE SHEET	REPORT NO: R-P2472
-----	---------------------------------	---

PROJECT: <u>WBN</u> UNIT: <u>2</u>	WELD NO: <u>SIF-D123-05</u> SYSTEM: <u>SIS (063)</u>
---------------------------------------	---

Record Thickness Measurements As Indicated, Including Weld Width, Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1	*	N/A	N/A	N/A
2	.699	.703	.694	.733
3	.670	.648	.637	.679
4	.625	.622	.577	.594
5	.648	.640	.605	.649

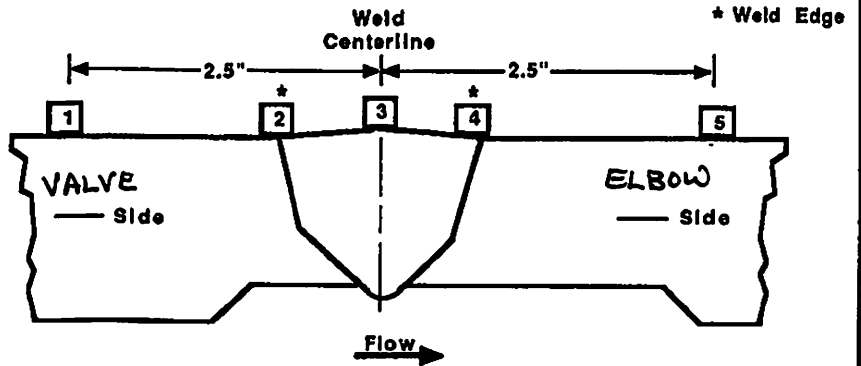

CROWN HEIGHT: <u>FLUSH</u>	DIAMETER: <u>14"</u>
CROWN WIDTH: <u>.875"</u>	WELD LENGTH: <u>45"</u>



* READINGS NOT TAKEN

EXAMINER: <u><i>Paul Cleary</i></u> LEVEL: <u>II</u> DATE: <u>03-10-15</u>	REVIEWED BY: <u><i>David L. Gentry</i></u> LEVEL: <u>III</u> DATE: <u>5-6-15</u>	ANII: <u><i>[Signature]</i></u> DATE: <u>7/14/15</u> PAGE <u>5</u> OF <u>6</u>
--	---	--

TVA

Office of Nuclear Power

PROJECT: WBN SYSTEM: SIS (063)

UNIT: 2 WELD NO: SIF-D123-05


REPORT NO.:

R.D2472

VALVE

FLOW →

ELBOW

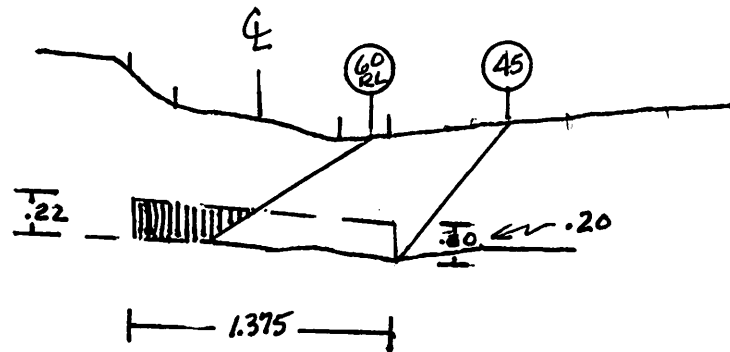

50% one sided examination
code credit coverage
achieved.

BY:

[Signature]

LEVEL: II

DATE: 03-10-15

PAGE 6

OF 6