




**NUCLEAR SAFETY RELATED
ITEMS ARE SHOWN ON THIS DRAWING
(FOR SAFETY CLASSIFICATION SEE PIPING,
EQUIPMENT, VALVE, OR INSTRUMENT LISTS.)**


NOTE
CLINTON POWER STATION
UPDATED SAFETY ANALYSIS REPORT
0-9036

UNLESS OTHERWISE NOTED, SHEET NUMBER & DIAGRAM
REFERENCE ARE SHOWN IN THE FUNCTION SYMBOL.

CLINTON POWER STATION UPDATED SAFETY ANALYSIS REPORT

FIGURE 3.6-1
DIVISIONAL SEPARATION AND
HIGH-ENERGY P&ID'S-
DIESEL GENERATOR OIL SYSTEM
SHEET 43 OF 111

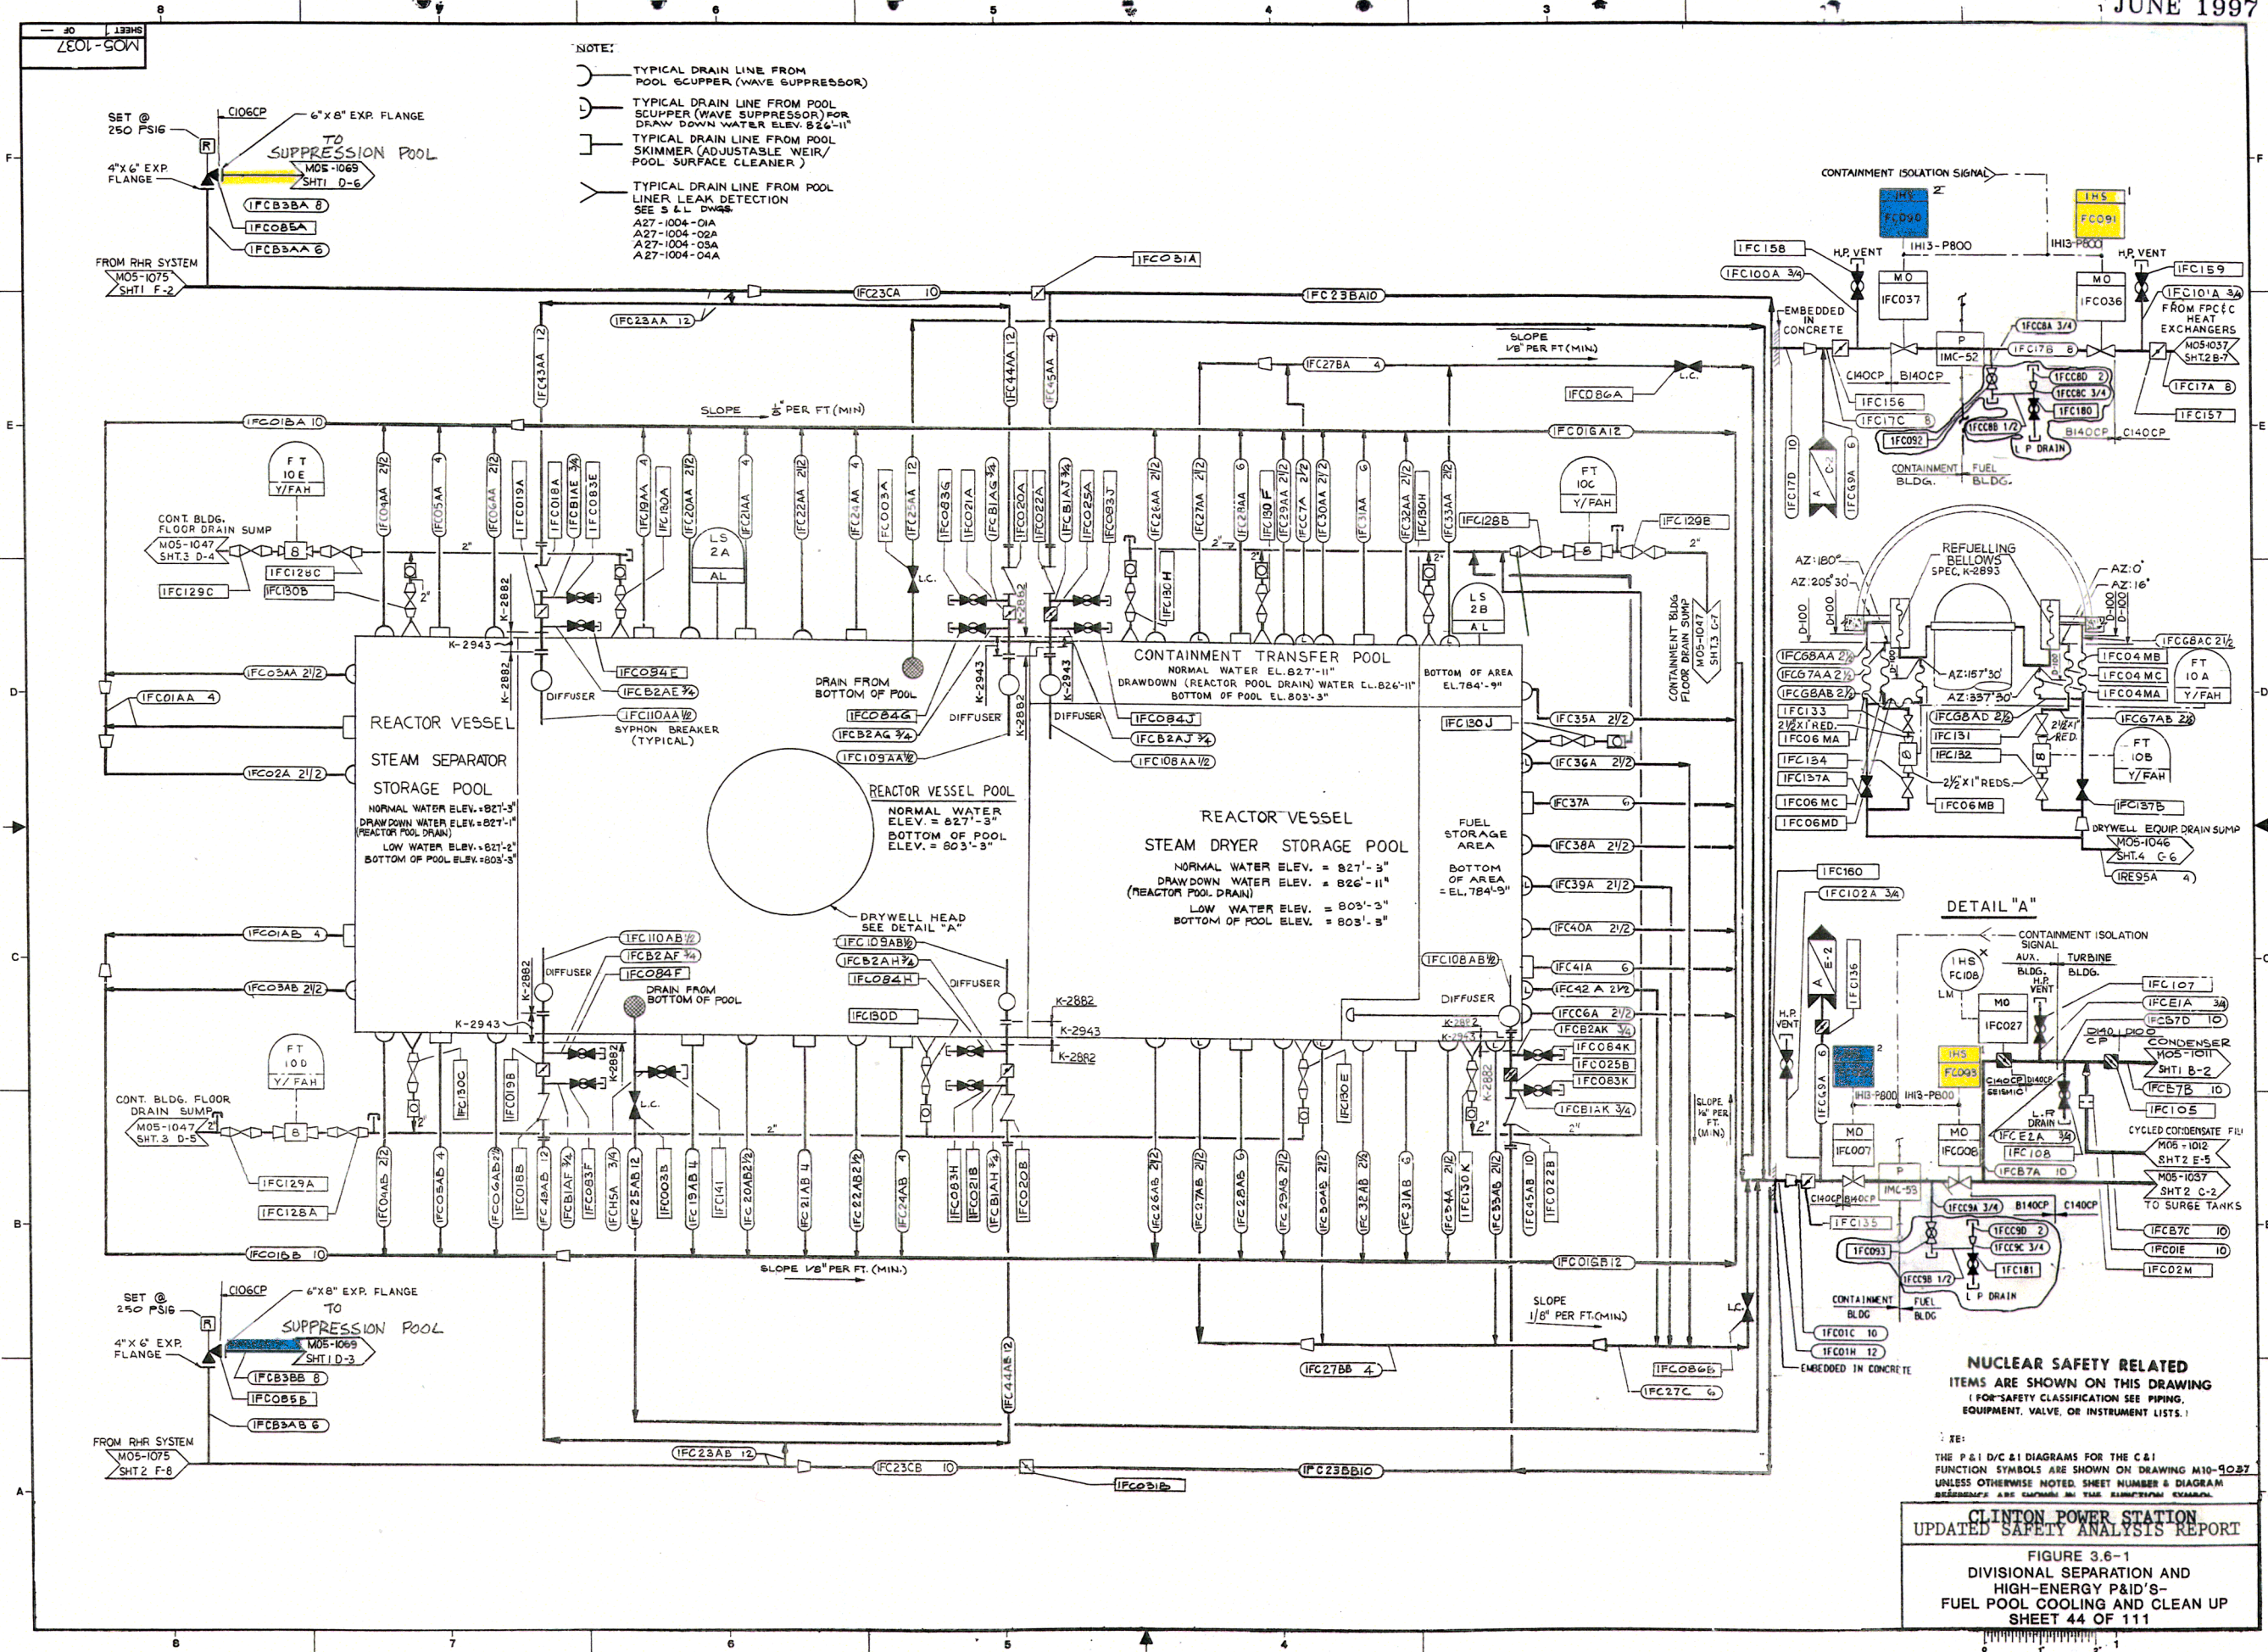

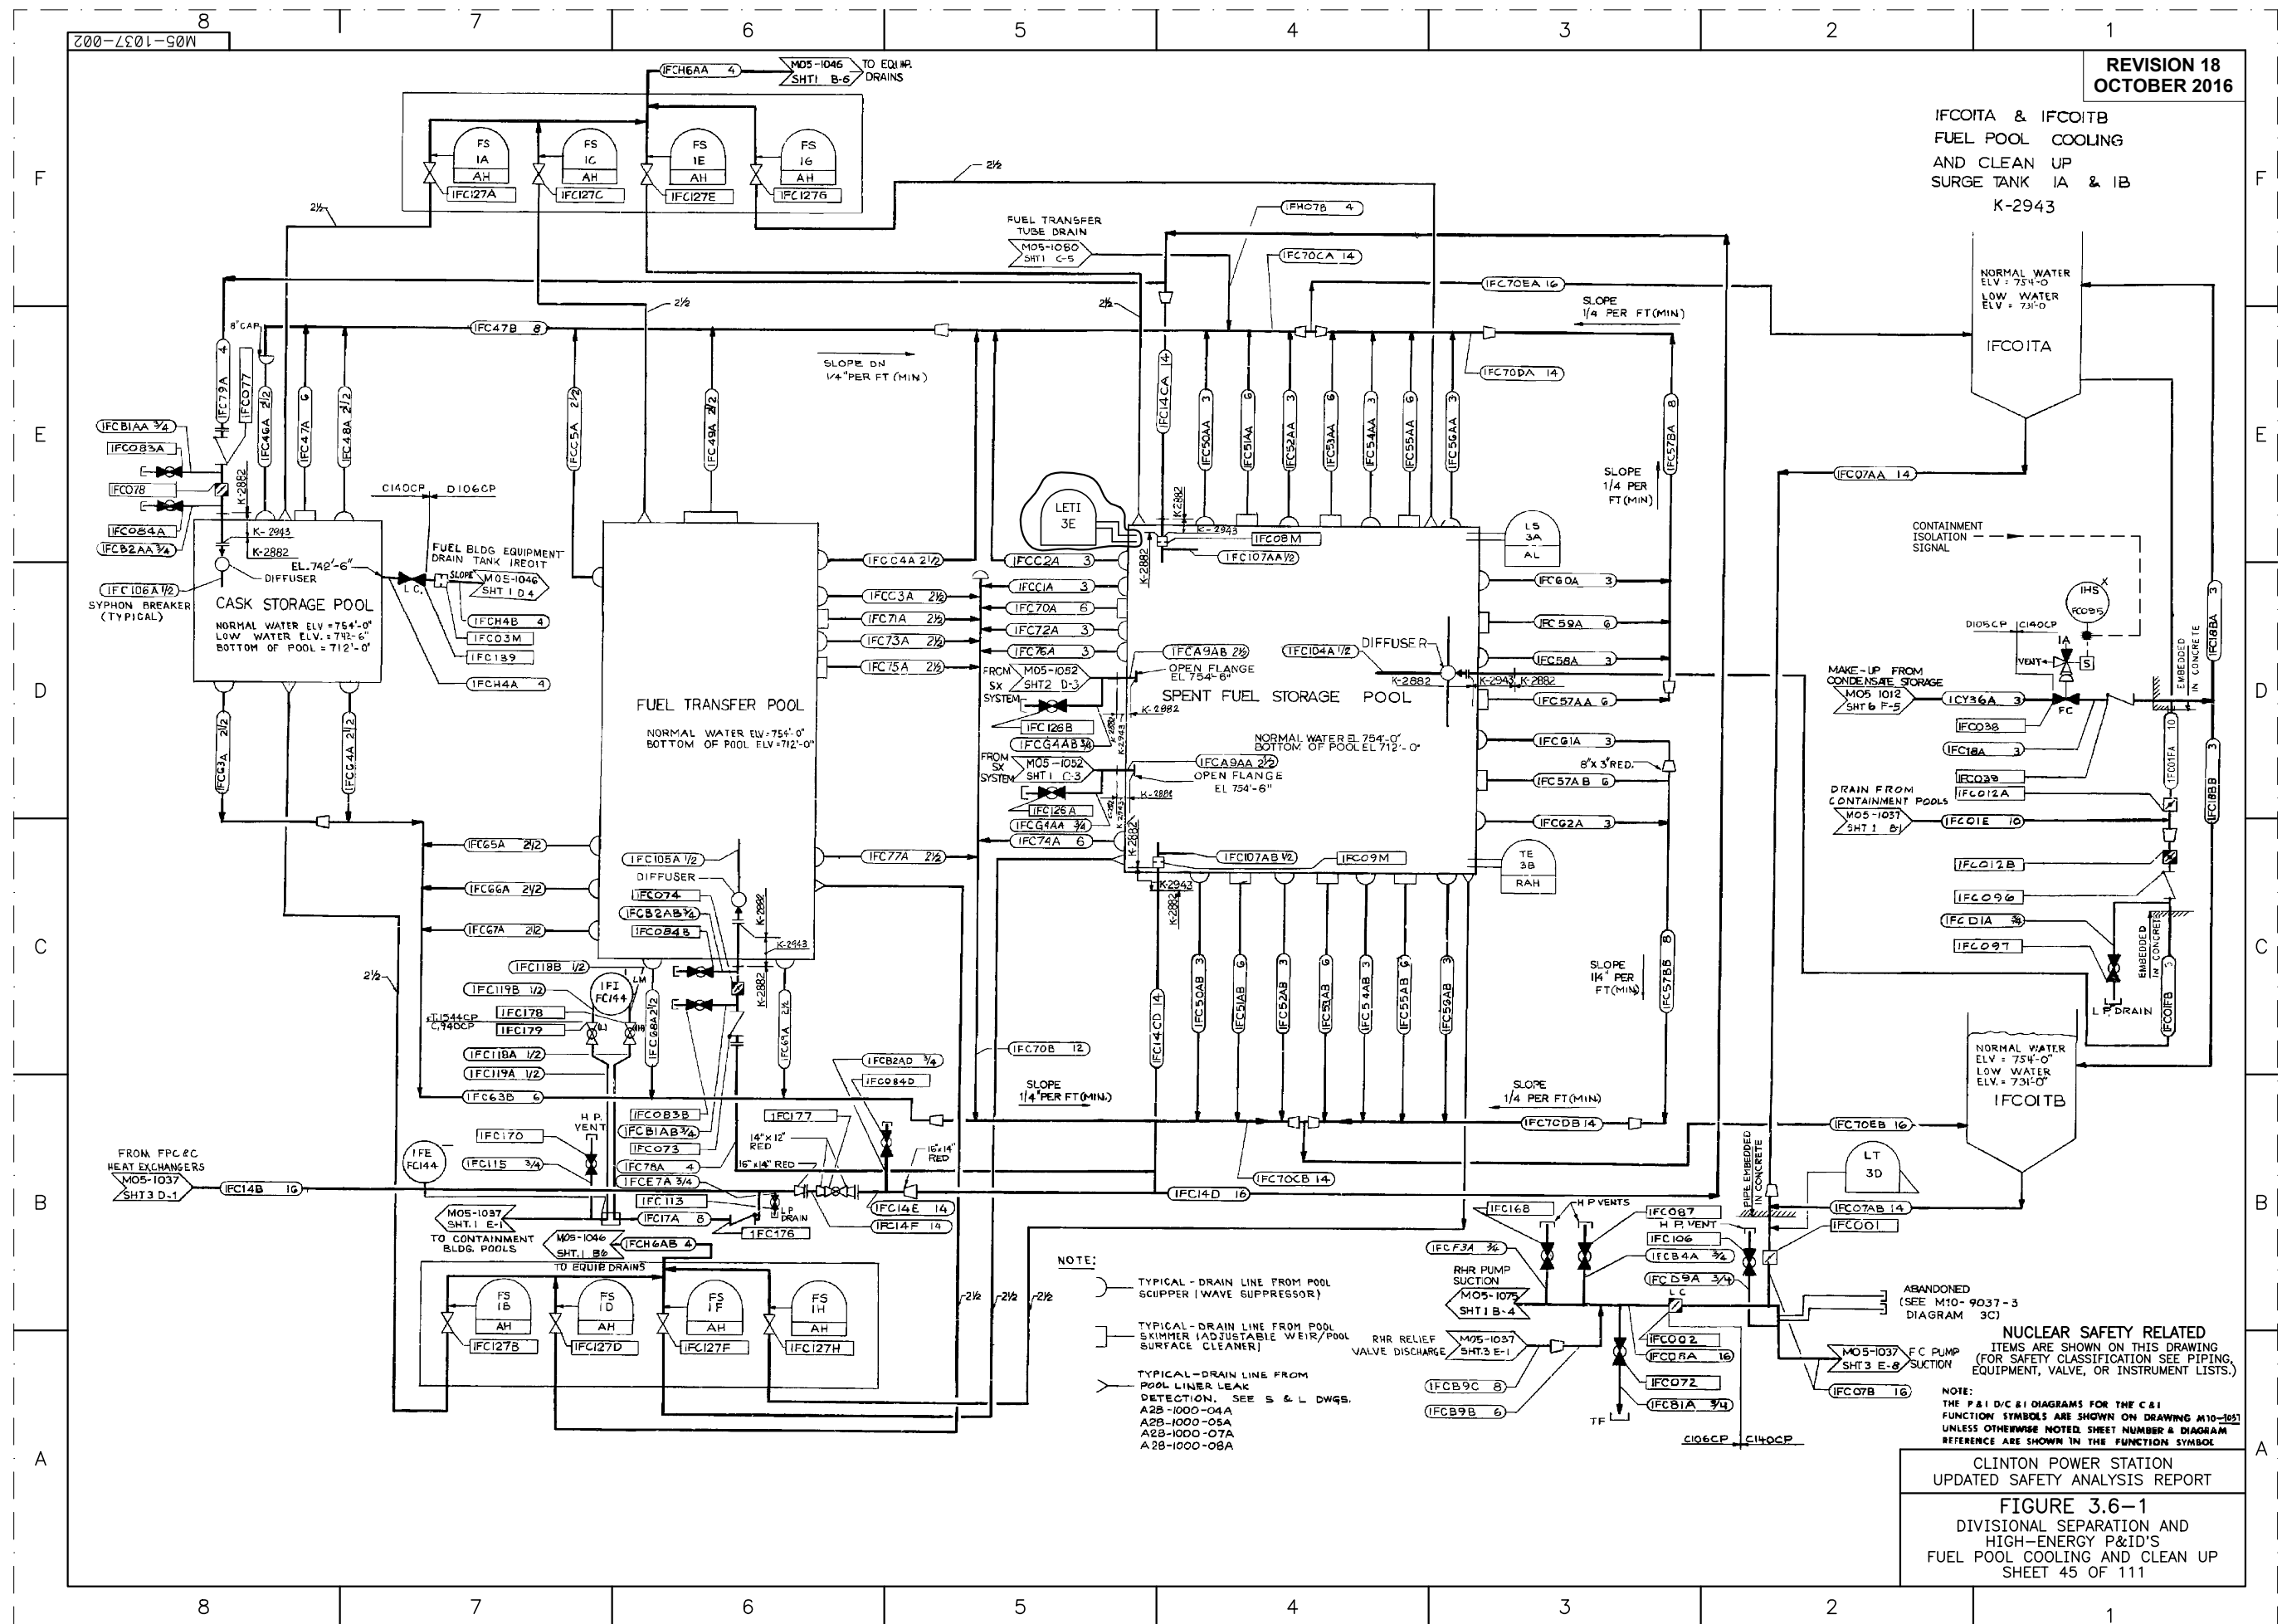

IFCOIAA & IFCOIA B
FUEL POOL COOLING &
CLEAN UP HEAT EXCHANGERS 1A & 1B
K-2815

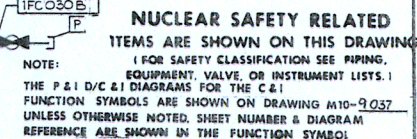


FIGURE 3.6-1
DIVISIONAL SEPARATION AND
HIGH-ENERGY P&ID'S-
FUEL POOL COOLING AND CLEAN UP
SHEET 46 OF 111

2901-90W

IE128001B
REHEAT EXCHANGER 1B
K-2801

ISX01PB
SHUTDOWN SERVICE
WATER PUMP 1B
K-2828

IDG11AB & IDG12AB
DIESEL GEN. 1B
HEAT EXCHANGERS
K-2861

ISX01FB
SHUTDOWN SERVICE
WATER STRAINER 1B
K-2880

OVC13CB
CONTROL ROOM HVAC
SYSTEM CHILLER
K-2905

IVH07SB
SSW PUMP ROOM 1B
COIL CABINET
K-2902

IVY05S
ECCS RHR HEAT
EXCHANGER ROOM 1B
COIL CABINET
K-2902


IVX13SB
INVERTER ROOM 1B
COIL CABINET
K-2902

IVX14S
DIVISION 1X INVERTER
ROOM COIL CABINET
K-2902

OVG05SB
SBGT ROOM 1B
COIL CABINET
K-2902

OVG07SB
HYDROGEN RECOMBINER
ROOM 1B COIL CABINET
K-2902


IVY10A
MSIV LEAKAGE OUTBOARD
ROOM COIL CABINET
K-2902

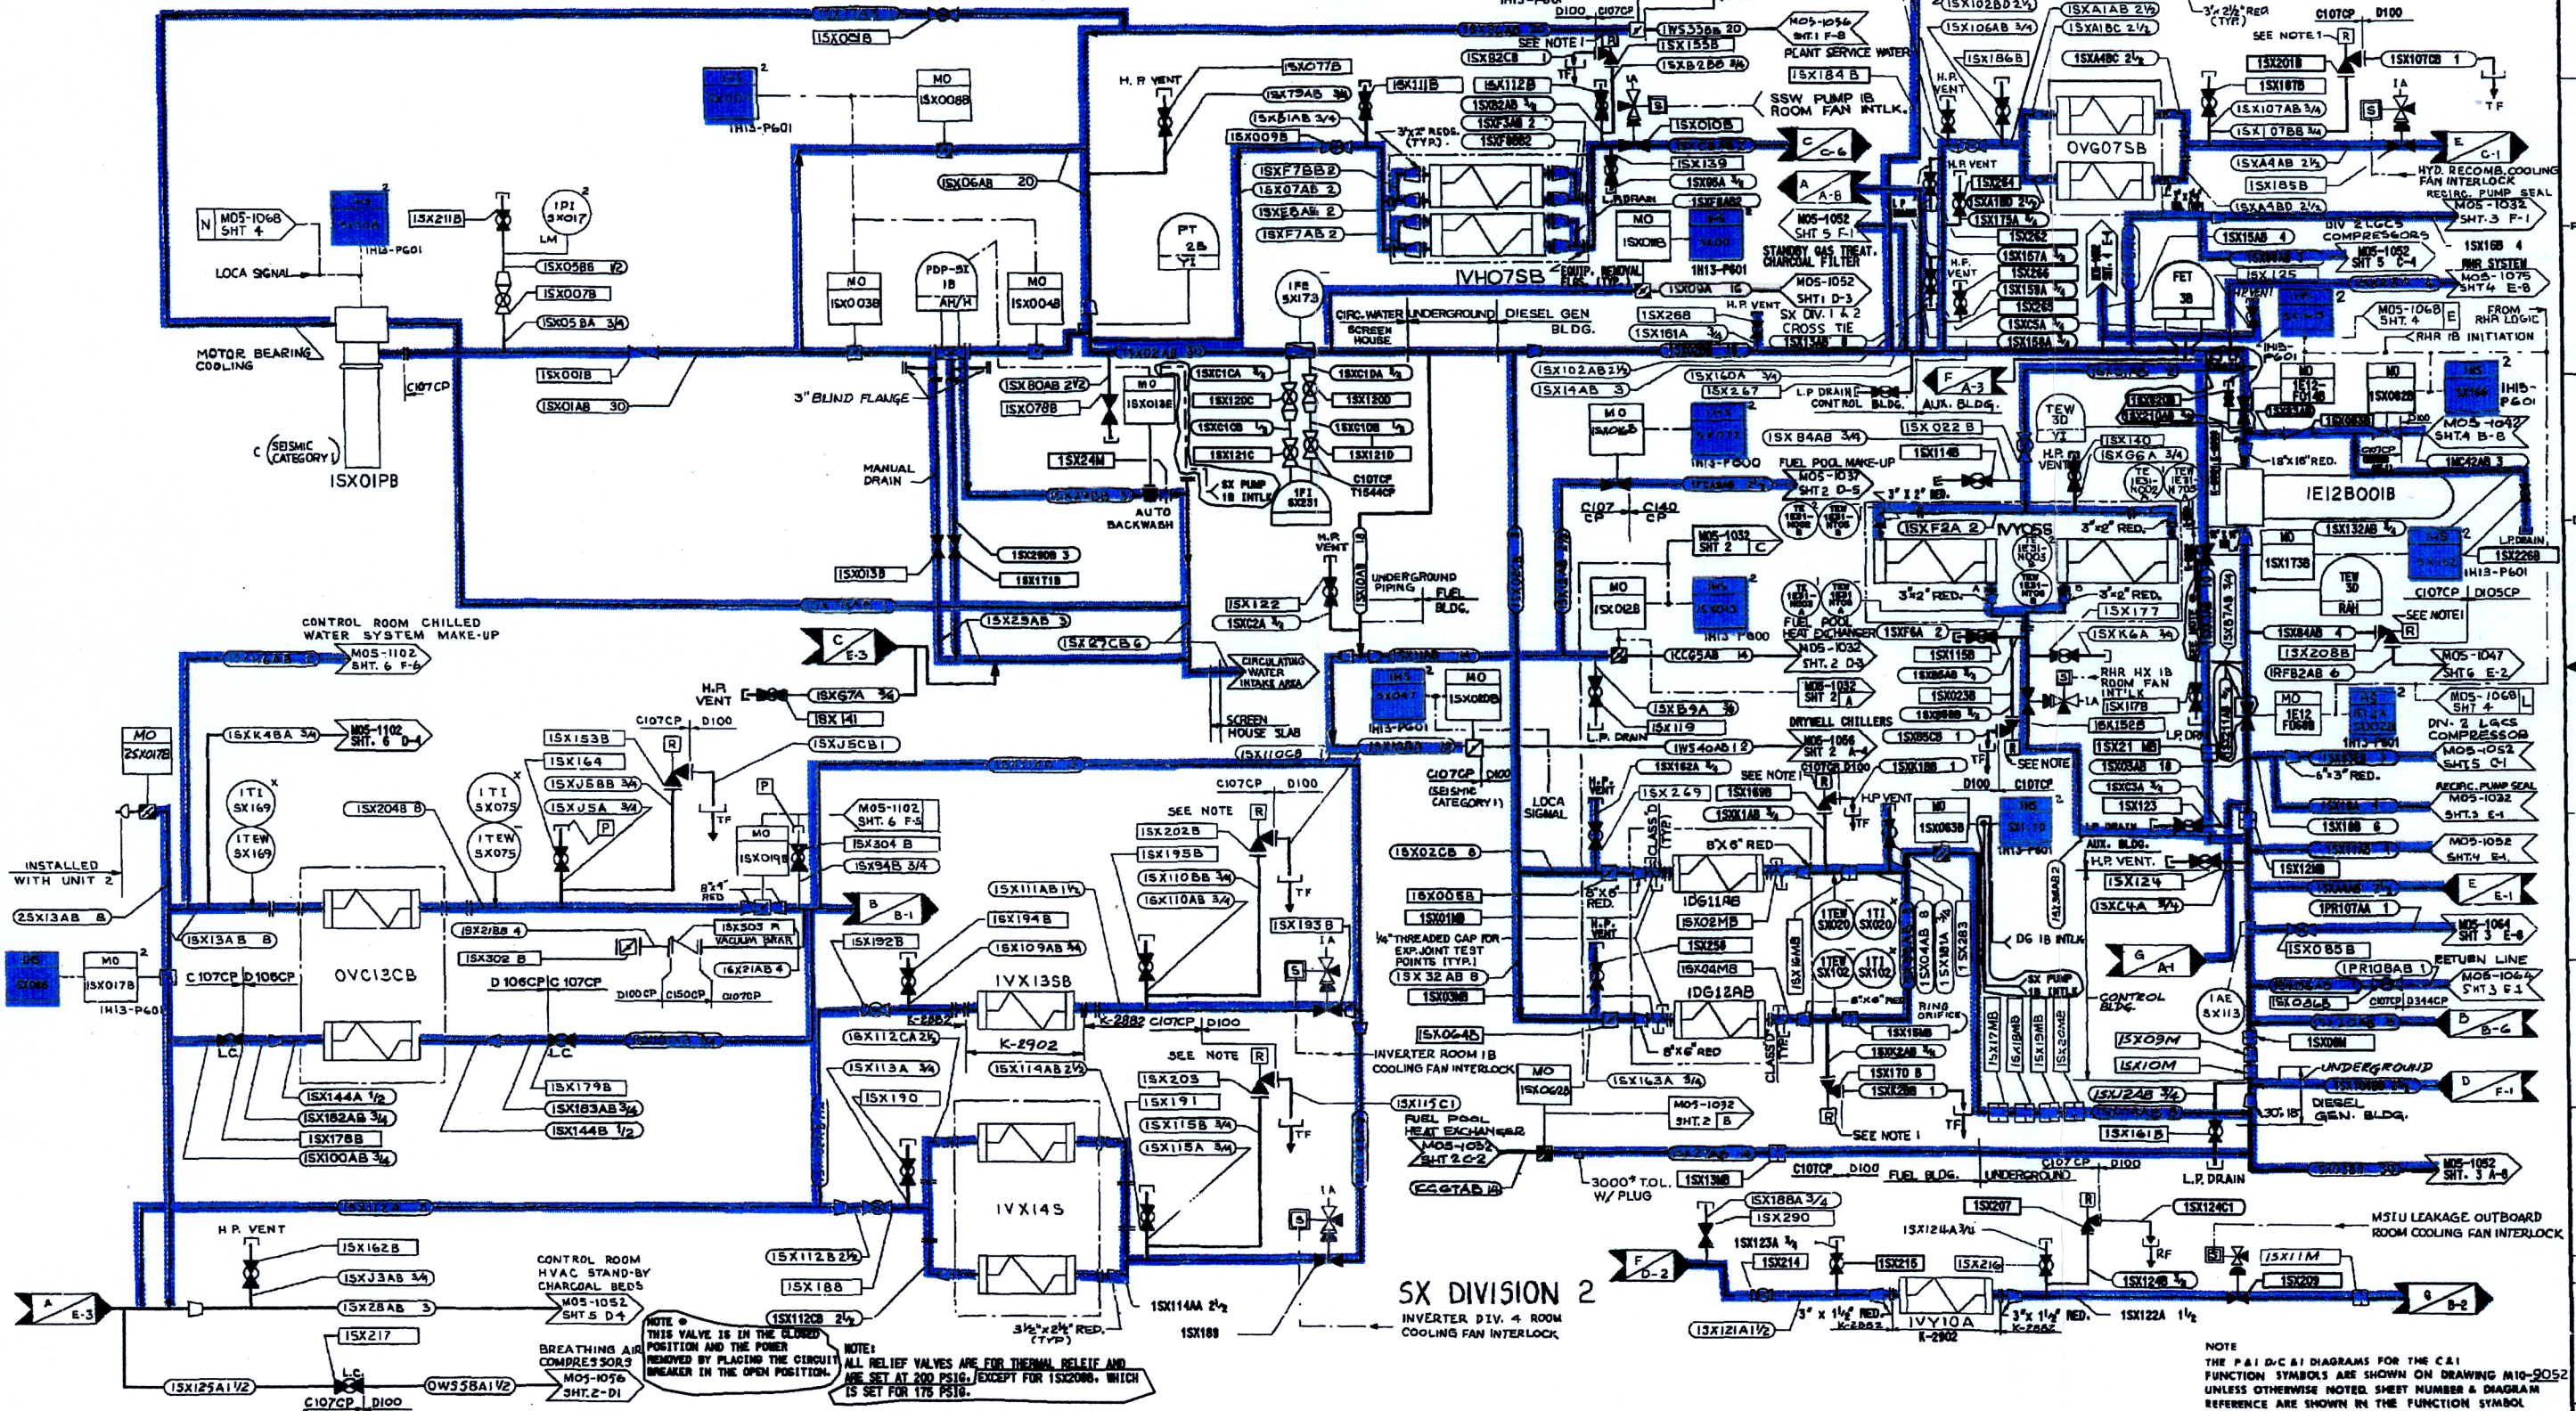

CLINTON POWER STATION
UPDATED SAFETY ANALYSIS REPORT

FIGURE 3.6-1

DIVISIONAL SEPARATION
HIGH-ENERGY P&ID
SHUTDOWN SERVICE WATER
SHEET 48 OF 111



NOTE
THE P & I D/C & I DIAGRAMS FOR THE C & I
FUNCTION SYMBOLS ARE SHOWN ON DRAWING MIO-9052
UNLESS OTHERWISE NOTED. SHEET NUMBER & DIAGRAM
REFERENCE ARE SHOWN IN THE FUNCTION SYMBOL.

CLINTON POWER STATION UPDATED SAFETY ANALYSIS REPORT

FIGURE 3.6-1
DIVISIONAL SEPARATION AND
HIGH-ENERGY P&ID'S-
SHUTDOWN SERVICE WATER
SHEET 49 OF 111