

FIGURE 18.2-1

SPDS VARIABLE STATUS FLOW CHART

**NIAGARA MOHAWK POWER CORP.
NINE MILE POINT-UNIT 2
UPDATED SAFETY ANALYSIS REPORT**


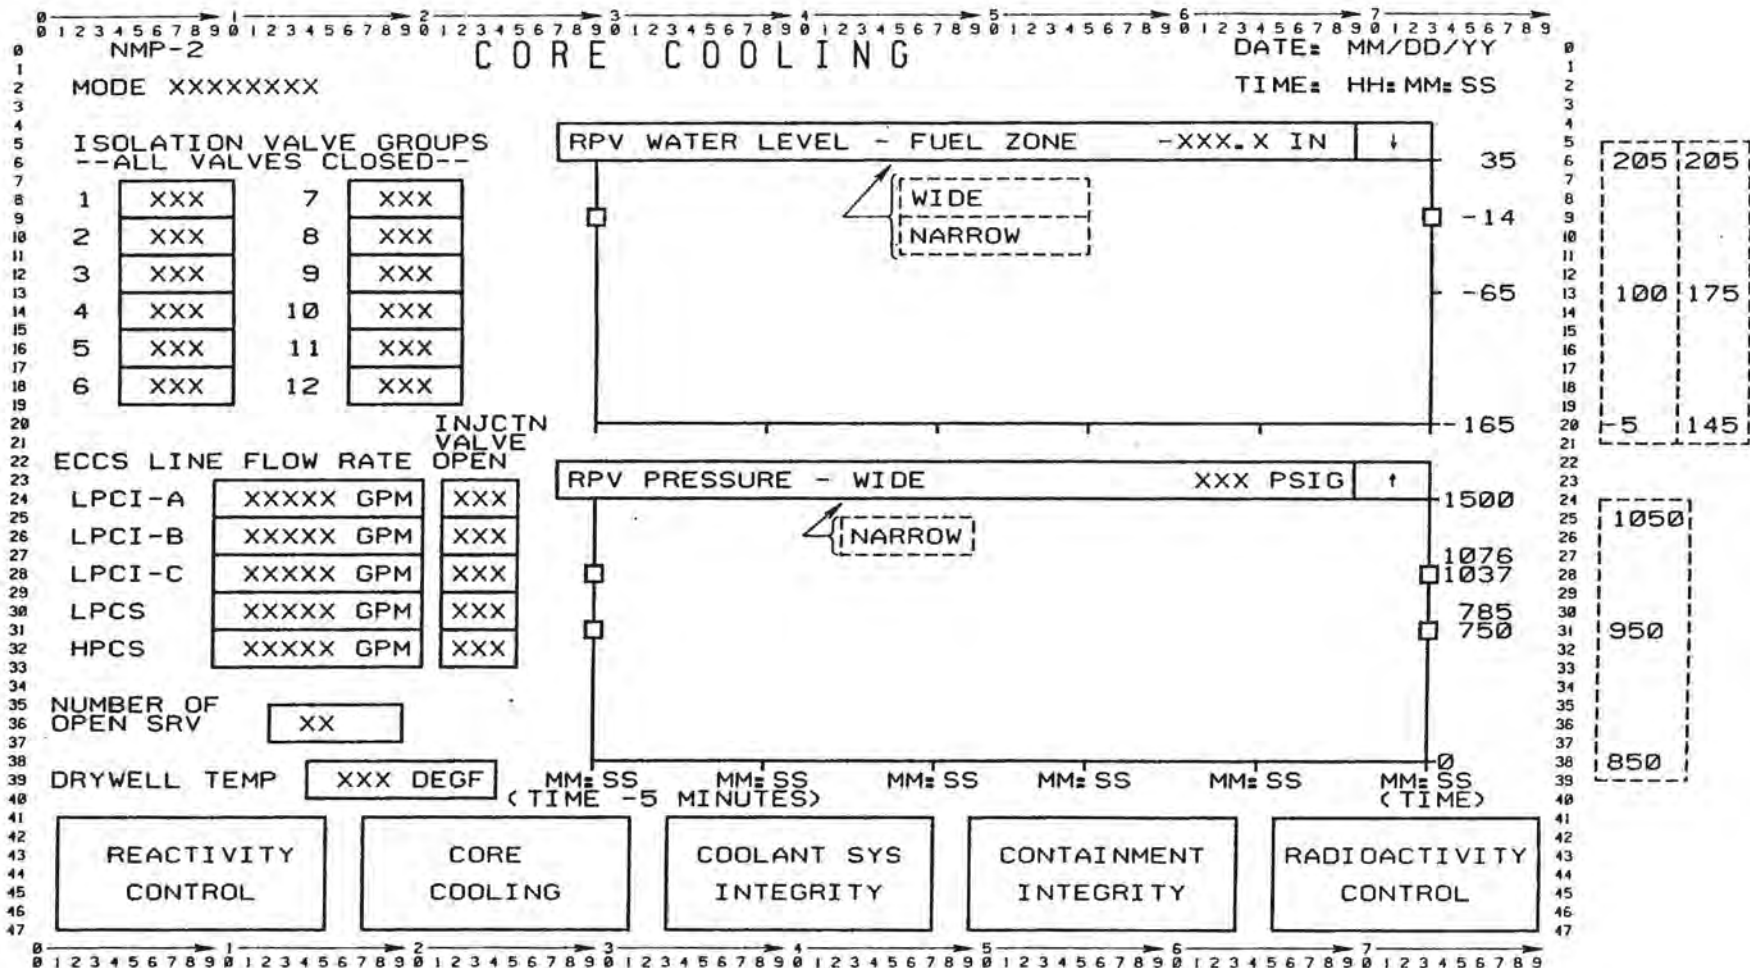


FIGURE 18.2-4

CORE COOLING DISPLAY

NIAGARA MOHAWK POWER CORPORATION
NINE MILE POINT-UNIT 2
UPDATED SAFETY ANALYSIS REPORT

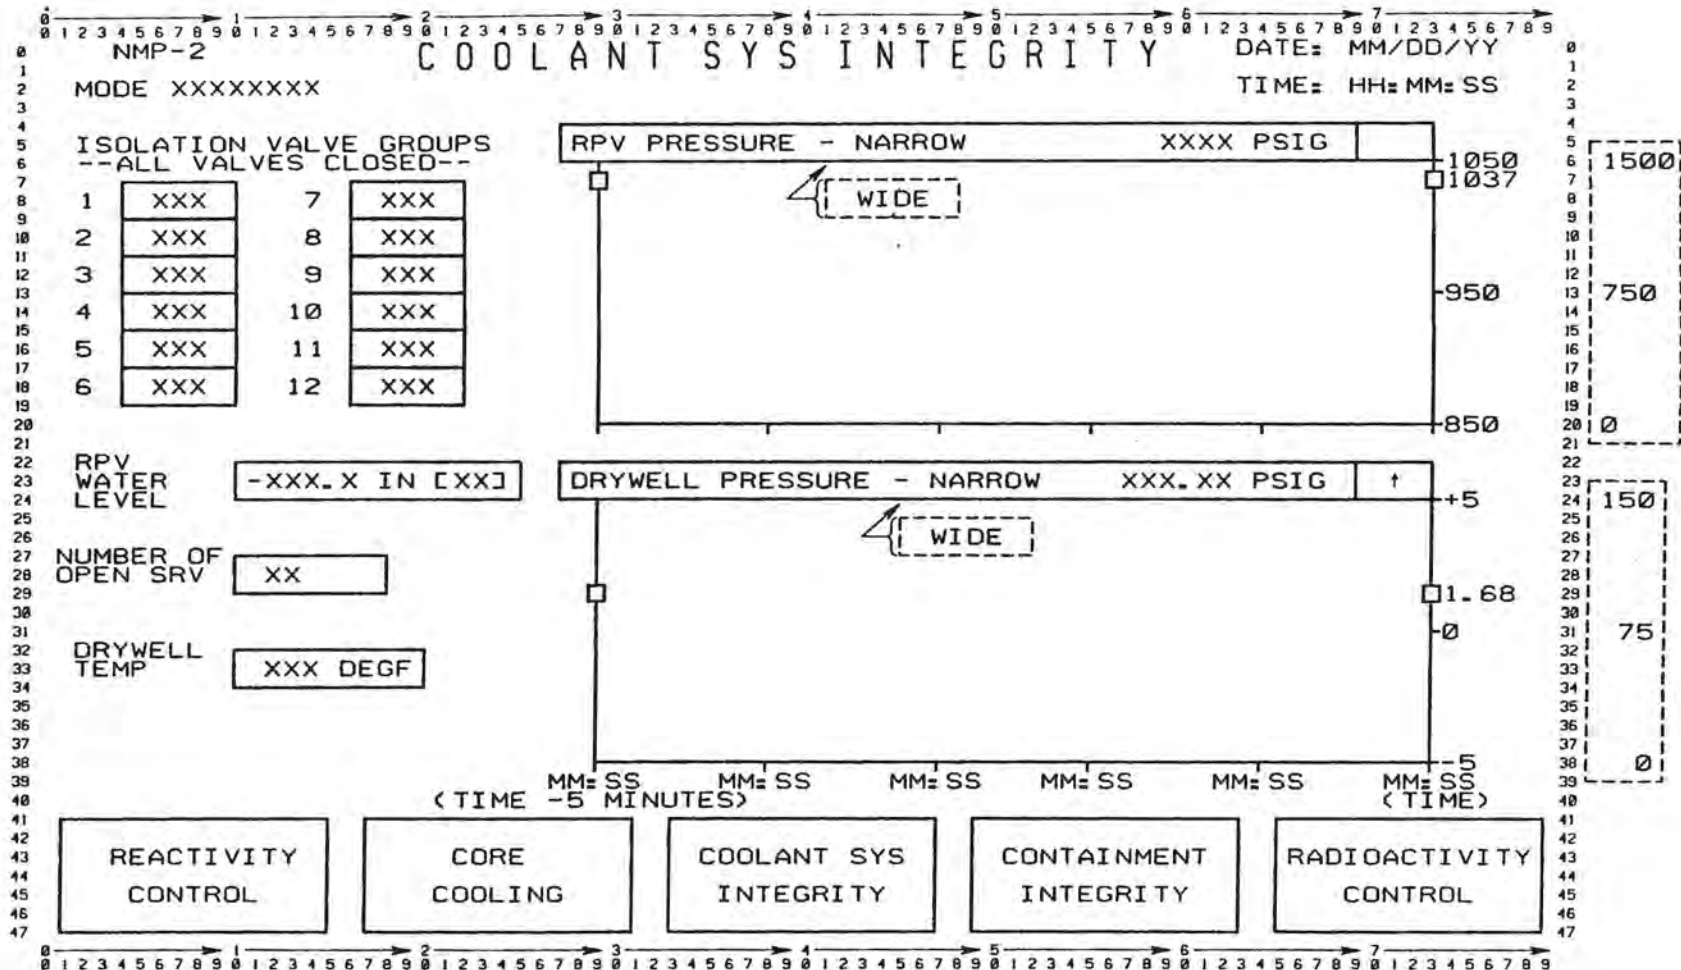


NOTE: PERIMETER GRID IS FOR INFORMATION ONLY.
ALARM MARKS ARE FOR INFORMATION/ILLUSTRATION
ONLY AND DO NOT REPRESENT ACTUAL SETPOINT VALUES.

FIGURE 18.2-5

COOLANT SYSTEM INTEGRITY
DISPLAY

NIAGARA MOHAWK POWER CORPORATION
NINE MILE POINT-UNIT 2
UPDATED SAFETY ANALYSIS REPORT

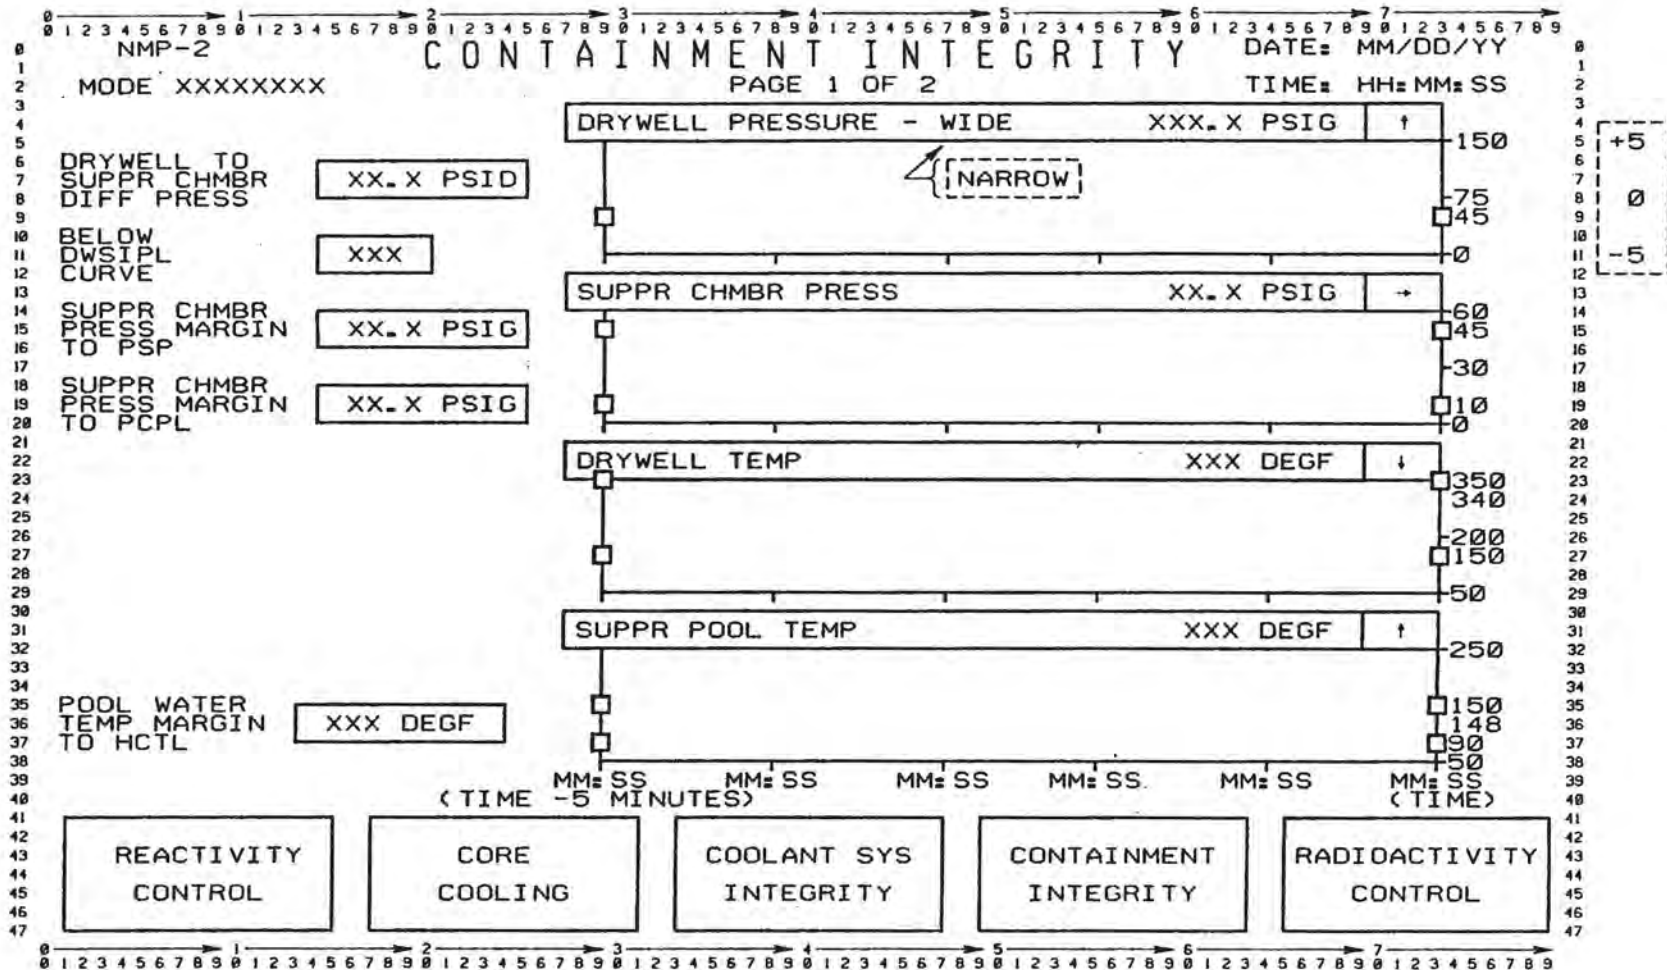


NOTE: PERIMETER GRID IS FOR INFORMATION ONLY.
ALARM MARKS ARE FOR INFORMATION/ILLUSTRATION
ONLY AND DO NOT REPRESENT ACTUAL SETPOINT VALUES.

FIGURE 18.2-6 (SHEET 1 OF 2)

CONTAINMENT INTEGRITY DISPLAY
(PAGE 1 OF 2)

NIAGARA MOHAWK POWER CORPORATION
NINE MILE POINT-UNIT 2
UPDATED SAFETY ANALYSIS REPORT

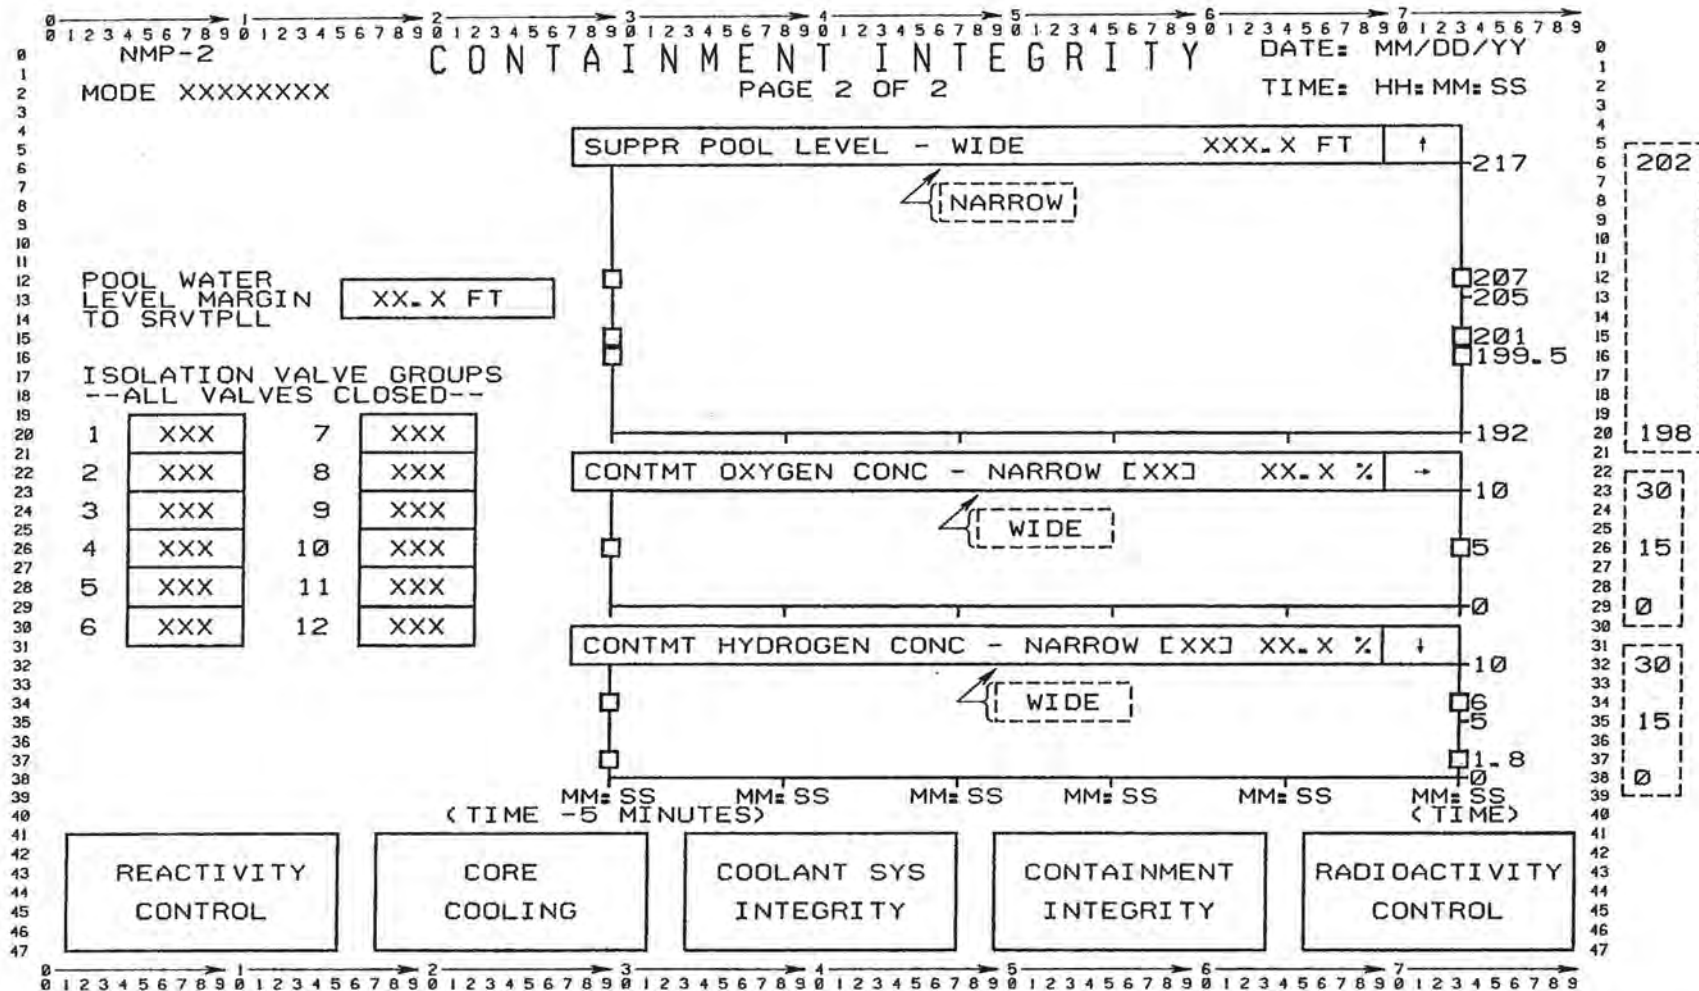


NOTE: PERIMETER GRID IS FOR INFORMATION ONLY.
ALARM MARKS ARE FOR INFORMATION/ILLUSTRATION ONLY AND DO NOT REPRESENT ACTUAL SETPOINT VALUES.

FIGURE 18.2-6 (SHEET 2 OF 2)

CONTAINMENT INTEGRITY DISPLAY
(PAGE 2 OF 2)

NIAGARA MOHAWK POWER CORPORATION
NINE MILE POINT-UNIT 2
UPDATED SAFETY ANALYSIS REPORT

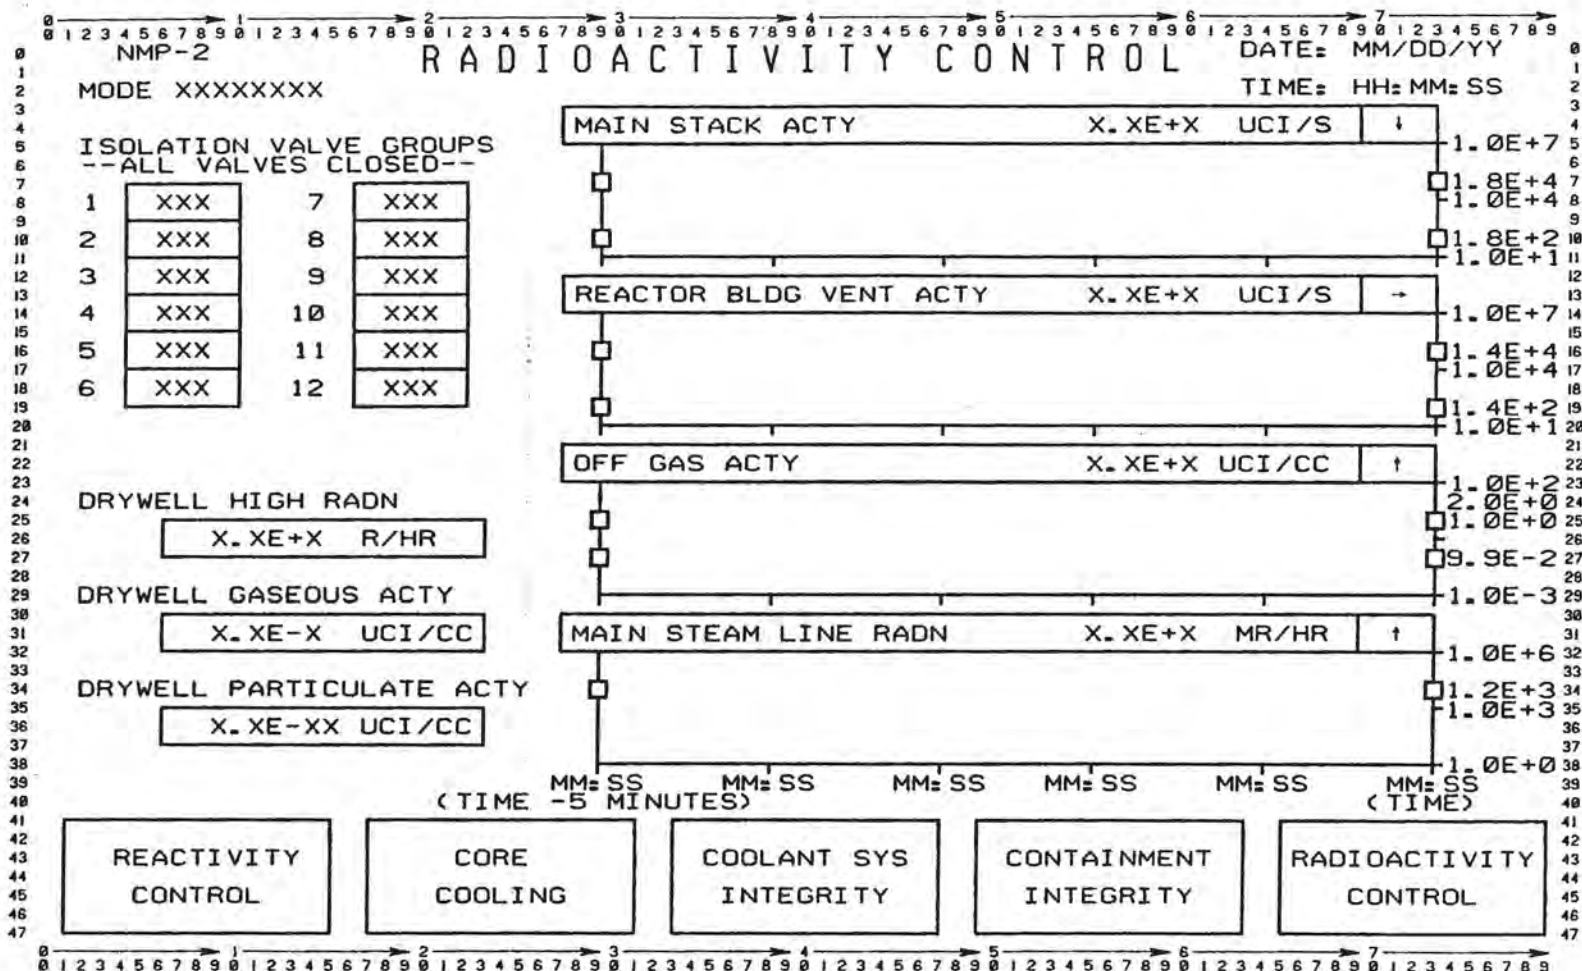

NOTE: PERIMETER GRID IS FOR INFORMATION ONLY.
ALARM MARKS ARE FOR INFORMATION/ILLUSTRATION
ONLY AND DO NOT REPRESENT ACTUAL SETPOINT VALUES.

FIGURE 18.2-7

RADIOACTIVITY CONTROL DISPLAY

NIAGARA MOHAWK POWER CORPORATION
NINE MILE POINT-UNIT 2
UPDATED SAFETY ANALYSIS REPORT

