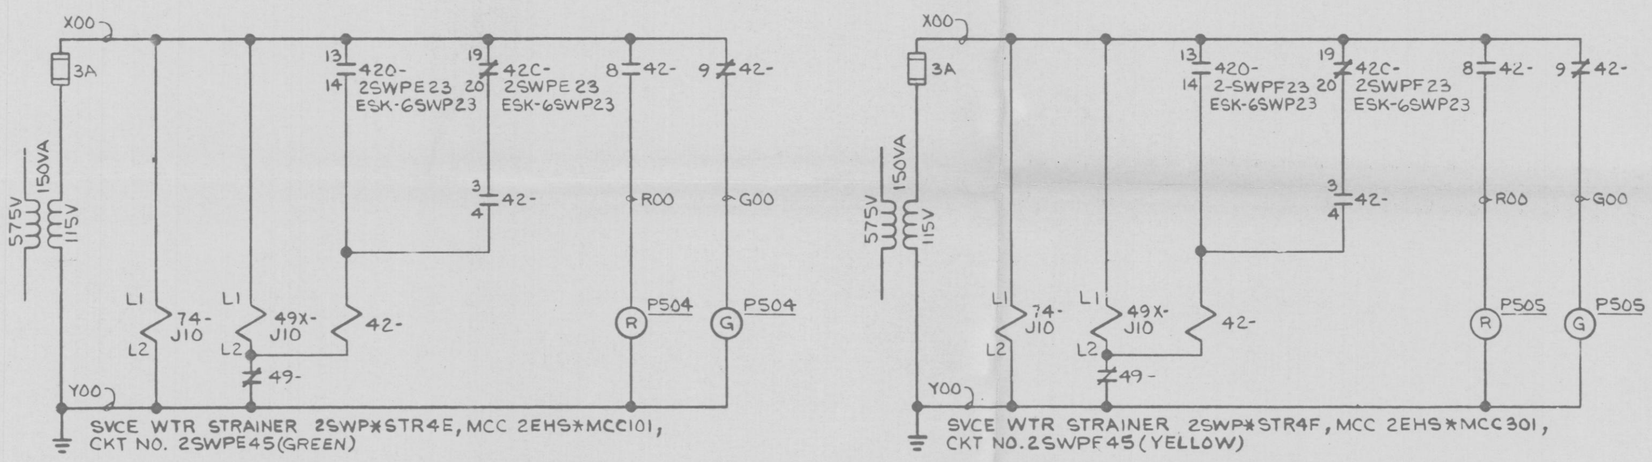

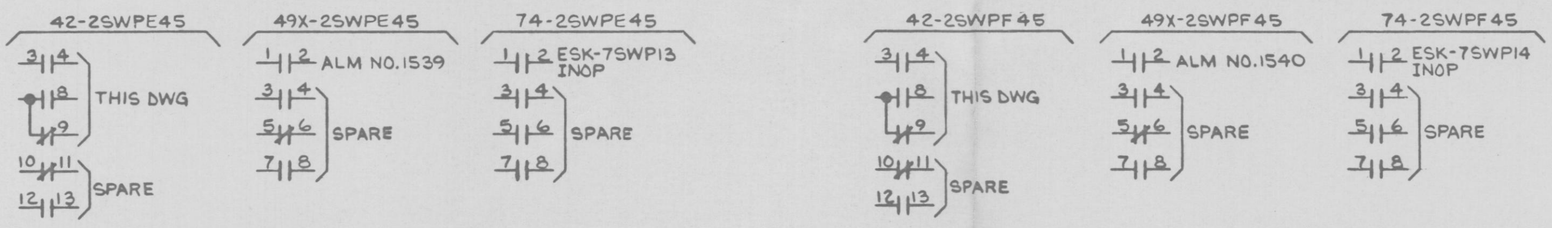

NOTES:
1. ALL EQUIPMENT LOCATED AT MCC UNLESS OTHERWISE NOTED.
2. LOGIC DIAGRAM LSK-9-10E
3. P505- DENOTES 2CES-IPNL505

PRC APERTURE CARD

D

NUCLEAR SAFETY RELATED
QA CAT I

AC ELEM DIAG - 600V MCC CKT
SERVICE WATER SYSTEM
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION
STONE & WEBSTER ENGINEERING CORPORATION

DESIGN CONTROL ISSUE
M 3/4/81
1 3/4/81

12177-ESK-6SWP40

JST

GE-LSTG
GE-NED