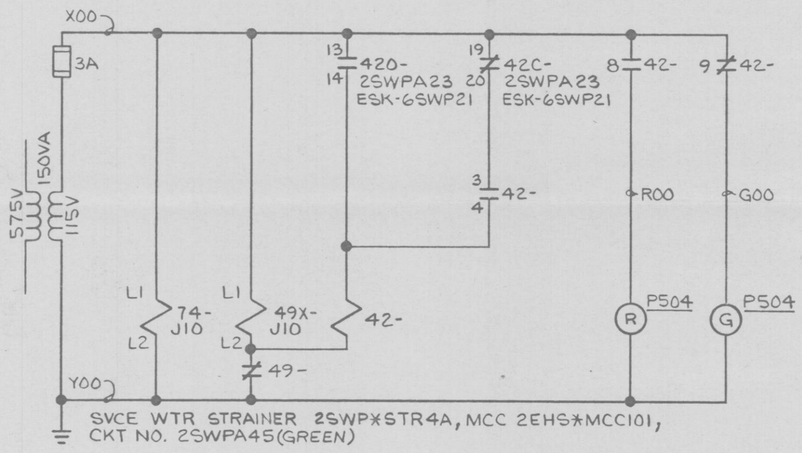

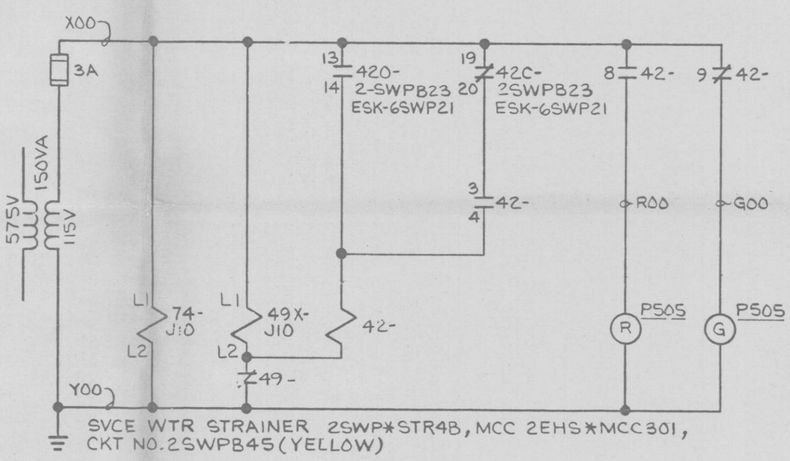

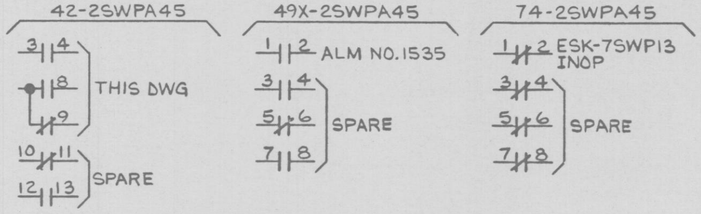

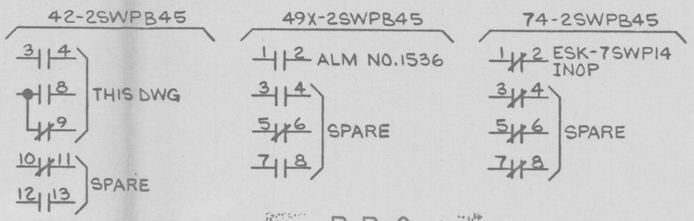

NOTES:
1. ALL EQUIPMENT LOCATED AT MCC UNLESS OTHERWISE NOTED.
2. LOGIC DIAGRAM LSK-9-10E
3. P505- DENOTES 2CES-IPNL505

PRC APERTURE CARD

NUCLEAR SAFETY RELATED
QA CAT I

	AC ELEM DIAG - 600V MCC CKT
	SERVICE WATER SYSTEM
	NINE MILE POINT NUCLEAR STATION - UNIT 2
	NIAGARA MOHAWK POWER CORPORATION
	STONE & WEBSTER ENGINEERING CORPORATION
DESIGN CONTROL ISSUE	12177-ESK-6SWP38

JST

GE-NED GE-LSTG