
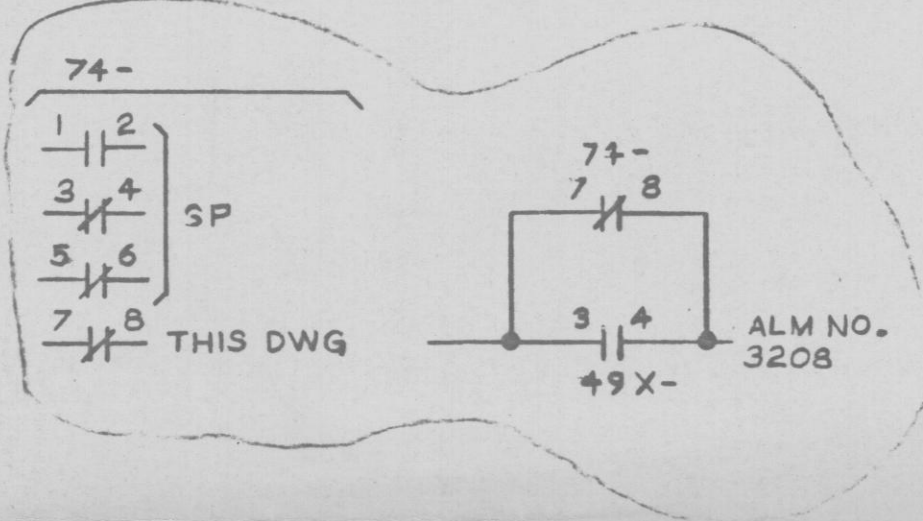


1

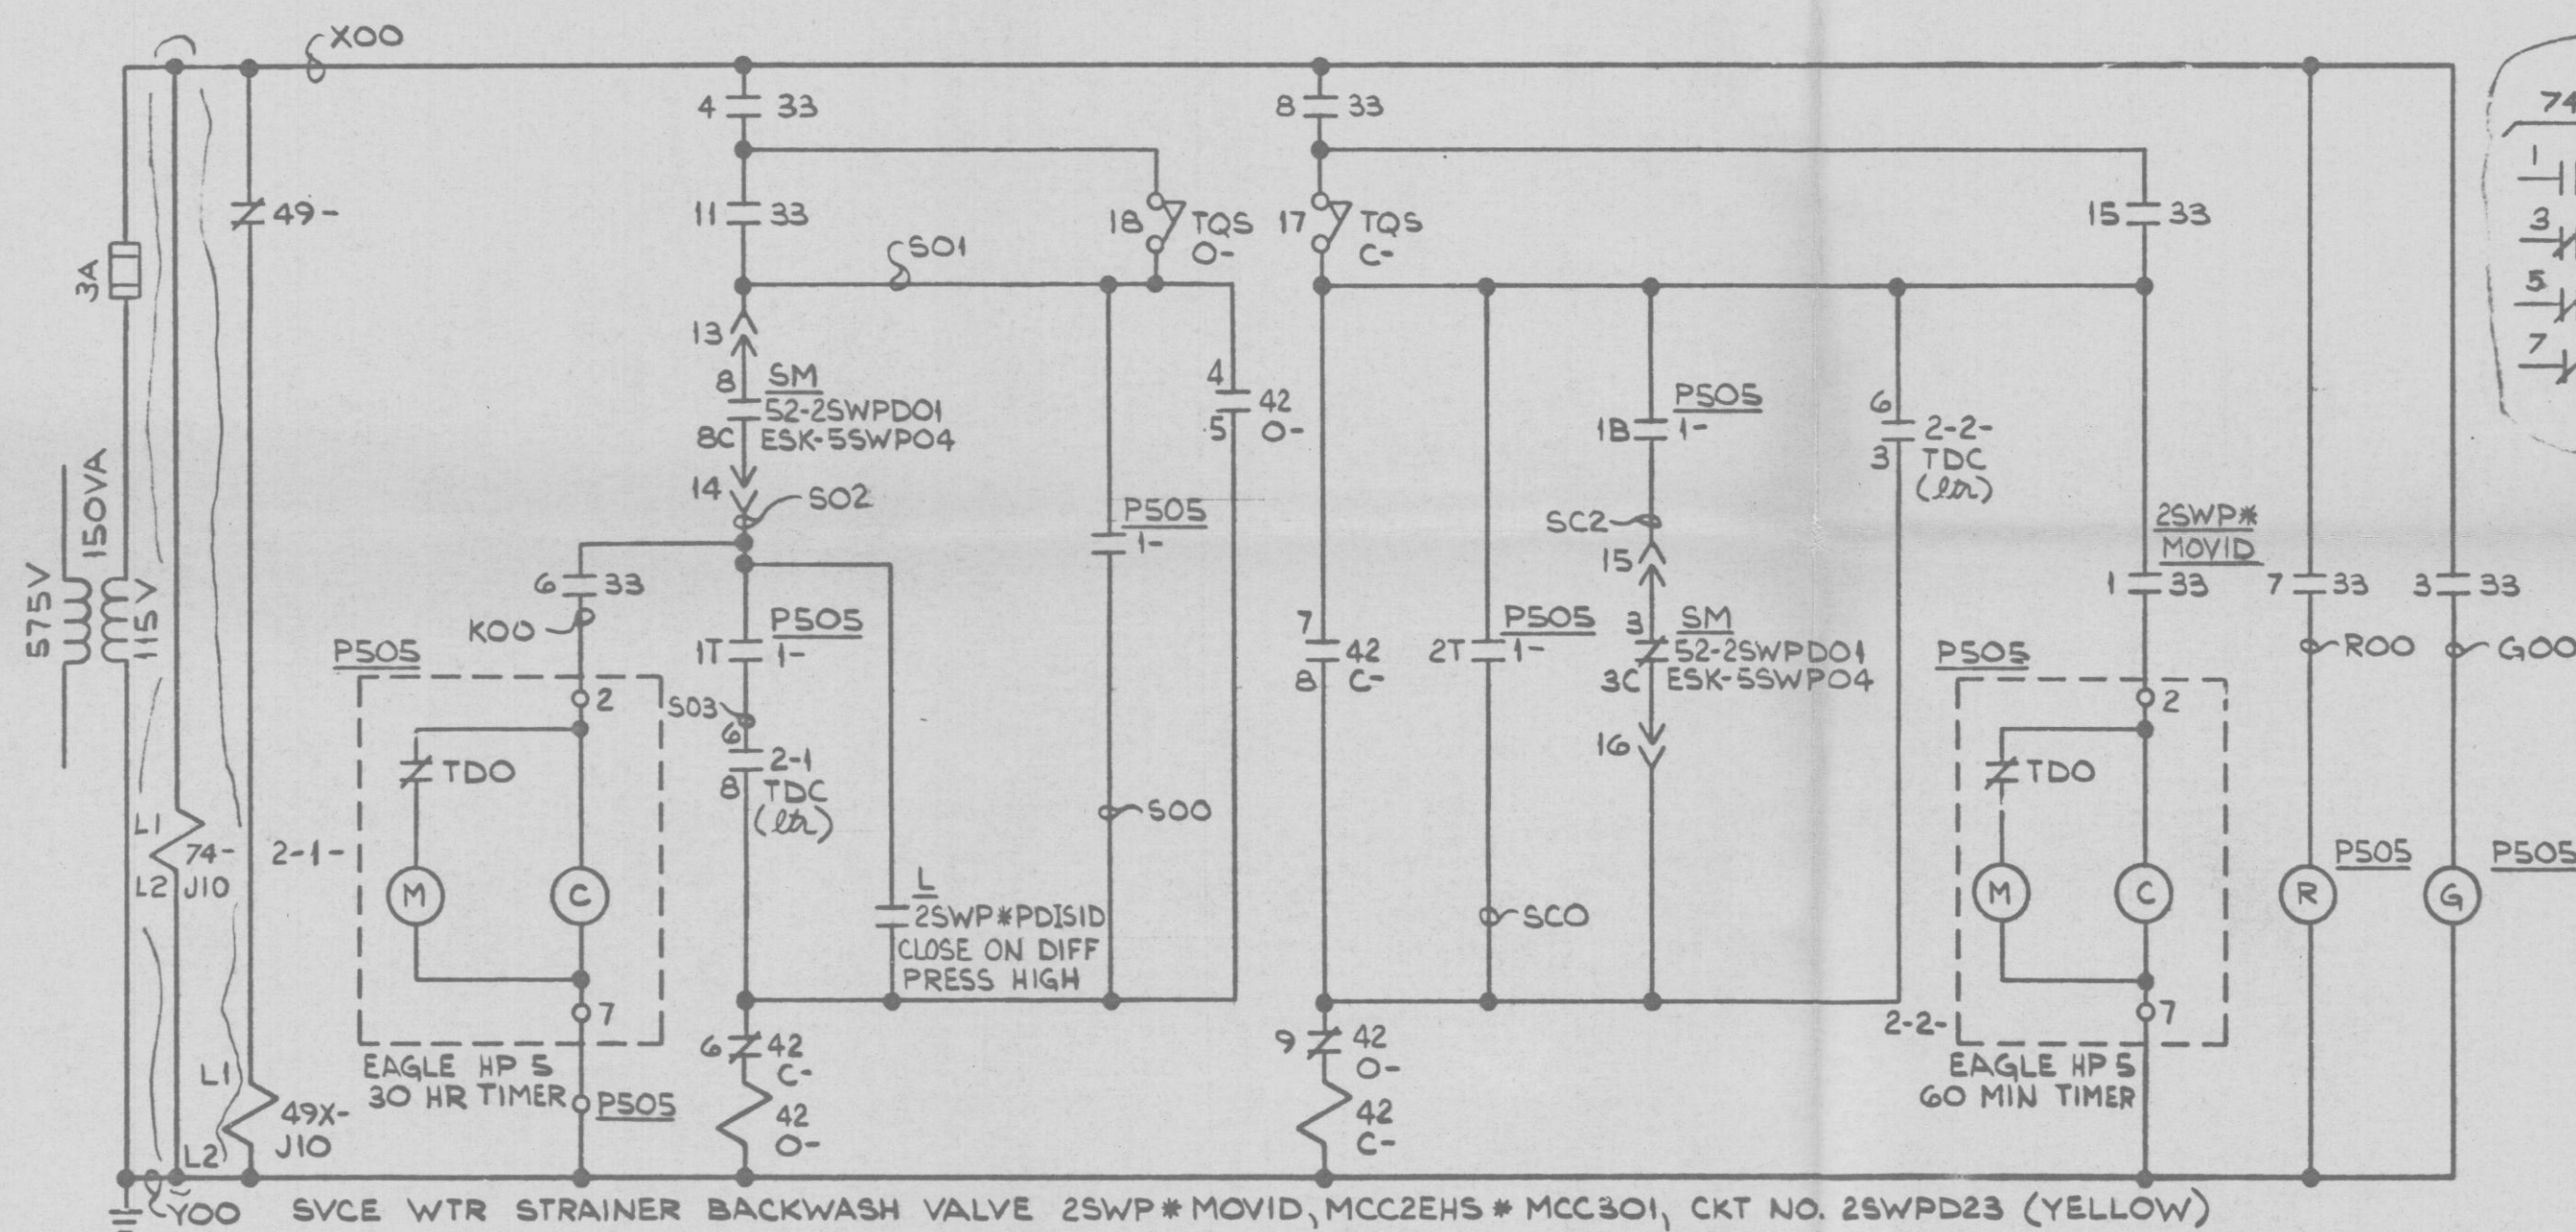

PRC  
APERTURE  
CARD

# NOTES:

1. VALVE LIMIT SWITCHES LOCATED ON VALVE ACTUATOR ALL OTHER EQUIPMENT LOCATED AT MCC UNLESS OTHERWISE NOTED.
2. LOGIC DIAGRAM LSK-9-IOE
3. PS05- DENOTES 2CES-IPNL505

NUCLEAR SAFETY RELATED  
QA CAT I

AC ELEM DIAG-600V MCC CKTS  
SVCE WTR STR BACKWASH VALVES  
NINE MILE POINT NUCLEAR STATION-UNIT 2  
NIAGARA MOHAWK POWER CORPORATION  
STONE & WEBSTER ENGINEERING CORPORATION  
12177-ESK-6SWP22 SH 2 OF 2

D

420-	42C-	49X-
4 5	7 8	1 2 SPARE
13 14	17 18	3 4 THIS DWG
15 16	19 20	5 6 SPARE
7 8	21 22	7 8 SPARE
NOT WIRED OUT	NOT WIRED OUT	

2SWP*PDISID	2-1-	2-2-
THIS DWG	1 3 SPARE	1 3 SPARE
SPARE	8 6 THIS DWG	8 6 THIS DWG
ALM NO. 1559	5 5 SPARE	5 5 SPARE
SPARE		

CS	DETAIL	ESK	SPARE
1-2SWPD23	*H2	3B	

7	6	5	4	3	2	1
ECN-001	6-4-82	10/11/82	10/11/82	10/11/82	10/11/82	10/11/82
JRM						