


PRC
APERTURE
CARD

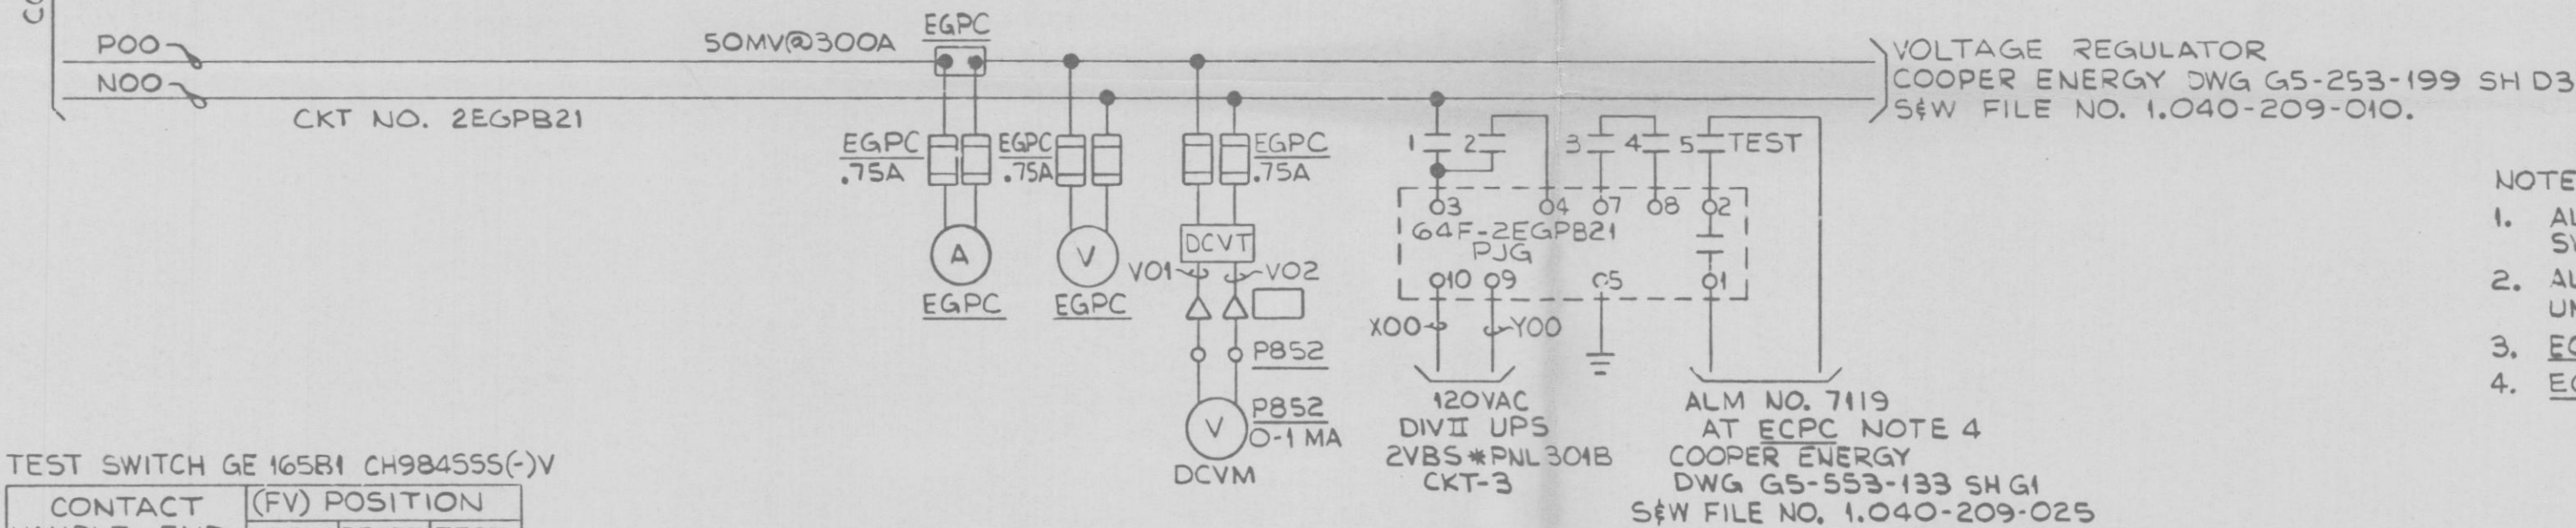

NOTES:

1. ALL EQUIPMENT LOCATED AT SWGR UNLESS OTHERWISE NOTED.
2. ALL CIRCUITS YELLOW UNLESS OTHERWISE NOTED.
3. EGPC: 2CEC*IPNL 412
4. ECPC: 2CEC*IPNL 408

TEST SWITCH GE 165B1 CH984555(-)V

CONTACT		(FV) POSITION			
HANDLE	END	NORM	RESET	TEST	
1-10	2-10	1	x		x
3-10	4-10	3		x	
5-10	6-10	5	x		
		6		x	x

CS AS-2EGPB02 TEST SW DETAIL ON THIS DWG
DETAIL "E" 3A
ESK SPARE USED ON 6

NUCLEAR SAFETY RELATED
QA CAT I

AC ELEM DIAG CURRENT CKT
DIESEL GEN 2EGS*EG3 RLY & MTR
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION
STONE & WEBSTER ENGINEERING CORPORATION



12177-ESK-8EGPO3 SH 2 OF 2

D