


PRC
APERTURE
CARD

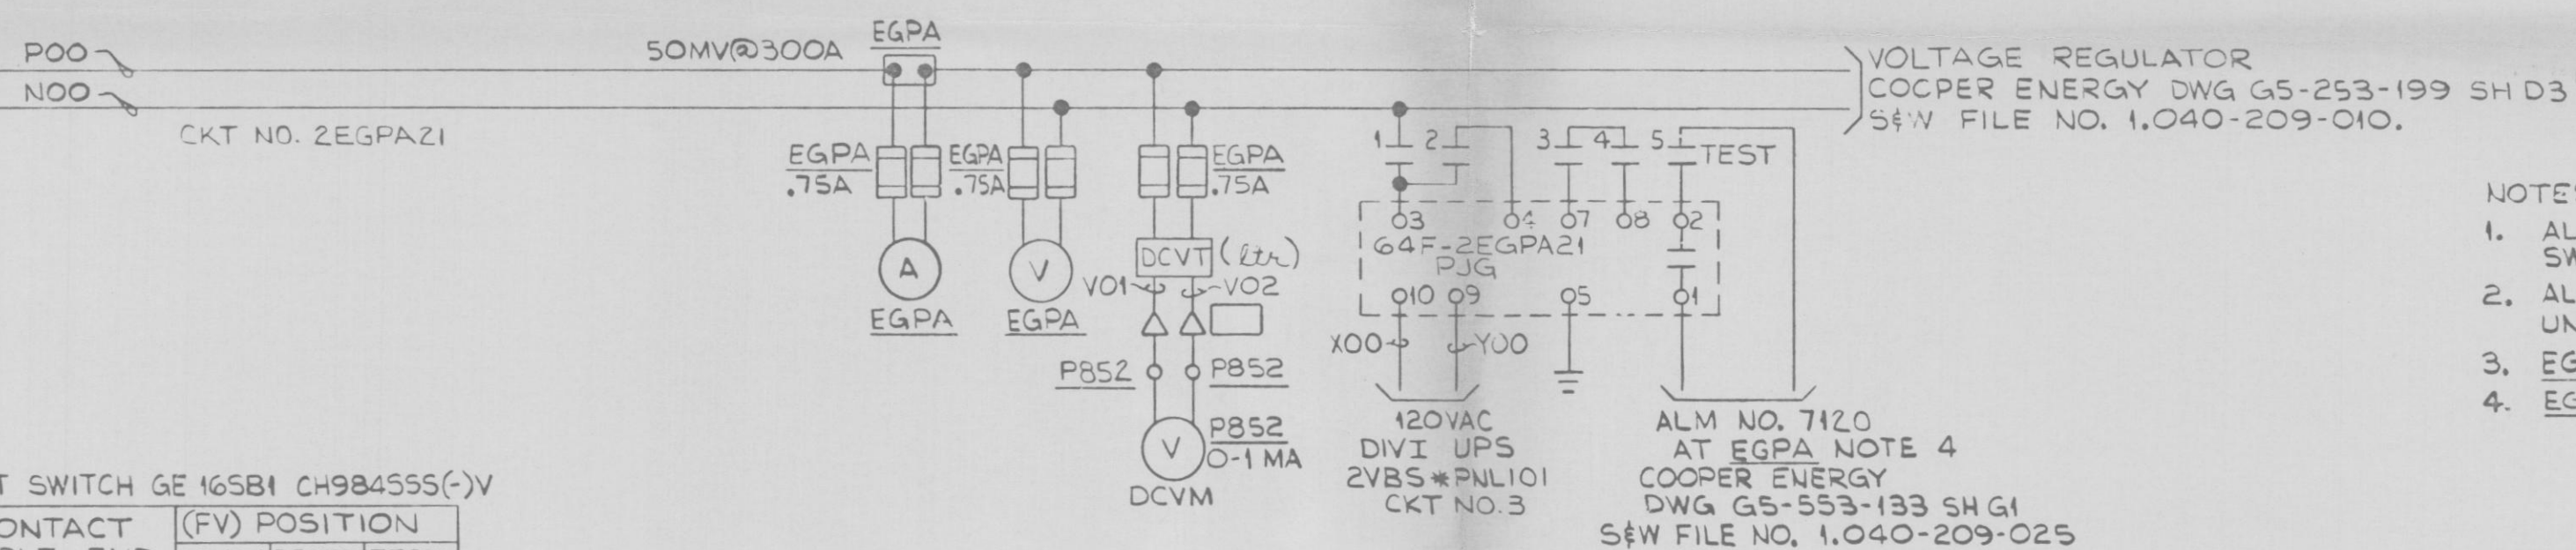

NOTES:

1. ALL EQUIPMENT LOCATED AT SWGR UNLESS OTHERWISE NOTED.
2. ALL CIRCUITS ARE GREEN UNLESS OTHERWISE NOTED.
3. EGPA: 2CEC * IPNL 407
4. EGPA: 2CEC * IPNL 406

TEST SWITCH GE 165B1 CH984555(-)V

CONTACT		(FV) POSITION	
HANDLE	END	NORM	RESET TEST
1	2	x	
3	4		x
5	6	x	
			x

X-DENOTES CONTACT CLOSED

CS AS-2EGPA02
DETAIL "E"
ESK 3A
SPARE -
USED ON TEST SW DETAIL ON THIS DWG 6

NUCLEAR SAFETY RELATED
QA CAT I

AC ELEM DIAG CURRENT CKT
DIESEL GEN 2EGS*EGI RLY & MTR
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-8EGPOI SH 2 OF 2

D