

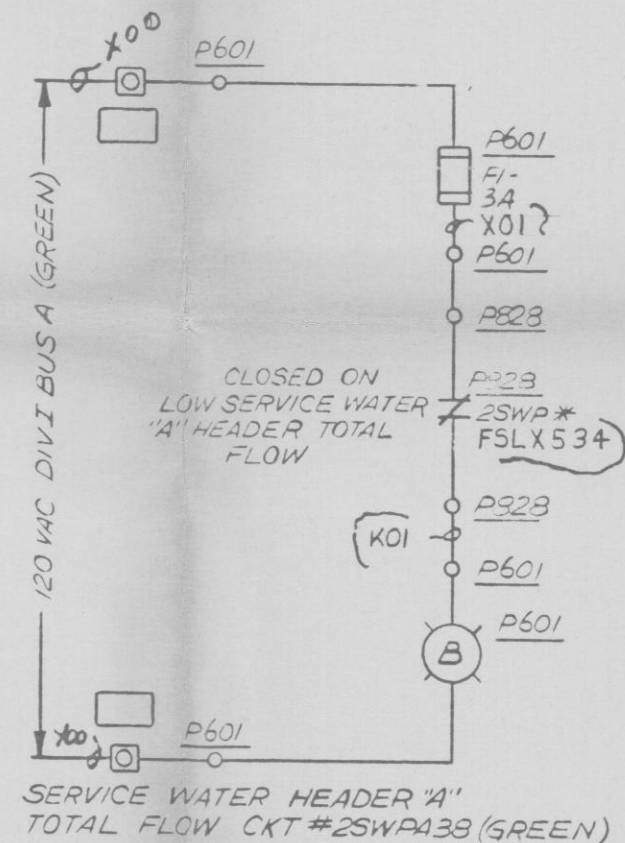


HPDS SWGR RM UNIT COOLER (2HVC*UC102) SVCE WATER VALVE 2SWP#A0V581
CKT # 2SWPN45 (PURPLE)


LIMIT SWITCH DEVELOPMENT			
		VALVE POSITION	
		FULL OPEN	FULL CLOSE
OPEN	1	A	B
	2	C	D
	3	E	F
	4	G	H
CLOSE	5	A	B
	6	C	D
	7	E	F
	8	G	H

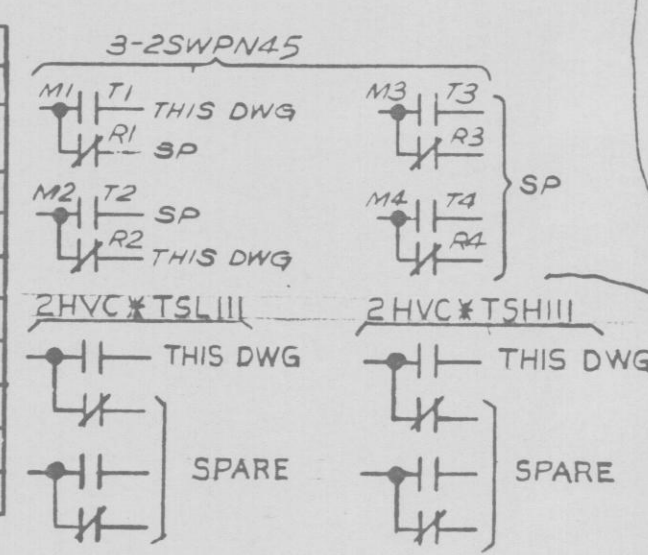

SERVICE WATER HEADER "A"
TOTAL FLOW CKT #2SWPA38 (GREEN)

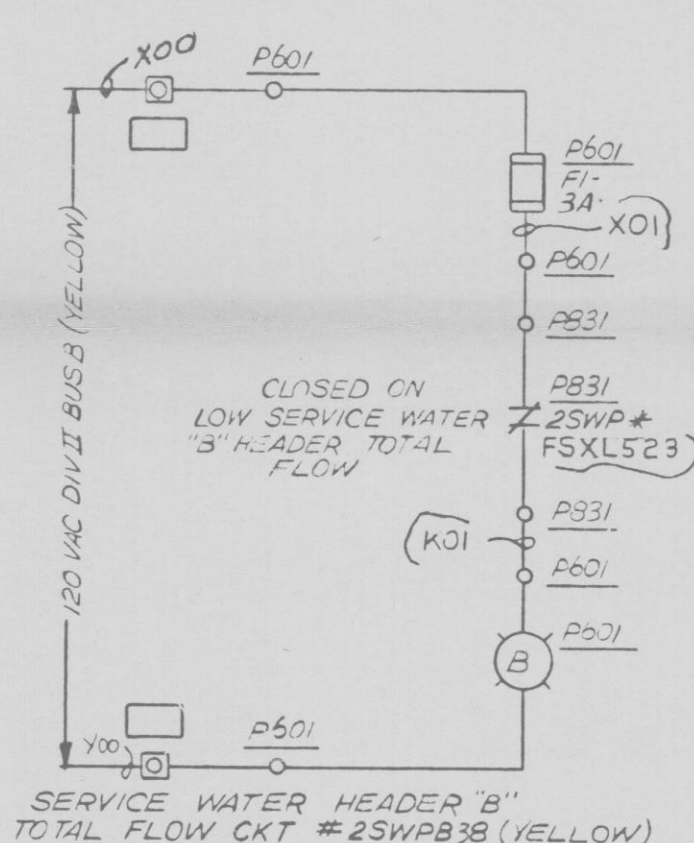

SERVICE WATER HEADER "B"
TOTAL FLOW CKT #2SWPB38 (YELLOW)

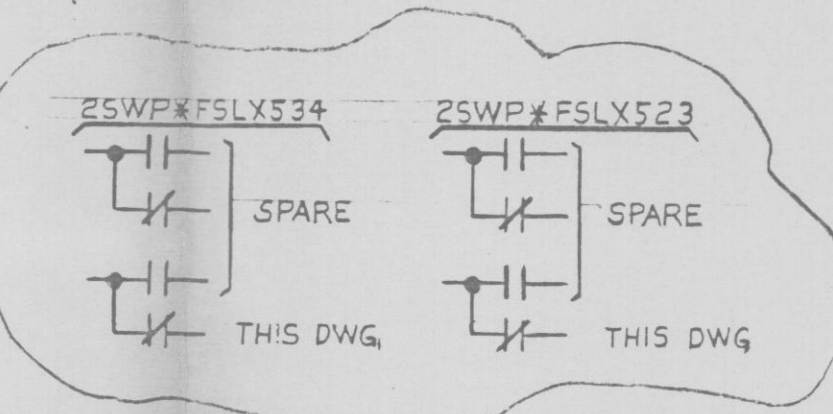

PRC
APERTURE
CARD

- NOTES:
1. O ASSOCIATED VALVE OPENS WHEN SOV IS DE-ENERGIZED.
 2. LOGIC DIAGRAM LSK-9-10

CS	DETAIL	ESK	SPARES	USED ON
1-2SWPN45	K6	38	18	

NUCLEAR SAFETY RELATED
QA CATI

AC ELEM DIAG MISC AC CKTS
SERVICE WATER MISC CKTS
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION
STONE & WADSWORTH ENGINEERING CORPORATION

12177-ESK-7SWPI8

6	5	4	3	2	1

GE MED V GE LSTG