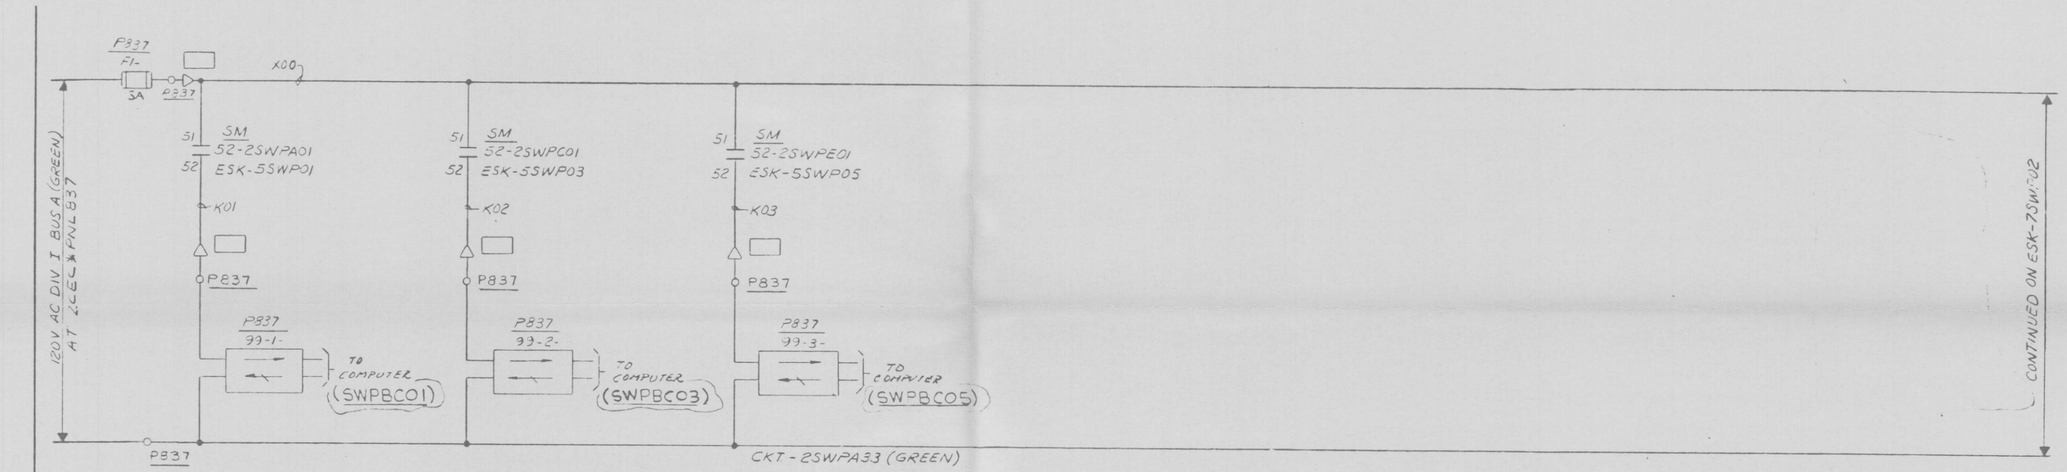

PRC APERTURE CARD

NOTES:
1. ALL EQUIPMENT LOCATED AT PGCC UNLESS OTHERWISE NOTED
2. LOGIC DIAGRAM LSK-9-10-

GE-NED V GE-LSTG

NUCLEAR SAFETY RELATED
QA CAT I

				AC ELEM DIAG-MISC AC CKT
				SERVICE WATER ALARMS
				NINE MILE POINT NUCLEAR STATION-UNIT 2
				NIAGARA MOHAWK POWER CORPORATION
				STONE & WEBSTER ENGINEERING CORPORATION
7	6	5	4	12177-ESK-7SWP11

	DESIGN CONTROL ISSUE	REV PGCC	PGCC
M 3	3/4/81	M 2 6-29-77	M 1 1-31-77

RK

D