


CONTINUED BELOW

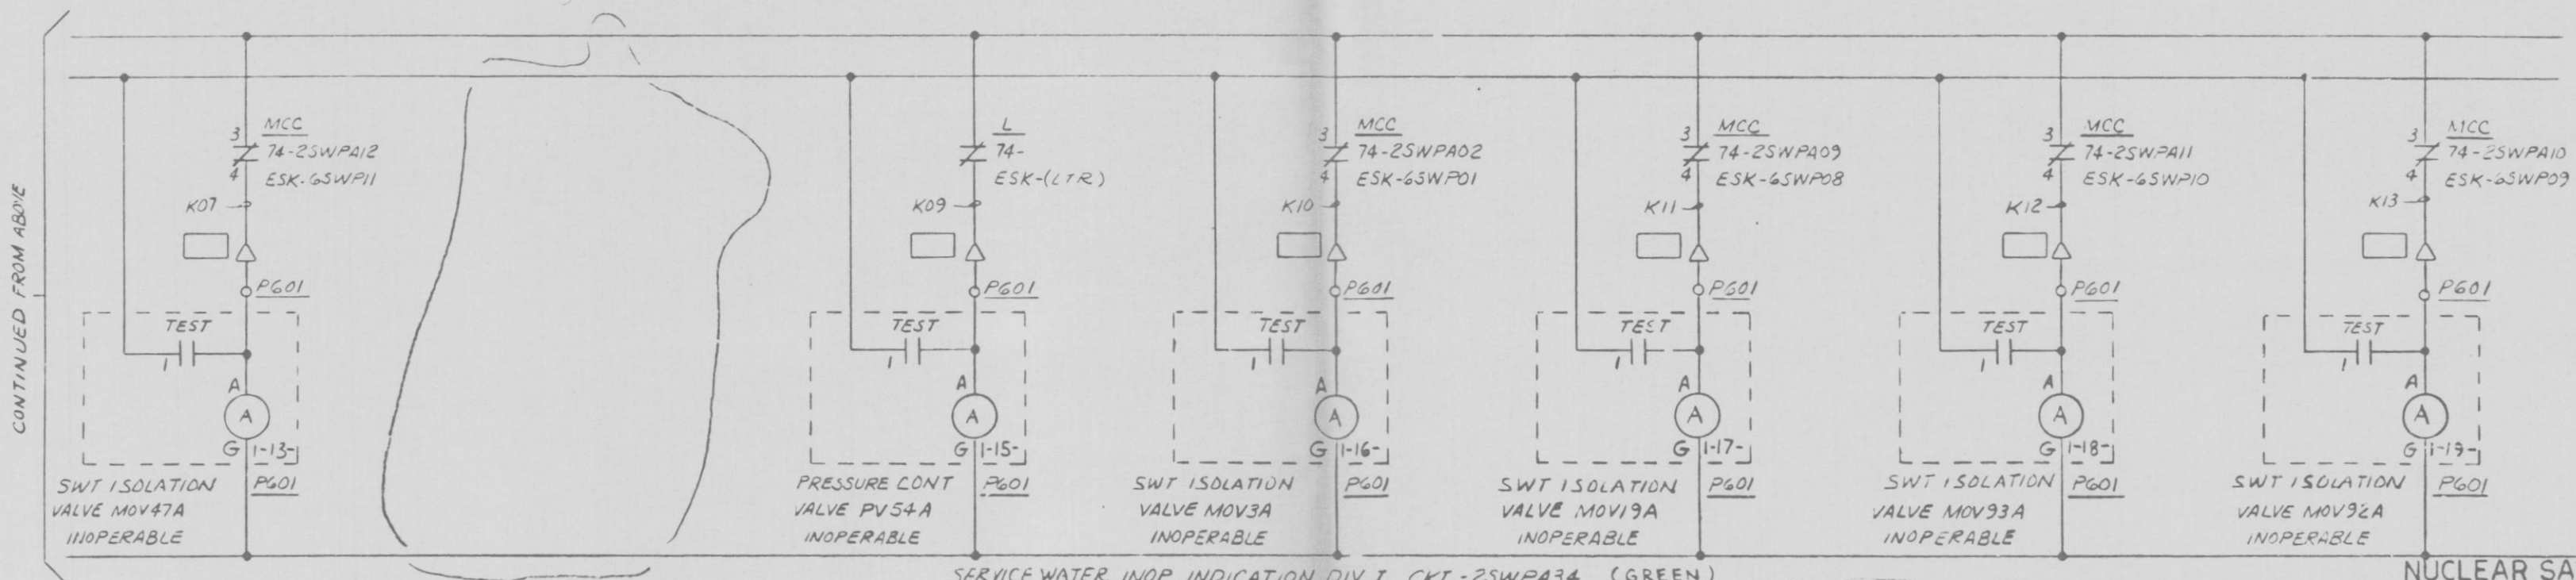

CONTINUED ON ESK-7SWP19

PRC APERTURE CARD

SERVICE WATER INOP INDICATION DIV I CKT - 2SWPA34 (GREEN)

NOTES:
1. LOGIC DIAG 9-10N

NUCLEAR SAFETY RELATED
QA CAT I

AC ELEM DIAG MISC AC CKT
SWT INOP INDICATION DIV I
NINE MILE POINT NUCLEAR STATION UNIT 2
NIAGARA MOHAWK POWER CORPORATION

STON & WEBSTER ENGINEERING CORPORATION
12177-ESK-7SWP06

CS	DETAIL	ESK	SPARES	USED ON
1-6-2SWPA34 THROUGH 1-19-2SWPA34	MN	3E	2	

DESIGN CONTROL ISSUE	REV	PGCC	PGCC
1	3/1/81	1	1-31-77
2	2-4-78	2	
3	4-8-77	3	
4	1-31-77	4	

GE-NEED
GE-1516

D