



RCIC TURBINE STEAM LEAD  
 BYPASS VALVE 2ICS\*MOV170(ESI-F076)  
 VALVE NORMALLY CLOSED, OPEN  
 FOR SYSTEM START-UP

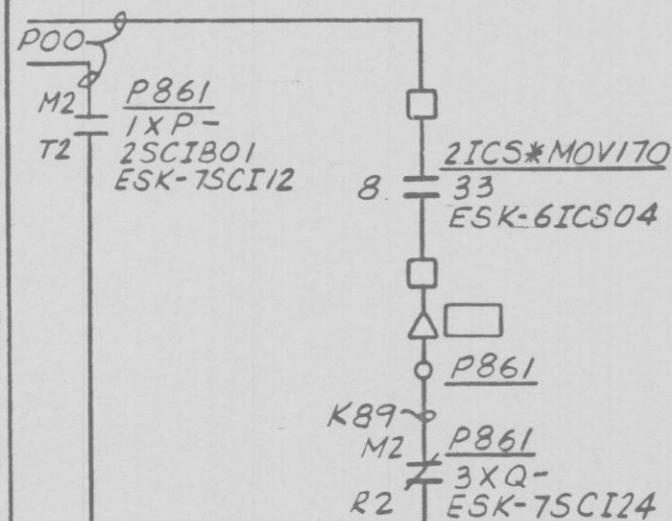

CONTAINMENT ISOLATION VALVE OFF-  
 NORMAL STATUS DISPLAY CKT NO. 2SCI802 (YELLOW)

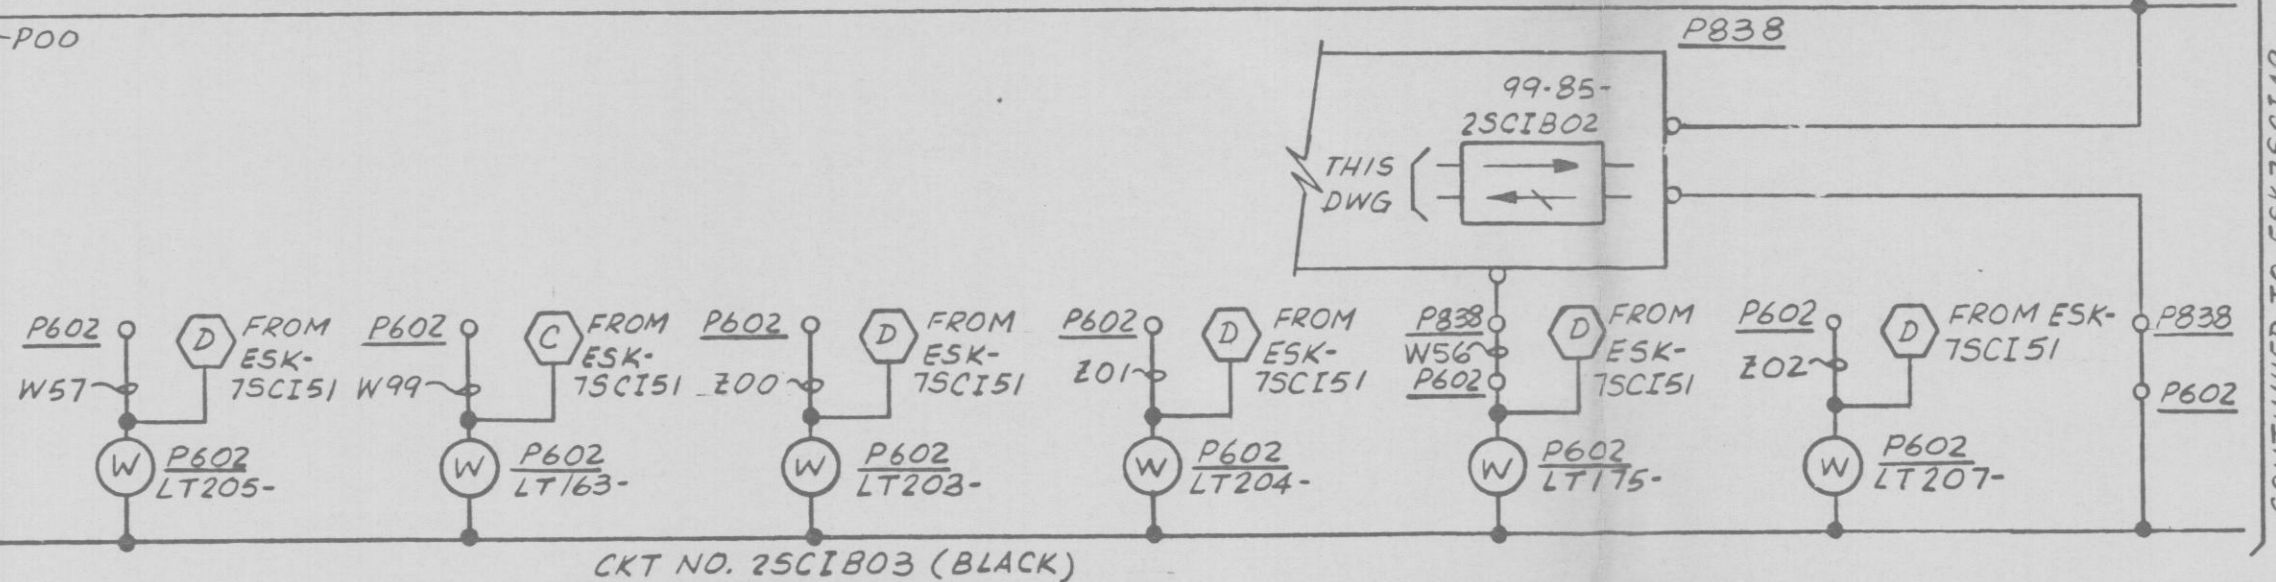

PRC  
 APERTURE  
 CARD

NOTES:  
 1. □ - INDICATES DRYWELL PENETRATION

NUCLER SAFETY RELATED  
 QA CAT I, II

DC ELEM DIAG-MISC DC CTS  
 OFF-NORMAL STATUS DISPLAY  
 NINE MILE POINT NUCLEAR STATION-UNIT 2,  
 NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-7SCI44

7	6	5	4	3	2	1
---	---	---	---	---	---	---

DM

1010 4